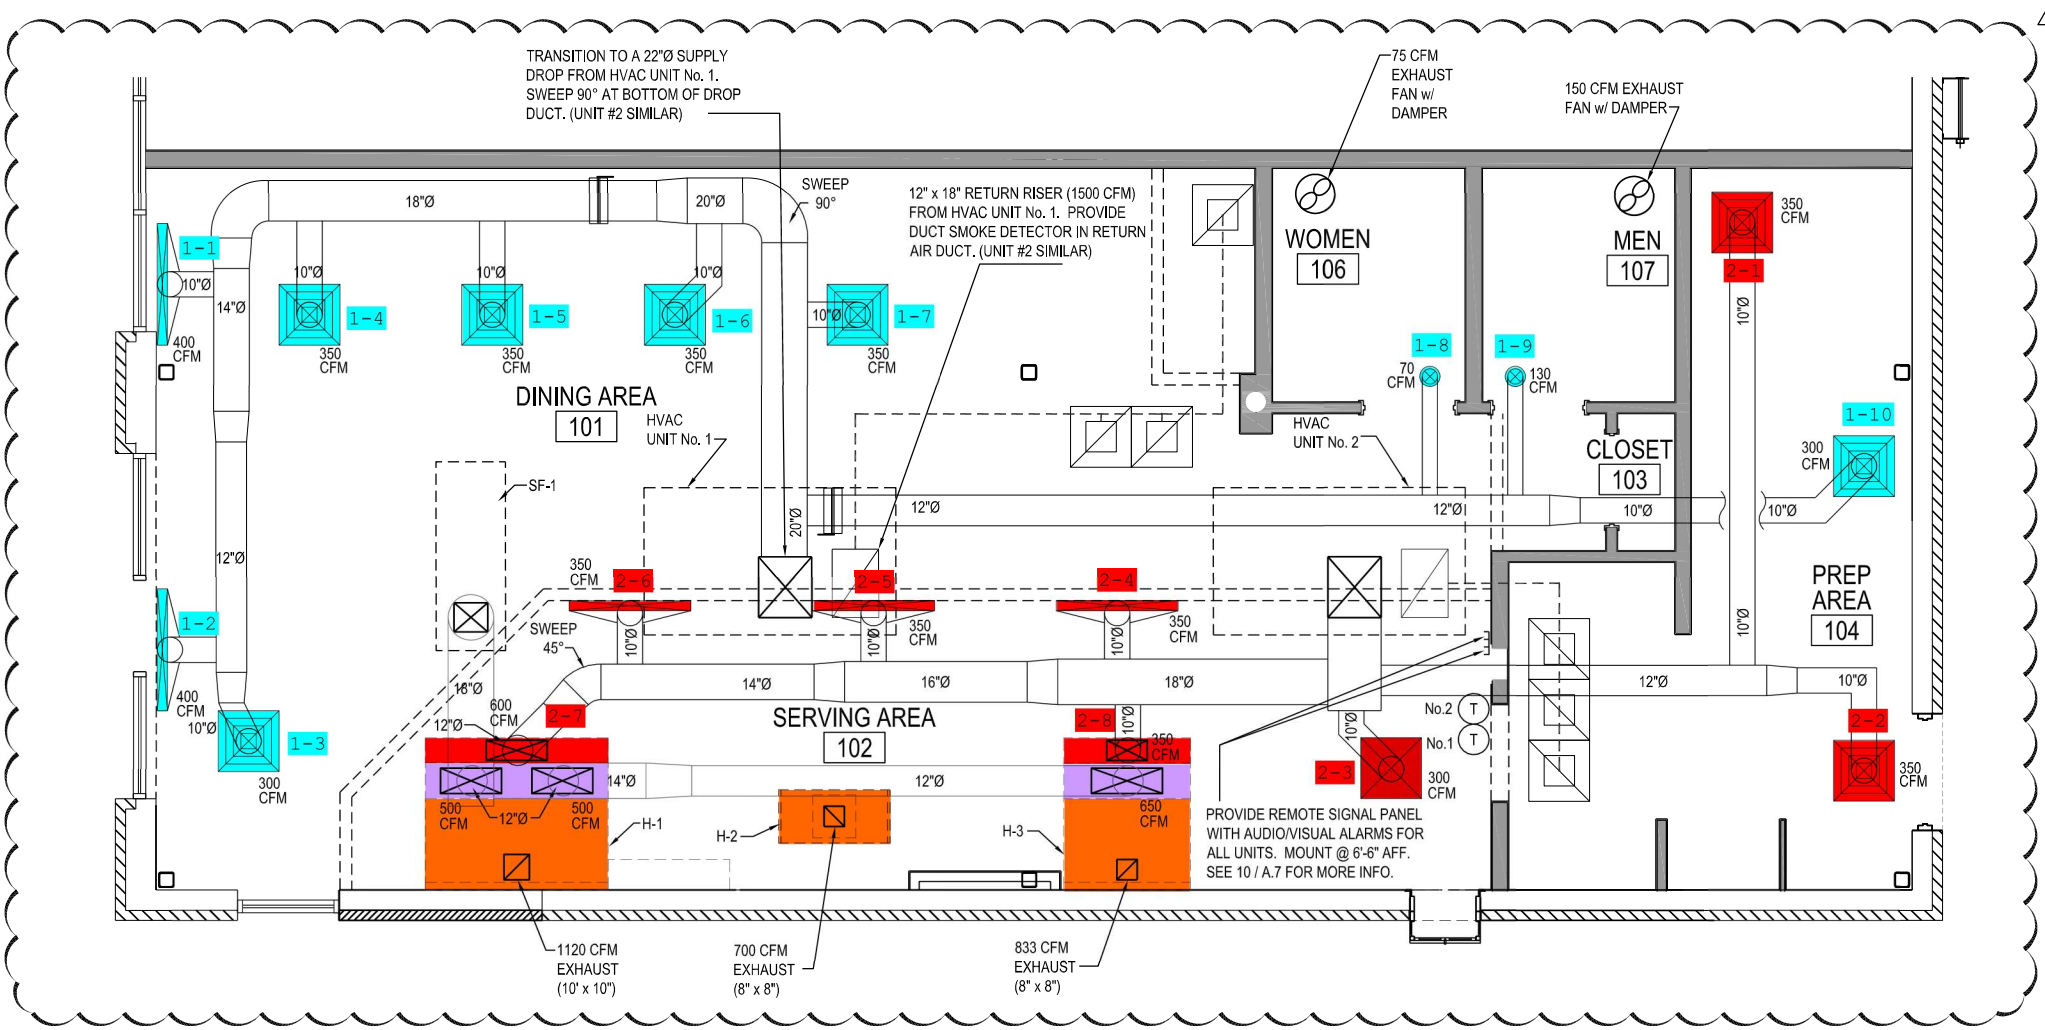
1
TRANSITION TO A 22"Ø SUPPLY DROP FROM HVAC UNIT No. 1. SWEEP 90° AT BOTTOM OF DROP DUCT. (UNIT #2 SIMILAR)
75 CFM EXHAUST FAN w/ DAMPER
150 CFM EXHAUST FAN w/ DAMPER
SWEEP 90°
12" x 18" RETURN RISER (1500 CFM) FROM HVAC UNIT No. 1. PROVIDE DUCT SMOKE DETECTOR IN RETURN AIR DUCT. (UNIT #2 SIMILAR)
WOMEN
106
MEN
107
CLOSET
103
PREP AREA
104
DINING AREA
101
SERVING AREA
102
HVAC UNIT No. 1
HVAC UNIT No. 2
SF-1
SWEEP 45°
1-1
1-2
1-3
1-4
1-5
1-6
1-7
1-8
1-9
1-10
2-1
2-2
2-3
2-4
2-5
2-6
2-7
2-8
400 CFM
350 CFM
300 CFM
70 CFM
130 CFM
600 CFM
500 CFM
650 CFM
H-1
H-2
H-3
No.2
No.1
PROVIDE REMOTE SIGNAL PANEL WITH AUDIO/VISUAL ALARMS FOR ALL UNITS. MOUNT @ 6'-6" AFF. SEE 10 / A.7 FOR MORE INFO.
1120 CFM EXHAUST (10' x 10")
700 CFM EXHAUST (8" x 8")
833 CFM EXHAUST (8" x 8")