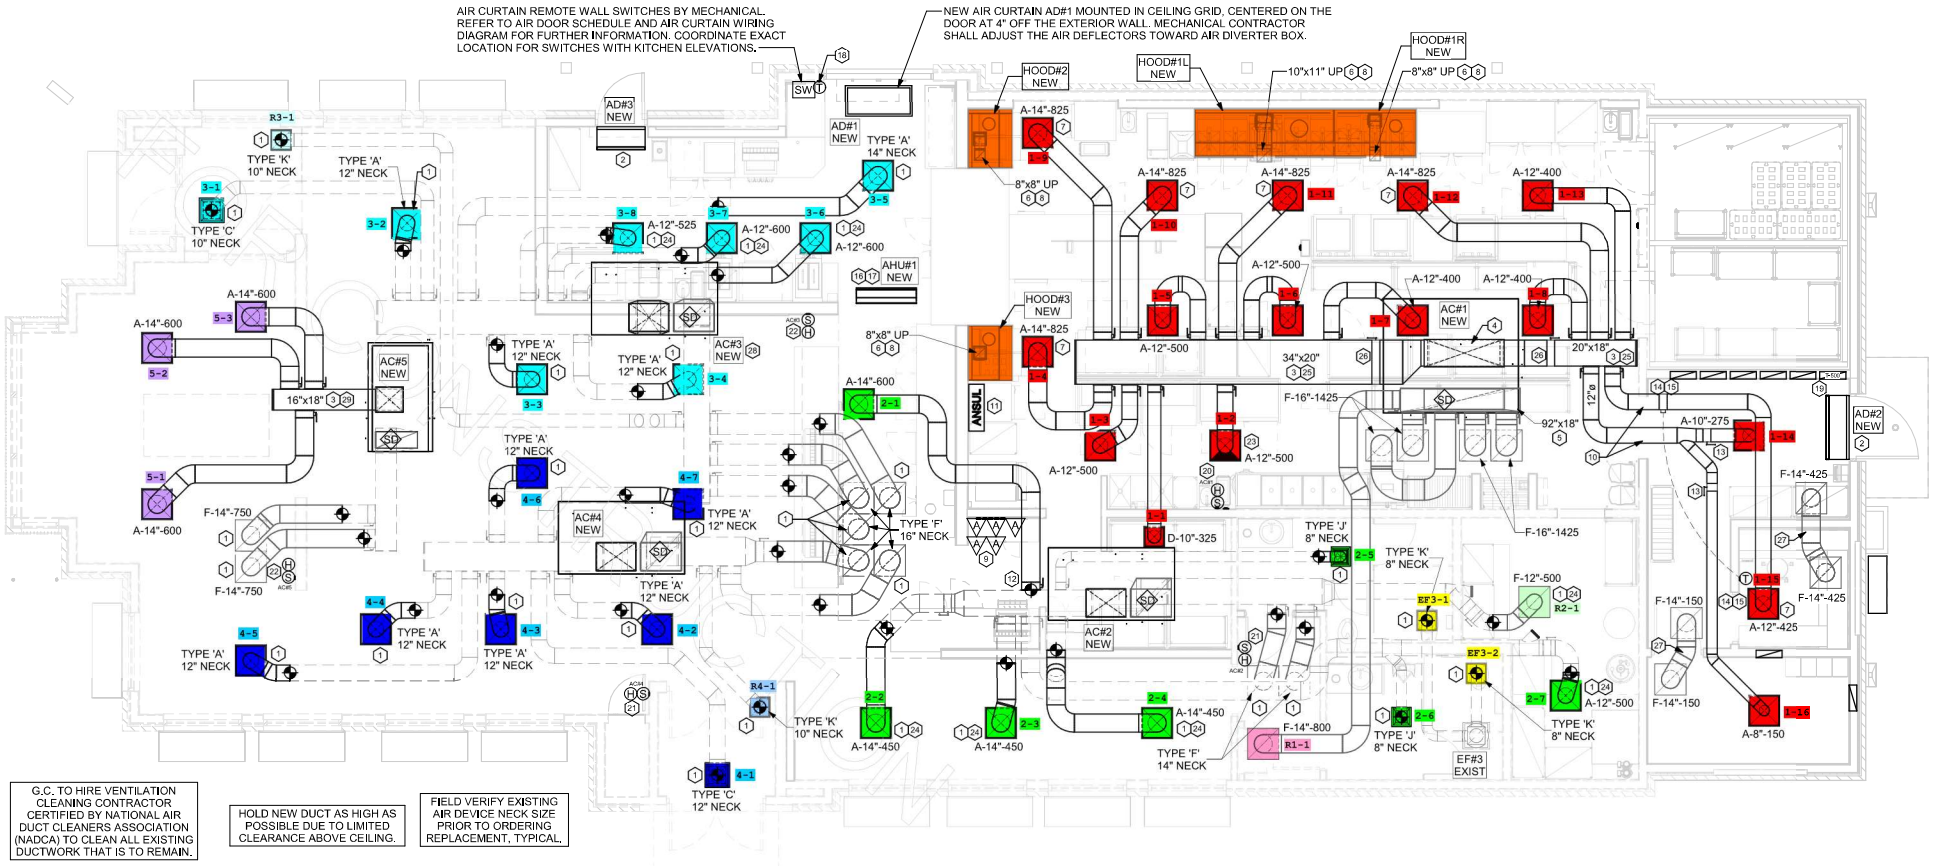
AIR CURTAIN REMOTE WALL SWITCHES BY MECHANICAL. REFER TO AIR DOOR SCHEDULE AND AIR CURTAIN WIRING DIAGRAM FOR FURTHER INFORMATION. COORDINATE EXACT LOCATION FOR SWITCHES WITH KITCHEN ELEVATIONS.
NEW AIR CURTAIN AD#1 MOUNTED IN CEILING GRID, CENTERED ON THE DOOR AT 4" OFF THE EXTERIOR WALL. MECHANICAL CONTRACTOR SHALL ADJUST THE AIR DEFLECTORS TOWARD AIR DIVERTER BOX.
HOOD#1R NEW
HOOD#1L NEW
HOOD#2 NEW
HOOD#3 NEW
10"x11" UP
8"x8" UP
AD#3 NEW
AD#1 NEW
AD#2 NEW
AHU#1 NEW
AC#1 NEW
AC#2 NEW
AC#3 NEW
AC#4 NEW
AC#5 NEW
TYPE 'K' 10" NECK
TYPE 'A' 12" NECK
TYPE 'A' 14" NECK
TYPE 'C' 10" NECK
TYPE 'C' 12" NECK
TYPE 'F' 16" NECK
TYPE 'F' 14" NECK
TYPE 'J' 8" NECK
TYPE 'K' 8" NECK
A-14"-825
A-14"-600
A-14"-450
A-12"-525
A-12"-600
A-12"-500
A-12"-400
A-12"-425
A-10"-275
A-8"-150
F-14"-750
F-14"-425
F-14"-150
F-16"-1425
F-12"-500
F-14"-800
D-10"-325
16"x18"
34"x20"
20"x18"
92"x18"
12"ø
EF3-1
EF3-2
EF#3 EXIST
SW
SD
G.C. TO HIRE VENTILATION CLEANING CONTRACTOR CERTIFIED BY NATIONAL AIR DUCT CLEANERS ASSOCIATION (NADCA) TO CLEAN ALL EXISTING DUCTWORK THAT IS TO REMAIN.
HOLD NEW DUCT AS HIGH AS POSSIBLE DUE TO LIMITED CLEARANCE ABOVE CEILING.
FIELD VERIFY EXISTING AIR DEVICE NECK SIZE PRIOR TO ORDERING REPLACEMENT, TYPICAL.