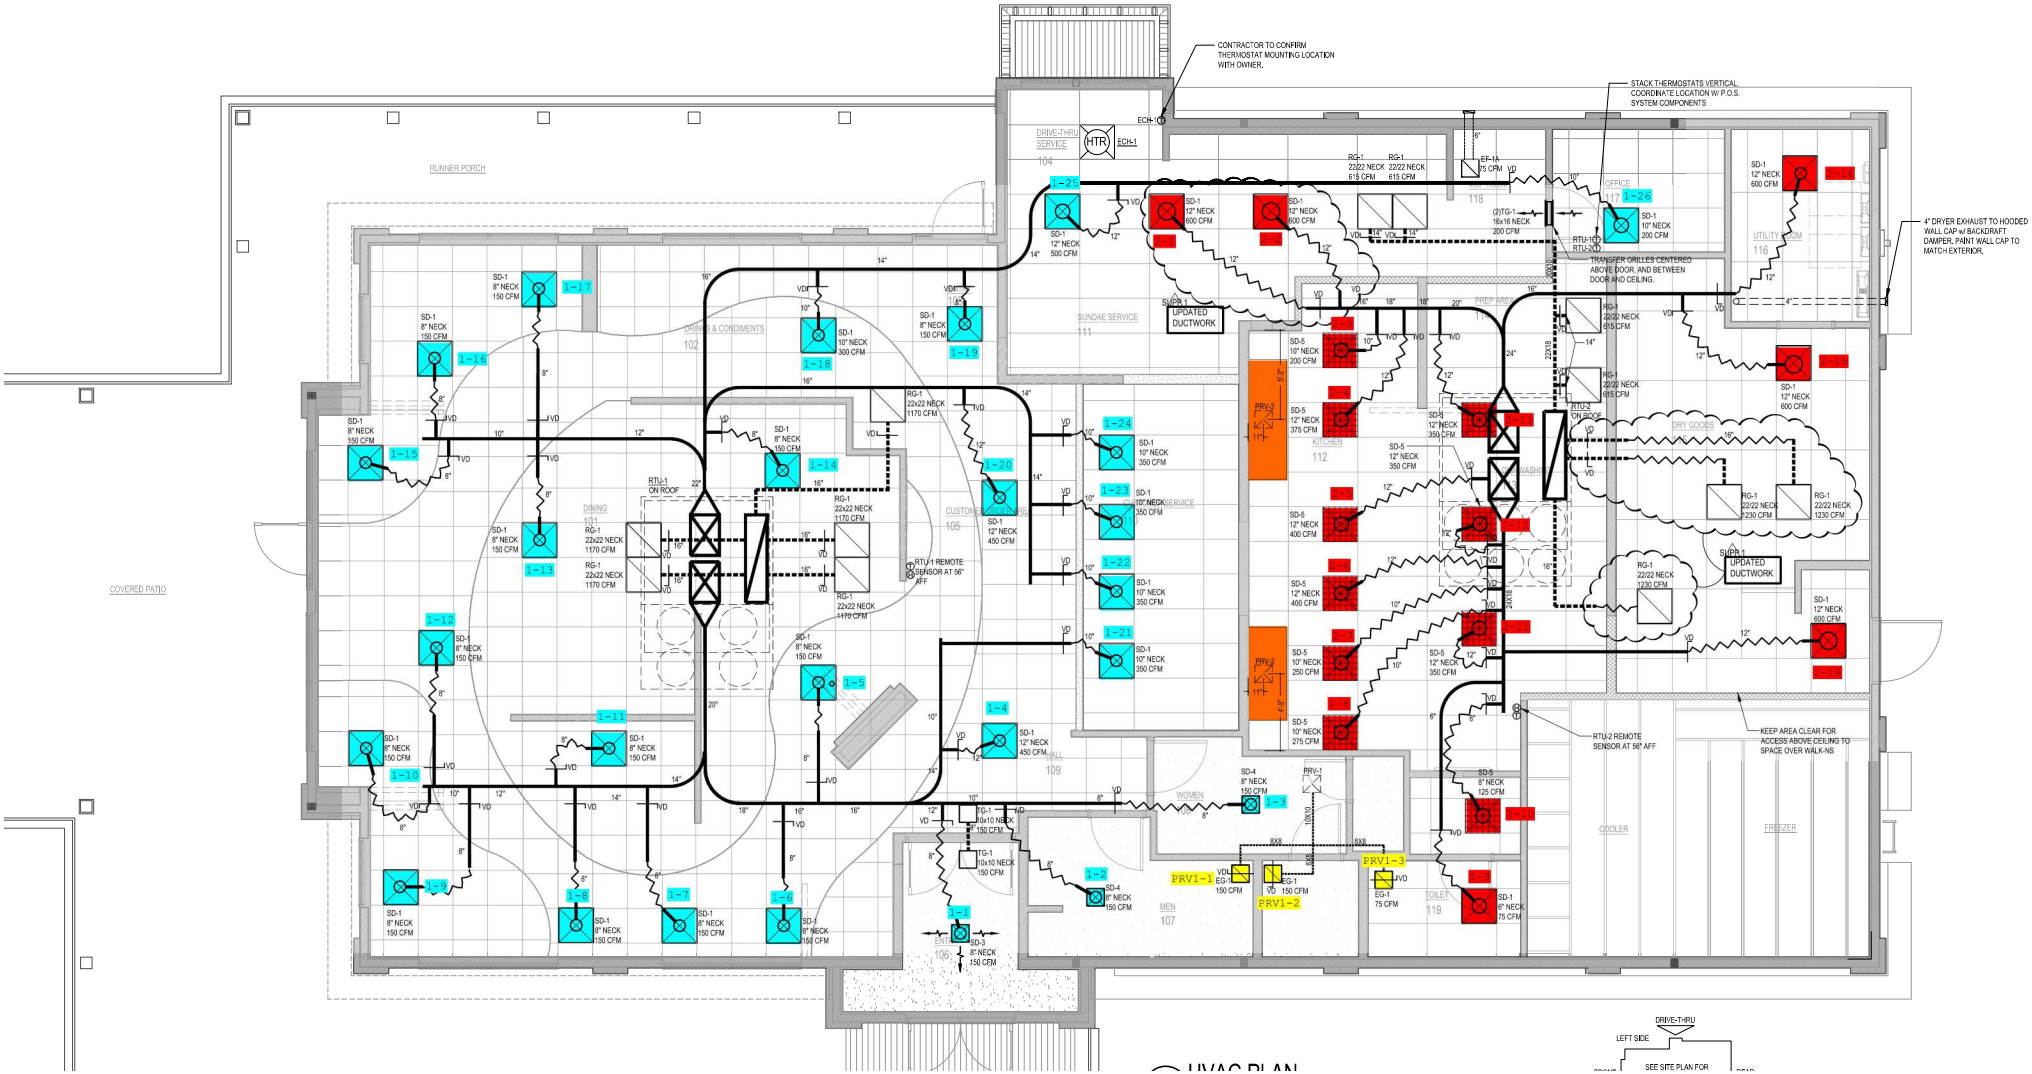
CONTRACTOR TO CONFIRM THERMOSTAT MOUNTING LOCATION WITH OWNER.
STACK THERMOSTATS VERTICAL. COORDINATE LOCATION W/ P.O.S. SYSTEM COMPONENTS
4" DRYER EXHAUST TO HOODED WALL CAP w/ BACKDRAFT DAMPER. PAINT WALL CAP TO MATCH EXTERIOR.
TRANSFER GRILLES CENTERED ABOVE DOOR, AND BETWEEN DOOR AND CEILING.
RTU-2 REMOTE SENSOR AT 56" AFF
KEEP AREA CLEAR FOR ACCESS ABOVE CEILING TO SPACE OVER WALK-INS
RTU-1 REMOTE SENSOR AT 56" AFF
RUNNER PORCH
COVERED PATIO
DRIVE-THRU SERVICE 104
DRIVE & CONDIMENTS 102
DINING 101
SUNDAE SERVICE 111
CUSTOMER CONVENIENCE 105
KITCHEN 112
PREP AREA
OFFICE 117
UTILITY ROOM 116
DRY GOODS
HALL 109
WOMEN 108
MEN 107
TOILET 119
COOLER
FREEZER
ENT 106
SUPR-1 UPDATED DUCTWORK
RTU-1 ON ROOF
RTU-2 ON ROOF
HTR
ECH-1
PRV1-1
PRV1-2
PRV1-3
DRIVE-THRU
LEFT SIDE
SEE SITE PLAN FOR

HVAC PLAN