

**KEY NOTES**

- 1 REMOVE TEST STATION FOR SMOKE DETECTORS FOR RTU-1, 2, & 3. TEST STATION TO BE MOUNTED ON THE MANAGER'S OFFICE WALL. SECURITY CONTRACTOR SHALL WIRE RTU FACTORY MOUNTED SMOKE DETECTORS TO SECURITY/FIRE ALARM PANEL. MECHANICAL CONTRACTOR SHALL PROVIDE TEST STATION AND WIRING BETWEEN COMPONENTS AS WELL AS WIRING TO SHUT DOWN THE A/C FAN UPON ACTIVATION OF THE SMOKE DETECTOR. G.C. TO TEST THE SMOKE DETECTOR FUNCTIONS WITH THE WAWA PROJECT MANAGER.
- 2 TRANSFER AIR DUCT ASSEMBLY.
- 3 PROVIDE SEALED 20" X 20" PLENUM BOX ASSEMBLY ABOVE TRANSFER GRILLE TO ALLOW FLEX TRANSFER DUCT CONNECTIONS. PAINT INTERIOR PLENUM FLAT BLACK.
- 4 WALL MOUNTED SENSOR(S) FOR EACH MECHANICAL UNIT PER ROOFTOP UNIT SCHEDULE. G.C. SHALL INSTALL AND WIRE TO UNIT. BAS CONTRACTOR SHALL CONNECT TO MECHANICAL UNIT ONLY.
- 5 WALL MOUNTED CO2 SENSOR AND WIRE TO RTU-1. SENSOR TO MONITOR CO2 LEVELS THROUGH REMOTE BAS INTERFACE.
- 6 ROUTE DUCT THROUGH ANGLED WEB MEMBER AND SUPPORT AT PANEL POINT.
- 7 DUCTWORK TO RUN WITHIN JOIST SPACING. MECHANICAL CONTRACTOR TO COORDINATE MECHANICAL WORK WITH ALL TRADES PRIOR TO INSTALLATION.
- 8 ROUTE DUCT THRU OPEN WEBBING OF JOIST GIRDER.
- 9 CONNECT TO BOTTOM OF DUCT WITH VOLUME DAMPER.
- 10 HEATER SHALL BE A MINIMUM OF 12" AWAY FROM ANY WALL. INSTALL HEATER IN STRICT ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTRUCTIONS.
- 11 NOT USED
- 12 EXHAUST DUCT UP TO ROOF MOUNTED EXHAUST FAN. SEE ROOF PLAN FOR CONTINUATION.
- 13 NOT USED
- 14 NOT USED
- 15 EMERGENCY SHUTOFF SWITCH AND WALL PLACARD INDICATING VENTILATION SYSTEM EMERGENCY SHUTOFF PROVIDED BY OTHERS. REFERENCE ELECTRICAL AND ARCHITECTURAL DRAWINGS.
- 16 NOT USED
- 17 RETURN DUCT PLENUM UP TO RTU FULL SIZE OF UNIT CONNECTION.
- 18 SUPPLY DUCT PLENUM DOWN FROM RTU FULL SIZE OF UNIT CONNECTION.
- 19 COORDINATE INSTALLATION OF MECHANICAL SENSORS IN CURBSTONE WALL WITH DETAIL ON ARCHITECTURAL PLANS.

**PERMITTING NOTE:**

ALL REFRIGERATION EQUIPMENT INCLUDING WALK-IN COOLERS AND REFRIGERATORS WILL BE SUBMITTED UNDER A SEPARATE PERMIT.

**SHEET GENERAL NOTES:**

- A. MECHANICAL CONTRACTOR SHALL ADJUST ALL LINEAR SLOT DIFFUSERS TO A GENERALLY VERTICAL FLOW. ADJUSTMENT SHALL BE MADE SO AS TO AVOID AIRFLOWS ON SENSORS, REFRIGERATION CASES, OR OPEN FOOD REFRIGERATION EQUIPMENT.
- B. IN ADDITION TO SPECIFICATIONS REQUIREMENTS FOR TESTING AND BALANCING, SUBMIT TESTING AND BALANCING REPORT WITH FLOOR PLAN INDICATING LOCATION OF INLETS AND OUTLETS WITH TAGS THAT MATCH THE TESTING AND BALANCING REPORT.
- C. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL VOLUME DAMPERS IN LOCATIONS ACCESSIBLE TO ALLOW FOR BALANCING.

1 HVAC FLOOR PLAN  
M1.0 1/4" = 1'-0"

**AECOM**  
AECOM Technical Services, Inc.  
300 BROADACRES DRIVE, SUITE 250  
BLOOMFIELD, NJ 07003  
973.883.8500 FAX 973.883.8601  
http://www.aecom.com

CLIENT NAME  
**WAWA INC.**  
260 W. BALTIMORE PIKE  
WAWA, PA 19083


PROJECT NAME  
W50 FB VA V2024.04  
**WAWA STORE #8681**  
8878 SEMINOLE TRAIL  
RUCKERSVILLE, VA 22968

SHEET TITLE  
**HVAC FLOOR PLAN**

RELEASE	DATE
ISSUED FOR PERMIT	12/06/2023
REV A - ISSUED FOR CONSTRUCTION	09/11/2024
REV B - ISSUED FOR CONSTRUCTION	02/07/2025
REV E - UTILITIES UPDATE	09/08/2025

PROTOTYPE	DATE	PROJECT NO.	DRAWN	CHECKED
W50 FB VA V2024.04		6069813-8681	RK	FA

**8681**  
RUCKERSVILLE, VA  
**Wawa**  
**M1.0**

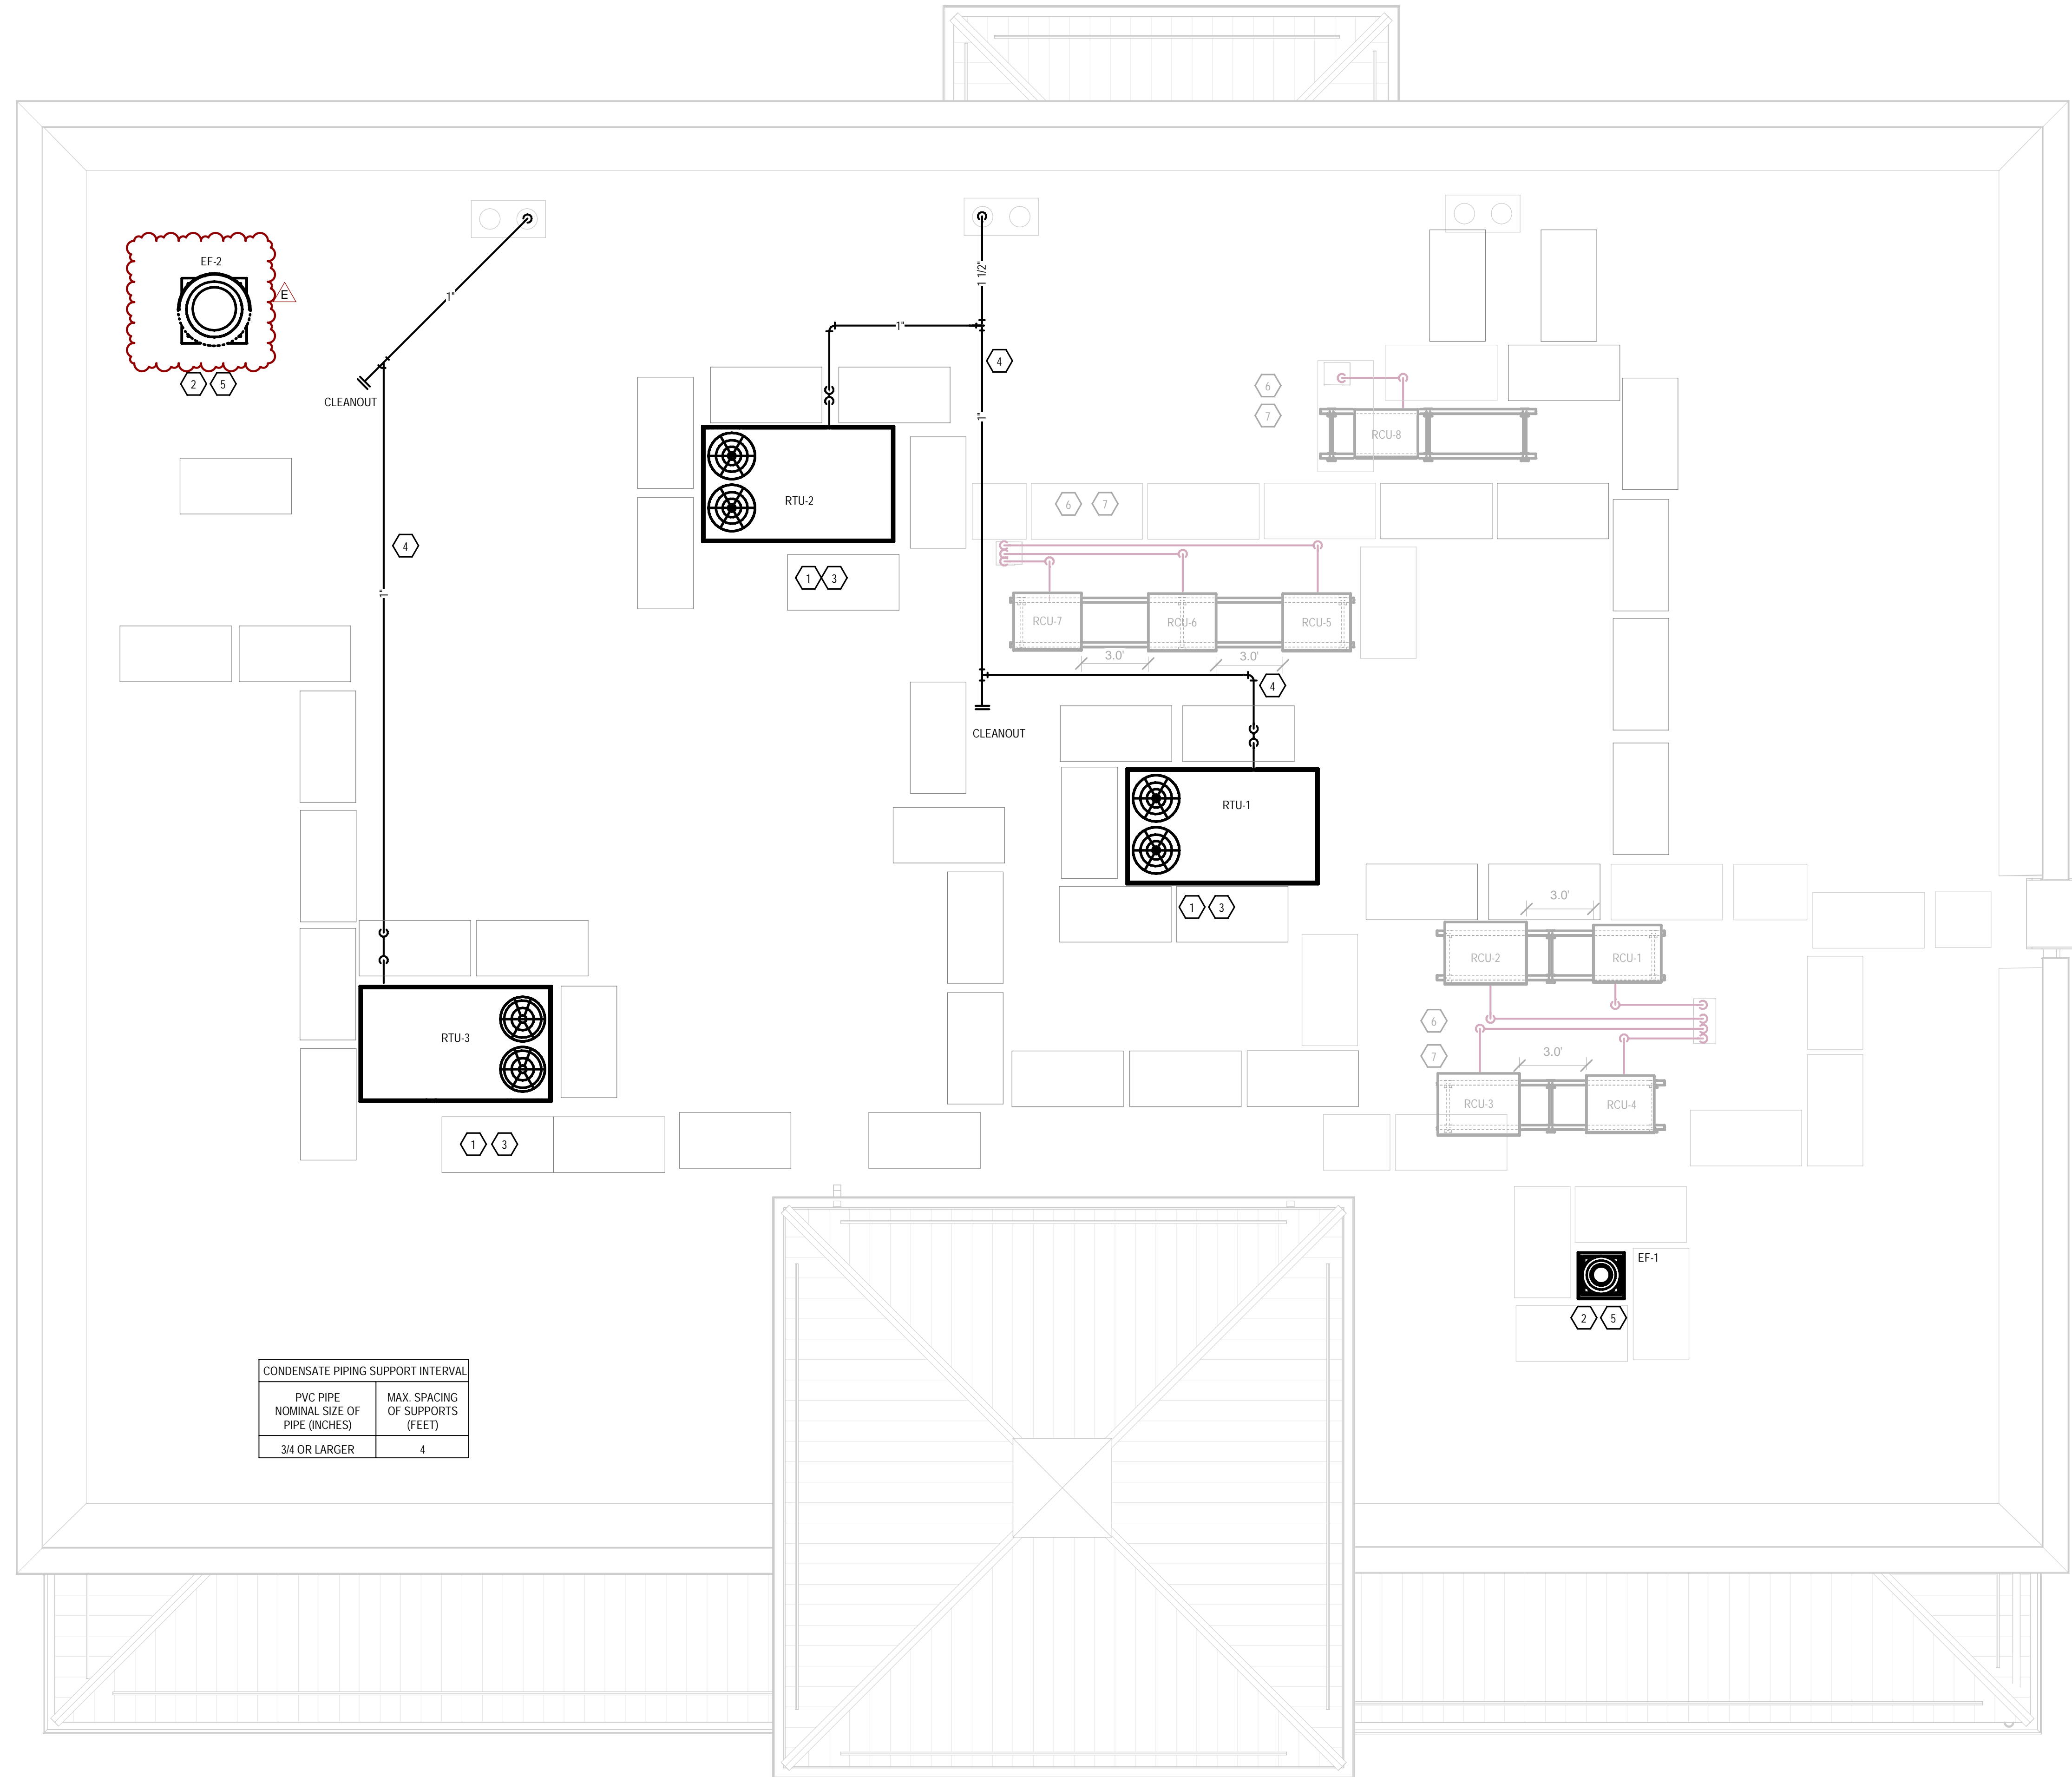

CONDENSATE PIPING SUPPORT INTERVAL		
PVC PIPE NOMINAL SIZE OF PIPE (INCHES)	MAX. SPACING OF SUPPORTS (FEET)	
3/4 OR LARGER	4	


**SHEET NOTES**

- 1 FACTORY INSTALLED SMOKE DETECTOR IN MAIN SUPPLY AND RETURN OF EACH ROOF TOP UNIT.
- 2 INSTALL ROOF MOUNTED EXHAUST FAN PER DETAIL ON SHEET M3.0. COORDINATE EXACT LOCATION OF FAN PENETRATION WITH ARCHITECTURAL ROOF PLAN. TRANSITION GALVANIZED DUCT WORK AS NECESSARY FROM FAN INTO CEILING/JOIST SPACE. SEE SHEET M1.0 FOR CONTINUATION.
- 3 PROVIDE FLEXIBLE CONNECTIONS BETWEEN ALL DUCT WORK AND MECHANICAL UNITS.
- 4 ROUTE SCH. 40 PVC CONDENSATE DRAIN PIPING ALONG ROOF TO STORM DRAIN. SUPPORT PIPING PER DETAIL ON SHEET M3.0.
- 5 MAINTAIN A MINIMUM 10" CLEARANCE BETWEEN OUTSIDE AIR INTAKES AND EXHAUST TERMINATIONS ON ROOF.
- 6 REFER TO REFRIGERATION DRAWINGS FOR ADDITIONAL INFORMATION.
- 7 PROVIDE CONDENSER PANEL IN LOCATION SHOWN. LOCATION SHOULD BE FIELD COORDINATED WITH OTHER TRADES, WHENEVER IT ENCLOSES ANY EQUIPMENT'S MAINTENANCE AND OPERATIONS CLEARANCES. REFER TO STRUCTURAL DRAWINGS FOR MOUNTING PANEL ON UNISTRUT SYSTEM.


RELEASE	DATE
ISSUED FOR PERMIT	12/06/2023
REV. A - ISSUED FOR CONSTRUCTION	09/11/2024
REV. B - ISSUED FOR CONSTRUCTION	02/07/2025
REV. E - UTILITIES UPDATE	09/08/2025

PROTOTYPE	DRAWN	CHK	CHECKED
W50 FB VA V2024.04	6699812-8681	RK	FA


BUILDING LOCATION	WIND SPEED ZONE (IBC FIGURE 1609A)
RUCKERSVILLE, VA	SEE STRUCTURAL PLANS

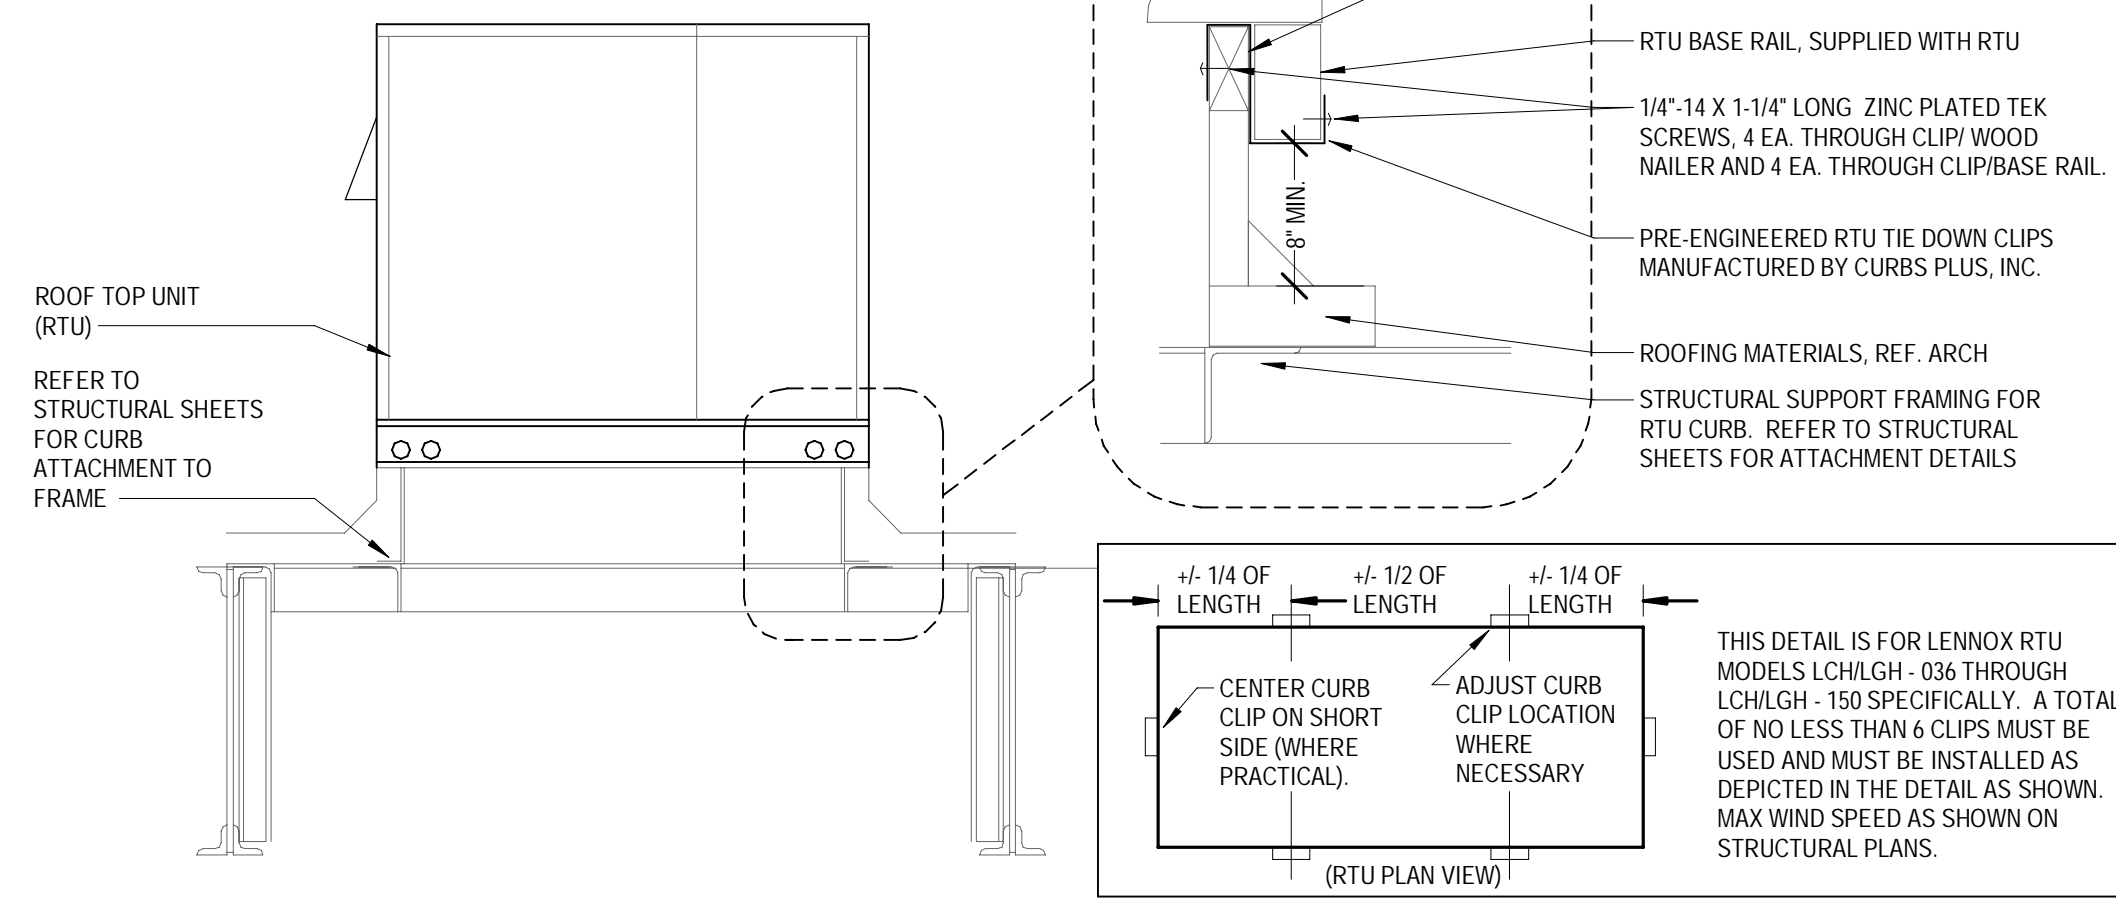


**1** HVAC RTU TIE-DOWN DETAIL  
M3.0 NOT TO SCALE

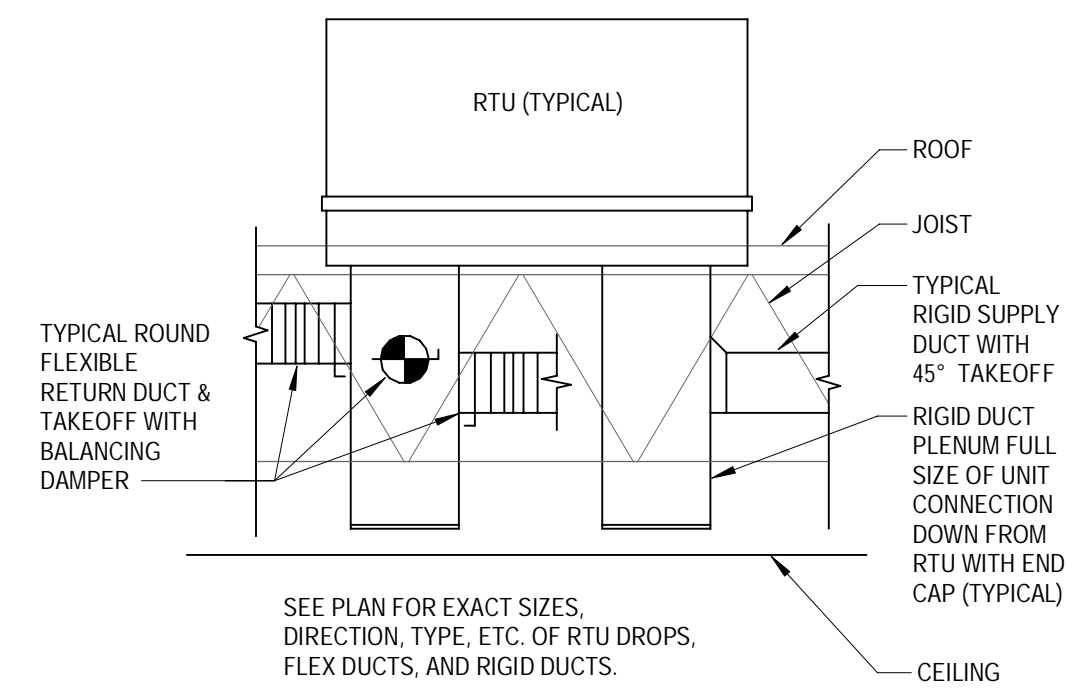


**2** TYPICAL DUCT PLENUM DETAIL  
M3.0 NOT TO SCALE

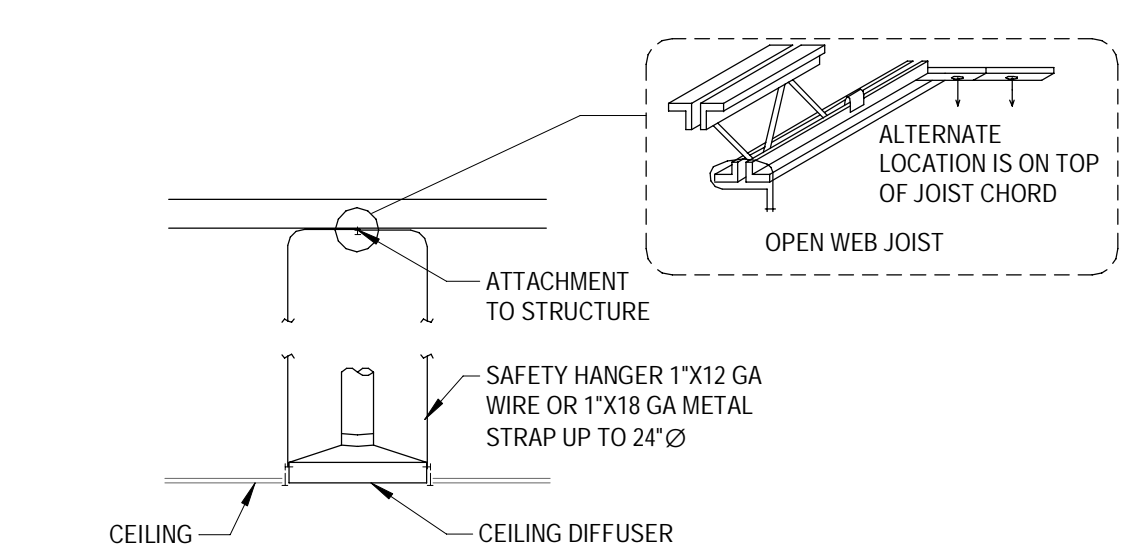


**3** HVAC CEILING MOUNTED AIR DIFFUSER SUPPORT DETAIL  
M3.0 NOT TO SCALE

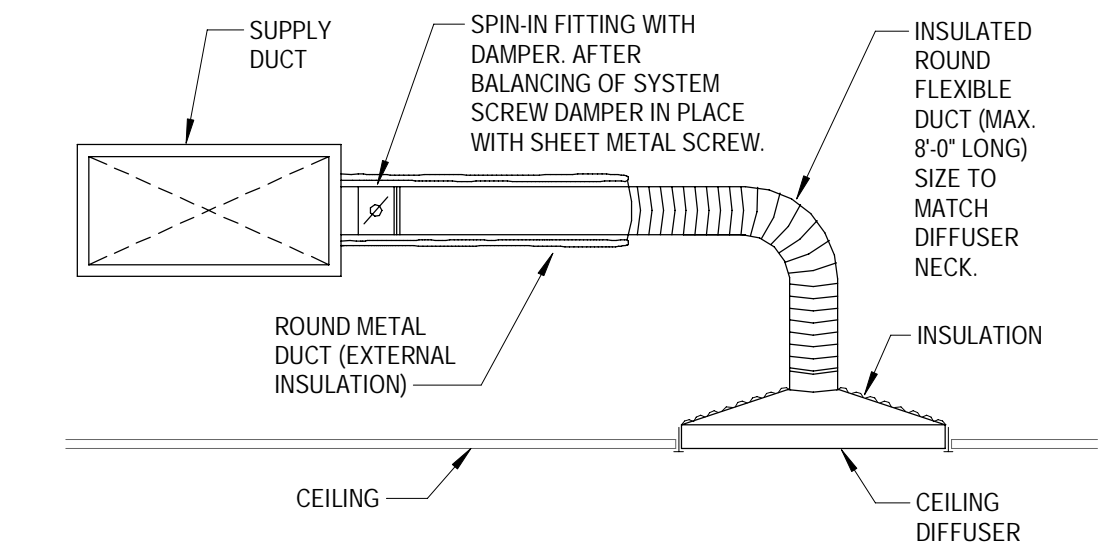


**4** HVAC CEILING DIFFUSER RUNOUT DETAIL  
M3.0 NOT TO SCALE

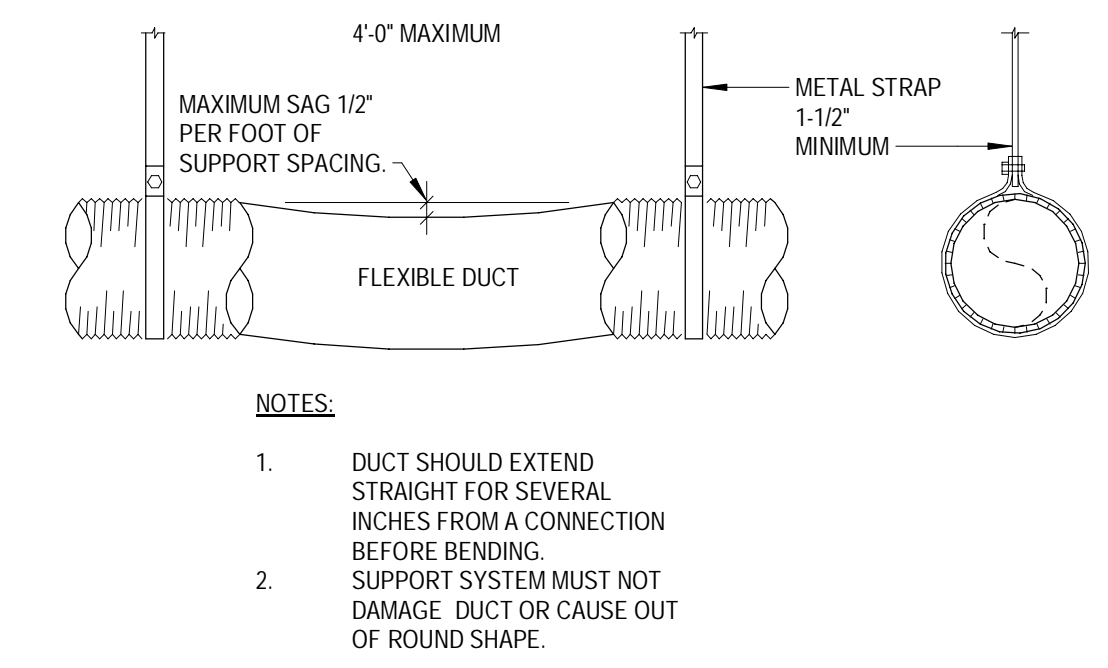


**5** HVAC FLEX DUCT SUPPORT DETAIL  
M3.0 NOT TO SCALE

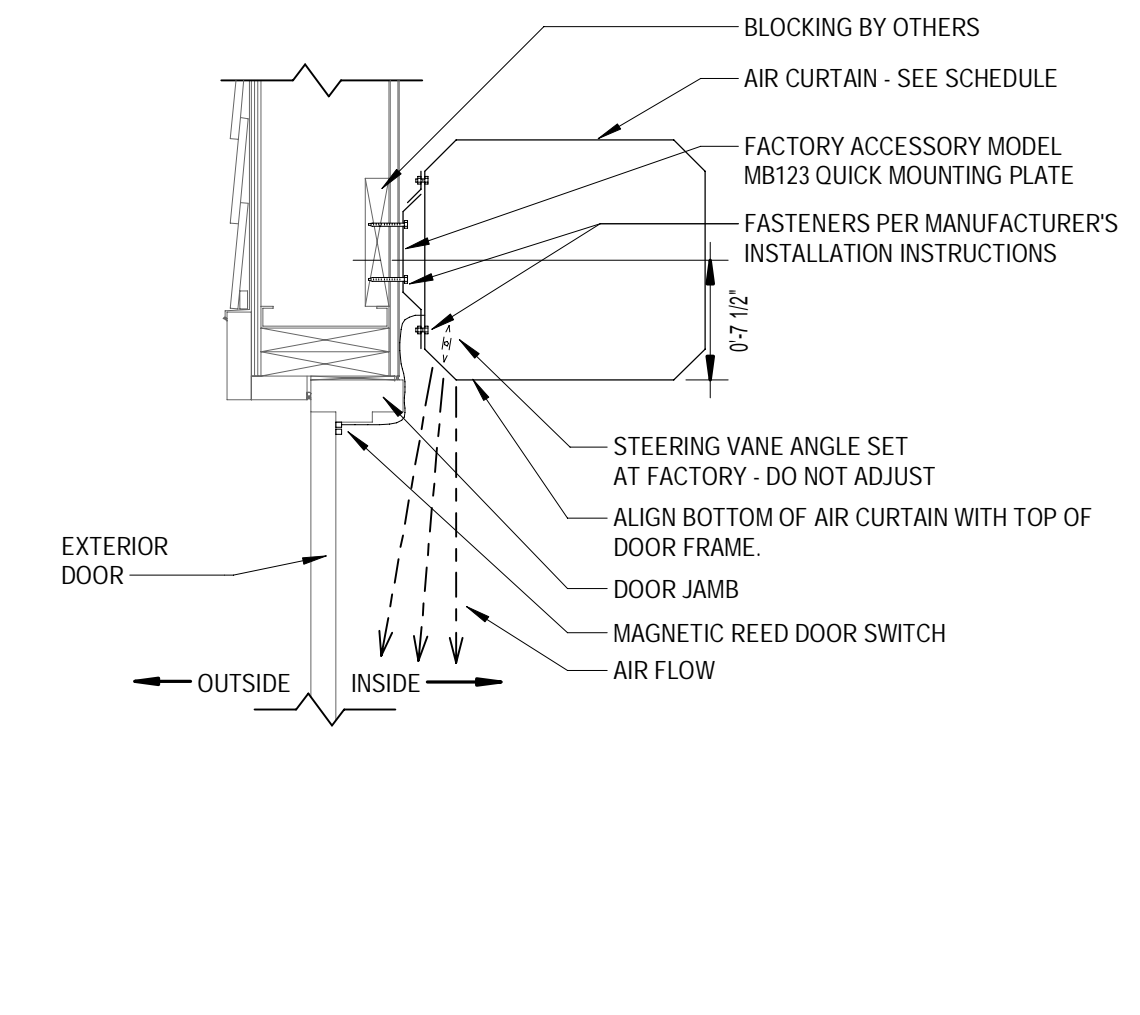


**6** AIR CURTAIN INSTALLATION DETAIL  
M3.0 NOT TO SCALE

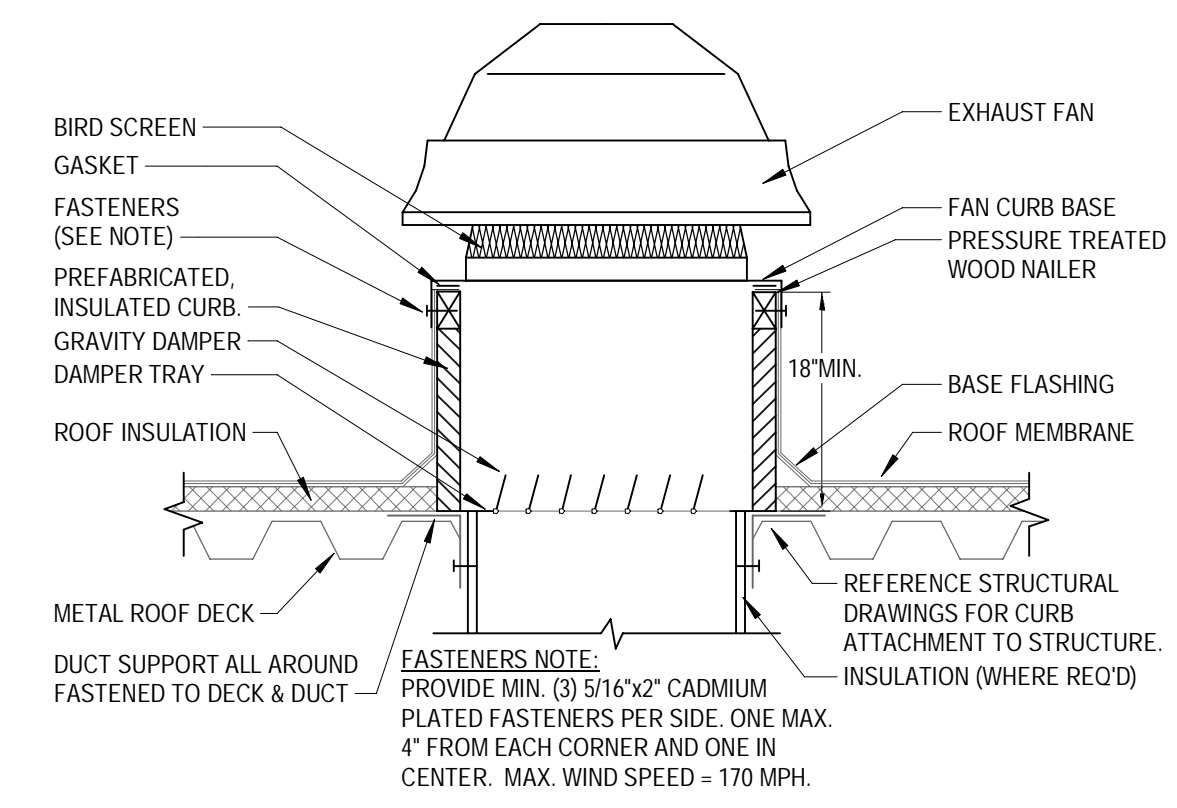

**7** ROOF FAN MOUNTING DETAIL  
M3.0 NOT TO SCALE

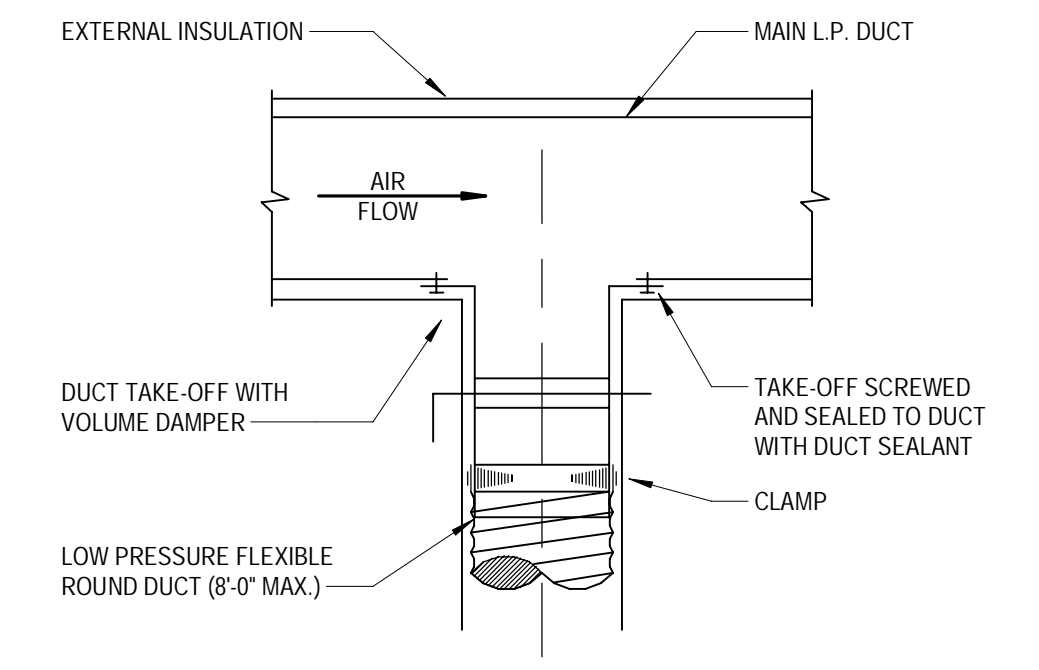

**8** HVAC SUPPLY DIFFUSER TAKE OFF DETAIL  
M3.0 NOT TO SCALE

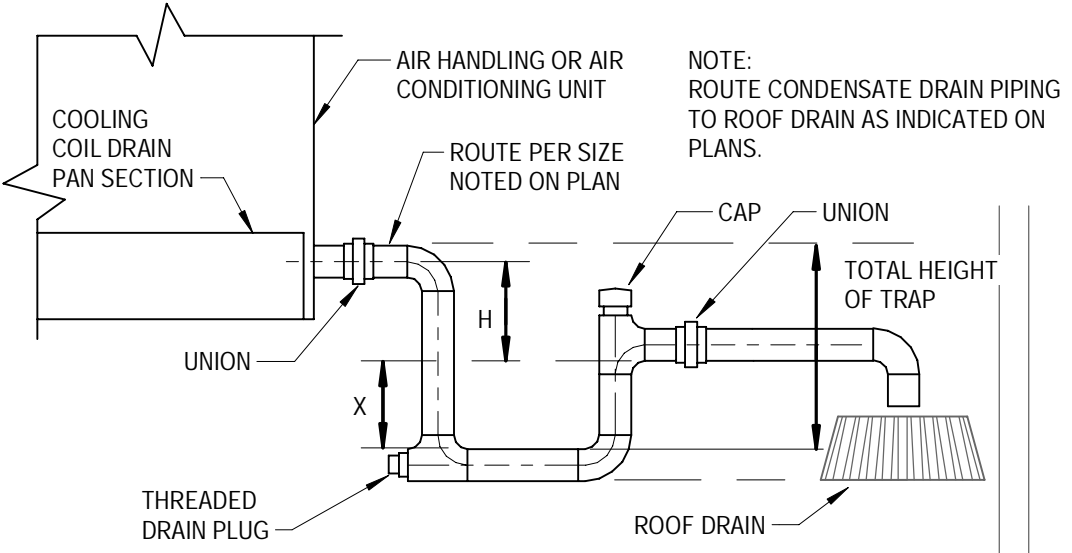

DRAIN TRAPPING HEIGHT		
FAN ARRANGEMENT	H	X
BLOW-THRU (POSITIVE STATIC PRESSURE)	A	B
DRAW-THRU (NEGATIVE STATIC PRESSURE)	D	C

A = MINIMUM 1"


B = AT LEAST 1" PLUS CASING STATIC PRESSURE

C = 1/2" D"


D = AT LEAST 1" PLUS CASING STATIC PRESSURE

TOTAL HEIGHT OF TRAP = X + H + (1.5 x PIPE DIAMETER) (WITHOUT INSULATION)


**9** HVAC CONDENSATE DRAIN DETAIL  
M3.0 NOT TO SCALE

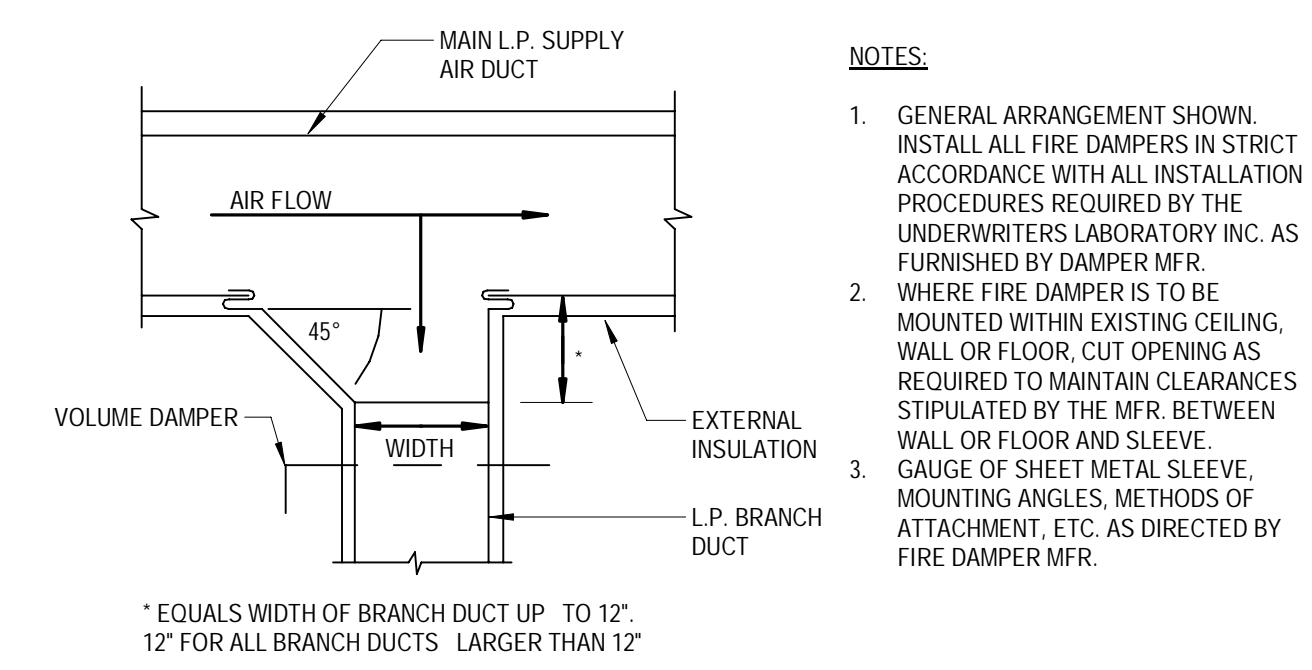

**10** HVAC LOW PRESSURE SUPPLY BRANCH DUCT DETAIL  
M3.0 NOT TO SCALE

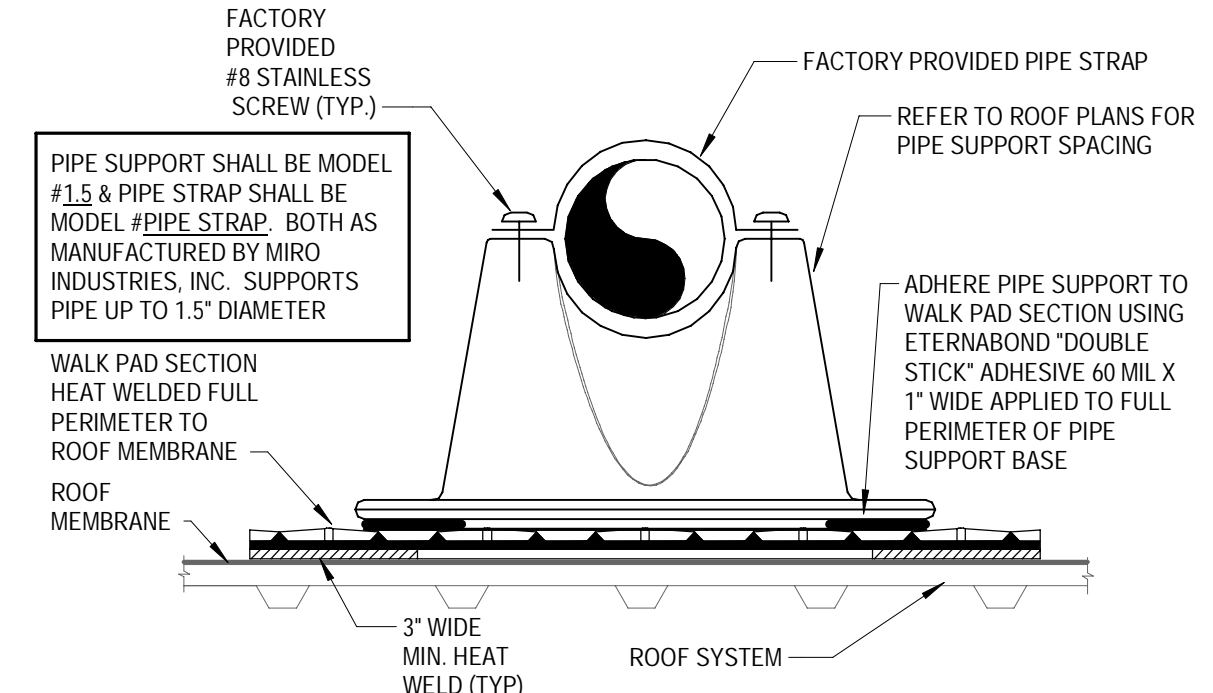

**11** PIPE ROOF SUPPORT DETAIL  
M3.0 NOT TO SCALE

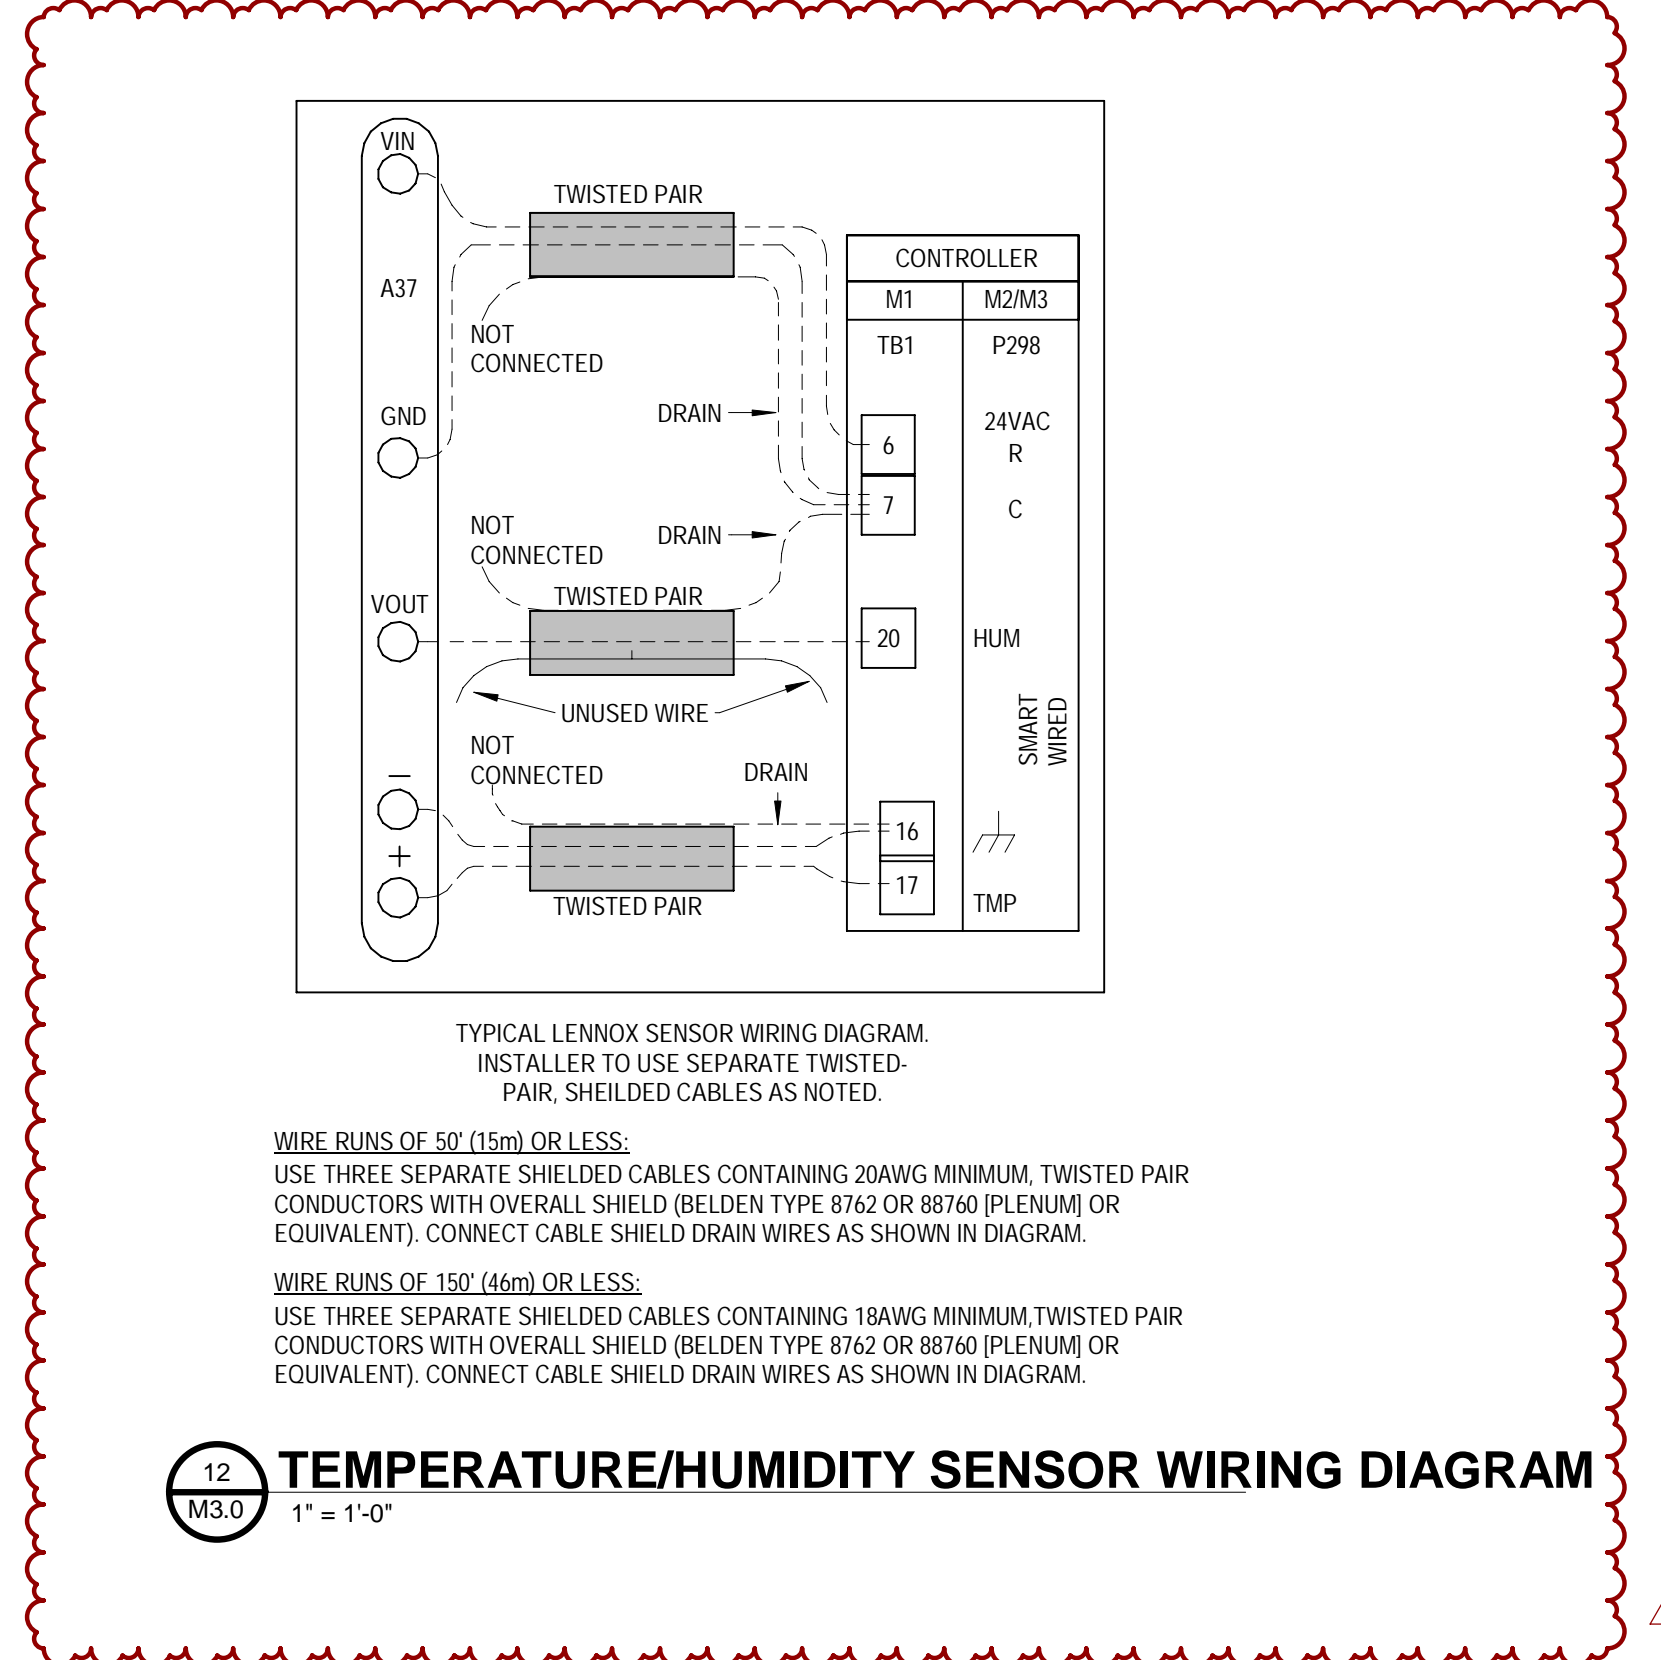

**12** TEMPERATURE/HUMIDITY SENSOR WIRING DIAGRAM  
M3.0 1" = 1'-0"

**AECOM**  
AECOM Technical Services, Inc.  
1255 BROAD STREET, SUITE 201  
CLIFTON, NJ 07030-3988  
973.883.8500 FAX 973.883.8601  
http://www.aecom.com

CLIENT NAME  
**WAWA INC.**  
260 W. BALTIMORE PIKE  
WAWA, PA 19063

PROJECT NAME  
W50 FB VA V2024.04  
**WAWA STORE #8681**  
8878 SEMINOLE TRAIL  
RUCKERSVILLE, VA 22968

DATE	RELEASE
12/06/2023	ISSUED FOR PERMIT
02/07/2025	REV C - ISSUED FOR CONSTRUCTION

PROTOTYPE	DATE	REVISION	DRAWN	CHECKED	FA
W50 FB VA V2024.04	12/06/2023				
6069813-8681	02/07/2025				

**8681**  
RUCKERSVILLE, VA

**Wawa**

**M3.0**

OUTSIDE AIR CALCULATION									
AREA SERVED	AREA (SOFT)	PEOPLE / 1000 SOFT	# PEOPLE	CFM/ PERSON	PEOPLE O.A. (CFM)	CFM / SOFT	SOFT O.A. (CFM)	TOTAL O.A. RECD (CFM)	TOTAL O.A. SUPPLIED (CFM)
RETAIL AREA	1647	15	25	7.5	188	0.12	198	386	
STAGING	55	2	1	10	10	0.12	7	17	
BACKROOM	124	20	3	7.5	23	0.12	15	38	
WASH ROOM	96	20	2	7.5	15	0.12	12	27	
REAR VEST.	48	10	1	5	5	0.06	3	8	
							RTU-1	408	850
COFFEE	152	5	1	5	5	0.06	10	15	
SPECIAL BEV.	218	5	2	5	10	0.06	14	24	
FOOD SVC. 1	457	20	10	7.5	75	0.12	55	130	
FOOD SVC. 2	197	20	4	7.5	30	0.12	24	54	
							RTU-2	266	970
OFFICE	65	5	2	5	10	0.06	4	14	
ASSOCIATE	76	5	2	5	10	0.06	5	15	
FRONT VEST.	81	10	1	5	5	0.06	5	10	
RR HALLWAY	64	-	-	-	-	0.06	4	4	
CHECKOUT	790	15	12	7.5	90	0.12	95	185	
							RTU-3	253	330

NOTES:  
 1. OCCUPANCY LOAD VENTILATION RATES ARE BASED ON NET OCCUPIABLE SPACE IN ACCORDANCE WITH THE JURISDICTIONS LATEST ACCEPTED VERSION OF THE INTERNATIONAL MECHANICAL CODE, TABLE 403.3.1.1  
 2. ANTICIPATED NUMBER OF PEOPLE IS BASED ON AN OCCUPANCY LOAD FACTOR (# PEOPLE/SF) VALUE (BASED ON THE JURISDICTIONS LATEST ACCEPTED VERSION OF THE INTERNATIONAL MECHANICAL CODE, TABLE 403.3.1.1).

### AIR BALANCE SCHEDULE

SYSTEM	CFM
RTU-1	+850
RTU-2	+970
RTU-3	+330
EF-1	-350
EF-2	-1300
BUILDING POSITIVE PRESSURE	+350

### MECHANICAL GENERAL NOTES

- REFER TO WRITTEN BOOK SPECIFICATIONS FOR ADDITIONAL INFORMATION.
- THE WORK TO BE DONE UNDER THESE SPECIFICATIONS AND THE DRAWINGS CONSISTS OF FURNISHING ALL EQUIPMENT, MATERIALS, LABOR AND SERVICES, AND PERFORMING ALL OPERATIONS TO COMPLETE THE MECHANICAL CONSTRUCTION WORK FOR THIS PROJECT. ANY WORK NOT SPECIFICALLY COVERED BY THESE SPECIFICATIONS OR INDICATED ON THE MECHANICAL ELECTRICAL/PLUMBING PLANS, BUT NECESSARY TO COMPLETE OR PERFECT ANY PART OF THIS INSTALLATION IN A SUBSTANTIAL MANNER, SHALL BE PROVIDED WITHOUT EXTRA COST TO OWNER.
- THE TERM "FURNISH" SHALL MEAN TO OBTAIN AND SUPPLY TO THE JOB SITE. THE TERM "INSTALL" SHALL MEAN TO FIX IN POSITION AND CONNECT FOR USE. THE TERM "PROVIDE" SHALL MEAN TO FURNISH AND INSTALL. THE TERM "MECHANICAL WORK" OR "WORK" SHALL MEAN ALL LABOR, MATERIAL, EQUIPMENT, SCAFFOLDING, RIGGING, TOOLS, SUPERVISION, SERVICES AND OTHER INCIDENTALS NECESSARY FOR COMPLETE AND OPERABLE INSTALLATION.
- THE CONTRACTOR SHALL FURNISH AND INSTALL ALL EQUIPMENT, MATERIALS AND LABOR TO PROVIDE A COMPLETE AND OPERATIONAL SYSTEM AS INDICATED ON THE DESIGN DOCUMENTS.
- CONTRACTOR SHALL OBTAIN ALL PERMITS, INSPECTIONS AND APPROVALS PRIOR TO AND DURING CONSTRUCTION.
- ALL MATERIALS, EQUIPMENT AND INSTALLATIONS SHALL BE IN STRICT ACCORDANCE WITH JURISDICTIONS LATEST ACCEPTED VERSION OF THE INTERNATIONAL BUILDING CODE - MECHANICAL, SMACNA, UL STATE CODES, LOCAL CODES, MANUFACTURER'S RECOMMENDATIONS, AND ALL AUTHORITIES HAVING JURISDICTION.
- CONTRACTOR SHALL PROVIDE ALL ROOFING OPENINGS, FLASHING, AUXILIARY STEEL, THREADED RODS, VIBRATION ISOLATORS, TURNBUCKLES, ETC. TO SUPPORT HIS EQUIPMENT ON OR FROM THE STRUCTURE.
- CONTRACTOR SHALL COORDINATE ALL WORK WITH TRADES AND IN FIELD PRIOR TO INSTALLATION OF ANY WORK. REPORT ALL CONFLICTS IMMEDIATELY TO ARCHITECT AND ENGINEER.
- THE DRAWINGS INDICATE DIAGRAMMATICALLY THE EXTENT, GENERAL CHARACTER AND LOCATION OF THE WORK INCLUDED. OFFSETS OR CHANGES IN DUCT SHAPE TO AVOID STRUCTURAL OR OTHER INTERFERENCES, AND WORK INDICATED BUT HAVING MINOR DETAILS OBVIOUSLY OMITTED SHALL BE PROVIDED WITHOUT EXTRA COST.
- ANY CHANGES AND/OR MODIFICATIONS MUST BE REVIEWED AND APPROVED BY THE ENGINEER OR OWNER'S REPRESENTATIVE PRIOR TO CONSTRUCTION.
- REMOVE ALL TRASH, DEBRIS AND DEMOLITION MATERIAL FROM PREMISES AT THE END OF EACH WORK DAY.
- SCHEDULE ALL WORK, CUTTING AND BUILDING SERVICE INTERRUPTIONS WITH BUILDING OWNER AND CONSTRUCTION MANAGER, PRIOR TO COMPLETING WORK.
- ALL DUCT DIMENSIONS ARE INSIDE CLEAR DIMENSIONS.
- THE MAXIMUM FLEXIBLE DUCT LENGTH PERMITTED IS 8'-0". THIS DUCTWORK SHALL BE INSTALLED WITHOUT KINKS OR 90° BENDS.
- ALL FLEXIBLE DUCTWORK SHALL BE FLEX-VENT TYPE KM INSULATED WITH POLYMER INNER FILM AND METALIZED OUTER JACKET, OR APPROVED EQUAL. SIZE SHALL BE SAME AS DIFFUSER NECK SIZE, UNLESS INDICATED OTHERWISE.
- FIELD ADJUST THE DIRECTION OF BLOW FOR ALL SUPPLY AIR DEVICES SO THAT THE DEVICES DO NOT BLOW DIRECTLY INTO SOFFITS, CURTAIN WALLS, REFRIGERATED CASES OR EXHAUST HOODS.
- ALL NEW AND EXISTING PIPES AND DUCTS SHALL HAVE UL FIRE RATED SLEEVES AND/OR FIRE RATED DAMPERS, WHEN PASSING THROUGH FIRE RATED CONSTRUCTION.
- COORDINATE LOCATION OF NEW DUCTWORK, AIR DEVICES AND EQUIPMENT WITH LIGHT FIXTURES, SPRINKLER PIPING AND HYDRONIC PIPING.
- CONTRACTOR SHALL VERIFY FIELD CONDITIONS AT THE SITE AND NOTIFY THE OWNER/ENGINEER OF ANY DISCREPANCIES PRIOR TO COMMENCING WITH WORK.
- ALL TEMPERATURE AND HUMIDITY SENSORS SHALL BE INSTALLED 5' ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE ON PLAN. COORDINATE FINAL LOCATIONS WITH EQUIPMENT, FURNITURE, TENANT AND ARCHITECT PRIOR TO INSTALLATION.
- ALL DUCTWORK SHALL BE GALVANIZED STEEL CONSTRUCTED AT 2" PRESSURE CLASS. ALL CONCEALED DUCTWORK BELOW TRUSSES SHALL BE INSULATED WITH 1-1/2" FIBERGLASS DUCT WRAP WITH WIRE SUPPORT BANDS ON 24" CENTERS. ALL CONCEALED DUCTWORK ABOVE THE TRUSSES SHALL BE INSULATED WITH 1-1/2" OF FIBERGLASS DUCT WRAP WITH WIRE SUPPORT BANDS ON 24" CENTERS. ALL INTERIOR EXPOSED DUCTWORK BELOW TRUSSES SHALL BE INSULATED WITH 1" RIGID FIBERGLASS DUCT BOARD WITH FOIL AND SCRIM FACING. ALL EXTERIOR EXPOSED DUCTWORK SHALL BE INSULATED WITH 4" RIGID FIBERGLASS BOARD WITH WEATHERPROOF MEMBRANE.
- VERIFY ALL EQUIPMENT VOLTAGES, WIRING REQUIREMENTS, AND REQUIRED BREAKER SIZES WITH THE ELECTRICAL CONTRACTOR PRIOR TO ORDERING EQUIPMENT.
- ALL ACCESS DOORS REQUIRED IN GENERAL CONSTRUCTION ARE TO BE PROVIDED AND INSTALLED BY THE GENERAL CONTRACTOR. IT IS THE RESPONSIBILITY OF THE MECHANICAL CONTRACTOR TO IDENTIFY SIZE, TYPE AND LOCATION OF SUCH DOORS FOR PROPER ACCESS TO ALL CONCEALED MECHANICAL EQUIPMENT, VALVES AND OTHER RELATED DEVICES. THE MECHANICAL CONTRACTOR SHALL IDENTIFY THESE REQUIREMENTS ON A COORDINATED SHOP DRAWING PRIOR TO SYSTEM FABRICATION AND INSTALLATION. AFTER THE HEATING AND AIR CONDITIONING SYSTEMS ARE COMPLETE, THE CONTRACTOR SHALL BALANCE THE SYSTEM AND PRESENT OWNER & ARCHITECT WITH A WRITTEN BALANCING REPORT BY A CERTIFIED INDEPENDENT TESTING LAB. DAMPER HANDLES SHALL BE FASTENED INTO DUCTWORK WITH SHEET METAL SCREWS AFTER BALANCING TO ASSURE CORRECT BALANCED AIRFLOW.
- PROVIDE ELBOWS OR TEES WITH TURNING VANES FOR ALL CHANGES IN SUPPLY DUCT DIRECTION. PROVIDE BRANCH DUCT DAMPERS WITH LOCKING QUADRANTS FOR ALL BRANCHES AND TAKE-OFFS. PROVIDE RAISED QUADRANTS FOR INSULATED DUCTWORK. ALL VOLUME DAMPER HANDLES ARE TO PROTRUDE NEATLY THROUGH DUCT INSULATION AND BE TAGGED SO THAT THEY ARE CLEARLY VISIBLE.
- PROVIDE FLEXIBLE CONNECTIONS AT ALL DUCT CONNECTIONS TO VIBRATING EQUIPMENT. THESE CONNECTIONS SHALL BE INSTALLED IN CLOSE PROXIMITY TO SUCH EQUIPMENT.
- THE MECHANICAL CONTRACTOR SHALL HAVE A QUALIFIED HVAC TECHNICIAN FROM THE UNIT MANUFACTURER PROVIDE AN EQUIPMENT OPERATION CHECK AFTER UNIT START-UP AND PRIOR TO CERTIFIED AIR BALANCING. THE CERTIFICATION, SIGNED BY THE TECHNICIAN, MUST BE INCLUDED IN THE GENERAL CONTRACTOR CLOSING DOCUMENTS FOR THE STORE.

### HVAC AIR DEVICE SCHEDULE

TYPE MARK	MANUFACTURER	MODEL	SERVICE	DESCRIPTION	MOUNTING TYPE	MATERIAL	NECK SIZE	FACE SIZE	NOTES
CD-1	PRICE	AMD	<varies>	LOUVERED FACE DIRECTIONAL DIFFUSER	LAY-IN	ALUMINUM	18"X18"	24"X24"	<varies>
CD-2	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	SURFACE	ALUMINUM	12"X12"	NECK+5"	5.6
CD-3	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	SURFACE	ALUMINUM	6"X6"	NECK+5"	5.6
G-1	PRICE	630FF	RET/EXH/TRAN	LOUVERED FACE FILTER RETURN GRILLE	LAY-IN	ALUMINUM	20"X20"	NECK+3-3/4"	4
G-2	PRICE	630FF	RET/EXH/TRAN	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	12"X12"	NECK+3-3/4"	4
G-3	PRICE	630FF	<varies>	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	8"X8"	NECK+3-3/4"	<varies>
LD-1	PRICE	TBD4	SUPPLY	48" INSULATED PLENUM W/ (4) 1" SLOTS	LAY-IN	ALUMINUM	SEE PLAN	N/A	2.3

NOTES:  
 -NO SUBSTITUTIONS PERMITTED--  
 1. FOR LAY-IN CEILINGS PROVIDE WITH 18"X18" FULL FACE APPEARANCE DIFFUSER NECK. PROVIDE WITH FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR". ROUND NECK SIZE SHALL BE EQUAL TO FLEX SIZE SERVING DIFFUSER.  
 2. PROVIDE WITH PLENUM INTERNALLY LINED WITH COATED FIBERBOARD. EXTERNALLY INSULATE PLENUM UPON INSTALLATION WITH DUCT WRAP INSULATION.  
 3. PROVIDE WITH CENTER NOTCH OPTION (CN) AS REQUIRED WHEN USED IN 24" T-BAR CEILING.  
 4. "OR" STYLE (1/4 TURN FASTENERS ONLY) - OMIT HINGE. FILTER TYPE RETURN GRILLES PROVIDED SOLELY FOR MAINTENANCE PURPOSES. OMIT FILTER UPON INSTALLATION.  
 5. PROVIDE WITH TYPE 6 BEVELED SURFACE MOUNT FRAME AND FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR".  
 6. PROVIDE WITH BACKPAN INSULATION.

### HVAC AIR CURTAIN SCHEDULE

MARK	AREA SERVED	BASIS OF DESIGN				UNIT POWER	MOUNTING HEIGHT	NOTES
		MANUFACTURER	MODEL	NOZZLE CFM	HP			
ARC-1		POWERED AIRE	BCE-1-48	2155	0.5	120 V	1	
ARC-2	DELIVERY ROOM	POWERED AIRE	BCE-1-48	2155	0.5	120 V	1	7'-2"

NOTES:  
 -NO SUBSTITUTIONS PERMITTED--  
 1. MOUNT INSIDE BUILDING ABOVE DOOR AT 7'-2" A.F.F. MOUNTING HEIGHT IS FROM BOTTOM OF AIR CURTAIN.  
 2. PROVIDE ALL NECESSARY MOUNTING BRACKETS AND ACCESSORIES.  
 3. PROVIDE WITH MODEL SM-300 COMMERCIAL MAGNETIC REED DOOR SWITCH.  
 4. AIR CURTAIN CONTROLLED BY MAGNETIC REED DOOR SWITCH, FAN ON WHEN DOOR IS OPEN.

### HVAC EXHAUST FAN SCHEDULE

MARK	CFM	EXT. STATIC PRESSURE	FAN TYPE	DRIVE TYPE	BASIS OF DESIGN				NOTES	
					SONES	HP	RPM	VOLTAGE		
EF-1	350	0.125 in-wg	DOWNBLAST	DIRECT	5.9	1/6	1550	120 V	1	1.2,3
EF-2	1300	0.375 in-wg	DOWNBLAST	DIRECT	9.5	1/3	1300	120 V	1	1.2,3

NOTES:  
 -NO SUBSTITUTIONS PERMITTED--  
 1. PROVIDE WITH FACTORY DISCONNECT, FACTORY WIRED SOLID STATE SPEED CONTROLLER, 18" HIGH ROOF CURB WITH DAMPER TRAY, BACKDRAFT DAMPER, AND BIRD SCREEN.  
 2. WIRE FOR CONTINUOUS OPERATION.  
 3. PROVIDE WITH FACTORY DISCONNECT & FACTORY WIRED SOLID STATE SPEED CONTROLLER. FAN SHALL BE WIRED TO EMERGENCY SHUTOFF SWITCH PROVIDED BY OTHERS. REFERENCE ARCHITECTURAL AND ELECTRICAL DRAWINGS.

### HVAC ROOFTOP UNIT SCHEDULE

MARK	AREA SERVED	SUPPLY AIR FAN DATA				ELECTRIC HEAT		UNIT POWER		WEIGHT (LBS. RTU ONLY)	COOLING CAPACITY					BASIS OF DESIGN						
		NOMINAL TONS	COOLING CFM	OUTSIDE AIR	E.S.P. (IN.)	HP	KW @ VOLTAGE LISTED	CONTROL STAGES	VOLTAGE		PHASE	MCA	MOC	TOTAL COOLING MBH	SENSIBLE COOLING MBH	EDB (°F)	EWB (°F)	AMBIENT (DB°F/WB°F)	EER (SEER) (IEER)	MANUFACTURER PRODUCT LINE	MODEL	NOTES
RTU-1	RETAIL	12.5	4225	850	0.50	3.75	30	1	208 V	3	63	80	1312	134.5	97.2	80	67.0	94/76	11.0(14.6)	LENNOX ENLIGHT	LCT150H4E	1-20
RTU-2	FOOD SERVICE	12.5	4890	970	0.50	3.75	30	1	208 V	3	63	80	1312	134.5	97.2	80	67.0	94/76	11.0(14.6)	LENNOX ENLIGHT	LCT150H4E	2-20
RTU-3	RETAIL/CHECKOUT	8.5	2550	330	0.50	3.75	22.5	1	208 V	3	46	50	1248	96.2	71	80.0	67.0	94/76	12.3(15.7)	LENNOX ENLIGHT	LCT120H4E	2-20

NOTES:  
 1. PROVIDE CO2 SENSOR FOR INTERLINK WITH BUILDING AUTOMATION SYSTEM.  
 2. PROVIDE LENNOX HUMIDITROL HOT GAS REHEAT OPTION.  
 3. PROVIDE REMOTE WALL MOUNTED COMBINATION TEMPERATURE/HUMIDITY SENSOR MODEL AND HUMIDITROL PACKAGE.  
 4. REFER TO CONTROL SYSTEM NOTES FOR CONTROL COMPONENTS REQUIREMENTS.  
 5. PROVIDE HIGH/LOW PRESSURE SWITCH, OVERLOAD PROTECTION, FREEZE PROTECTION, LOSS OF CHARGE SWITCH, ANTI-SHORT CYCLE TIMER.  
 6. PROVIDE THRU THE BASE ELECTRICAL AND SINGLE POINT CONNECTION.  
 7. PROVIDE WITH FACTORY 2" THROW AWAY PLEATED MERV 8 FILTERS.  
 8. PROVIDE WITH 18" ROOF CURB.  
 9. PROVIDE FACTORY 15 AMP GFCI SERVICE OUTLET WITH WEATHERPROOF COVER. COORDINATE WITH ELECTRICAL CONTRACTOR TO PROVIDE FIELD WIRING TO RECEPTACLE.  
 10. PROVIDE WITH FACTORY INSTALLED DISCONNECT.  
 11. PROVIDE WITH HIGH PERFORMANCE SINGLE ENTHALPY ECONOMIZER AND POWERED EXHAUST FAN.  
 12. PROVIDE MANUFACTURERS MOTOR AND DRIVE PACKAGE AS REQUIRED TO MEET SCHEDULED AIR CAPACITIES AND PRESSURE DROP.  
 13. PROVIDE BUILDING AUTOMATION SYSTEM (BAS) EQUIPMENT - REFER TO BAS SYSTEM MASTER SPEC FOR SYSTEM DETAILS AND EQUIPMENT PART NUMBERS.  
 14. PROVIDE FACTORY INSTALLED BACNET BAS INTERFACE WITH RETURN AIR SENSOR, OUTDOOR AIR SENSOR, DISCHARGE AIR SENSOR.  
 15. PROVIDE LENNOX DIRTY FILTER SWITCH.  
 16. PROVIDE HINGED ACCESS DOOR.  
 17. CORROSION RESISTANT, REVERSIBLE DRAIN PAN WITH OVERFLOW SWITCH.  
 18. PROVIDE WITH FACTORY CONDENSATE PAN WATER LEVEL MONITORING DEVICE FOR COMPLIANCE WITH IMC, SECTION 307.2.3.  
 19. PROVIDE WITH FACTORY INSTALLED SUPPLY AND RETURN SMOKE DETECTORS. PROVIDE REMOTE TEST STATIONS (RTS).  
 20. PROVIDE EQUIPMENT OPERATIONS CHECK (EOC) AND GUIDED SETUP


### RTU-1, 2, & 3 SEQUENCE OF OPERATION

GENERAL: TEMPERATURE SETPOINT: 74°F COOLING, 68°F HEATING, HUMIDITY SETPOINT: 50% RELATIVE HUMIDITY.  
 SUPPLY AIR BLOWER SPEED  
 UNIT HAS FOLLOWING SUPPLY AIR BLOWER SPEED SETTINGS THAT PERTAIN TO THIS INSTALLATION:  
 - COOLING AIR BLOWER SPEED  
 - HEATING AIR BLOWER SPEED  
 COOLING MODE  
 - Y1 DEMAND: COMPRESSOR 1 OPERATES AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.  
 - Y2 DEMAND: ALL COMPRESSORS OPERATE AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.  
 DEHUMIDIFICATION MODE  
 - IF THE UNIT RECEIVES A CALL FOR DEHUMIDIFICATION, ECONOMIZER FREE COOLING IS LOCKED OUT (ON UNITS EQUIPPED WITH ECONOMIZER).  
 - CALL FOR DEHUMIDIFICATION, NO Y1, Y2 DEMAND: 1ST STAGE COMPRESSOR OPERATES, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS ENERGIZED.  
 - Y1 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED AND THE REHEAT VALVE IS ENERGIZED.  
 - Y2 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS DE-ENERGIZED.  
 HEATING MODE (GAS HEAT)  
 - W1 DEMAND: 1ST STAGE GAS HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.  
 - W2 DEMAND: 2ND STAGE GAS HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.

### ABBREVIATIONS

DB°F	DRY BULB DEGREES FAHRENHEIT	LD	LINEAR DIFFUSER
AC	AIR CONDITIONING	LP	LOW PRESSURE
AC	AIR CURTAIN	MAX	MAXIMUM
A.F.F.	ABOVE FINISHED FLOOR	MBH	1000 BTU PER HOUR
BAS	BUILDING AUTOMATION SYSTEM	MCA	MINIMUM CIRCUIT AMPACITY
BTU	BRITISH THERMAL UNIT	MIN	MINIMUM
CD	CEILING DIFFUSER	MOC	MAXIMUM OVER CURRENT PROTECTION
CFM	CUBIC FEET PER MINUTE	MPH	MILES PER HOUR
CO2	CARBON DIOXIDE	O.A.	OUTSIDE AIR
D	DIAMETER	O.C.	ON CENTER
EER	ENERGY EFFICIENCY RATIO	PVC	POLYVINYL CHLORIDE
EF	EXHAUST FAN	REQ'D	REQUIRED
FFH	FAN FORCED HEATER	RTU	PACKAGED ROOF TOP HVAC UNIT
G	GRILLE	SCH	SCHEDULE
G.C.	GENERAL CONTRACTOR	SEER	SEASONAL ENERGY EFFICIENCY RATIO
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	SF	SQUARE FOOT
HP	HORSEPOWER	TYP.	TYPICAL
IEER	INTEGRATED ENERGY EFFICIENCY RATIO	V	VOLTS
IN	INCHES WATER COLUMN	CO	CLEANOUT
LBS.	POUNDS	WB°F	WET BULB DEGREES FAHRENHEIT

### HVAC LEGEND

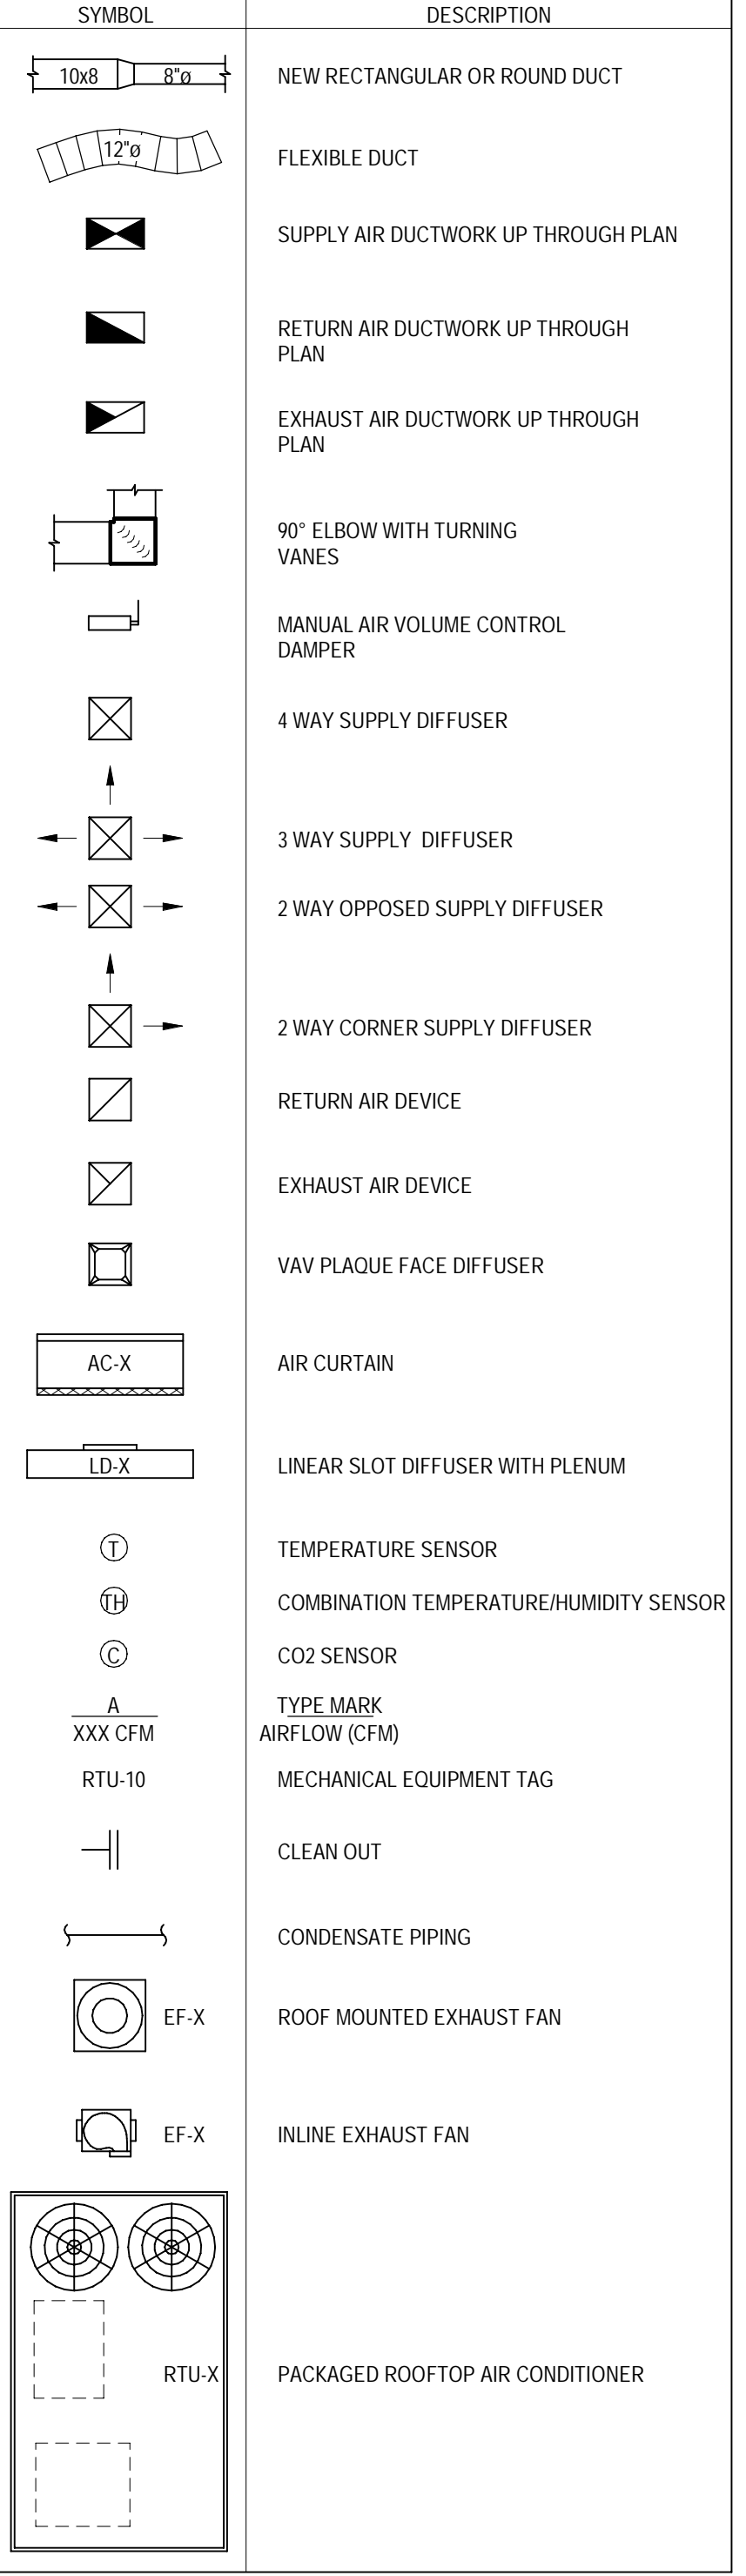

### LENNOX SETUP PARAMETERS / MID-ATLANTIC STORES (R3)

- UNIT ID CONFIGURATION (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):
- BACNET CONFIGURATION: GO TO SETTINGS-GENERAL-CONFIGURATION ID1 POSITION 5 SET TO "B"
  - NETWORK CONFIGURATION: GOT TO SETUP-NETWORK INTEGRATION, SET TO BACNET
  - CONTROL MODE: SET CONTROL MODE TO ROOM SENSOR: CO2, TEMP. & HUMIDITY TO "NO".
  - ENTHALPY CONFIGURATION: CHANGE CONFIG ID1 POSITION 2 FROM D (DUAL ENTHALPY) TO S (SINGLE ENTHALPY)
  - FRESH AIR COOLING: SETUP-TEST & BALANCE-DAMPER. SCROLL TO FRESH AIR COOLING SET TO "NO"
  - FRESH AIR HEAT: SETUP-TEST & BALANCE-DAMPER. SCROLL TO FRESH AIR HEAT SET TO "NO"

### INDIVIDUAL PARAMETER CONFIGURATIONS (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):

- PARAMETER 105 DEHUMID MODE: 7 (NO CONDITIONS)
- PARAMETER 106 DEHUMID SETPOINT: 50. THIS IS A CENTERED SET POINT (+/-)
- PARAMETER 107 DEHUMID DEADBAND: 3 (DEFAULT) THIS IS THE ACTUAL +/- VALUE
- PARAMETER 117 CO2 DAMPER MAX OPEN %: 50
- PARAMETER 118 CO2 START OPEN PPM: 1200
- PARAMETER 119 CO2 FULL OPEN PPM: 1500
- PARAMETER 131 FREE COOL MAX DAMPER: 100%
- PARAMETER 137 OCC HEAT SET POINT: 68 (BACK UP)
- PARAMETER 139 OCC COOLING SET POINT: 72 (BACK UP)
- PARAMETER 154 OCC BLOWER MODE: ON-CONTINUOUS 1
- PARAMETER 155 FREE COOL LOCK OUT SET POINT: 29 (DISABLED)
- PARAMETER 159 FREE COOL SUPPLY SET POINT: 55 (DEFAULT)
- PARAMETER 160 ECON FREE COOL SET POINT: 55 (DEFAULT)
- PARAMETER 161 ECON FREE COOL OFFSET: 10 (DEFAULT)
- PARAMETER 162 FREE COOL ENTHALPY SET POINT (SINGLE ENTHALPY): 19 MA (50% HUM + 60F)
- PARAMETER 163 ECON FREE COOL ENTHALPY OFFSET: 1 (DEFAULT)
- PARAMETER 164 ECONOMIZER PROFILE: 2 (DEFAULT)

### CFM VALUES / MSAV FAN SPEEDS (AIR BALANCER TO DEFINE / IF APPLICABLE):

- HEAT CFM VALUE: PER THE HVAC SCHEDULE
- HIGH COOL CFM VALUE: PER THE HVAC SCHEDULE
- LOW COOL CFM VALUE: MATCH THE HIGH COOL CFM VALUE
- VENTILATION CFM VALUE: MATCH THE HIGH COOL CFM VALUE

### RTU-1, 2, & 3 TEST AND BALANCE NOTES

- TEST AND BALANCE CONTRACTOR TO OBTAIN INITIAL BALANCE OF COOLING CFM FOR RTU USING FAN SHEAVE ADJUSTMENT TO WITHIN +/- 5% SCHEDULED SUPPLY AIR CFM. PRODIGY CONTROLLER MAY BE USED FOR FINAL 5% TO OBTAIN SCHEDULED SUPPLY AIR CFM.
- SET MINIMUM OUTSIDE AIR DAMPER POSITION FOR COOLING AND VERIFY OUTSIDE AIR CFM PER RTU SCHEDULE.
- NOT USED
- NOT USED
- USING PRODIGY CONTROLLER, VERIFY HEATING CFM EQUALS COOLING CFM.
- ALL PRODIGY CONTROLLER SETTINGS OTHER THAN THOSE MENTIONED ABOVE SHALL REMAIN AS THEIR DEFAULT VALUE AS SET FROM THE FACTORY.
- VERIFY POSITIVE BUILDING PRESSURE THROUGH ALL FAN STAGES.

**AECOM**  
 AECOM Technical Services, Inc.  
 300 BROADACRES DRIVE, SUITE 250  
 BLOOMFIELD, NJ 07003  
 973.883.8500 FAX 973.883.8601  
 http://www.aecom.com