


# Amerex Pre-Engineered Fire Suppression System

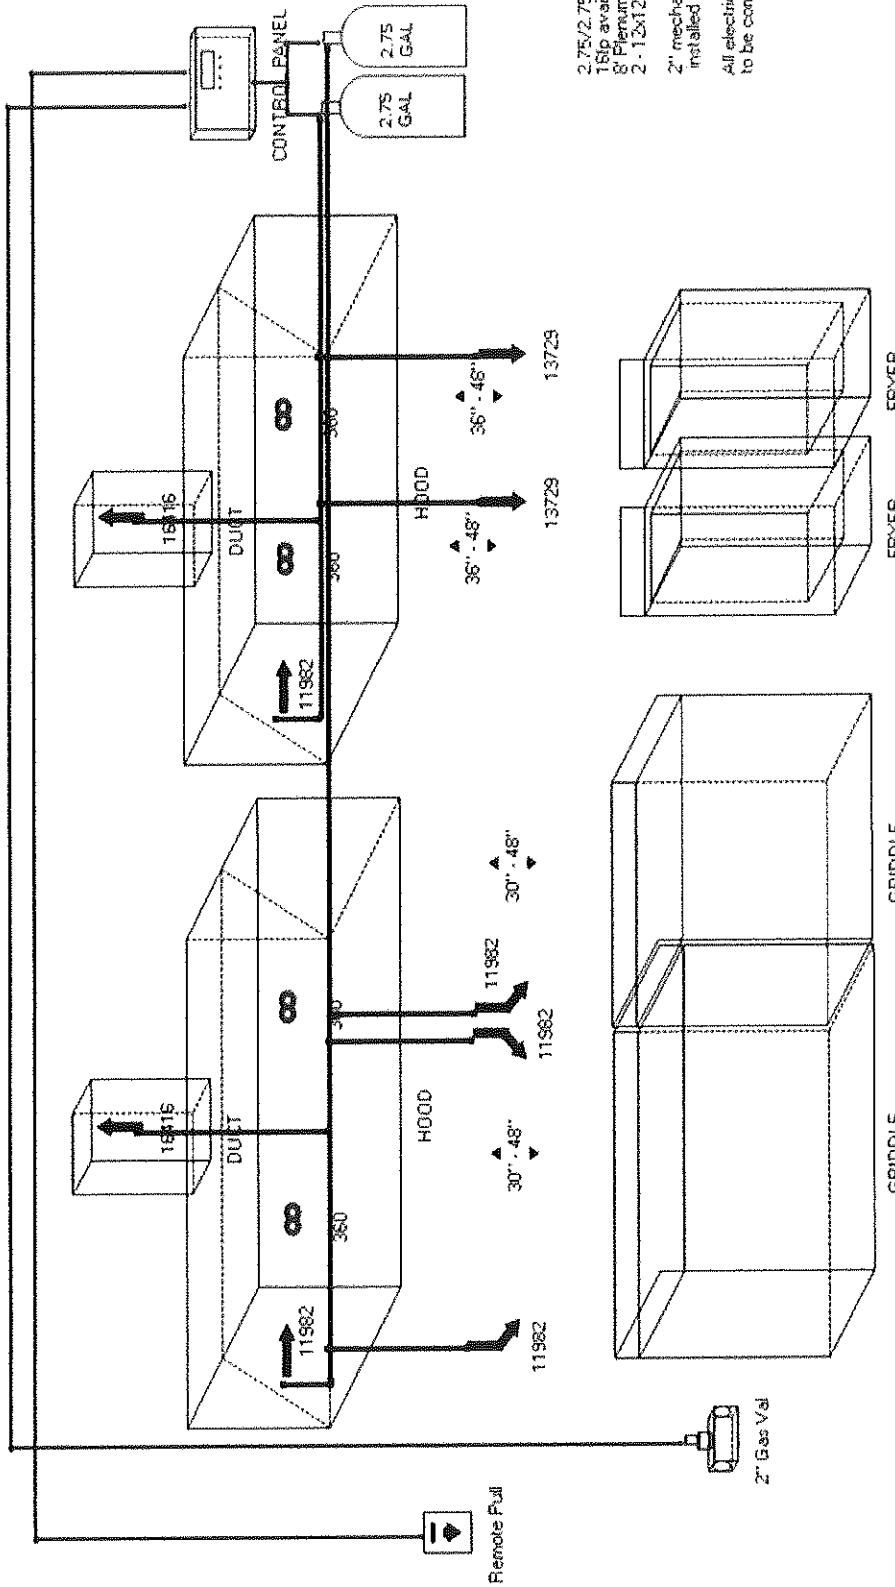


2.75/2.75 Amerex KP System  
 18tp avail/11tp used  
 8' Plenum & 5' Plenum  
 2 - 12x12 ducts  
 2\"/>

**LOGANVILLE FIRE & EMERGENCY SERVICES**  
**APPROVED BY**  
  
**FIRE MARSHAL**  
**KENT DURDEN**  
 2:14 pm, Sep 07 2021

Stamp

Total System Flow Points = 16 . Flow Points Used = 11

	Designed & Installed by: Peach State Fire Inc 626 Industrial Blvd Gainesville, GA 30501 770-536-3948	For: Freddy's 4245 US-78 Loganville, Ga 30052	Lic #: 0043B Designer: Vicki Whitmire Permit #: 21-093 Date: 9/7/2021
---	--	--	--