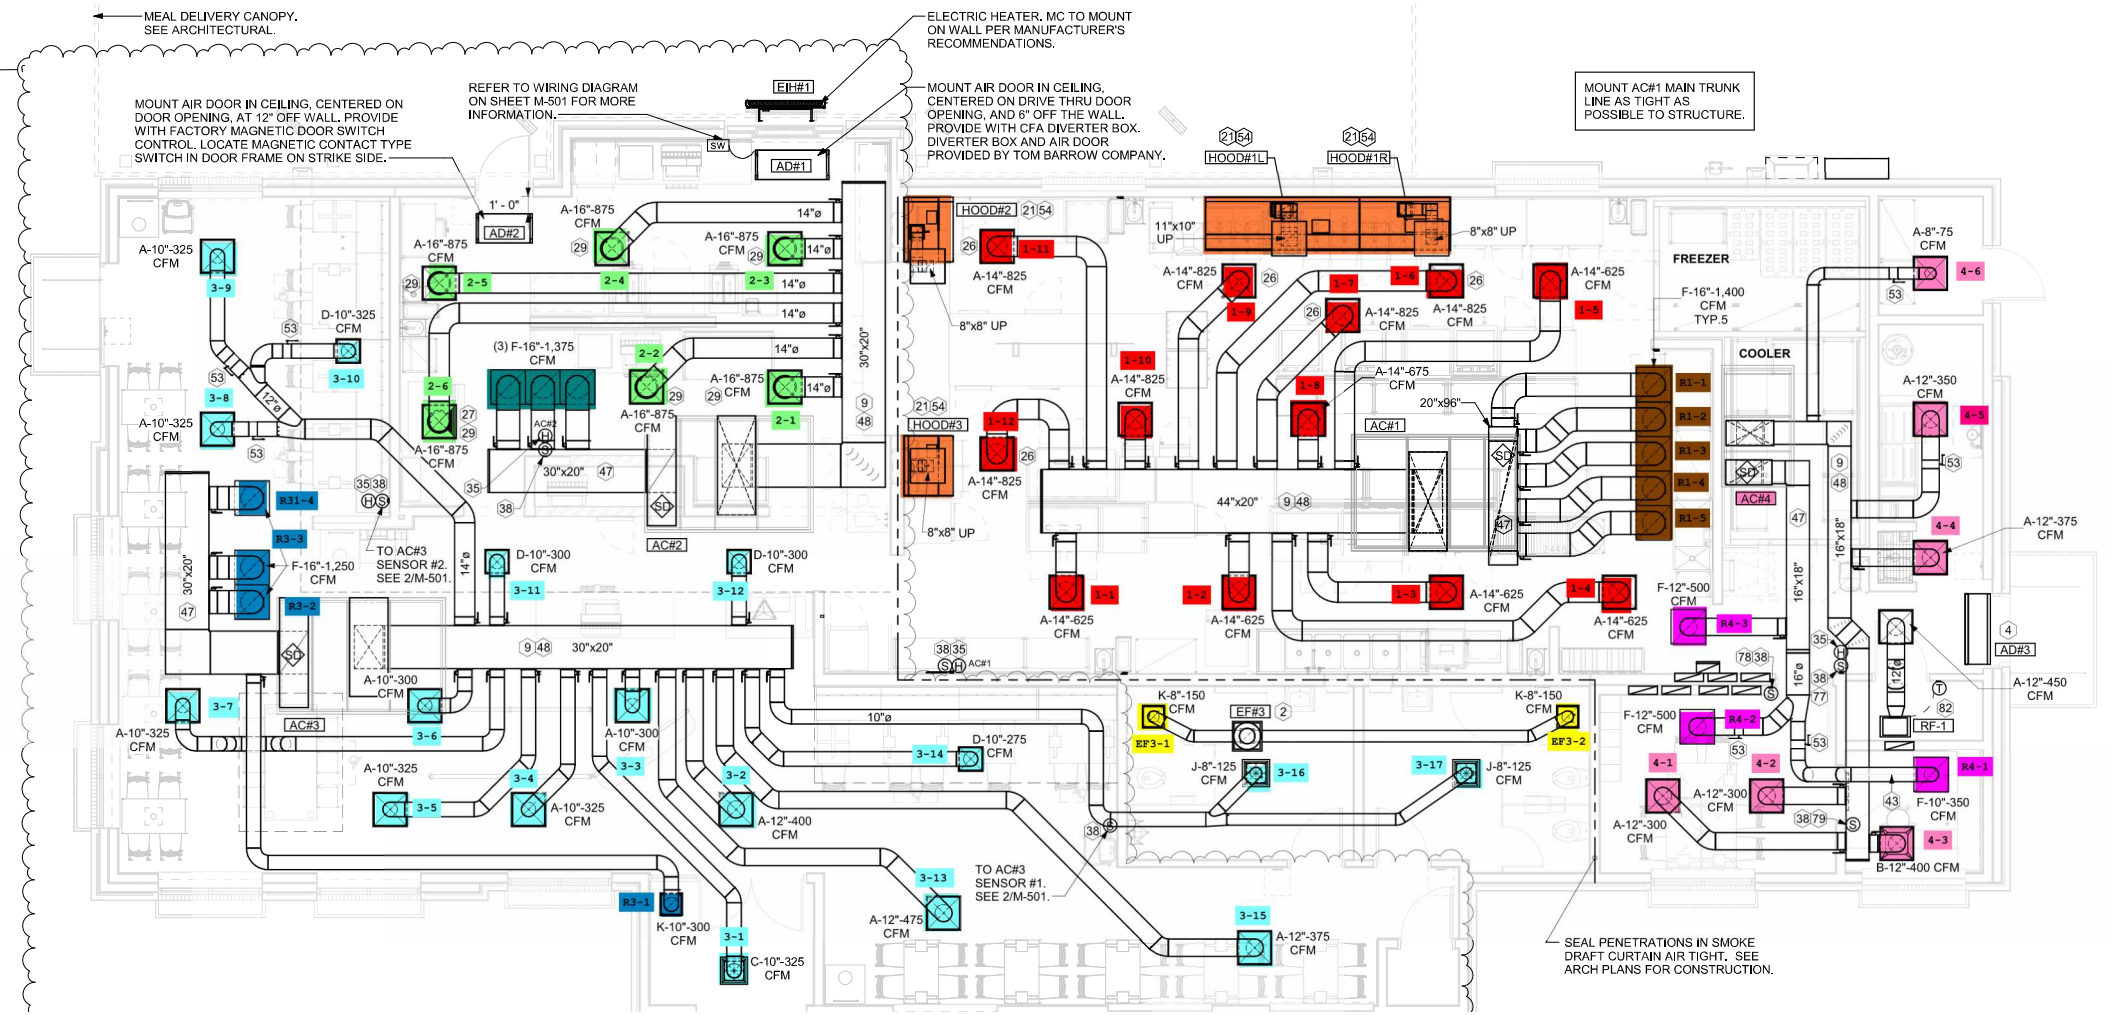
MEAL DELIVERY CANOPY. SEE ARCHITECTURAL.
MOUNT AIR DOOR IN CEILING, CENTERED ON DOOR OPENING, AT 12" OFF WALL. PROVIDE WITH FACTORY MAGNETIC DOOR SWITCH CONTROL. LOCATE MAGNETIC CONTACT TYPE SWITCH IN DOOR FRAME ON STRIKE SIDE.
REFER TO WIRING DIAGRAM ON SHEET M-501 FOR MORE INFORMATION.
ELECTRIC HEATER. MC TO MOUNT ON WALL PER MANUFACTURER'S RECOMMENDATIONS.
MOUNT AIR DOOR IN CEILING, CENTERED ON DRIVE THRU DOOR OPENING, AND 6" OFF THE WALL. PROVIDE WITH CFA DIVERTER BOX. DIVERTER BOX AND AIR DOOR PROVIDED BY TOM BARROW COMPANY.
MOUNT AC#1 MAIN TRUNK LINE AS TIGHT AS POSSIBLE TO STRUCTURE.
EH#1
AD#1
AD#2
AD#3
HOOD#1L
HOOD#1R
HOOD#2
HOOD#3
AC#1
AC#2
AC#3
AC#4
EF3-1
EF3-2
EF#3
RF-1
FREEZER
COOLER
TO AC#3 SENSOR #2. SEE 2/M-501.
TO AC#3 SENSOR #1. SEE 2/M-501.
SEAL PENETRATIONS IN SMOKE DRAFT CURTAIN AIR TIGHT. SEE ARCH PLANS FOR CONSTRUCTION.
A-10"-325 CFM
D-10"-325 CFM
A-16"-875 CFM
(3) F-16"-1,375 CFM
F-16"-1,250 CFM
D-10"-300 CFM
A-10"-300 CFM
A-10"-325 CFM
A-12"-400 CFM
D-10"-275 CFM
K-10"-300 CFM
C-10"-325 CFM
A-12"-475 CFM
A-12"-375 CFM
A-14"-825 CFM
A-14"-625 CFM
A-14"-675 CFM
F-16"-1,400 CFM TYP.5
K-8"-150 CFM
J-8"-125 CFM
A-8"-75 CFM
A-12"-350 CFM
A-12"-375 CFM
A-12"-450 CFM
F-12"-500 CFM
A-12"-300 CFM
F-10"-350 CFM
B-12"-400 CFM
11"x10" UP
8"x8" UP
20"x96"
44"x20"
30"x20"
16"x18"
10"ø
12"ø
14"ø