

CONDENSER, IF REFRIGERANT PIPING TO  
STAINLESS STEEL SHROUD AS SHOWN


INSTALLATION INSTRUCTIONS AND AS  
SHOWN.

DETAILS IN THE ARCHITECTURAL AND  
MECHANICAL FURNISHED BY CHIPOTLE ON

1 PER DETAIL 1/TI-M700. TYPICAL.  
INDICATOR WITH REMOTE KEY OPERATED  
UNIT 60" AFF. TYPICAL.  
2 PER DETAIL 6/TI-M700. SEE  
SECTION. INSTALL UV WARNING STICKERS  
ON SS DOOR(S) THROUGH WHICH THE

TERMINATION AND OUTSIDE AIR  
FOR COMBUSTION AIR INTAKE AND  
FOR MORE INFORMATION ON WATER

ON OPPOSITE SIDE OF ROOM AT  
ROOM ROOM.

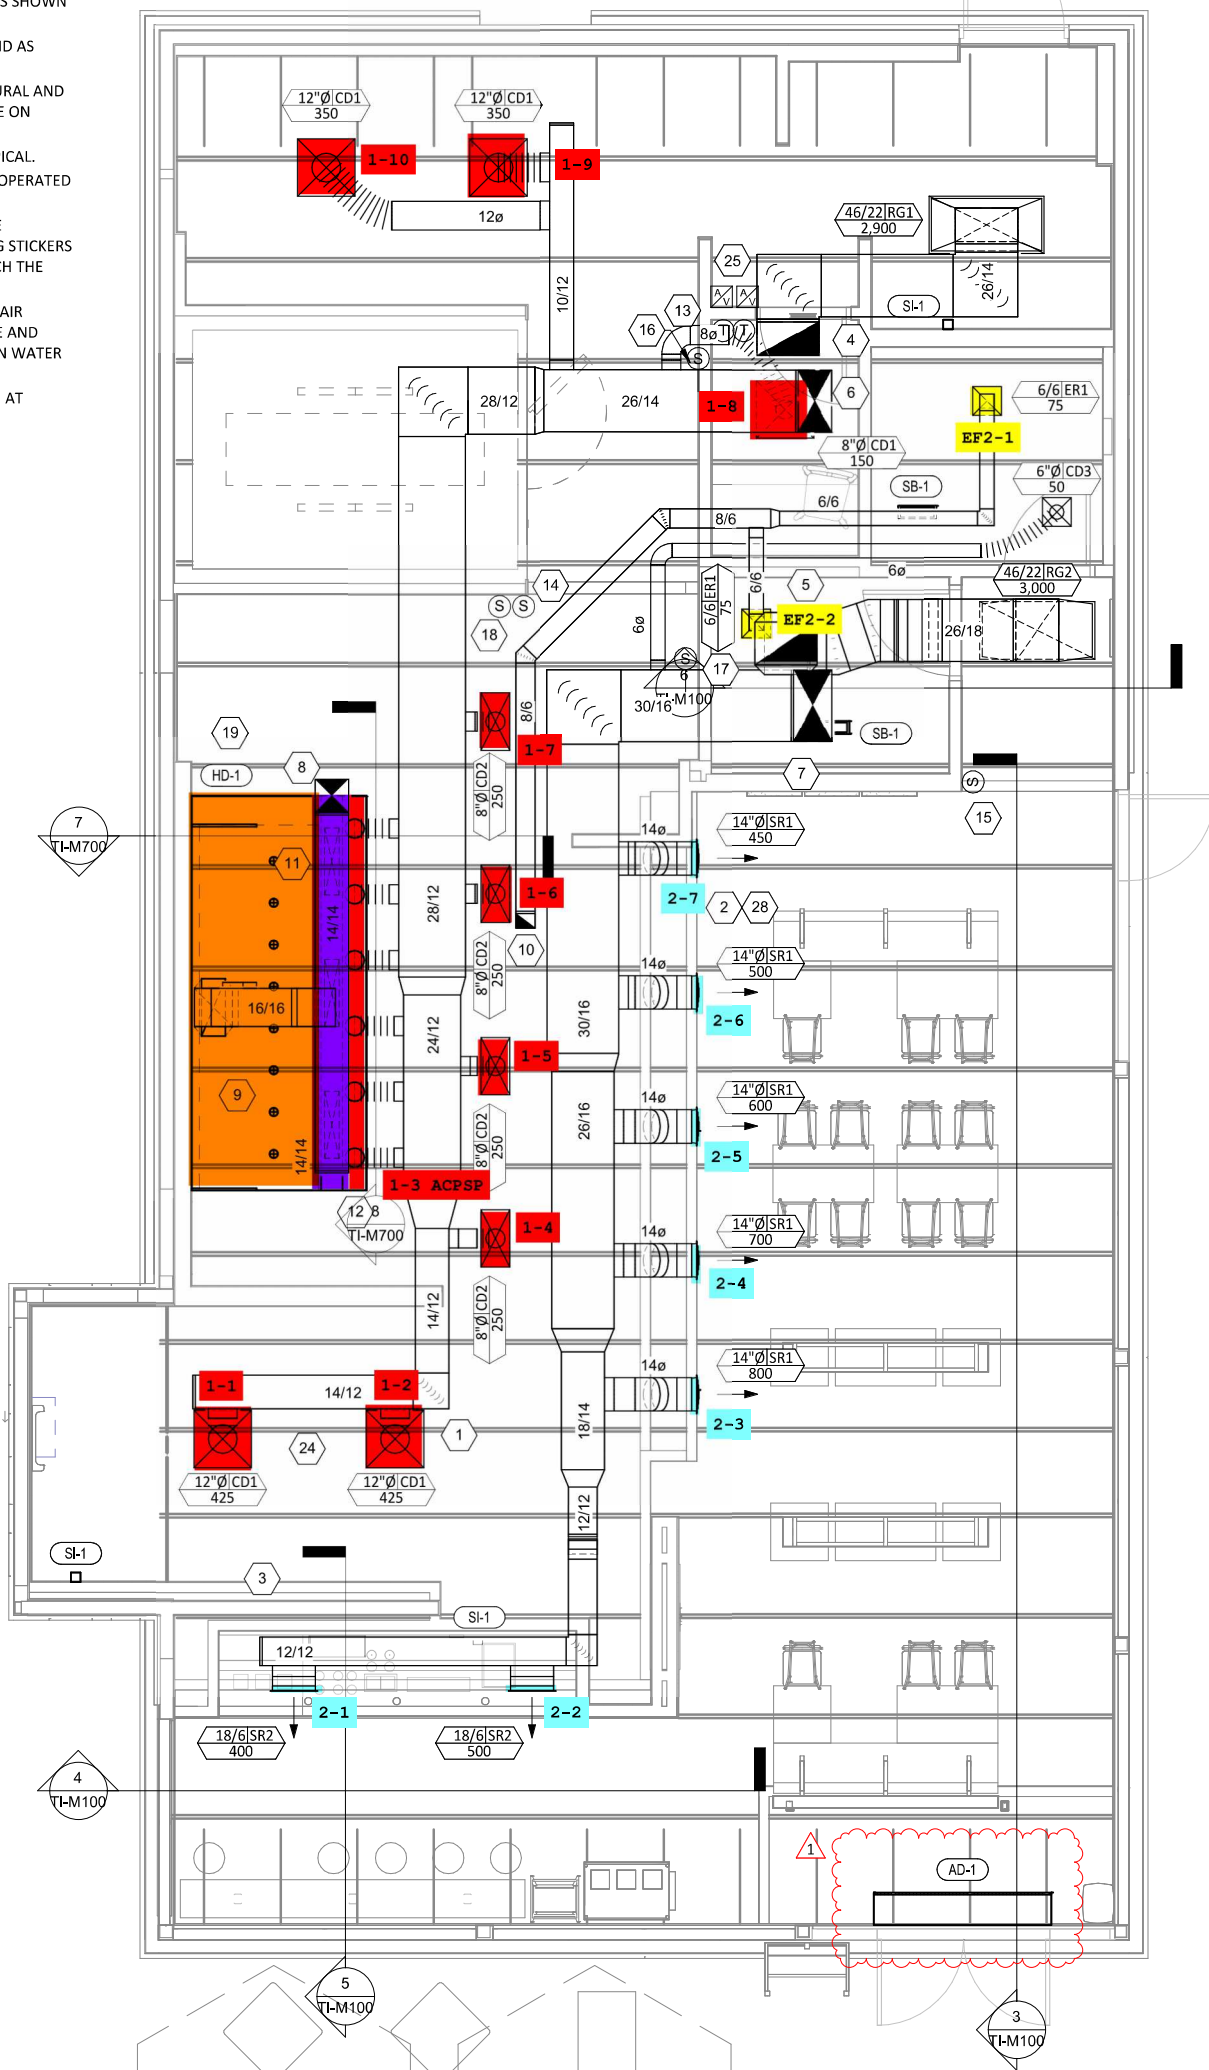

FTER  
ON AIR INTAKE

CO

COPYRIGHT  
THIS DRAWING AND ALL  
CHIPOTLE  
USE OF THIS  
EXTENDED  
CHIPOTLE



STORE NO. 5390

Issue Reco  
10.24.22  
12.19.22  
03.24.23

Revisions:  
1 03.24.23

Drawn:  
AJJ

Project No  
240105E

Contents:  
HVA