

MECHANICAL SYMBOL LEGEND

DUCTWORK	
	SQ. DUCT SIZE (WIDTH X HEIGHT)
	OVAL DUCT SIZE (WIDTH / HEIGHT)
	ROUND DUCT SIZE (DIAMETER)
	EXISTING DUCT TO REMAIN
	DUCT TO BE DEMOLISHED
	SUPPLY AIR
	OUTDOOR AIR
	RETURN AIR
	GENERAL EXHAUST AIR
	KITCHEN EXHAUST DUCT
	LABORATORY FUME EXHAUST
	FLUE GAS VENT
	RECT. SUPPLY DUCT RISE / DROP
	ROUND SUPPLY DUCT RISE / DROP
	RECT. RETURN DUCT RISE / DROP
	ROUND RETURN DUCT RISE / DROP
	RECT. EXHAUST DUCT RISE / DROP
	ROUND EXHAUST DUCT RISE / DROP
DIFFUSER/GRILLES	
	TYPE (SEE SCHEDULE) AIRFLOW NECK SIZE / MODULE SIZE
	AIRFLOW NECK SIZE TYPE COUNT FOR SPACE
	AIRFLOW SLOT(S) / ACTIVE LENGTH
	AIRFLOW NECK SIZE / MODULE SIZE
MECHANICAL EQUIPMENT	
	UNIT IDENTITY
	EXISTING TO REMAIN EQUIPMENT
	EXISTING RELOCATED EQUIPMENT
DUCT ACCESSORIES	
	BALANCING DAMPER
	MOTORIZED DAMPER
	BACKDRAFT DAMPER
	SMOKE DAMPER
	FIRE DAMPER
	COMB. FIRE/SMOKE DAMPER
	DUCT SMOKE DETECTOR
MECHANICAL DEVICES	
	UNIT IDENTITY
	TEMPERATURE SENSOR
	TEMP/HUMIDITY SENSOR
	TEMP/CO2 SENSOR
	THERMOSTAT
	HUMIDISTAT
	CARBON DIOXIDE DETECTOR
	CARBON MONOXIDE DETECTOR
	NITROGEN DIOXIDE DETECTOR
GENERAL PLAN SYMBOLS	
	PLAN REVISION NUMBER
	DETAIL NUMBER ON SHEET
	SHEET NUMBER WHERE DETAIL IS PLACED
	KEYNOTE SYMBOL
	CONTINUATION SYMBOL
	POINT WHERE NEW CONNECTS TO EXISTING
	ROOM NAME / NUMBER
	AREA BEING DEMOLISHED
	AREA NOT IN CONTRACT

MECHANICAL GENERAL NOTES

- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE CURRENT EDITION OF ALL APPLICABLE CODES LOCAL CODES AS APPLIED BY THE AUTHORITY HAVING JURISDICTION.
- DO NOT SCALE DRAWINGS. VERIFY DIMENSIONS IN FIELD PRIOR TO COMMENCEMENT OF WORK. MECHANICAL PLANS ARE GENERAL, DIAGRAMMATIC IN NATURE, AND ARE TO BE READ IN CONJUNCTION WITH ARCHITECTURAL, PLUMBING, ELECTRICAL, FIRE SPRINKLER, STRUCTURAL AND INTERIOR DESIGNER PLANS AND SHALL BE CONSIDERED AS ONE SET OF DOCUMENTS. PROVIDE OFFSETS AND DEVIATIONS FROM WORK SHOWN ON THE DRAWINGS AS MAY BE NECESSARY TO FIT ACTUAL SPACE CONDITIONS AT NO ADDITIONAL COST TO THE OWNER. DUCTWORK CHANGES MAY BE MADE BY CONTRACTOR USING EQUIVALENT SIZED DUCT. CONTACT ENGINEER IF DUCT AREA WILL NOT FIT.
- THE OWNER, OPERATOR, ARCHITECT NOR ENGINEER ARE RESPONSIBLE FOR THE CONTRACTOR'S SAFETY PRECAUTIONS, MEANS AND METHODS, WORK TECHNIQUES, CONSTRUCTION SEQUENCE, OR PROCEDURES REQUIRED TO COMPLETE THE WORK.
- COORDINATE WITH ELECTRICAL, PLUMBING, STRUCTURAL, FIRE PROTECTION CONTRACTOR SHALL PROVIDE A COMPLETE MECHANICAL SYSTEM(S) AS DETAILED ON THE DRAWINGS AND SPECIFICATIONS. WORK CONSISTS OF PROVIDING ALL MATERIALS, EQUIPMENT, APPURTENANCES, ETC. REQUIRED FOR A COMPLETE SYSTEM(S). INCLUDE ANY INCIDENTAL APPARATUS, APPLIANCES, MATERIALS, LABOR, PERMITS, SERVICES, ETC. NECESSARY TO MAKE WORK COMPLETE AND READY FOR OPERATION. IT IS THE INTENT OF THE DRAWINGS AND SPECIFICATIONS TO CALL FOR COMPLETE, FINISHED WORK, TESTED, AND READY FOR OPERATION.
- CONTRACTOR IS RESPONSIBLE FOR IDENTIFYING CONFLICTS IN THE DRAWINGS AND SPECIFICATIONS PRIOR TO BIDDING AND REPORTING CONFLICTS TO THE ENGINEER BEFORE BIDDING. ANY CHANGES RESULTING FROM CONFLICTS IN THE FIELD, WHICH WERE NOT BROUGHT TO THE ENGINEER'S ATTENTION, ARE TO BE MADE BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
- CONTRACTOR SHALL GUARANTEE THE INSTALLATION AGAINST DEFECTS IN MATERIALS AND WORKMANSHIP WHICH MAY OCCUR UNDER NORMAL USAGE FOR A PERIOD OF ONE YEAR AFTER OWNER'S ACCEPTANCE. DEFECTS SHALL BE PROMPTLY REMEDIATED WITHOUT COST TO THE OWNER.
- CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS, FEES, INSPECTION AND TESTS. CONTRACTOR SHALL OBTAIN PERMIT AND APPROVED SUBMITTALS PRIOR TO COMMENCEMENT OF WORK OR ORDERING EQUIPMENT. CONTRACTOR SHALL BE PRESENT FOR ALL INSPECTIONS OF HIS WORK BY REGULATORY AUTHORITIES.
- CONTRACTOR SHALL PROVIDE RECORD DRAWINGS TO THE BUILDING OWNER AND ARCHITECT. DRAWINGS SHALL INCLUDE ALL ADDENDUM ITEMS, CHANGE ORDERS, ALTERATIONS, REROUTING, ETC.
- CONTRACTOR SHALL PROVIDE INSURANCE FOR PROTECTION AGAINST PUBLIC LIABILITY AND PROPERTY DAMAGE FOR THE DURATION OF THE WORK.
- ALL MATERIAL SHALL BE NEW OF U.S. MANUFACTURER OF GOOD QUALITY. ALL WORK SHALL BE PERFORMED AT INDUSTRY STANDARD QUALITY LEVEL BY CERTIFIED PROFESSIONALS. ALL EQUIPMENT SHALL BE UL OR ETL LISTED.
- CONTRACTOR SHALL PROVIDE SHOP DRAWINGS FOR ALL MECHANICAL EQUIPMENT, CONTROLS AND ACCESSORIES COORDINATED WITH ALL TRADES AT ONE TIME, INDEXED IN A NEAT AND ORDERLY MANNER. PARTIAL SUBMITTALS WILL NOT BE ACCEPTED. CONTRACTOR SHALL NOT ORDER ANY EQUIPMENT WITHOUT APPROVAL FROM ENGINEER, ARCHITECT, OWNER, AND INTERIOR DESIGNER (IF APPLICABLE).
- COORDINATE EXACT LOCATION OF ALL DIFFUSERS AND RETURNS WITH ARCHITECTURAL REFLECTED CEILING PLAN.
- CONTRACTOR SHALL PROVIDE ACCESS PANELS FOR ALL CONCEALED MECHANICAL EQUIPMENT. PANELS IN RATED WALLS OR CEILINGS MUST MAINTAIN THE SAME RATING AND MUST MATCH THE FINISH OF THE WALL OR CEILING IN WHICH IS INSTALLED.
- LOCATE THERMOSTATS, TEMPERATURE SENSORS, CONTROLLERS, CO2 SENSORS, AND HUMIDITY SENSORS ABOVE FINISHED FLOOR AS PER ACCESSIBILITY CODE SECTION 5 REQUIREMENT 5. COORDINATE LOCATIONS WITH OTHER EQUIPMENT, FURNITURE, AND DOOR SWINGS. MECHANICAL CONTRACTOR SHALL COORDINATE WITH ELECTRICAL CONTRACTOR ALL REQUIREMENTS FOR JUNCTION BOXES, CONDUITS, CONTROL WIRING, POWER, ETC. AND DEFINE RESPONSIBILITIES AND SCOPE OF WORK FOR EACH TRADE PRIOR TO PURCHASING/INSTALLATION.
- PROVIDE NEW FILTERS FOR ALL AIR CONDITIONING EQUIPMENT BEFORE START-UP. REPLACE PRIOR TO FINAL ACCEPTANCE BY OWNER.
- CONTRACTOR SHALL PROVIDE A CERTIFIED TEST & BALANCE REPORT AT COMPLETION OF PROJECT PRIOR TO FINAL INSPECTION. IT SHALL BE DONE BY AN INDEPENDENT COMPANY FOR ALL MECHANICAL EQUIPMENT, AIR AND WATER DEVICES, DAMPERS, AND ANY AIR MOVING SYSTEMS. THE TEST AND BALANCE REPORT SHALL BE IN ACCORDANCE WITH THE ASHRAE OR NEBS STANDARDS AND PROCEDURES AND SHALL INCLUDE AIR QUANTITIES FOR ALL SUPPLY GRILLES, RETURN GRILLES AND EXHAUST GRILLES AND THE LEAVING AND ENTERING AIR TEMPERATURE (°F) FROM SUPPLY GRILLES, EVAPORATORS, ENERGY RECOVERY UNITS AND ANY TYPE OF HEAT EXCHANGERS. CONTRACTOR SHALL INCLUDE COSTS NECESSARY (PART OF BID) TO MAKE ONE CHANGE IN EACH UNIT'S SHEAVE, BUSHINGS AND BELTS. BALANCING DAMPERS REQUIRED AND ANY OTHER DEVICES REQUIRED FOR THE CORRECT BALANCE OF THE SYSTEM AS REQUIRED BY THE TAB FIRM.
- THE MECHANICAL CONTRACTOR SHALL COORDINATE WITH THE GENERAL CONTRACTOR AND OTHER TRADES FOR ALL REQUIRED OPENINGS IN WALLS, FOUNDATIONS, FLOORS, AND ROOFS.
- REMOVE FROM THE SITE AND LEGALLY DISPOSE OF ALL ITEMS GENERATED AS CONSTRUCTION DEBRIS AS A RESULT OF NEW WORK OF THIS PROJECT.
- ALL OUTSIDE AIR INLETS SHALL BE LOCATED A MINIMUM OF 10 FEET FROM ANY EXHAUST AIR OUTLET OR PLUMBING VENT STACK COORDINATE WITH THE PLUMBING DRAWINGS AND WITH THE PLUMBING AND GENERAL CONTRACTORS IN THE FIELD.
- ENGINEER HAS VERIFIED DIMENSIONAL AND PERFORMANCE SUITABILITY OF BASIS-OF-DESIGN EQUIPMENT MANUFACTURERS AS LISTED IN THE EQUIPMENT SCHEDULES. CONTRACTOR SHALL BE RESPONSIBLE TO VERIFY UNIT PROPOSED TO BE INSTALLED FITS ALL REQUIRED PROJECT DIMENSIONS AND MEETS ALL SCHEDULED OR SPECIFIED PERFORMANCE CRITERIA PRIOR TO BID. ANY ADDITIONAL WORK DUE TO EQUIPMENT OTHER THAN THAT SPECIFIED AS 'BASIS-OF-DESIGN' SHALL BE AT THE EXPENSE OF THE CONTRACTOR.
- UNDERCUT DOORS BY 3/4" TO ALLOW RETURN OR EXHAUST AIR FLOW. COORDINATE WITH ARCHITECTURAL DRAWINGS AND WITH GENERAL CONTRACTOR.
- THE MECHANICAL CONTRACTOR SHALL VERIFY ALL MECHANICAL EQUIPMENT LOCATIONS AND BE RESPONSIBLE FOR ALL RELATED CLEARANCES IN THE FIELD. PROVIDE ADEQUATE MAINTENANCE CLEARANCE AROUND EACH INDOOR AND OUTDOOR UNIT PER MANUFACTURER'S RECOMMENDATIONS. COORDINATE EXACT LOCATION OF ALL MECHANICAL UNITS IN THE FIELD WITH THE ARCHITECT AND THE OWNER LOCATE EQUIPMENT REQUIRING ACCESS 2'-0" MAXIMUM ABOVE CEILING.

MECHANICAL GENERAL DUCTWORK NOTES

- ALL DUCT SIZES SHOWN ARE INSIDE CLEAR DIMENSIONS.
- DUCT CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE SMACNA HVAC DUCT CONSTRUCTION STANDARD AND DETAILS ON THESE PLANS.
- ALL AIR DEVICES (DIFFUSERS, REGISTERS AND GRILLES) SHALL BE ALL ALUMINUM CONSTRUCTION WITH EXPOSED SURFACE OFF WHITE BAKED ENAMEL FINISH OR AS SPECIFIED BY ARCHITECT. PROVIDE OPPOSED BLADE DAMPERS AT ALL DIFFUSERS AND REGISTERS AS INDICATED ON PLANS. PROVIDE BALANCING DAMPERS WITH EXTRACTOR FOR ALL SUPPLY AND RETURN DIFFUSERS AND REGISTERS TO ENSURE COMPLIANCE AIR FLOW FOR BALANCED RETURN TRANSFER AIR FLOW. REMOTE CABLE OPERATED DAMPERS SHALL BE PROVIDED IN INACCESSIBLE AND HARD CEILING AREAS, "YOUNG REGULATOR OR EQUAL".
- ALL DAMPER CONTROLS SHALL BE ACCESSIBLE.
- ALL PENETRATIONS OF REQUIRED FIRE RATED WALLS, SLABS AND CEILINGS SHALL BE WITH AN ACCESSIBLE UL LABELED FIRE DAMPER OR WITH A UL LISTED FIRE STOPPING SYSTEM INSTALLED IN ACCORDANCE WITH THE MANUFACTURE'S LISTED DETAILS AND SPECS.
- ALL BRANCH TAKE-OFFS SHALL BE PROVIDED WITH MANUAL VOLUME DAMPERS. PROVIDE RADIUS ELBOWS WHERE FEASIBLE. SQUARE ELBOWS AND TEE'S SHALL BE FURNISHED W/SINGLE FOIL TURNING VANES. PROVIDE MANUAL VOLUME DAMPERS WITH EXTRACTOR AT ALL FLEX TAKE-OFFS. PROVIDE REMOTE, CABLE OPERATED VOLUME DAMPERS IN INACCESSIBLE AND HARD CEILING AREAS, "YOUNG REGULATOR" OR EQUAL.
- SMACNA DUCT PRESSURE CLASSES BASED ON OPERATING PRESSURE ARE: 1/2", 1", 2", 3", 4", 6", AND 10". EACH DUCT SYSTEM SHALL BE CONSTRUCTED FOR THE SPECIFIC DUCT PRESSURE CLASS SHOWN ON PLANS. WHERE NO PRESSURE CLASS IS SPECIFIED FOR CONSTANT VOLUME SYSTEMS, 1" W.G. PRESSURE CLASS IS THE BASIS OF COMPLIANCE WITH THE SMACNA STANDARDS REGARDLESS OF VELOCITY. WHERE NO PRESSURE CLASS IS SPECIFIED FOR VARIABLE VOLUME SYSTEMS, 2" W.G. PRESSURE CLASS IS THE BASIS OF COMPLIANCE WITH THE SMACNA STANDARDS FOR DUCTWORK UPSTREAM OF VAV BOXES. ALL DUCTWORK SHALL BE SEALED TO SMACNA "HVAC DUCT CONSTRUCTION STANDARDS" FOR ITS PRESSURE CLASS SEALING METHODS.
- ALL INSULATION SHALL HAVE FIRE/SMOKE RATING LESS THAN 25/50.

MECHANICAL SHEET INDEX

M-001	MECHANICAL LEGEND, SYMBOLS, AND ABBREVIATIONS
M-010	MECHANICAL SPECIFICATIONS
M-011	MECHANICAL SPECIFICATIONS
M-020	MECHANICAL COMPLIANCE FORMS
M-100	HVAC PLANS
M-300	MECHANICAL SCHEDULES
M-400	MECHANICAL DETAILS

MECHANICAL ABBREVIATIONS

ABV	ABOVE
ADD	ADDENDUM
AFI	ABOVE FINISHED FLOOR
AFUE	ANNUAL FUEL UTILIZATION EFFICIENCY
ALT	ALTERNATE
ARCH	ARCHITECT/ARCHITECTURAL
BFF	BELOW FINISHED FLOOR
BLW	BELOW
BTU	BRITISH THERMAL UNITS
BTUH	BRITISH THERMAL UNITS PER HOUR
CAP	CAPACITY
CB	CATCH BASIN
CFM	CUBIC FEET PER MINUTE
D	DEGREE
DB	DRY BULB
DIA	DIAMETER
DN	DOWN
E/A	EXHAUST AIR
EACH	EACH
EAT	ENTERING AIR TEMPERATURE
ELEC	ELECTRICAL
EQUIP	EQUIPMENT
ETC	ETCETERA
EWT	ENTERING WATER TEMPERATURE
EXIST	EXISTING
F	DEGREES FAHRENHEIT
FL	FLOOR
FPM	FEET PER MINUTE
FT	FOOT/FEET
GAL	GALLON
GC	GENERAL CONTRACTOR
GPM	GALLONS PER MINUTE
HP	HORSE POWER
HTG	HEATING
IN	INCH
LA	LEAVING AIR TEMPERATURE
LB/HR	POUNDS PER HOUR
LWT	LEAVING WATER TEMPERATURE
M/A	MIXED AIR
MAX	MAXIMUM
MBH	ONE THOUSAND BTU PER HOUR
MECH	MECHANICAL
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MTR	MOTOR
NC	NOISE CRITERIA
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
Ø	ROUND
O/A	OUTSIDE AIR
PD	PRESSURE DROP
PLBG	PLUMBING
PWR	POWER
R	DUCT RISER
RA	RETURN AIR
RE	RETURN/EXHAUST FAN
RH	RELATIVE HUMIDITY
R/LA	RELIEF AIR
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
SA	SUPPLY AIR
SF	SQUARE FOOT
SP	STATIC PRESSURE
STM	STEAM
T	THERMOSTAT
TD	TEMPERATURE DROP
TEMP	TEMPERATURE
TYP	TYPICAL
UG	UNDERGROUND
UCON	UNLESS OTHERWISE NOTED
VAV	VARIABLE AIR VOLUME
VENT	VENTILATION
WB	WET BULB




sweetgreen

3102 WEST 36TH STREET
LOS ANGELES, CA CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION NOR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

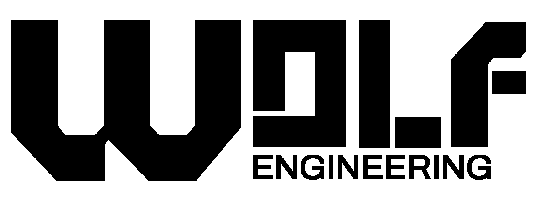

P.O. BOX 38 | DALTON, GA 30722

STAMP:



PROJECT INFORMATION:
BENTONVILLE

PROJECT INFORMATION:
**1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712**

DRAWN BY:	TAL
CHECKED BY:	EW
PROJECT MANAGER:	JH
SG DESIGN MANAGER:	SC
SG DM CHECKED BY:	SC
SG CONSTR. MANAGER:	MC
PROJECT NO.:	20250070.0
TEMPLATE VERSION:	2401

REVISONS		
REV.	DATE	DESCRIPTION
	06/24/2025	ISSUE FOR PERMIT

**MECHANICAL
LEGEND, SYMBOLS,
AND
ABBREVIATIONS**

M-001

SECTION 230600 - BASIC MECHANICAL REQUIREMENTS

PART 1 - GENERAL

- 11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE GENERAL ADMINISTRATIVE AND PROCEDURAL REQUIREMENTS FOR THE INSTALLATION OF MECHANICAL SYSTEMS.
B. WHEN USED IN THESE SPECIFICATIONS THE TERM "PROVIDE" IS DEFINED TO MEAN TO "FURNISH AND INSTALL" MATERIALS, EQUIPMENT, ETC.
12 APPLICABLE STANDARDS
A. APPLICABILITY OF STANDARDS: EXCEPT WHERE THE CONTRACT DOCUMENTS INCLUDE MORE STRINGENT REQUIREMENTS, APPLICABLE CONSTRUCTION INDUSTRY STANDARDS HAVE THE SAME FORCE AND EFFECT AS IF BOUND OR COPIED DIRECTLY INTO THE CONTRACT DOCUMENTS. SUCH STANDARDS ARE MADE A PART OF THE CONTRACT DOCUMENTS BY REFERENCE.
B. CONFLICTING REQUIREMENTS: WHERE COMPLIANCE WITH TWO OR MORE STANDARDS IS SPECIFIED, AND THE STANDARDS ESTABLISH DIFFERENT OR CONFLICTING REQUIREMENTS FOR MINIMUM QUANTITIES OR QUALITY LEVELS, REFER REQUIREMENTS THAT ARE DIFFERENT, BUT APPARENTLY EQUAL, AND UNCERTAINTIES TO THE ARCHITECT FOR A DECISION BEFORE PROCEEDING.
C. PUBLICATION DATES: WHERE THE DATE OF ISSUE OF A REFERENCED STANDARD IS NOT SPECIFIED, COMPLY WITH THE STANDARD IN EFFECT AS OF DATE OF CONTRACT DOCUMENTS.
D. COMPLY WITH THE REQUIREMENTS OF APPLICABLE LOCAL PLUMBING, MECHANICAL, FIRE PROTECTION, AND BUILDING CODES.

- 13 CONSTRUCTION PERMITS AND INSPECTIONS
A. CONTRACTOR SHALL FILE FOR AND OBTAIN ALL REQUIRED PERMITS AND LICENSES, AND PAY ALL RELATED INSPECTION AND PERMITTING FEES, AS REQUIRED FOR THE EXECUTION OF THE CONTRACT. ARRANGE FOR NECESSARY INSPECTIONS REQUIRED BY CITY, COUNTY, STATE AND OTHER AUTHORITIES HAVING JURISDICTION IN A TIMELY MANNER AND AS REQUIRED OVER THE COMPLETE COURSE OF CONSTRUCTION. DELIVER INSPECTION CERTIFICATES AND WRITTEN APPROVAL NOTICES TO THE OWNER AT CONTRACT CLOSEOUT. THOSE ITEMS AND SYSTEMS DEEMED CRITICAL OR REQUIRED TO OBTAIN A COMPLETED CERTIFICATE OF OCCUPANCY SHALL TAKE PRIORITY OVER NON-CRITICAL ITEMS.
14 WORKMANSHIP AND QUALIFICATIONS
A. ALL EQUIPMENT, MATERIALS, SPECIALTIES, ETC., SHALL BE INSTALLED AND CONNECTED IN ACCORDANCE WITH THE BEST ENGINEERING PRACTICE AND STANDARDS FOR THIS TYPE WORK. UNLESS OTHERWISE SPECIFIED OR SHOWN ON THE DRAWINGS, THE RECOMMENDATIONS OF THE MANUFACTURER SHALL BE FOLLOWED FOR INSTALLING THE WORK.
15 SUBMITTALS
A. PRIOR TO THE PERFORMANCE OF ANY WORK OR INSTALLATION OF ANY MATERIALS, OBTAIN APPROVAL FROM THE ARCHITECT BY SUBMITTING SHOP DRAWINGS AND DATA SHEETS.
B. SUBMITTAL OF SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES WILL BE ACCEPTED ONLY WHEN SUBMITTED BY THE CONTRACTOR. DATA SUBMITTED FROM SUBCONTRACTORS AND MATERIAL SUPPLIERS DIRECTLY TO THE ENGINEER OF RECORD WILL NOT BE ACCEPTED.
C. ANY ITEM WITH A TAG NUMBER MUST BE SUBMITTED FOR REVIEW. SUBMITTALS SHALL PROVIDE ALL PERTINENT DATA AND INFORMATION NECESSARY TO EVALUATE EACH ITEM. IN ADDITION TO THE REQUIREMENTS OUTLINED IN THE SPECIFIC DIVISION 23 SECTIONS, ALL SUBMITTALS MUST INDICATE THE APPLICABLE SPECIFICATION SECTION NUMBER AND EQUIPMENT TAG NUMBER.
D. ARCHITECT'S REVIEW OF SHOP DRAWINGS DOES NOT RELEASE CONTRACTOR FROM RESPONSIBILITY OF COORDINATING HIS WORK AT JOBSITE AND TAKING FIELD MEASUREMENTS. IN CASES WHERE INTERFERENCES BECOME APPARENT, THE CONTRACTOR SHALL NOTIFY ARCHITECT SO THAT SUCH INTERFERENCES MAY BE RESOLVED PRIOR TO PROCEEDING WITH SHOP WORK. NO CLAIM WILL BE ALLOWED FOR WORK THAT MIGHT HAVE TO BE MOVED OR REPLACED BASED ON A CLAIM THAT WORK WAS PLACED IN ACCORDANCE WITH DIMENSIONS SHOWN ON AN APPROVED SHOP DRAWING.

- 16 CONSTRUCTION DOCUMENTS
A. THE DRAWINGS FOR MECHANICAL WORK ARE IN PART DIAGRAMMATIC, INTENDED TO CONVEY THE SCOPE OF WORK AND INDICATE GENERAL ARRANGEMENT AND APPROXIMATE SIZES AND LOCATIONS OF EQUIPMENT AND MATERIALS. WHERE JOB CONDITIONS REQUIRE REASONABLE CHANGES IN INDICATED LOCATIONS AND ARRANGEMENT, THE CONTRACTOR SHALL MAKE SUCH CHANGES AS DIRECTED BY THE ENGINEER, WITHOUT ADDITIONAL COST TO THE OWNER.
B. BECAUSE OF THE SCALE OF THE DRAWINGS, CERTAIN BASIC ITEMS SUCH AS ACCESS PANELS, SLEEVES, ETC. MAY NOT BE SHOWN, BUT WHERE SUCH ITEMS ARE REQUIRED BY THE NATURE OF THE WORK, THEY SHALL BE FURNISHED AND INSTALLED. ROUGH-IN DIMENSIONS AND LOCATIONS SHALL BE VERIFIED WITH THE SUPPLIER OF ALL EQUIPMENT FURNISHED BY OTHER TRADES, OR BY THE OWNER, PRIOR TO THE TIME OF ROUGH-IN.
C. EQUIPMENT SPECIFICATIONS MAY NOT DEAL INDIVIDUALLY WITH MINUTE ITEMS REQUIRED SUCH AS COMPONENTS, PART, CONTROLS AND DEVICES WHICH MAY BE REQUIRED TO MEET THE EQUIPMENT WARRANTIES. WHERE SUCH ITEMS ARE REQUIRED, THEY SHALL BE INCLUDED BY THE SUPPLIER OF THE EQUIPMENT, WHETHER OR NOT SPECIFICALLY CALLED FOR.
D. THE DRAWINGS AND THE SPECIFICATIONS ARE THE SUPPLIER OF THE EQUIPMENT AND SUPPLEMENTARY. IT IS THE INTENT OF BOTH SAID DRAWINGS AND SPECIFICATIONS TO COVER ALL MECHANICAL REQUIREMENTS IN THEIR ENTIRETY AS NEARLY AS POSSIBLE. THE CONTRACTOR SHALL CLOSELY CHECK THE DRAWINGS AND SPECIFICATIONS FOR ANY OBVIOUS ERRORS OR OMISSIONS AND BRING ANY SUCH CONDITION TO THE ATTENTION OF THE ENGINEER PRIOR TO THE RECEIPT OF BID, IN ORDER TO PERMIT CLARIFICATION BY MEANS OF A MAILED ADDENDUM. IF THERE ARE NO QUESTIONS PRIOR TO THE BID PROPOSAL DATE, IT SHALL BE UNDERSTOOD THAT THE DRAWINGS AND SPECIFICATIONS ARE COMPLETE AND CORRECT, AND THAT THE INTENT OF SAID DOCUMENTS WILL BE COMPLIED WITH, AND THE INSTALLATION TO BE COMPLETE IN ALL RESPECTS, ACCORDING TO SAID INTENT. IF THERE IS A CONFLICT BETWEEN THE DRAWINGS AND SPECIFICATIONS, THE MORE STRINGENT REQUIREMENT SHALL GOVERN, IF NOT CLARIFIED IN WRITING BY THE ENGINEER.
E. THE CONTRACTOR SHALL LOCATE ALL EQUIPMENT WHICH MUST BE SERVICED, OPERATED OR MAINTAINED IN FULL ACCESSIBLE POSITIONS. MINOR DEVIATIONS FROM THE CONTRACT DRAWINGS MAY BE MADE TO ALLOW FOR BETTER ACCESSIBILITY, BUT CHANGES OF MAGNITUDE, OR WHICH INVOLVE EXTRA COST, SHALL NOT BE MADE WITHOUT APPROVAL. AMPLE SPACE SHALL BE ALLOWED FOR REMOVAL OF ALL PARTS THAT MAY REQUIRE REPLACEMENT OR SERVICE IN THE FUTURE.

- 17 PRE-BID SITE VISIT
A. PERSONALLY INSPECT THE SITE OF THE PROPOSED WORK AND BECOME FULLY INFORMED OF CONDITIONS UNDER WHICH THE WORK IS TO BE DONE. FAILURE TO DO SO WILL NOT BE CONSIDERED SUFFICIENT JUSTIFICATION TO REQUEST OR OBTAIN EXTRA COMPENSATION OVER AND ABOVE THE CONTRACT PRICE.
PART 2 - PRODUCTS
21 DESIGN BASIS
A. THE PRODUCTS/MATERIALS SPECIFICALLY NAMED IN THE SPECIFICATION AND/OR ON THE DRAWINGS ARE THE BASIS OF DESIGN. THE ARCHITECT AND/OR OWNER'S REPRESENTATIVE RESERVES THE RIGHT TO REJECT PRODUCT/MATERIALS, EVEN IF FROM OTHER ACCEPTABLE MANUFACTURERS, IF IT IS FELT THEY DO NOT MEET THE INTENT OF THE SPECIFICATION.
B. THE ARCHITECT RESERVES THE SOLE RIGHT FOR THE APPROVAL OF PROPOSED MATERIAL FOR EQUIPMENT, AND THE PHRASE, "OR AN APPROVED EQUIVALENT", USED IN THESE SPECIFICATIONS, OR ON THE DRAWINGS, SHALL BE INTERPRETED TO MEAN AN EQUIVALENT APPROVED BY THE ARCHITECT.
C. ALL CHANGES REQUIRED BY ALTERNATE EQUIPMENT SHALL BE MADE AT NO ADDITIONAL COST TO THE OWNER, AND ALL COSTS INCURRED BY OTHER TRADES, PUBLIC UTILITIES OR THE OWNER, AS A RESULT OF THE USE OF SUCH EQUIPMENT, SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR.
D. THE CONTRACTOR SHALL IDENTIFY THE DIFFERENCES IN ALTERNATE MATERIAL OR EQUIPMENT AS COMPARED TO THAT SPECIFIED, AND SHALL INDICATE THE BENEFITS TO THE PROJECT AS A RESULT OF SELECTING THE ALTERNATIVE.
E. THE ENGINEER RESERVES THE RIGHT TO REFUSE APPROVAL OF EQUIPMENT WHICH DOES NOT MEET THE SPECIFICATION, IN HIS OPINION, OR OF EQUIPMENT FOR WHICH NO LOCAL EXPERIENCE OF SATISFACTORY SERVICE IS AVAILABLE. THE ENGINEER FURTHER RESERVES THE RIGHT TO REJECT EQUIPMENT FOR WHICH MAINTENANCE SERVICE AND THE AVAILABILITY OF REPLACEMENT PARTS IS QUESTIONABLE.

SECTION 230648 - VIBRATION CONTROLS FOR HVAC

- PART 1 - GENERAL
11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE VIBRATION ISOLATORS AT ALL MECHANICAL EQUIPMENT, UNLESS THE VIBRATION GENERATION COMPONENTS ARE INTERNALLY ISOLATED.
B. TYPES OF VIBRATION CONTROL PRODUCTS REQUIRED INCLUDE NEOPRENE PADS AND SPRING HANGERS.
C. FLOOR OR PAD MOUNTED EQUIPMENT WITHOUT VIBRATION ISOLATORS SHALL BE BOLTED TO THE FLOOR (SLAB OR HOUSEKEEPING PAD) WITH 3/8" DIAMETER EXPANSION BOLTS.
PART 2 - PRODUCTS
21 ACCEPTABLE MANUFACTURERS
A. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE VIBRATION CONTROL PRODUCTS AS MANUFACTURED BY AMBER/BOOTH CO., KORFUND DYNAMICS CORP., MASON INDUSTRIES, INC., OR APPROVED EQUIVALENT.

- PART 3 - EXECUTION
31 MECHANICAL INSTALLATIONS
A. GENERAL: SEQUENCE, COORDINATE, AND INTEGRATE THE VARIOUS ELEMENTS

OF MECHANICAL SYSTEMS, MATERIALS, AND EQUIPMENT. COORDINATE MECHANICAL SYSTEMS, EQUIPMENT, AND MATERIALS INSTALLATION WITH OTHER BUILDING COMPONENTS. VERIFY ALL DIMENSIONS BY FIELD MEASUREMENTS. VERIFY FINAL LOCATIONS FOR ROUGH-INS WITH FIELD MEASUREMENTS AND WITH THE REQUIREMENTS OF THE ACTUAL EQUIPMENT TO BE CONNECTED.

- 3.2 CUTTING AND PATCHING
A. CUT, REMOVE AND LEGALLY DISPOSE OF SELECTED MECHANICAL EQUIPMENT, COMPONENTS, AND MATERIALS AS INDICATED, INCLUDING BUT NOT LIMITED TO REMOVAL OF MECHANICAL PIPING, HEATING UNITS, PLUMBING FIXTURES AND TRIM, AND OTHER MECHANICAL ITEMS MADE OBSOLETE BY THE NEW WORK. MAINTAIN SERVICES TO AREAS OUTSIDE DEMOLITION LIMITS. WHEN SERVICES MUST BE INTERRUPTED, INSTALL TEMPORARY SERVICES FOR AFFECTED AREAS.
B. PROTECT THE STRUCTURE, FURNISHINGS, FINISHES, AND ADJACENT MATERIALS NOT INDICATED OR SCHEDULED TO BE REMOVED.
C. PROVIDE AND MAINTAIN TEMPORARY PARTITIONS OR DUST BARRIERS ADEQUATE TO PREVENT THE SPREAD OF DUST AND DIRT TO ADJACENT AREAS.
D. PATCH EXISTING FINISHED SURFACES AND BUILDING COMPONENTS USING NEW MATERIALS MATCHING EXISTING MATERIALS AND EXPERIENCED INSTALLERS. INSTALLERS' QUALIFICATIONS REFER TO THE MATERIALS AND METHODS REQUIRED FOR THE SURFACE AND BUILDING COMPONENTS BEING PATCHED.
3.3 PAINTING
A. FACTORY PAINTED EQUIPMENT THAT HAS BEEN SCRATCHED OR MARRED SHALL BE REPAINTED TO MATCH ORIGINAL FACTORY COLOR.
B. ALL UNINSULATED BLACK FERROUS METAL ITEMS EXPOSED TO SIGHT SUCH AS EQUIPMENT HANGERS, PIPING, FRAMES AND SUPPORTS NOT PROVIDED WITH FACTORY PRIME COAT, SHALL BE CLEANED AND PAINTED WITH ONE COAT OF RUST INHIBITING PRIMER. IN ADDITION, SUCH ITEMS IN FINISHED SPACES SHALL ALSO BE PAINTED WITH TWO COATS OF FINISH PAINT IN A COLOR TO MATCH ADJACENT SURFACES OR AS OTHERWISE SELECTED BY THE ARCHITECT.

- 3.4 PERFORMANCE
A. ALL EQUIPMENT AND SYSTEMS SHALL BE PROTECTED AGAINST FREEZING, FLOODING, CORROSION, AND OTHER FORMS OF DAMAGE PRIOR TO ACCEPTANCE BY THE OWNER.
B. DESIGN AND FABRICATION FEATURES OR PROVEN METHODS NOT SPECIFICALLY COVERED BY THIS SPECIFICATION SHALL BE SPECIFICALLY STATED AND DOCUMENTED IN THE PROPOSAL.
C. LABOR SHALL BE FURNISHED FOR ASSEMBLING ALL PIECES OF EQUIPMENT WHICH, DUE TO SHIPPING LIMITATIONS, HAVE COMPONENTS WHICH ARRIVE ON THE JOBSITE DISASSEMBLED.
3.5 OPERATING AND MAINTENANCE INSTRUCTIONS
A. ARRANGE FOR EACH INSTALLER OF EQUIPMENT THAT REQUIRES REGULAR MAINTENANCE TO MEET WITH THE OWNER'S PERSONNEL TO PROVIDE INSTRUCTION IN PROPER OPERATION AND MAINTENANCE. IF INSTALLERS ARE NOT EXPERIENCED IN PROCEDURES, PROVIDE INSTRUCTION BY MANUFACTURER'S REPRESENTATIVES.

- 3.6 FINAL INSPECTION
A. PRIOR TO FINAL ACCEPTANCE, ALL SYSTEMS SHALL BE OPERATED TO TEST PERFORMANCE TO THE SATISFACTION OF THE ENGINEER.
B. DEFECTS DEMONSTRATED BY INSPECTIONS AND TESTS SHALL BE CORRECTED TO THE SATISFACTION OF THE ENGINEER AT THE SUBCONTRACTOR'S EXPENSE.

- 3.7 CLEANING OF SYSTEMS AND PREMISES
A. BEFORE THE SYSTEMS ARE TESTED AND BALANCED, DUCTS AND EQUIPMENT SHALL BE THOROUGHLY CLEANED SO THAT NO DIRT, DUST OR OTHER FOREIGN MATTER WILL BE DEPOSITED IN OR CARRIED THROUGH THE SYSTEM.
B. AIR HANDLING UNITS SHALL NOT BE OPERATED WITHOUT FILTERS IN PLACE. ALL AIR FILTERS SHALL BE REPLACED AFTER COMPLETION OF CONSTRUCTION AND PRIOR TO AIR BALANCING. IF AIR HANDLING SYSTEMS ARE USED FOR TEMPORARY HEATING OR COOLING, THE AIR FILTERS SHALL BE CHANGED A MINIMUM OF EVERY TWO WEEKS.
C. WATER AND STEAM SYSTEMS SHALL BE THOROUGHLY FLUSHED AND CLEANED OF ANY AND ALL DELETERIOUS MATERIALS BEFORE THE SYSTEMS ARE PLACED IN OPERATION.
D. ALL EQUIPMENT SHALL BE THOROUGHLY CLEANED OF DIRT AND DEBRIS AT THE COMPLETION OF THE PROJECT AND PRIOR TO ACCEPTANCE BY THE OWNER.

- 3.8 PROTECTION
A. GUARDS, BARRICADES, LIGHTS, SERVICES, ETC., NECESSARY FOR THE PROTECTION OF PERSONS AND PROPERTY SHALL BE FURNISHED AND MAINTAINED.
B. EXISTING WORK SUCH AS PAVEMENTS, LAWNS, SIDEWALKS, FLOORS, CURBS, AND OTHER STRUCTURES AND UTILITIES WHICH ARE DAMAGED OR DISTURBED DUE TO MAKING CONNECTIONS OR ANY PHASE OF OPERATIONS SHALL BE RESTORED TO THE SATISFACTION OF THE OWNER AND THE GOVERNING AUTHORITIES.

- 3.9 SAFETY
A. THE CONTRACTOR SHALL BE RESPONSIBLE FOR INITIATING, MAINTAINING AND SUPERVISING ALL SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE DEMOLITION AND INSTALLATION OF THIS WORK. CONTRACTOR SHALL COMPLY WITH ALL APPLICABLE LAWS, ORDINANCES, RULES, REGULATIONS AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY BEARING ON THE SAFETY OF PERSONS OR PROPERTY OR THEIR PROTECTION FROM DAMAGE, INJURY, OR LOSS.
B. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE IDENTIFICATION AND PREVENTION OF UNSAFE CONDITIONS IN REGARD TO DEMOLITION, CONSTRUCTION, HAZARDOUS MATERIALS, AND EQUIPMENT USAGE. CONTRACTOR SHALL COMPLY WITH ALL OSHA, ENVIRONMENTAL PROTECTION AGENCY, AND LOCAL AUTHORITY REQUIREMENTS.
C. THE CONTRACTOR SHALL ERECT AND MAINTAIN, AS REQUIRED BY EXISTING CONDITION AND PROGRESS OF THE WORK, ALL REASONABLE SAFEGUARDS FOR SAFETY AND PROTECTION, INCLUDING POSTING DANGER SIGNS AND OTHER WARNINGS AGAINST HAZARDS, PROMULGATING SAFETY REGULATIONS AND NOTIFYING OWNERS AND USERS OF ADJACENT UTILITIES.
D. REMOVE DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM DEMOLITION OPERATIONS FROM BUILDING SITE. TRANSPORT AND LEGALLY DISPOSE OF MATERIALS OFF SITE.
E. IF HAZARDOUS MATERIALS ARE ENCOUNTERED DURING DEMOLITION OPERATIONS, COMPLY WITH APPLICABLE REGULATIONS, LAWS, AND ORDINANCES CONCERNING REMOVAL, HANDLING AND PROTECTION AGAINST EXPOSURE OR ENVIRONMENTAL POLLUTION.

SECTION 230700 - MECHANICAL INSULATION

- PART 1 - GENERAL
11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE MECHANICAL INSULATION FOR DUCT AND EQUIPMENT AS INDICATED ON DRAWINGS AND SCHEDULES, AND BY REQUIREMENTS OF THIS SECTION.

- 1.2 QUALITY ASSURANCE
A. PROVIDE COMPOSITE MECHANICAL INSULATION (INSULATION, JACKETS, COVERINGS, SEALERS, MASTICS AND ADHESIVES) WITH FLAME-SPREAD INDEX OF 25 OR LESS, AND SMOKE-DEVELOPED INDEX OF 50 OR LESS, AS TESTED BY ASTM E 84 (NFPA 255) METHOD.

- PART 2 - PRODUCTS
21 ACCEPTABLE MANUFACTURERS
A. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE PRODUCTS MANUFACTURED BY ONE OF THE FOLLOWING: ARMSTRONG WORLD INDUSTRIES, INC.; CERTAINTEED CORP.; KNAUF FIBER GLASS GMBH; OWENS-CORNING FIBERGLAS CORP.

- PART 3 - EXECUTION
31 DUCT AND EQUIPMENT INSULATION APPLICATION SCHEDULE
A. INSULATE CONCEALED DUCT AND EQUIPMENT ACCORDING TO THE FOLLOWING SCHEDULE:

Table with 4 columns: SERVICE, MAX SERVICE TEMP, INSULATION TYPE, INSULATION THICKNESS. Rows include HVAC supply ductwork, HVAC return ductwork, and HVAC plenums.

PART 3 - EXECUTION

- 3.1 APPLICATIONS
A. GENERAL: EXCEPT AS OTHERWISE INDICATED, SELECT VIBRATION CONTROL PRODUCTS IN ACCORDANCE WITH ASHRAE HANDBOOK, 1991 APPLICATIONS VOLUME, CHAPTER 42 "SOUND AND VIBRATION CONTROL", TABLE 34, WHERE MORE THAN ONE TYPE OF PRODUCT IS OFFERED, SELECTION IS INSTALLER'S OPTION.

SECTION 230653 - IDENTIFICATION FOR HVAC PIPING AND EQUIPMENT

- PART 1 - GENERAL
11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE IDENTIFICATION DEVICES SPECIFIED IN THIS SECTION INCLUDING PLASTIC TAPE, AND ENGRAVED PLASTIC-LAMINATE SIGNS.
B. CODES AND STANDARDS: COMPLY WITH ANSI A13.1 FOR LETTERING SIZE, LENGTH OF COLOR FIELD, COLORS, AND VIEWING ANGLES OF IDENTIFICATION DEVICES.

- PART 2 - PRODUCTS
21 ACCEPTABLE MANUFACTURERS
A. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE MECHANICAL IDENTIFICATION MATERIALS AS MANUFACTURED BY ALLEN SYSTEMS, INC., BRADY (W.H.) CO., SIGNMARK DIV., SETON NAME PLATE CORP., OR APPROVED EQUIVALENT.

- 2.2 MECHANICAL IDENTIFICATION MATERIALS
A. GENERAL: PROVIDE MANUFACTURER'S STANDARD PRODUCTS OF CATEGORIES AND TYPES REQUIRED FOR EACH APPLICATION AS REFERENCED IN OTHER DIVISION 23 SECTIONS. WHERE MORE THAN SINGLE TYPE IS SPECIFIED FOR APPLICATION, SELECTION IS INSTALLER'S OPTION, BUT PROVIDE SINGLE SELECTION FOR EACH PRODUCT CATEGORY.

PART 3 - EXECUTION

- 3.1 MECHANICAL EQUIPMENT IDENTIFICATION
A. GENERAL: INSTALL ENGRAVED PLASTIC LAMINATE SIGN OR PLASTIC EQUIPMENT MARKER ON OR NEAR EACH MAJOR ITEM OF MECHANICAL EQUIPMENT AND EACH OPERATIONAL DEVICE, AS SPECIFIED HEREIN IF NOT OTHERWISE SPECIFIED FOR EACH ITEM OR DEVICE.
B. LETTERING SIZE: MINIMUM 1/4" HIGH LETTERING FOR NAME OF UNIT WHERE VIEWING DISTANCE IS LESS THAN 2'-0". 1/2" HIGH FOR DISTANCES UP TO 6'-0". AND PROPORTIONATELY LARGER LETTERING FOR GREATER DISTANCES. PROVIDE SECONDARY LETTERING 2/3 TO 3/4 OF SIZE OF PRINCIPAL LETTERING.
C. TEXT OF SIGNS: IN ADDITION TO NAME OF IDENTIFIED UNIT, PROVIDE LETTERING TO DISTINGUISH BETWEEN MULTIPLE UNITS, INFORM OPERATOR OF OPERATIONAL REQUIREMENTS, INDICATE SAFETY AND EMERGENCY PRECAUTIONS, AND WARN OF HAZARDS AND IMPROPER OPERATIONS.
D. IN ADDITION TO THE PLASTIC SIGN, INSTALL PRESSURE SENSITIVE LABEL DESCRIBED IN PART 2 OR PAINTED STENCIL LABEL ABOVE ON EACH PIECE OF MECHANICAL EQUIPMENT. THOROUGHLY CLEAN EQUIPMENT SURFACE PER LABEL MANUFACTURER'S INSTRUCTIONS PRIOR TO INSTALLING LABEL.

SECTION 230700 - MECHANICAL INSULATION

PART 1 - GENERAL

- 1.1 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE MECHANICAL INSULATION FOR DUCT AND EQUIPMENT AS INDICATED ON DRAWINGS AND SCHEDULES, AND BY REQUIREMENTS OF THIS SECTION.
1.2 QUALITY ASSURANCE
A. PROVIDE COMPOSITE MECHANICAL INSULATION (INSULATION, JACKETS, COVERINGS, SEALERS, MASTICS AND ADHESIVES) WITH FLAME-SPREAD INDEX OF 25 OR LESS, AND SMOKE-DEVELOPED INDEX OF 50 OR LESS, AS TESTED BY ASTM E 84 (NFPA 255) METHOD.

PART 2 - PRODUCTS

- 2.1 ACCEPTABLE MANUFACTURERS
A. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE PRODUCTS MANUFACTURED BY ONE OF THE FOLLOWING: ARMSTRONG WORLD INDUSTRIES, INC.; CERTAINTEED CORP.; KNAUF FIBER GLASS GMBH; OWENS-CORNING FIBERGLAS CORP.
2.2 DUCTWORK AND EQUIPMENT INSULATION MATERIALS
A. RIGID FIBERGLASS DUCTWORK INSULATION (TYPE RFG): ASTM C 612, 'K' VALUE OF 0.29 AT 75 F, NON-COMBUSTIBLE, RIGID, JACKET, CONFRM ASJ OR FSX WITH ARCHITECT.
B. FLEXIBLE FIBERGLASS DUCTWORK INSULATION (TYPE FFG): ASTM C 563, 'K' VALUE OF 0.38 AT 75 F, NON-COMBUSTIBLE, FLEXIBLE, JACKET, CONFRM ASJ OR FSX WITH ARCHITECT.
C. PROVIDE ASTM C 921 JACKETS FOR DUCTWORK INSULATION: TYPE I FOR DUCTWORK WITH TEMPERATURES BELOW AMBIENT; TYPE II FOR DUCTWORK WITH TEMPERATURES ABOVE AMBIENT.
D. DUCTWORK INSULATION ACCESSORIES: PROVIDE STAPLES, BANDS, WIRES, TAPE, ANCHORS, CORNER ANGLES AND SIMILAR ACCESSORIES AS RECOMMENDED BY INSULATION MANUFACTURER FOR APPLICATIONS INDICATED.

PART 3 - EXECUTION

- 3.1 DUCT AND EQUIPMENT INSULATION APPLICATION SCHEDULE
A. INSULATE CONCEALED DUCT AND EQUIPMENT ACCORDING TO THE FOLLOWING SCHEDULE:

- C. INSTALL DUCT AND EQUIPMENT THERMAL INSULATION PRODUCTS IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS, AND IN COMPLIANCE WITH RECOGNIZED INDUSTRY PRACTICES.
D. MAINTAIN INTEGRITY OF VAPOR-BARRIER AND PROTECT IT TO PREVENT PUNCTURE AND OTHER DAMAGE.

SECTION 233113 - METAL DUCTWORK

PART 1 - GENERAL

- 11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE RECTANGULAR, ROUND METAL DUCTS, AND ACCESSORIES INCLUDING: VENTILATING, AND AIR CONDITIONING SYSTEMS IN LOW PRESSURE PRESSURE CLASS (STATIC PRESSURE LESS THAN OR EQUAL TO 2-INCH WATER GAGE).

- 1.2 QUALITY ASSURANCE
A. COMPLY WITH THE REQUIREMENTS OF NFPA 90A, "STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTILATING SYSTEMS," EXCEPT AS INDICATED OTHERWISE.

PART 2 - PRODUCTS

- 2.1 SHEET METAL MATERIALS
A. GALVANIZED SHEET STEEL: LOOK-FORMING QUALITY, ASTM A 527. COATING DESIGNATION G 90, PROVIDE MIL PHOSPHATIZED FINISH FOR EXPOSED SURFACES OF DUCTS EXPOSED TO VIEW.
B. REINFORCEMENT SHAPES AND PLATES: UNLESS OTHERWISE INDICATED, PROVIDE GALVANIZED STEEL REINFORCING WHERE INSTALLED ON GALVANIZED SHEET METAL DUCTS. FOR ALUMINUM AND STAINLESS STEEL DUCTS PROVIDE REINFORCING OF COMPATIBLE MATERIALS.
C. TIE RODS: GALVANIZED STEEL, 1/4-INCH MINIMUM DIAMETER FOR 36-INCH LENGTH OR LESS; 3/8-INCH MINIMUM DIAMETER FOR LENGTHS LONGER THAN 36 INCHES.

- 2.2 SEALING MATERIALS
A. JOINT AND SEAM TAPE: 2 INCHES WIDE, GLASS-FIBER-FABRIC REINFORCED, JOINT AND SEAM SEALANT: ONE-PART, NONSAG, SOLVENT-RELEASE-CURING, POLYMERIZED BUTYL SEALANT COMPLYING WITH FS TT-S-001867, TYPE I; FORMULATED WITH A MINIMUM OF 75 PERCENT SOLIDS.
C. FLANGED JOINT MASTICS: ONE-PART, ACID-CURING, SILICONE ELASTOMERIC JOINT SEALANTS, COMPLYING WITH ASTM C 920, TYPE S, GRADE NS, CLASS 25, USE O.

- 2.3 DUCT AND FITTING FABRICATION
A. EXCEPT AS OTHERWISE INDICATED, FABRICATE DUCTS WITH GALVANIZED SHEET STEEL, IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS", INCLUDING THEIR ASSOCIATED DETAILS, CONFORM TO THE REQUIREMENTS IN THE REFERENCED STANDARD FOR METAL THICKNESS, REINFORCING TYPES AND INTERVALS, THE ROD APPLICATIONS, AND JOINT TYPES AND INTERVALS.
B. FABRICATE ELBOWS, TRANSITIONS, OFFSETS, BRANCH CONNECTIONS, AND OTHER DUCT CONSTRUCTION IN ACCORDANCE WITH SMACNA "HVAC METAL DUCT CONSTRUCTION STANDARD".
C. ROUND DUCT OF EQUIVALENT DIAMETER TO THE INDICATED RECTANGULAR DUCT MAY BE SUBSTITUTED AT THE CONTRACTOR'S OPTION.
D. FABRICATE ROUND DUCT AND ROUND FITTINGS INCLUDING ELBOWS, TRANSITIONS, OFFSETS, BRANCH CONNECTIONS, AND OTHER DUCT CONSTRUCTION IN ACCORDANCE WITH SMACNA "HVAC METAL DUCT CONSTRUCTION STANDARD". ALL ROUND DUCT 12" DIAMETER AND GREATER SHALL BE FABRICATED OF SPIRAL-WOUND DUCT.
E. IN LIEU OF SHOP FABRICATED DUCT AND FITTINGS, FACTORY FABRICATED DUCT AND FITTINGS MAY BE SUBSTITUTED, SUCH AS MANUFACTURED BY UNIDAB, OR APPROVED EQUIVALENT.

PART 3 - EXECUTION

- 3.1 DUCT INSTALLATION
A. USE FABRICATED FITTINGS FOR ALL CHANGES IN DIRECTIONS, CHANGES IN SIZE AND SHAPE, AND CONNECTIONS.
B. LOCATE DUCTS, EXCEPT AS OTHERWISE INDICATED, VERTICALLY AND HORIZONTALLY, PARALLEL AND PERPENDICULAR TO BUILDING LINES; AVOID DIAGONAL RUNS.
C. BRANCH CONNECTIONS: COMPLY WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".
D. SEAL DUCT SEAMS AND JOINTS ACCORDING TO SMACNA "DUCT CONSTRUCTION STANDARDS".
E. INSTALL RIGID ROUND AND RECTANGULAR METAL DUCT WITH SUPPORT SYSTEMS INDICATED IN SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".
F. SUPPORT HORIZONTAL DUCTS WITHIN 2 FEET OF EACH ELBOW AND WITHIN 4 FEET OF EACH BRANCH INTERSECTION.
G. SUPPORT VERTICAL DUCTS AT A MAXIMUM INTERVAL OF 16 FEET AND AT EACH FLOOR.

- 3.2 CONNECTIONS
A. EQUIPMENT CONNECTIONS: CONNECT EQUIPMENT WITH FLEXIBLE CONNECTORS IN ACCORDANCE WITH DIVISION 23 SECTION "DUCT ACCESSORIES".
B. BRANCH CONNECTIONS: COMPLY WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".
C. OUTLET AND INLET CONNECTIONS: COMPLY WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".
D. TERMINAL UNITS CONNECTIONS: COMPLY WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".

SECTION 233300 - DUCTWORK ACCESSORIES

PART 1 - GENERAL

- 11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE DUCTWORK ACCESSORIES WORK AS INDICATED ON DRAWINGS AND IN SCHEDULES, AND BY REQUIREMENTS OF THIS SECTION, WHICH INCLUDES DAMPERS, DAMPER ACTUATORS, TURNING VANES, DUCT HARDWARE, AND DUCT ACCESS DOORS.
1.2 QUALITY ASSURANCE
A. COMPLY WITH APPLICABLE SECTIONS OF THE FOLLOWING CODES AND STANDARDS:
1. SMACNA "HVAC DUCT CONSTRUCTION STANDARDS, METAL AND FLEXIBLE".
2. ASHRAE RECOMMENDATIONS PERTAINING TO CONSTRUCTION OF DUCTWORK ACCESSORIES, EXCEPT AS OTHERWISE INDICATED.
3. UL STANDARD 55 "FIRE DAMPERS AND CEILING DAMPERS".
4. NFPA 90A "STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTILATING SYSTEMS".

PART 2 - PRODUCTS

- 2.1 DAMPERS AND ACTUATORS
A. LOW PRESSURE MANUAL DAMPERS: PROVIDE DAMPERS OF SINGLE BLADE TYPE OR MULTI-BLADE TYPE, CONSTRUCTED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS", OR AS MANUFACTURED BY RUSKIN MODEL M035, M029, OR M0R525 AS REQUIRED, OR EQUIVALENT.
B. BACKDRAFT DAMPERS: HEAVY DUTY, MINIMUM 0.125" WALL THICKNESS EXTRUDED ALUMINUM FRAME, MINIMUM 0.070" THICK EXTRUDED ALUMINUM BLADES WITH VINYL EDGE SEALS, SYNTHETIC BEARINGS, MIL FINISH, RUSKIN MODEL 886, OR EQUIVALENT.
C. CONTROL DAMPERS: PROVIDE DAMPERS WITH PARALLEL BLADES FOR 2-POSITION CONTROL, OR OPPOSED BLADES FOR MODULATING CONTROL. CONSTRUCT BLADES OF 16-GA STEEL, PROVIDE HEAVY-DUTY MOLDED SELF-LUBRICATING NYLON BEARINGS, 3/4" DIAMETER STEEL AXLES SPACED ON 9" CENTERS. CONSTRUCT FRAME OF MINIMUM 5" X 1" X 16-GUAGE STEEL HAT

- CHANNEL, DAMPER TO BE EQUIPPED WITH FOAM BLADE SEALS AND METAL COMPRESSION TYPE JAMB SEALS. PROVIDE GALVANIZED STEEL FINISH WITH ALUMINUM TOUCH-UP. MAXIMUM LEAKAGE ALLOWED 10 CFMSQ. FT. OF DAMPER AREA AT 1" W.C. DIFFERENTIAL PRESSURE. DAMPER SHALL BE RUSKIN MODEL CD35, OR EQUIVALENT.
D. DAMPER ACTUATOR: THE ACTUATOR FURNISHED SHALL BE THE DIRECT-COUPLED TYPE, ENABLING IT TO BE MOUNTED DIRECTLY TO THE DAMPER SHAFT WITHOUT THE NEED FOR CONNECTING LINKAGE. ACTUATOR SHALL BE BELIMO, OR EQUIVALENT.

- 2.2 TURNING VANES
A. FABRICATED TURNING VANES: PROVIDE FABRICATED TURNING VANES AND VANE RUNNERS, CONSTRUCTED IN ACCORDANCE WITH SMACNA "HVAC DUCT CONSTRUCTION STANDARDS".
B. MANUFACTURED TURNING VANES: PROVIDE TURNING VANES CONSTRUCTED OF 1-1/2" WIDE CURVED BLADES SET AT 3/4" O.C., SUPPORTED WITH BARS PERPENDICULAR TO BLADES SET AT 2" O.C., AND SET INTO SIDE STRIPS SUITABLE FOR MOUNTING IN DUCTWORK.

- 2.3 DUCT HARDWARE AND ACCESS DOORS
A. PROVIDE DUCT HARDWARE, MANUFACTURED BY ONE MANUFACTURER FOR ALL ITEMS ON PROJECT, INCLUDING TEST HOLES AND QUADRANT LOCKS.
B. ACCESS DOORS: CONSTRUCT OF SAME OR GREATER GAGE AS DUCTWORK SERVED, PROVIDE INSULATED DOORS FOR INSULATED DUCTWORK. PROVIDE FLUSH FRAMES FOR UNINSULATED DUCTWORK, EXTENDED FRAMES FOR EXTERNALLY INSULATED DUCT. PROVIDE ONE SIDE HINGED, OTHER SIDE WITH ONE HANDLE-TYPE LATCH FOR DOORS 12" HIGH AND SMALLER, 2 HANDLE-TYPE LATCHES FOR LARGER DOORS.

- 2.4 FLEX DUCT
A. FABRICATED OF ACOUSTICALLY TRANSPARENT NYLON INNER FILM LOCKED TO GALVANIZED STEEL HELIX WIRE, WITH R6 FIBERGLASS INSULATION AND REINFORCED METAL BLADES SET AT 2" O.C., AND SET INTO SIDE STRIPS SUITABLE FOR MOUNTING IN DUCTWORK.

PART 3 - EXECUTION

- 3.1 INSTALLATION OF DUCTWORK ACCESSORIES
A. INSTALL DUCTWORK ACCESSORIES IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS, WITH APPLICABLE PORTIONS OF DETAILS OF CONSTRUCTION AS SHOWN IN SMACNA STANDARDS, AND IN ACCORDANCE WITH RECOGNIZED INDUSTRY PRACTICES TO ENSURE THAT PRODUCTS SERVE INTENDED FUNCTION.
B. INSTALL ACCESS DOORS AT ALL FIRE DAMPERS/FIRE-SMOKE DAMPERS, CONTROL DAMPERS, OTHER DUCT MOUNTED EQUIPMENT, AND ELSEWHERE AS SHOWN ON DRAWINGS. INSTALL TO OPEN AGAINST SYSTEM AIR PRESSURE, WITH LATCHES OPERABLE FROM EITHER SIDE, EXCEPT OUTSIDE ONLY WHERE DUCT IS TOO SMALL FOR PERSON TO ENTER.
C. COORDINATE WITH OTHER WORK, INCLUDING DUCTWORK, AS NECESSARY TO INTERFACE INSTALLATION OF DUCTWORK ACCESSORIES PROPERLY WITH OTHER WORK.
D. CONNECT DIFFUSERS OR TROFFER BOOTS TO DUCTS WITH 5 FEET MAXIMUM LENGTH OF INSULATED FLEXIBLE DUCT. HOLD IN PLACE WITH STRAP OR CLAMP. IF THIS LENGTH IS EXCEEDED ON THE PLANS, THE EXTRA FOOTAGE REQUIRED TO MEET THIS MINIMUM LENGTH WILL BE INSTALLED AS RIGID ROUND GALVANIZED STEEL DUCT OF THE SAME SIZE OR LARGER. INSTALL FLEXIBLE DUCTWORK AT INLET TO ALL DIFFUSERS WHICH ARE SHOWN TO BE CONNECTED WITH FLEXIBLE DUCTWORK. SUPPORT ALL FLEXIBLE DUCT ON MINIMUM 4" CENTERS.

SECTION 233400 - FANS

PART 1 - GENERAL

- 11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE THE REQUIREMENTS OF THE SCHEDULED FANS INCLUDING CEILING MOUNTED AND IN-LINE CENTRIFUGAL FANS, ROOF MOUNTED INTAKE AND EXHAUST FANS, AND OTHER FAN TYPES AS SCHEDULED OR NOTED.
1.2 QUALITY ASSURANCE
A. FANS SHALL BE DESIGNED, MANUFACTURED, AND TESTED IN ACCORDANCE WITH UL 705 "POWER VENTILATORS".
B. MOTORS AND ELECTRICAL ACCESSORIES SHALL COMPLY WITH NEMA STANDARDS.

PART 2 - PRODUCTS

- 2.1 MANUFACTURERS
A. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE PRODUCTS MANUFACTURED BY COOK, GREENHECK, PENN VENTILATOR, OR APPROVED EQUIVALENT.
2.2 FANS - GENERAL
A. GENERAL: PROVIDE FANS THAT ARE FACTORY FABRICATED AND ASSEMBLED, FACTORY TESTED, AND FACTORY FINISHED, WITH INDICATED CAPACITIES AND CHARACTERISTICS.
B. FANS AND SHAFTS: STATICALLY AND DYNAMICALLY BALANCED AND DESIGNED FOR CONTINUOUS OPERATION AT THE MAXIMUM RATED FAN SPEED AND MOTOR HORSEPOWER. FANS SHALL BE FACTORY BALANCED AND CHECKED FOR VIBRATION. MAXIMUM FAN SELF-EXCITED VIBRATION VELOCITY SHALL NOT EXCEED 0.137 INCH/SECOND AT BEARING CAPS, MEASURED WITH THE FAN FULLY ASSEMBLED AND OPERATING AT DESIGN CONDITIONS. FAN SHAFT SHALL BE TURNED, GROUND, AND POLISHED STEEL DESIGNED TO OPERATE AT NO MORE THAN 70 PERCENT OF THE FIRST CRITICAL SPEED AT THE TOP OF THE SPEED RANGE OF THE FAN'S CLASS.
C. FACTORY FINISH: FINISHING FINISHES ARE REQUIRED:
1. SHEET METAL PARTS: PRIME COATING PRIOR TO FINAL ASSEMBLY.
2. EXTERIOR SURFACES: BAKED-ENAMEL FINISH COAT AFTER ASSEMBLY ON ALL FERROUS METAL PARTS. NO FINISH ON GALVANIZED OR ALUMINUM PARTS.

PART 3 - EXECUTION

- 3.1 INSTALLATION - GENERAL
A. INSTALL FANS LEVEL AND PLUMB, IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS. SUPPORT UNITS AS DESCRIBED BEFORE, USING THE VIBRATION CONTROL DEVICES INDICATED.
B. ACCURATELY LOCATE ROOF CURBS. SECURE ROOF-MOUNTED FANS TO ROOF CURBS WITH CADMIUM-PLATED HARDWARE.
C. ARRANGE INSTALLATION OF UNITS TO PROVIDE ACCESS SPACE AROUND UNITS FOR SERVICE AND MAINTENANCE.
3.2 CONNECTIONS
A. DUCT INSTALLATIONS AND CONNECTIONS ARE SPECIFIED IN OTHER DIVISION 23 SECTIONS. MAKE FINAL DUCT CONNECTIONS WITH FLEXIBLE CONNECTIONS.

SECTION 233713 - AIR OUTLETS AND INLETS

PART 1 - GENERAL


- 11 DESCRIPTION OF WORK
A. THIS PROJECT SHALL INCLUDE AIR OUTLETS AND INLETS WORK AS INDICATED BY DRAWINGS AND SCHEDULES, AND BY REQUIREMENTS OF THIS SECTION.
B. TYPES OF AIR OUTLETS AND INLETS REQUIRED FOR PROJECT INCLUDE CEILING AIR DIFFUSERS AND REGISTERS, WALL REGISTERS AND GRILLES, AND LOUVERS. REFER TO PLANS AND EQUIPMENT SCHEDULES.
1.2 QUALITY ASSURANCE
A. CODES AND STANDARDS: AIR OUTLETS AND INLETS SHALL BE TESTED AND RATED



sweetgreen
3102 WEST 36TH STREET
LOS ANGELES, CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION NOR LIABILITY TO THE OTHER EXCEPT AS STATED ABOVE UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

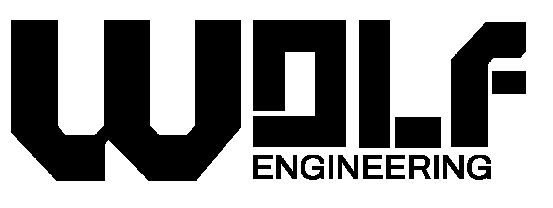

P.O. BOX 38 | DALTON, GA 30722

STAMP:



06/24/2025

PROJECT INFORMATION:

BENTONVILLE
1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712

DRAWN BY: TAL
CHECKED BY: EW
PROJECT MANAGER: JH
SG DESIGN MANAGER: SC
SG DM CHECKED BY: SC
SG CONSTR. MANAGER: MC
PROJECT NO: 20250070.0
TEMPLATE VERSION: 2401

REVISIONS
REV. DATE DESCRIPTION
06/24/2025 ISSUE FOR PERMIT

MECHANICAL SPECIFICATIONS

M-010

IN CONFORMANCE WITH APPLICABLE SECTIONS OF ARI 650, ASHRAE 70, AMCA 500 AND NFPA 90A.

PART 2 - PRODUCTS

2.1 DIFFUSERS AND GRILLES

- A. GENERAL: EXCEPT AS OTHERWISE INDICATED, PROVIDE MANUFACTURER'S STANDARD CEILING AIR DIFFUSERS AND WALL GRILLES WHERE SHOWN; OF SIZE, SHAPE, CAPACITY AND TYPE INDICATED; CONSTRUCTED OF MATERIALS AND COMPONENTS AS INDICATED, AND AS REQUIRED FOR COMPLETE INSTALLATION.
- B. PERFORMANCE: PROVIDE DIFFUSERS AND GRILLES THAT HAVE, AS MINIMUM, TEMPERATURE AND VELOCITY TRAVERSES, THROW AND DROP, AND NOISE CRITERIA RATINGS FOR EACH SIZE DEVICE AS LISTED IN MANUFACTURER'S CURRENT DATA.
- C. CEILING COMPATIBILITY: PROVIDE DIFFUSERS WITH BORDER STYLES THAT ARE COMPATIBLE WITH ADJACENT CEILING SYSTEMS, AND THAT ARE SPECIFICALLY MANUFACTURED TO FIT INTO CEILING MODULE WITH ACCURATE FIT AND ADEQUATE SUPPORT. REFER TO GENERAL CONSTRUCTION DRAWINGS AND SPECIFICATIONS FOR TYPES OF CEILING SYSTEMS WHICH WILL CONTAIN EACH TYPE OF CEILING AIR DIFFUSER.
- D. PROVIDE MOUNTING FRAMES TO ADAPT TO CONSTRUCTION TYPE, WHERE INSTALLED IN HARD CEILINGS OR WALLS, PROVIDE SURFACE MOUNT FRAME BELOW CEILING WITH PERIMETER FLANGE AND GASKET TO SEAL AGAINST CEILING CONSTRUCTION.
- E. WHERE INDICATED, PROVIDE ADJUSTABLE OPPOSED BLADE DAMPER ASSEMBLY, KEY OPERATED FROM FACE OF DIFFUSER.
- F. PROVIDE, WHERE REQUIRED TO PROTECT FIRE RATED CEILING PENETRATIONS, COMBINATION ADJUSTABLE OPPOSED BLADE DAMPER AND FUSIBLE LINK FIRE DAMPER WITH UL APPROVED LINK AND ASSEMBLY DESIGNED TO MEET REQUIREMENTS OF NFPA 90A.
- G. SUBJECT TO COMPLIANCE WITH REQUIREMENTS, PROVIDE EQUIPMENT MANUFACTURED BY KRUEGER MFG. CO.; TITUS PRODUCTS CO.; TUTTLE & BAILEY CORP.; OR APPROVED EQUIVALENT.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. GENERAL: INSTALL AIR OUTLETS AND INLETS IN ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS AND IN ACCORDANCE WITH RECOGNIZED INDUSTRY PRACTICES TO INSURE THAT PRODUCTS SERVE INTENDED FUNCTIONS.
- B. COORDINATE WITH OTHER WORK, INCLUDING DUCTWORK AND DUCT ACCESSORIES AS NECESSARY TO INTERFACE INSTALLATION OF AIR OUTLETS AND INLETS WITH OTHER WORK.
- C. LOCATE CEILING AIR DIFFUSERS, REGISTERS, AND GRILLES, AS INDICATED ON GENERAL CONSTRUCTION "REFLECTED CEILING PLANS", UNLESS OTHERWISE INDICATED. LOCATE UNITS IN CENTER OF ACOUSTICAL CEILING MODULES.

SECTION 238900 - TESTING, ADJUSTING, AND BALANCING

PART 1 - GENERAL

1.1 DESCRIPTION OF WORK

- A. THIS PROJECT SHALL INCLUDE THE REQUIREMENTS AND PROCEDURES FOR TOTAL MECHANICAL SYSTEMS TESTING, ADJUSTING, AND BALANCING. REQUIREMENTS INCLUDE MEASUREMENT AND ESTABLISHMENT OF THE FLUID QUANTITIES OF THE MECHANICAL SYSTEMS AS REQUIRED TO MEET DESIGN SPECIFICATIONS, AND RECORDING AND REPORTING THE RESULTS. WORK INCLUDES TESTING, ADJUSTING AND BALANCING THE SUPPLY AIR SYSTEMS, RETURN AIR SYSTEMS, EXHAUST AIR SYSTEMS, AND VERIFYING THE TEMPERATURE CONTROL SYSTEM OPERATION.
- B. SYSTEMS/DEVICES TO BE BALANCED INCLUDE THE FOLLOWING:
 - 1. ALL AIR DEVICES, INCLUDING ALL SUPPLY DIFFUSERS, RETURN GRILLES AND EXHAUST GRILLES.
 - 2. ALL SPLIT SYSTEM AIR CONDITIONING UNITS.
 - 3. ALL NEW/EXISTING EXHAUST FANS.
- 1.2 QUALITY ASSURANCE
 - A. AGENCY QUALIFICATIONS: EMPLOY THE SERVICES OF AN INDEPENDENT TESTING, ADJUSTING, AND BALANCING AGENCY MEETING THE QUALIFICATIONS SPECIFIED BELOW, TO BE THE SINGLE SOURCE OF RESPONSIBILITY TO TEST, ADJUST, AND BALANCE THE BUILDING MECHANICAL SYSTEMS IDENTIFIED ABOVE, TO PRODUCE THE DESIGN OBJECTIVES. SERVICES SHALL INCLUDE CHECKING INSTALLATIONS FOR CONFORMITY TO DESIGN, MEASUREMENT AND ESTABLISHMENT OF THE FLUID QUANTITIES OF THE MECHANICAL SYSTEMS AS REQUIRED TO MEET DESIGN SPECIFICATIONS, AND RECORDING AND REPORTING THE RESULTS.
 - 1. THE INDEPENDENT TESTING, ADJUSTING, AND BALANCING AGENCY SHALL BE CERTIFIED BY THE ASSOCIATED AIR BALANCE COUNCIL (AABC) OR THE NATIONAL ENVIRONMENTAL BALANCING BUREAU (NEBB) IN THOSE TESTING AND BALANCING DISCIPLINES REQUIRED FOR THIS PROJECT, AND HAVING AT LEAST ONE PROFESSIONAL ENGINEER REGISTERED IN THE STATE IN WHICH THE SERVICES ARE TO BE PERFORMED, CERTIFIED BY AABC OR NEBB AS A TEST AND BALANCE ENGINEER.
 - B. CODES AND STANDARDS:
 - 1. NEBB: "PROCEDURAL STANDARDS FOR TESTING, ADJUSTING, AND BALANCING OF ENVIRONMENTAL SYSTEMS."
 - 2. AABC: "NATIONAL STANDARDS FOR TOTAL SYSTEM BALANCE"
 - 3. ASHRAE: ASHRAE HANDBOOK, HVAC APPLICATIONS VOLUME, CHAPTER 39, TESTING, ADJUSTING, AND BALANCING.

PART 3 - EXECUTION

3.1 INITIAL BASELINE TESTING

- A. PRIOR TO THE START OF CONSTRUCTION, PERFORM A BASELINE TEST TO DETERMINE THE EXISTING CONDITIONS OF ALL SYSTEMS SERVING THE AREA OF CONSTRUCTION WHICH WILL BE MODIFIED AS A RESULT OF THE PROJECT.
 - 1. MEASURE AIRFLOW AT EACH INLET AND OUTLET.
 - 2. MEASURE TOTAL AIRFLOW AT FAN DISCHARGE BY PITOT TUBE.
 - 3. MEASURE VOLTAGE AND AMPERAGE OF ALL SYSTEM MOTORS.
- B. RECORD OPERATING CONDITIONS AND PROVIDE REPORT TO THE OWNER AND ENGINEER, SPECIFICALLY NOTING ANY DEFICIENCIES WHICH MAY IMPACT THE SUCCESSFUL COMPLETION OF THIS PROJECT.

3.2 PERFORMING TESTING, ADJUSTING, AND BALANCING

- A. EXAMINATION: BEFORE COMMENCING TESTS, VERIFY THAT SYSTEMS ARE COMPLETE AND OPERABLE. ENSURE THE FOLLOWING:
 - 1. EQUIPMENT IS OPERABLE AND IN SAFE AND NORMAL CONDITION.
 - 2. TEMPERATURE CONTROL SYSTEMS ARE INSTALLED COMPLETE AND OPERABLE.
 - 3. PROPER THERMAL OVERLOAD PROTECTION IS IN PLACE AND OPEN.
 - 4. DUCT SYSTEMS ARE CLEAN OF DEBRIS.
 - 5. FIRE AND VOLUME DAMPERS ARE IN PLACE AND OPEN.
 - 6. ACCESS DOORS ARE CLOSED AND DUCT END CAPS ARE IN PLACE.
 - 7. AIR OUTLETS ARE INSTALLED AND CONNECTED.
 - 8. DUCT SYSTEM LEAKAGE HAS BEEN MINIMIZED.
- B. PERFORM TESTING AND BALANCING PROCEDURES ON EACH SYSTEM IDENTIFIED, IN ACCORDANCE WITH THE DETAILED PROCEDURES OUTLINED IN THE REFERENCED STANDARDS.
- C. CUT INSULATION, DUCTWORK, AND PIPING FOR INSTALLATION OF TEST PROBES TO THE MINIMUM EXTENT NECESSARY TO ALLOW ADEQUATE PERFORMANCE OF PROCEDURES. PATCH INSULATION, DUCTWORK, AND HOUSINGS, USING MATERIALS IDENTICAL TO THOSE REMOVED. SEAL INSULATION TO RE-ESTABLISH INTEGRITY OF THE VAPOR BARRIER.
- D. MARK EQUIPMENT SETTINGS, INCLUDING DAMPER CONTROL POSITIONS, VALVE INDICATORS, FAN SPEED CONTROL LEVERS, AND SIMILAR CONTROLS AND DEVICES, TO SHOW FINAL SETTINGS. MARK WITH PAINT OR OTHER SUITABLE, PERMANENT IDENTIFICATION MATERIALS.

3.3 RECORD AND REPORT DATA

- A. PREPARE TEST AND BALANCE REPORT AND SUBMIT ONE (1) COPY TO THE ENGINEER AND ONE (1) COPY TO THE OWNER'S REPRESENTATIVE. REPORT SHALL BE STANDARD NEBB OR AABC FORMAT.
- B. AIR BALANCE AND ADJUSTING
 - 1. SUPPLY AIR SYSTEMS INSTALLED IN FINISHED AREAS OF THE BUILDING SHALL BE BALANCED AND ADJUSTED AS FOLLOWS:
 - A. AFTER DUCT SYSTEMS HAVE BEEN INSTALLED COMPLETE WITH ALL VAV BOXES, TERMINAL DEVICES, GRILLES, DAMPERS, DUCTS, COILS, AND OTHER ITEMS HEREINAFTER SPECIFIED THE CONTRACTOR SHALL MAKE ADJUSTMENTS, AS REQUIRED, TO DELIVER THE VOLUME OF AIR AT EACH

AIR OUTLET WITHIN 5% OF DESIGN FLOW AS SHOWN ON THE DRAWINGS. AFTER THE FINISHED AREA IS OCCUPIED, THE AIR VOLUMES SHALL BE READJUSTED, IF REQUIRED, TO PROPERLY BALANCE THE COOLING AND HEATING LOADS THROUGHOUT THE CONDITIONED AREAS.

B. AIR OUTLETS SHALL BE BALANCED WITH AIR PATTERN AS SHOWN ON THE DRAWINGS.

2. ALL BALANCING MUST BE ACCOMPLISHED WITH DIFFUSER AIR PATTERNS AS INDICATED ON THE DRAWINGS.

3. THE CONTRACTOR SHALL SUBMIT DETAILED BALANCING PROCEDURES AND RECORDING FORMS FOR THE ENGINEER'S REVIEW, PRIOR TO COMMENCING ANY AIR BALANCE WORK.

C. FINAL AIR BALANCE READINGS

1. AFTER AIR FLOW ARE BALANCED, AND WITH THE TEMPERATURE CONTROLS SET TO PRODUCE DESIGN COOLING, MEASURE AND RECORD ALL DATA NECESSARY TO COMPILE A COMPLETE REPORT TO DEMONSTRATE THE ACCEPTABILITY OF THE VARIOUS MECHANICAL SYSTEMS. INCLUDE AT LEAST THE FOLLOWING DATA IN THE REPORT:

A. OUTSIDE DRY BULB AND WET BULB TEMPERATURE.

B. INSIDE DRY BULB AND WET BULB TEMPERATURES IN SIX SELECTED AREAS OF THE CONDITIONED SPACE, ROOM OR AREA SELECTED BY THE ENGINEER.

C. DRY BULB TEMPERATURES OF AIR ENTERING AND LEAVING ALL COILS.

D. TEMPERATURE OF WATER ENTERING AND LEAVING EACH WATER COIL.

2. THE BALANCED POSITION OF EACH CONTROLLING VALVE AND DAMPER SHALL BE PERMANENTLY MARKED ON THE PIPE, INSULATION, OR DUCTWORK.

D. TEMPERATURE CONTROL ADJUSTING

1. AUTOMATIC TEMPERATURE CONTROLS SHALL BE CALIBRATED AND ALL THERMOSTATS, DAMPERS, ETC., ADJUSTED SO THAT CONTROL SYSTEM IS IN THE PROPER OPERATING CONDITION, SUBJECT TO REVIEW BY THE ENGINEER.

E. FINAL REPORT

1. SUBMIT PDF AND SIX (6) COPIES OF COMPLETE REPORTS TO THE ARCHITECT.




sweetgreen

3102 WEST 36TH STREET
LOS ANGELES, CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED (IN WHOLE OR IN PART), SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE (WHICH IS SUBJECT TO CHANGE AT ANY TIME) AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION OR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

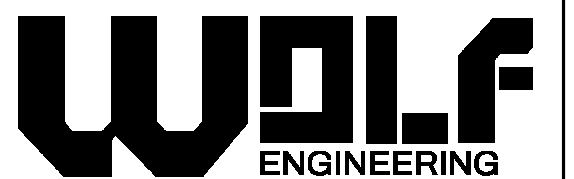

P.O. BOX 38 | DALTON, GA 30722

STAMP:



PROJECT INFORMATION:
BENTONVILLE

PROJECT INFORMATION:
**1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712**

DRAWN BY:	TAL
CHECKED BY:	EW
PROJECT MANAGER:	JH
SG DESIGN MANAGER:	SC
SG DM CHECKED BY:	SC
SG CONSTR. MANAGER:	MC
PROJECT NO:	20250070.0
TEMPLATE VERSION:	2401

REVISIONS		
REV.	DATE	DESCRIPTION
06242025		ISSUE FOR PERMIT

MECHANICAL SPECIFICATIONS

M-011



Generated by COMcheck-Web Software
Mechanical Compliance Certificate

Section 1: Project Information

Energy Code: 2009 IECC
Project Title: Sweetgreen - Bentonville, AR
Project Type: Alteration

Construction Site: 1701 SE 8th Street, Bentonville, Arkansas 72712
Owner/Agent: Georgia
Designer/Contractor: Wolf Engineering, PO Box 38, Dalton, Georgia 30722

Section 2: General Information

Building Location (for weather data): Bentonville, Arkansas
Climate Zone: 4a

Section 3: Mechanical Systems List

- Quantity System Type & Description
2 AHU-1 & AHU-2 (Single Zone)
Heating: 1 each - Central Furnace, Gas, Capacity = 77 kBtu/h
Proposed Efficiency = 96.00% E1, Required Efficiency: 80.00 % E1 (or 78% AFUE)
Cooling: 1 each - Split System, Capacity = 46 kBtu/h, Air-Cooled Condenser, Unknown Economizer
Proposed Efficiency = 16.00 SEER, Required Efficiency = 13.00 SEER
Proposed Part Load Efficiency = 0.00, Required Part Load Efficiency = 0.00
Fan System: FAN SYSTEM 1 - Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 1 Supply, Constant Volume, 1600 CFM, 0.8 motor nameplate hp
2 AHU-3 & AHU-4 (Single Zone)
Heating: 1 each - Central Furnace, Gas, Capacity = 58 kBtu/h
Proposed Efficiency = 96.00% E1, Required Efficiency: 80.00 % E1 (or 78% AFUE)
Cooling: 1 each - Split System, Capacity = 34 kBtu/h, Air-Cooled Condenser, Unknown Economizer
Proposed Efficiency = 16.00 SEER, Required Efficiency = 13.00 SEER
Proposed Part Load Efficiency = 0.00, Required Part Load Efficiency = 0.00
Fan System: FAN SYSTEM 2 - Compliance (Motor nameplate HP and fan efficiency method) : Passes
Fans:
FAN 2 Supply, Constant Volume, 1200 CFM, 0.5 motor nameplate hp
1 Water Heater:
Gas Storage Water Heater, Capacity: 100 gallons, Input Rating: 199 kBtu/h w/ Circulation Pump
Proposed Efficiency: 97.00 % E1, Required Efficiency: 80.00 % E1

Section 4: Requirements Checklist

- Requirements Specific To: AHU-1 & AHU-2 :
1. Equipment minimum efficiency: Central Furnace (Gas): 80.00 % E1 (or 78% AFUE)
2. Equipment minimum efficiency: Split System: 13.00 SEER

- Requirements Specific To: AHU-3 & AHU-4 :
1. Equipment minimum efficiency: Central Furnace (Gas): 80.00 % E1 (or 78% AFUE)
2. Equipment minimum efficiency: Split System: 13.00 SEER

Requirements Specific To: Water Heater :

- 1. Water heating equipment meets minimum efficiency requirements: Gas Storage Water Heater efficiency: 80.00 % E1 (259 SL, kBtu/h)
2. All piping in circulating system insulated
3. Hot water storage temperature controls that allow setpoint of 90°F for non-dwelling units and 110°F for dwelling units.
4. Automatic time control of heat tapes and recirculating systems present
5. Controls will shut off operation of circulating pump between water heater/boiler and storage tanks within 5 minutes after end of heating cycle

Generic Requirements: Must be met by all systems to which the requirement is applicable:

- 1. Plant equipment and system capacity no greater than needed to meet loads
Exception(s):
- Standby equipment automatically off when primary system is operating
- Multiple units controlled to sequence operation as a function of load
2. Minimum one temperature control device per system
3. Minimum one humidity control device per installed humidification/dehumidification system
4. Load calculations per ASHRAE/ACCA Standard 183
5. Automatic Controls: Setback to 55°F (heat) and 85°F (cool), 7-day clock, 2-hour occupant override, 10-hour backup
Exception(s):
- Continuously operating zones
6. Outside-air source for ventilation, system capable of reducing OSA to required minimum
7. R-5 supply and return air duct insulation in unconditioned spaces
R-8 supply and return air duct insulation outside the building
R-8 insulation between ducts and the building exterior when ducts are part of a building assembly
Exception(s):
- Ducts located within equipment
- Ducts with interior and exterior temperature difference not exceeding 15°F
8. Mechanical fasteners and sealants used to connect ducts and air distribution equipment
9. Ducts sealed - longitudinal seams on rigid ducts, transverse seams on all ducts, UL 181A or 181B tapes and mastics
10. Hot water pipe insulation: 1.5 in. for pipes <=1.5 in. and 2 in. for pipes >1.5 in.
Chilled water/refrigerant/brine pipe insulation: 1.5 in. for pipes <=1.5 in. and 1.5 in. for pipes >1.5 in.
Steam pipe insulation: 1.5 in. for pipes <=1.5 in. and 3 in. for pipes >1.5 in.
Exception(s):
- Piping within HVAC equipment.
- Fluid temperatures between 55 and 105°F.
- Fluid not heated or cooled with renewable energy.
- Piping within room fan-coil (with AHR3440 rating) and unit ventilators (with AHR340 rating).
- Runouts <= 4 ft in length.
11. Operation and maintenance manual provided to building owner
12. Thermostatic controls have 5°F deadband
Exception(s):
- Thermostats requiring manual changeover between heating and cooling
- Special occupancy or special applications where wide temperature ranges are not acceptable and are approved by the authority having jurisdiction.
13. Balancing devices provided in accordance with IMC 603.17
14. Demand control ventilation (DCV) present for high design occupancy areas (>40 person/1000 ft2 in spaces >500 ft2) and served by systems with any one of 1) an air-side economizer, 2) automatic modulating control of the outdoor air damper, or 3) a design outdoor airflow greater than 3000 cfm.
Exception(s):
- Systems with heat recovery.
- Multiple-zone systems without DDC of individual zones communicating with a central control panel.
- Systems with a design outdoor airflow less than 1200 cfm.
- Spaces where the supply airflow rate minus any makeup or outgoing transfer air requirement is less than 1200 cfm.
15. Motorized, automatic shutoff dampers required on exhaust and outdoor air supply openings
Exception(s):
- Gravity dampers acceptable in buildings <3 stories
16. Automatic controls for freeze protection systems present
17. Exhaust air heat recovery included for systems 5,000 cfm or greater with more than 70% outside air fraction or specifically exempted
Exception(s):
- Hazardous exhaust systems, commercial kitchen and clothes dryer exhaust systems that the International Mechanical Code prohibits the use of energy recovery systems.

- Systems serving spaces that are heated and not cooled to less than 60°F.
Where more than 60 percent of the outdoor heating energy is provided from site-recovered or site solar energy.
Heating systems in climates with less than 3600 HDD.
Cooling systems in climates with a 1 percent cooling design wet-bulb temperature less than 64°F.
Systems requiring dehumidification that employ energy recovery in series with the cooling coil.
Laboratory fume hood exhaust systems that have either a variable air volume system capable of reducing exhaust and makeup air volume to 50 percent or less of design values or, a separate make up air supply meeting the following makeup air requirements:
a) at least 75 percent of exhaust flow rate, b) heated to no more than 2°F below room setpoint temperature, c) cooled to no lower than 3°F above room setpoint temperature, d) no humidification added, e) no simultaneous heating and cooling.

Section 5: Compliance Statement

Compliance Statement: The proposed mechanical alteration project represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed mechanical alteration project has been designed to meet the 2009 IECC, Chapter 8, requirements in COMcheck-Web and to comply with the mandatory requirements in the Requirements Checklist.

Eric Wolf, PE
Name - Title
Signature
Date: 06/09/2024

Section 6: Post Construction Compliance Statement

- HVAC record drawings of the actual installation, system capacities, calibration information, and performance data for each equipment provided to the owner.
HVAC O&M documents for all mechanical equipment and system provided to the owner by the mechanical contractor.
Written HVAC balancing and operations report provided to the owner.

The above post construction requirements have been completed.

Principal Mechanical Designer-Name Signature Date

Project Title: Sweetgreen - Bentonville, AR
Data filename:
Report date: 06/09/25
Page 1 of 3

Project Title: Sweetgreen - Bentonville, AR
Data filename:
Report date: 06/09/25
Page 2 of 3

Project Title: Sweetgreen - Bentonville, AR
Data filename:
Report date: 06/09/25
Page 3 of 3




sweetgreen

3102 WEST 36TH STREET
LOS ANGELES, CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION OR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

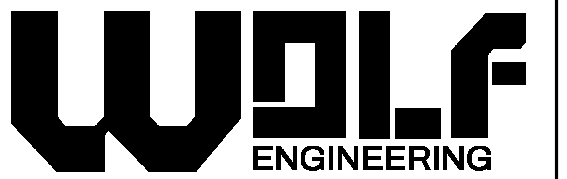

P.O. BOX 38 | DALTON, GA 30722

STAMP:



PROJECT INFORMATION:
BENTONVILLE

PROJECT INFORMATION:
1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712

DRAWN BY: TAL
CHECKED BY: EW
PROJECT MANAGER: JH
SG DESIGN MANAGER: SC
SG DM CHECKED BY: SC
SG CONSTR. MANAGER: MC
PROJECT NO: 20250070.0
TEMPLATE VERSION: 2401

REVISIONS
REV. DATE DESCRIPTION
06/24/2025 ISSUE FOR PERMIT

MECHANICAL COMPLIANCE FORMS

M-020




sweetgreen

3102 WEST 36TH STREET
LOS ANGELES, CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION OR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

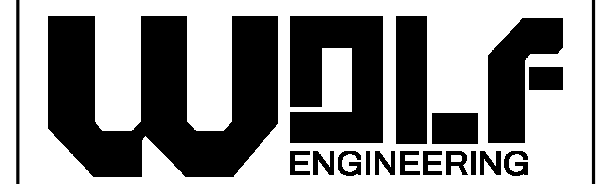

P.O. BOX 38 | DALTON, GA 30722

STAMP:



PROJECT INFORMATION:
BENTONVILLE
PROJECT INFORMATION:
**1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712**

DRAWN BY: TAL
CHECKED BY: EW
PROJECT MANAGER: JH
SG DESIGN MANAGER: SC
SG DM CHECKED BY: SC
SG CONSTR. MANAGER: MC
PROJECT NO: 20250070.0
TEMPLATE VERSION: 2401

REVISIONS
REV. DATE DESCRIPTION
06/24/2025 ISSUE FOR PERMIT

HVAC PLANS

M-100


GENERAL NOTES

- A. IT IS THE RESPONSIBILITY OF THE GENERAL AND MECHANICAL CONTRACTOR TO FULLY INSPECT THE SITE PRIOR TO COMMENCEMENT.
- B. VERIFY ALL EXISTING CONDITIONS INCLUDING LOCATION OF ALL STRUCTURAL ELEMENTS, BAR JOISTS, COLUMNS, ETC. AND COORDINATE DUCT LOCATIONS ACCORDINGLY.
- C. DRAWINGS ARE DIAGRAMMATIC ONLY. FINAL EQUIPMENT LOCATIONS SHALL BE DETERMINED IN THE FIELD. ADDITIONAL OFFSETS, ELBOWS, ETC. SHALL BE PROVIDED AND INSTALLED WITHOUT ADDITIONAL COST TO OWNER.
- D. LOCATE THERMOSTATS SUCH THAT THEY ARE ACCESSIBLE, PROTECTED, AND IN AN AREA OF UNOBSTRUCTED AIR CIRCULATION.
- E. ALL WALL PENETRATIONS SHALL BE APPROVED BY BUILDING STRUCTURAL ENGINEER.
- F. EXISTING HEAT PUMPS USED FOR TEMPORARY SPACE CONDITIONING PRIOR TO TENANT OCCUPANCY SHALL BE RETURNED TO OWNER.

KEY NOTES (CONT.)

KEY NOTES

- 1. PROVIDE CONDENSER FOR WALK-IN COOLER ON MECHANICAL MEZZANINE. COORDINATE WITH LANDLORD FOR EXACT LOCATION. MAINTAIN UNIT OPERATING AND SERVICE CLEARANCES.
- 2. PROVIDE CONDENSER ON MECHANICAL MEZZANINE. COORDINATE WITH LANDLORD FOR EXACT LOCATION. MAINTAIN UNIT OPERATING AND SERVICE CLEARANCES.
- 3. PROVIDE AND ROUTE 3" FLUE AND 3" COMBUSTION AIR TO BACK EXTERIOR WALL AT CONDENSER AREA WITH LOW PROFILE WALL CAP COMBINATION TERMINATION. COORDINATE EXACT LOCATION WITH LANDLORD. MAINTAIN CODE REQUIRED CLEARANCES. COORDINATE EXACT ROUTING IN FIELD.
- 4. ROUTE E/A DUCT FROM RESTROOM CEILING EXHAUST FANS TO BACK EXTERIOR WALL. PROVIDE WITH WALL CAP TERMINATION WITH BIRD SCREEN AND BACKDRAFT DAMPER. MAINTAIN CODE REQUIRED CLEARANCES.
- 5. ROUTE E/A FROM HOOD ABOVE COMBINATION OVEN TIGHT TO STRUCTURE AND PENETRATE CEILING SLAB TO ROUTE ABOVE PARKING LEVEL 3. COORDINATE EXACT LOCATION OF PENETRATION WITH STRUCTURAL MEMBERS/COLUMNS AND LANDLORD. PROVIDE DUCTWORK WITH EXTERIOR RATED INSULATION. INSULATION SHALL EXTEND A MINIMUM OF 24" INTO THE SPACE. SEAL PENETRATION IN SLAB WEATHERTIGHT. REFER TO DETAIL ON A-300 SHEET.
- 6. PROVIDE INLINE EF-3 FOR KITCHEN HOOD ON PARKING DECK ON 4" CONCRETE CURB. SUPPORT DUCTWORK CONNECTIONS TO EXHAUST FAN. REFER TO DETAIL FOR FURTHER INFORMATION. EF-3 SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS AND FAN SHALL BE WET RATED AND PROVIDED WITH WEATHERTIGHT HOUSING.
- 7. ROUTE E/A TO EXHAUST LOUVER, L-1, ON SIDE OF BUILDING ABOVE PARKING LEVEL 3. COORDINATE WITH LANDLORD ON EXACT LOCATION. COORDINATE FINAL LOCATION AND COLOR OF LOUVER WITH ARCHITECT AND LANDLORD. MAINTAIN 10'-0" FROM MECHANICAL INTAKES, OUTDOOR AIR OPENINGS, AND PLUMBING VENTS.
- 8. PROVIDE THERMOSTATS WHERE INDICATED. INSTALL AT 48" ABOVE FINISHED FLOOR. COORDINATE WITH EQUIPMENT AND WALL-MOUNTED FIXTURES AS REQUIRED SUCH THAT ACCESS IS NOT BLOCKED.
- 9. CONTRACTOR SHALL FURNISH AND INSTALL REME HALO AIR PURIFICATION SYSTEM IN SUPPLY AIR DUCT AND REQUIRED TRANSFORMER PER MANUFACTURER'S INSTRUCTIONS. CONTRACTOR SHALL FURNISH THROUGH NATIONAL ACCOUNT AND INSTALL
NATIONAL ACCOUNT: NATIONAL TAB
CONTACT: WILL TURNBOUGH
PHONE: (855)682-6822, EXT. 4,2
EMAIL: WILL@NATIONALTAB.COM
- 10. PAINT ALL DUCTWORK VISIBLE THROUGH GRILLES IN DINING AREA BLACK (TYPICAL). PAINT ALL EXPOSED DUCTWORK IN DINING AREA. COORDINATE PAINT COLOR WITH ARCHITECT AND OWNER.
- 11. ROUTE FULL SIZED CONDENSATE TO NEAREST EXISTING, SHELL PROVIDED CONDENSATE HUB DRAIN. FIELD COORDINATE LOCATION AND ROUTING AND PROVIDE CONDENSATE PUMP AS NECESSARY.
- 12. INDOOR UNIT SHALL BE PROVIDED WITH MOTORIZED DAMPER ON O/A DUCT. SEQUENCE SHALL BE COMPLETELY CLOSED BEFORE/AFTER STORE HOURS, AND DURING STORE HOURS: OPEN TO MINIMUM DCV POSITION WHEN CO2 IS AT OR BELOW 300 PPM, AND DESIGN DCV POSITION WHEN CO2 IS AT OR ABOVE 900 PPM, AND LINEARLY INTERPOLATED POSITION WHEN CO2 IS BETWEEN 300 AND 900 PPM.
- 13. INDOOR UNIT SHALL BE PROVIDED WITH MOTORIZED DAMPER ON O/A DUCT. SEQUENCE SHALL BE COMPLETELY CLOSED BEFORE/AFTER STORE HOURS, AND OPEN TO MINIMUM O/A POSITION DURING STORE HOURS.
- 14. HANG INDOOR UNIT PER DETAILS. COORDINATE EXACT LOCATION IN FIELD. MAINTAIN ALL OPERATING AND SERVICE CLEARANCES.
- 15. ROUTE AND CONNECT O/A DUCTWORK HIGH IN SPACE. DROP AT CORNER WALL AND ROUTE TO LOUVER AT FRONT OF STORE. COORDINATE EXACT ROUTING WITH OWNER AND ARCHITECT PRIOR TO CONSTRUCTION. CONNECT TO EXISTING LOUVER AT FRONT OF STORE. PROVIDE DUCTWORK WITH INTERNAL INSULATION WHERE EXPOSED.
- 16. LOCATION OF FLUE AND COMBUSTION AIR AT AIR HANDLER/WATER HEATER SHOWN FOR REFERENCE. FIELD COORDINATE EXACT LOCATION OF CONNECTIONS ON UNITS.

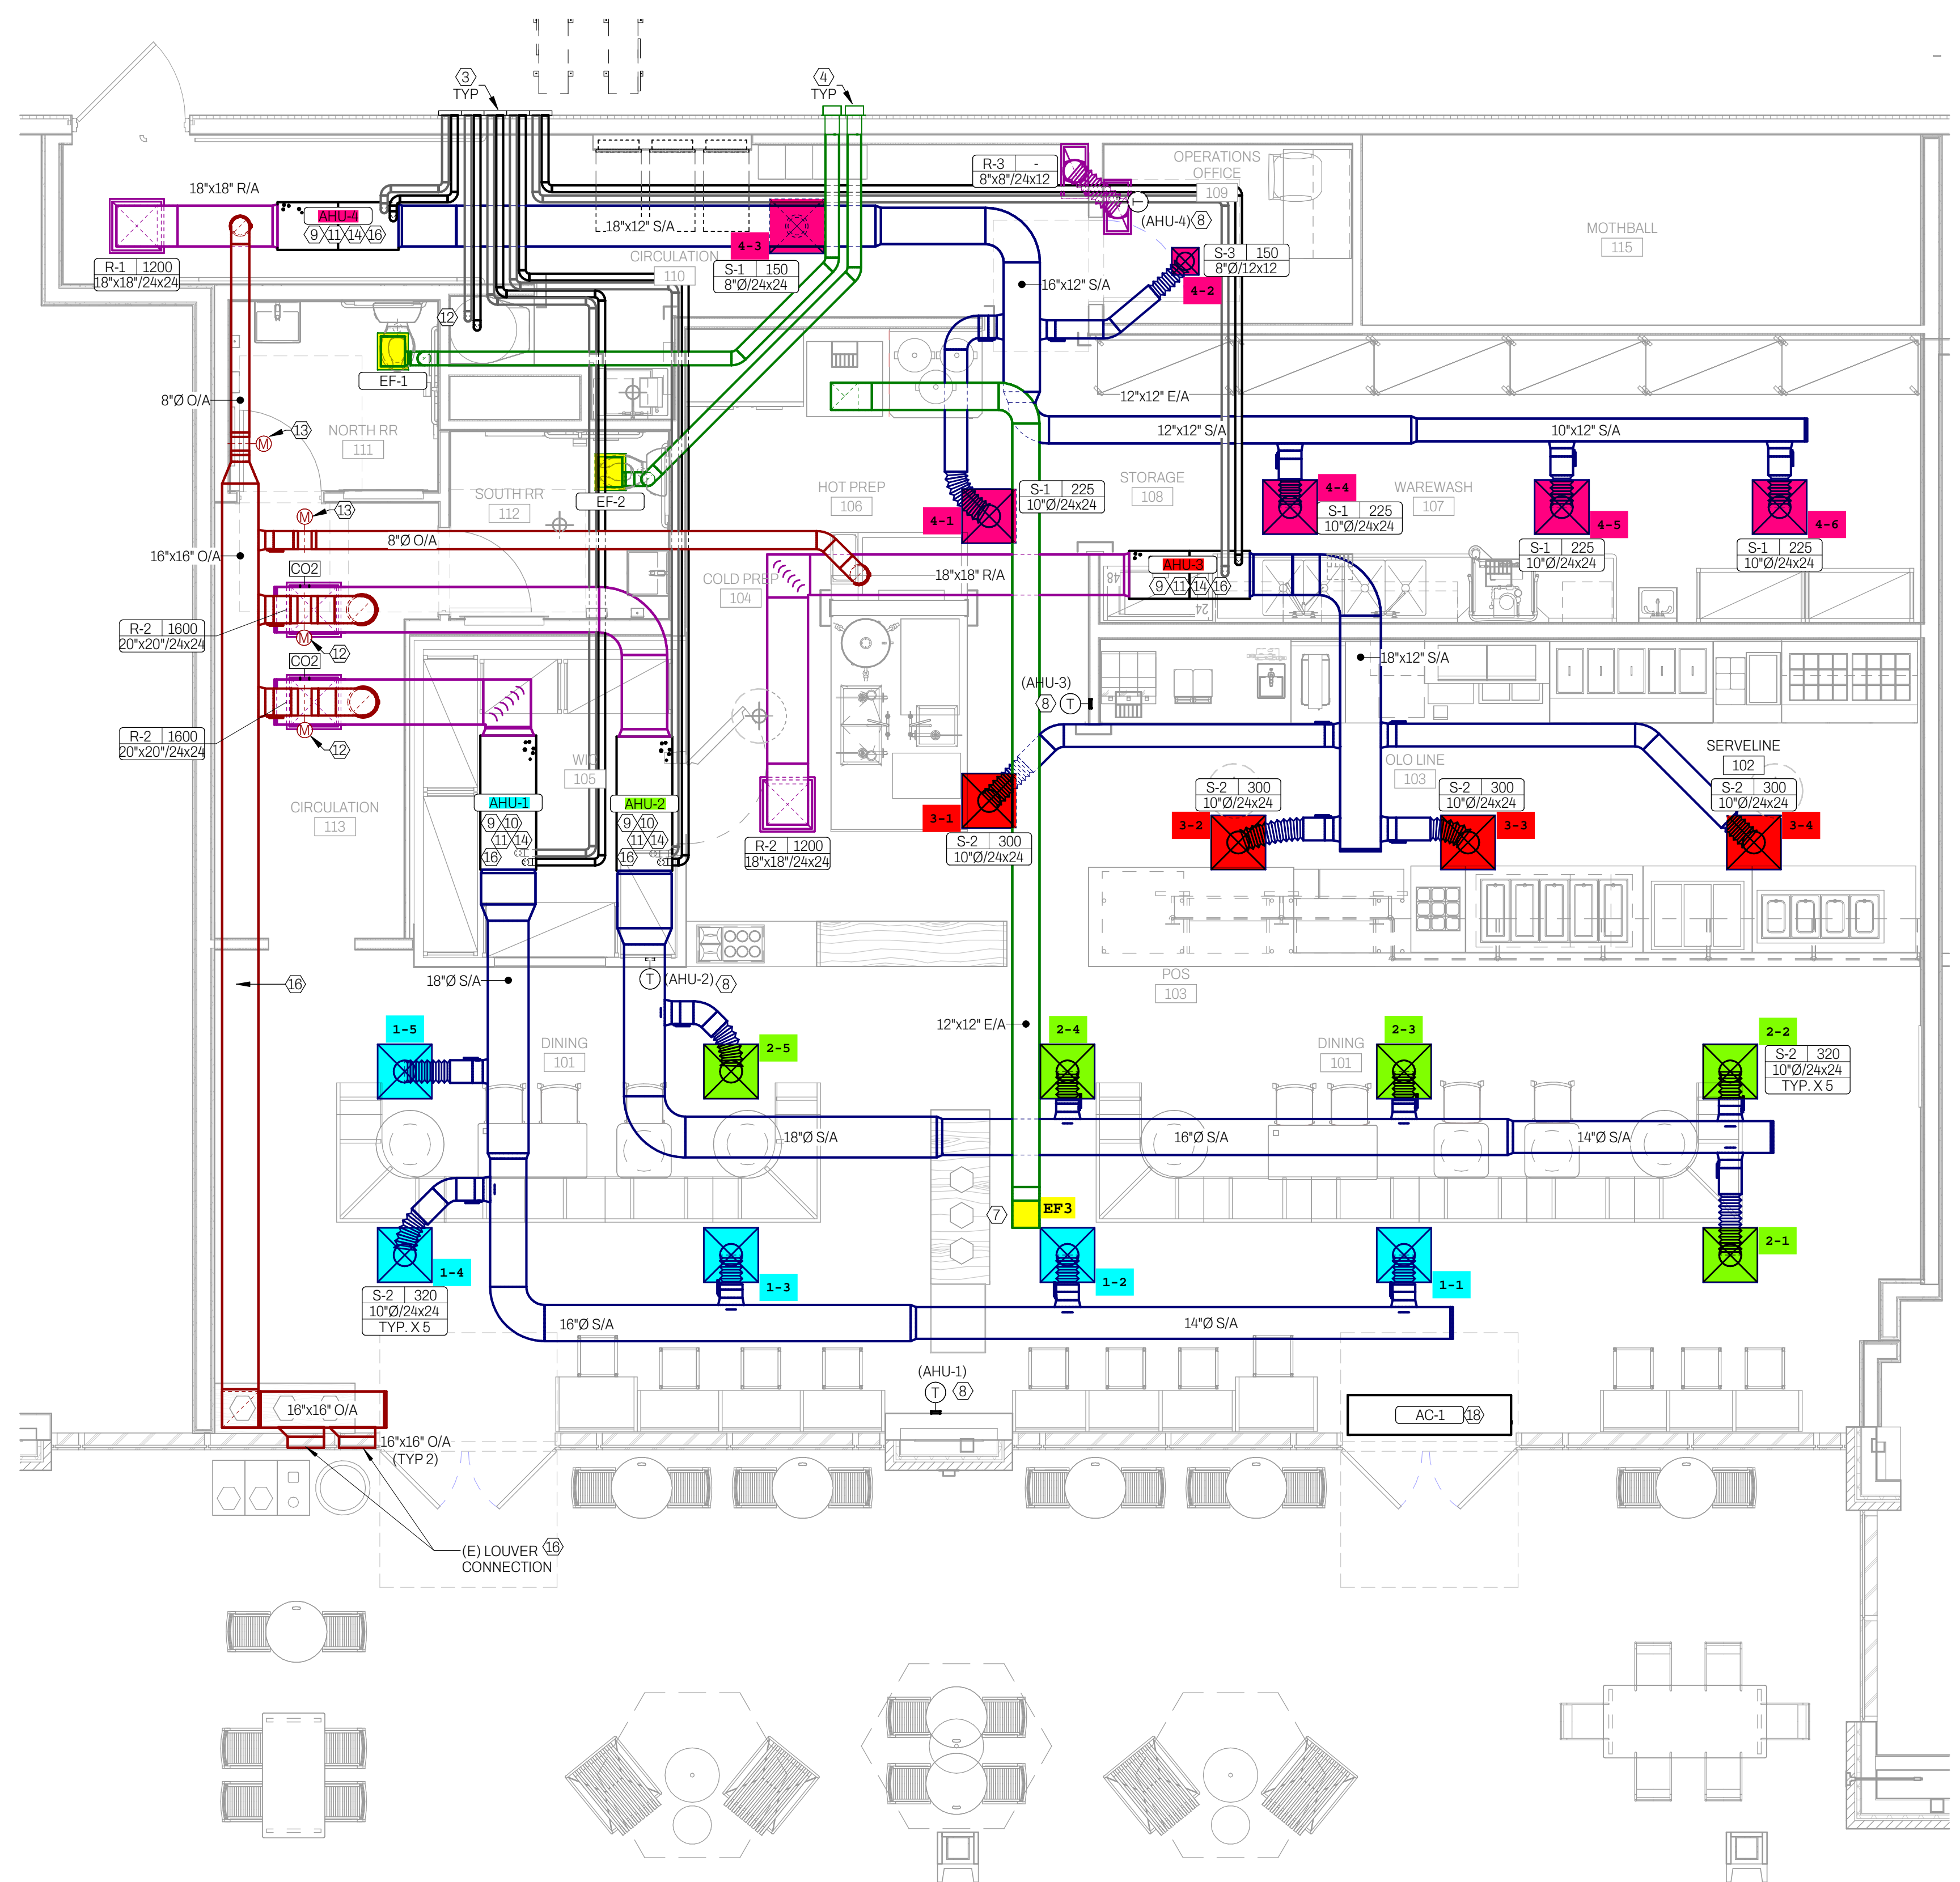

1 MECHANICAL - LEVEL 1 HVAC PLAN
1/4" = 1'-0"

2 MECHANICAL - SECOND FLOOR - MECHANICAL MEZZANINE
1/8" = 1'-0"

3 MECHANICAL - THIRD FLOOR - EXHAUST FAN
1/8" = 1'-0"

6/24/2025 4:26:11 PM

GAS FURNACE SPLIT SYSTEM SCHEDULE

MARK	MANUFACTURER	NOMINAL CAPACITY	SERVES	FURNACE										COOLING COIL			OUTDOOR UNIT				REMARKS			
				MODEL	TOTAL CFM	OA CFM	FAN ESP	MOTOR HP	HEATING					V/PH/Hz	MCA/MOCP	COIL MODEL	REFRIGERANT	MODEL	TOTAL COOLING CAPACITY	SENSIBLE		EER2 / SEER2	V/PH/Hz	MCA/MOCP
									HIGH FIRE INPUT	HIGH FIRE OUTPUT	LOW FIRE INPUT	LOW FIRE OUTPUT	AFUE											
AHU-CU-1	DAIKIN	4-TON	DINING	DR96TC080	1,600 CFM	475 CFM	0.75 IN-WG	0.75	80,000 BTU/H	76,880 BTU/H	56,000 BTU/H	53,816 BTU/H	96.1	120/1/60	10.9/15.0	CHPEA48	R-32	DC6VS48	45,500 BTU/H	34,100 BTU/H	8.6 / 16.0	208/1/60	31.8 A / 35.0 A	ALL
AHU-CU-2	DAIKIN	4-TON	DINING	DR96TC080	1,600 CFM	475 CFM	0.75 IN-WG	0.75	80,000 BTU/H	76,880 BTU/H	56,000 BTU/H	53,816 BTU/H	96.1	120/1/60	10.9/15.0	CHPEA48	R-32	DC6VS48	45,500 BTU/H	34,100 BTU/H	8.6 / 16.0	208/1/60	31.8 A / 35.0 A	ALL
AHU-CU-3	DAIKIN	3-TON	SERVE	DR96TC080	1,200 CFM	120 CFM	0.75 IN-WG	0.50	60,000 BTU/H	57,680 BTU/H	42,000 BTU/H	40,362 BTU/H	96.1	120/1/60	7.6/15.0	CHPEA36	R-32	DC6VS36	34,200 BTU/H	25,650 BTU/H	8.6 / 16.0	208/1/60	22.4 A / 25.0 A	ALL
AHU-CU-4	DAIKIN	3-TON	WAREWASH/BOH	DR96TC080	1,200 CFM	145 CFM	0.75 IN-WG	0.50	60,000 BTU/H	57,680 BTU/H	42,000 BTU/H	40,362 BTU/H	96.1	120/1/60	7.6/15.0	CHPEA36	R-32	DC6VS36	34,200 BTU/H	25,650 BTU/H	8.6 / 16.0	208/1/60	22.4 A / 25.0 A	ALL

REMARKS:
 1. EQUIPMENT SHALL BE PROCURED THROUGH A DAIKIN NATIONAL ACCOUNT. ANY CHANGES OR VARIATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE DAIKIN NATIONAL ACCOUNT TEAM. CONTACT PAUL ROMERO (714)632-9800, PROMERO@NSWCLA.COM.
 2. PROVIDE HIGH EFFICIENCY R32 CHLORINE-FREE REFRIGERANT TO UNIT. PROVIDE WITH REFRIGERANT LEAK DETECTION SENSOR WITHIN UNIT.
 3. ESP SHOWN DOES NOT INCLUDE PRESSURE DROP THROUGH FILTERS. FAN MOTOR SHALL BE ECM TYPE.
 4. PROVIDE FACTORY INSTALLED THERMAL EXPANSION VALVE (TXV) AND TIME-DELAY RELAY.
 5. PROVIDE INTERNAL DRAIN PAN AND DRAIN PAN LEVEL SENSOR. INTERNAL FLOAT SWITCH SHALL BE WIRED FOR UNIT SHUTDOWN.
 6. PROVIDE OUTDOOR UNIT WITH ACCESSORY DISCONNECT SWITCH.
 7. INSTALL OUTDOOR UNIT ON 4" CONCRETE BASE WITH NEOPRENE PAD ISOLATORS. CONTROL WIRING IN FLEX CONDUIT. LOW AMBIENT CONTROLS AND ANTI-SHORT CYCLE TIMER.
 8. PROVIDE HONEYWELL TH632 THERMOSTATS WITH LOCKABLE COVERS (MODEL CG611A1000 OR EQUAL). ALTERNATE - MODEL D4271C - COMMERCIAL 7 DAY PROGRAMMABLE WIFI THERMOSTAT.
 9. PROVIDE PIPED FLUE INLETS SIZED AND ROUTED PER MANUFACTURER.
 10. PROVIDE COMPRESSOR START ASSIST CAPACITOR AND RELAY, CRANKCASE HEATER, EVAP FREEZE TSTAT, ISOLATION RELAY, AND LOW AMBIENT ACCESSORIES.
 11. PROVIDE WITH MIXING BOX AND FILTER BOX.
 12. PROVIDE HORIZONTAL INDOOR UNIT CONFIGURATION.
 13. PROVIDE WITH DISCHARGE AIR TEMPERATURE DEVICE.
 14. PROVIDE DINING ROOM AIR HANDLER(S) WITH CO2 MONITORS AND INTERLOCK WITH MOTORIZED DAMPER FOR DEMAND CONTROL VENTILATION STRATEGY (REFER TO DCV CALCULATIONS, THIS SHEET).
 15. PROVIDE UNIT WITH 20 YEAR WARRANTY, AND ALL FUNCTIONAL PARTS COVERED BY A 5-YEAR PARTS WARRANTY.
 * CONFIRM ALL UNIT DIMENSIONS WITH MANUFACTURER AND COORDINATE WITH ARCHITECTURAL AND STRUCTURAL DESIGNS.

HEATED AIR CURTAIN SCHEDULE

MARK	INSTALLED LOCATION	MANUFACTURER	MODEL	NOZZLE LENGTH	DESIGN AIRFLOW RATE	HEATING TEMP. RISE	ELECTRIC HEAT		ELECTRICAL				PRODUCT WEIGHT	REMARKS
							RATING	LOAD	VOLTAGE	PHASE	MCA	MOCP		
AC-1	FRONT ENTRANCE	BERNER	CLC08-1072E	72"	2,010 CFM	17 °F	15.0 KW	41.6 A	208 V	3	43.3 A	60.0 A	77 LB	ALL

REMARKS:
 1. PROVIDE AND INTERLOCK WITH DOOR SENSOR.

EXHAUST FAN SCHEDULE

MARK	MANUFACTURER	MODEL	TYPE	SERVES	AIRFLOW RATE	ESP	MOTOR		VOLTAGE	PHASE	FLA	MCA	MOCP	FAN INTERLOCK	WEIGHT	REMARKS
							POWER	RPM								
EF-1	CAPTIVEAIRE	CFA-S70	CEILING	RESTROOM	70 CFM	0.25 IN-WG	0.02 HP	850	120 V	1	0.6 A	0.7 A	15.0 A	OCCUPANCY LIGHT SWITCH	12 LB	1,2,4,5,6,7,8,9,10
EF-2	CAPTIVEAIRE	CFA-S70	CEILING	RESTROOM	70 CFM	0.25 IN-WG	0.02 HP	850	120 V	1	0.6 A	0.7 A	15.0 A	OCCUPANCY LIGHT SWITCH	12 LB	1,2,4,5,6,7,8,9,10
EF-3	CAPTIVEAIRE	SIF11DD	INLINE DIRECT DRIVE	HOOD	930 CFM	1.00 IN-WG	1.00 HP	1938	208 V	3	3.0 A	3.8 A	15.0 A	HOOD	206 LB	1,3,4,5,6,7,8,9,10

REMARKS:
 1. FAN SHALL BE AMCA CERTIFIED AND UL LISTED FOR SOUND AND PERFORMANCE.
 2. PROVIDE WITH 3 AMP FAN MOUNTED SPEED CONTROLS FOR AIRFLOW ADJUSTMENT.
 3. PROVIDE WITH HVAV PACKAGE WITH MANUAL CONTROL (VFD FACTORY MOUNTED).
 4. PROVIDE SPRING/NEOPRENE ISOLATION HANGERS.
 5. PROVIDE UNIT WITH NAME PLATE TO INCLUDE DESIGNATION AND AREA SERVED BY FAN.
 6. PROVIDE WITH MANUFACTURER'S 2 YEAR WARRANTY.
 7. INSTALL PER MANUFACTURER'S INSTRUCTIONS.
 8. PROVIDE WITH BACKDRAFT DAMPER.
 9. PROVIDE WITH ADAPTERS AS NECESSARY TO MAKE DUCT CONNECTIONS.
 10. EQUIPMENT SHALL BE PROCURED THROUGH A CAPTIVEAIRE NATIONAL ACCOUNT. ANY CHANGES OR VARIATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE CAPTIVEAIRE NATIONAL ACCOUNT TEAM - CONTACT KEVIN BOEHM - REG40@CAPTIVEAIRE.COM

EXTERIOR WALL LOUVER SCHEDULE

MARK	MANUFACTURER	MODEL	DESCRIPTION	WIDTH	HEIGHT	DEPTH	DESIGN AIRFLOW RATE	DESIGN FREE AREA VELOCITY	MIN. FREE AREA	BEGINNING POINT OF WATER PENETRATION	MAX. PRESSURE DROP	REMARKS
------	--------------	-------	-------------	-------	--------	-------	---------------------	---------------------------	----------------	--------------------------------------	--------------------	---------

REMARKS:
 1. PROVIDE INTEGRAL FRAME FLANGE.
 2. PROVIDE KYNAR FINISH IN CUSTOM COLOR, TO BE SELECTED BY ARCHITECT.
 3. PROVIDE 3/4"X0.051" FLATTENED EXPANDED ALUMINUM BIRDSCREEN IN REMOVABLE FRAME, INSIDE-MOUNTED.
 4. LOUVER SHALL BEAR AMCA SEAL.

DEMAND CONTROL VENTILATION CALCULATIONS

UNIT	SPACE NAME	OCCUPANCY CATEGORY	ZONE FLOOR AREA (SF)	ZONE POPULATION (RA)	ZONE DENSITY (PZ/1000 SF)	OUTDOOR AIRFLOW RATE PER PERSON (RP)	OUTDOOR AIRFLOW RATE PER AREA (PZ)	ZONE AIR DISTRIBUTION EFFECTIVENESS (EZ)	DCV MINIMUM CFM (300 PPM)		DCV DESIGN CFM (900 PPM)	
									CALCULATED	PROVIDED	CALCULATED	PROVIDED
									AHU-1/AHU-2	DINING	DINING ROOMS	1094
AHU-1/AHU-2	CIRCULATION	CORRIDOR	119	0	0	0	0.06	0.8	7	10	7	10
									210		945	

RECIRCULATING HOOD SCHEDULE

MARK	BASIS OF DESIGN		TYPE	WATTS	V/PH	CFM	SUPPLIER/INSTALLER	WEIGHT (LBS)	REMARKS
	MANUFACTURER...	MODEL							
HD-1	RATIONAL	60.76.177	VENTLESS CANOPY HOOD	170	120/1/60	415	KES	175	ALL

REMARKS:
 1. SEE PLANS FOR DUCT SIZE AND ROUTING.
 2. UL710B COOKING APPLIANCE WITH A GREASE DISCHARGE LESS THAN 5.0 E-06 KG/CUBIC METER WHERE OPERATED WITH A TOTAL AIRFLOW OF 500 CFM.
 3. CONTACT SINGER EQUIPMENT FOR KITCHEN EQUIPMENT SUPPLY TEAM - KATIE DIXON - KDIXON@SINGEREQUIPMENT.COM - 443.419.1009.

CONDENSING UNIT SCHEDULE

MARK	DESCRIPTION	COMPRESSORS	FURNISHED BY	INSTALLED BY	MANUFACTURER	REMARKS
CU-6	WALK-IN COOLER REMOTE CONDESIGN UNIT	1	KES	KES	BY KES	ALL

REMARKS:
 1. FURNISHED WITH THE WALK-IN COOLER.

MINIMUM VENTILATION CALCULATIONS

UNIT NAME	ROOM NAME	OCCUPANCY CATEGORY	ZONE FLOOR AREA	ZONE POPULATION (RA)	USER DEFINED POPULATION	ZONE DENSITY (PZ / 1000 SF)	OUTDOOR AIRFLOW RATE PER PERSON (AZ)	OUTDOOR AIRFLOW RATE PER AREA (PZ)	ZONE AIR DISTRIBUTION EFFECTIVENESS (EZ)	BREATHING ZONE OUTDOOR AIRFLOW (VBZ)	REQUIRED OUTDOOR AIR INTAKE FLOW, VOT	OUTDOOR AIR FLOW (VOZ)	ZONE OUTDOOR AIR FLOW (VOZ)
AHU-3	FRONT KITCHEN	KITCHEN (COOKING)	536 SF	4	4	20	7.5 CFM	0.12 CFM/FT²	0.8	94 CFM	118 CFM	117.9	120
AHU-3											118 CFM	120	
AHU-4	BACK KITCHEN	KITCHEN (COOKING)	477 SF	4	4	20	7.5 CFM	0.12 CFM/FT²	0.8	87 CFM	109 CFM	109.05	110
AHU-4	OPERATIONS OFFICE	OFFICE SPACE	61 SF	1	1	5	5.0 CFM	0.06 CFM/FT²	0.8	9 CFM	11 CFM	10.825	15
AHU-4	CIRCULATION	CORRIDORS	251 SF	0	0	0	0.0 CFM	0.06 CFM/FT²	0.8	15 CFM	19 CFM	18.825	20
AHU-4											139 CFM	145	

MINIMUM EXHAUST REQUIREMENTS

UNIT NAME	ROOM NAME	OCCUPANCY CATEGORY	NUMBER OF FIXTURES	ZONE FLOOR AREA	ASHRAE EXHAUST AIRFLOW DENSITY	ASHRAE EXHAUST AIRFLOW PER UNIT	DESIGN ACH	CALCULATED AIRFLOW	DESIGN AIRFLOW
EF-1	NORTH RR	TOILETS - PUBLIC - INTERMITTENTLY	1	56 SF	0 CFM/FT²	70 CFM	0	70 CFM	70 CFM
EF-1								70 CFM	70 CFM
EF-2	SOUTH RR	TOILETS - PUBLIC - INTERMITTENTLY	1	55 SF	0 CFM/FT²	70 CFM	0	70 CFM	70 CFM
EF-2								70 CFM	70 CFM

AIR BALANCE SCHEDULE

MARK	(CFM) SUPPLY AIR	(CFM) RETURN	(CFM) OA	(CFM) EXHAUST	(CFM) TOTAL:
AHU/HP-1	1600	1125	475		475
AHU/HP-2	1600	1125	475		475
AHU/HP-3	1200	1185	120		120
AHU/HP-4	1200	1185	145		145
EF-1				-70	-70
EF-2				-70	-70
EF-3				-930	-930
NET PRESSURIZATION (CFM):					145

AIR DEVICE SCHEDULE

MARK	MANUFACTURER	MODEL	DESCRIPTION	FACE SIZE	MATERIAL	MOUNTING STYLE	REMARKS
R-1	TITUS	350FL	RETURN GRILLE WITH 3/4" BLADE SPACING, 35 DEGREE DEFLECTION AND FRONT BLADES PARRALEL TO SHORT DIMENSION	24X24	ALUMINUM	LAY-IN	1,3,4
R-2	TITUS	350FL	RETURN GRILLE WITH 3/4" BLADE SPACING, 35 DEGREE DEFLECTION AND FRONT BLADES PARRALEL TO SHORT DIMENSION	24X24	ALUMINUM	SURFACE	1,3,4
R-3	TITUS	350FL	RETURN GRILLE WITH 3/4" BLADE SPACING, 35 DEGREE DEFLECTION AND FRONT BLADES PARRALEL TO SHORT DIMENSION	24X12	ALUMINUM	SURFACE	
S-1	TITUS	TMS-AA	HIGH PERFORMANCE 3-CONE DIFFUSER	24X24	ALUMINUM	LAY-IN	ALL
S-2	TITUS	TMS-AA	HIGH PERFORMANCE 3-CONE DIFFUSER	24X24	ALUMINUM	SURFACE	ALL
S-3	TITUS	TMS-AA	HIGH PERFORMANCE 3-CONE DIFFUSER	12X12	ALUMINUM	LAY-IN	ALL

REMARKS:
 1. COORDINATE BORDER TYPE AND FINISH WITH ARCHITECT PRIOR TO PURCHASING.
 2. MATCH SNAPLOCK AND FLEXIBLE DUCT RUNOUT SIZES AS NOTED ON PLANS.
 3. MODULE SIZE INDICATED INCLUDES NOMINAL BORDER SIZE.
 4. PROVIDE OPPOSED BLADE MANUAL VOLUME DAMPER FOR AIRFLOW ADJUSTMENT ACCESSIBLE THROUGH GRILLE FACE.
 5. ALL DIFFUSERS IN INACCESSIBLE CEILINGS SHALL BE PROVIDED WITH CABLE OPERATED DAMPERS. DAMPER TO BE ADJUSTABLE FROM THE FACE OF DIFFUSER.




sweetgreen

3102 WEST 36TH STREET
 LOS ANGELES, CALIFORNIA 90018

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION OR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

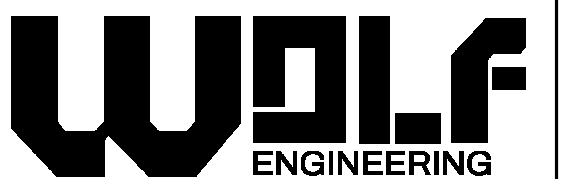

P.O. BOX 38 | DALTON, GA 30722

STAMP:



PROJECT INFORMATION:
BENTONVILLE

PROJECT INFORMATION:
**1701 SE 8TH STREET
 SUITE #11
 BENTONVILLE, AR 72712**

DRAWN BY: TAL
 CHECKED BY: EW
 PROJECT MANAGER: JH
 SG DESIGN MANAGER: SC
 SG DM CHECKED BY: SC
 SG CONSTR. MANAGER: MC
 PROJECT NO: 20250070.0
 TEMPLATE VERSION: 2401


REVISIONS
 REV. DATE DESCRIPTION
 06/24/2025 ISSUE FOR PERMIT

MECHANICAL SCHEDULES

M-300

THESE DRAWINGS & SPECIFICATIONS ARE CONFIDENTIAL AND SHALL REMAIN THE SOLE PROPERTY OF SWEETGREEN CORPORATION. THEY SHALL NOT BE REPRODUCED IN WHOLE OR IN PART, SHARED WITH THIRD PARTIES OR USED IN ANY MANNER ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT WITHOUT THE PRIOR WRITTEN CONSENT OF SWEETGREEN CORPORATION. THESE DRAWINGS & SPECIFICATIONS ARE INTENDED TO EXPRESS DESIGN INTENT FOR A PROTOTYPICAL SWEETGREEN STORE WHICH IS SUBJECT TO CHANGE AT ANY TIME AND MAY NOT REFLECT ACTUAL SITE CONDITIONS. NEITHER PARTY SHALL HAVE ANY OBLIGATION OR LIABILITY TO THE OTHER (EXCEPT AS STATED ABOVE) UNTIL A WRITTEN AGREEMENT IS FULLY EXECUTED.

ENGINEER OF RECORD:

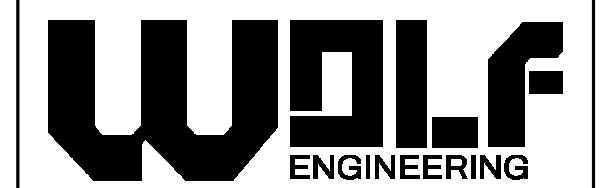

P.O. BOX 38 | DALTON, GA 30722

STAMP:




PROJECT INFORMATION:
BENTONVILLE
PROJECT INFORMATION:
**1701 SE 8TH STREET
SUITE #11
BENTONVILLE, AR 72712**

DRAWN BY: TAL
CHECKED BY: EW
PROJECT MANAGER: JH
SG DESIGN MANAGER: SC
SG DM CHECKED BY: SC
SG CONSTR. MANAGER: MC
PROJECT NO: 20250070.0
TEMPLATE VERSION: 2401


REVISIONS
REV. DATE DESCRIPTION
06/24/2025 ISSUE FOR PERMIT

**MECHANICAL
DETAILS**


M-400

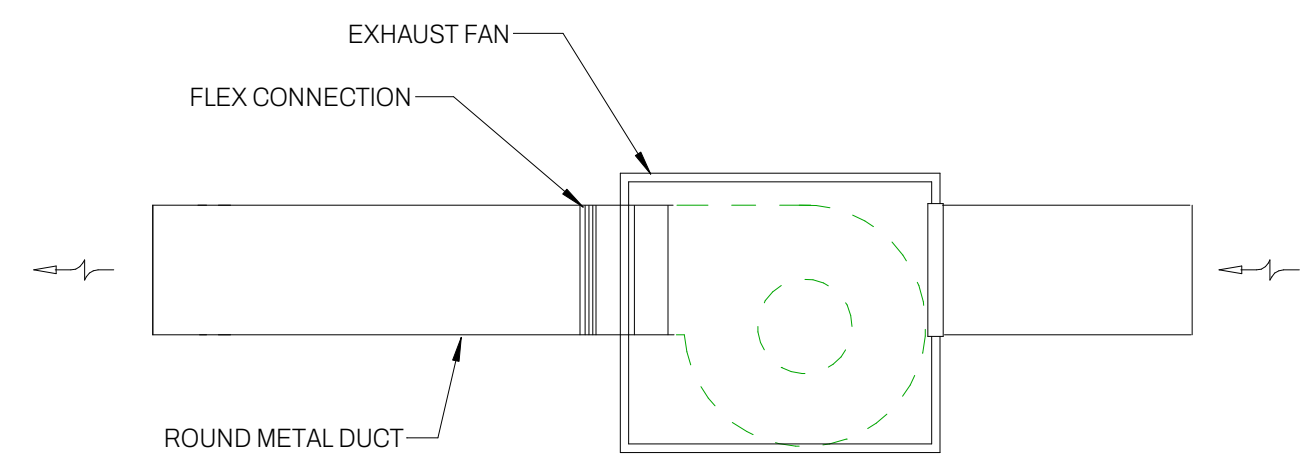


8 MECHANICAL - IN-LINE EXHAUST FAN
M-400 N.T.S.

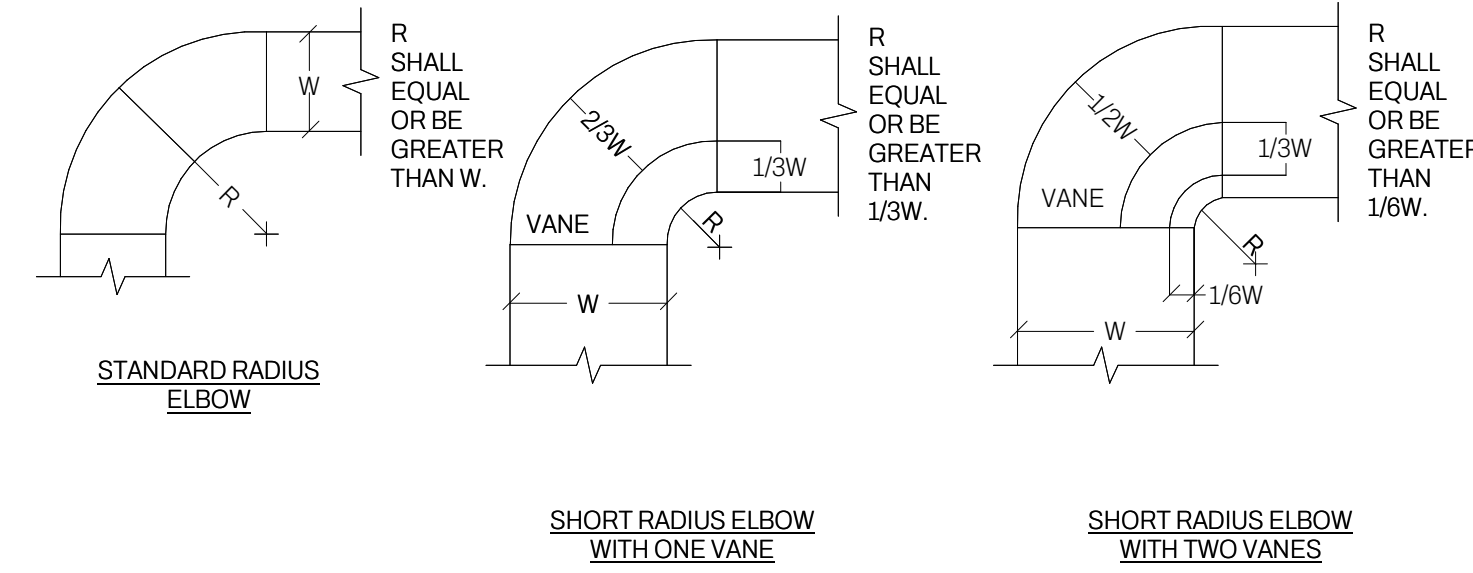


9 MECHANICAL - TYPICAL RADIUS ELBOW DETAIL
M-400 N.T.S.

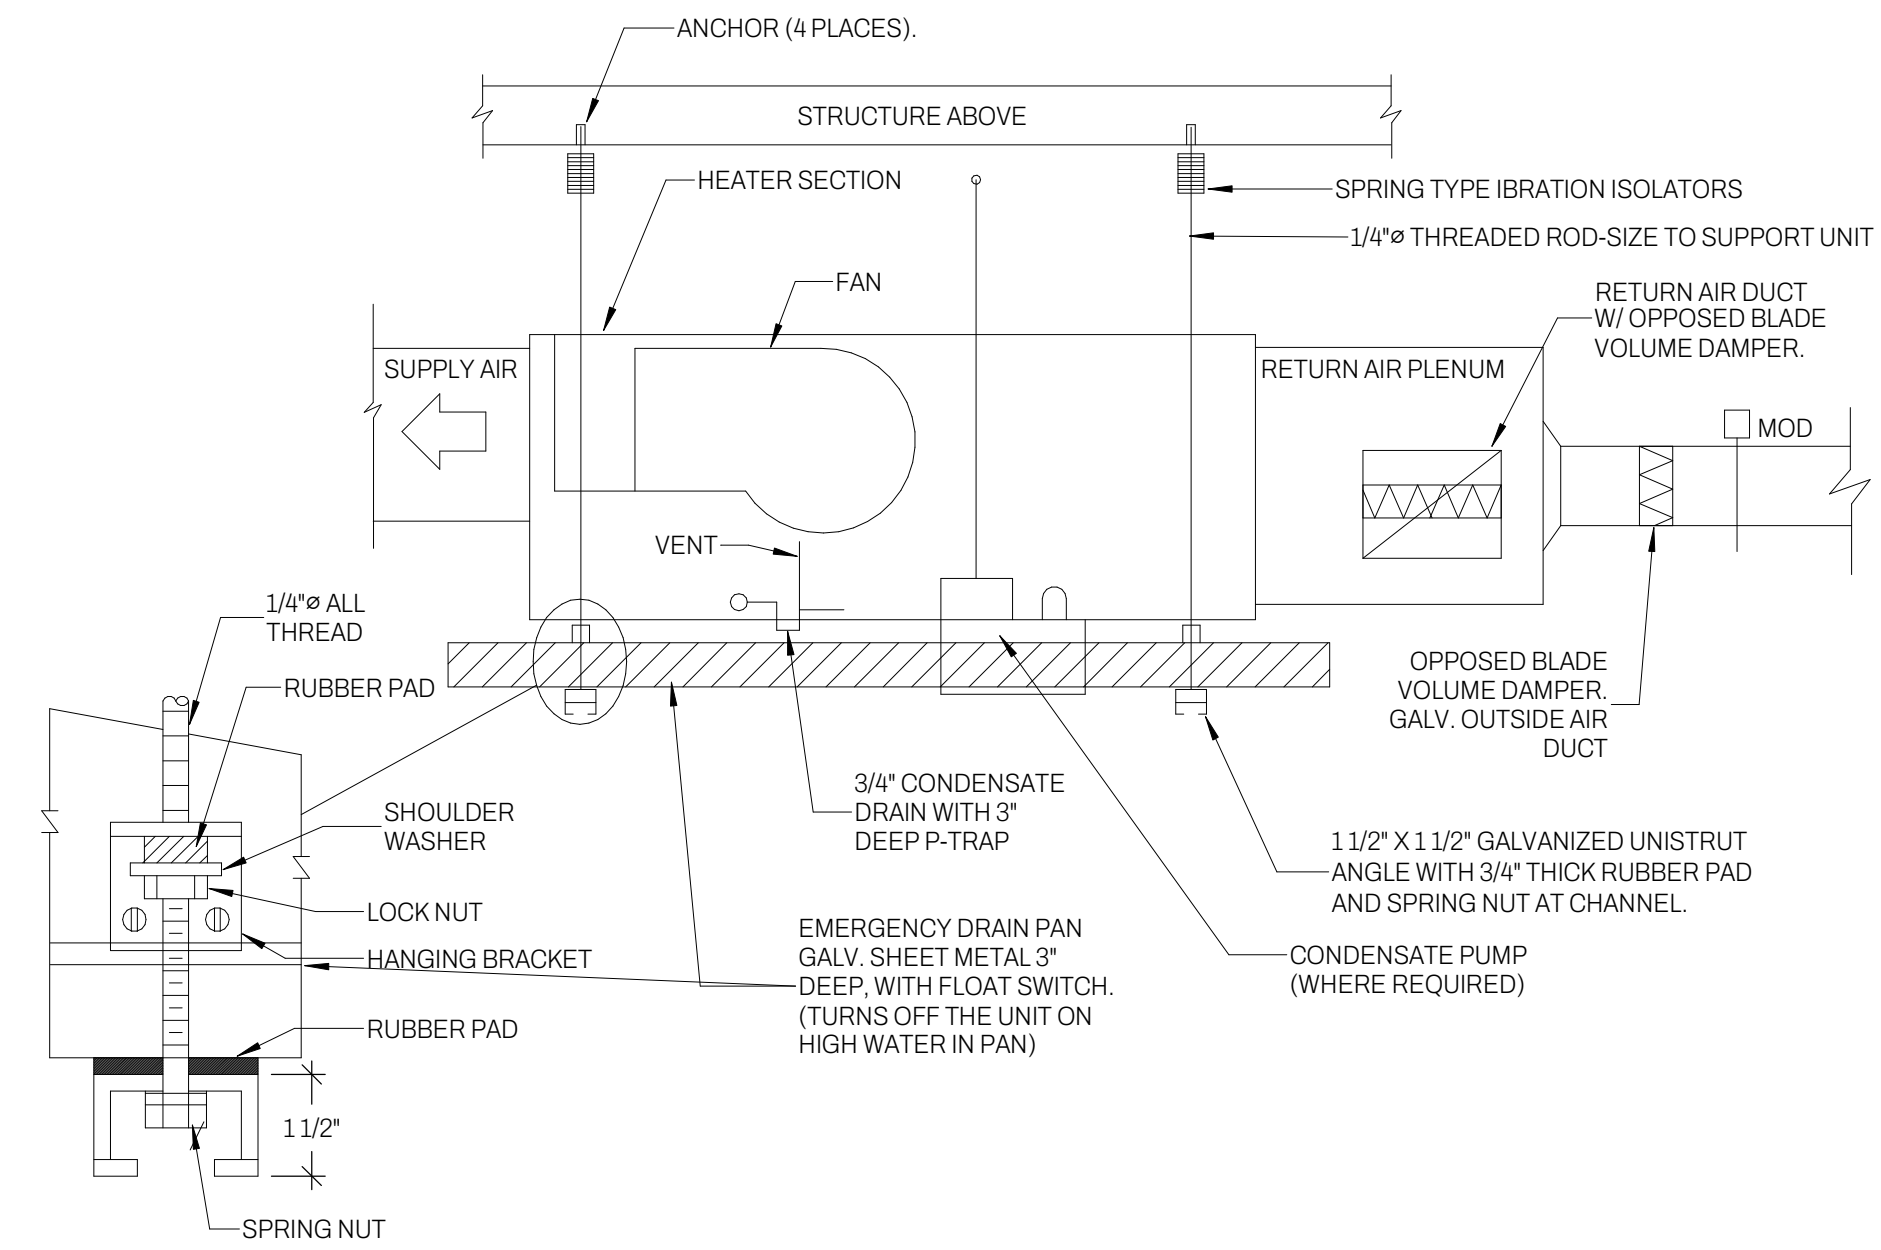


10 MECHANICAL - HORIZONTAL AIR HANDLING UNIT DETAIL
M-400 N.T.S.

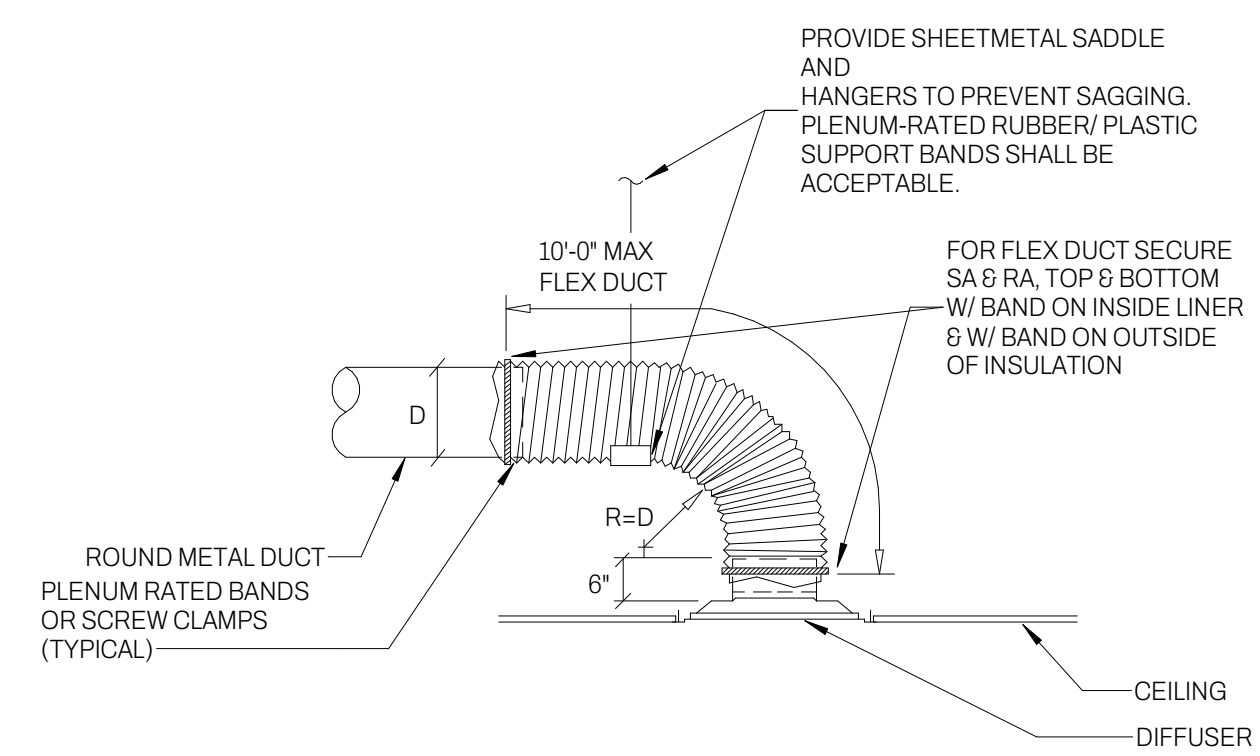


4 DIFFUSER CONNECTION DETAIL
M-400 NOT TO SCALE

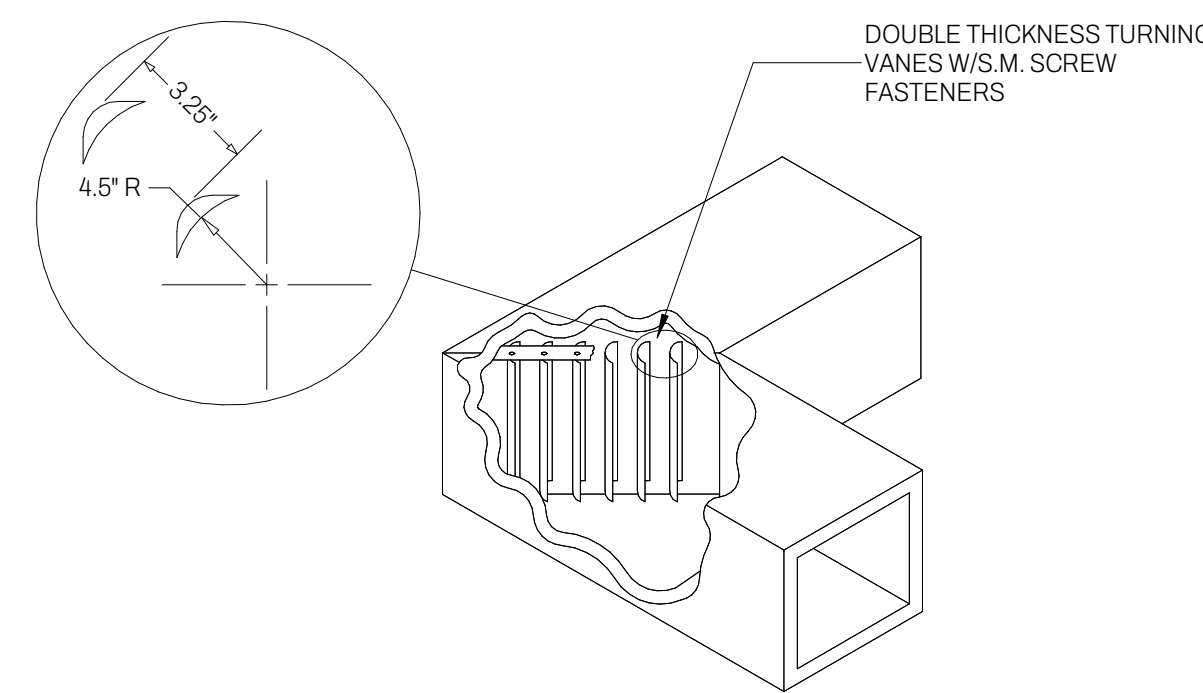


5 TURNING VANE DETAIL
M-400 NOT TO SCALE

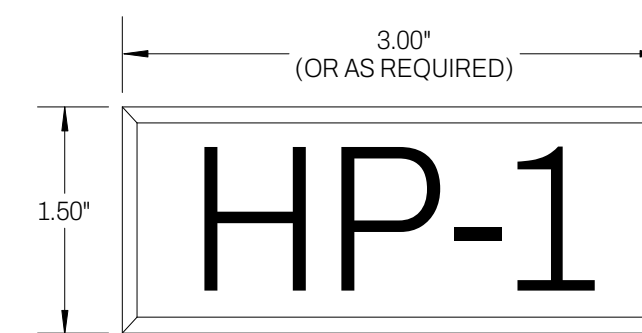


6 TYPICAL ENGRAVED TAG DETAIL
M-400 NOT TO SCALE

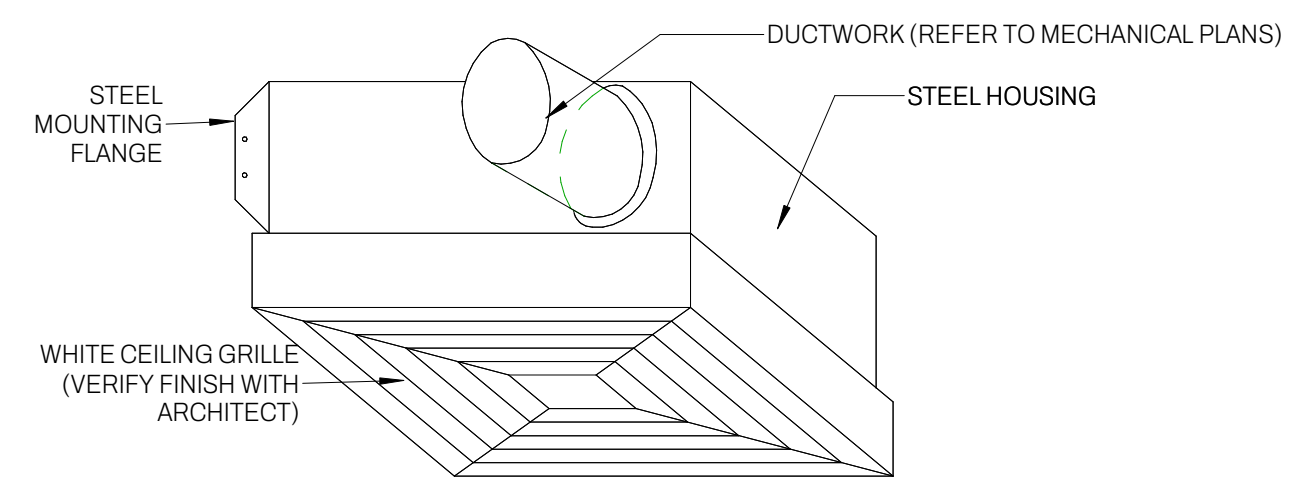


7 CABINET CEILING EXHAUST FAN
M-400 NOT TO SCALE

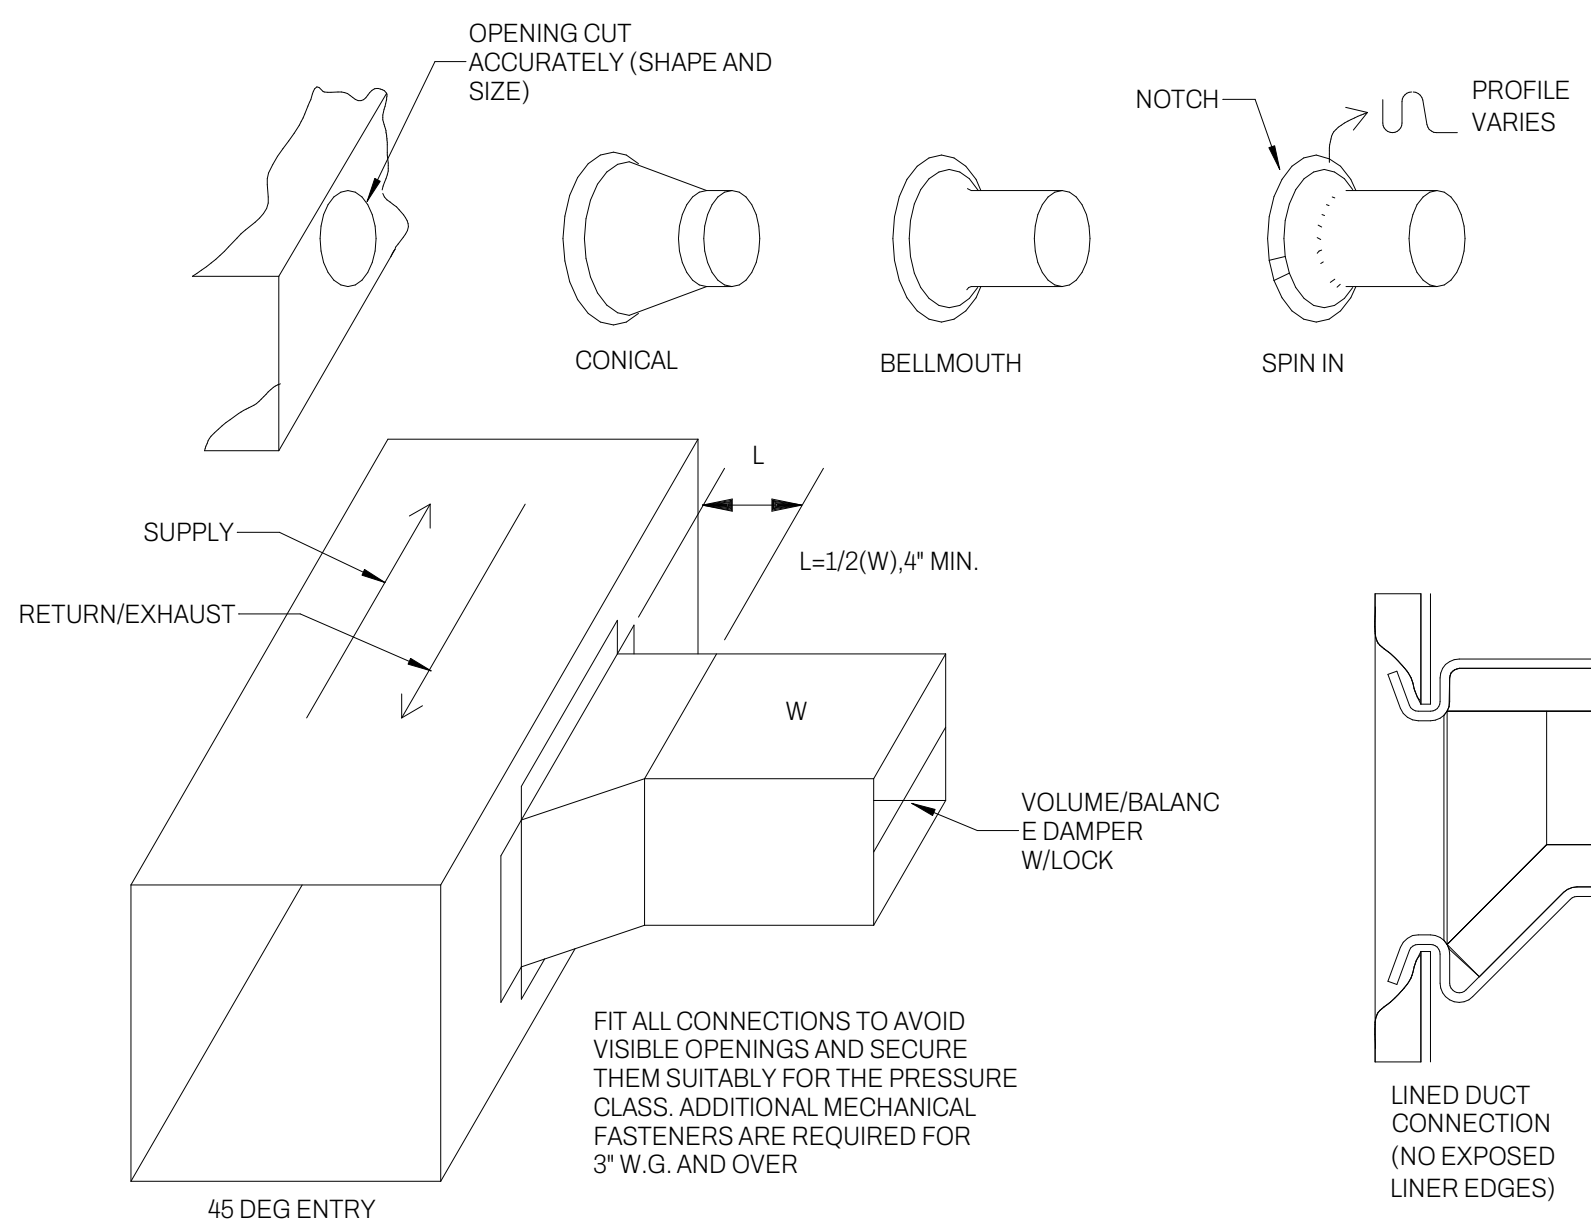

1 DUCT BRANCH CONNECTION DETAIL
M-400 NOT TO SCALE

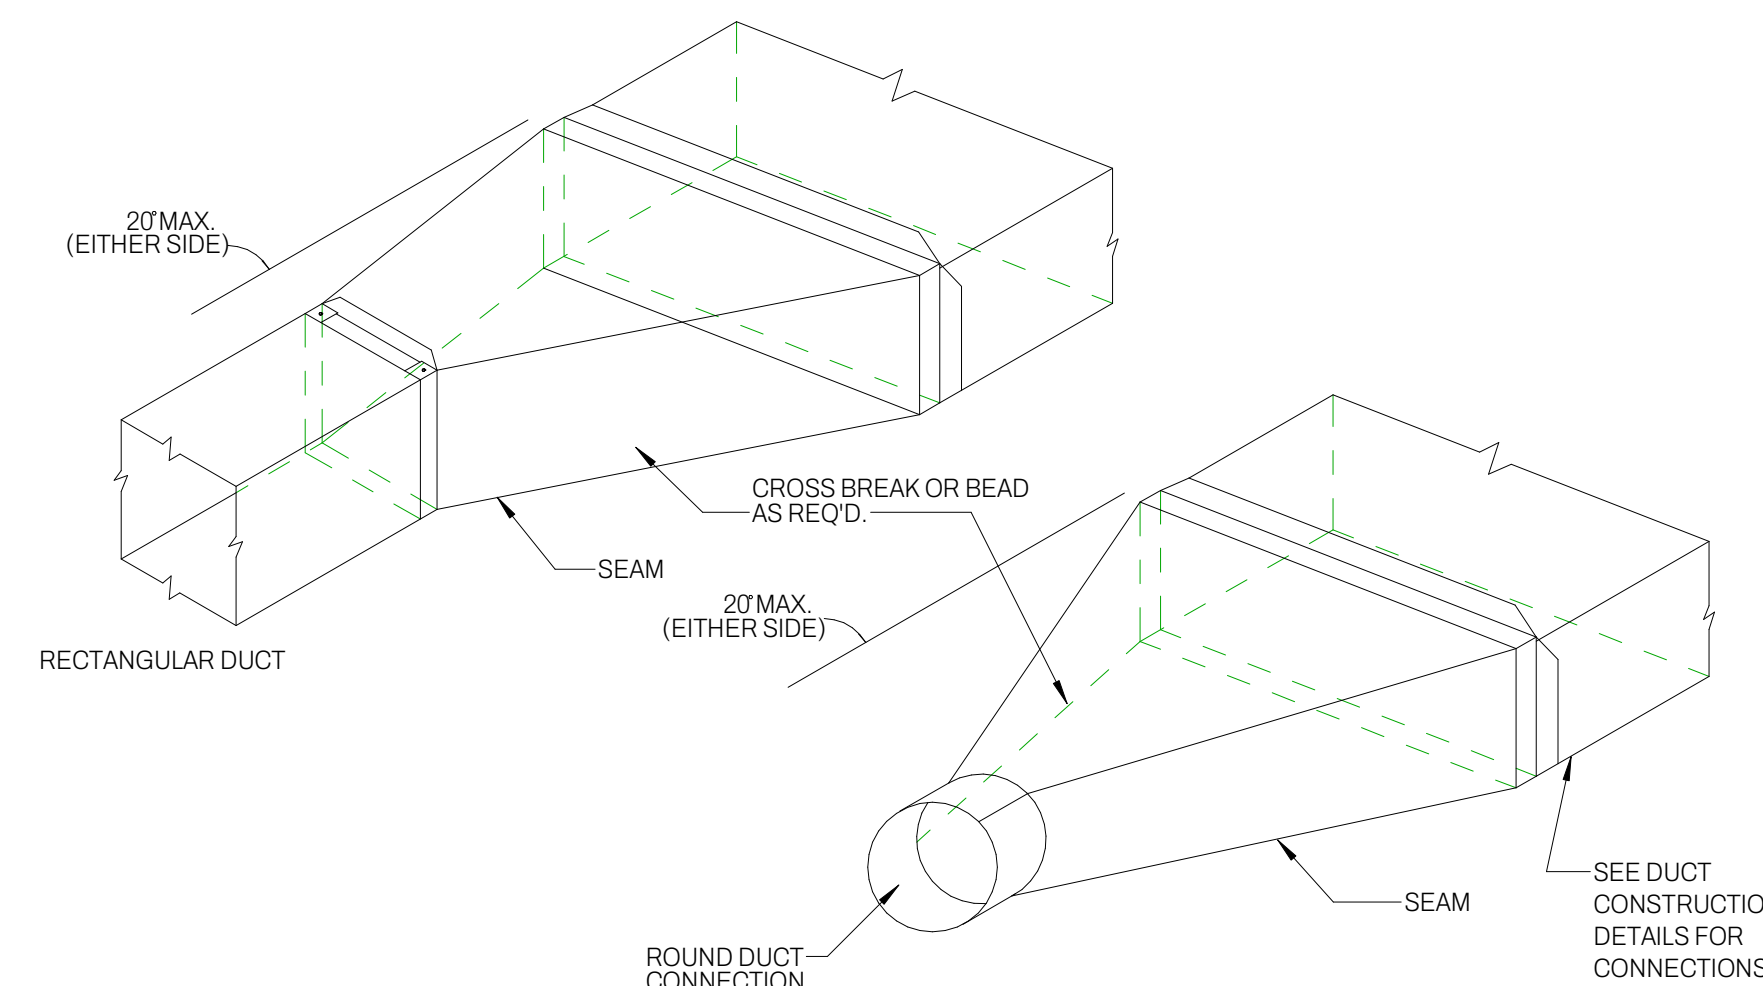

2 TRANSITION DETAIL
M-400 NOT TO SCALE

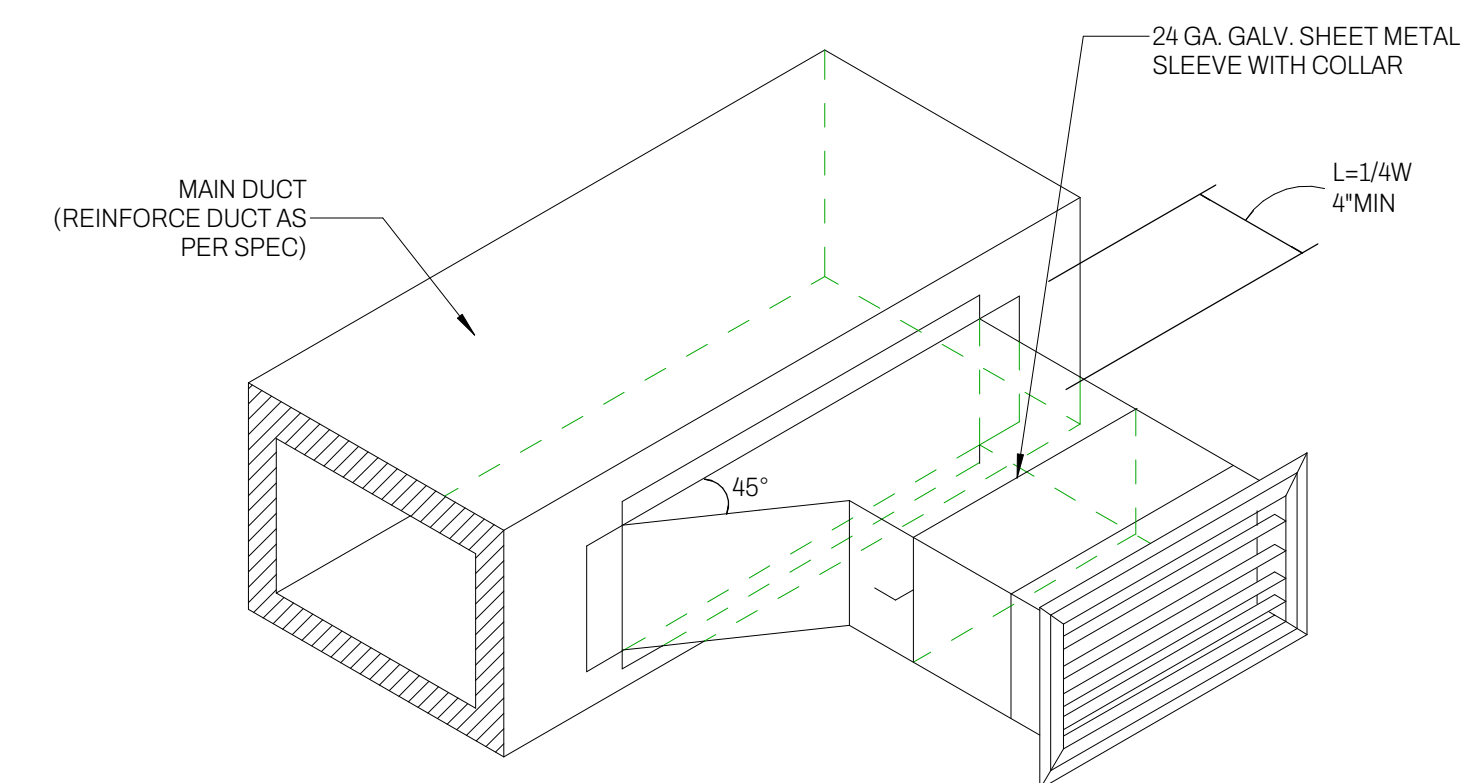

3 MECHANICAL - SIDEWALL REGISTER DETAIL
M-400 N.T.S.