




8 HVAC DINING ROOM SECTION
1/4" = 1'-0"

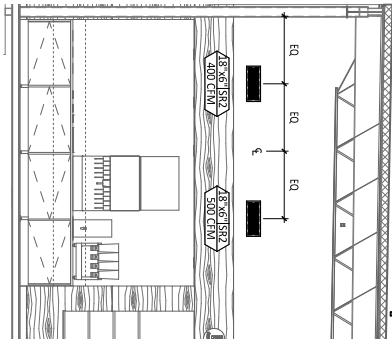

5 HVAC DINING ROOM SECTION
1/4" = 1'-0"

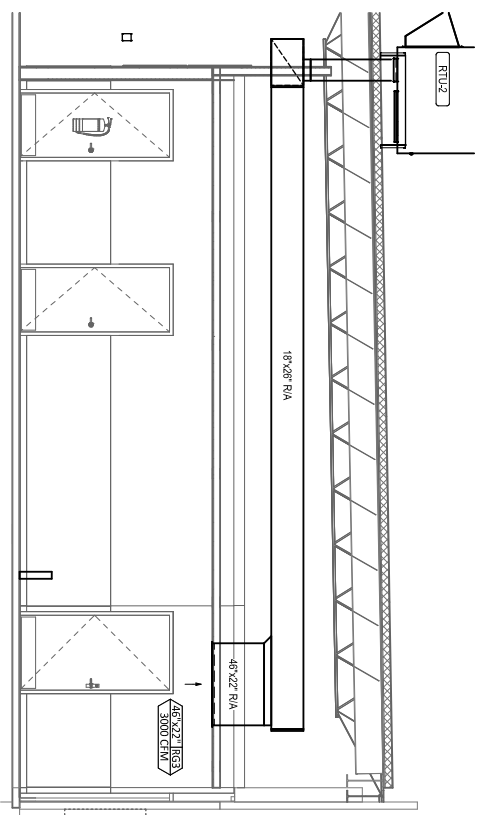


4 HVAC DINING ROOM RETURN SECTION
1/4" = 1'-0"

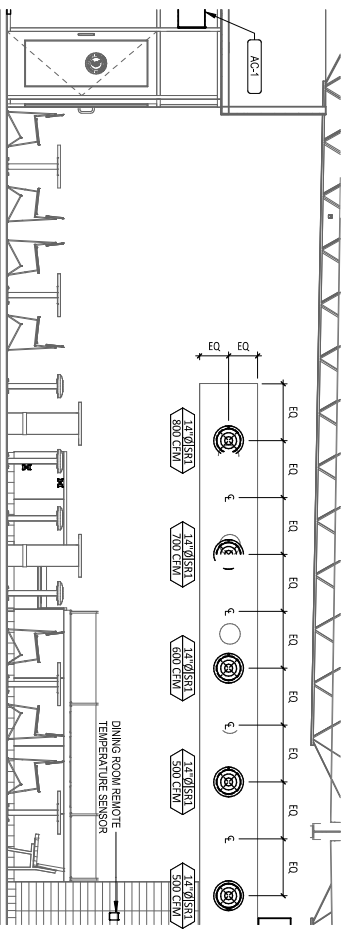

3 HVAC DINING ROOM SECTION
1/4" = 1'-0"

- 1 SUPPLY DUCT UP THROUGH ROOF TO TRANSITION TO RTU2 IN ROOF CURB.
- 2 MAKEUP AIR DUCT UP THROUGH ROOF TO TRANSITION TO MAKEUP AIR IN ROOF CURB.
- 3 EXHAUST DUCT UP THROUGH ROOF TO EX-1 COMPLIANT WITH MPA 96. PROVIDE INSULATED ELBOWS WITH AN INSIDE RADIUS OF 6.5W AT ELBOWS IN GREASE DUCT.
- 4 DUCT UP THROUGH ROOF TO EF-2.
- 5 28W DUCT DOWN TO MAKEUP AIR PDP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE TYPICAL FOR 3.
- 6 9\"/>

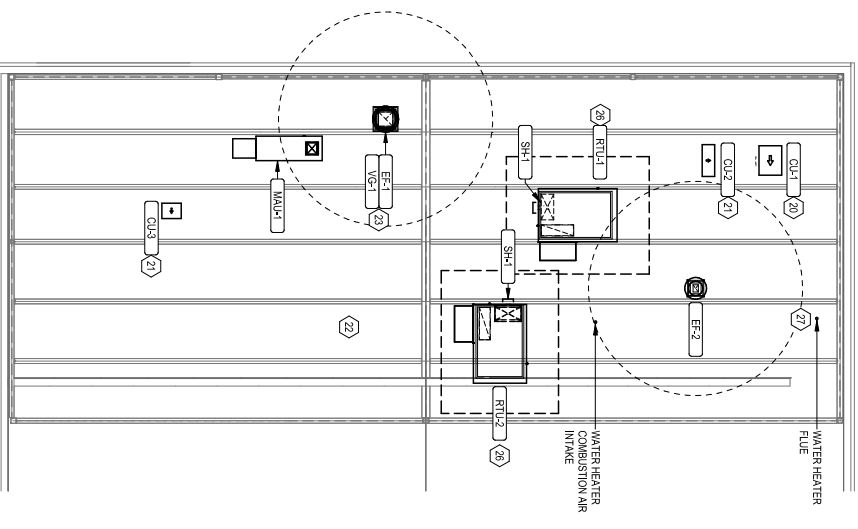

2 ROOF MECHANICAL PLAN
1/8" = 1'-0"

7

