


EQUIPMENT SCHEDULE

Packaged Ventilator														
Mark Name	Qty	Model	Mounting Location	Weight	Outdoor Air Volume	Recirc Air Volume	Economizer Outdoor Air Volume	Economizer Exhaust Air Volume						
RTU-1 (Dining)	1	XRV-45-20J-1-G1	Outdoor	3,216 lb	1,955 CFM	4,795 CFM	NA	NA						
Supply Fan				Electrical										
Supply Air Volume	Supply ESP	Supply TSP	FRPM	Supply BHP	Supply Motor	Voltage	Frequency	Phase	Unit MCA	Unit MOP				
6,750 CFM	0.75 in. wg	2.378 in. wg	1592	4.207	(1) 5 hp	208	60	3	99.9	125				
Cooling Section														
Coil Entering DB	Coil Entering WB	Coil Leaving DB	Coil Leaving WB	Nominal Tonnage	Total Capacity	Sensible Capacity	Coil Face Velocity	Coil Pressure Drop	Rows Deep	Fins per Inch	Compressor Type	Compressor Qty	AHRI 340/360 EER	AHRI 340/360 IEER
79.6 F	67.9 F	54.1 F	53.9 F	20.0	295.8 MBH	189.8 MBH	299 ft/min	0.419 in. wg	6	14	Inverter Scroll	2	10.6	17.2
Heating Section						Hot Gas Reheat								
Actual Size	EAT	LAT	Voltage	Amps	Controls	Single Point Power	Temp Rise	Hot Gas Reheat Capacity	LAT					
32.8 kW	31.0 F	75.5 F	208 V	91.0 A	SCR	No	15.4 F	226.5 MBH	85.1 F					
NOTES														
Painted exterior with 2,500 hr. salt spray rating. Double wall 2" R13 injected foam insulated cabinet. Single condenser fan shall not exceed a sound power level of 75 LWA. Compressors mounted on a shelf behind an insulated door for minimized radiated and transmitted sound. Direct-drive fans with factory mounted VFDs. Controller must have simplified access via a laptop to view and change unit operation, set points, alarm history & 1 week of trending data. EC motors on all condenser fans.														
OPTIONS AND ACCESSORIES														
Weatherhood: Downturned Hood Supply Filters - 2" Pleated MERV 13, 3-16x20x2, 3-20x20x2 Outdoor Air Dampers - Motorized Low Leakage Recirc Dampers - Motorized Low Leakage Barometric Damper Painted Exterior - Concrete Gray (RAL 7023) Microprocessor Controls Supply Fan VFD Control - Constant Volume-Adj. Setpoint O/A/R Damper Controls - Constant Position-Adj. Setpoint Economizer Mode - Temp./Enthalpy Space Thermostat - 1 Temp and RH Only Remote Display w/150' Cord Dirty Filter Sensor: Final Phase and Brown Out Protection Branch Circuit Fusing 120v NEMA 3R Outlet (Factory mounted and wired) Unit Disconnect - Mounted By Factory Hail Guards Shipped Loose Smoke Detectors - Exhaust Condensate Overflow Switch Economizer Fault Detection Diagnostics Special Design Request(s) Special Design Request for "O/A/R damper controls by building pressure", (09999999) Unit Warranty: 18 Months Standard														

Curb Installation Instructions


1. Factory supplied roof curbs. Roof curbs are model GKD which ship in a knockdown kit (includes duct adapters) and require field assembly (by others) on all units except XRV-110 which are shipped assembled. Assembly instructions are included with the curb kit.
2. Install curb. Locate curb over roof opening and fasten in place. Check that the diagonal dimensions are within ± 1/8 inch of each other and adjust as necessary. For proper coil drainage and unit operation, it is important that the installation be level. Shim the curb as required to level. Install gasketing on top surface of curb (provided by others).
3. Install ductwork. Installation of all ducts should be done in accordance with SMACNA and AMCA guidelines. Duct adapters are provided to support ducts prior to setting the unit.
4. Set the unit. Lift unit to a point directly above the curb and duct openings. Guide unit while lowering to align with duct openings. Roof curbs fit inside the unit base. Make sure the unit is properly seated on the curb and level.
5. Fasten the unit. Fasten the unit to the curb/equipment support(s) using the appropriate methods. The installer is responsible for determining appropriate support and fastening methods to ensure compliance with all applicable codes.
6. Install vestibule. If unit was ordered with a vestibule and it has not yet been attached to the unit, caulk and attach the vestibule at this time.

Curb Detail

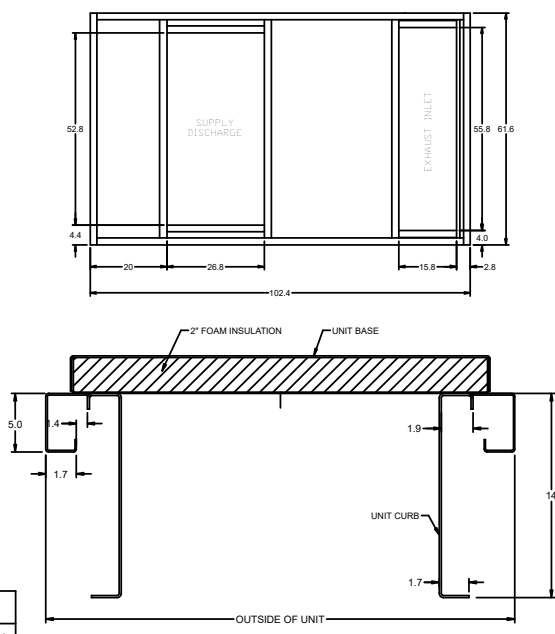


Curb Specifications						
Height (in)	Length (in)	Width (in)	Material	Finish Type	Duct Adapter	Weight (lb)
14	102.4	61.6	Galvanized	Galvanized	Yes	263

Component Layout

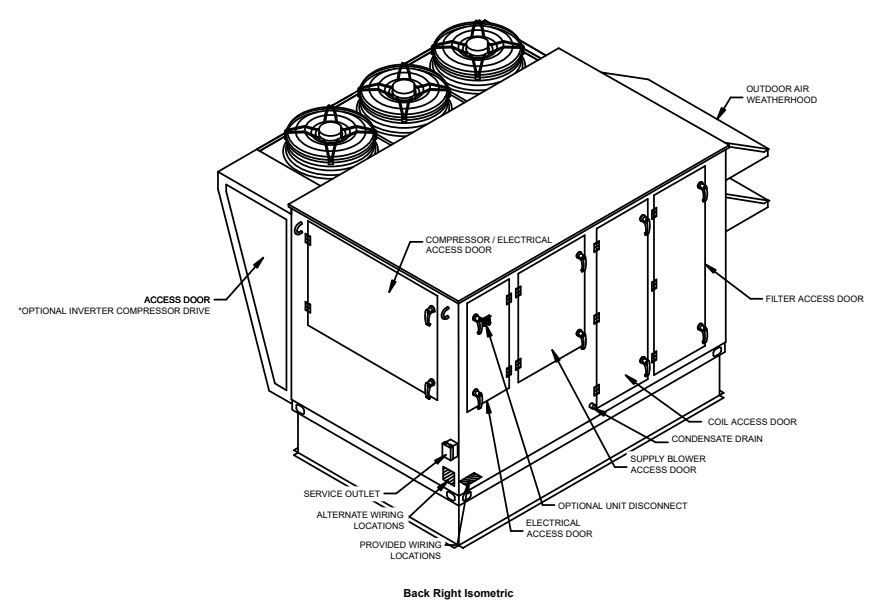


Back Right Isometric

Service Clearances

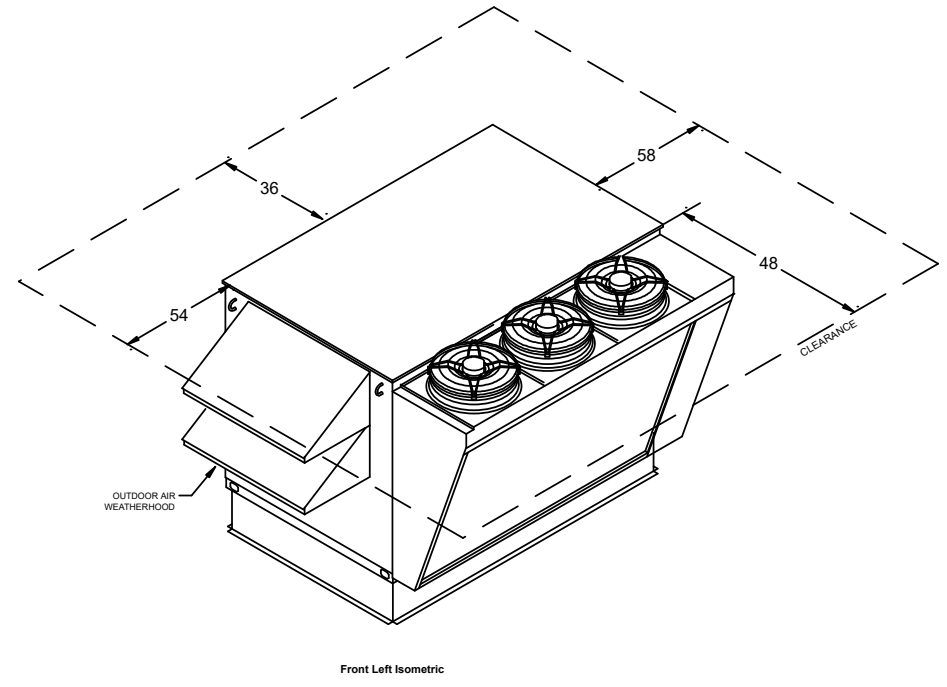


Front Left Isometric


**Electrical Connections**

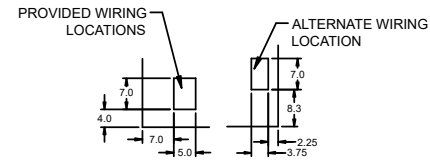


**Dimensional Overview**

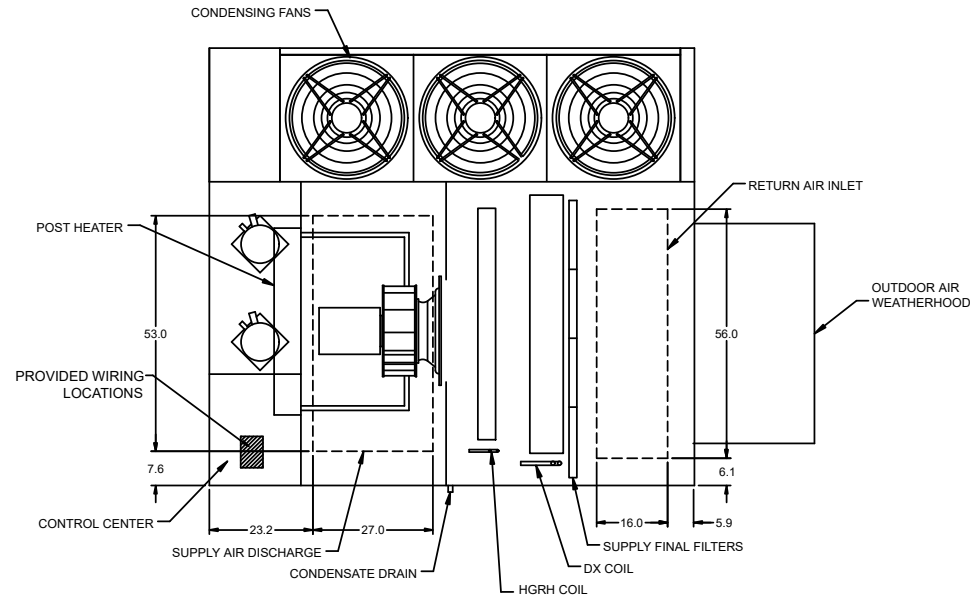


**Plan**

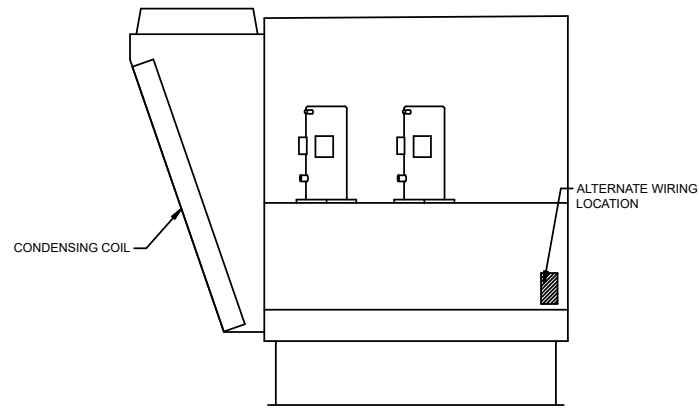

**Left End**

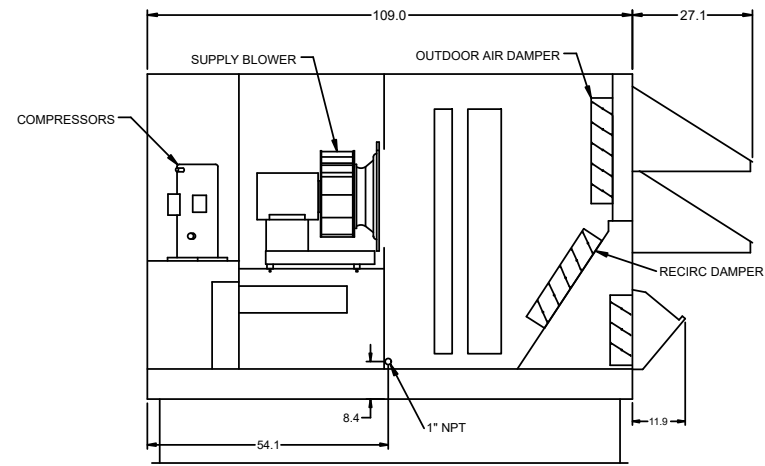

**Elevation**

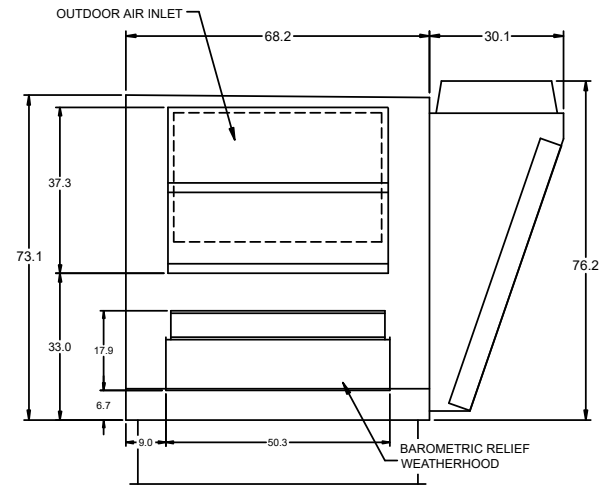


**Right End**



CULVERS - NORTH FORT MEYERS DOAS


PROJECT 2/15/2023

ACCUREX W/L/A  
ANDREW JACOBS  
BRAD BORCHARDT@ACCUREX.COM  
(262)227-7865

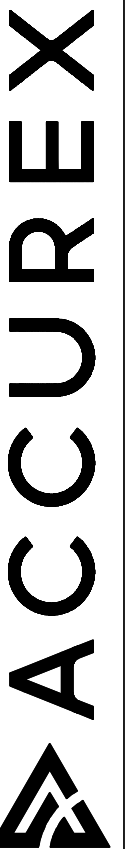


RTU-1 (DINING)

MARK

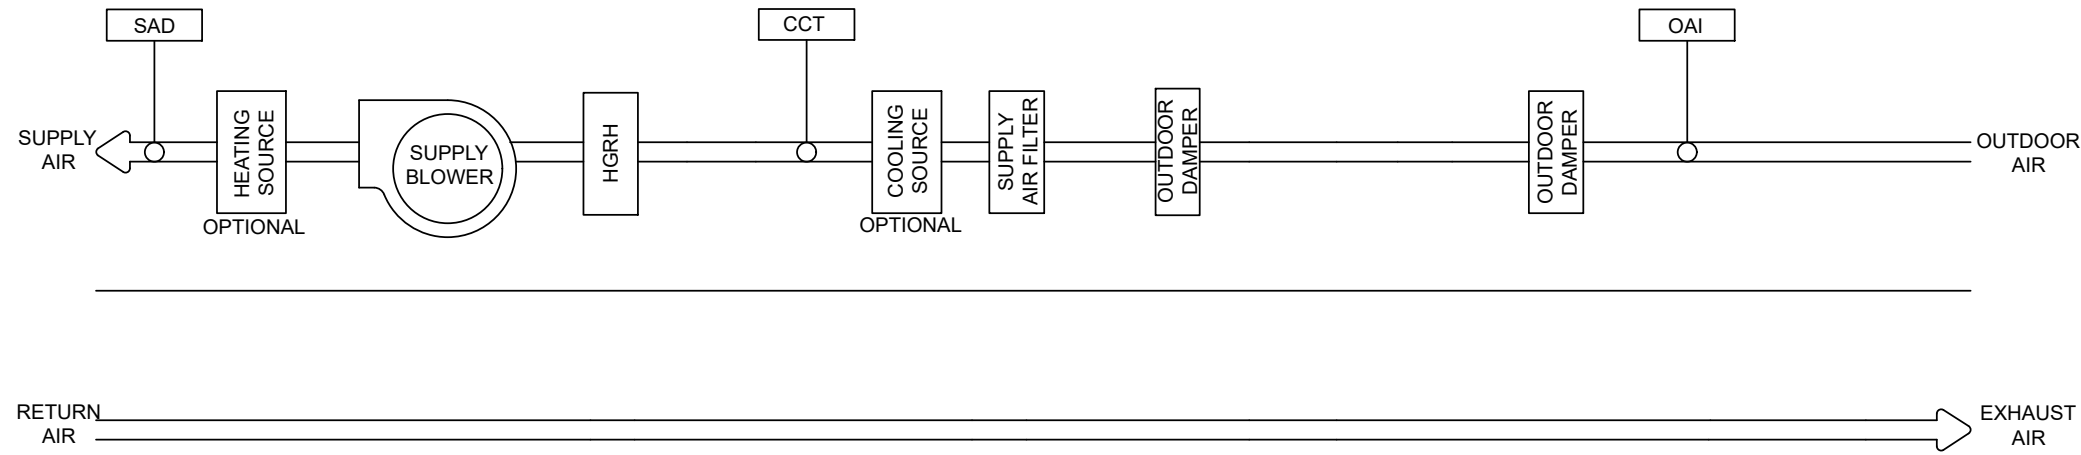

SENSORS	
SAD:	Supply air discharge temperature
OAI:	Outdoor air intake temperature
CS:	Condensate overflow switch
CCT:	Cooling coil temperature

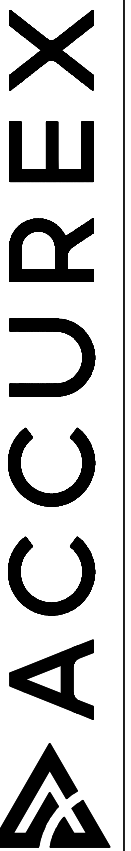

ACCUREX W/L/A  
 ANDREW JACOBS  
 BRAD.BORCHARDT@ACCUREX.COM  
 (262)227-7865

PROJECT)  
 2/15/2023

CULVERS - NORTH FORT  
 MEYERS DOAS

MARK

RTU-1 (DINING)



COMMERCIAL ROOF TOP UNITS

EQUIPMENT SCHEDULE

Packaged Ventilator														
Mark Name	Qty	Model	Mounting Location	Weight	Outdoor Air Volume	Recirc Air Volume	Economizer Outdoor Air Volume	Economizer Exhaust Air Volume						
RTU-2 (Kitchen)	1	XRV-25-15J-1-G1	Outdoor	2,391 lb	1,495 CFM	4,855 CFM	NA	NA						
Supply Fan				Electrical										
Supply Air Volume	Supply ESP	Supply TSP	FRPM	Supply BHP	Supply Motor	Voltage	Frequency	Phase	Unit MCA	Unit MOP				
6,150 CFM	0.75 in. wg	3.605 in. wg	2701	6.651	(1) 7-1/2 hp	208	60	3	95.8	125				
Cooling Section														
Coil Entering DB	Coil Entering WB	Coil Leaving DB	Coil Leaving WB	Nominal Tonnage	Total Capacity	Sensible Capacity	Coil Face Velocity	Coil Pressure Drop	Rows Deep	Fins per Inch	Compressor Type	Compressor Qty	AHRI 340/360 EER	AHRI 340/360 IEER
78.9 F	67.6 F	57.2 F	57.0 F	15.0	208.5 MBH	146.2 MBH	463 ft/min	0.723 in. wg	6	14	Inverter Scroll	1	11	19.2
Heating Section						Hot Gas Reheat								
Actual Size	EAT	LAT	Voltage	Amps	Controls	Single Point Power	Temp Rise	Hot Gas Reheat Capacity	LAT					
24.6 kW	31.0 F	74.7 F	208 V	68.3 A	SCR	No	12.7 F	154.9 MBH	80.6 F					
NOTES						OPTIONS AND ACCESSORIES								
Painted exterior with 2500 hr. salt spray rating. Double wall 2" R13 injected foam insulated cabinet. Single condenser fan shall not exceed a sound power level of 75 LWA. Compressors mounted on a shelf behind an insulated door for minimized radiated and transmitted sound. Direct-drive fans with factory mounted VFDs. Controller must have simplified access via a laptop to view and change unit operation, set points, alarm history & 1 week of trending data. EC motors on all condenser fans.						Weatherhood: Downturned Hood Supply Filters - 2" Pleated MERV 13, 2-20x22x2, 2-20x24x2 Outdoor Air Dampers - Motorized Low Leakage Recirc Dampers - Motorized Low Leakage Barometric Damper Painted Exterior - Concrete Gray (RAL 7023) Microprocessor Controls Supply Fan VFD Control - Constant Volume-Adj. Setpoint O/A/R Damper Controls - Constant Position-Adj. Setpoint Economizer Mode - Temp./Enthalpy Space Thermostat - 1 Temp and RH Only Remote Display w/150' Cord Dirty Filter Sensor: Final Phase and Brown Out Protection Branch Circuit Fusing 120v NEMA 3R Outlet (Factory mounted and wired) Unit Disconnect - Mounted By Factory Hail Guards Shipped Loose Smoke Detectors - Exhaust Condensate Overflow Switch Economizer Fault Detection Diagnostics Special Design Request(s) Special Design Request for "O/A/R damper controls by building pressure", (09999999) Unit Warranty: 18 Months Standard								



**Curb Installation Instructions**

1. Factory supplied roof curbs. Roof curbs are model GKD which ship in a knockdown kit (includes duct adapters) and require field assembly (by others) on all units except XRV-110 which are shipped assembled. Assembly instructions are included with the curb kit.
2. Install curb. Locate curb over roof opening and fasten in place. Check that the diagonal dimensions are within ± 1/8 inch of each other and adjust as necessary. For proper coil drainage and unit operation, it is important that the installation be level. Shim the curb as required to level. Install gasketing on top surface of curb (provided by others).
3. Install ductwork. Installation of all ducts should be done in accordance with SMACNA and AMCA guidelines. Duct adapters are provided to support ducts prior to setting the unit.
4. Set the unit. Lift unit to a point directly above the curb and duct openings. Guide unit while lowering to align with duct openings. Roof curbs fit inside the unit base. Make sure the unit is properly seated on the curb and level.
5. Fasten the unit. Fasten the unit to the curb/equipment support(s) using the appropriate methods. The installer is responsible for determining appropriate support and fastening methods to ensure compliance with all applicable codes.
6. Install vestibule. If unit was ordered with a vestibule and it has not yet been attached to the unit, caulk and attach the vestibule at this time.


**Curb Specifications**

Height (in)	Length (in)	Width (in)	Material	Finish Type	Duct Adapter	Weight (lb)
14	91.9	45.9	Galvanized	Galvanized	Yes	218


**Curb Detail**

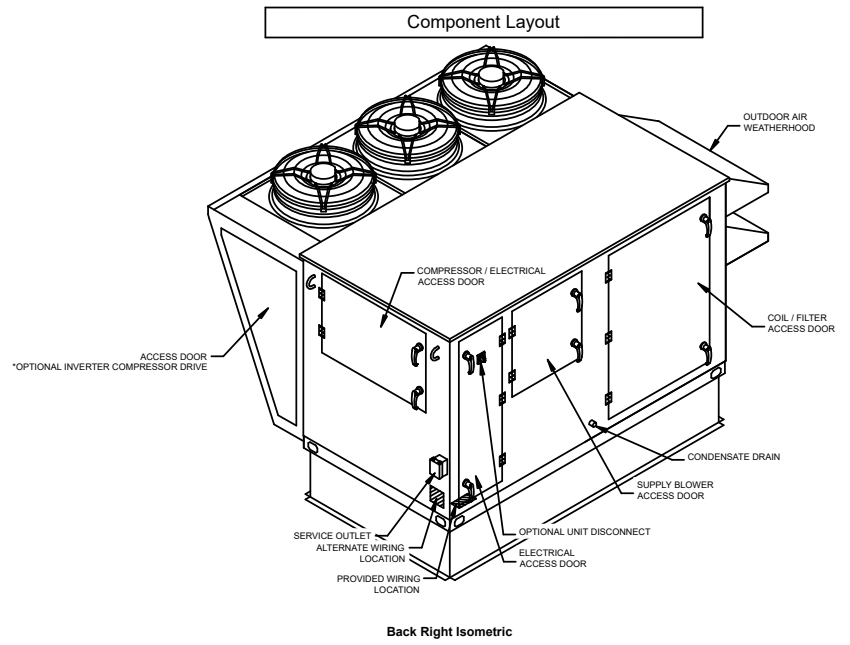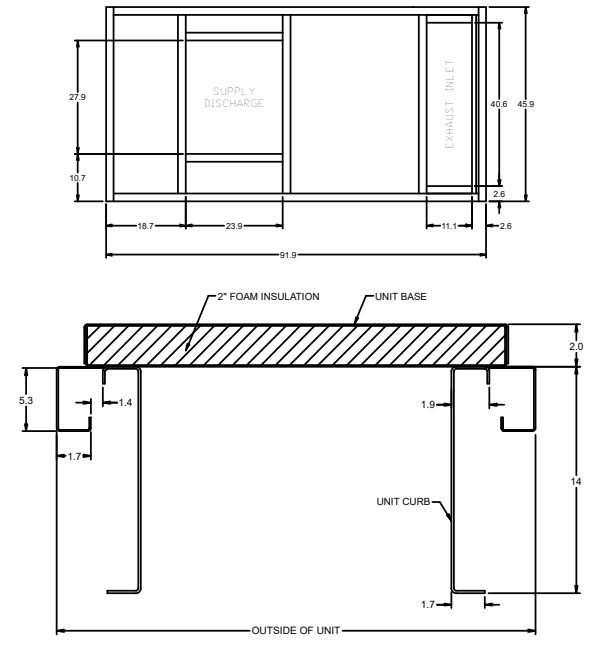


**Service Clearances**

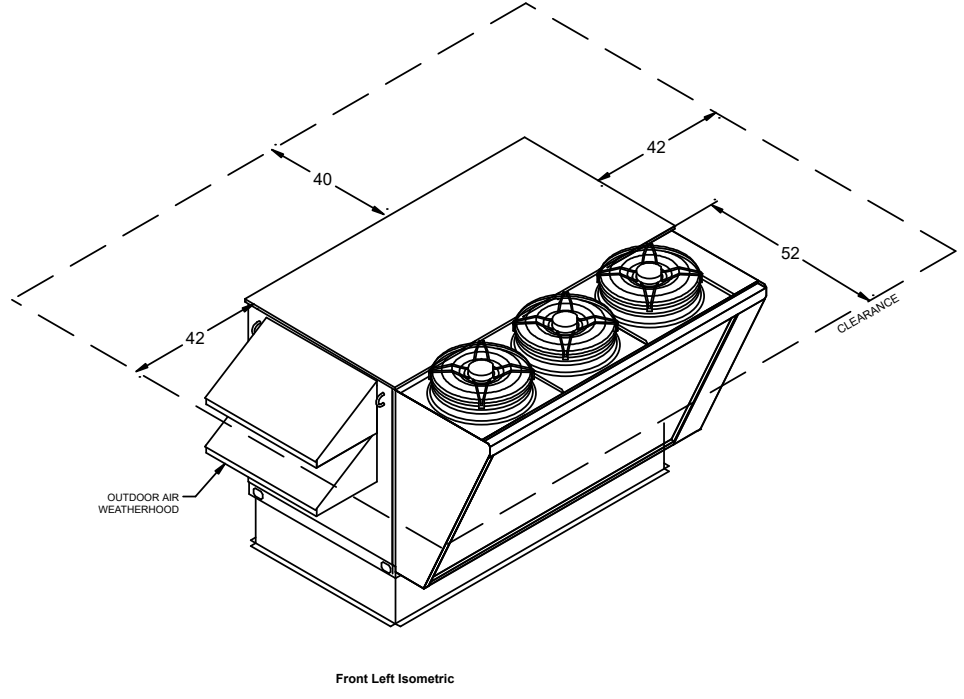


Dimensional Overview

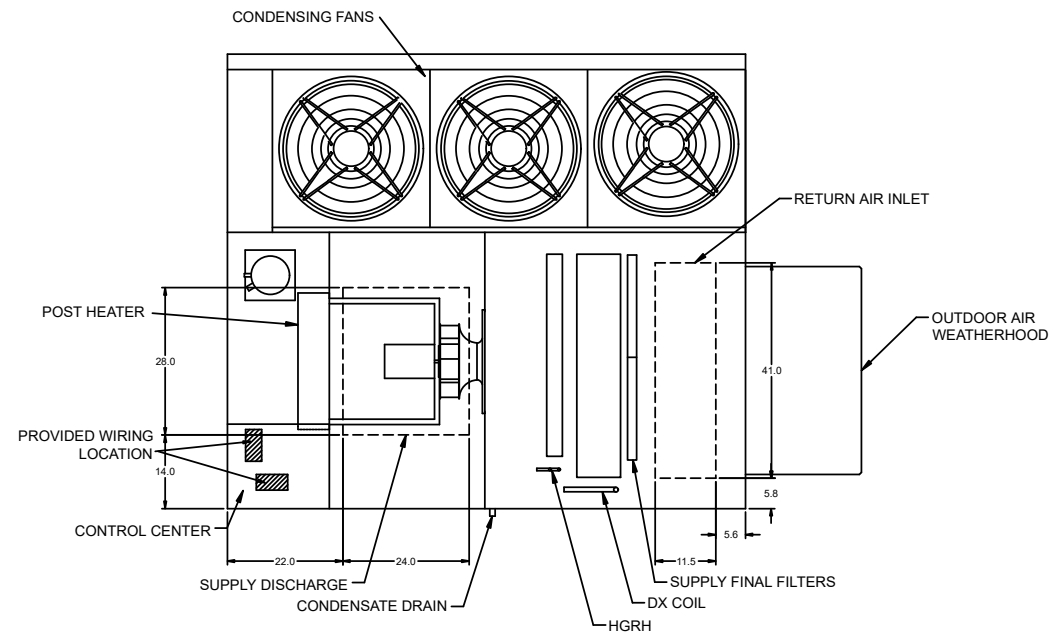

Plan


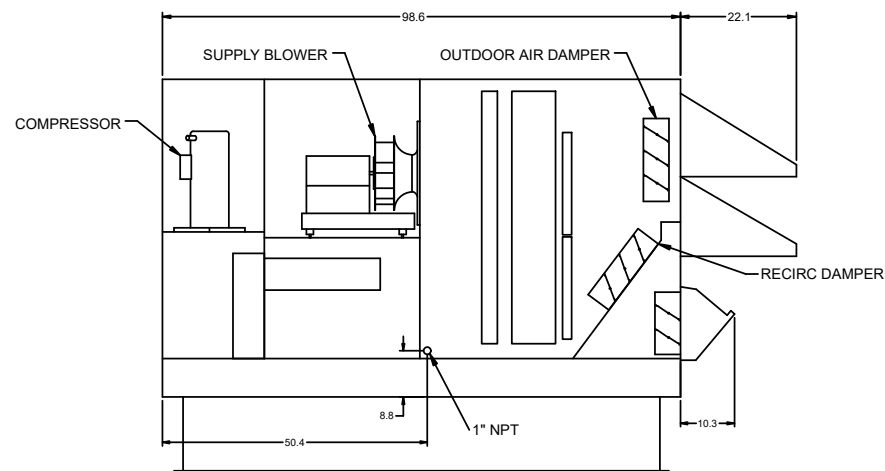


Elevation

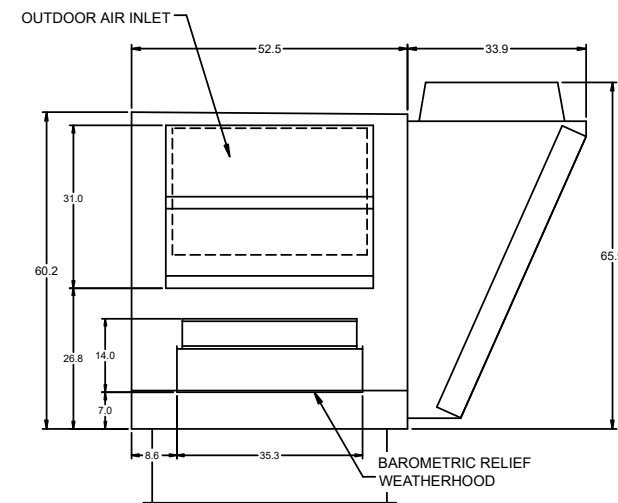


Right End


Electrical Connections

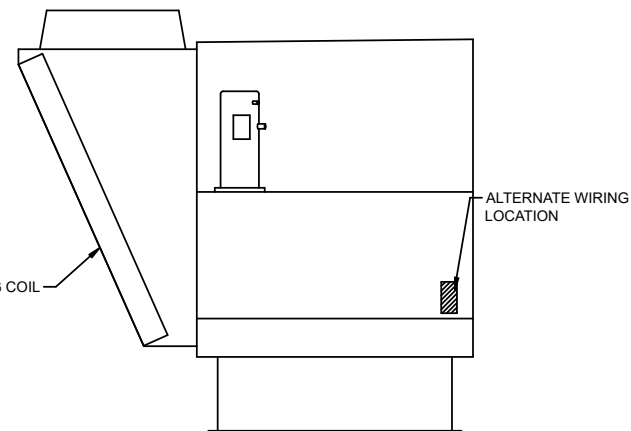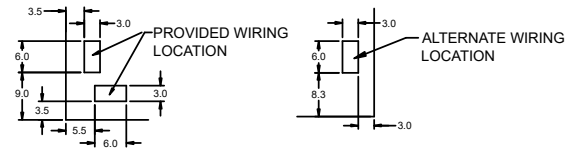

Left End

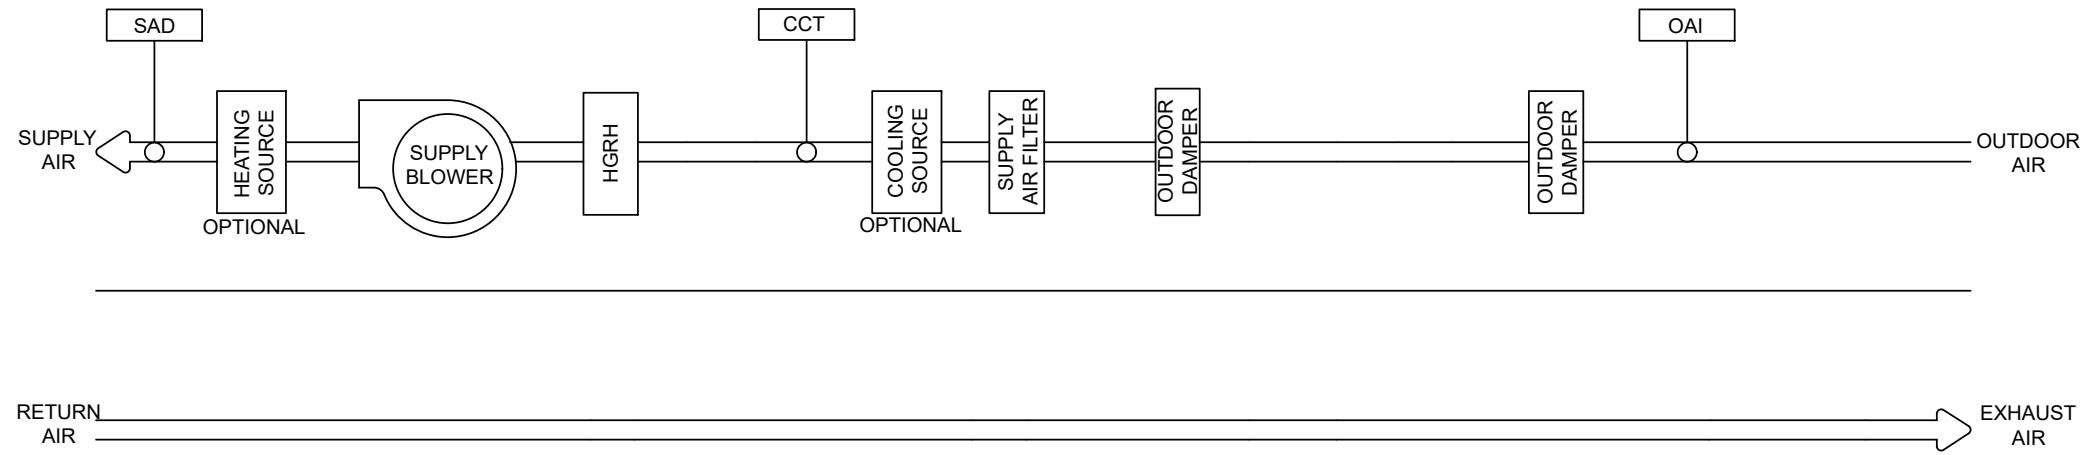

SENSORS
SAD: Supply air discharge temperature
OAI: Outdoor air intake temperature
CS: Condensate overflow switch
CCT: Cooling coil temperature

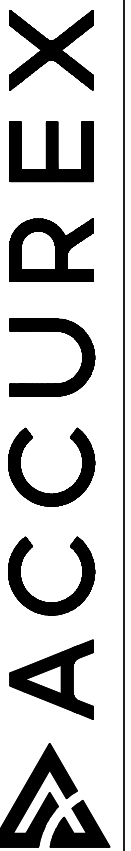

ACCUREX W/IA  
 ANDREW JACOBS  
 BRAD.BORCHARDT@ACCUREX.COM  
 (262)227-7865

PROJECT)  
 2/15/2023

MARK

CULVERS - NORTH FORT  
 MEYERS DOAS

RTU-2 (KITCHEN)



HOOD NO.	MARK	MODEL	HOOD DIMENSIONS (IN.)			HOOD CONSTR.	COOKING LOAD / DUTY RATING	EXHAUST					SUPPLY		TOTAL WEIGHT LBS.	SECTION LOCATION	
			LENGTH	WIDTH	HEIGHT			TOTAL CFM	COLLAR(S)			MUA CFM	AC CFM				
1	GRIDDLE HOOD	XGPE-64-S	64	TOP 23 BOT 8	FRT 12 BACK 36	430 SS WHERE EXPOSED	MEDIUM	1500	12	12		1500	1.918			136.8	SINGLE

HOOD NO.	MARK	LIGHTING DETAILS			GREASE FILTRATION DETAILS			UTILITY CABINET(S)				
		FIXTURE TYPE BULB / LAMP INFO	QTY	FOOT CANDLES	TYPE / MODEL MATERIAL	QTY	SIZE (IN.) L H	LOCATION	FIRE SYSTEM TYPE	SIZE	MODEL	CONTROLS INTERFACE
1	GRIDDLE HOOD				GREASE GRABBER STAINLESS STEEL	4	16 20	16				

HOOD OPTIONS		SPECIAL DESIGN REQUESTS	
UL 710 LISTED W/ OUT EXHAUST FIRE DAMPER - UL #R25625	BACK NON-INTEGRAL AIR SPACE - 3 IN WIDE	SDR #K1100145 - FLUE BYPASS HOOD	
26 IN HIGH CEILING ENCLOSURES - FRONT LEFT RIGHT - FIELD INSTALLED	FACTORY MOUNTED EXHAUST COLLAR(S)	SDR #K1800144 - CULVERS 4VAT 2FIRE PROCESS - GRIDDLE HOOD	
PERFORMANCE ENHANCING LIP (PEL) TECHNOLOGY	STANDING SEAM CONSTRUCTION FOR SUPERIOR STRENGTH		

Direct Drive Upblast Centrifugal Roof Exhaust Fan

MARK INFORMATION		FAN INFORMATION					MOTOR INFORMATION						
QTY	MARK	MODEL	VOLUME (CFM)	TOTAL EXTERNAL SP (IN WG)	FAN RPM	OPERATING POWER (HP)	WEIGHT (LB.)	SIZE (HP)	V/C/P	ENCLOSURE	MOTOR RPM	WINDINGS	NEC FLA*
1	PRV-2 Griddle Fan	XCUE-140-VG	1,500	1.8	1,703	0.83	92	1	115/60/1	OP	1725	1	16

\*NEC FLA - Based on table 430.250 or 430.248 of National Electrical Code 2020. Actual motor FLA may vary for sizing thermal overload, consult factory\*

PRV-2 Griddle Fan : SELECTED OPTIONS AND ACCESSORIES	
One piece fully welded windband	Tapered bushing wheel hub
Breather tube outlet area min. 4.4 sq. in. (sizes 99-480), 2.0 sq. in. (sizes 60-95)	Min. windband material thickness: 0.051" aluminum (060-240), 0.064" aluminum (240HP, 240XP), 0.080" aluminum (sizes 300-480)
Larger Curb Cap Size - 26 Square	UL/cUL 762 Listed - "Power Ventilators for Rest. Exh. Appliances"
Switch, NEMA-3R, Toggle, Shipped with Unit	Hinge, Factory Installed
High Temp Curb Seal Rated for Continuous Duty at 1500 F (Factory Attached)	Grease Trap (PN 475538)
Clean-out Port - Factory Installed	

MARK	MODEL	LOCATION	FLOW POINTS		SUPPLY LINE	DETECTION	MARK(S) PROTECTED BY FIRE SYSTEM
			HOODS	PCU			
FIRE SUPPRESSION-GRIDDLE HOOD	ANSUL R-102 WET CHEMICAL	REMOTE MOUNTED	6 UTILIZED 11 AVAILABLE		CONTINUOUS	FUSIBLE LINK	GRIDDLE HOOD SECTION 1

**FIRE SYSTEM OPTIONS AND ACCESSORIES**  
 FULL INSTALLATION (INCLUDES PRE-PIPED HOOD(S) WITH DETECTION AND FACTORY COORDINATED INSTALL)  
 CHROME SLEEVES FOR FACTORY PROVIDED APPLIANCES DROPS - INCLUDED  
 METAL BLOW-OFF CAPS - INCLUDED  
 HOOD SUPPRESSION TANK - INCLUDED - 3 GAL. - [(1) 3.0 TANK(S)]  
 REMOTE PULL STATION - STANDARD - FIELD INSTALLATION AT SINGLE POINT OF EGRESS

**SPECIAL DESIGN REQUESTS**  
 SDR #K1800144 - CULVERS 4VAT 2FIRE PROCESS - GRIDDLE HOOD

**ANSUL R102 (WET CHEMICAL) FIRE PROTECTION SYSTEM - MODEL FSSC**

**CONTROL PANEL**

- STAINLESS STEEL ENCLOSURE
- AGENT STORAGE TANK
- EXCELLENT GAS CARTRIDGE
- ANSUL AUTOMAN RELEASE
- RESISTOR
- KNOCKOUT FOR WIRING MICROSWITCH

**WIRING DIAGRAMS**  
 WIDPOT MICRO SWITCH  
 DRIP SWITCHES PROVIDED BY MANUFACTURER MAY BE WIRED PER TYPICAL EXAMPLES SHOWN. VERIFY WITH LOCAL CODES AND EQUIPMENT SUPPLIER AS THE CONNECTION NEEDED FOR YOUR INSTALLATION.

**CONNECTION TO BUILDINGS ALARM**

**CONNECTION TO COOKING EQUIPMENT SHUT DOWN**



**CONNECTION TO FAN SHUT DOWN**

**NOTES:**

WET CHEMICAL FIRE PROTECTION SYSTEM TO BE ANSUL R-102, DESIGNED IN COMPLIANCE WITH UL 300 REQUIREMENTS.  
 - VERIFICATION OF ALL COOKING EQUIPMENT MAKE, MODEL AND LOCATION REQUIRED FOR ALL FIRE PROTECTION SYSTEMS.  
 - ALL FIRE SYSTEM PIPING IS STANDARD 1/2" TO THE RIGHT END OF THE HOOD UNLESS A WALL IS LOCATED ON THE RIGHT END.  
 - ANSUL AUTOMAN RELEASE TO BE LOCATED WITHIN 60" OF HOOD.


THE BASIC FIRE SYSTEM WILL INCLUDE THE FOLLOWING:  
 - GAS SHUT-OFF VALVE, IF REQUIRED, TO BE SUPPLIED BY MANUFACTURER (UP TO 2" DIAMETER AS STANDARD), AND INSTALLED BY A LICENSED PLUMBER.  
 - MICRO SWITCH TO BE SUPPLIED BY MANUFACTURER FOR CONNECTION TO, BUT NOT LIMITED TO, BUILDING ALARM SYSTEMS, EXHAUST AND SUPPLY FANS AND ELECTRICAL POWER SHUT DOWN. FIELD WIRING AND CONNECTIONS TO BE PERFORMED BY A LICENSED ELECTRICIAN.

THE BASIC FIRE SYSTEM DOES NOT INCLUDE THE FOLLOWING:  
 - FULL DUMP TEST OTHER THAN WHAT IS SPECIFIED PER THE INSTALLATION MANUAL, OR TO SATISFY A STATE OR LOCAL CODE. PERMIT AND TESTING FEES ARE NOT INCLUDED UNLESS NOTED UNDER THE EQUIPMENT SCHEDULE FOR THE FIRE SYSTEM.  
 - MORE THAN TWO TRIPS TO THE JOBSITE OR SPECIAL TRANSPORTATION, OR OVERNIGHT LOGGING REQUIREMENTS IN REMOTE AREAS. NORMAL TRAVEL DISTANCE IS FIRST 50 MI. (80.5 KM) FROM OFFICE.  
 - SPECIAL CLASSES OR ADDITIONAL LABOR FOR ACCESS TO SECURITY SENSITIVE AREAS.  
 - INSTALLATION OF GAS SHUT-OFF VALVE.  
 - SPECIAL DRAWINGS REQUIRED TO SATISFY STATE OR LOCAL CODE. PLAN EXAMINATION FEES, PE OR PS APPROVAL STAMP.  
 - UNION LABOR, GOVERNMENT LABOR, OR PREVAILING WAGES REQUIRED FOR FINAL FIELD HOUR-UP.  
 - ANY AND ALL ELECTRICAL COMPONENTS/CONNECTIONS REQUIRED TO SHUT DOWN FANS, SHUT OFF DEVICE FOR ELECTRIC COOKING EQUIPMENT (SHUNT TRIP BREAKER), OR ACTIVATE AN ALARM SYSTEM, ETC.  
 - ANY DISMANTLING OR REASSEMBLY REQUIRED TO GAIN ACCESS TO THE FIRE SUPPRESSION PIPING LOCATED ON THE TOP OF THE HOOD.  
 - ROUGH-IN HIDDEN CONDUIT FOR REMOTE PULL STATION OR GAS VALVE (FLUSH MOUNTED PULL STATION).  
 - INSTALLATION OF MORE THAN (1) REMOTE PULL STATIONS OR DISTANCES GREATER THAN 20 FT (6.1M).  
 - PARTS OR LABOR REQUIRED TO CORRECT PIPING DUE TO COOKING EQUIPMENT CHANGES OR DEVIATION FROM PLANS, OR ANY CHARGES FOR MISSING OR ADDITIONAL PARTS OTHER THAN THOSE INDICATED ON THE FIRE SUPPRESSION DETAIL.

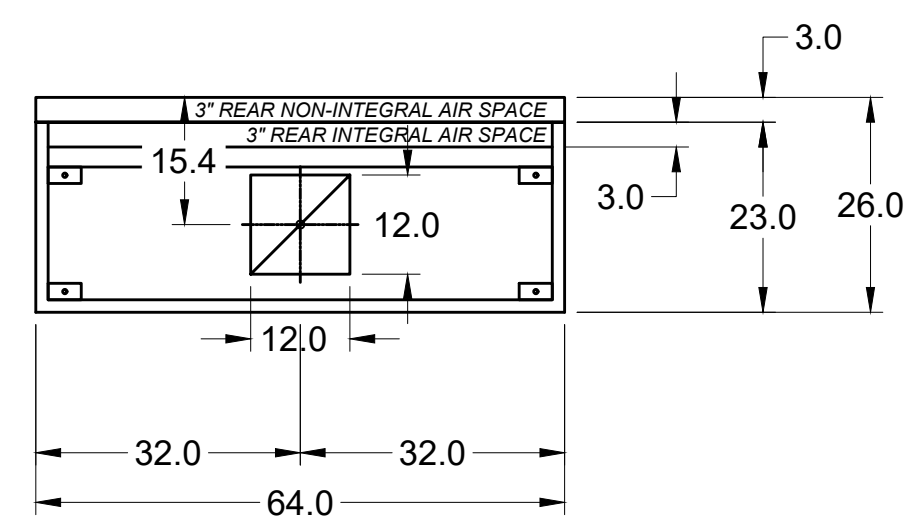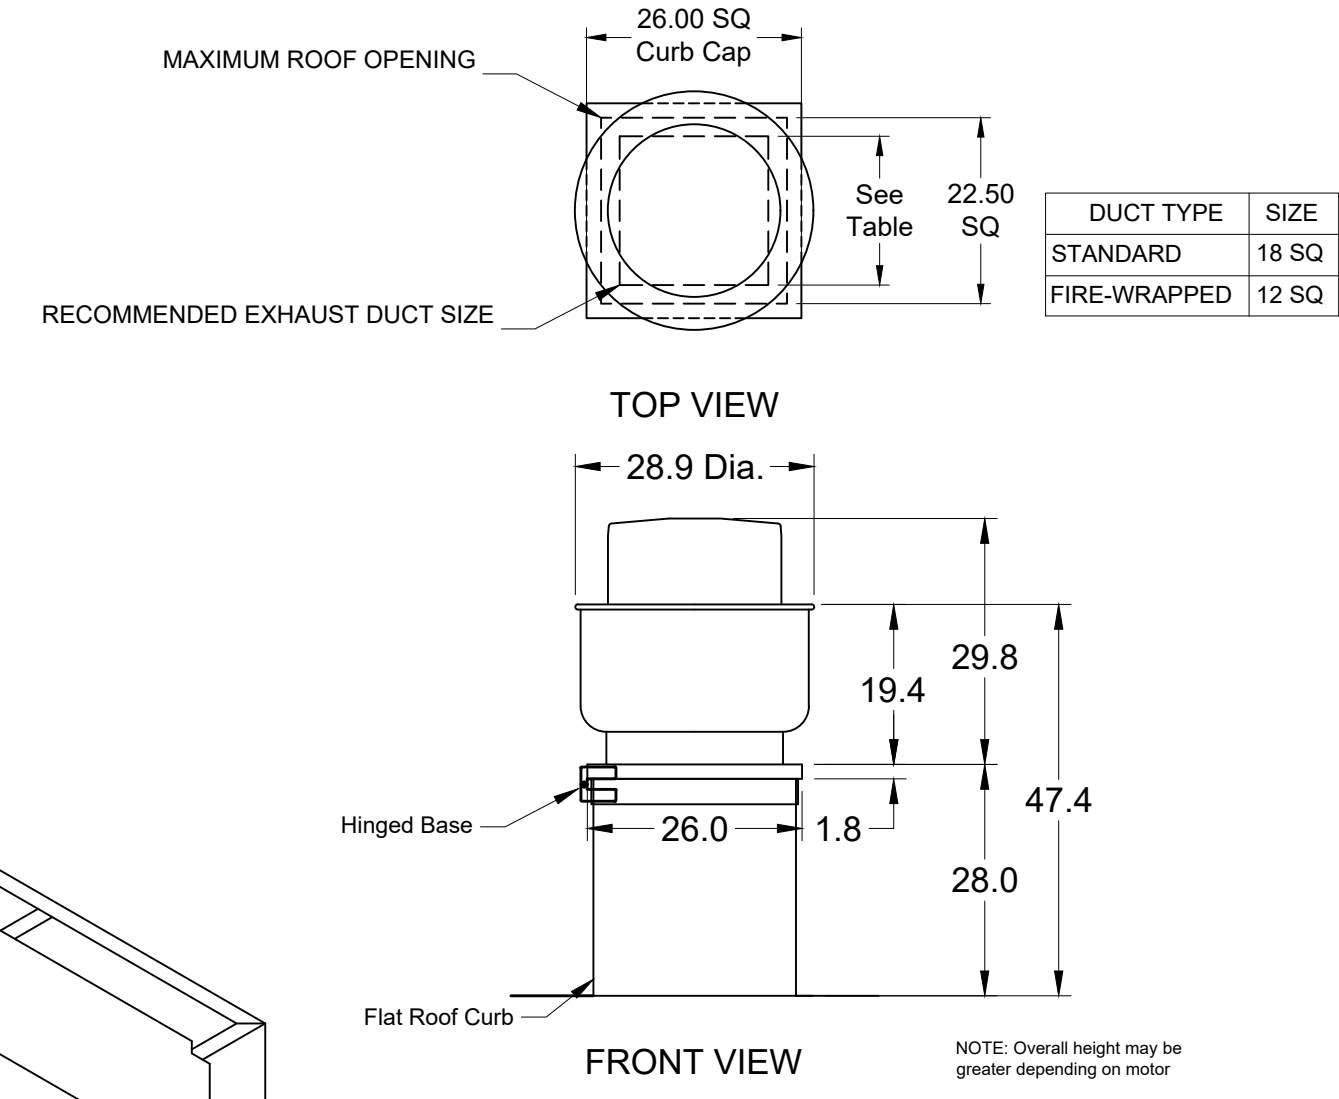



MARK: Griddle Hood - SECTION 1  
PLAN VIEW

MUST USE WITH MAGIKITCH'N MODEL MKG-C-60  
 VERIFY MAGIKITCHEN OR ANETS GRILL  
 60" MAGIKITCH'N GRIDDLE FLUE ADAPTER

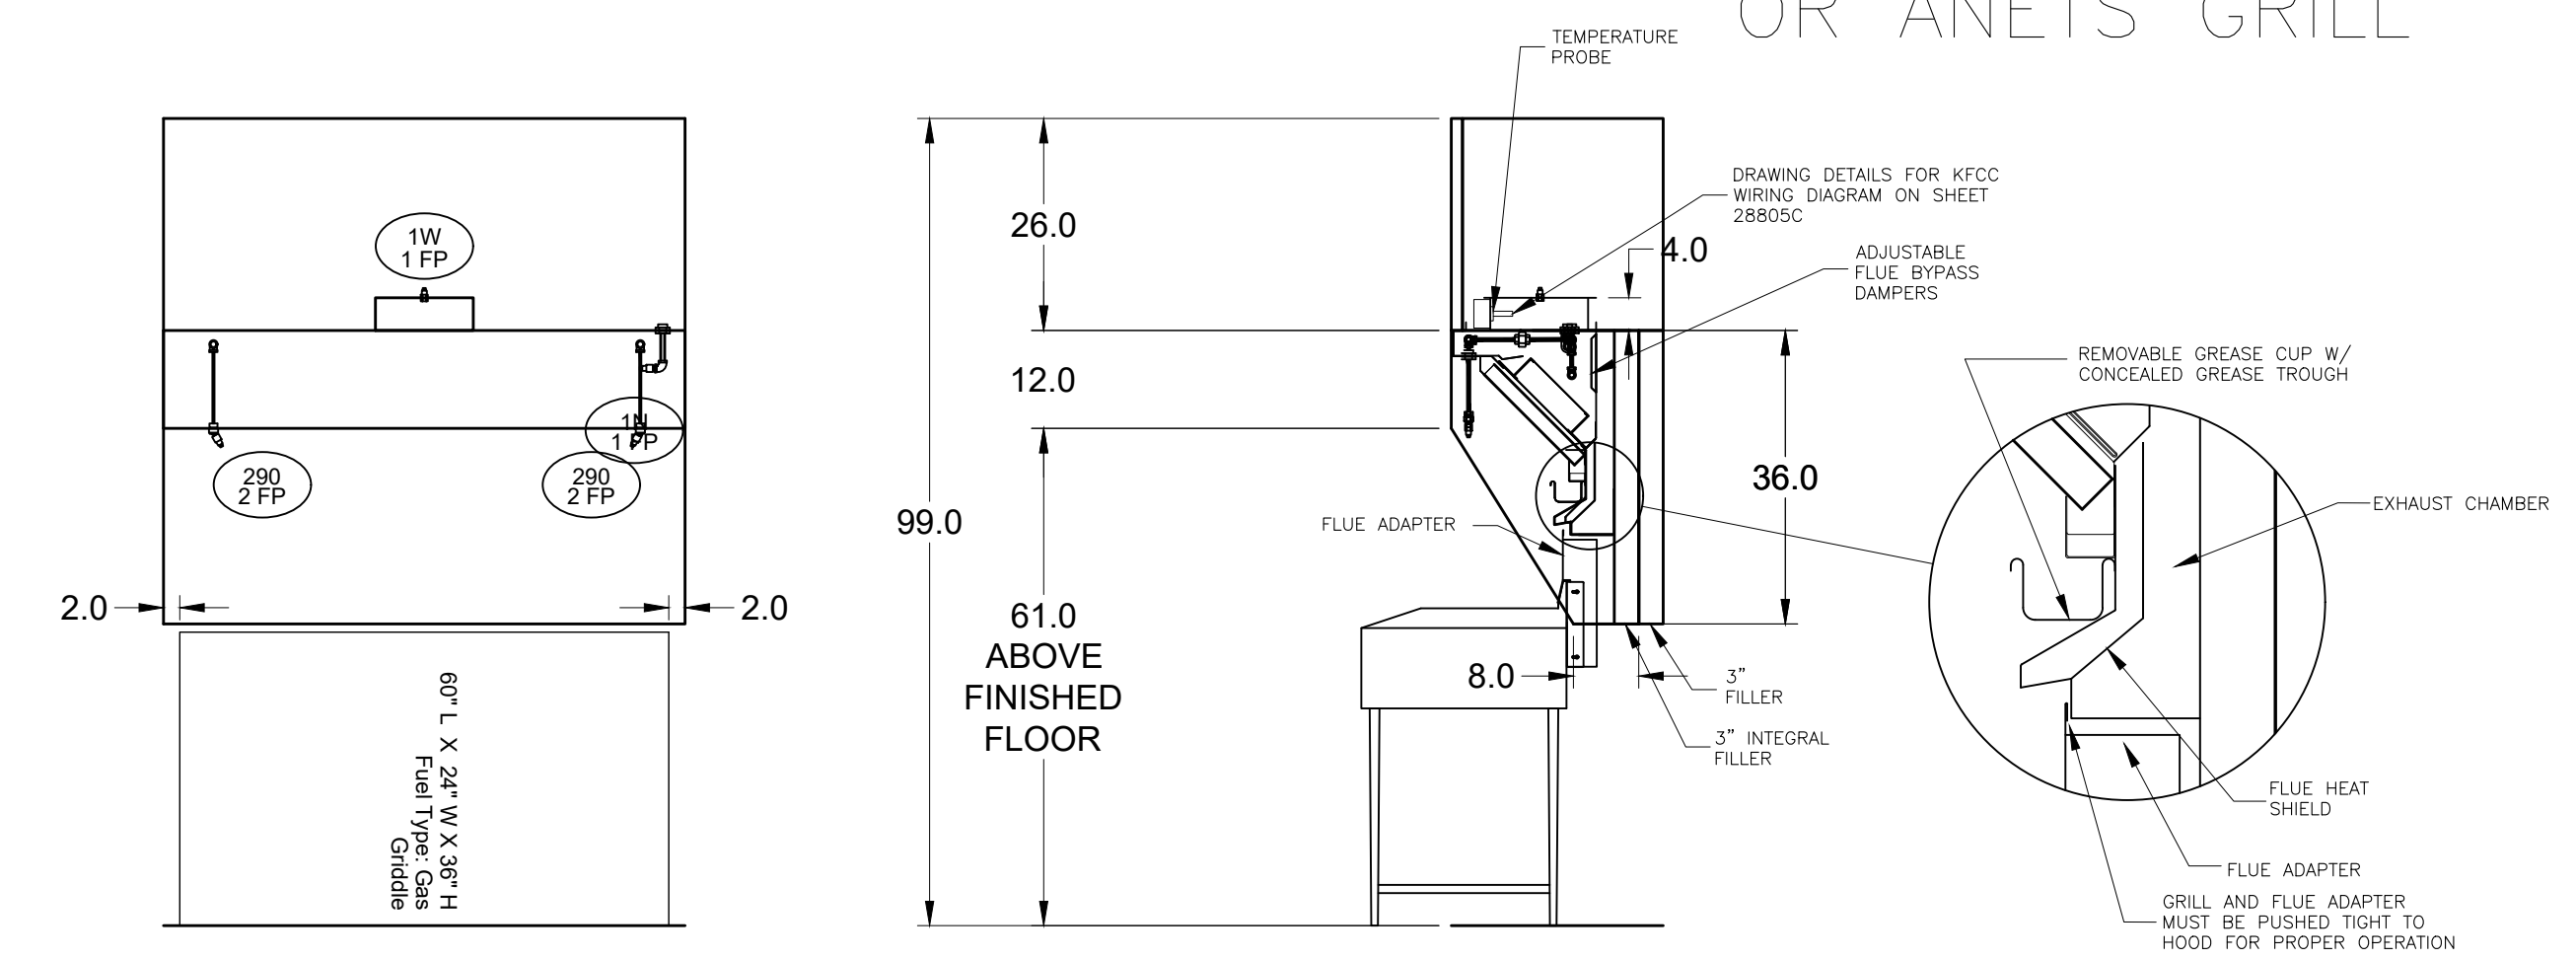

SECTION 1  
ELEVATION VIEW

MARK: Griddle Hood  
SECTION VIEW

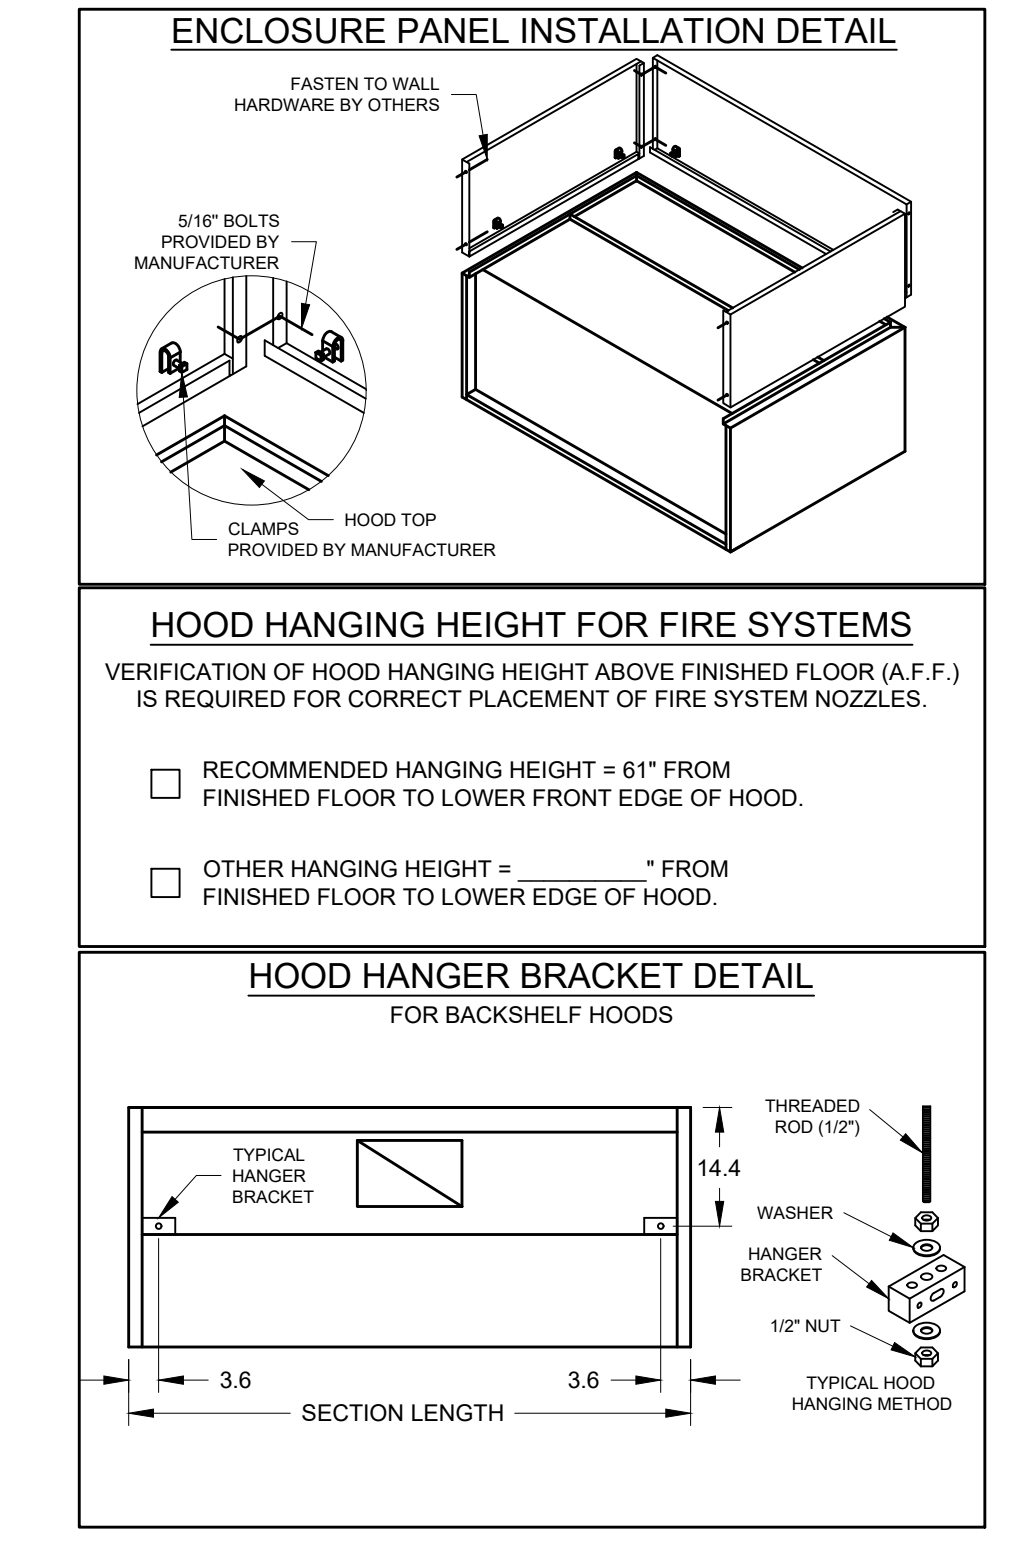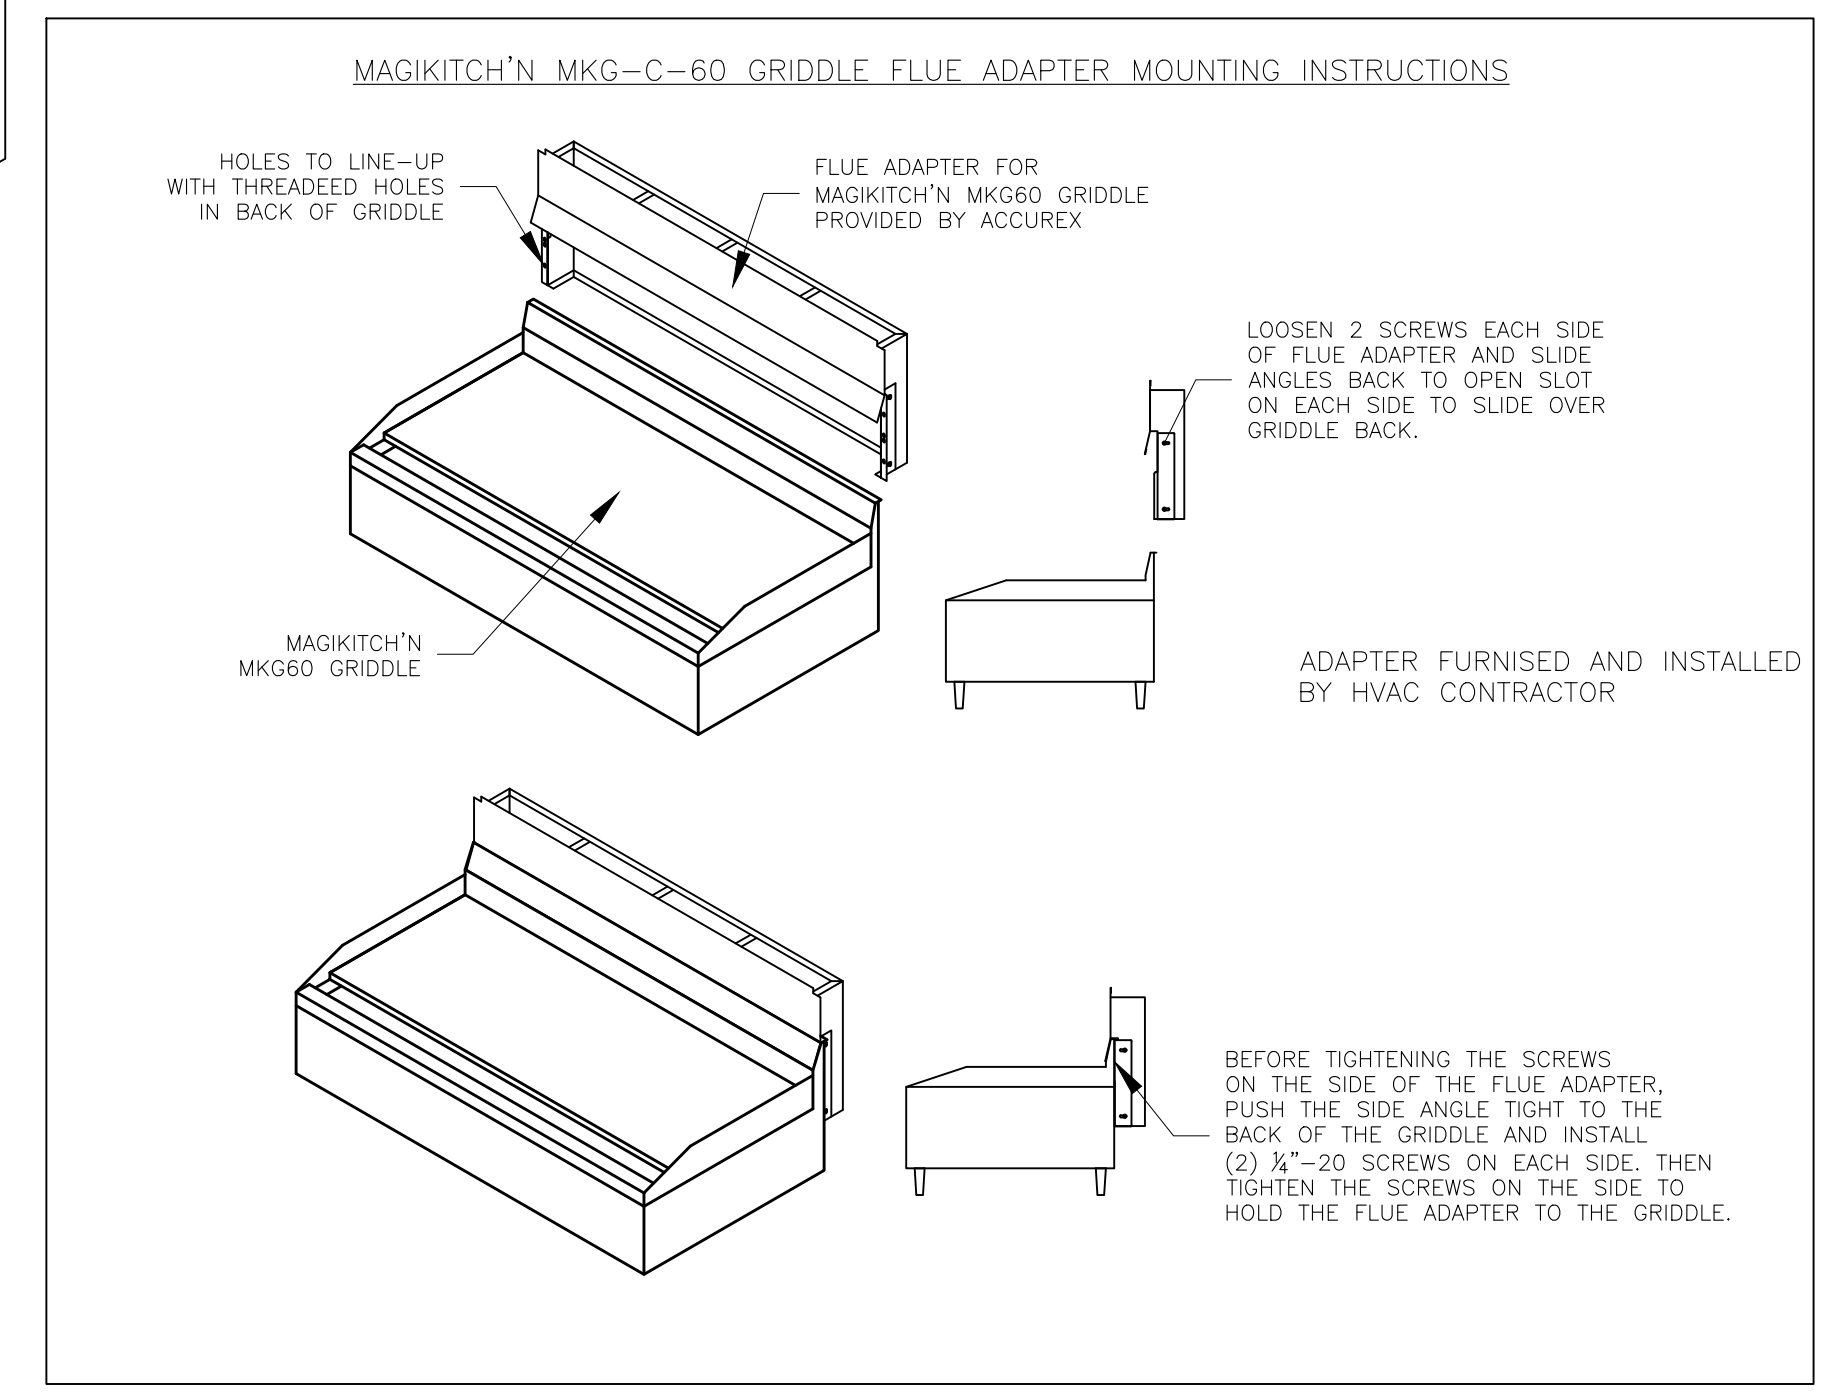

PROJECT 12/4/2019  
 ACCUREX - MI, IA  
 PHILLIP KRAFT  
 PHILLIP.KRAFT@ACCUREX.COM  
 262-227-7865  
 UL LISTED  
 GRIDDLE HOOD  
 PRV-2 GRIDDLE FAN  
 FIRE SUPPRESSION-GRIDDLE HOOD  
 ACCUREX

HOOD NO.	MARK	MODEL	HOOD DIMENSIONS (IN.)			HOOD CONSTR.	COOKING LOAD / DUTY RATING	EXHAUST					SUPPLY		TOTAL WEIGHT LBS.	SECTION LOCATION	
			LENGTH	WIDTH	HEIGHT			TOTAL CFM	COLLAR(S)			MUA CFM	AC CFM				
1	FRYER HOOD	XXEP-83-S	83	TOP 23 BOT 3	FRT 12 BACK 36	430 SS WHERE EXPOSED	MEDIUM	1500	12	12		1500	0.518			169.1	SINGLE

HOOD NO.	MARK	LIGHTING DETAILS			GREASE FILTRATION DETAILS			UTILITY CABINET(S)				
		FIXTURE TYPE BULB / LAMP INFO	QTY	FOOT CANDLES	TYPE / MODEL MATERIAL	QTY	SIZE (IN.) L H	LOCATION	FIRE SYSTEM TYPE	SIZE	MODEL	CONTROLS INTERFACE
1	FRYER HOOD				X-TRACTOR STAINLESS STEEL	5	16 20	16				

**HOOD OPTIONS**

UL 710 LISTED W/ OUT EXHAUST FIRE DAMPER - UL #R25625  
 BACK NON-INTEGRAL AIR SPACE - 3 IN WIDE  
 26 IN HIGH CEILING ENCLOSURES - FRONT LEFT RIGHT - FIELD INSTALLED  
 FACTORY MOUNTED EXHAUST COLLAR(S)  
 PERFORMANCE ENHANCING LIP (PEL) TECHNOLOGY  
 STANDING SEAM CONSTRUCTION FOR SUPERIOR STRENGTH

**SPECIAL DESIGN REQUESTS**

SDR #K1100559 - NEW PITCO 4L FRYER FLUE BYPASS SYSTEM  
 SDR #K1700974 - CULVERS 4VAT 2FIRE PROCESS - FRYER HOOD


Direct Drive Upblast Centrifugal Roof Exhaust Fan

MARK INFORMATION			FAN INFORMATION					MOTOR INFORMATION					
QTY	MARK	MODEL	VOLUME (CFM)	TOTAL EXTERNAL SP (IN WG)	FAN RPM	OPERATING POWER (HP)	WEIGHT (LB.)	SIZE (HP)	V/C/P	ENCLOSURE	MOTOR RPM	WINDINGS	NEC FLA*
1	PRV-3 Fryer Fan	XCUE-140-VG	1,500	1	1,349	0.46	92	1	115/60/1	OP	1725	1	16


\*NEC FLA - Based on table 430.250 or 430.248 of National Electrical Code 2020. Actual motor FLA may vary for sizing thermal overload, consult factory\*

**PRV-3 Fryer Fan : SELECTED OPTIONS AND ACCESSORIES**

One piece fully welded windband  
 Tapered bushing wheel hub  
 Breather tube outlet area min. 4.4 sq. in. (sizes 99-480), 2.0 sq. in. (sizes 60-95)  
 Min. windband material thickness: 0.051" aluminum (060-240), 0.064" aluminum (240HP, 240XP), 0.080" aluminum (sizes 300-480)  
 Larger Curb Cap Size - 26 Square  
 UL/cUL 762 Listed - "Power Ventilators for Rest. Exh. Appliances"  
 Switch, NEMA-3R, Toggle, Shipped with Unit  
 Hinge, Factory Installed  
 High Temp Curb Seal Rated for Continuous Duty at 1500 F (Factory Attached)  
 Grease Trap (PN 475538)  
 Clean-out Port - Factory Installed

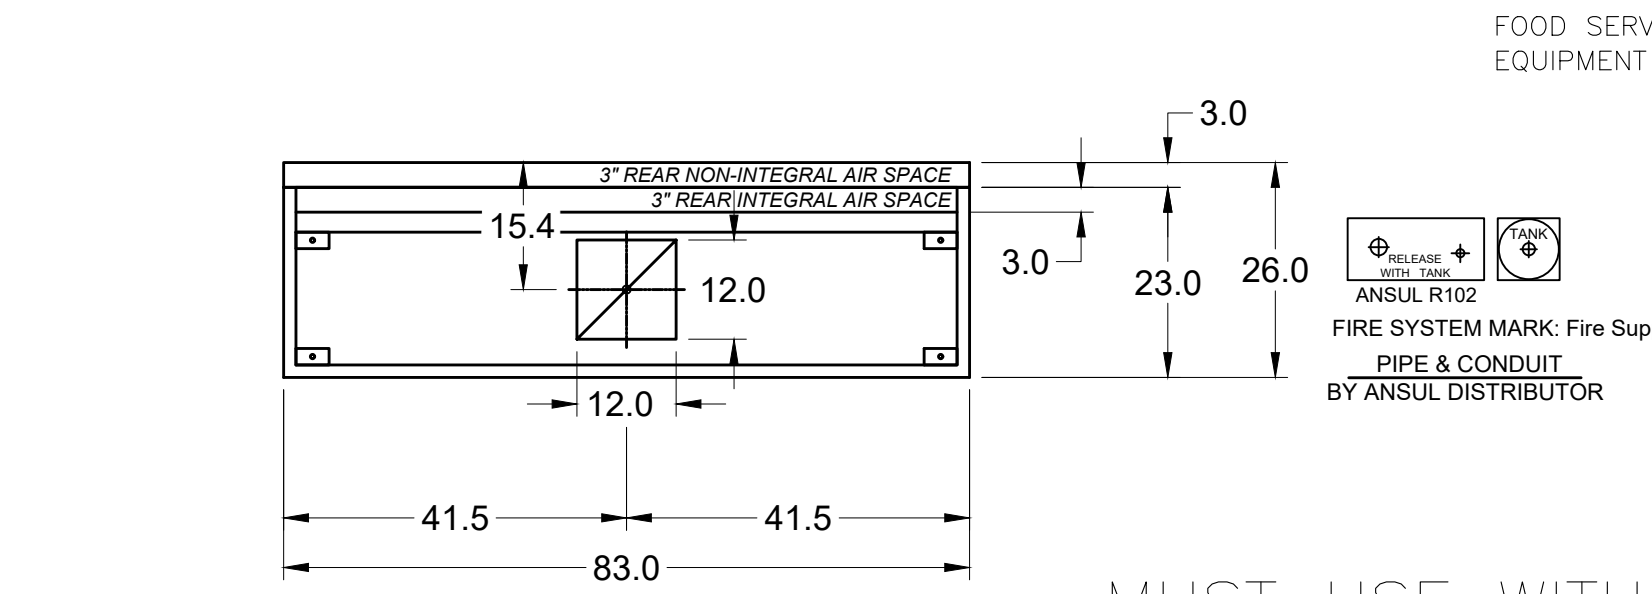

MARK: Fryer Hood  
PLAN VIEW

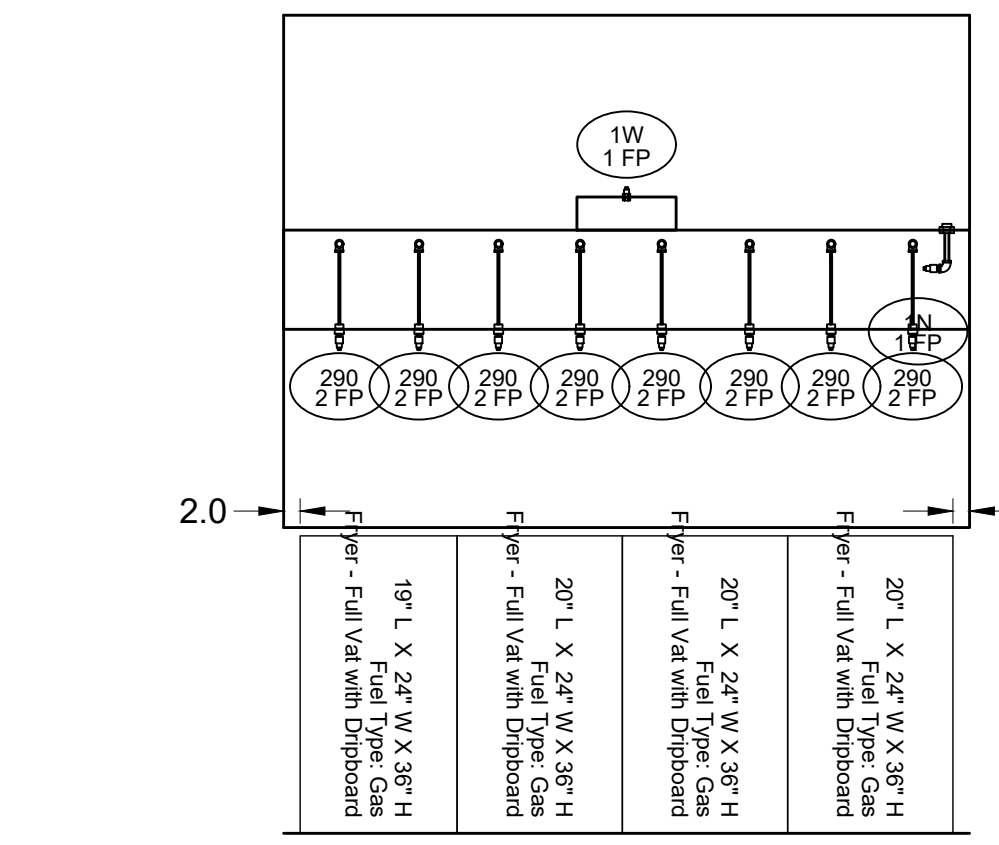


SECTION 1  
ELEVATION VIEW

MUST USE WITH PITCO MODEL CU-SSH60W

PITCO FRYER 4-VAT FLUE ADAPTER

VERIFY 4-VAT OR 5-VAT FRYER BATTERY

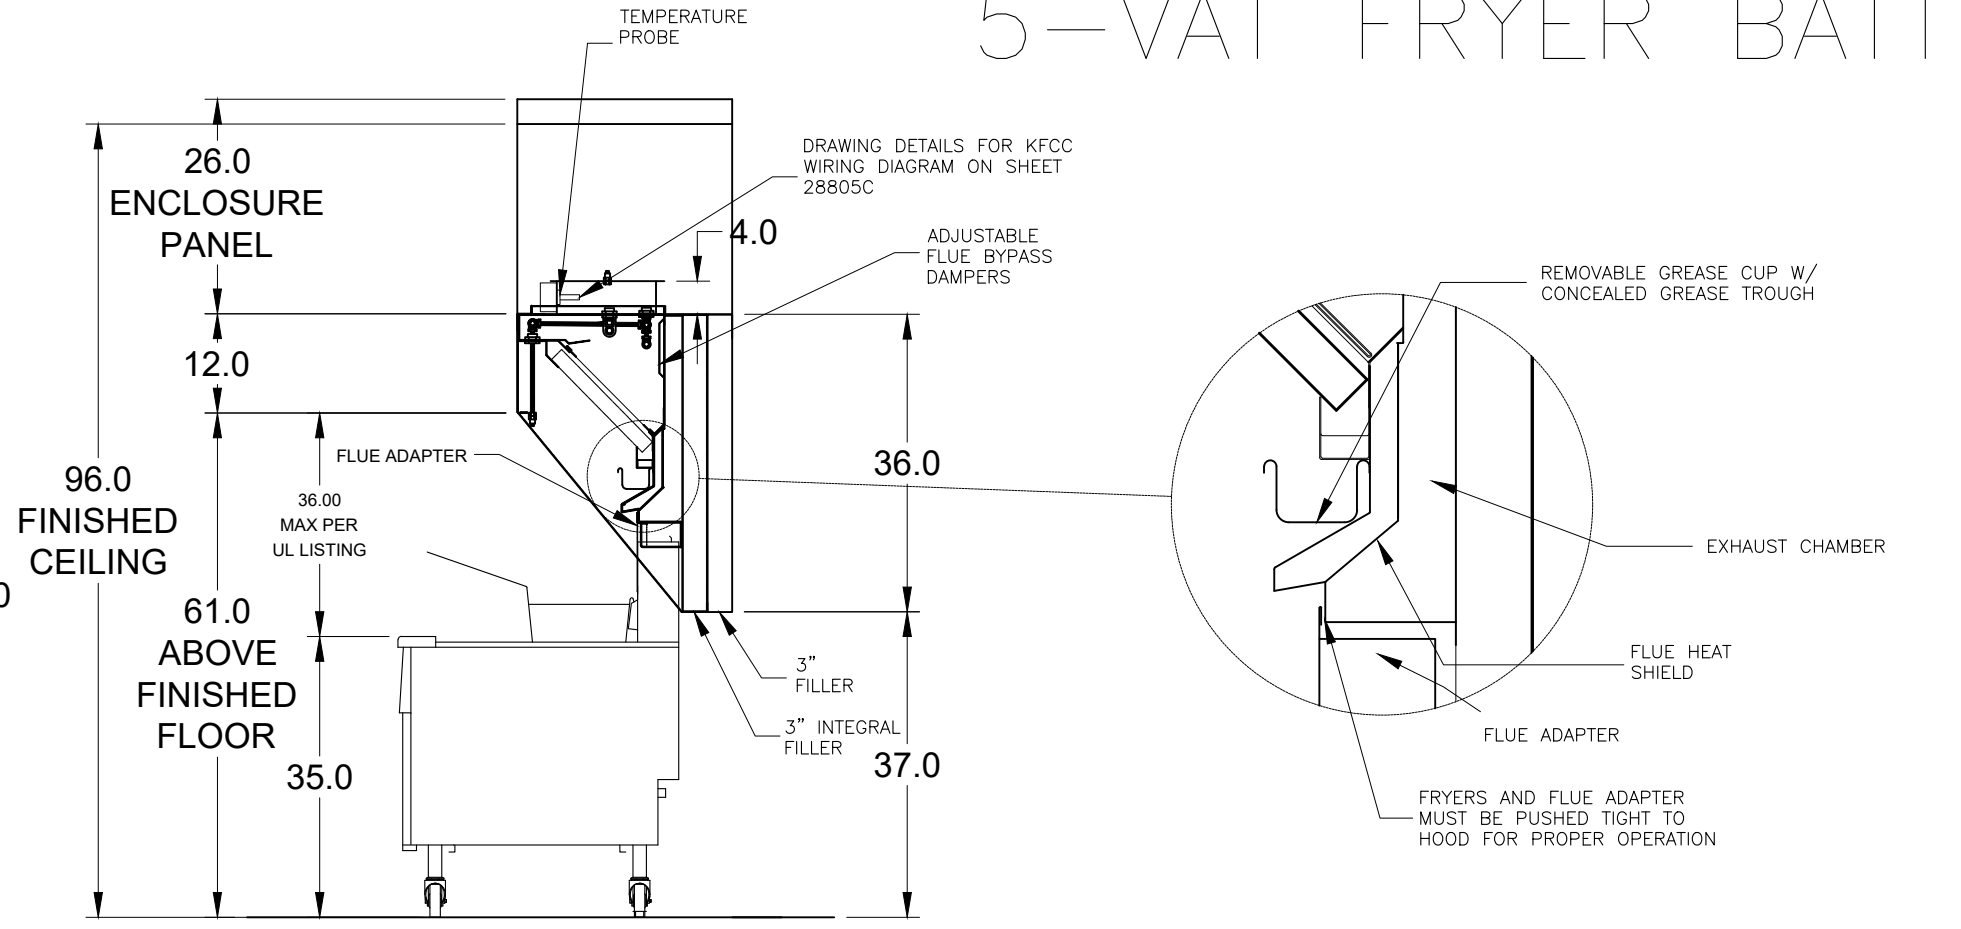

MARK: ITEM #59  
SECTION VIEW

**FIRE SYSTEM INFORMATION**





MARK	MODEL	LOCATION	FLOW POINTS		SUPPLY LINE	DETECTION	MARK(S) PROTECTED BY FIRE SYSTEM
			HOODS	PCU			
FIRE SUPPRESSION-FRYER HOOD	ANSUL R-102 WET CHEMICAL	REMOTE MOUNTED	18 UTILIZED 22 AVAILABLE		CONTINUOUS	FUSIBLE LINK	FRYER HOOD SECTION 1

**FIRE SYSTEM OPTIONS AND ACCESSORIES**

FULL INSTALLATION (INCLUDES PRE-PIPED HOOD(S) WITH DETECTION AND FACTORY COORDINATED INSTALL)  
 CHROME SLEEVES FOR FACTORY PROVIDED APPLIANCES DROPS - INCLUDED  
 METAL BLOW-OFF CAPS - INCLUDED  
 GAS VALVE - INCLUDED - MECHANICAL SHUTOFF VALVE, 2", (ANSUL) - PART# ANSULMECHSHUTOFFVALVE200  
 HOOD SUPPRESSION TANK - INCLUDED - 6 GAL. - ((2) 3.0 TANK(S))  
 REMOTE PULL STATION - STANDARD - FIELD INSTALLATION AT SINGLE POINT OF EGRESS  
 TANK ENCLOSURES (STAINLESS STEEL) FOR REMOTE MOUNTING - INCLUDED

**SPECIAL DESIGN REQUESTS**

SDR #K1700974 - CULVERS 4VAT 2FIRE PROCESS - FRYER HOOD  
 SDR #K1800795 - FIRE SYSTEM DEDUCT

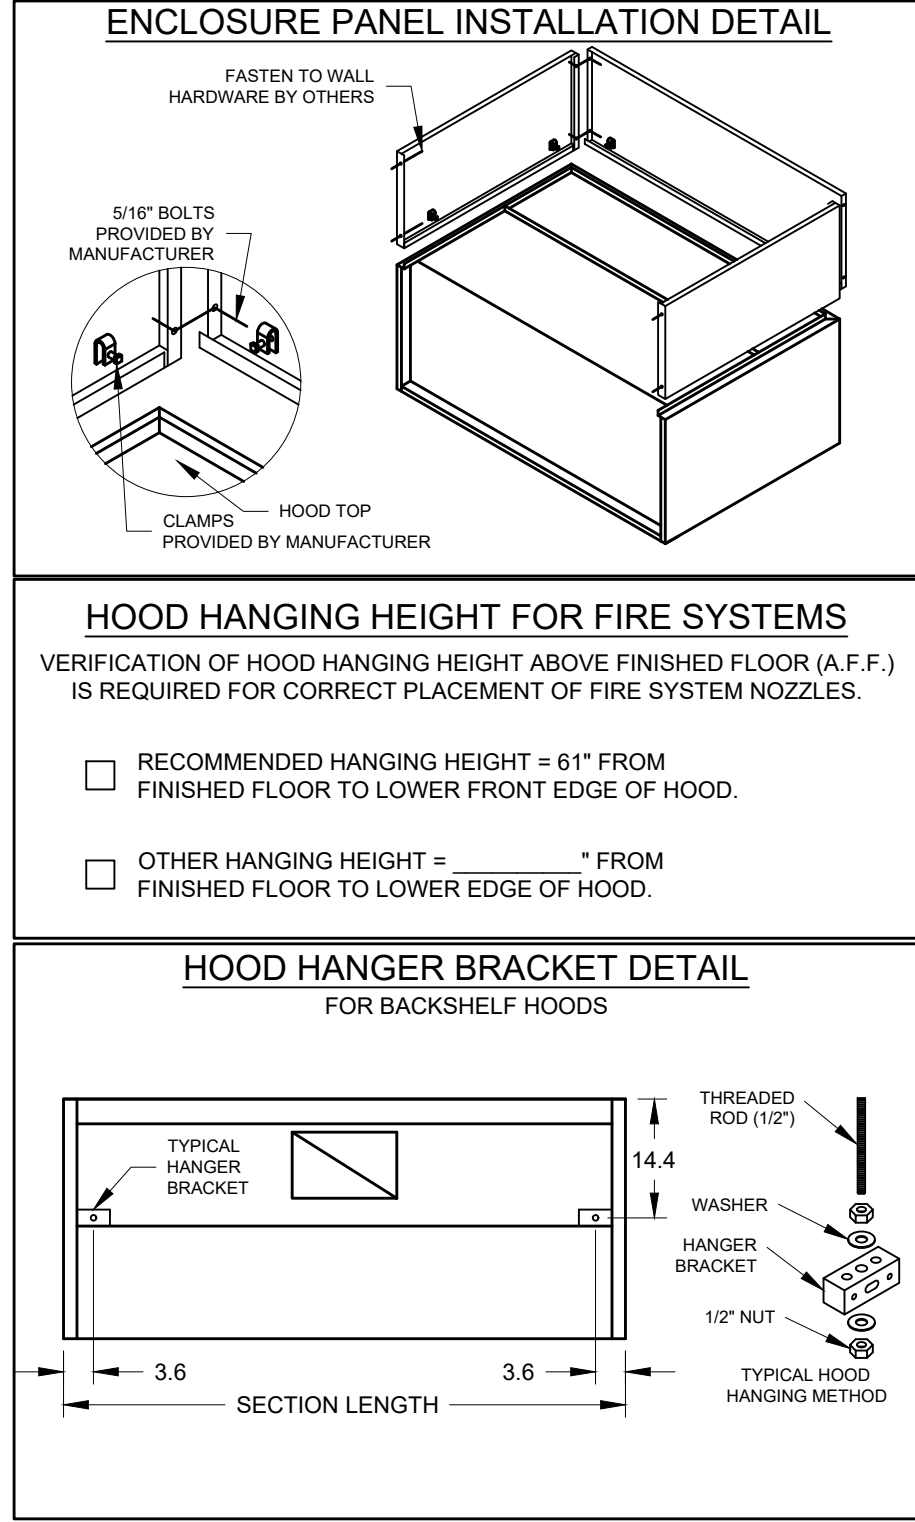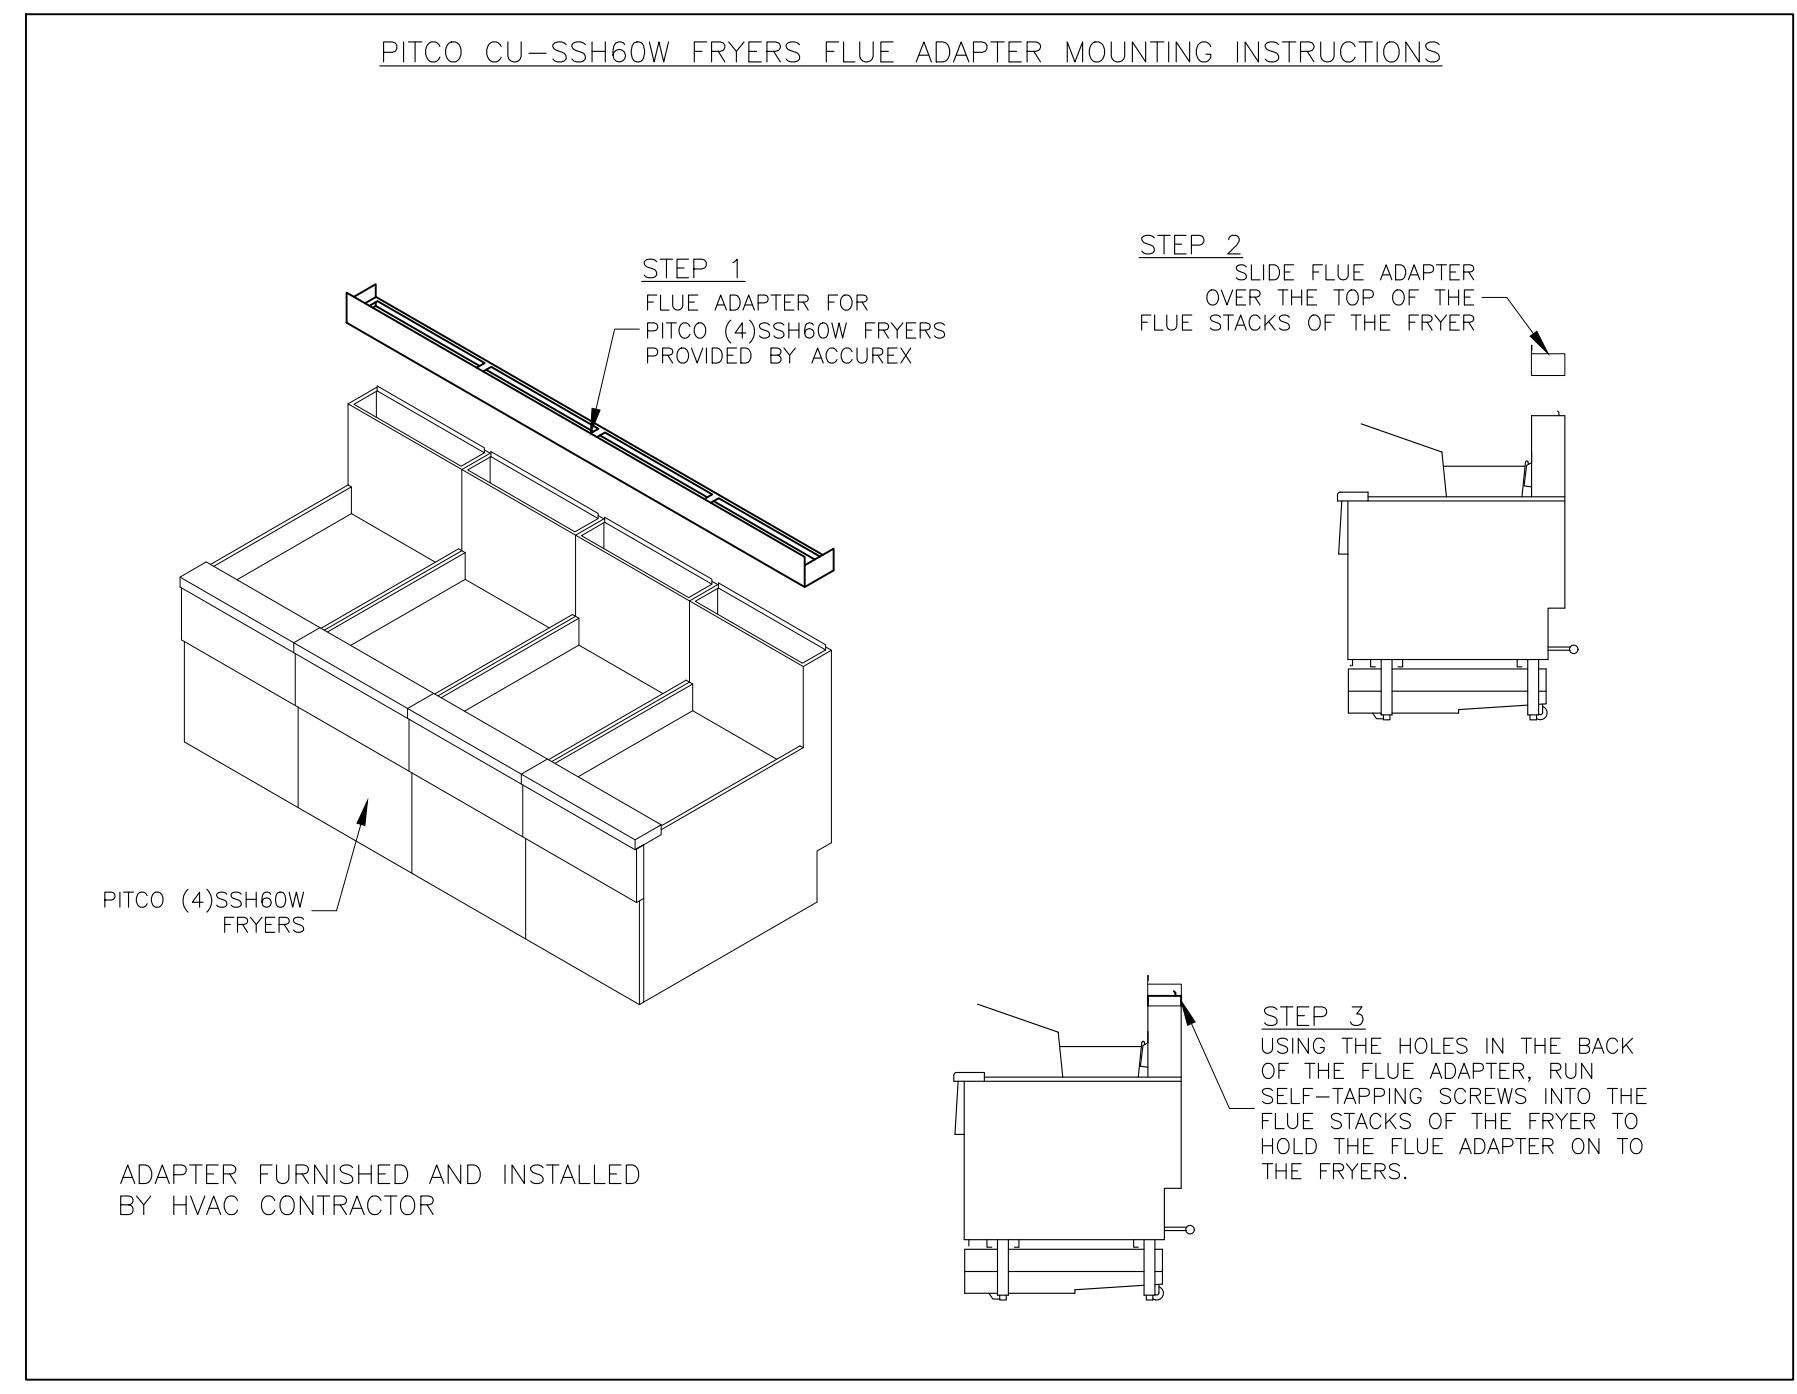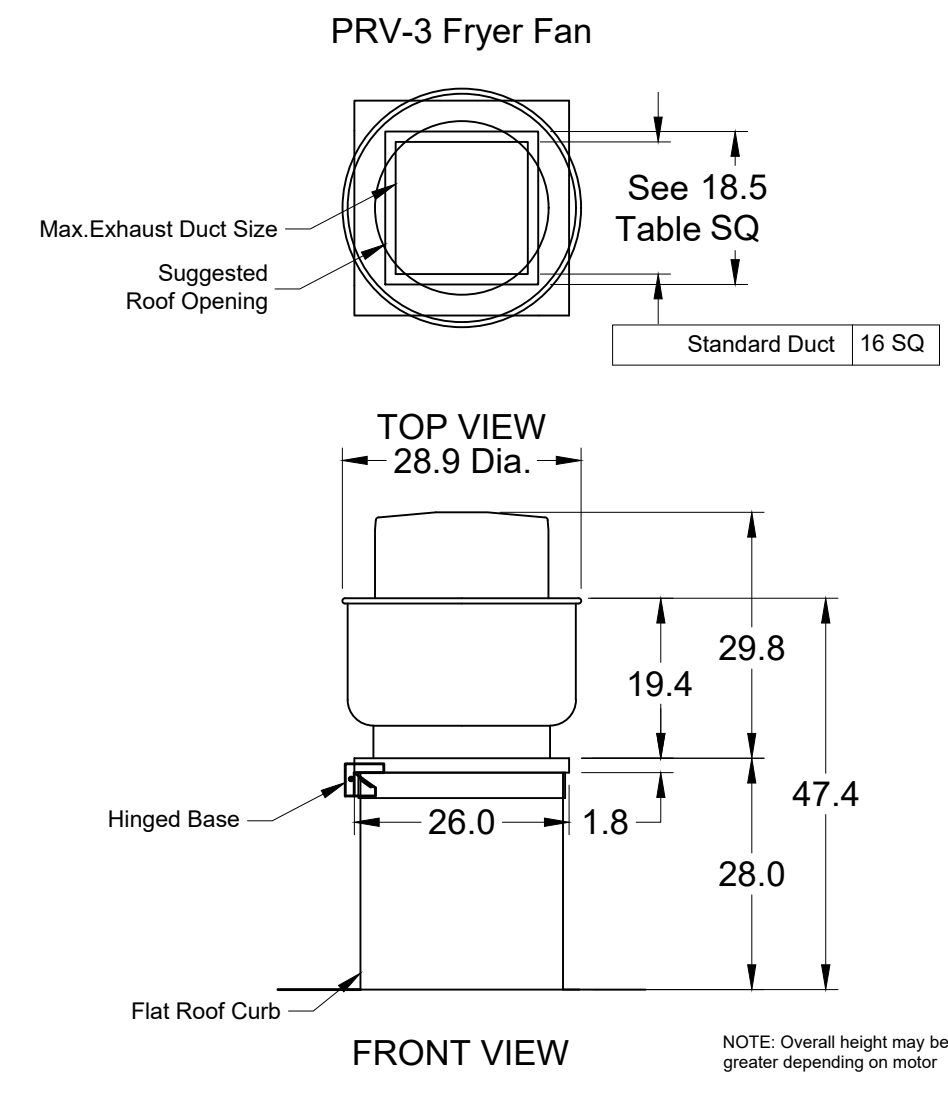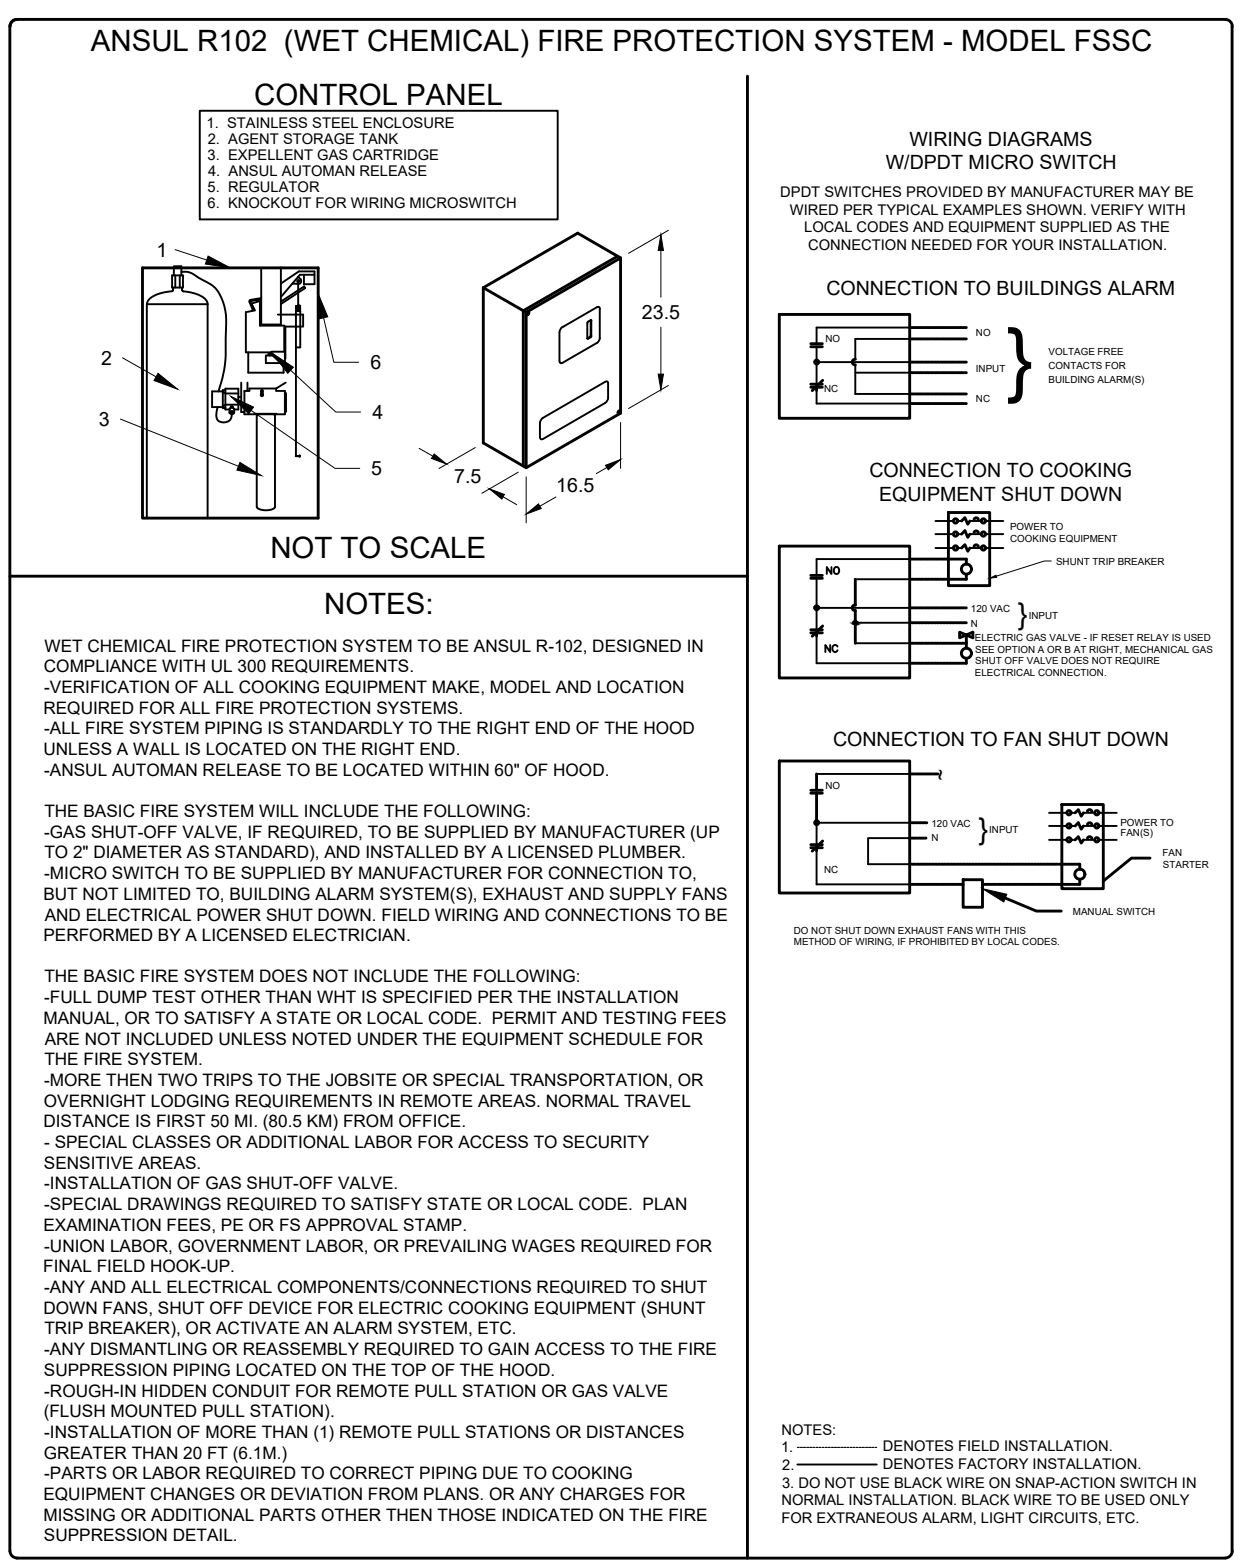

**UL**  
LISTED  
CONSTRUCTION  
ELECTRICAL  
SYSTEMS

**PROJECT**  
12/4/2019

**MARK**

**ACCUREX - W/ IA**  
PHILLIP KRAFT  
PHILLIP.KRAFT@ACCUREX.COM  
262-227-7865

**ACCUREX**

**CULVERS - NORTH FORT MYERS, FL (NC)**  
FRYER HOOD  
PRV-3 FRYER FAN  
FIRE SUPPRESSION-FRYER HOOD

