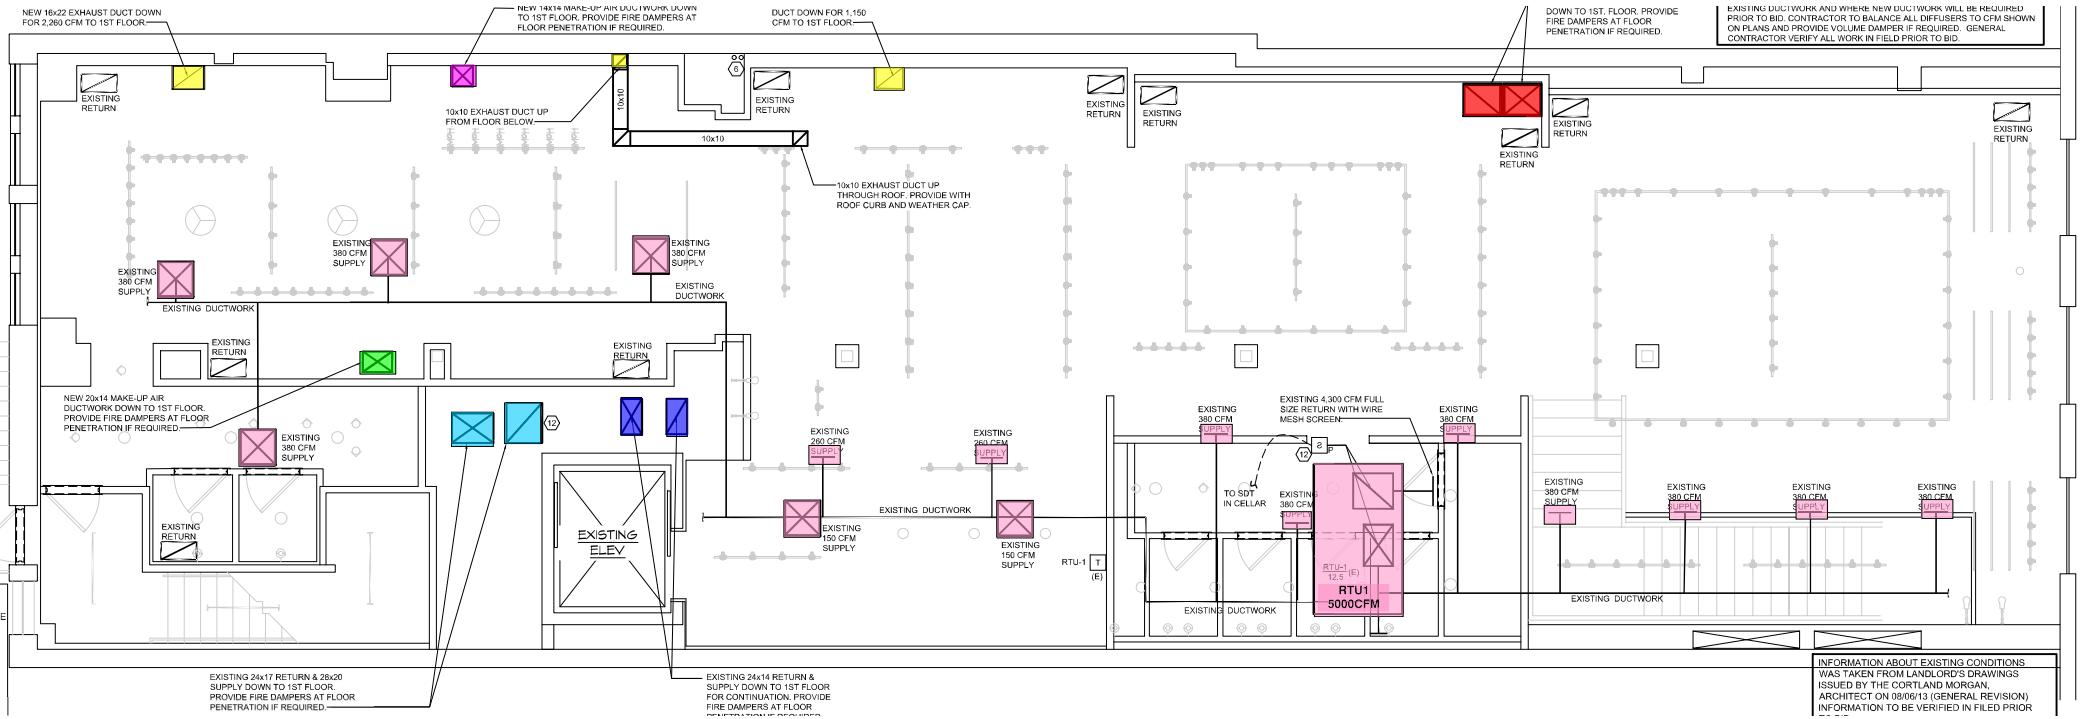
NEW 16x22 EXHAUST DUCT DOWN FOR 2,260 CFM TO 1ST FLOOR
NEW 14x18 MAKE-UP AIR DUCTWORK DOWN TO 1ST FLOOR. PROVIDE FIRE DAMPERS AT FLOOR PENETRATION IF REQUIRED.
DUCT DOWN FOR 1,150 CFM TO 1ST FLOOR
DOWN TO 1ST. FLOOR. PROVIDE FIRE DAMPERS AT FLOOR PENETRATION IF REQUIRED.
EXISTING DUCTWORK AND WHERE NEW DUCTWORK WILL BE REQUIRED PRIOR TO BID. CONTRACTOR TO BALANCE ALL DIFFUSERS TO CFM SHOWN ON PLANS AND PROVIDE VOLUME DAMPER IF REQUIRED. GENERAL CONTRACTOR VERIFY ALL WORK IN FIELD PRIOR TO BID.
EXISTING RETURN
10x10 EXHAUST DUCT UP FROM FLOOR BELOW
10x10
10x10 EXHAUST DUCT UP THROUGH ROOF. PROVIDE WITH ROOF CURB AND WEATHER CAP.
EXISTING 380 CFM SUPPLY
EXISTING DUCTWORK
NEW 20x14 MAKE-UP AIR DUCTWORK DOWN TO 1ST FLOOR. PROVIDE FIRE DAMPERS AT FLOOR PENETRATION IF REQUIRED.
EXISTING ELEV
EXISTING 260 CFM SUPPLY
EXISTING 150 CFM SUPPLY
RTU-1
EXISTING 4,300 CFM FULL SIZE RETURN WITH WIRE MESH SCREEN
TO SDT IN CELLAR
RTU1 5000CFM
EXISTING 24x17 RETURN & 28x20 SUPPLY DOWN TO 1ST FLOOR. PROVIDE FIRE DAMPERS AT FLOOR PENETRATION IF REQUIRED.
EXISTING 24x14 RETURN & SUPPLY DOWN TO 1ST FLOOR FOR CONTINUATION. PROVIDE FIRE DAMPERS AT FLOOR
INFORMATION ABOUT EXISTING CONDITIONS WAS TAKEN FROM LANDLORD'S DRAWINGS ISSUED BY THE CORTLAND MORGAN, ARCHITECT ON 08/06/13 (GENERAL REVISION) INFORMATION TO BE VERIFIED IN FILED PRIOR