


H.E.S. SYSTEM
 MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL STANDFAST H.E.S. SYSTEM FOR ALL NEW HOODS. SEE HOOD FRACTIONAL INTERLOCK WIRING DIAGRAM ON SHEET TALL FOR MORE INFORMATION.

AIR CURTAIN REMOTE WALL SWITCHES BY MECHANICAL CENTER FOR THE HOODS SHALL BE LOCATED IN THE EXTERIOR FOR SWITCHES WITH KITCHEN EQUIPMENT AND PLANS.

NEW AIR CURTAIN LIGHT MOUNTED IN CEILING GRID, CENTERED ON THE FLOOR AT 4" OFF THE EXTERIOR WALL. MECHANICAL CONTRACTOR SHALL ADJUST AIR DEFLECTORS TOWARD AIR DIVERTER BOX.

HOOD DUCT AT EACH FLOOR AS HIGH AS POSSIBLE TO LIMITED CLEARANCE ABOVE CEILING.

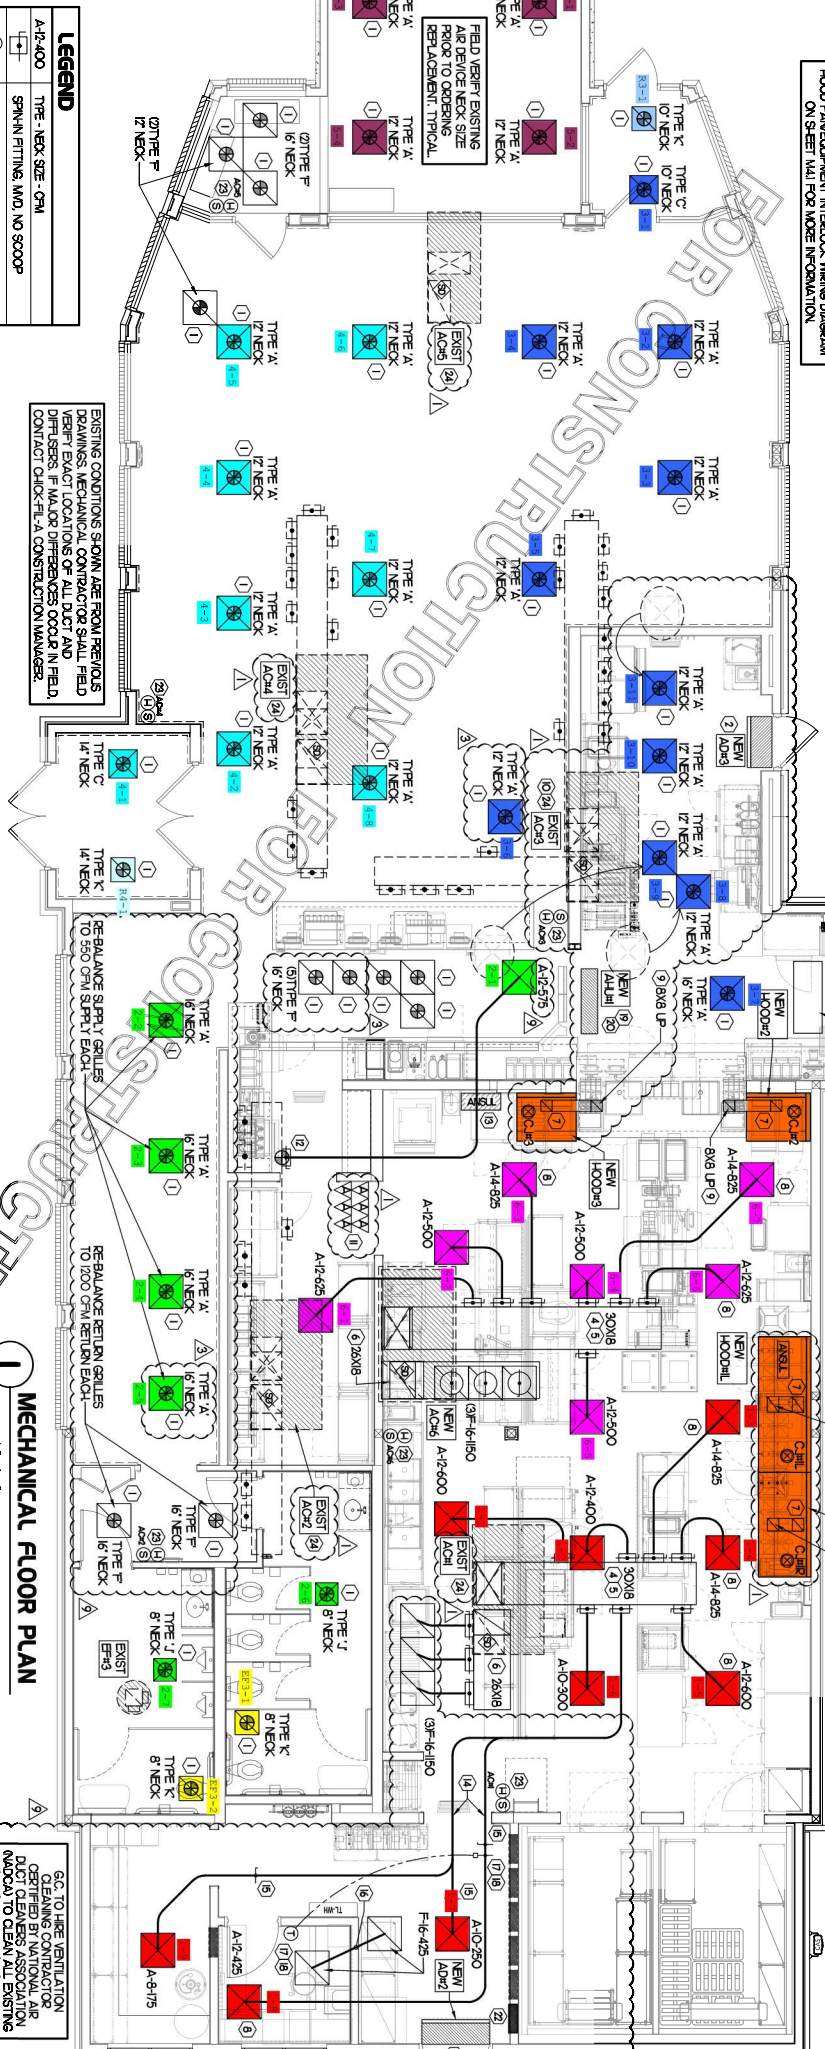

EXISTING CONDITIONS SPIN TAKE FROM PREVIOUS SHEETS. VERIFY LOCATION OF ALL DUCTS AND DIFFUSERS. IF MAJOR DIFFERENCES OCCUR IN FIELD CONTACT CHICK-FIL-A CONSTRUCTION MANAGER.

MECHANICAL FLOOR PLAN

GO TO HVE VENTILATION CLEANING CONTRACTOR OR DIST. CLEANING ASSOCIATION (MACH) TO CLEAN ALL EXISTING

LEGEND

A-12-400	TYPE - NECK SIZE - 6"AI
	SPRINK FITTINGS, MFD, NO SCOOP