



ROOM NAME/AREA	OCCUPANCY CLASSIFICATION	NET AREA SQ.FT.	OCC. DENSITY PER SQ.FT.	REQUIRED OCCUPANTS	CFM PER OCCUPANT	CFM PER SQ.FT.	REQD. OCC. OUTSIDE AIR CFM	REQD. SQ.FT. OUTSIDE AIR CFM	H	MUST BE ≤	K	EXHAUST FLOW RATE CFM / SQ.FT.	EXHAUST CFM REQUIRED PER SQ.FT.	50 CFM REQUIRED PER R.R. FIXTURE	CFM EXHAUST PROVIDED
									TOTAL REQD. OUTSIDE AIR CFM	ACTUAL SUPPLY CFM	ACTUAL OUTSIDE AIR CFM				
A	B	C	D	E	F	G	H	J	K	L	M	N	O		
PER PLAN	PER MC TABLE 403.3	= AxB	PER MC TABLE 403.3	PER MC TABLE 403.3	= CxD	= AxE	= F+G	= PROVIDED SUPPLY AIR	= PROVIDED FRESH AIR	PER OMC TABLE 403.3	= AxL	= FIXTURE CFM TOTAL	= PROVIDED EXHAUST		
AREA 1	DINING	1,520	-	-	-	-	-	-	-	-	-	-	-	-	-
105 DINING															
AREA 2	KITCHEN	1,108	-	-	-	-	-	-	4,150	830	0.7	775.6	-	-	3,033
111 CHOPPING STATION									400	80					
112 PIZZA TOS5									800	160					
113 PIZZA PREP									800	160					
114 SALAD PREP									400	80					
115 CLEANING AREA									400	80					
116 MANAGER'S DESK									550	110					
117 ORDER DESK									400	80					
118 DISHWASHING									400	80					
AREA 3	REST ROOM	27												50	100
106 REST ROOM														50	100
AREA 4	BATHROOMS	190							250	50				200	300
107 MEN									125	25				100	150
109 WOMEN									125	25				100	150
TOTAL		1,722							TOTALS	1,068.6	10,000	2,000			

ROOF PLAN KEYED NOTES (#)

- HINGE SIDE OF EXHAUST CURB.
- NEW TANK-LESS WATER HEATER FLUE VENT.
- NEW EXHAUST FAN (ECON-AIR MODEL EADU12H). PROVIDE NEW CURB IF OLD CURB CAN NOT BE RELOCATED OR IS NOT TALL ENOUGH. OUTLET OF EXHAUST FAN MUST BE GREATER THAN 2'-0" ABOVE FRESH AIR INTAKE OF HVAC UNIT OR MAKE-UP AIR UNIT. MODIFY EXHAUST FAN CURB AS REQUIRED.
- USE EXISTING FLUE FOR NEW REST ROOM VENTING EXHAUST FAN.
- REMOVE & DISPOSE OF EXISTING UNIT FOR COOLER.
- SEAL OPENING WATER TIGHT.
- REMOVE OVEN EXHAUST FAN & CAP OPENING WATER TIGHT.

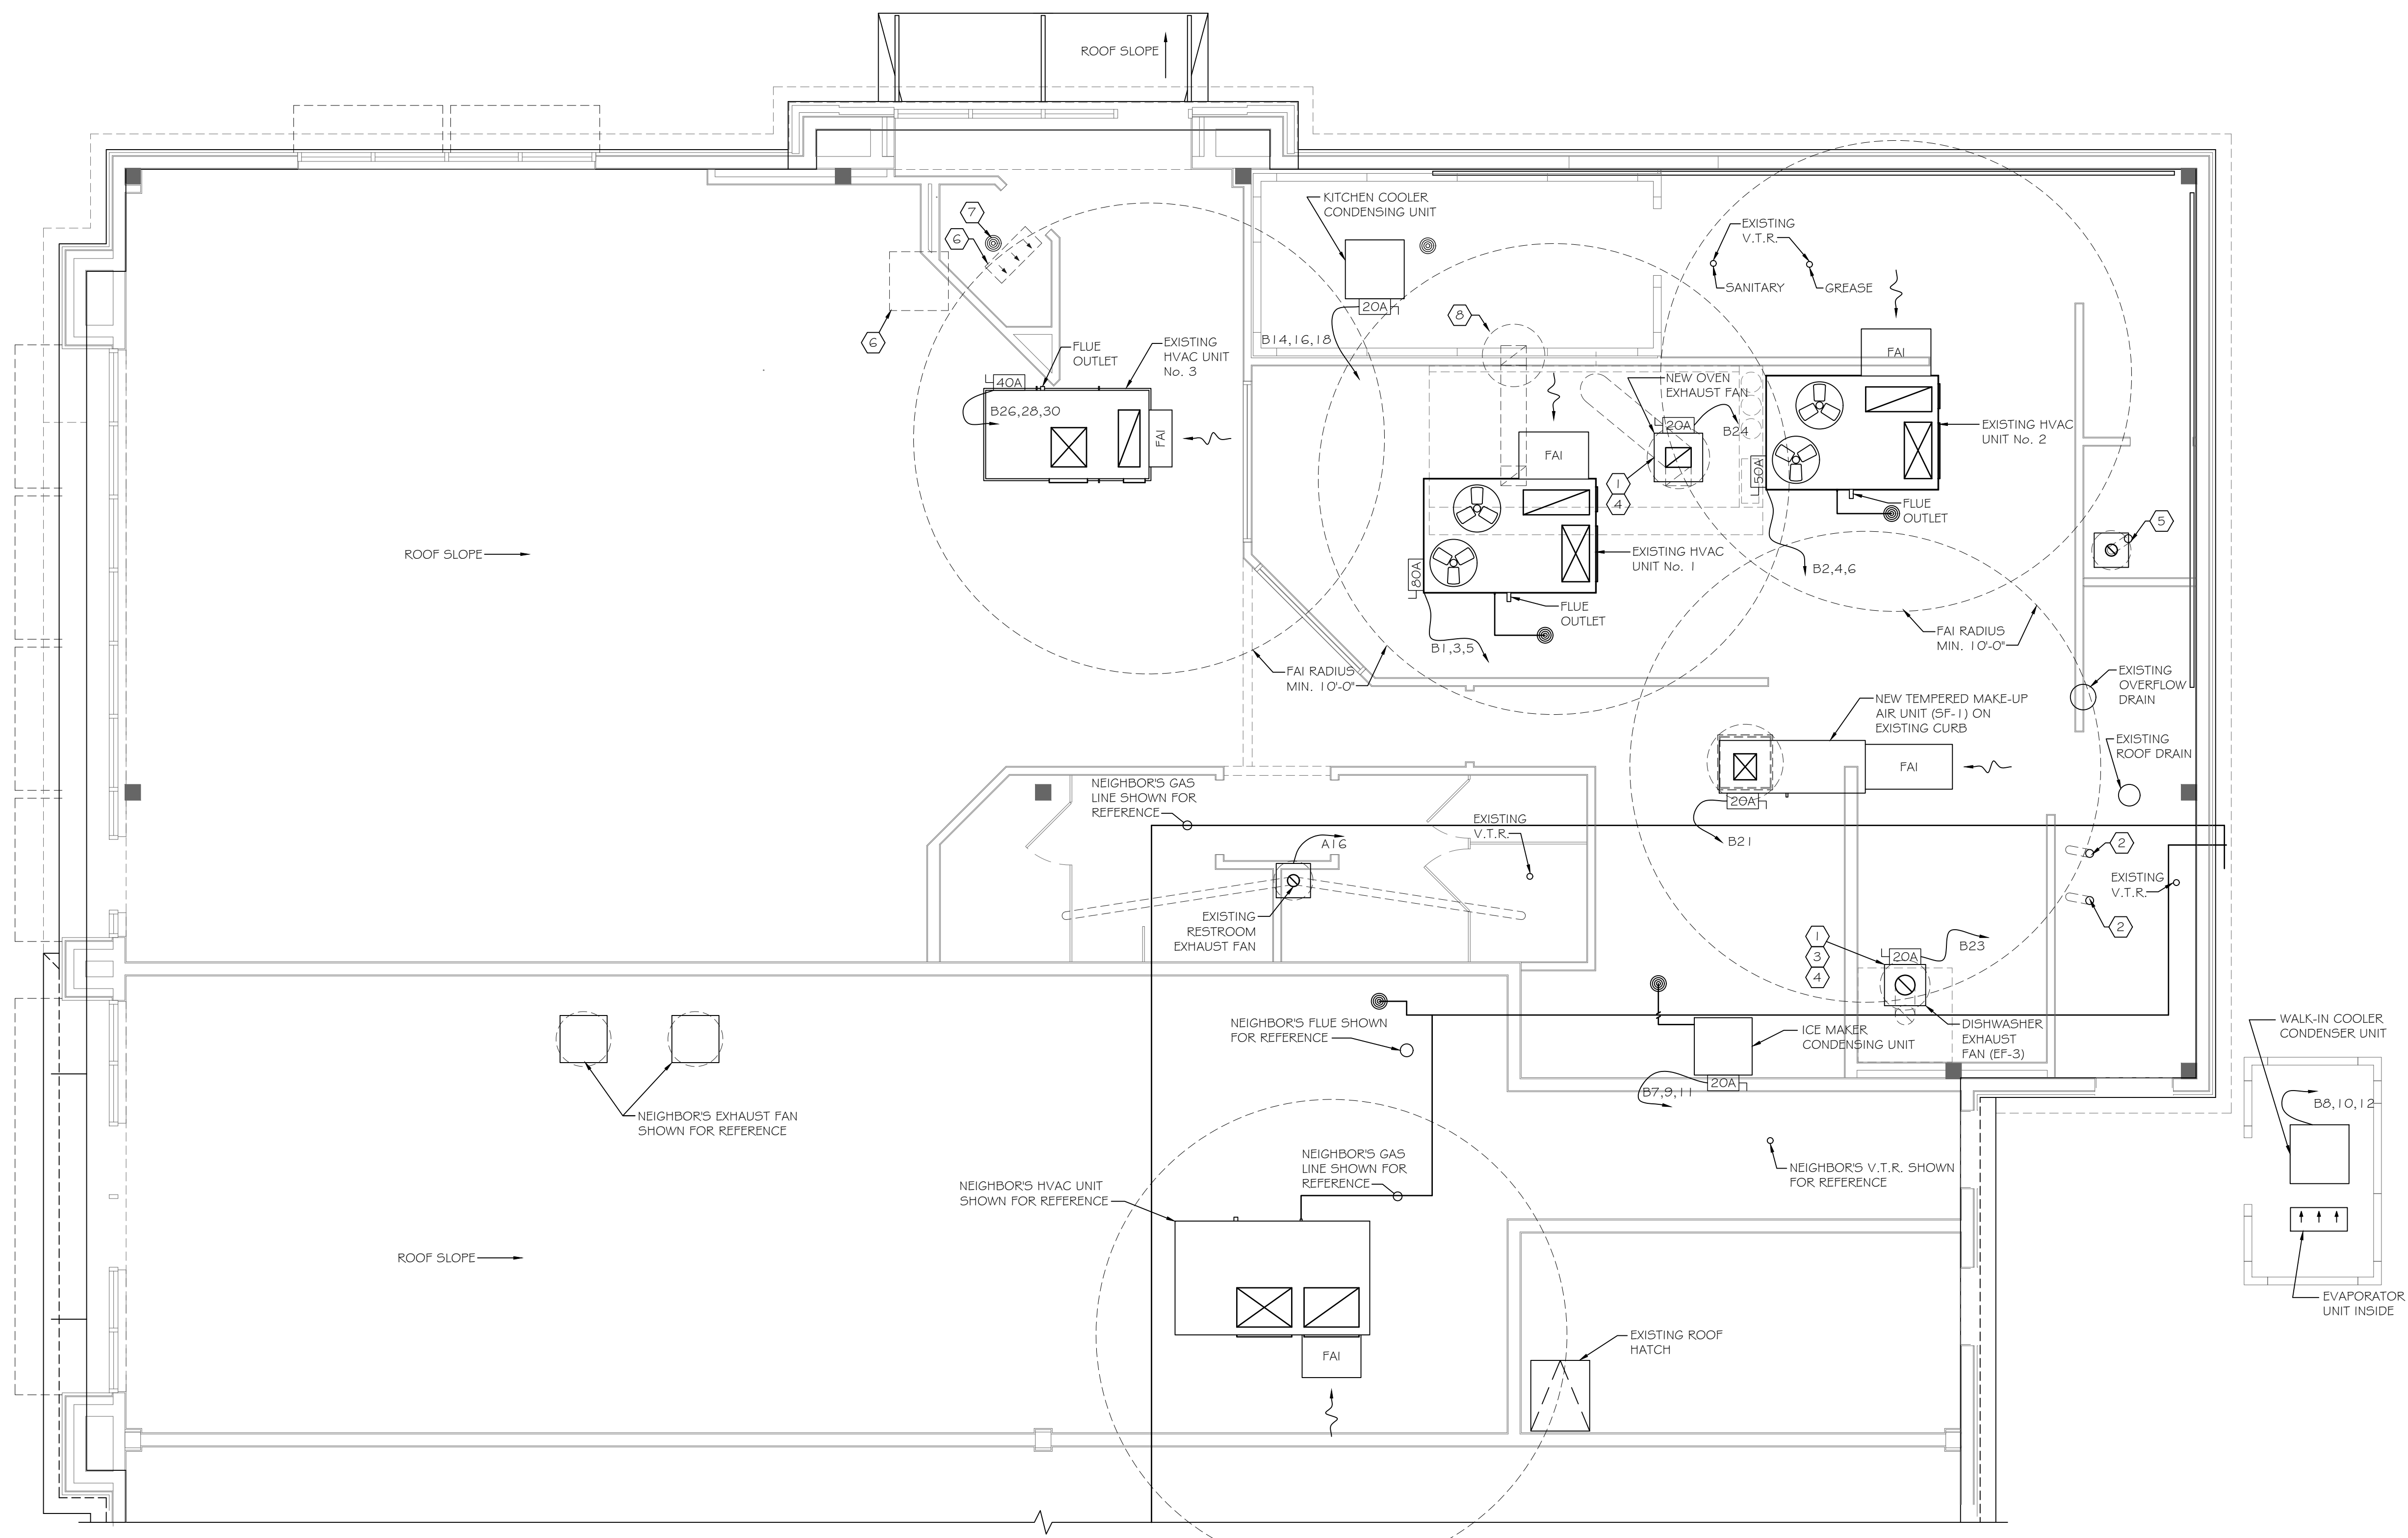


ROOF PLAN
1/4" = 1'-0" FAI = FRESH AIR INLET

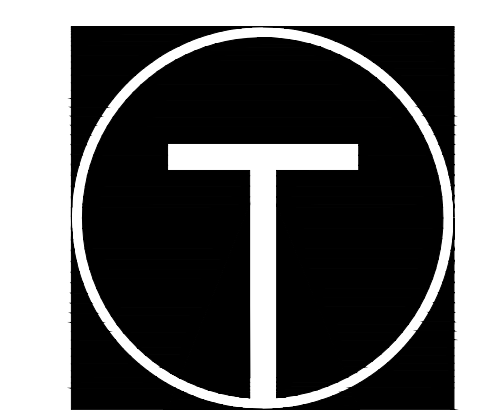

TILSLEY
ARCHITECTS
1143 SAINT GREGORY ST. CINCINNATI, OHIO 45202
TEL: 513.651.4300 WWW.TILSLEYARCHITECTS.COM

INTERIOR RENOVATIONS FOR:
DEWEYS PIZZA - CRESTVIEW HILLS, KY
2949 Dixie Highway, Building 9000
Crestview Hills, KY 41017

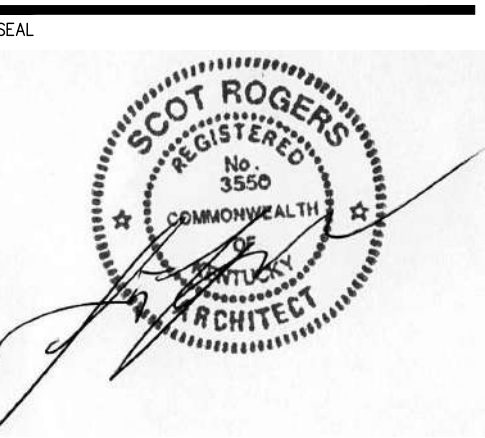

NO.	ISSUE DESCRIPTION	DATE

Sheet Title:
ROOF PLAN
Issued For Permit Date:
04/08/2025
Scale:
As Noted
Drawn By:
DVM
Checked By:
DVM