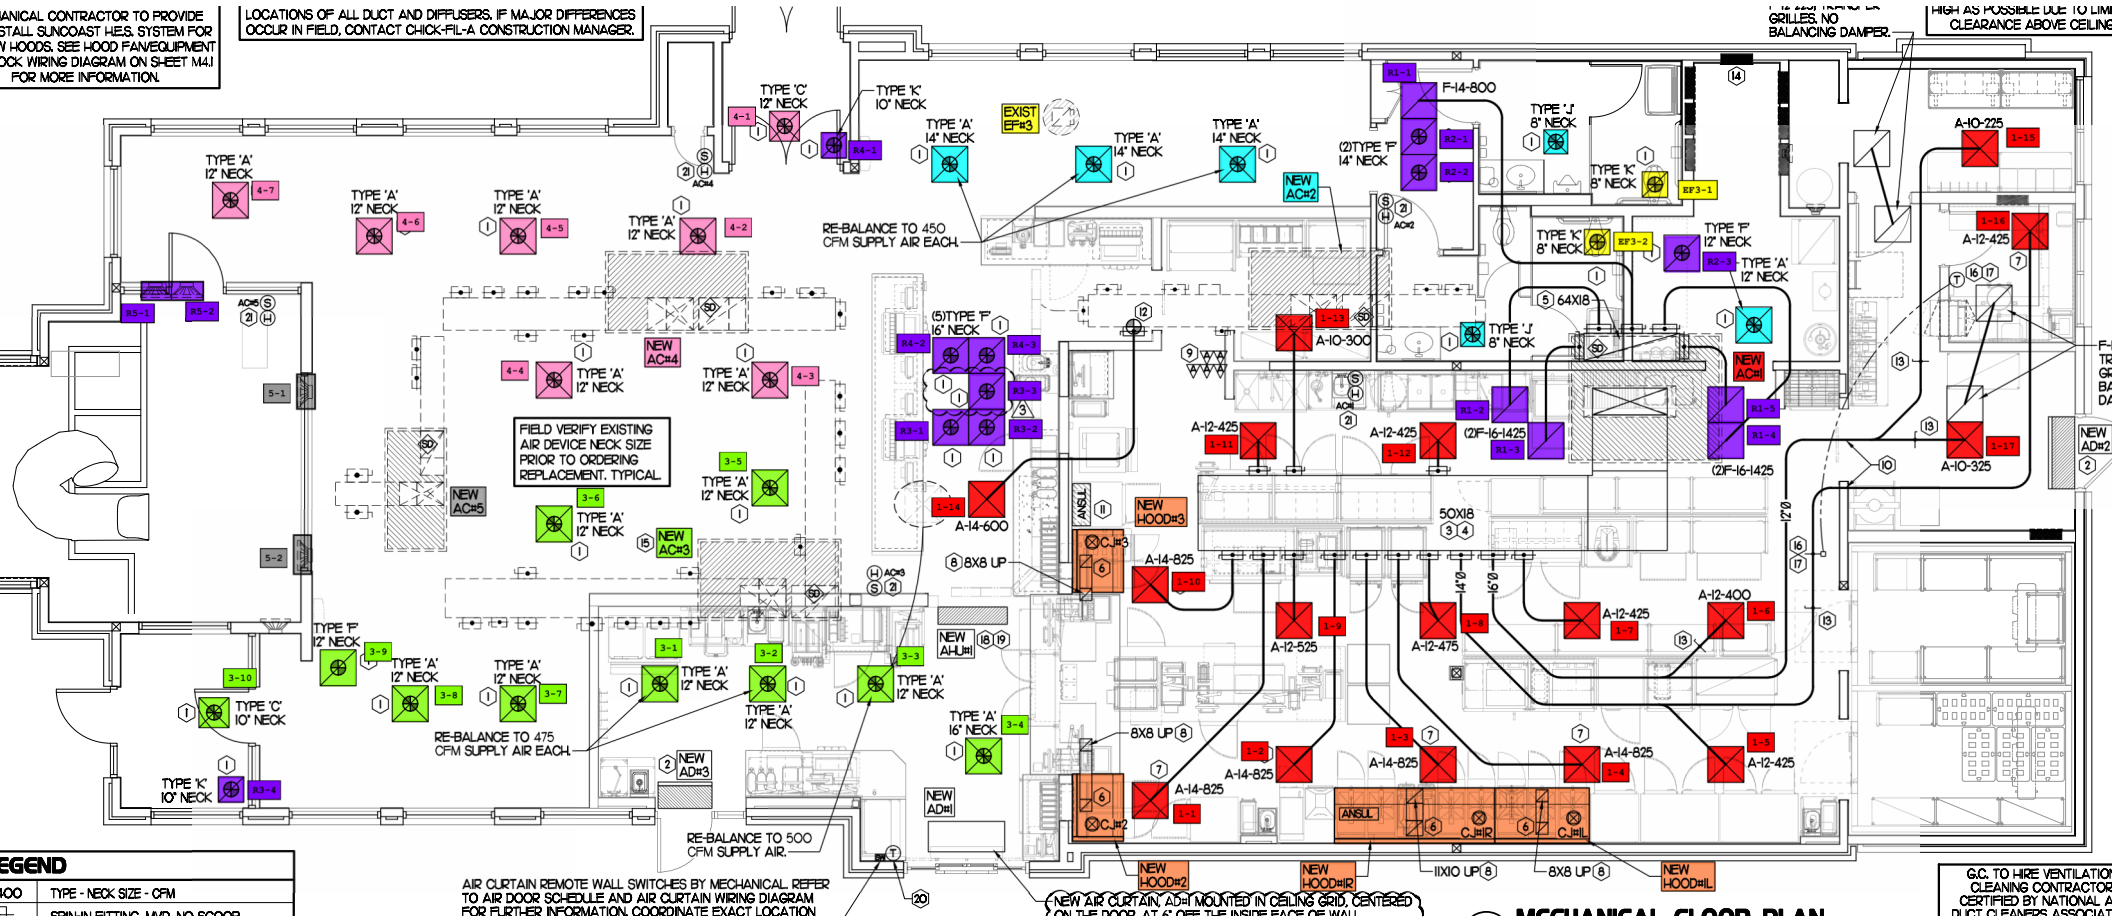
ANICAL CONTRACTOR TO PROVIDE STALL SUNCOAST HES. SYSTEM FOR W HOODS. SEE HOOD FAN/EQUIPMENT OCK WIRING DIAGRAM ON SHEET M4.1 FOR MORE INFORMATION.
LOCATIONS OF ALL DUCT AND DIFFUSERS. IF MAJOR DIFFERENCES OCCUR IN FIELD, CONTACT CHICK-FIL-A CONSTRUCTION MANAGER.
GRILLES. NO BALANCING DAMPER.
HIGH AS POSSIBLE DUE TO LIMI CLEARANCE ABOVE CEILING
TYPE 'A' 12" NECK
TYPE 'C' 12" NECK
TYPE 'K' 10" NECK
TYPE 'A' 14" NECK
EXIST EF#3
RE-BALANCE TO 450 CFM SUPPLY AIR EACH.
NEW AC#2
(2)TYPE 'F' 14" NECK
F-14-800
TYPE 'J' 8" NECK
TYPE 'K' 8" NECK
EF3-1
EF3-2
TYPE 'F' 12" NECK
A-10-225
A-12-425
NEW AC#4
NEW AC#5
NEW AC#3
NEW AC#1
FIELD VERIFY EXISTING AIR DEVICE NECK SIZE PRIOR TO ORDERING REPLACEMENT. TYPICAL.
(5)TYPE 'F' 16" NECK
A-10-300
64X18
A-12-425
(2)F-16-1425
(2)F-16-1425
A-10-325
A-14-600
8X8 UP
NEW HOOD#3
NEW AHU#1
50X18
A-14-825
A-12-525
A-12-475
A-12-400
TYPE 'F' 12" NECK
TYPE 'C' 10" NECK
TYPE 'K' 10" NECK
TYPE 'A' 16" NECK
RE-BALANCE TO 475 CFM SUPPLY AIR EACH.
NEW AD#3
NEW AD#1
RE-BALANCE TO 500 CFM SUPPLY AIR.
NEW HOOD#2
NEW HOOD#1R
11X10 UP
8X8 UP
NEW HOOD#1L
AIR CURTAIN REMOTE WALL SWITCHES BY MECHANICAL. REFER TO AIR DOOR SCHEDULE AND AIR CURTAIN WIRING DIAGRAM FOR FURTHER INFORMATION. COORDINATE EXACT LOCATION
NEW AIR CURTAIN, AD#1 MOUNTED IN CEILING GRID, CENTERED ON THE DOOR AT 6" OFF THE INSIDE FACE OF WALL
G.C. TO HIRE VENTILATION CLEANING CONTRACTOR CERTIFIED BY NATIONAL A DUCT CLEANERS ASSOCIAT
EGEND
400 TYPE - NECK SIZE - CFM