


# AHU 47

C-Wing 2nd Floor East C-2025 Roof  
Interventional Radiology  
Control Located C NE Gen Rm

Setpoints/Control	
OCC_SCHEDULE	Occupied
DAT_SP	55.0 °F
DAP_SP	1.2 in/wc
MAT_SP	55.0 °F
OAD_MINPOS	0.0 %
RF_OFFSET	0.0 %
ECON_EN	Disable
SAFETY_RESET	Off

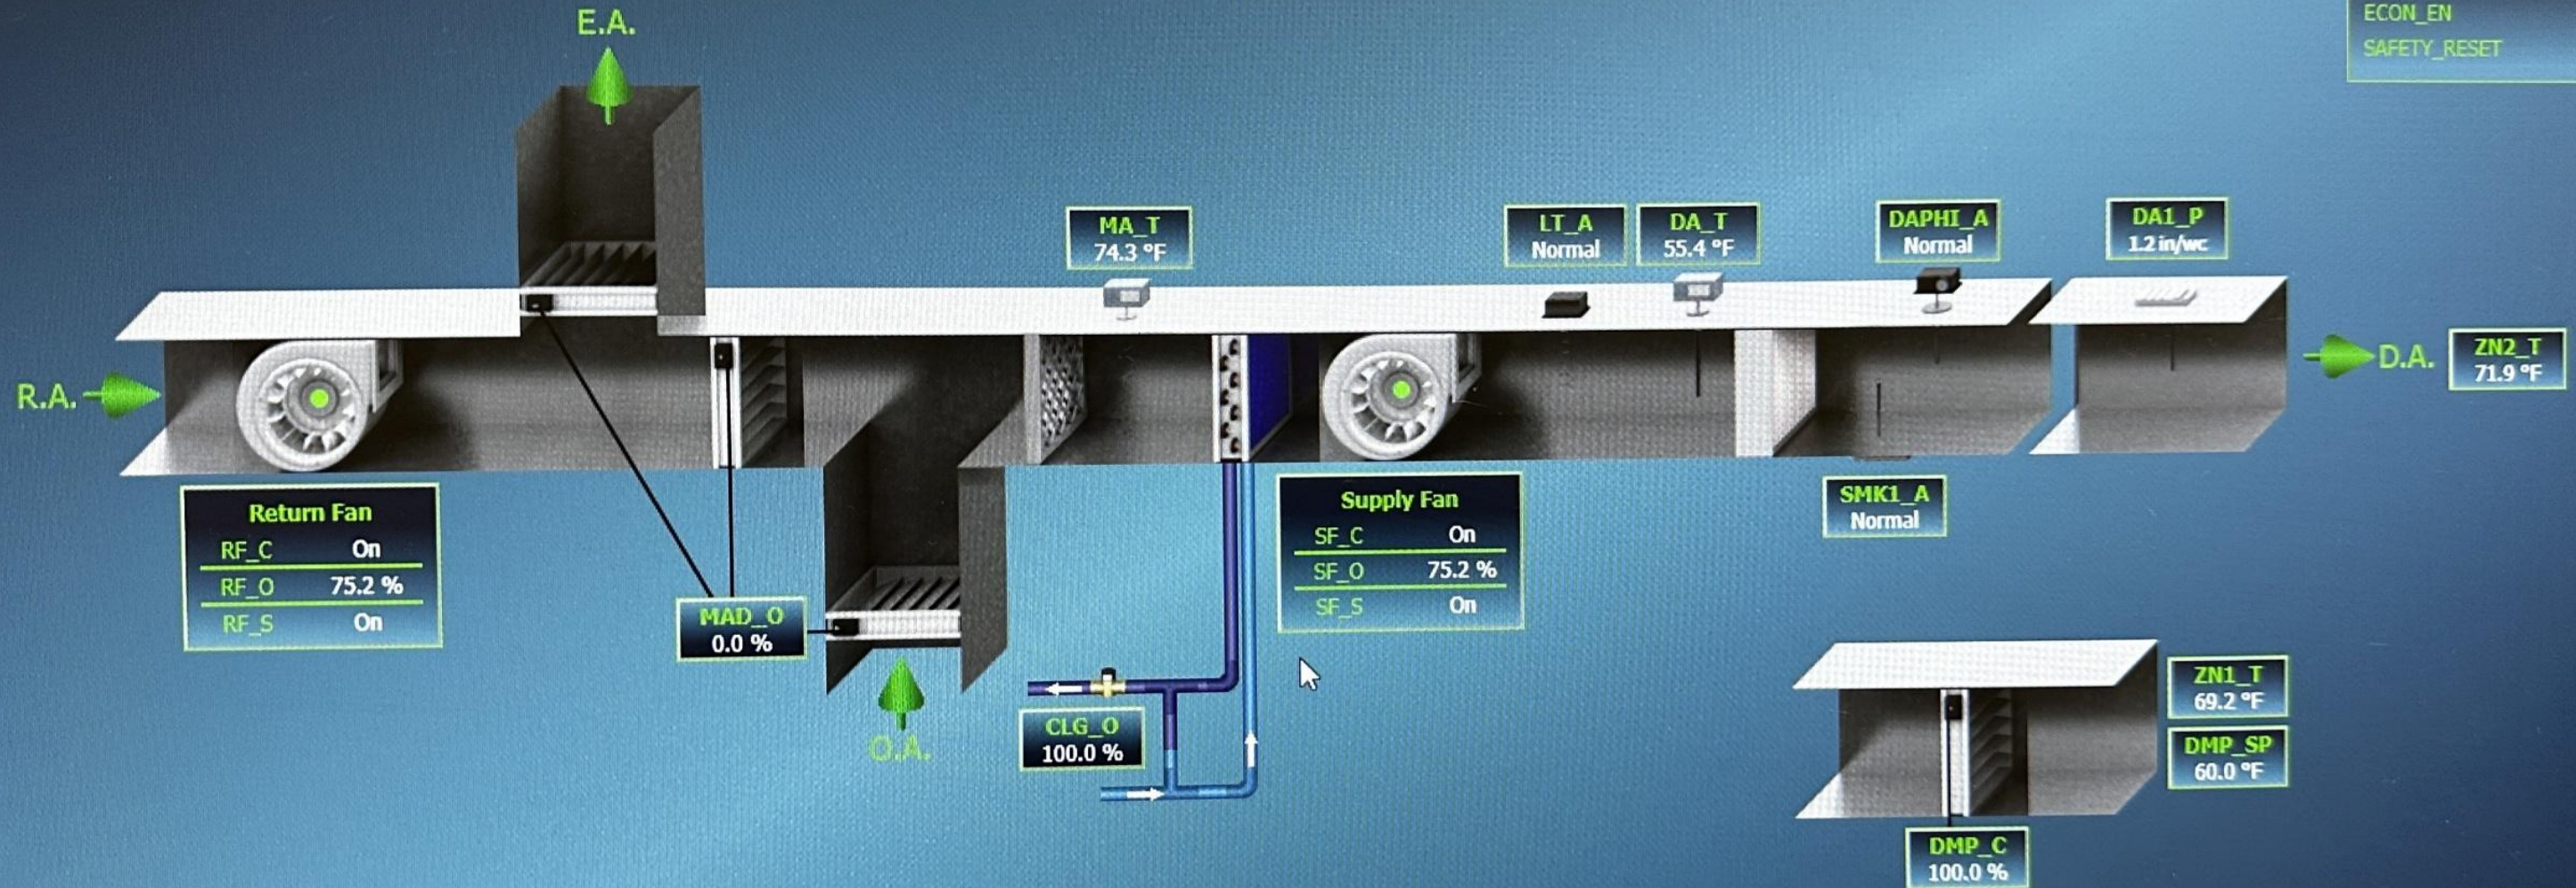

Point Page	Overrides & Notes	Drawings	Add Note
		OAT: 83.7 °F	FX60_21
		QAH: 36.5 %RH	
		WB: 65.1 °F	
		DP: 54.3 °F	
		Enth: 29.9 BTU/lb	