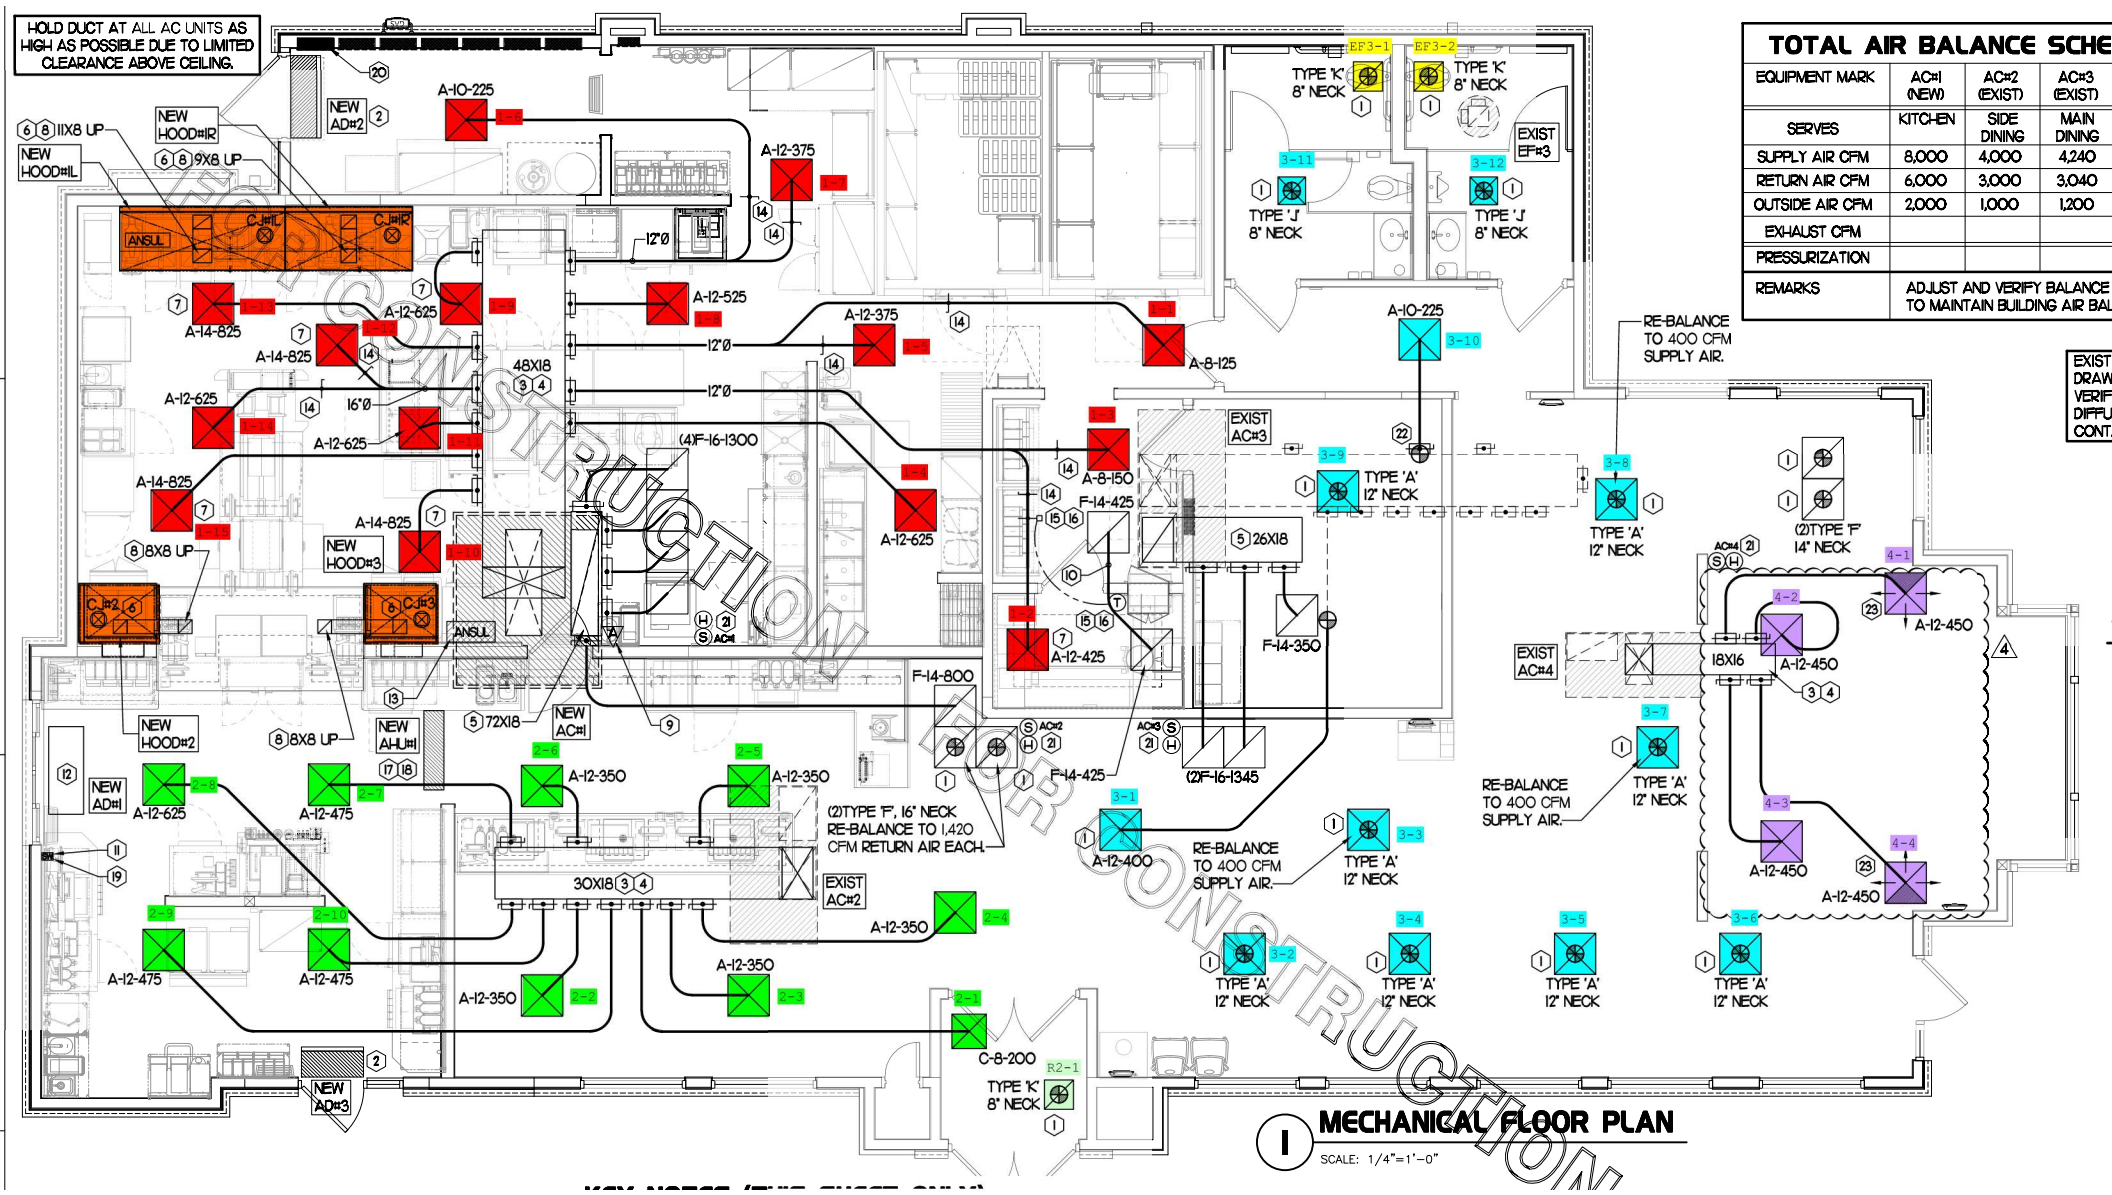

TOTAL AIR BALANCE SCHE

EQUIPMENT MARK	AC#1 (NEW)	AC#2 (EXIST)	AC#3 (EXIST)
SERVES	KITCHEN	SIDE DINING	MAIN DINING
SUPPLY AIR CFM	8,000	4,000	4,240
RETURN AIR CFM	6,000	3,000	3,040
OUTSIDE AIR CFM	2,000	1,000	1,200
EXHAUST CFM			
PRESSURIZATION			
REMARKS	ADJUST AND VERIFY BALANCE TO MAINTAIN BUILDING AIR BAL		

EXIST DRAW VERIF DIFFU CONT.

1 MECHANICAL FLOOR PLAN

SCALE: 1/4"=1'-0"