


SEAL PENETRATIONS IN DRAFTSTOPPING CURTAIN AIR-TIGHT. REFER TO ARCHITECTURAL PLANS FOR LOCATION AND CONSTRUCTION OF DRAFTSTOPPING CURTAIN.

FROM OUTSIDE FACE OF EXTERIOR WALL FRAMING

MEAL DELIVERY CANOPY. SEE ARCHITECTURAL.

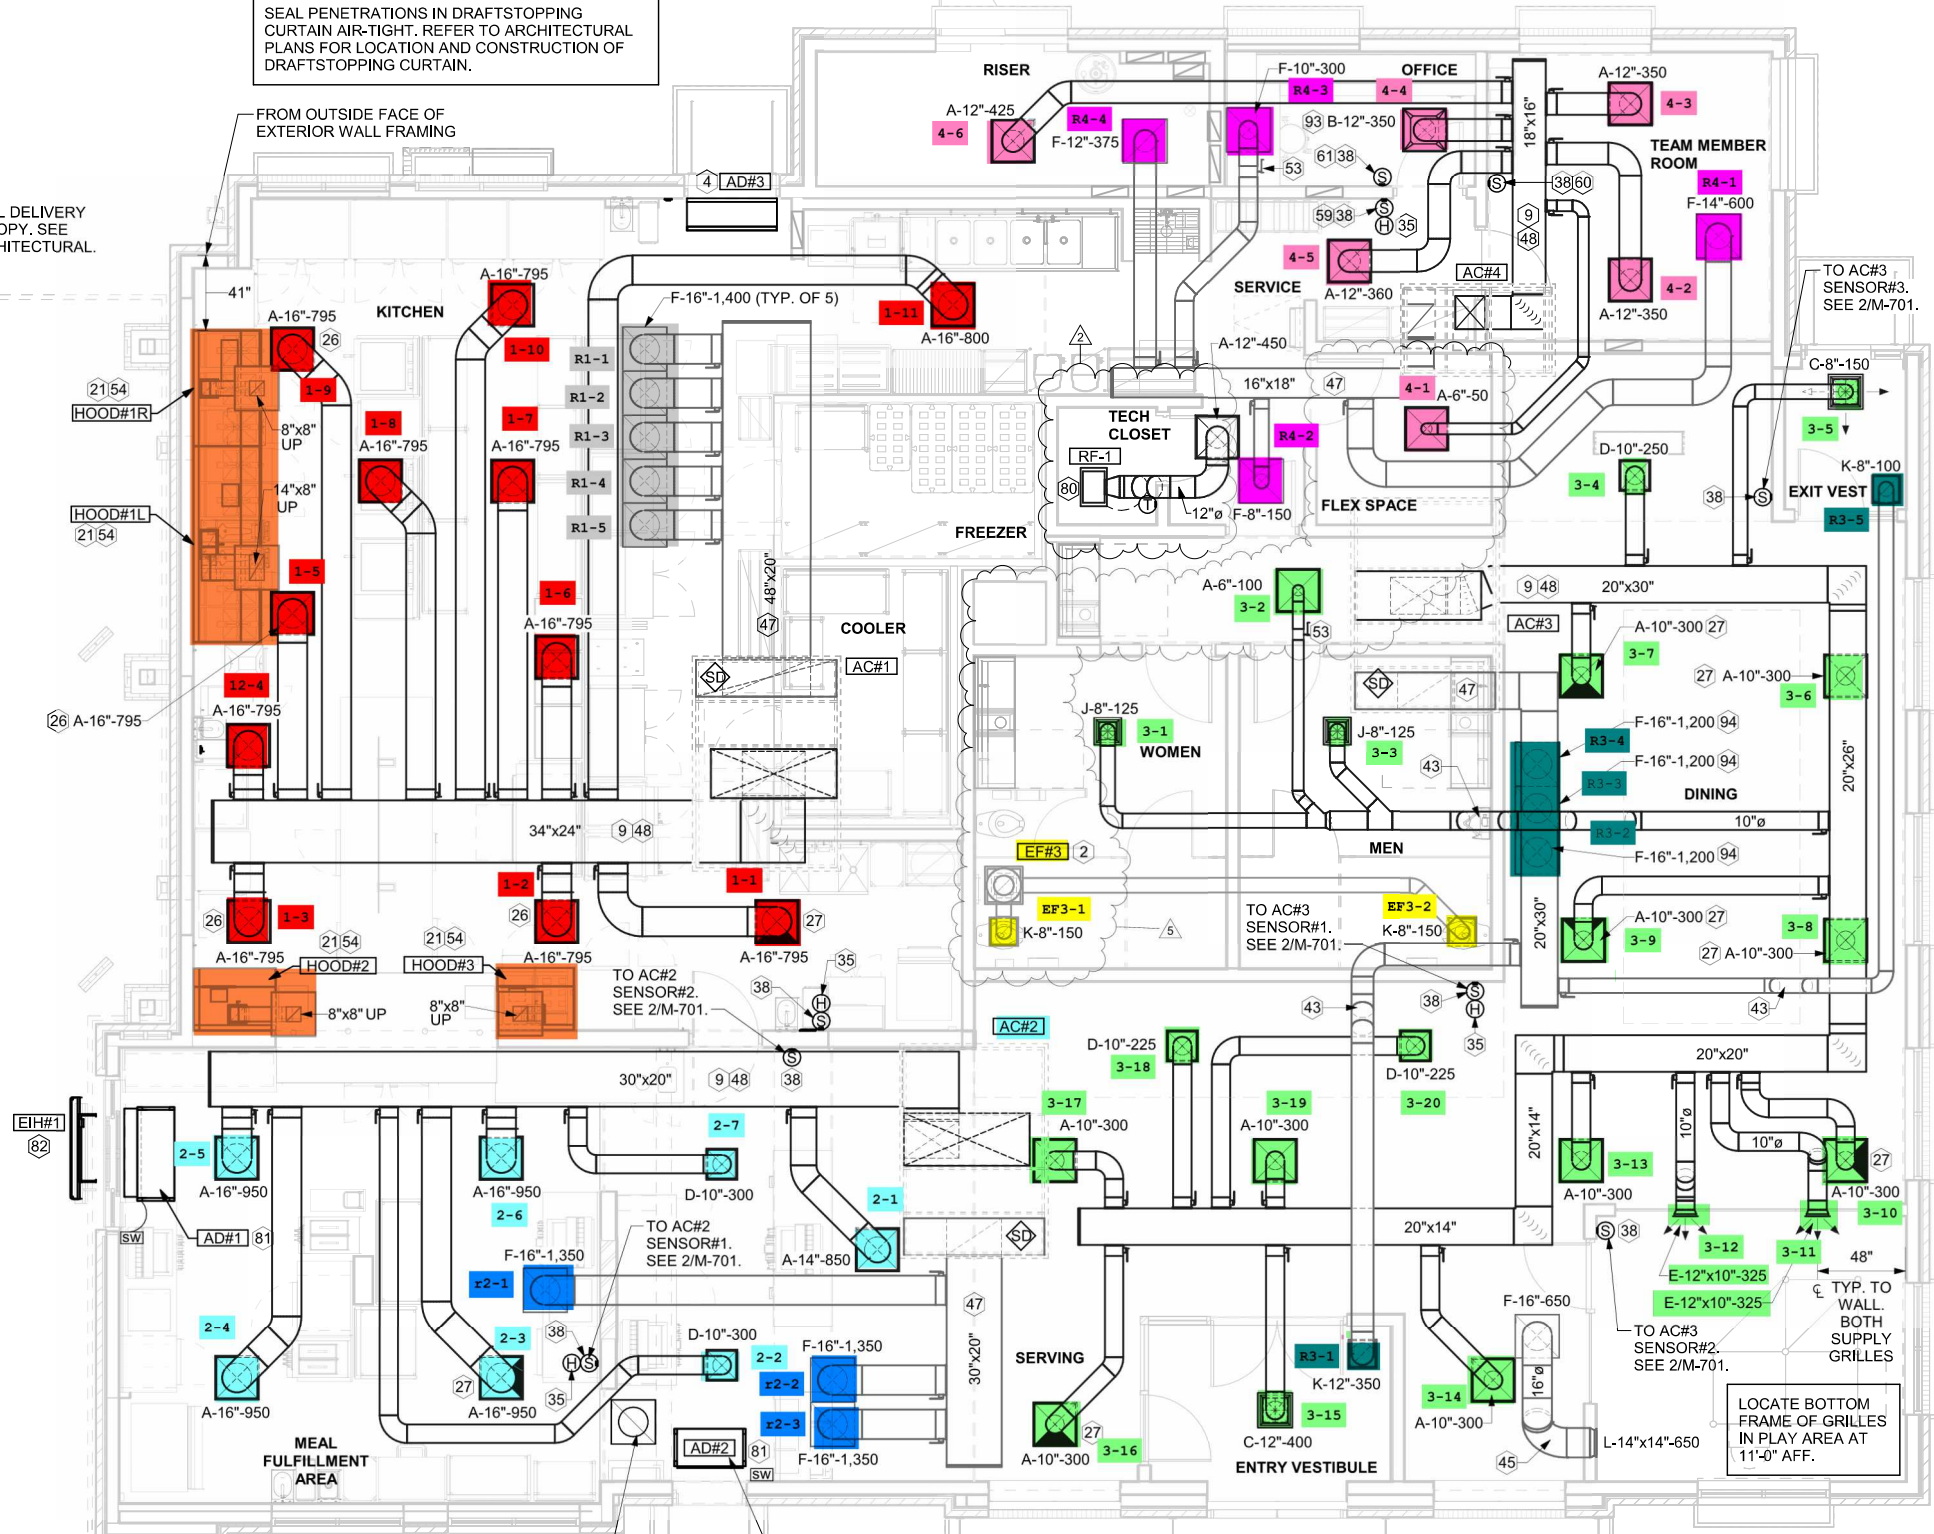

TYPE 'FF' FILTERED RETURN GRILLE LOCATED IN LAY-IN CEILING ADJACENT TO AD#2. GRILLE IS NOT DUCTED

PROVIDE WITH FACTORY MAGNETIC DOOR SWITCH CONTROL. LOCATE MAGNETIC CONTACT TYPE DOOR SWITCH IN DOOR FRAME ON STRIKE SIDE.

LOCATE BOTTOM FRAME OF GRILLES IN PLAY AREA AT 11'-0" AFF.

TO AC#3 SENSOR#3. SEE 2/M-701.

TO AC#3 SENSOR#1. SEE 2/M-701.

TO AC#2 SENSOR#2. SEE 2/M-701.

TO AC#2 SENSOR#1. SEE 2/M-701.

TO AC#3 SENSOR#2. SEE 2/M-701.

TYP. TO WALL. BOTH SUPPLY GRILLES