

MECHANICAL SHEET INDEX

Table with 2 columns: Code and Description. Lists items like M001 MECHANICAL GENERAL INFORMATION, M101 MECHANICAL FLOOR PLAN, etc.

RESPONSIBILITY MATRIX

Responsibility Matrix table with columns: DESCRIPTION, GC, OWNER, LL, GC, OWNER, LL, REMARKS. Includes sections for HVAC Ductwork, Mechanical Piping, and Kitchen Exhaust.

SUBMITTAL MATRIX


Submittal Matrix table with columns: SUBMITTAL DESCRIPTION, Required Review Time (Business Days), Architect of Record, Shake Shack, Physical Sample Required, Submittal for Record, Submittal for Record Only.

GENERAL NEW NOTES:

- 1. PRIOR TO SUBMITTING BID, VISIT THE JOB SITE AND BECOME FULLY ACQUAINTED WITH THE EXISTING CONDITIONS OF THE PROJECT...
2. EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS AND SITE VISITS AND MAY NOT REFLECT EXACT 'AS-BUILT' CONDITIONS...
3. COORDINATE THE INSTALLATION OF THE MECHANICAL SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION...


MECHANICAL SYMBOLS

MECHANICAL SYMBOLS legend. Includes sections for STANDARD MOUNTING HEIGHT, HVAC DUCTWORK AND ACCESSORIES, PIPING SYMBOLS, ANNOTATION, ABBREVIATIONS, and HVAC CONTROL DEVICES. Contains various symbols and their corresponding descriptions.

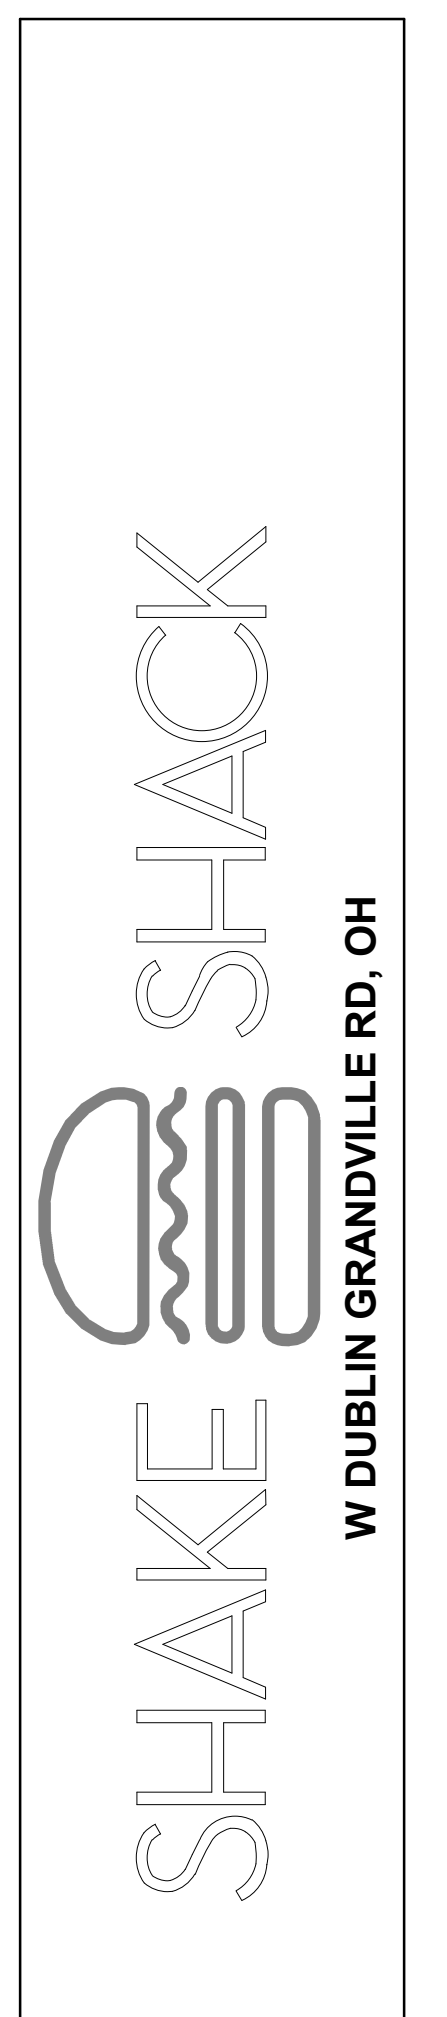

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

Table with 3 columns: NO., DATE, REMARKS. Contains revision entries for construction, addendum, and permit/bid.

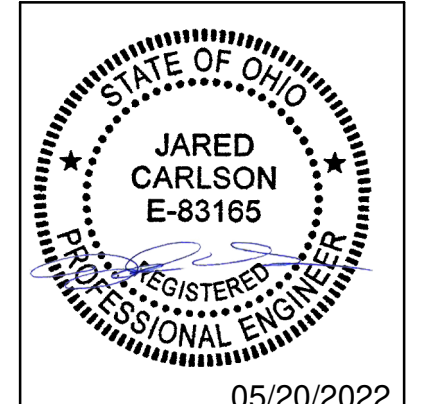


Drawing Title: MECHANICAL GENERAL INFORMATION
Job No. 2150002415, Drawn: AJP
Scale: N.T.S., Date: 11/12/2021
Sheet No. M001

MECHANICAL GENERAL NOTES:

- DO NOT ROUTE ANY DUCTWORK OR PIPING ABOVE ELECTRICAL PANELS. REFER TO SHEET M001 FOR ADDITIONAL GENERAL NOTES AND REQUIREMENTS.
- REFER TO DETAILS AND SCHEDULES SHEETS FOR FURTHER INFORMATION.
- MOUNT ALL THERMOSTATS AND SENSORS CONTROLLING HVAC EQUIPMENT AT 4'-0" AFF UNLESS OTHERWISE NOTED.

MECHANICAL PLAN NOTES:

- TYPE I HOODS SHALL BE FURNISHED COMPLETE WITH INTERNALLY PIPED FIRE SUPPRESSION SYSTEM AND EXTERNAL FOAM SUPPLY BOTTLES WITH REMOTE FULL CONTROLS AND IN COMPLIANCE WITH NFPA 96, DIVISION 23 SHALL COORDINATE COMPLETE INSTALLATION WITH FIRE PROTECTION CONTRACTOR TO MEET APPROVAL OF LOCAL INSPECTOR AND CODE COMPLIANCE INCLUDING TESTING.
- TYPE II GREASE HOOD EXHAUST DUCTWORK SHALL BE MINIMUM 18 GAUGE STEEL OR MINIMUM 18 GAUGE STAINLESS STEEL WITH LIQUID TIGHT WELDS. INSTALL ACCESS PANELS FOR CLEANING AS REQUIRED BY NFPA 96 AND LOCAL CODES. TRANSITION GREASE DUCTWORK AS REQUIRED TO HOOD AND FAN CONNECTIONS. PROVIDE 45° MAX OFFSETS AS REQUIRED TO COORDINATE WITH STRUCTURE. PROVIDE RADIUS ELBOWS WITHOUT TURNING VANES. SLOPE HORIZONTAL GREASE DUCT BACK TOWARDS HOOD AT MINIMUM OF 1/4" PER LINEAL FOOT. GREASE DUCTS SHALL BE CONTAINED IN A UL APPROVED GREASE DUCT WRAP SYSTEM.
- MOUNT THERMOSTATS AND TEMPERATURE SENSOR(S) ON WALL. THERMOSTATS AND SENSOR(S) SHALL BE LABELED TO MATCH THE UNIT TAG AND CORRESPOND TO THE ELECTRICAL LEGEND IN THE ELECTRICAL PANELBOARD SERVING THE EQUIPMENT. COORDINATE COLOR WITH ARCHITECT.
- PROVIDE RA DUCT THROUGH ROOF, FULL SIZE OF UNIT OPENING, AND CONNECT TO UNIT WITH FLEXIBLE CONNECTOR. TRANSITION 45 DEGREES THROUGH ROOF CURB.
- COMBINATION TEMPERATURE SENSOR AND HUMIDITY SENSOR.
- CARBON MONOXIDE DETECTOR FURNISHED BY OWNER. INSTALL AT 5'-0" AFF. COORDINATE FINAL LOCATION WITH OWNER REPRESENTATIVE.
- PROVIDE ANALOX X80 OR APPROVED EQUAL CARBON DIOXIDE SENSOR WITH REMOTE ALARM REPEATER TO BE MOUNTED AT 18" AFF. PROVIDE CARBON DIOXIDE SENSOR WITH RELAY. RELAY SHALL BE INTERLOCKED WITH THE BUILDING FIRE ALARM SYSTEM. THE SENSOR SHALL BE EQUIPPED WITH A LOCAL AUDIBLE AND VISUAL ALARM. THE LOW LEVEL ALARM SHALL ACTIVATE THE LOCAL AUDIBLE AND VISUAL ALARM. THE HIGH LEVEL ALARM SHALL ACTIVATE RELAY. INSTALL SENSOR PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- PROVIDE CONCENTRIC VENT MODEL NUMBER PVC-3CT.
- MOUNT TEMPERATURE SENSOR PROVIDED WITH KITCHEN.
- 8"x8" GREASE EXHAUST DUCT UP TO KEF-2 ON ROOF.
- 7"x8" GREASE EXHAUST DUCT UP TO KEF-3 ON ROOF.
- 8"x8" GREASE EXHAUST DUCT UP TO KEF-3 ON ROOF.
- INSTALL "DUCTMATE ULTIMATE DOOR" ON DUCTS 12" OR LARGER AND INSTALL "DUCTMATE F1 SANDWICH ACCESS DOOR" FOR DUCTS LESS THAN 12" ON GREASE DUCT ACCESS PANELS FOR CLEANING IN LOCATION SHOWN AT A MINIMUM AND AS REQUIRED BY LOCAL AND LOCAL CODES.
- INSTALL DUCT SMOKE DETECTOR IN RETURN AIR PLENUM.
- INSTALL HOOD FIRE SUPPRESSION MANUAL PULL STATION. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH FIRE SUPPRESSION SYSTEM INSTALLER AND THE AUTHORITY HAVING JURISDICTION.
- PROVIDE 14" GALVANIZED CONSTRUCTION HARDWARE CLOTH SCREEN OVER OPEN END OF RETURN DUCT. PROVIDE DUCT LINER IN BOOT. RETURN AIR DUCT SHALL BE MINIMUM 36" HORIZONTAL EXTENSION FOR SOUND ATTENUATION.
- UP TO EF-1 ON ROOF.
- 8"x8" GREASE EXHAUST DUCT UP TO KEF-1 ON ROOF.

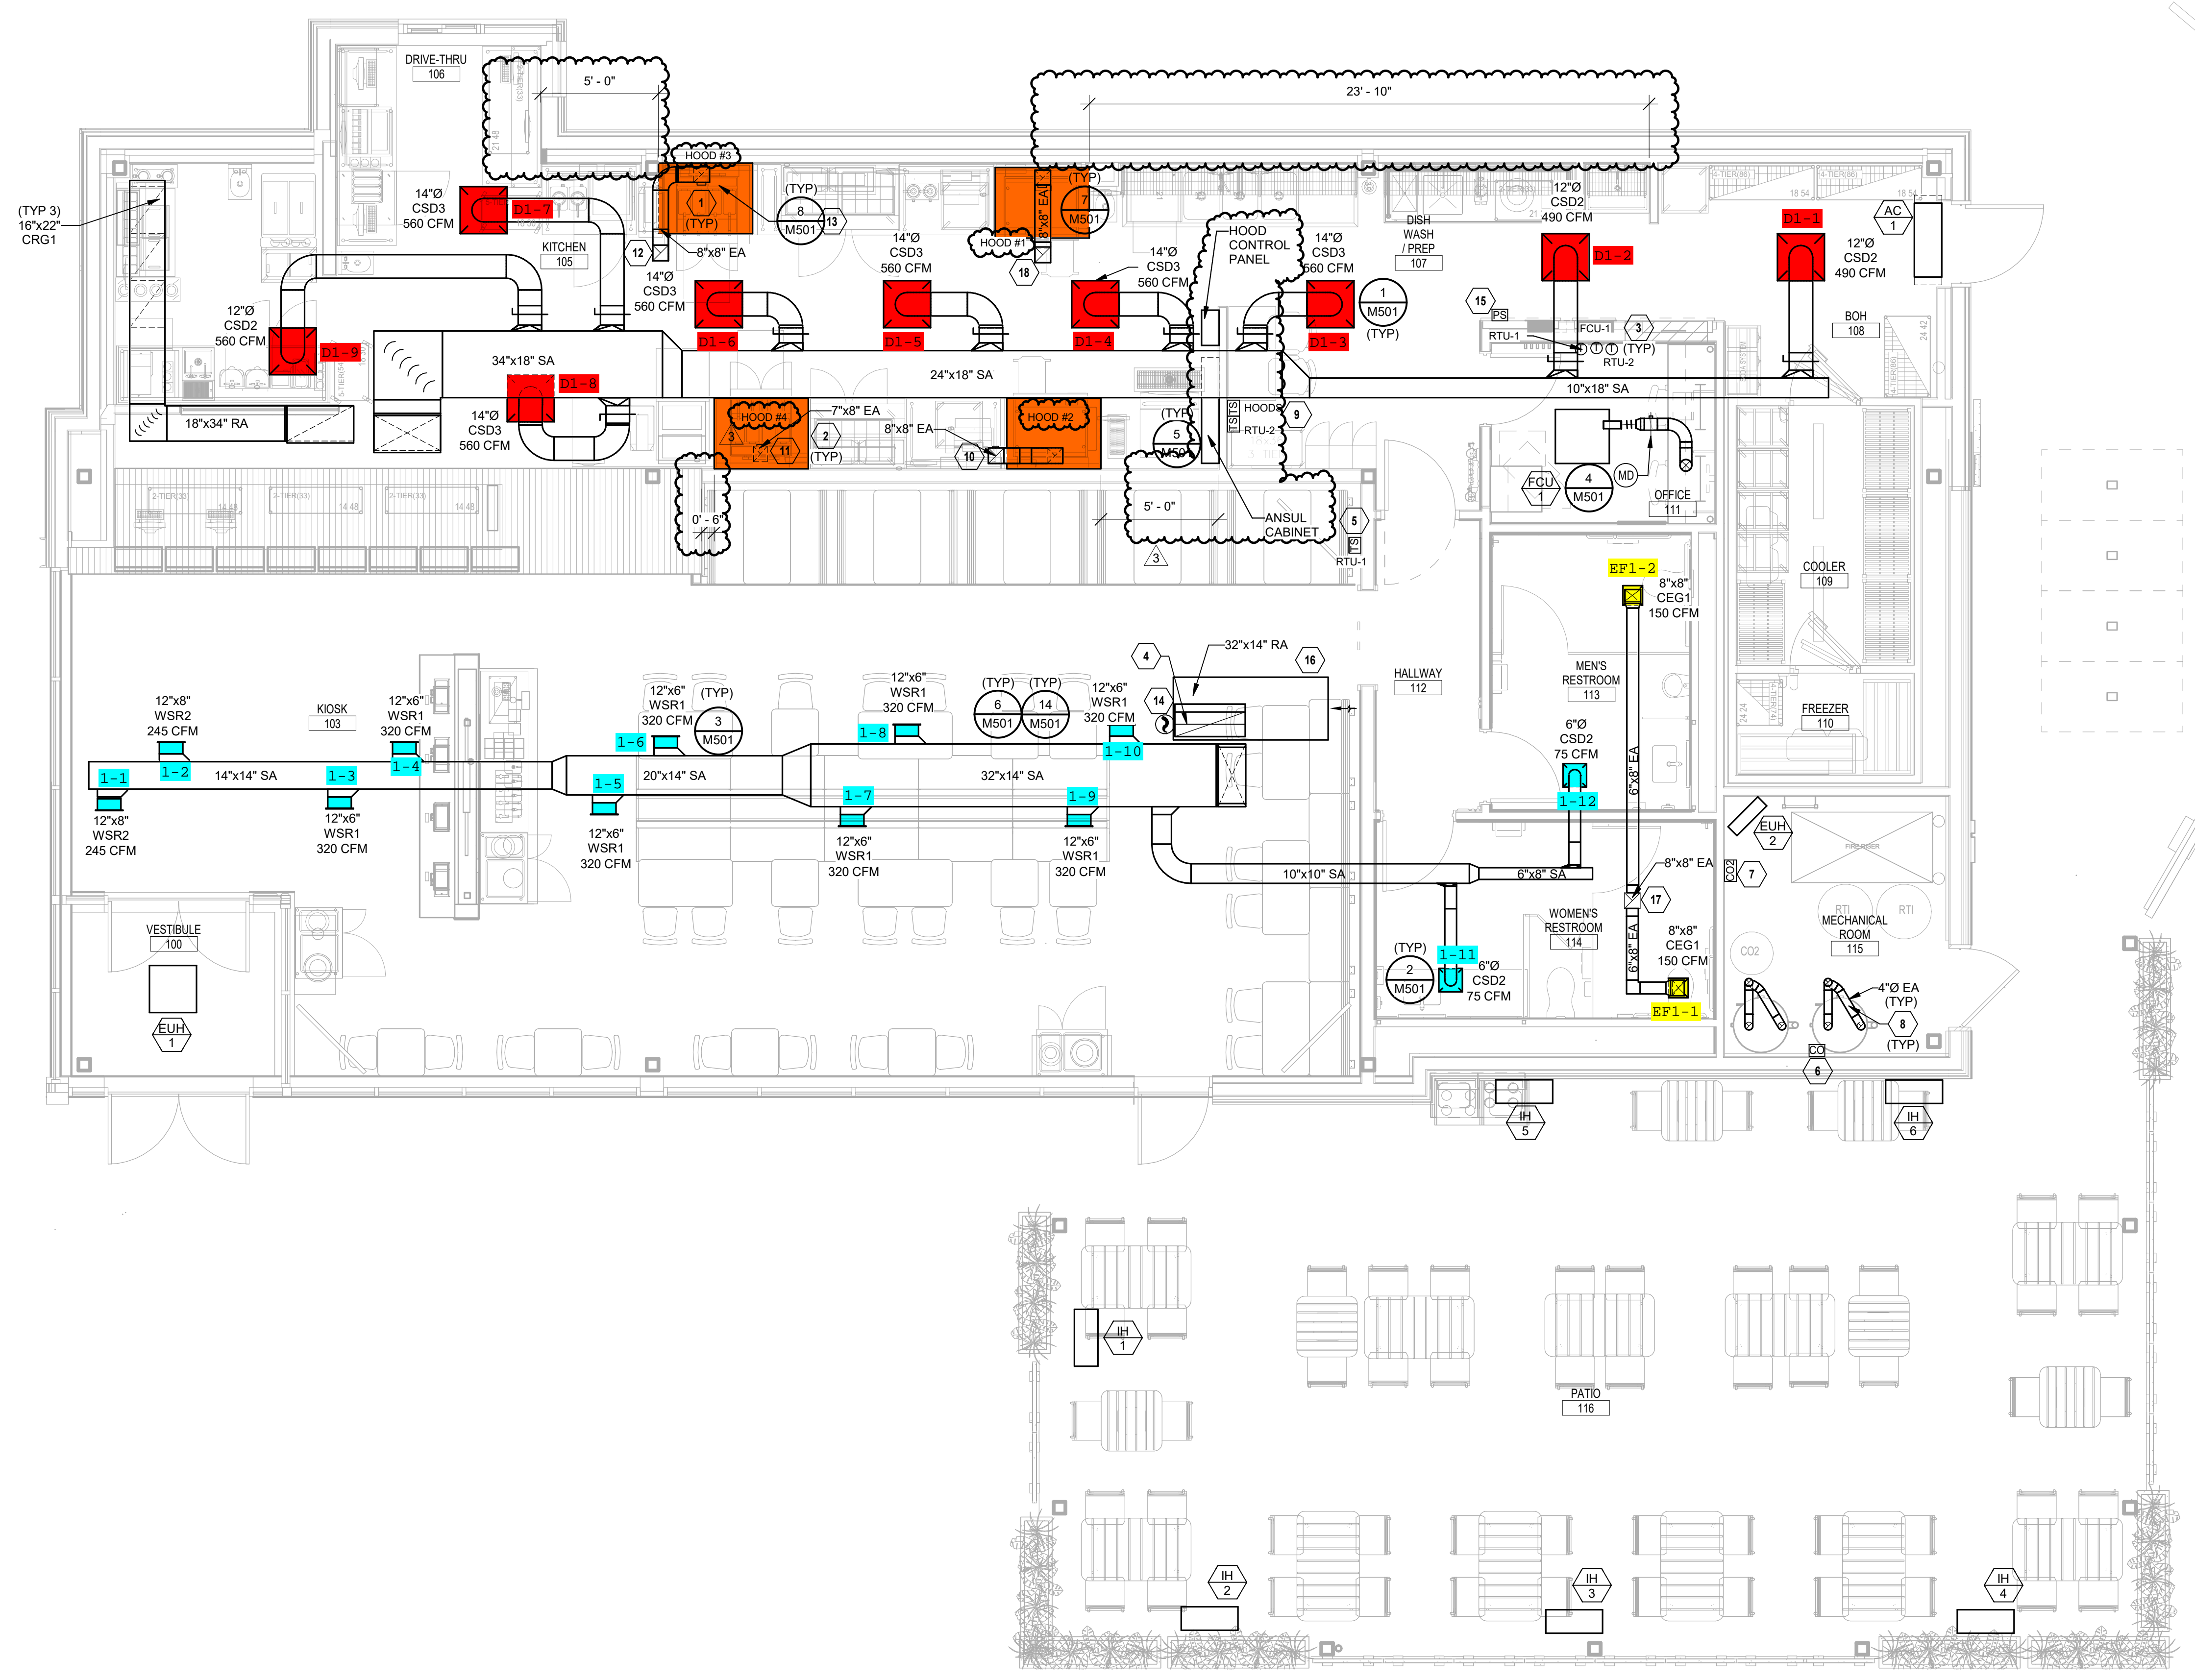


1 MECHANICAL FLOOR PLAN
1/4" = 1'-0"

ALL GREASE DUCT TO BE WATER TESTED BY ENVIROMATIC AT MECHANICAL CONTRACTOR'S EXPENSE. CONTACT OWNER'S NATIONAL ACCOUNT VENDOR:
ENVIROMATIC
DON PFLEDERER
1.800.325.8476
inspections@enviromatic.com

THE BUILDINGS HVAC SYSTEMS SHALL BE BALANCED BY NATIONAL TAB (NO EXCEPTIONS) AND CONTRACTED BY THE GENERAL CONTRACTOR.
CONTACT:
WILL TURNBOUGH
will@nationaltab.com
855-682-6822 ext704

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDING REVIEW SET

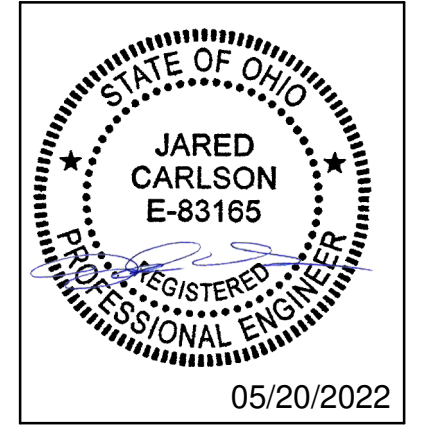

Drawing Title
MECHANICAL FLOOR PLAN

Job No. 2150002415
Drawn AJP

Scale 1/4" = 1'-0"
Date 11/12/2021


Sheet No.
M101

MECHANICAL GENERAL NOTES:

1. ALL VENT STACKS SHALL BE NO LESS THAN 12" FROM PARAPET, AT LEAST 10 FEET FROM OUTSIDE AIR INTAKES, AND ABOVE ROOF SURFACE 6" MINIMUM TO FULL HEIGHT OF PARAPET, WHICHEVER IS GREATER. CONTRACTOR SHALL PROVIDE BRACING AS SPECIFIED.
2. COORDINATE EXACT EQUIPMENT LOCATIONS WITH OTHER TRADES PRIOR TO INSTALLATION.
3. REFER TO SHEET M001 FOR ADDITIONAL GENERAL NOTES.
4. REFER TO DETAILS AND SCHEDULES SHEETS FOR FURTHER INFORMATION.

MECHANICAL PLAN NOTES:

1. MAINTAIN ALL OUTSIDE AIR INTAKES A MINIMUM OF 10'-0" RADIUS FROM EXHAUST, TYPICAL.
2. TURN DOWN Ø" INTAKE AND END OPEN OVER ROOF (MIN. 24") WITH INSECT SCREEN.
3. CONTRACTOR SHALL VERIFY WITH EQUIPMENT SUPPLIER EXACT ROUTING AND SIZE OF INSULATED REFRIGERANT PIPING. SINGLE LINESET SHOWN FOR CLARITY. INSTALL PER MANUFACTURERS RECOMMENDATIONS.
4. REFER TO CAPTIVE AIRE DRAWINGS FOR INFORMATION REGARDING KITCHEN EXHAUST FANS.
5. PROVIDE EQUIPMENT WITH NATIONAL TAB UV-PHI INDOOR AIR PURIFICATION SYSTEM, MODEL PHI-PK6-24V. INSTALL IN UNIT BLOWER COMPARTMENT PER MANUFACTURERS INSTRUCTIONS.

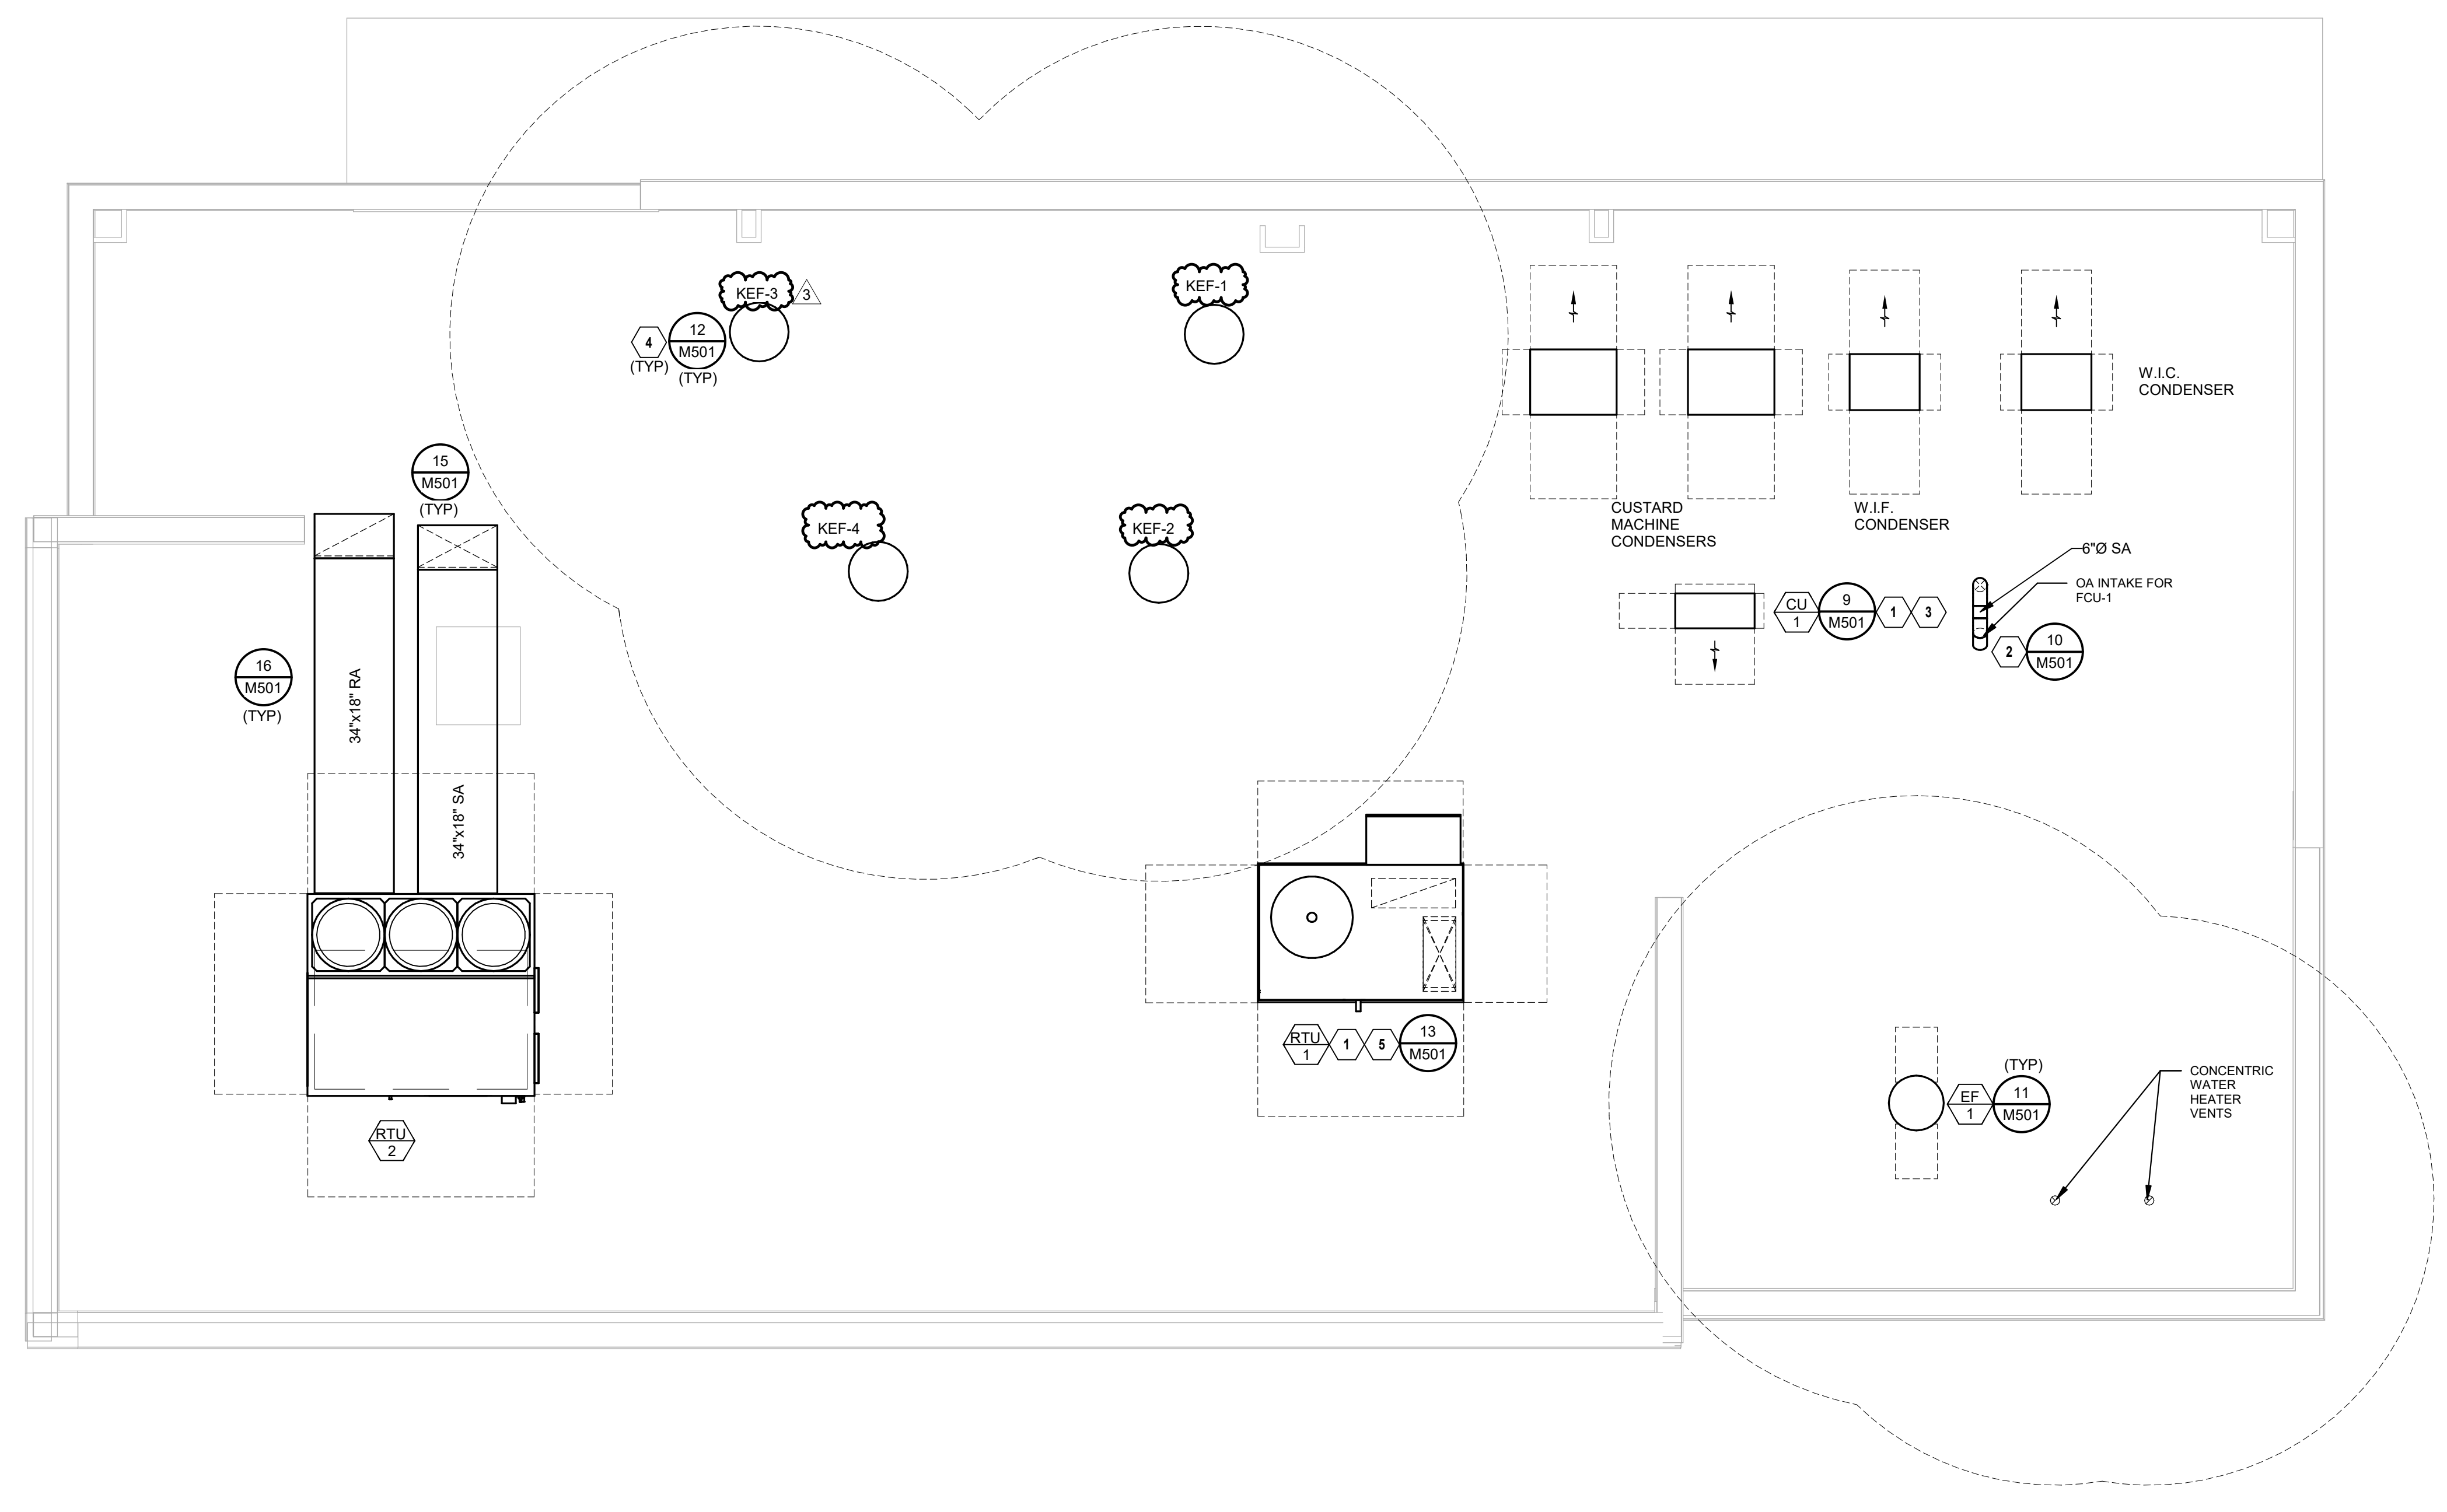


1 MECHANICAL ROOF PLAN
1/4" = 1'-0"

SHAKE SHACK
W DUBLIN GRANDVILLE RD, OH

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

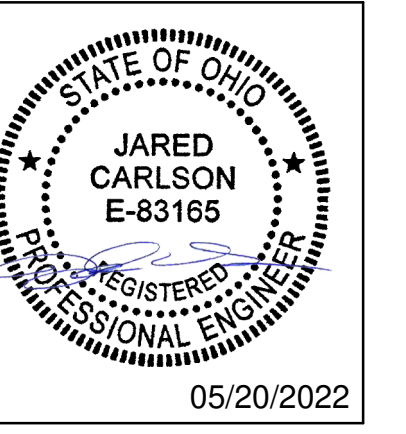


Drawing Title
MECHANICAL ROOF PLAN

Job No. 2150002415
Drawn AJP


Scale 1/4" = 1'-0"
Date 11/12/2021

Sheet No.
M150

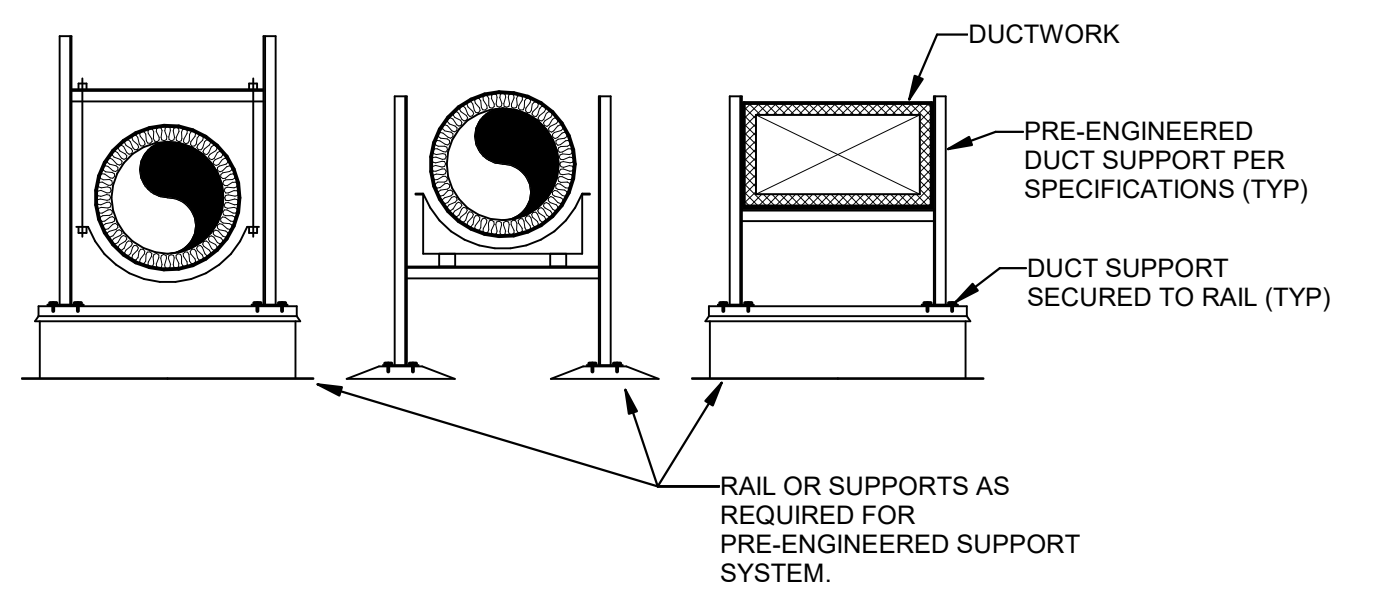


NOTES:
 1. DUCT SUPPORTS SHALL BE PRE-ENGINEERED SUPPORT PRODUCT BY APPROVED MANUFACTURER. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS FOR DUCT SUPPORTS, ANCHORING, AND SEISMIC/WIND RESISTANCE.
 2. DUCTWORK SHALL REST ON OR BE ATTACHED TO SUPPORTS AS REQUIRED BY INSTALLATION REQUIREMENTS PER MANUFACTURER.

16 ROOF MOUNTED DUCT SUPPORT DETAIL
 NTS

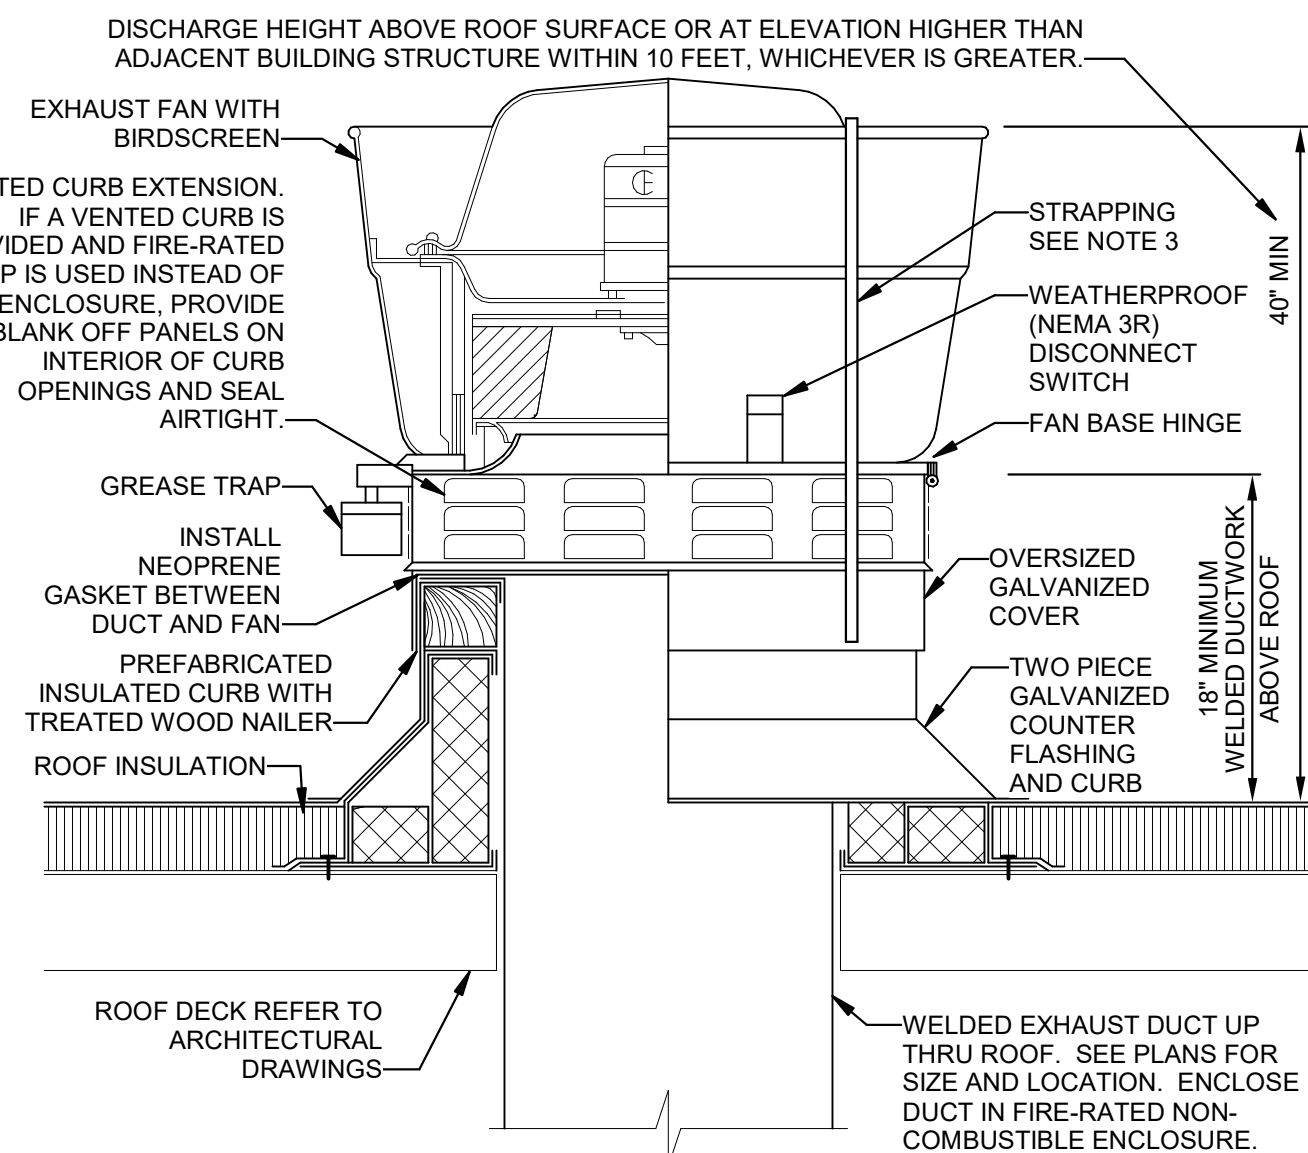


NOTES:
 1. SCREW FAN BASE INTO CURB WITH QUANTITY AND LENGTH SUFFICIENT TO WITHSTAND HURRICANE WIND SPEED PER LOCAL CODE.
 2. PROVIDE SPACER BETWEEN FAN BASE AND CURB AS REQUIRED TO AVOID DAMAGE TO FAN BASE.
 3. PROVIDE STAINLESS STEEL STRAPPINGS WITH SPACING, THICKNESS, WIDTH, AND LENGTH SUFFICIENT TO WITHSTAND HURRICANE WIND SPEED PER LOCAL CODE. WRAP OVER FAN AND SECURELY ATTACH TO OPPOSITE SIDES OF CURB.
 4. PROVIDE WRAP SYSTEM WHERE APPROVED BY LOCAL CODES IN LIEU OF RATED ENCLOSURE OR CURB.

12 UPBLAST GREASE EXHAUST FAN DETAIL
 NTS

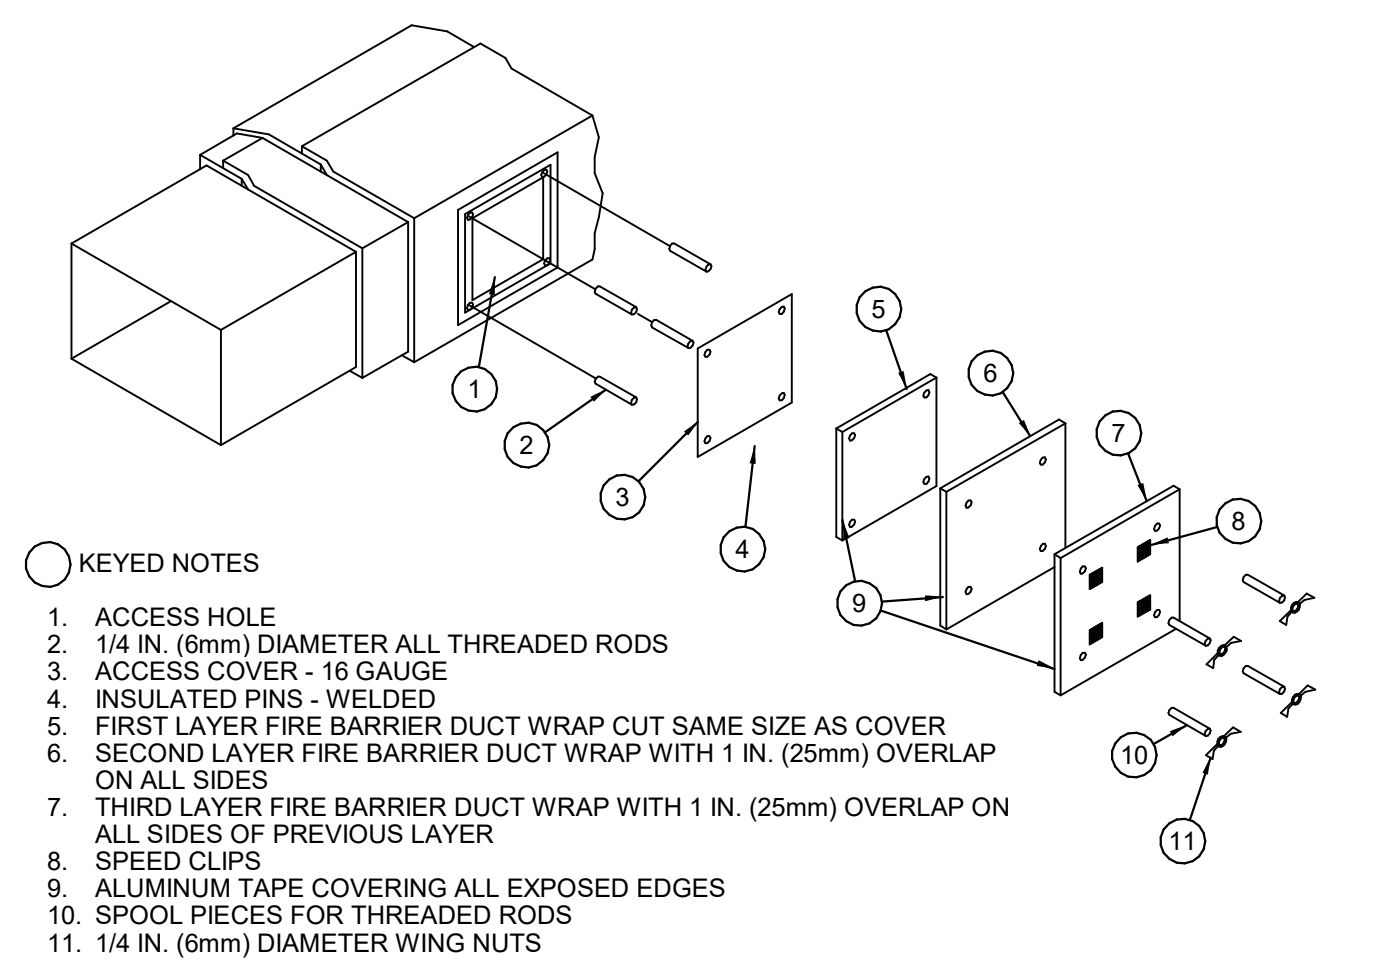


NOTES:
 1. FOR REFERENCE ONLY. INSTALL PER MANUFACTURER'S RECOMMENDATIONS.
 2. AT CONTRACTOR'S OPTION, A LISTED UL 1978 GREASE ACCESS DOOR PRODUCT MAY BE SUBSTITUTED FOR THE ACCESS DOOR PICTURED IN THIS DETAIL. DOOR SHALL BE RATED FOR UP TO 2,300' AND MEET NFPA96 STANDARDS. BOLTS SHALL BE LONG ENOUGH FOR DUCT WRAP SYSTEM (WHEN USED). INSTALL IN ACCORDANCE WITH MANUFACTURER'S LITERATURE.

8 GREASE DUCT CLEANOUT ACCESS DOOR DETAIL
 NTS

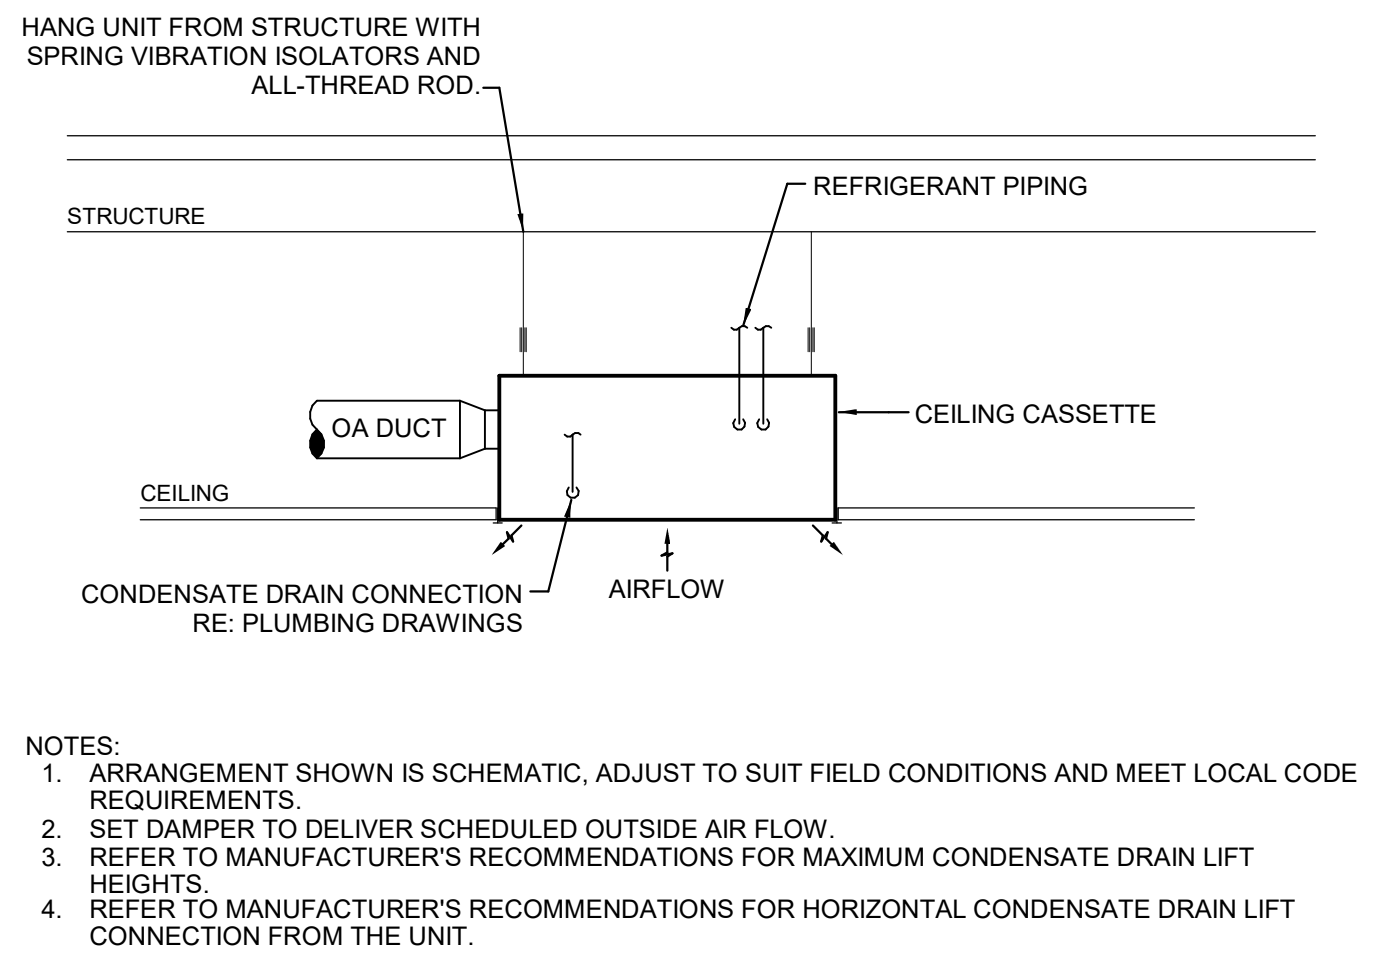


NOTES:
 1. ARRANGEMENT SHOWN IS SCHEMATIC, ADJUST TO SUIT FIELD CONDITIONS AND MEET LOCAL CODE REQUIREMENTS.
 2. SET DAMPER TO DELIVER SCHEDULED OUTSIDE AIR FLOW.
 3. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR MAXIMUM CONDENSATE DRAIN LIFT HEIGHTS.
 4. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR HORIZONTAL CONDENSATE DRAIN LIFT CONNECTION FROM THE UNIT.

4 CEILING CASSETTE DETAIL
 NTS

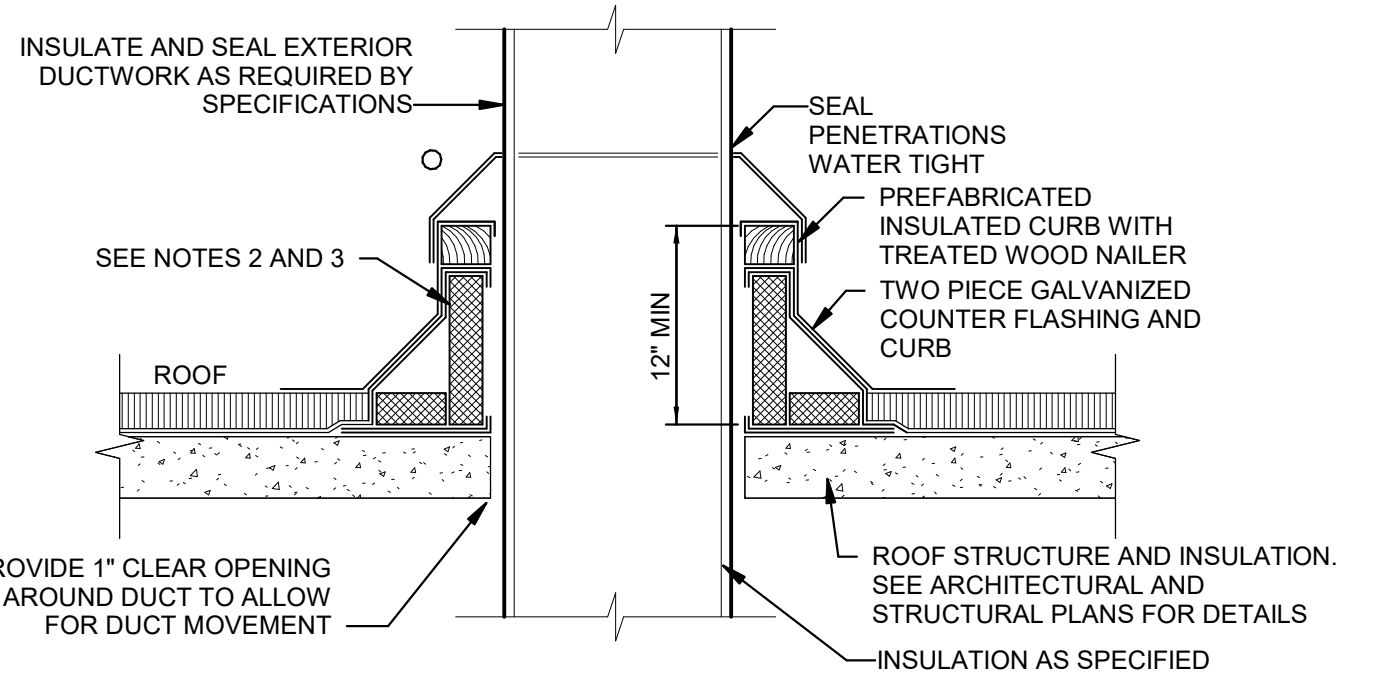


NOTES:
 1. ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT FIELD CONDITIONS AND MEET LOCAL CODE.
 2. PREFABRICATED INSULATED ROOF CURB WITH TREATED WOOD NAILER, CANT, AND STEP AS REQUIRED TO ACCOMMODATE ROOF INSULATION, FRAME AND SECURE CURB TO ROOF WITH METHOD CONSISTENT WITH ROOF CONSTRUCTION. ROOF CURB SHALL BEAR ON ROOF STRUCTURE. REFER TO ARCHITECTURAL DRAWINGS AND CURB MANUFACTURER'S DETAILS FOR MORE INFORMATION.
 3. FOR SLOPED ROOFS, PROVIDE CURB WITH DIMENSIONS CAPABLE OF COMPENSATING ROOF SLOPE TO ENSURE FAN IS INSTALLED LEVEL.

15 RECTANGULAR AIR DUCT PENETRATION THROUGH ROOF DETAIL
 NTS

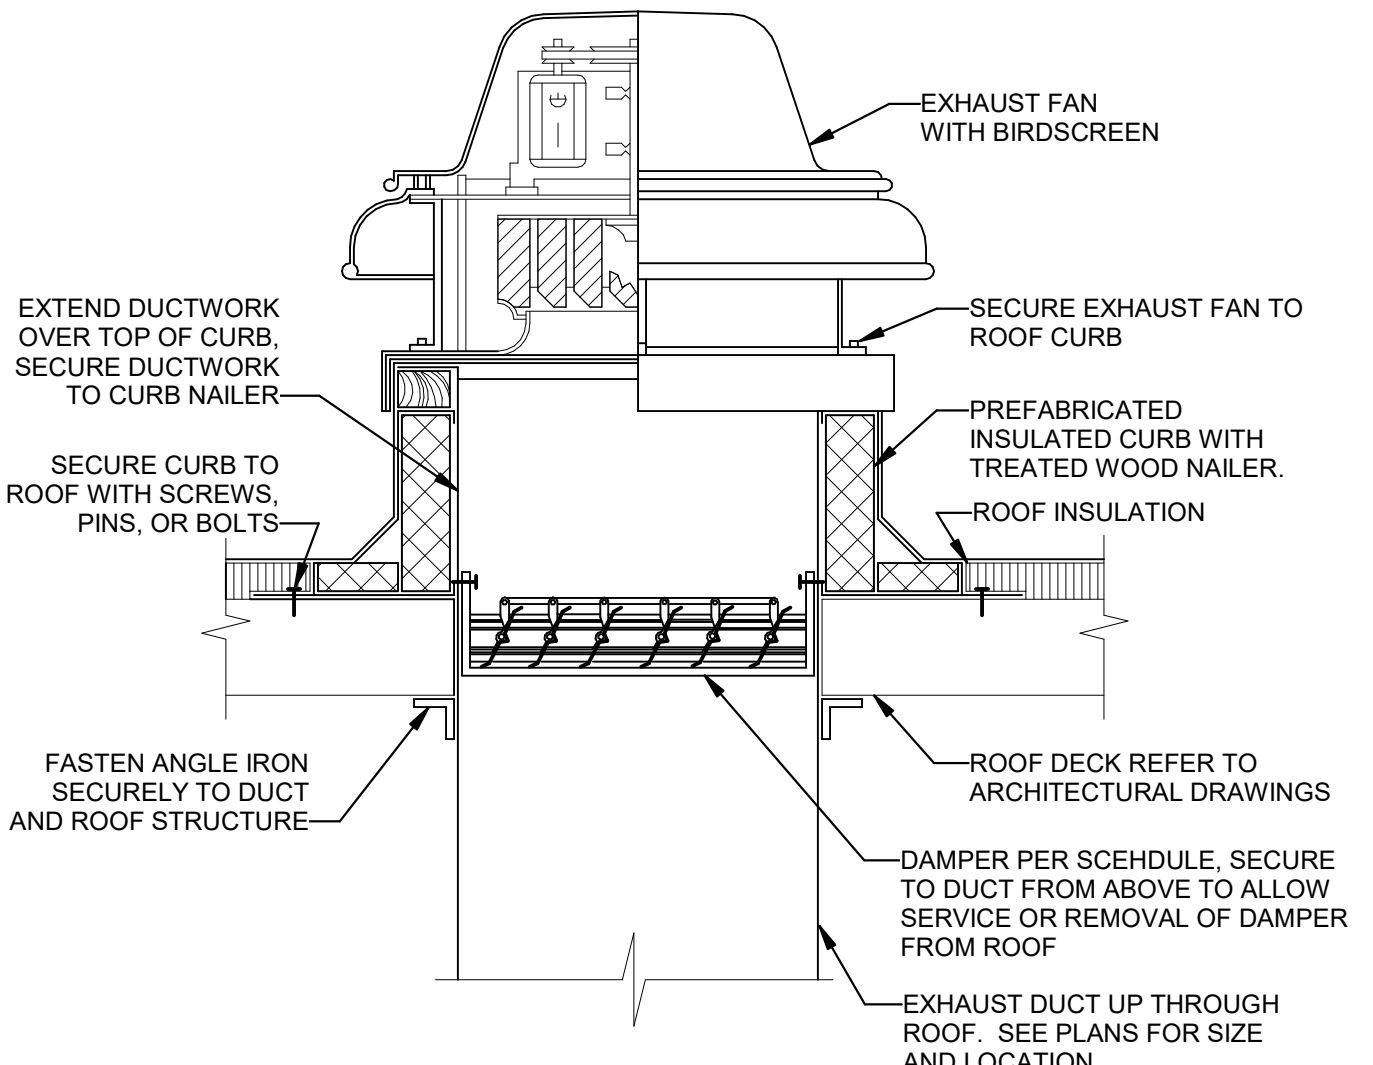


11 DOWNBLAST EXHAUST FAN DETAIL
 NTS

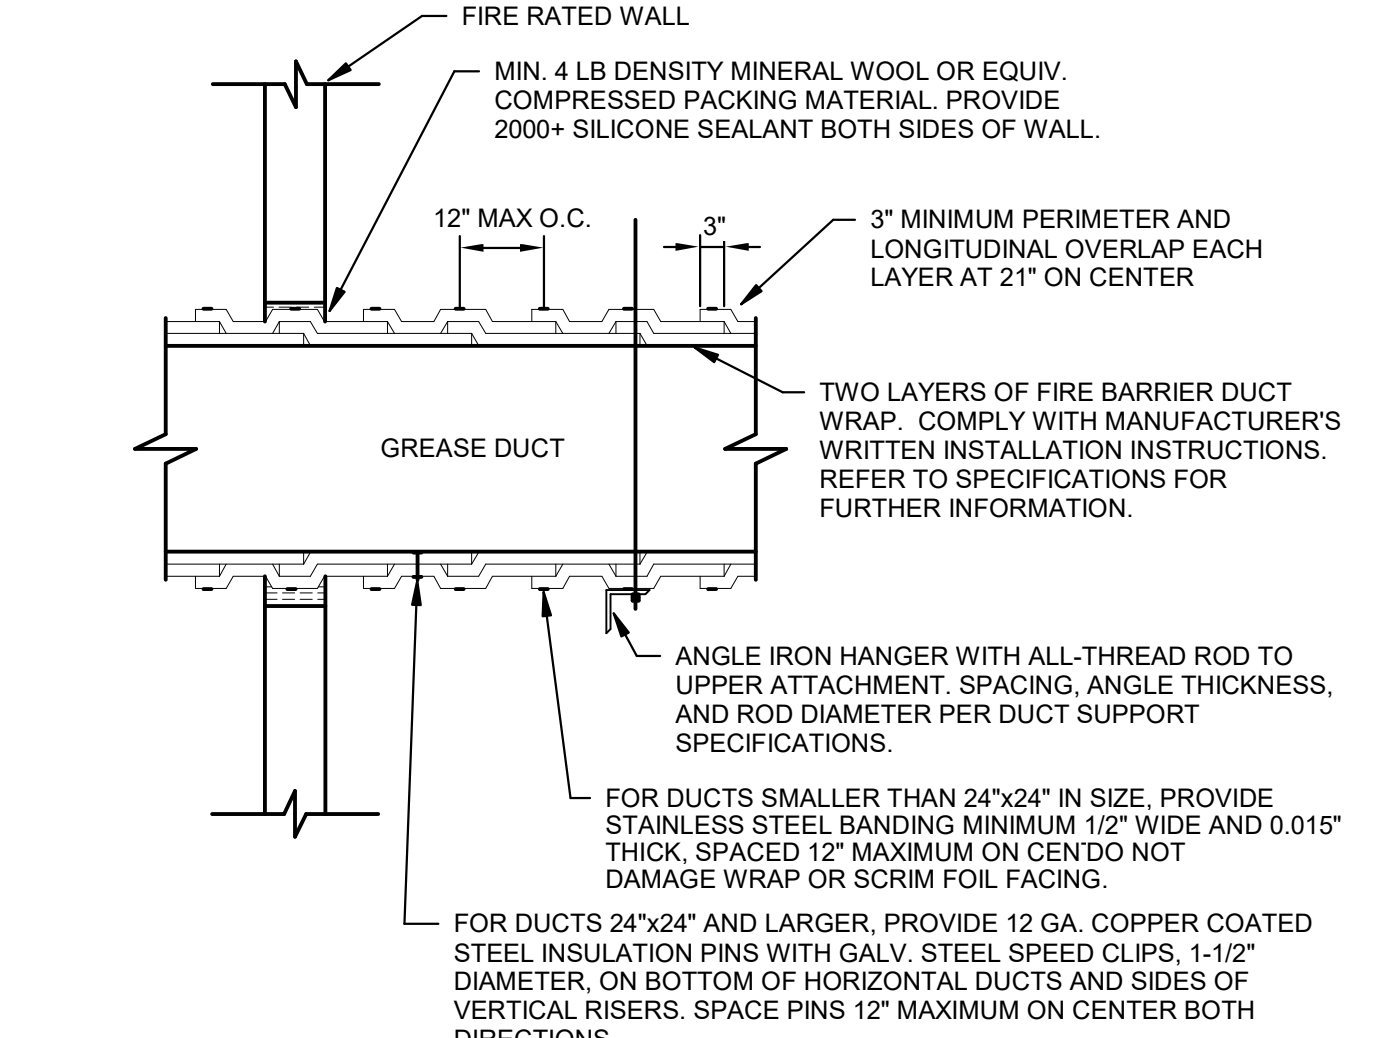


NOTES:
 1. INSTALL GREASE EXHAUST AND FIRE RATED DUCT WRAP IN ACCORDANCE WITH THE MANUFACTURER'S APPROVED INSTRUCTIONS AND UL LISTED INSTALLATION DETAILS. TECHNIQUES THAT DIFFER FROM THE ABOVE METHOD ARE ACCEPTABLE IF THEY ARE UL TESTED AND APPROVED.

7 GREASE DUCT FIRE WRAP INSULATION INSTALLATION DETAIL
 NTS

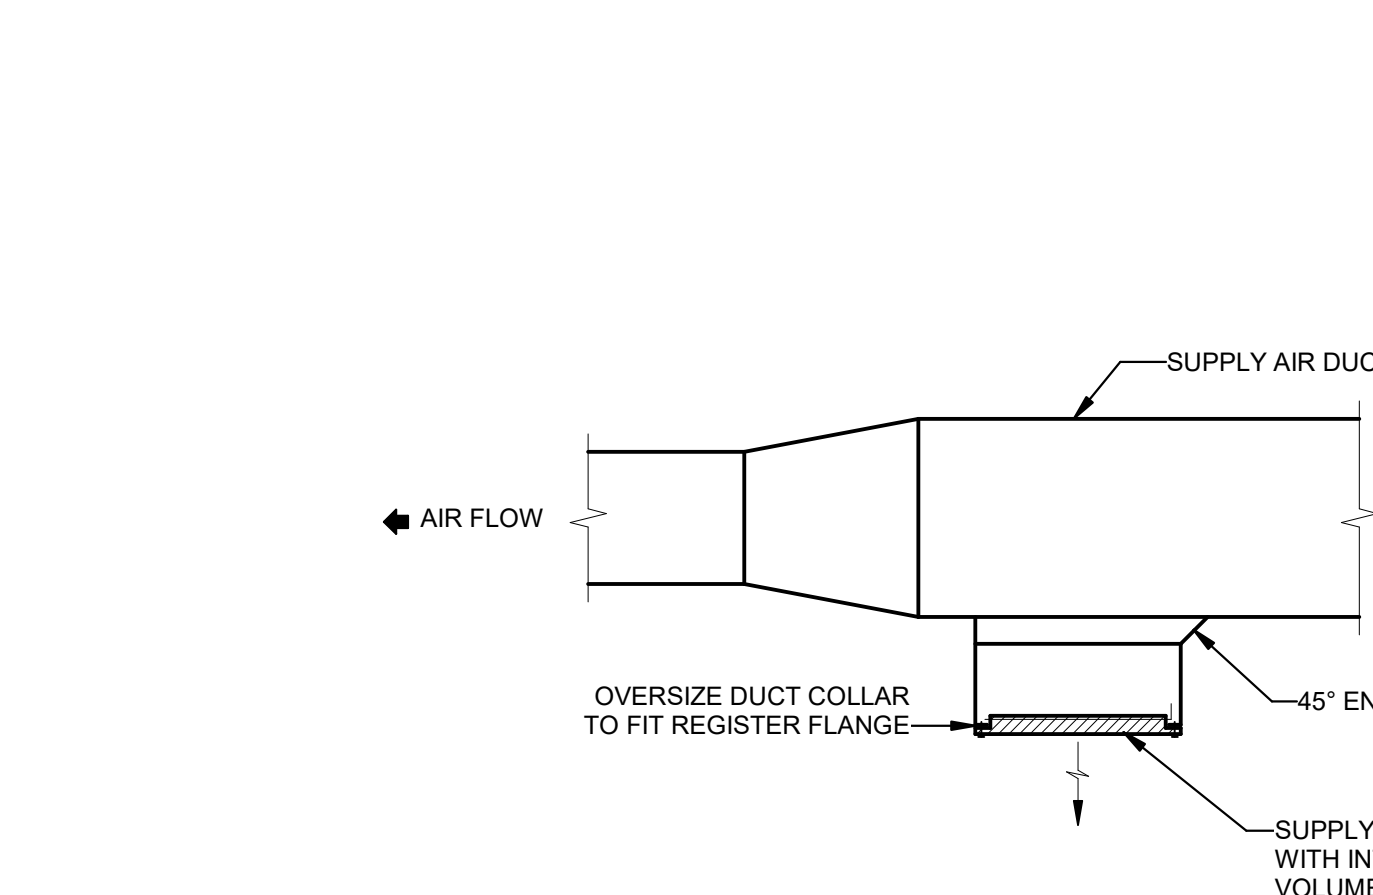


3 DUCT MOUNTED REGISTER DETAIL
 NTS

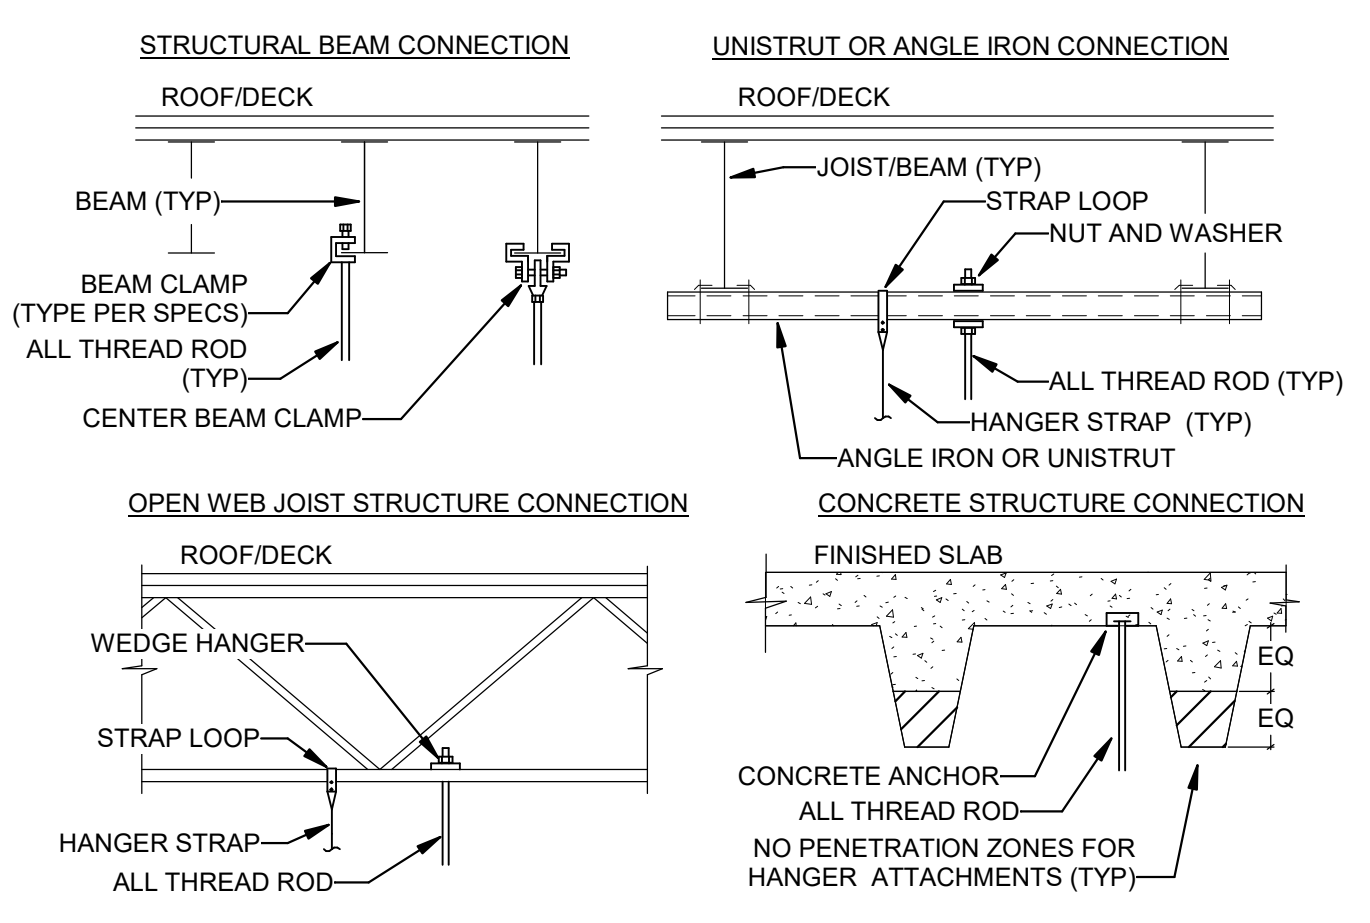


NOTES:
 1. ALL ATTACHMENTS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS AND SHALL BE APPROVED FOR THE SPECIFIC APPLICATION.
 2. COORDINATE ALL ATTACHMENTS WITH ARCHITECT AND STRUCTURAL ENGINEER.
 3. REFER TO SPECIFICATIONS FOR MORE INFORMATION ON APPROVED ATTACHMENT METHODS.
 4. REFER TO SPECIFICATIONS FOR REQUIREMENTS RELATING TO SEISMIC INSTALLATIONS.
 5. FOR OPEN WEB JOIST STRUCTURE, CONTRACTOR MAY HANG FROM TOP CHORD AND RUN DUCT AND PIPING THROUGH WEB JOIST WHEN APPROPRIATE. ANY CONCENTRATED LOADS NOT OCCURRING AT JOIST PANEL POINTS MUST BE REVIEWED BY A STRUCTURAL ENGINEER FOR FIELD INSTALLED PANEL BRACE REQUIREMENTS.

14 HANGER UPPER ATTACHMENT DETAILS
 NTS

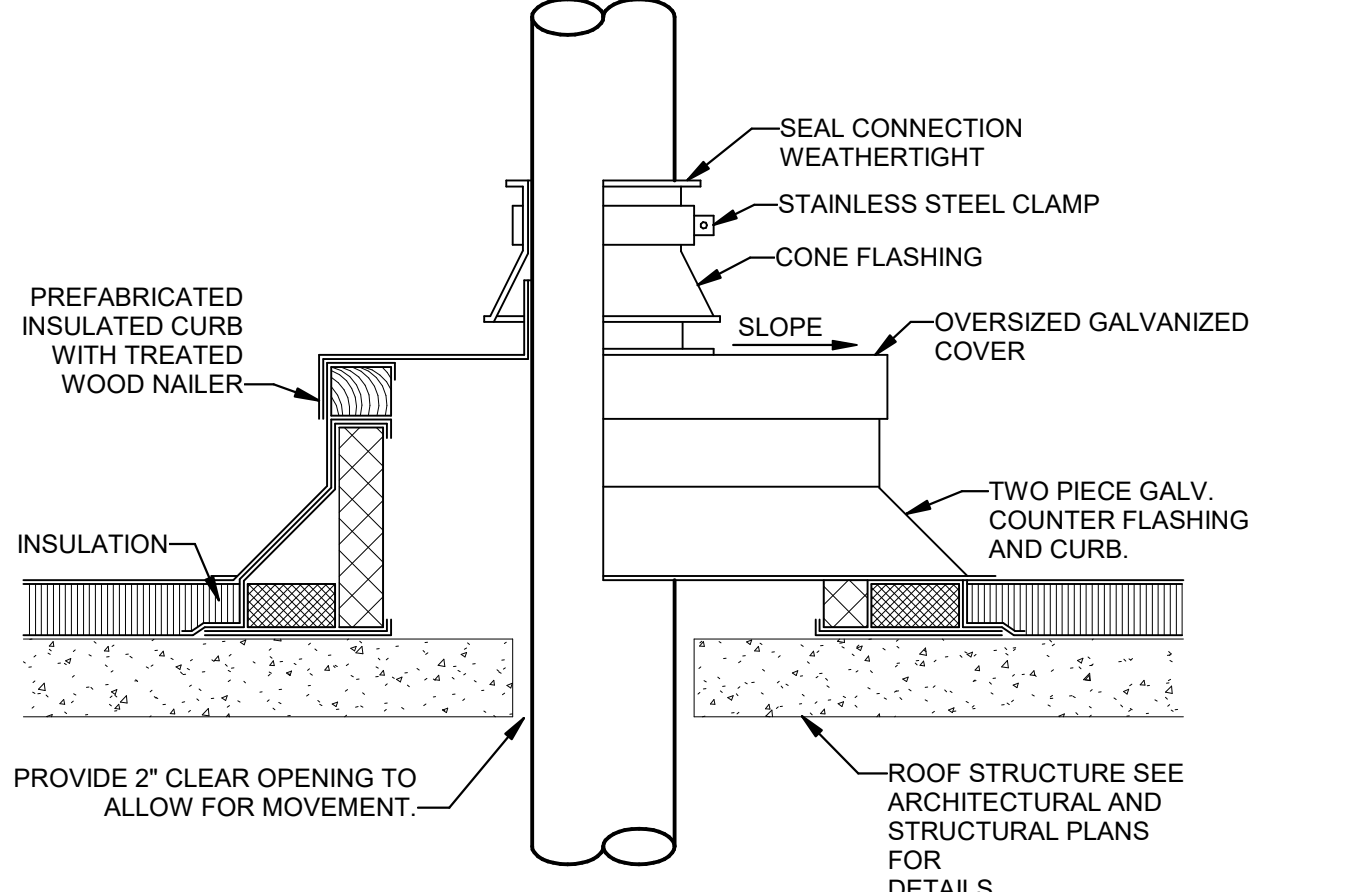


10 ROUND AIR DUCT OR PIPE PENETRATION THROUGH ROOF DETAIL
 NTS

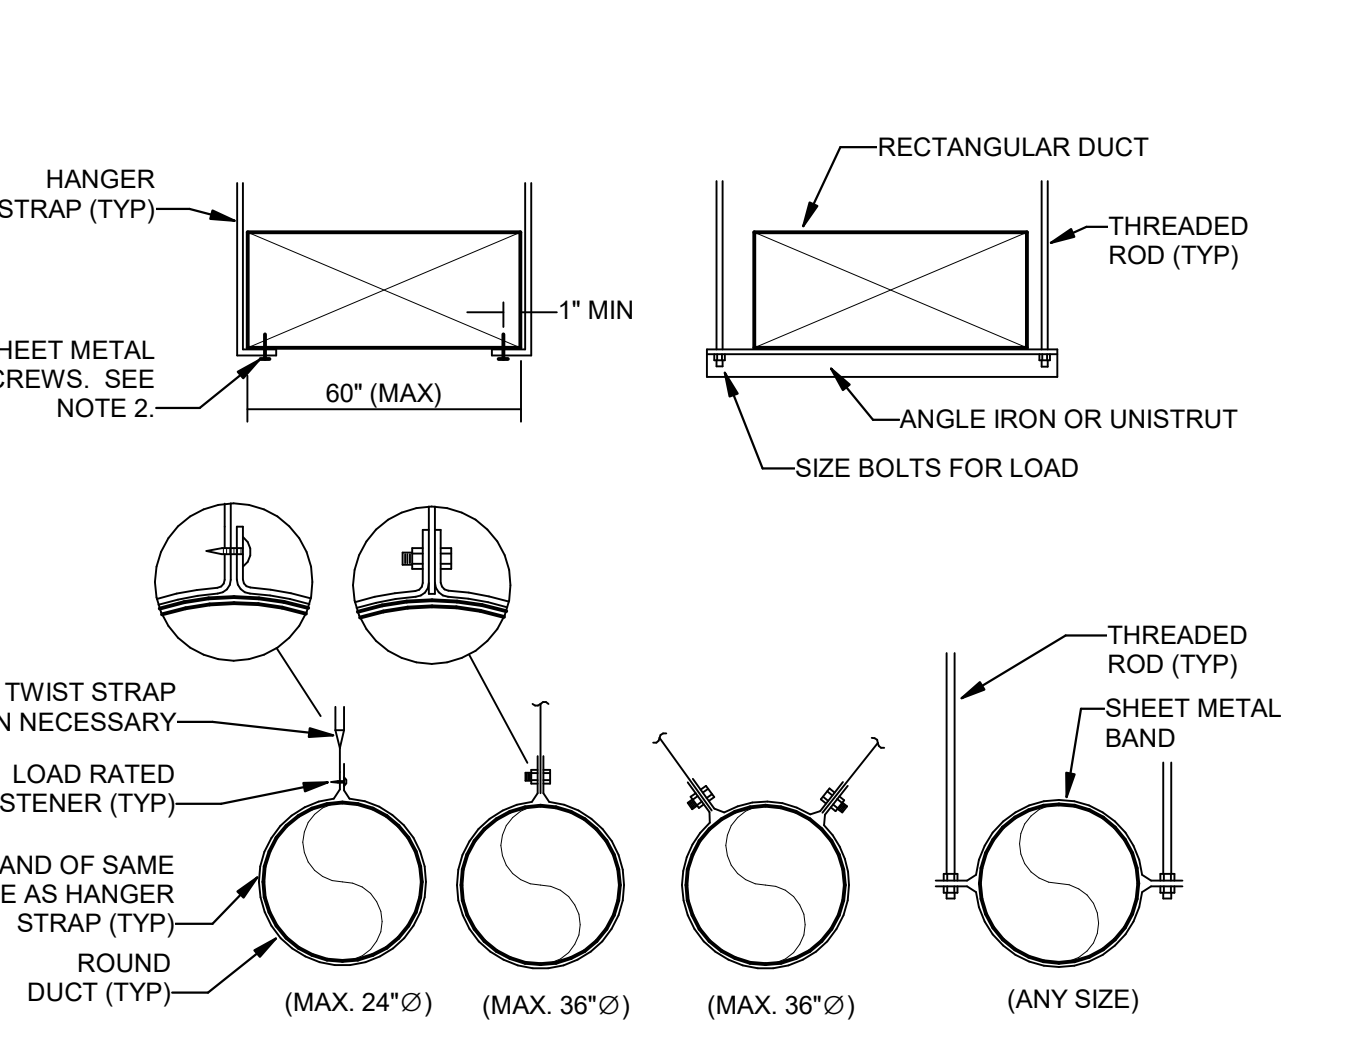


NOTES:
 1. USE THREADED ROD FOR RECTANGULAR DUCTS LARGER THAN 60\"/>

6 DUCT HANGER LOWER ATTACHMENT DETAILS
 NTS

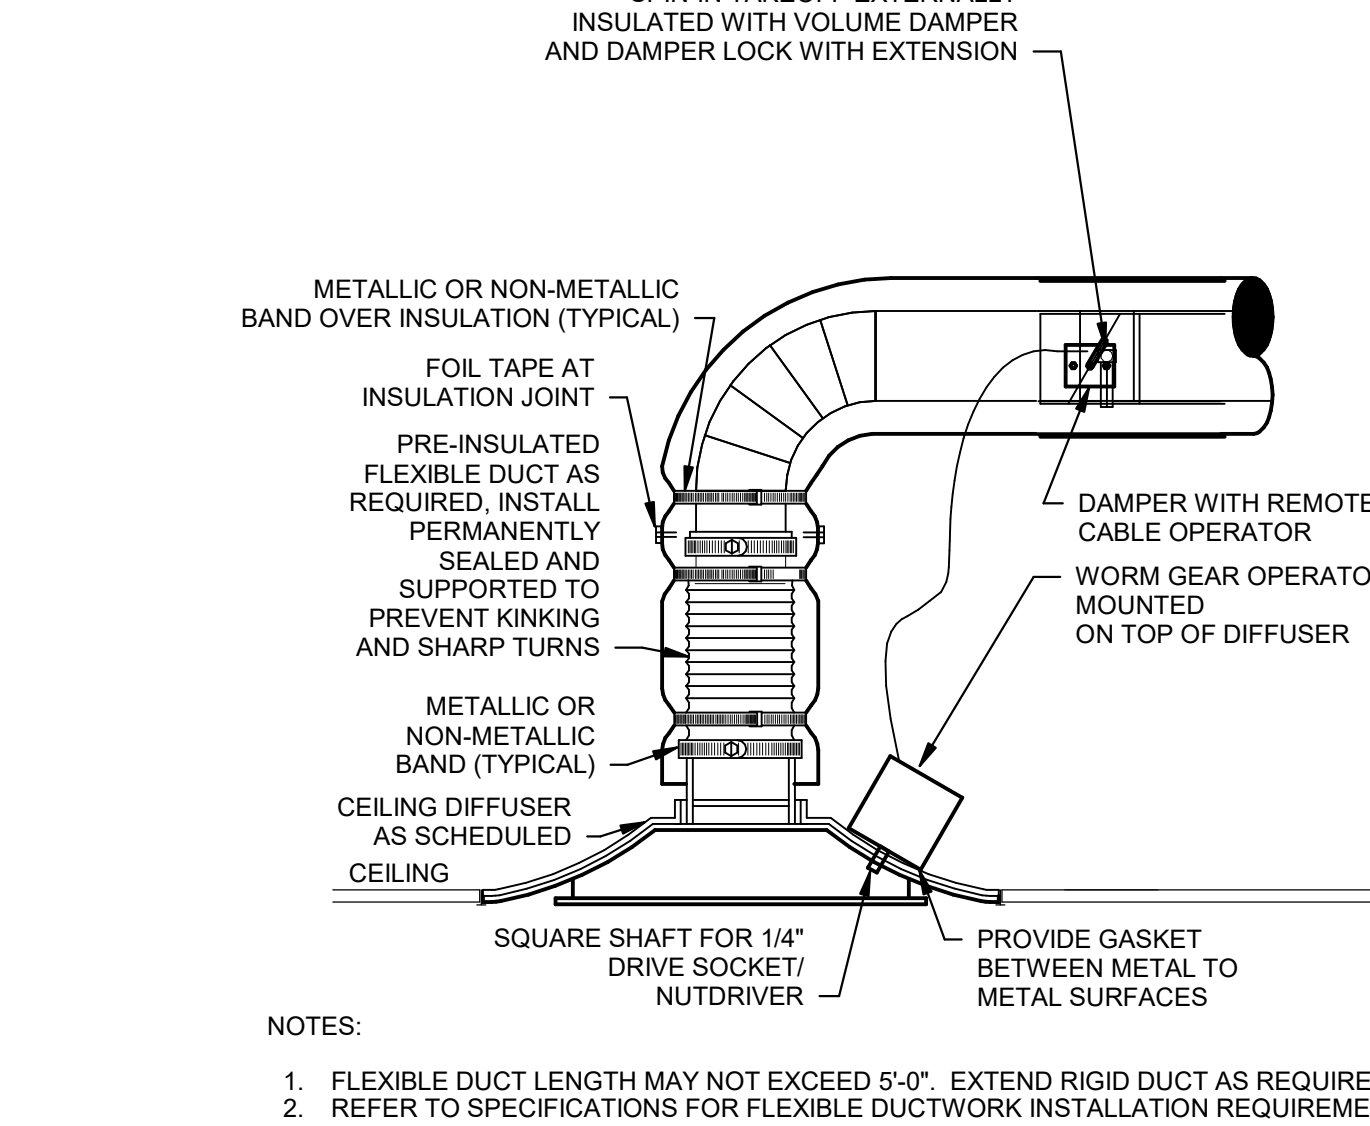


NOTES:
 1. FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0\"/>

2 HARD CEILING DIFFUSER DETAIL
 NTS

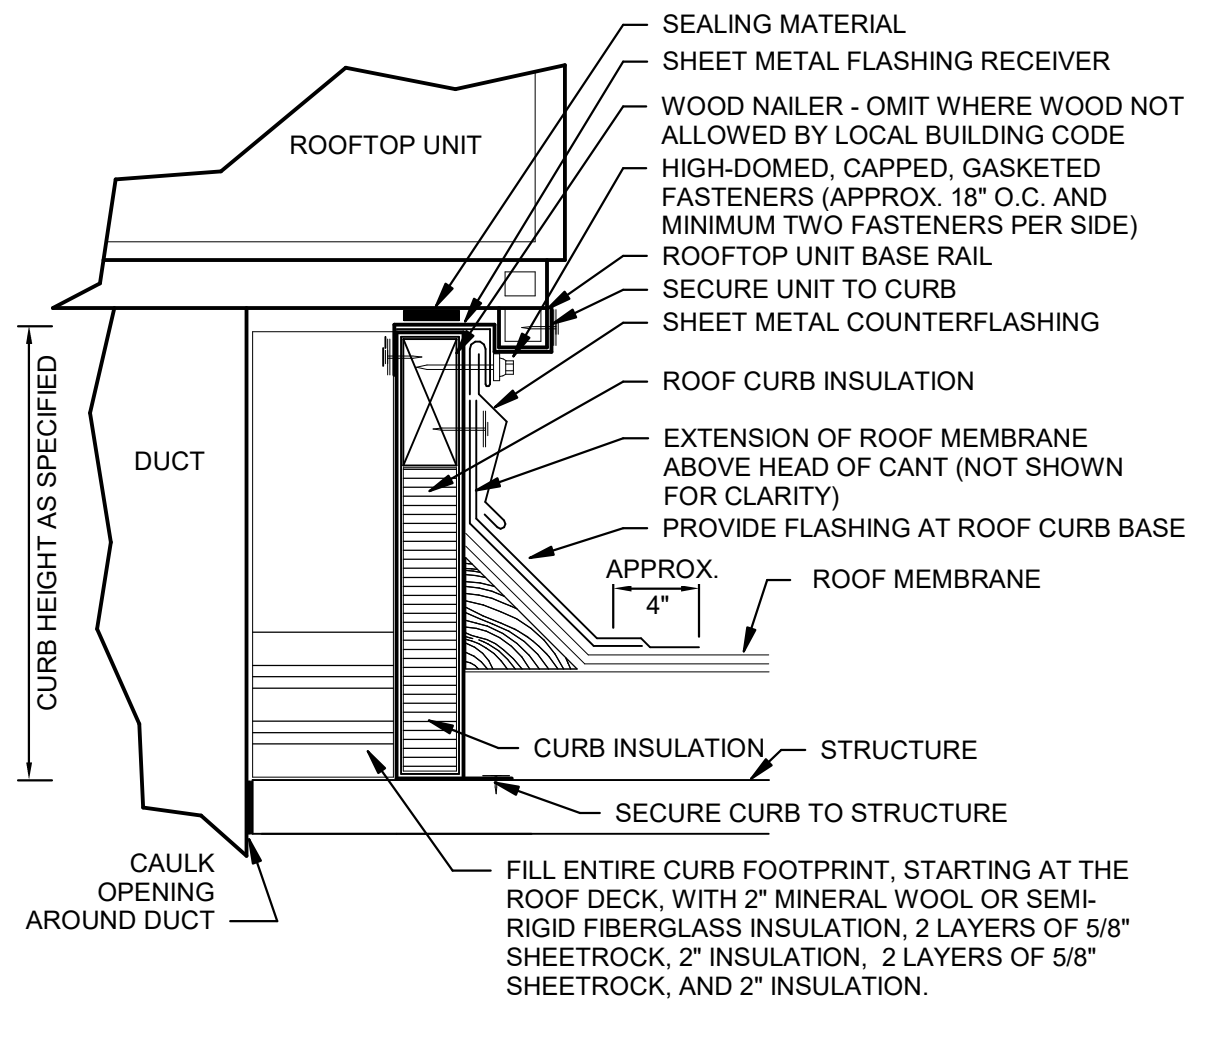


NOTES:
 1. CUT METAL DECKING TO ALLOW CURB INSTALLATION ON STEEL FRAMING. AFTER CURB IS SET IN PLACE, TRIM REMAINING METAL DECKING AND INSTALL WITHIN CURB. TACK WELD DECKING TO SUPPORT STEEL. DO NOT WELD INTERIOR DECKING TO ROOF CURB. PROVIDE ADDITIONAL CROSS FRAMING TO SUPPORT INTERIOR DECKING AND FILL MATERIAL AS REQUIRED.
 2. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS FOR ROOF CURBS, ANCHORING AND SEISMIC/WIND RESISTANCE.

13 ROOF CURB DETAIL
 NTS

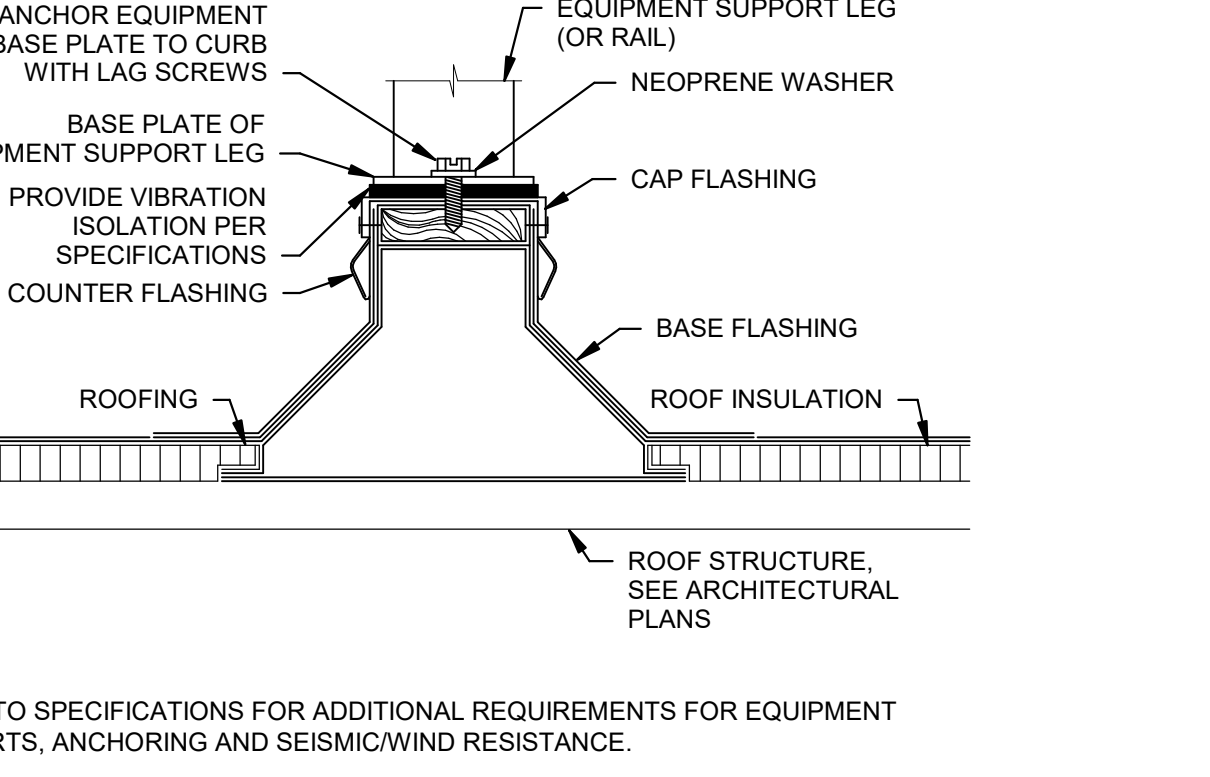


NOTES:
 1. REFER TO SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS FOR EQUIPMENT SUPPORTS, ANCHORING AND SEISMIC/WIND RESISTANCE.

9 ROOF EQUIPMENT SUPPORT RAIL DETAIL
 NTS

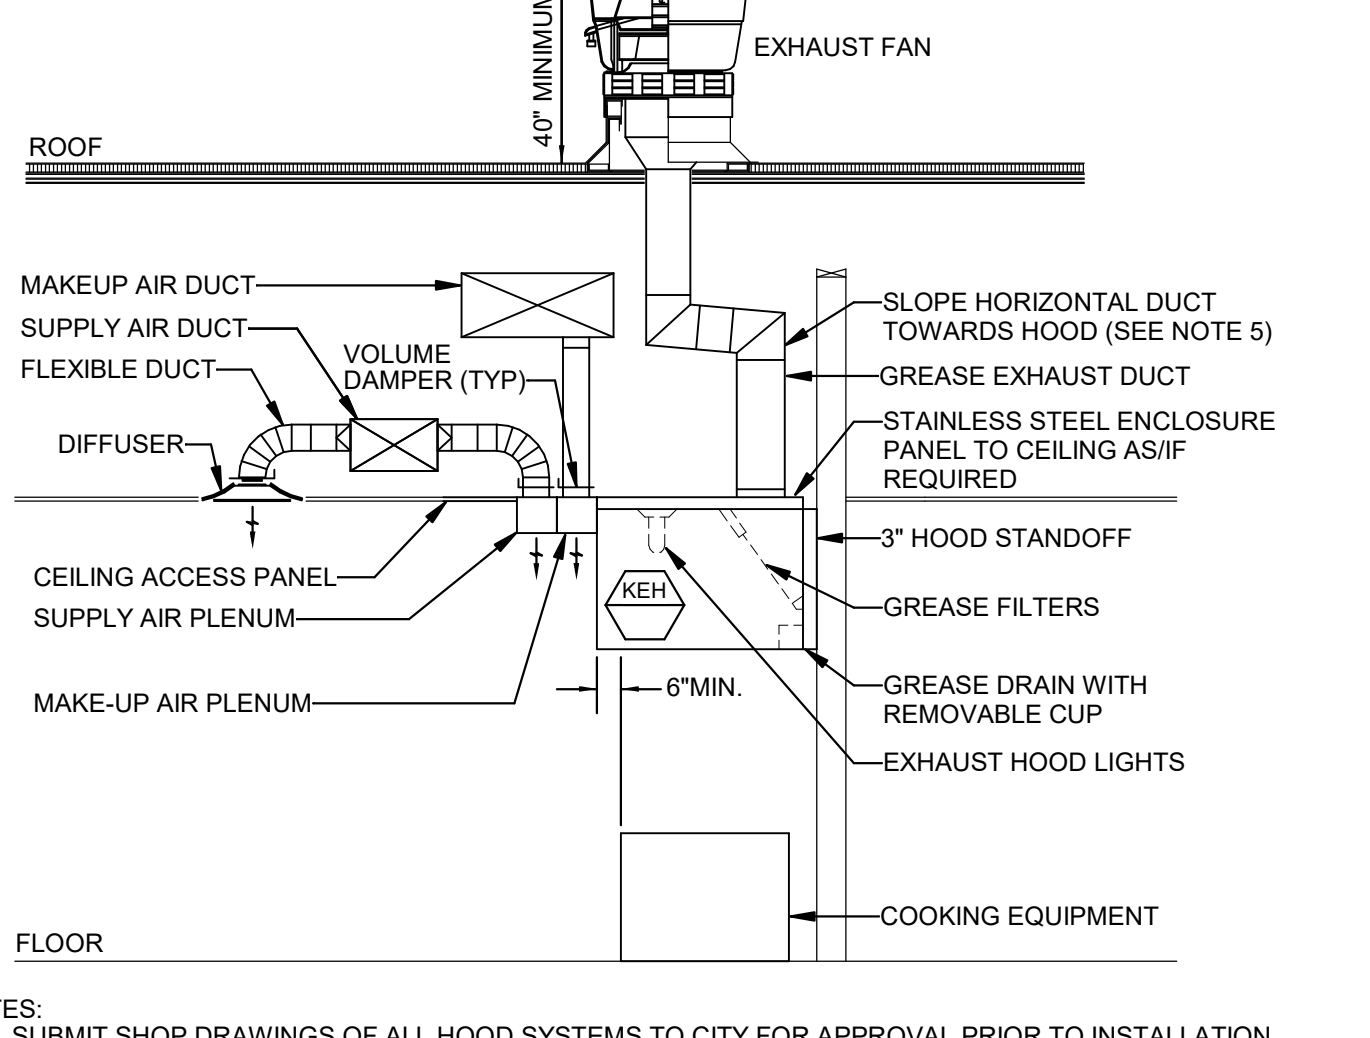

NOTES:
 1. SUBMIT SHOP DRAWINGS OF ALL HOOD SYSTEMS TO CITY FOR APPROVAL PRIOR TO INSTALLATION.
 2. TOTAL HOOD SYSTEM TO BE IN COMPLETE CONFORMANCE WITH NFPA, AND ALL LOCAL CODES AND REGULATIONS.
 3. COORDINATE ALL FIRE PROTECTION SYSTEMS WITH FIRE PROTECTION CONTRACTOR WHO SHALL ALSO BE RESPONSIBLE FOR ALL PERMITS AND TESTING REQUIRED.
 4. PROVIDE WRAP SYSTEM WHERE APPROVED BY LOCAL CODES IN LIEU OF RATED ENCLOSURE.
 5. PROVIDE ACCESS PANELS AS REQUIRED BY LOCAL CODE AND PER PLANS.
 6. HOODS SHALL EXTEND MINIMUM 6\"/>

5 KITCHEN EXHAUST HOOD ELEVATION DETAIL
 NTS

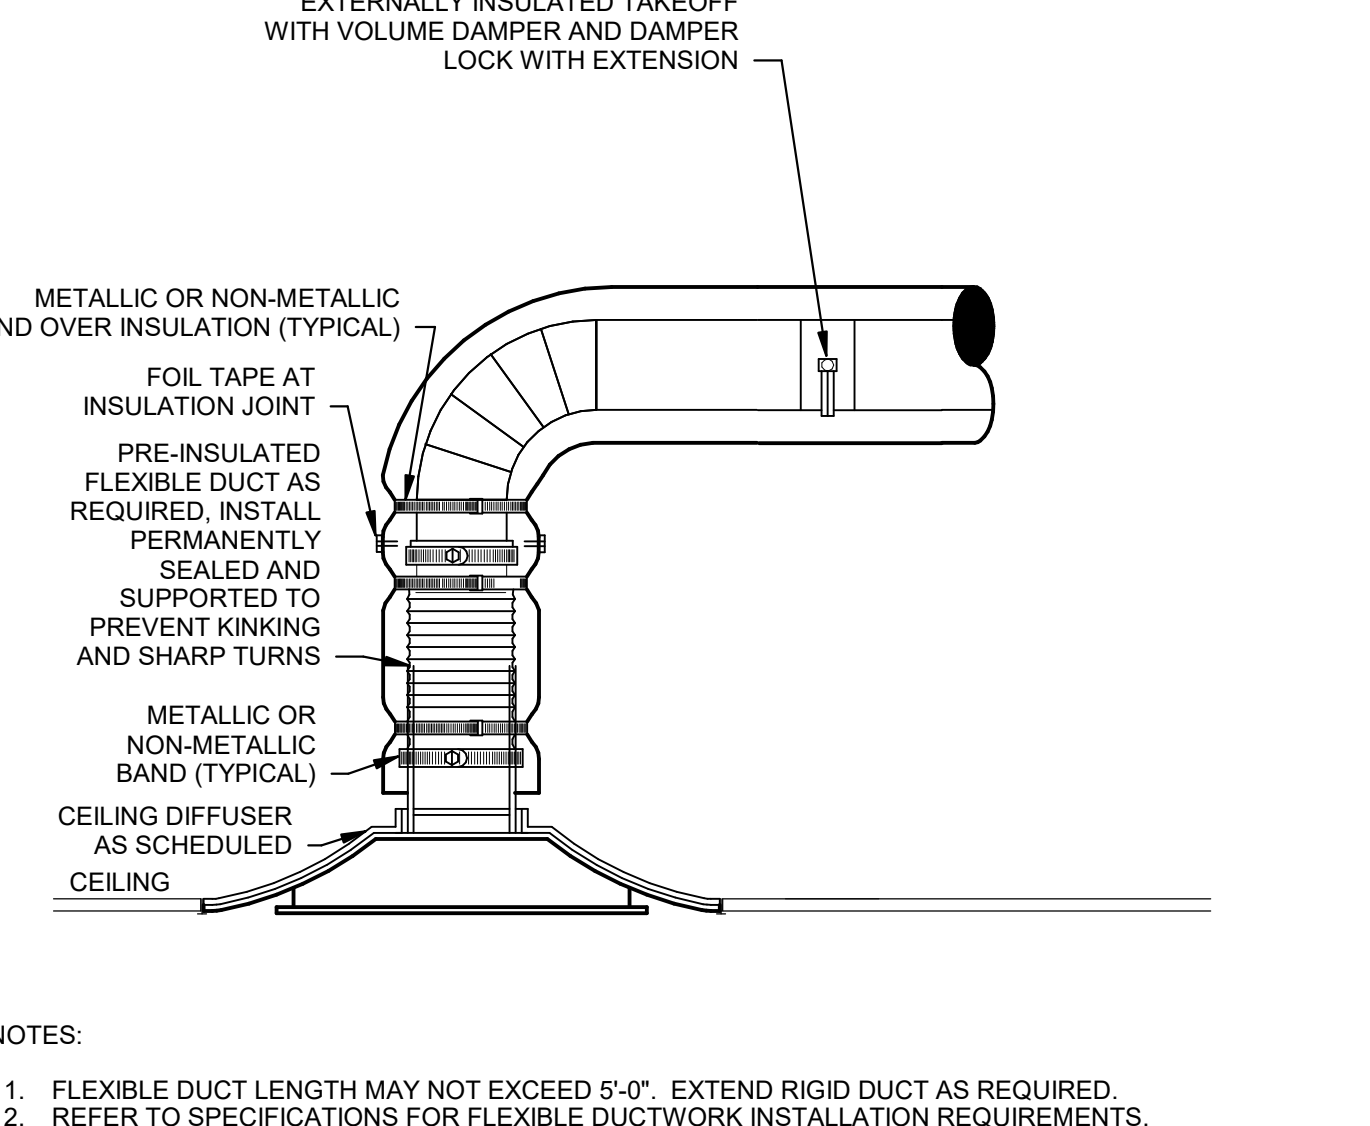


NOTES:
 1. FLEXIBLE DUCT LENGTH MAY NOT EXCEED 5'-0\"/>

1 LAY-IN CEILING DIFFUSER DETAIL
 NTS

FIELD VERIFICATION
 Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
 COPYRIGHT
 Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #1
1	01/14/2022	ADDENDUM #2
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

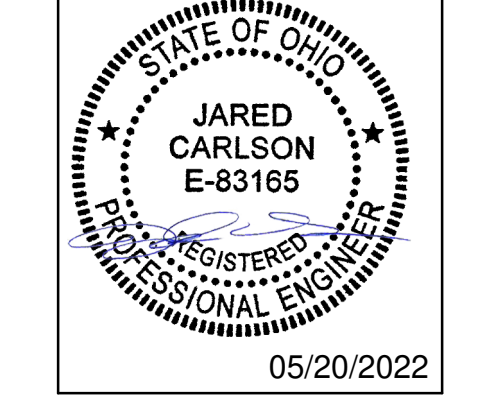

Drawing Title
MECHANICAL DETAILS


Job No. 2150002415 Drawn AJP

Scale N.T.S. Date 11/12/2021

Sheet No.
M501

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET




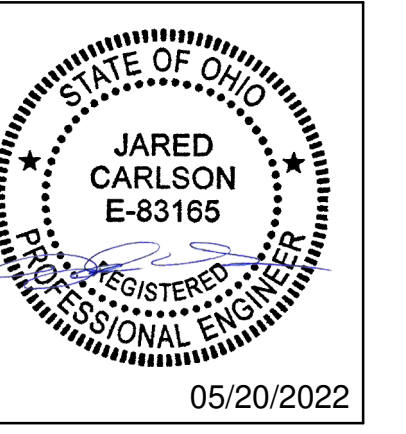


Drawing Title
MECHANICAL DETAILS

Job No. 2150002415
Drawn AJP

Scale N.T.S.
Date 11/12/2021

Sheet No.
M502

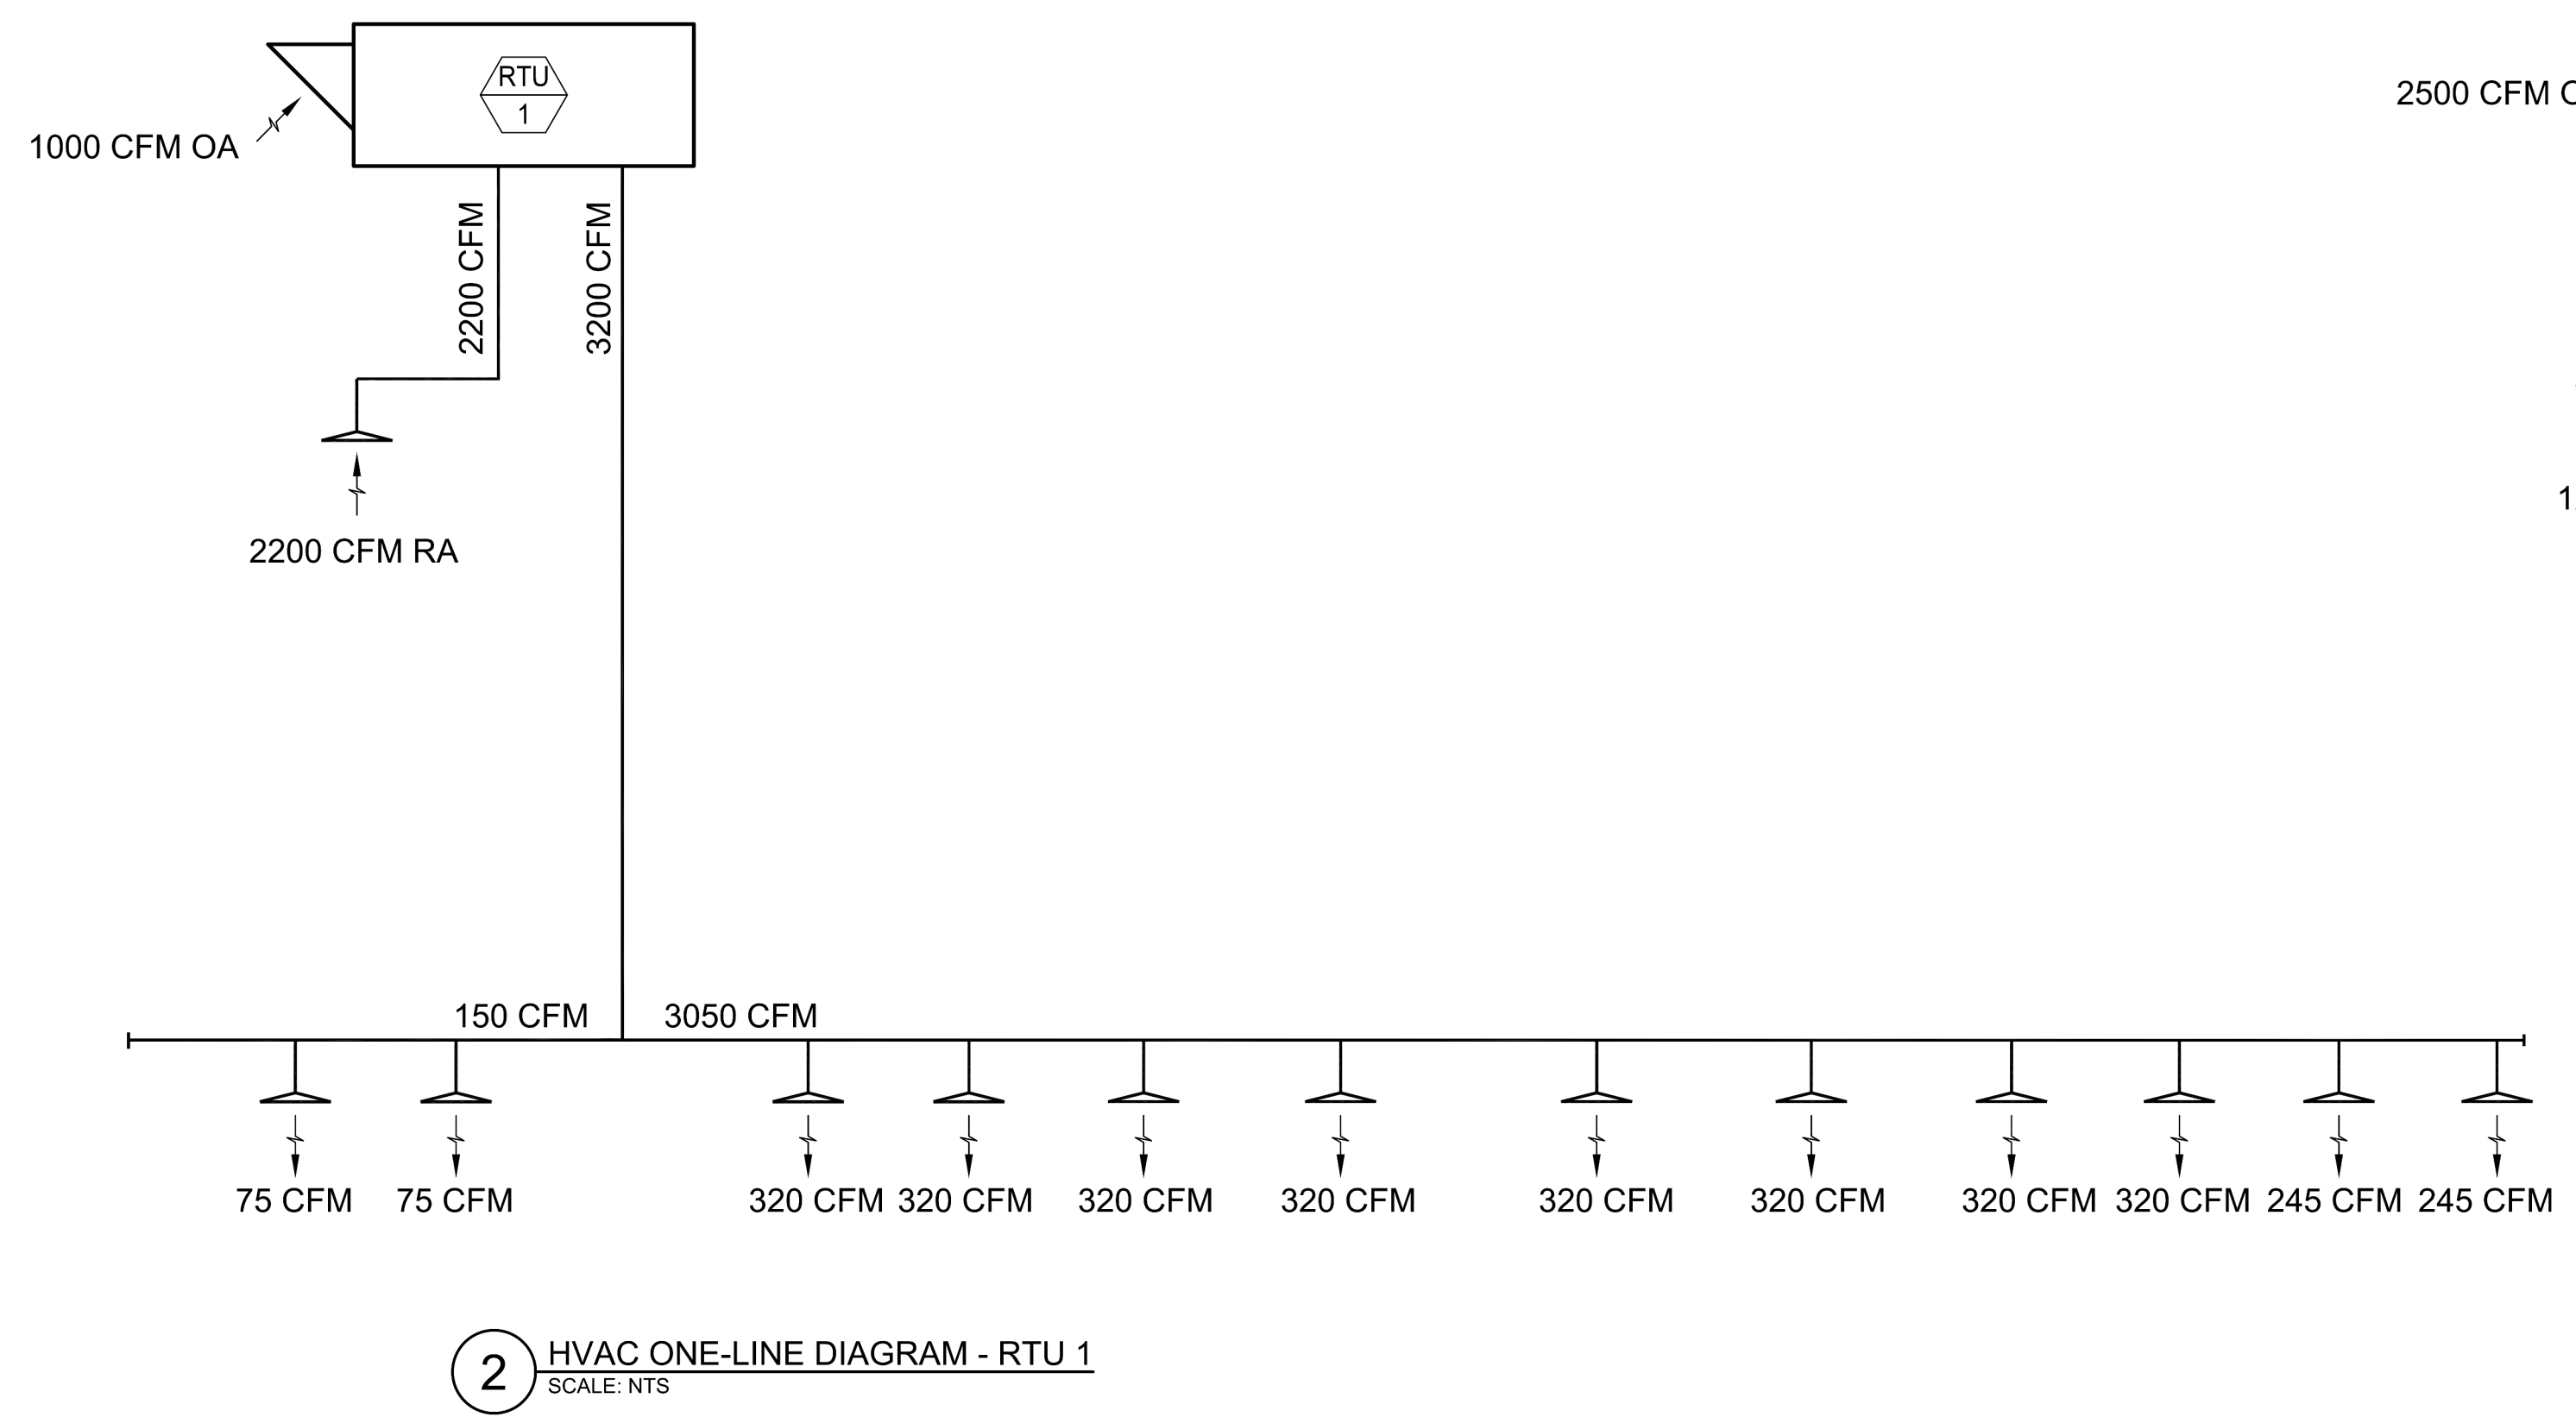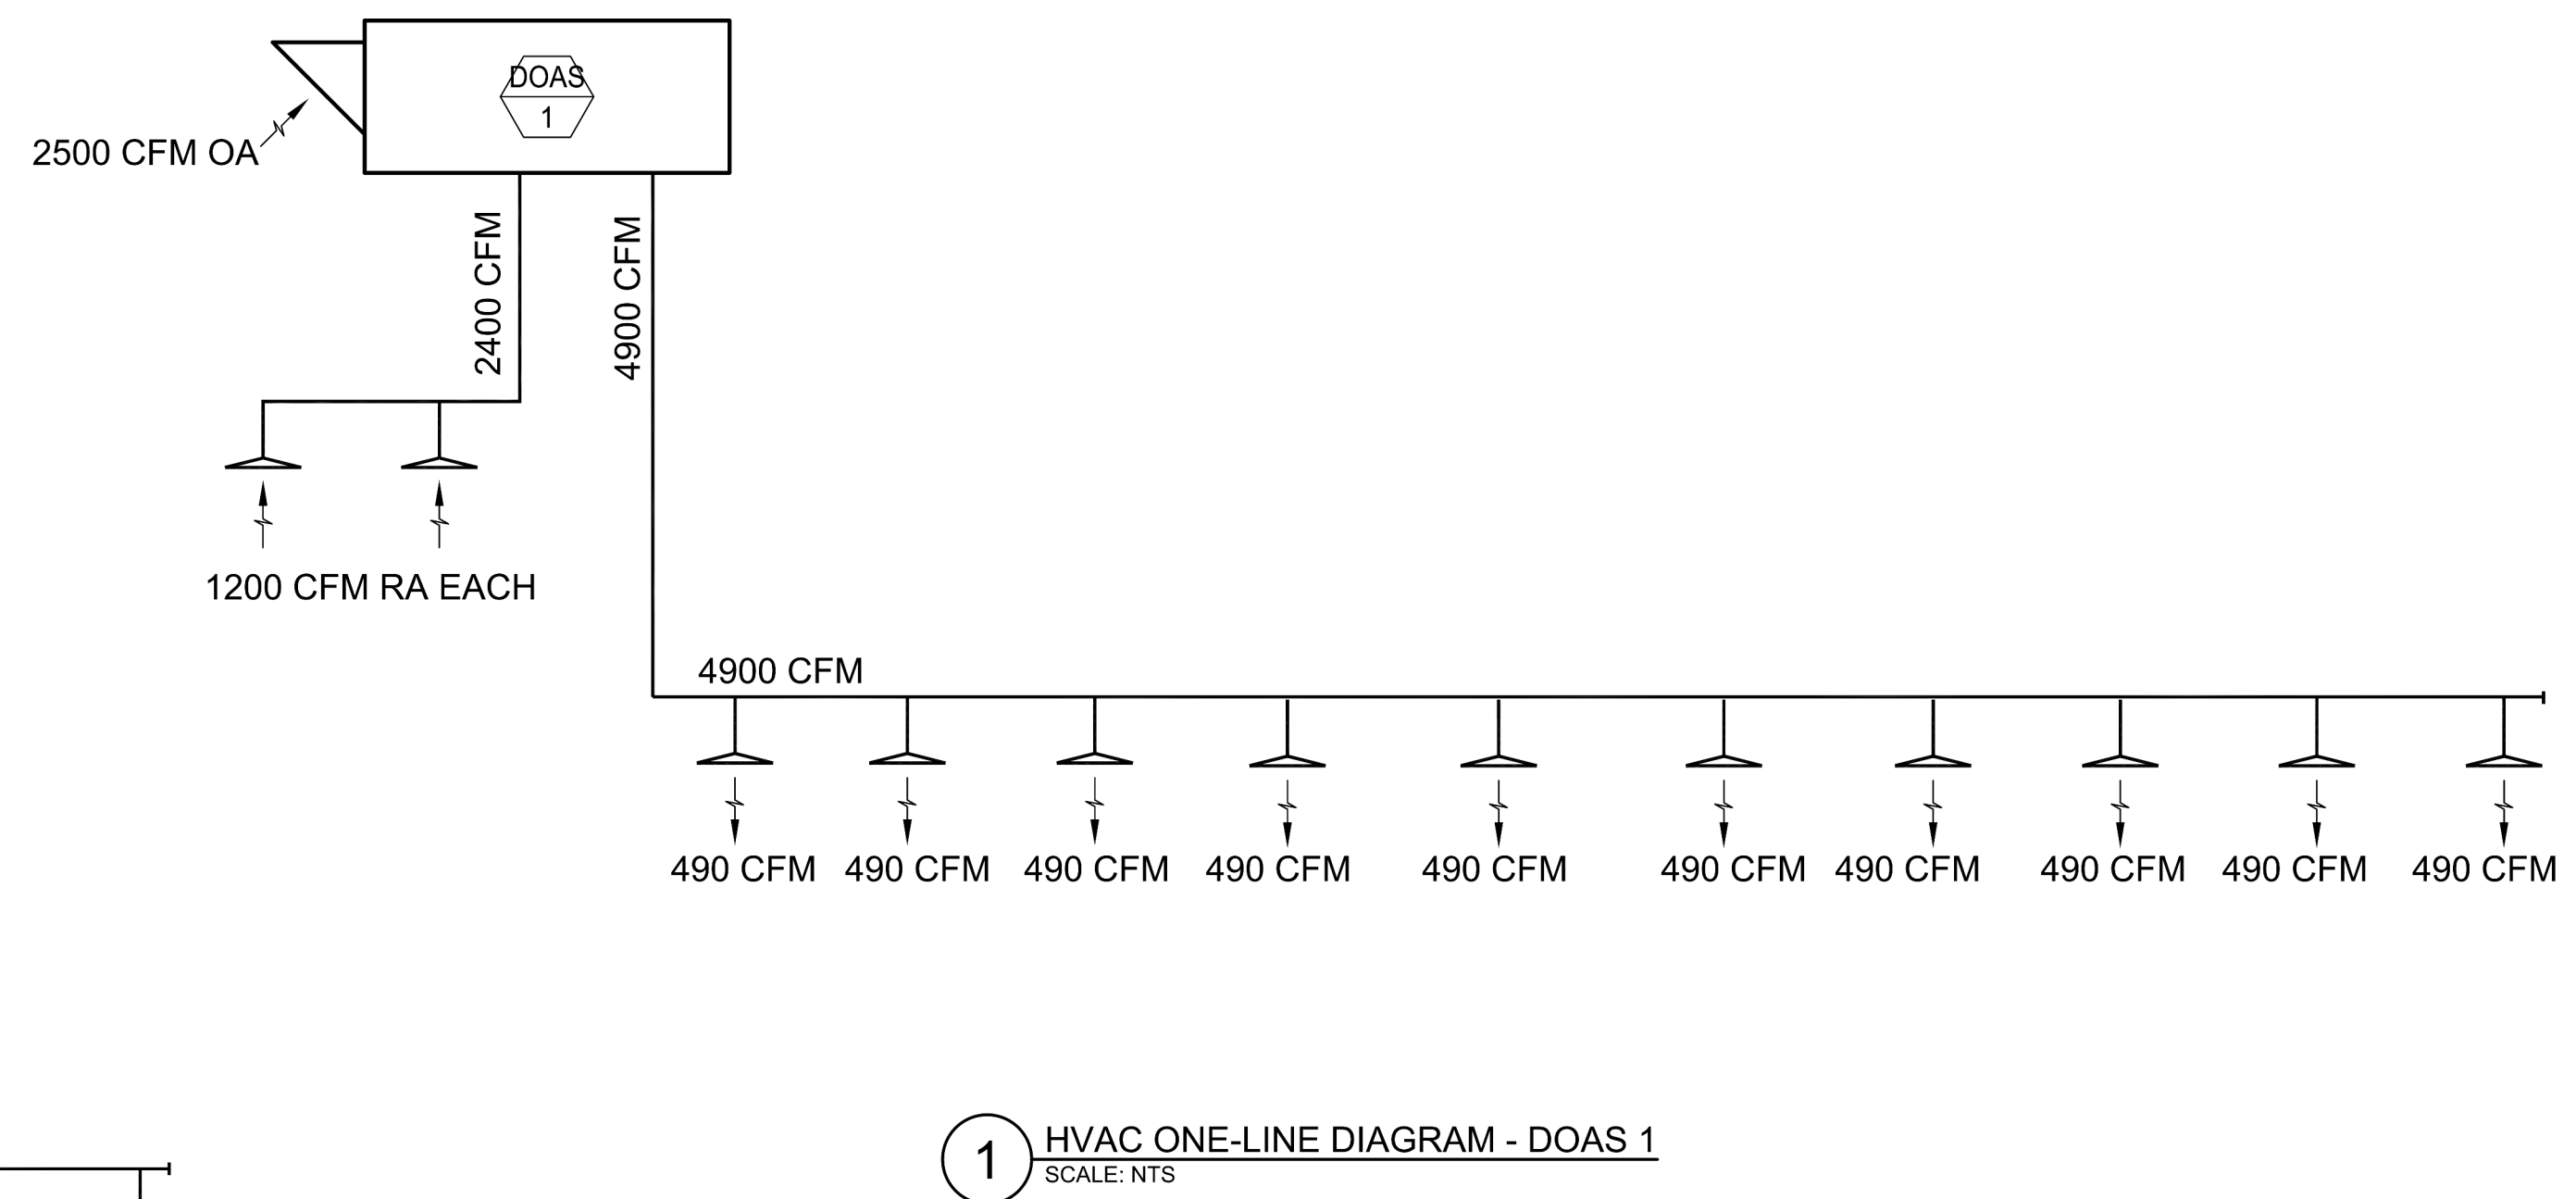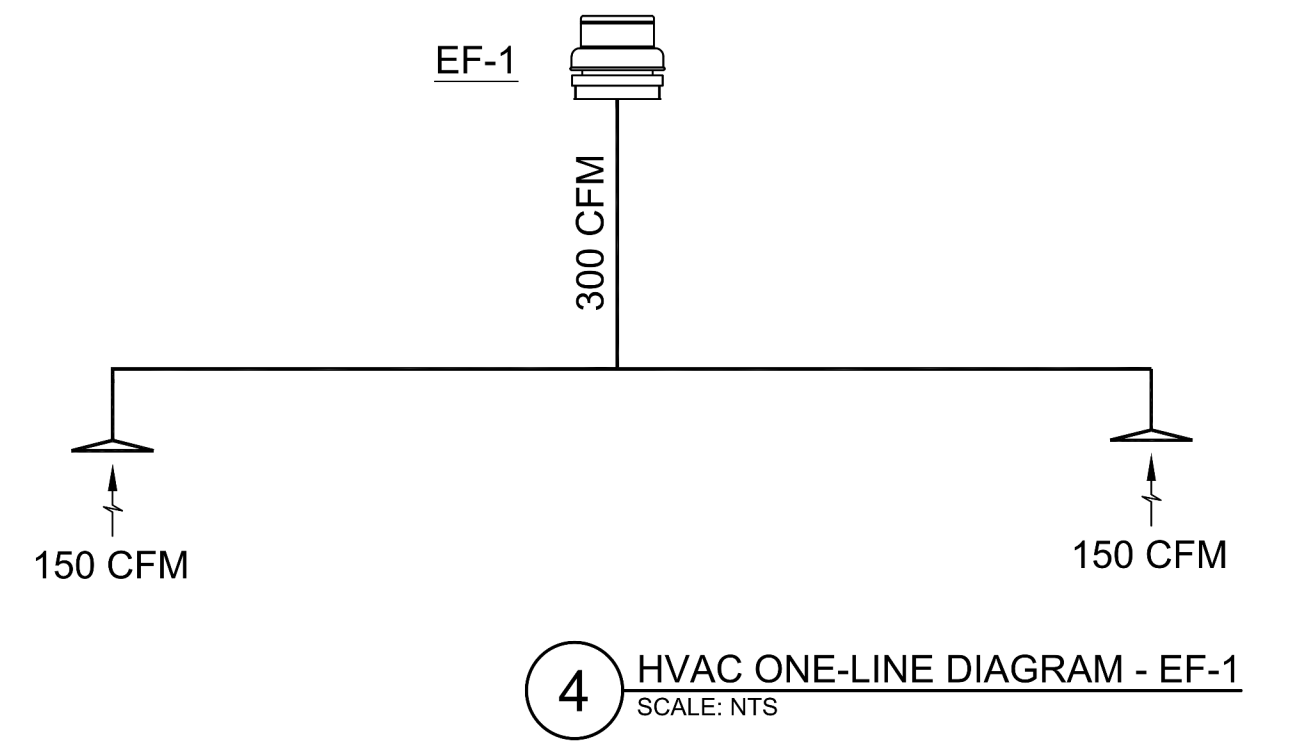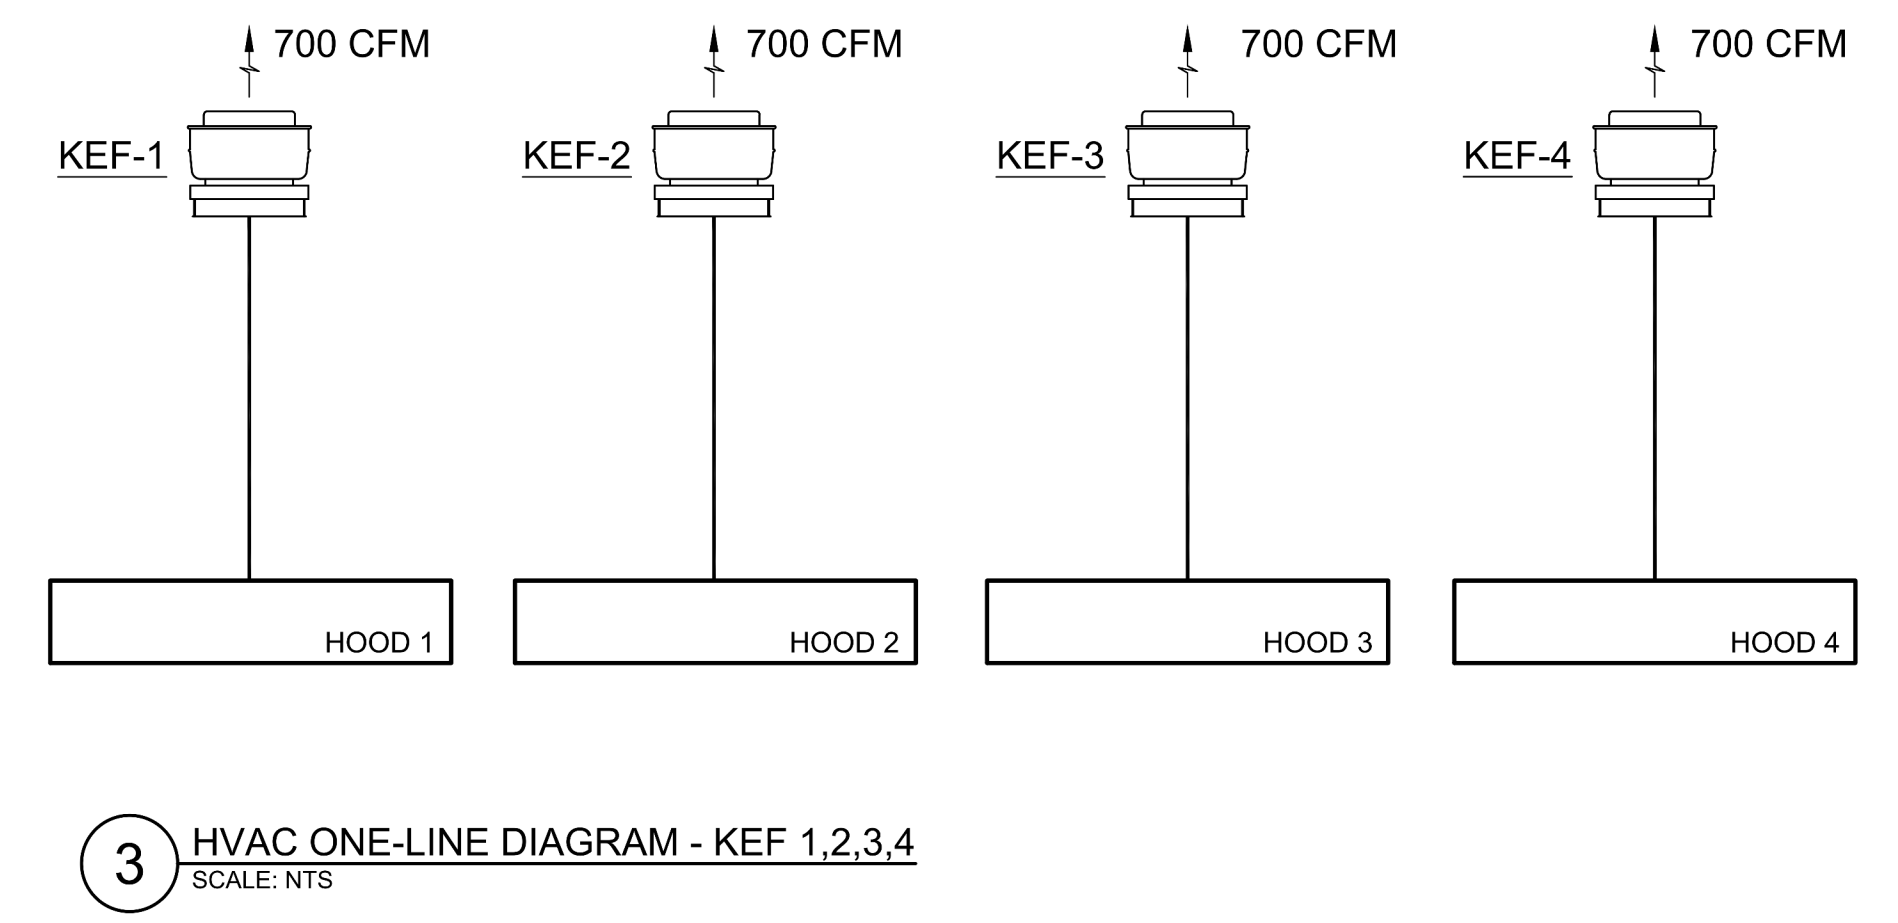

\\net.ccs.hawaii.edu\carlsonj\Projects\2150002415 MEP_V01_andrew_pattus_20220519\161918.rvt

GENERAL MECHANICAL REQUIREMENTS

1. GENERAL INSTRUCTIONS

A. GENERAL REQUIREMENTS
 B. DEFINITIONS
 C. PRE-BID SITE VISIT
 D. MATERIAL AND WORKMANSHIP
 E. MANUFACTURERS
 F. COORDINATION
 G. ORDINANCES AND CODES
 H. PROTECTION OF EQUIPMENT AND MATERIALS
 I. SUBSTITUTIONS
 J. SUBMITTALS
 K. RECORD DRAWINGS FILES
 L. RECORD DRAWINGS (AS-BUILT DRAWINGS)
 M. OPERATION AND MAINTENANCE INSTRUCTIONS
 N. SPARE PARTS
 O. TRAINING
 P. WARRANTIES

2. GENERAL MATERIALS AND INSTALLATION

A. BUILDING OPERATION
 B. EXISTING EQUIPMENT REUSE AND REMOVAL
 C. EXCAVATION AND BACKFILLING
 D. COINCIDENTAL DAMAGE
 E. CUTTING AND PATCHING
 F. ROUGH-IN
 G. STRUCTURAL SUPPORT SYSTEMS
 H. PRE-ENGINEERED ROOF EQUIPMENT SUPPORTS AND CURBS
 I. ACCESS PANELS AND DOORS
 J. PENETRATIONS
 K. FIRESTOPPING
 L. MOTORS AND STARTERS
 M. VARIABLE FREQUENCY DRIVES
 N. ELECTRICAL WIRING
 O. EQUIPMENT FURNISHED BY OTHERS
 P. SYSTEM TESTING, ADJUSTING, AND BALANCING
 Q. VIBRATION ISOLATION
 R. SEISMIC CONTROLS FOR MEPF SYSTEMS
 S. FILTERS
 T. REFRIGERANT AND OIL
 U. IDENTIFICATION

3. DUCT INSULATION, DUCTWORK, ACCESSORIES, FLUES AND FANS

A. DUCT INSULATION
 B. DUCTWORK
 C. FLEXIBLE DUCT
 D. PLASTIC FLUE GAS VENTS
 E. AIR DEVICES
 F. CONTROL DAMPERS
 G. EXHAUST AIR SYSTEMS
 H. KITCHEN EXHAUST AIR SYSTEMS

4. HVAC EQUIPMENT

A. ROOFTOP UNITS (GAS FIRED HEAT) 3-25 TONS
 B. ROOFTOP UNITS (GAS FIRED HEAT) 20 TONS (RTU-2)
 C. ELECTRIC UNIT HEATERS
 D. NATURAL GAS RADIANT HEATERS
 E. SPLIT DUCTLESS AIR-CONDITIONING SYSTEMS
 F. AIR CURTAINS

5. PIPING AND PIPING SPECIALTIES

A. REFRIGERANT PIPING AND INSULATION
 B. SYSTEM EVACUATION AND CHARGING

6. TEMPERATURE CONTROLS

A. GENERAL REQUIREMENTS
 B. WIRING
 C. THERMOSTAT CONTROL EQUIPMENT
 D. SENSORS AND RELAYS

7. SEQUENCE OF OPERATION

A. FAN COIL UNIT CONTROL
 B. KITCHEN EXHAUST FAN CONTROL
 C. MAKE-UP AIR UNIT CONTROL
 D. ROOFTOP UNIT CONTROL
 E. RESTROOM EXHAUST FAN (EF-1) CONTROL
 F. AIR CURTAIN CONTROL
 G. ELECTRIC UNIT HEATER CONTROL

8. ALTERNATIVES

A. DESCRIPTION

9. COMMISSIONING OF MECHANICAL SYSTEM

A. GENERAL
 B. EXECUTION

Division 23: HEATING, VENTILATING, AND AIR CONDITIONING

1. GENERAL INSTRUCTIONS

A. GENERAL REQUIREMENTS

All requirements under Division 01 and the general and supplementary conditions of these specifications apply to this section and division 23. Where these requirements do not apply, the requirements of Division 01, this section and division take precedence. Become thoroughly familiar with all its contents as to requirements that affect this division, section, or both. Work required under this division includes all material, equipment, appliances, transportation, services, and labor required to complete the entire system as required by the drawings and specifications, or reasonably inferred to be necessary to facilitate the function of each system as implied by the design and the equipment specified.

The specifications and drawings for the project are complementary, and any portion of work described in one shall be provided as if described in both. In the event of discrepancies, notify the Engineer and request clarification prior to proceeding with the work involved.

Drawings are graphic representations of the work upon which the contract is based. They show the materials and their relationship to one another, including sizes, shapes, locations, and connections. They convey the scope of work, indicating the intended general arrangement of the systems without showing all of the exact details as to elevations, offsets, control lines, and other installation requirements. Use the drawings as a guide to verify that materials and equipment will fit into the designated spaces, and which when installed per manufacturer's requirements, will ensure a complete, coordinated, satisfactory, and properly operating system.

Drawings are graphic representations of the work upon which the contract is based. They show the materials and their relationship to one another, including sizes, shapes, locations, and connections. They convey the scope of work, indicating the intended general arrangement of the systems without showing all of the exact details as to elevations, offsets, control lines, and other installation requirements. Use the drawings as a guide to verify that materials and equipment will fit into the designated spaces, and which when installed per manufacturer's requirements, will ensure a complete, coordinated, satisfactory, and properly operating system.

B. DEFINITIONS

Division: References contained in this specification follow the numbering system defined in the Construction Specifications Institute (CSI) MasterFormat 2004 Edition. Specification Divisions 01 through 13 provided with this project may reference the CSI MasterFormat 1995 Edition. The corresponding division references between the 2004 Edition and 1995 Edition are as follows:

2004 Edition	1995 Edition
1. Division 21 - Fire Suppression	Division 15
2. Division 22 - Plumbing	Division 15
3. Division 23 - HVAC	Division 15
4. Division 26 - Electrical	Division 16
5. Division 27 - Communications	Division 16
6. Division 28 - Electronic Safety and Security	Division 16

Furnish: "to supply and deliver to the project site, ready for unloading, unpacking, assembly, installation and similar operations."

Install: "to perform all operations at the project site including, but not limited to, the actual unloading, unpacking, assembling, erecting, placing, anchoring, applying, working to dimension, finishing, curing, protecting, cleaning, testing, commissioning, starting up and similar operations, complete, and ready for the intended use."

Provide: "to furnish and install."

Furnished by Owner (or Owner-Furnished) or Furnished by Others: "an item furnished by the Owner or under other divisions or contracts, and installed under the requirements of this division, complete and ready for intended use, including all items and services necessary to the work necessary for proper installation and operation. Include the installation under the warranty required by this division."

Engineer: Where referenced in this division, "Engineer" is the Engineer of Record and the Design Professional for the work under this division, and is a consultant to, and an authorized representative of the Architect, as defined in the General and/or Supplementary Conditions. When used in this division, "Engineer" means increased involvement by and obligations to the Engineer, in addition to involvement by and obligations to the Architect.

AHJ: The local code and/or inspection agency (Authority) Having Jurisdiction over the work.

NRTL: Nationally recognized testing laboratory, as defined and listed by OSHA in 29 CFR 1910.7 (e.g., UL, ETL, CSA), and acceptable to the AHJ over this project. Nationally recognized testing laboratories and standards listed are used only to represent the characteristics and are not intended to restrict the use of other NRTLs that are acceptable to the AHJ and standards that meet the specified criteria.

Substitution: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor. Substitutions include Value Engineering proposals.

C. FREPID SITE VISIT

Prior to submitting bid, visit the site of the proposed work and become fully informed as to the conditions under which the work is to be done. Failure to comply with this requirement shall not be considered sufficient justification to request or obtain extra compensation over and above the contract price.

D. MATERIAL AND WORKMANSHIP

Provide new material, equipment, and apparatus under this contract unless otherwise stated herein, of best quality normally used for the purpose in good commercial practice, and free from defects. Install material and equipment in accordance with the manufacturer's instructions. Model numbers listed in the specifications or shown on the drawings are not necessarily intended to designate the required trim, written descriptions of the trim govern model numbers.

Pipe, pipe fittings, pipe specialties and valves shall be manufactured in plants located in the United States or certified to meet the specified ASTM and ANSI standards.

Work performed under this contract shall provide a neat and "workmanlike" appearance when completed, to the satisfaction of the Architect and Engineer. Workmanship shall be the finest possible by experienced mechanics. Installations shall comply with applicable codes and laws.

The complete installation shall function as designed and intended with respect to efficiency, capacity, noise level, etc. Abnormal noise caused by rattling equipment, piping, ducts, air devices, and squeaks in rotating components shall not be acceptable. Materials and equipment shall be of commercial quality grade, in quantity. Light duty and residential grade equipment shall not be accepted unless otherwise indicated.

Remove from the premises waste material present as a result of work, including cartons, crating, paper, stickers, and/or excavation material not used in backfilling, etc. Clean equipment installed under this contract to present a neat and clean installation at the termination of the work.

Repair or replace public and private property damaged as a result of work performed under this contract to the satisfaction of authorities and regulations having jurisdiction. Provide all safety lights, guards, and warning signs required for the performance of the work and for the safety of the public.

E. MANUFACTURERS

In other articles where lists of manufacturers are introduced, subject to compliance with requirements, provide products by one of the manufacturers specified.

Where a list is provided, manufacturers are listed alphabetically and not in accordance with any ranking or preference.

Where manufacturers are not listed, provide products subject to compliance with requirements from manufacturers that have been actively involved in manufacturing the specified product for no less than 5 years.

F. COORDINATION

Coordinate work with that of other trades so that the various components of the systems are installed at the proper time, will fit the available space, and will allow proper service access to those items requiring maintenance. Components which are installed without regard to the above shall be relocated at no additional cost to the Owner.

Unless otherwise indicated, the General Contractor shall provide chases and openings in building construction required for installation of the systems specified herein. Contractor shall furnish the General Contractor with information where chases and openings are required. Contractor shall keep informed as to the work of other trades engaged in the construction of the project and shall execute work in a manner so as not to interfere with or delay the work of other trades.

Figured dimensions shall be taken in preference to scale dimensions. Contractor shall take his own measurements at the building, as variations may occur. Contractor shall be held responsible for errors that could have been avoided by proper checking and inspection.

Provide materials with trim that will properly fit the types of ceiling, wall, or floor finishes actually installed. Model numbers listed in the specifications or shown on the drawings are not intended to designate the required trim.

G. ORDINANCES AND CODES

Work performed under this contract shall, at a minimum, be in conformance with applicable national, state and local codes having jurisdiction, including but not limited to the applicable codes of the International Building Code (IBC) and the International Fire Code (IFC). Where there are conflicts between these codes, ordinances, rules, regulations, referenced standards, and these documents to the attention of the Architect and Engineer for final resolution. Contractor will be held responsible for any violation of the law.

Procure and pay for permits and licenses required for the accomplishment of the work herein described. Where required, obtain, pay for, and furnish certificates of inspection to Owner.

H. PROTECTION OF EQUIPMENT AND MATERIALS

Store and protect from damage equipment and materials delivered to job site. For materials and equipment susceptible to changing weather conditions or temperature variations, store inside in conditioned spaces. For materials and equipment not susceptible to these conditions, cover with waterproof, tear-resistant, heavy tarp or polyethylene plastic as required to protect from plaster, dust, dirt, paint, water, or physical damage. Replace insulation that has become wet at any time during construction. Drying the insulation is not acceptable. Seal any tears or joints of internal fibreglass insulation. Equipment and material damaged by construction activities shall be rejected and Contractor shall furnish new equipment and material of a like kind at his own expense.

Keep premises broom clean of foreign material created during work performed under this contract. Piping, equipment, etc. shall have a neat and clean appearance at the termination of the work. Remove debris from ceiling/return air plenum, including dust.

Plug, seal, or cap open ends of ductwork and piping systems while stored and installed during construction when not in use to prevent the entrance of debris into the systems. Remove temporary protection prior to starting equipment and turning the system over to the owner.

I. SUBSTITUTIONS

Materials, products, equipment, and systems described in the Bidding Documents establish a standard of required function, dimension, appearance and quality to be met by the proposed substitution. The base bid shall include only the products from manufacturers specifically named in the drawings and specifications. To request a substitution, request the Substitution Request Form from the Architect or Engineer. Complete and attach the Substitution Request Form, and send the Substitution Request Form, product, equipment, or system that is proposed to be substituted. The burden of proof of the merit of the proposed substitution is upon the proposer.

Unless stated otherwise in writing to the Engineer by the Contractor, Contractor warrants to the Engineer, Architect, and Owner the following:

- Proposed substitution has been fully investigated and determined to meet or exceed the specified Work in all respects unless stated otherwise in the substitution request.
- Proposed substitution is consistent with the Contract Documents and will produce indicated results, including functional clearances, maintenance service, and sourcing of replacement parts.
- Proposed substitution has received necessary approval of authorities having jurisdiction.
- Same warranty will be furnished for proposed substitution as for specified Work.

J. SUBMITTALS

Assemble and submit for review shop drawings, material lists, manufacturer product literature for equipment to be furnished, and items requiring coordination between contractors under this contract. Provide submittals in sufficient detail so as to demonstrate compliance with these contract documents and the design concept. Prior to transmitting submittals, verify that the equipment submitted is mutually compatible and suitable for the intended use, will fit the available space, and maintain manufacturer recommended service clearances. If the size of equipment furnished makes necessary any change in location or configuration, submit a shop drawing showing the proposed layout.

Transmit submittals as early as required to support the project schedule. Allow for two weeks Engineer review time, plus to/from mailing time via the Architect, plus a duplication of this time for resubmittal, if required. Only resubmit those sections requested for resubmittal.

Submittals shall contain the project name, applicable specification section, submittal date, equipment identification acronym as used on the drawings, and the Contractor's stamp. The stamp shall certify that the submittal has been checked by the Contractor, complies with the drawings and specifications, and is coordinated with other trades. Manufacturer product literature shall include shop drawings, product data, performance sheets, samples and other submittals required by this division. Highlight, mark, list, or indicate the materials, performance criteria, and accessories that are being proposed. General product catalog data not specifically noted to be part of the specified product will be rejected and returned without review.

Submittals and shop drawings shall not contain the firm name, logo, seal, or signature of the Engineer. They shall not be copies of the work product of the Engineer. If the Contractor desires to use elements of such product, refer to paragraph "Electronic Drawing Files" for procedures to be used.

Separate submittals according to individual specification sections. Illegible submittals will be rejected and returned without review. Catalog data shall be properly bound, identified, indexed and tabbed in a 3-ring binder. Each item or model number shall be clearly marked and accessories indicated. Label the catalog data with the equipment identification acronym or number as used on the drawings and include performance curves, capacities, sizes, weights, materials, finishes, wiring diagrams, electrical requirements and deviations from specified equipment or materials. For equipment with motor starters or VFDs, include short circuit current ratings. Mark cut-inscapable items. Shop drawings will be returned without review if the above mentioned requirements are not met.

Provide the quantity of submittals required by Division 01. If not indicated and hard-copy sets are provided, submit a minimum of six (6) copies. Refer to Division 01 for acceptance of electronic submittals for this project. For electronic submittals, Contractor shall submit the documents in accordance with the procedures specified in Division 01. Contractor shall notify the Architect and Engineer that the submittals have been posted. If electronic submittal procedures are not defined in Division 01, Contractor shall include the website, user name, and password information needed to access the submittals. For submittals sent by e-mail, Contractor shall copy the designated representatives of the Architect and Engineer. Contractor shall allow for the Engineer review time as specified above in the construction schedule. Contractor shall submit only the documents required to purchase the materials and/or equipment in the electronic submittals.

The checking and subsequent acceptance of submittals by the Engineer and/or Architect shall not relieve the Contractor from responsibility for deviations from the drawings and specifications, errors in dimensions, details, size of members, or quantities, omissions of components or fittings; coordination of electrical requirements; and not coordinating items with actual building conditions and adjacent work. Proceed with the procurement and installation of equipment only after receiving approved shop drawings relative to each item.

K. ELECTRONIC DRAWING FILES

In preparation of shop drawings or record drawings, Contractor may, at his option, obtain electronic drawing files in AutoCAD or DXF format on CD-ROM, DVD disk, flash drive or direct download, as desired, from the Engineer for a shipping and handling fee of \$200 for a drawing set up to 12 sheets and \$15 per sheet for each additional sheet. Contact the Architect for written authorization and Engineer for the necessary release agreement form and to specify shipping method and drawing format. In addition to payment, the written authorization from the Architect and release agreement form from the Engineer must be received before electronic drawing files will be sent.

L. RECORD DRAWINGS (AS-BUILT DRAWINGS)

During progress of the work in this division, Contractor shall maintain an accurate record of all changes made during the installation of the system. Upon completion of the work, accurately transfer all record information to three identical sets of the approved shop drawings. Insert one set into each copy of the manual described below.

M. OPERATION AND MAINTENANCE INSTRUCTIONS

During the course of construction, collect and compile a complete brochure of equipment furnished and installed on this project. Include operational and maintenance instructions, manufacturer's catalog sheets, wiring diagrams, parts lists, approved submittals and shop drawings, warranties, and descriptive literature as furnished by the equipment manufacturer. Include an inside cover sheet that lists the project name, date, Owner, Architect, Engineer, General Contractor, Sub-Contractor, and an index of contents.

Submit three copies of literature bound in approved binders with index and tabs separating equipment types to the Architect, for Engineer's review, at the termination of the work. Paper clips, staples, rubber band bindings, and mailing envelopes are not considered approved binders. Final approval of systems installed under this contract shall be withheld until this equipment brochure is received and deemed complete by the Architect and Engineer. Instruct workmen to save required literature shipped with the equipment itself for inclusion in this brochure.

Include Record Drawings as described above.

N. SPARE PARTS

Furnish to Owner, with receipt, the following spare parts for the equipment furnished for this project:

- One set of spare filters of each type required for each unit. In addition to the spare set of filters, install new filters prior to testing, adjusting, and balancing work and before turning system over to Owner.
- Furnish one complete set of belts for each fan.
- Furnish three operating keys for each type of air outlet and inlet that require them.

O. TRAINING

At a time mutually agreed upon between the Owner and Contractor, provide the services of a factory trained and authorized representative to train Owner's designated personnel on the operation and maintenance of the equipment provided for this project.

Provide training to include, but not be limited to, an overview of the system and/or equipment as it relates to the facility as a whole; operation and maintenance procedures and schedules related to startup and shutdown, troubleshooting, servicing, preventive maintenance and appropriate operator intervention; and review of data included in the operation and maintenance manuals.

Submit a certification letter to the Architect stating that the Owner's designated representative has been trained as specified herein. Letter shall include date, time, attendees and subject of training. The Contractor and the Owner's representative shall sign the certification letter indicating agreement that the training has been provided.

P. WARRANTIES

Warrant each system and each element thereof against all defects due to faulty workmanship, design, or material for a period of 12 months from date of Substantial Completion, unless specific items are noted to carry a longer warranty in the construction documents or manufacturer's standard warranty exceeds 12 months. Remedy all defects, occurring within the warranty periods), as stated in the General Conditions and Division 01.

Warranties shall include labor and material, including travel expenses. Make repairs or replacements without any additional costs to the Owner, and to the satisfaction of the Owner, Architect, and Engineer.

Perform the remedial work promptly, upon written notice from the Engineer or Owner.

At the time of Substantial Completion, deliver to the Owner all warranties, in writing and properly executed, including term limits for warranties extending beyond the one year period and any actions the Owner must take in order to maintain warranty status. Each warranty instrument shall be addressed to the Owner and state the commencement date and term.

2. GENERAL MATERIALS AND INSTALLATION

A. BUILDING OPERATION

Comply with the schedule of operations as outlined in the architectural portions of this specification. Accomplish work requiring interruption of building operation at a time when the building is not in operation and only with written approval of building Owner and/or tenant. Coordinate interruption of building operation with the Owner and/or tenant a minimum of seven (7) days in advance of work.

D. COINCIDENTAL DAMAGE

Repair streets, sidewalks, drives, paving, walks, finishes, and other facilities damaged in the course of the work. Repair materials shall match existing construction. Repair work shall meet all requirements of the Owner, local authorities having jurisdiction, and meet the satisfaction of the Architect.

E. CUTTING AND PATCHING

Conform to the requirements in Division 01. Cut walls, floors, ceilings, and other portions of the facility as required to install work under this division. Obtain permission from the Architect prior to cutting. Do not cut or disturb structural members without prior approval from the Architect and Structural Engineer. For post-tensioned slabs, x-ray slab and closely coordinate all core drill locations with Architect and Structural Engineer prior to performing any work. Obtain approval from Architect and Structural Engineer for all core drills and penetrations at least four days prior to performing work. Penetrations shall be made as small as possible while maintaining required clearances between the building element penetrated and the system component. Patch around openings to match the adjacent construction including fire ratings, if applicable. Repair and refresh areas disturbed by work to the condition of adjoining surfaces in a manner satisfactory to the Architect.

F. ROUGH-IN

Coordinate without delay all rough-in with other divisions. Conceal piping, conduit, and rough-in except in unfinished areas and where otherwise shown.

G. STRUCTURAL SUPPORT SYSTEMS

Structural steel used for support of equipment, ductwork and piping shall be new, clean, and conform to ASTM Designation A-36. Support mechanical components from the building structure. Do not support mechanical components from ceilings, other mechanical or electrical components, and other non-structural elements.

H. PRE-ENGINEERED ROOF EQUIPMENT SUPPORTS AND CURBS

Provide prefabricated equipment support rails and roof curbs manufactured by AES Industries, Custom Curb, Inc., Pate Company, Thybar or approved equal. Provide with fully mitered raised cant and step to match roof insulation thickness, welded, minimum 1/8 gauge galvanized steel shell, internally reinforced to load bearing factors of equipment being supported, minimum 1-1/2 inch thick, 3 pound rigid insulation internal to shell to maintain continuous roof insulation where required, factory installed wood nailer, and minimum 18 gauge jacket with counterflashing. Where equipment does not fully cover the equipment support. Provide sloped roof equipment supports to eave level installation. Provide rigid backing material behind cant and maintain cant slope. Provide multiple support rails to uniformly support the equipment. Attach to roof structure according to manufacturer's installation instructions.

3. ACCESS PANELS AND DOORS

Refer to Architectural documents for specification of access panels and doors.

Provide access doors for all concealed equipment and duct and piping accessories that require service where indicated or as required, except where above lay-in ceilings. Access doors shall be adequately sized for the devices served with a minimum size of 18 inches x 18 inches. Access doors must be of the proper construction for type of construction in which it is installed. Obtain Architect's approval of type, size, location and color before ordering. Provide factory-fabricated and assembled units, complete with attachment devices and fasteners ready for installation, concealed hinges, flush screwdriver-operated cam lock, and anchor straps. Provide access doors manufactured by Greenheck, Milcor, Tlus, Zurn, or equal.

J. PENETRATIONS

Provide sleeves for pipes passing through above grade concrete or masonry walls, concrete floor or roof slabs. Sleeves are not required for core drilled holes in existing masonry walls, concrete floors or roofs. Provide 10 gauge galvanized steel sleeves for sleeves 6 inches and smaller. Provide stainless steel metal sleeves for larger than 6 inches. Schedule 40 PVC sleeves are acceptable for installation in areas without return air plenums.

Seal elevated floor, exterior wall and roof penetrations watertight and weathertight with non-shrink, non-hardening commercial sealant. Pack with mineral wool and seal both ends with minimum of 1/2 inch of sealant.

Seal around penetrations of fire rated assemblies. Coordinate fire ratings and locations with the architectural drawings. Refer to architectural specifications for fire stoppings. Provide a product schedule for UL listing, location, wall or floor rating and installation drawing for each penetration fire stop system.

Extend pipe insulation for insulated pipe through floor, wall and roof penetrations, including fire rated walls and floors. The vapor barrier shall be maintained. Size sleeve for a minimum of 1 inch annular clear space between inside of sleeve and outside of insulation.

Provide prefabricated roof curbs where pipes and/or ductwork penetrate elevated slabs or to the roof to the exterior. Provide cover curb of weather-resistant material and seal duct or pipe penetrations through the cover. Provide pipe collar of weather-resistant material with stainless steel pipe clamps for piping penetrations.

Provide box frames for rectangular openings welded 12 gauge galvanized steel attached to forms and of a maximum dimension established by the Architect. Notify the General Contractor or Architect before installing any box openings not shown on the Architectural or Structural drawings.

Seal concrete or masonry exterior wall penetrations below grade with "wall pipes" and mechanical sleeve. Provide cast iron "wall pipes" with integral waterstop ring manufactured by Jay R. Smith, Josam, Wade, Watts or Zurn. Provide modular mechanical sleeve pipes, manufactured by Caljico, Metalflex, or Thunderrine / Link Seal.

Seal elevated concrete slab with water proof membrane penetrations with "wall pipes" and water proof sealant. Secure waterproof membrane flashing between "wall pipe" clamping flange and clamping ring. Provide cast iron "wall pipes" with integral waterstop ring manufactured by Jay R. Smith, Josam, Wade, Watts or Zurn.

Provide sleeves for horizontal pipe passing through or under foundation. Sleeves shall be cast iron soil pipe two nominal pipe sizes larger than the pipe served.

Provide Schedule 40 PVC pipe sleeves for vertical pressure pipe passing through concrete slab on grade. Sleeves shall be one nominal pipe size larger than the pipe served and two pipe sizes larger than pipe served for ductile iron pipes with restraining rods. Seal water-tight with silicone caulk.

Provide 1/2 inch thick cellular foam insulation around perimeter of non-pressure pipe passing thru concrete slab on grade. Insulation shall extend to 2 inches above and below the concrete slab.

K. FIRESTOPPING

Sealants and accessories shall have fire-resistance ratings indicated, as established by testing identical assemblies in accordance with UL 2079 or ASTM E 814, or other NRTL acceptable to AHJ.

Manufacturers: Hill, RectorSeal, Specified Technologies Inc., United States Gypsum Company, or 3M corp.

Through and Membrane Penetration Firestopping Systems Product Schedule: Provide UL listing, location, wall or floor rating, and installation drawings for each penetration fire stop system.

Where project conditions require modification to qualified testing and inspecting agency's illustrations for a particular firestopping condition, submit illustration, with modifications marked, approved by penetration firestopping manufacturer's fire-protection engineer as an engineering judgment or equivalent fire-resistance-rated assembly. Include qualifications data for testing agency.

L. MOTORS AND STARTERS

Provide motors and starting equipment where not furnished with the equipment package. Motors shall have copper windings, Class B insulation, and standard squirrel cage with starting torque characteristics suitable for the equipment served. Motors controlled by variable frequency drives shall be provided with minimum service life in accordance with NEMA MG1, Part 31. Motors 5 horsepower and larger controlled by variable frequency drives shall be provided with a shaft grounding system equal to Aegis SGR Bearing Protection Ring, InproSeal Current Diverter Ring (CDR) or approved equal. Motors for air handling equipment shall be selected for quiet operation. Each motor shall be checked for proper rotation after electrical connection has been completed. Provide drip-proof enclosure for locations protected from weather and not in air stream of fan; and totally enclosed fan cooled enclosure for motors exposed to weather. Motors shall be manufactured by Century, General Electric, Louis Allis, Westinghouse, or approved equal.

Provide every motor, except fractional horsepower single phase motors with an approved type of "built-in" thermal overload protection, with a motor starter. Each starter shall be provided with overload heaters sized to the motor rating, and every three phase motor starter shall have overload heaters in each phase. Ambient compensated heaters shall be installed wherever necessary. Unless noted otherwise, motor starters shall be furnished by the Division 23 Contractor for installation and connection by the Division 26 Contractor. Starters shall be Allen-Bradley, Clark, Furnas, Square D, or approved equal.

M. VARIABLE FREQUENCY DRIVES

Provide PWM variable frequency drives (VFD) to control fan or pump motors as indicated on the drawings. Provide VFD as manufactured by AC Technology, Asea Brown Boveri, Danfos, Reliance Electric, or Yaskawa. Include an integral, door-interlocked input circuit breaker or fused disconnect which may be padlocked in the "OFF" position.

Provide a magnetic contactor manual bypass integral to each drive. Provide two magnetic contactors, mechanically and electrically interlocked, to isolate the inverter output from line voltage. The inverter input shall be isolated by either a third magnetic contactor or a second disconnect switch to allow removal of power to the inverter for service while still operating the motor across the line. Bypass shall include a 120V/60 control transformer, fused on both the primary and secondary, and bi-metallic thermal motor overload relays with adjustable trip settings.

Provide input AC line reactors without exception. Reactors shall be minimum 3 percent impedance, and "K" rated per IEEE C57-110 for harmonic current content. Reactors shall be integral to the drive enclosure without need for field wiring.

The VFD shall have an RS-485 port as standard. The standard protocols shall be Johnson Controls N2 bus, Modbus, and Siemens Building Technologies FLN. Other protocols, i.e. Ethernet, LonWorks, and Profibus DP shall be available. Each individual drive shall have the protocol in the base VFD. The use of third party gateways and multiplexers is not acceptable. All protocols shall be "certified" by the governing authority. Use of non-certified protocols is not allowed. The VFD shall allow the DDC system to control the digital and analog outputs of the drive to the serial interface. This control shall be independent of any VFD function. In addition, all the digital and analog inputs of the drive shall be capable of being monitored by the DDC system.

Drive supplier shall provide jobsite start-up, Owner training, and a one-year parts and on-site labor warranty. Multiple visits shall be included to allow for tuning and troubleshooting of the controls system as required.

N. ELECTRICAL WIRING

High voltage wiring is defined as 50 Volts or higher. Low voltage wiring is defined as less than 50 Volts. Line voltage wiring shall be provided by Division 26. Line voltage control and interlock wiring for mechanical systems shall also be provided by Division 26. Low voltage control wiring shall be provided by Division 23. Furnish wiring diagrams to Division 26 as required for proper equipment hookup. Coordinate with Division 26 the actual wire sizing amps for mechanical equipment (from the equipment manufacturer) to ensure proper installation.

Provide power and communication wiring with transient protection in accordance with IEEE C62.41.2. All control and interlock wiring shall comply with the NEC. Control wiring shall be sized to accommodate the voltage drop associated with the distance between the control device and the controller. Control wiring not installed in conduit shall be UL rated for plenum installation. All NEC Class 1 (line voltage) wiring shall be UL listed in approved raceway according to the NEC and Division 26 requirements. Maximum allowable voltage for control wiring shall be 120 V. All voltage of communication wiring shall be independent of any VFD function. In addition, all the digital and analog inputs of the drive shall be capable of being monitored by the DDC system.

Conduit for Control Wiring - EMT with compression fittings, cold rolled steel, zinc coated or zinc-coated rigid steel with threaded connections.


Pull and Junction Boxes: Size according to number, size, and position of entering raceway as required by National Electrical Codes. Enclosure type shall be suited to location.

Install wiring parallel to building lines wherever possible. Conceal all control wiring in finished rooms. Do not install Class 2 wiring in raceway containing Class 1 wiring. Boxes and panels containing high voltage wiring and equipment may not be used for low-voltage wiring except for the purpose of interfacing the two wires (e.g., relays and transformers). All wire-to-device and wire-to-wire connections shall be made at a terminal block or patch strip. All runs of communication wiring shall be unspliced length when that length is commercially available. Verify the integrity of the entire network following the cable installation. Use appropriate test procedures for each particular cable. Label all wiring and cabling at each end within 2 inches of termination with the controller termination number. Label control devices used in the system with permanent labels using the identifiers that match the record documents.

O. EQUIPMENT FURNISHED BY OTHERS

Provide necessary equipment and accessories that are not provided by the equipment supplier or Owner to complete installation of equipment furnished by others in locations as indicated on the drawings, specified herein, or both. Equipment and accessories not provided by the equipment supplier may include, but not be limited to, fuses, intakes, associated roof jacks and caps to outdoors, dampers, in-line fans, roof fans, and control interlocks, etc. as required for proper operation of the complete system in accordance with the manufacturer's instructions.


Contractor shall be responsible for correct rough-in dimensions and shall verify them with Architect and/or equipment supplier prior to service installations.

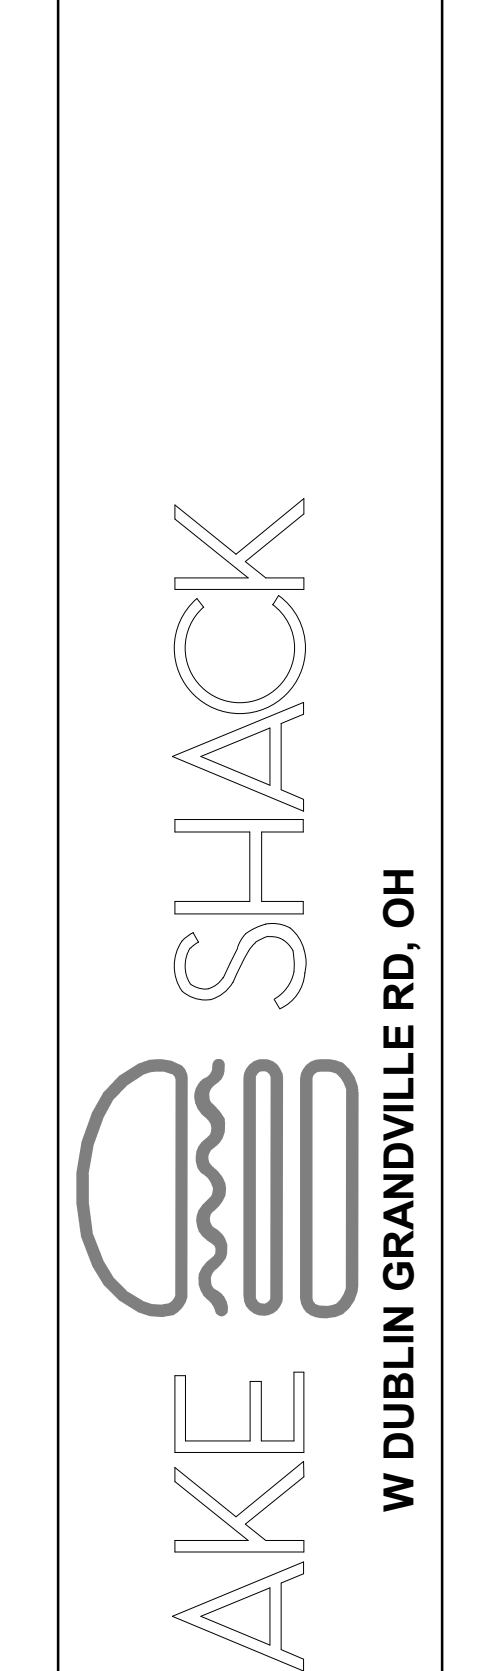


FIELD VERIFICATION
 Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies as soon as they begin or later, but not later than 7 days after start of work. Do not state these drawings.

COPYRIGHT
 Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without written consent of Aria Group Architects, Inc.


NO.	DATE	REVISIONS	REMARKS
3	05/20/2022	ISSUE FOR CONSTRUCTION	
2	01/25/2022	ADDENDUM #2	
1	01/14/2022	ADDENDUM #1	
	11/15/2021	ISSUE FOR PERMIT/BD	
	10/25/2021	LANDLORD REVIEW SET	

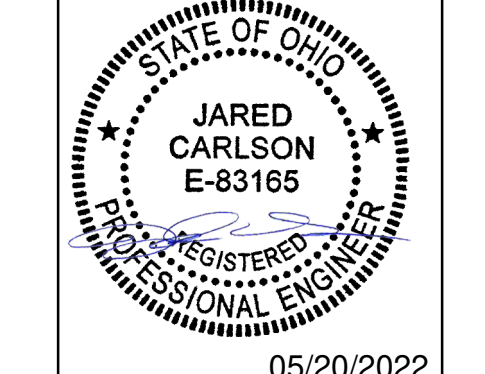

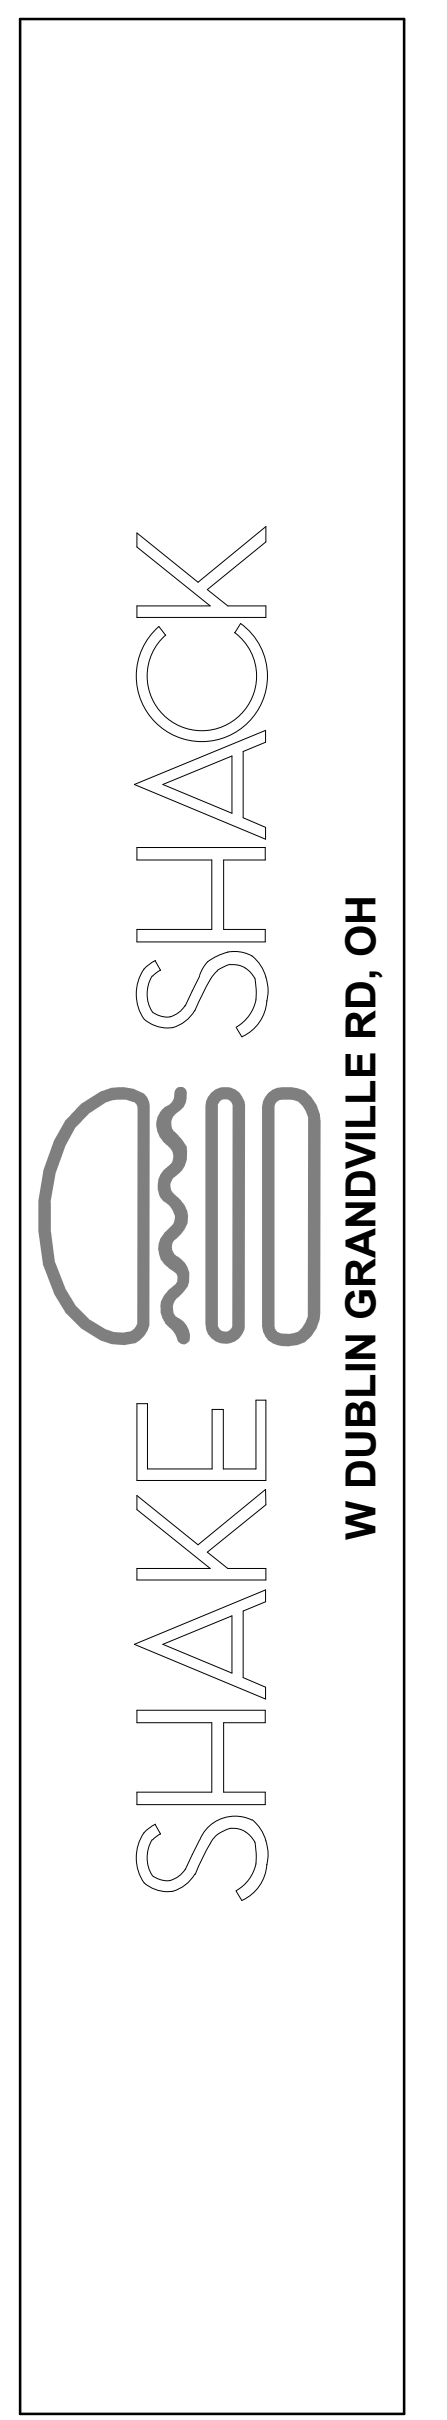

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/IBD
	10/25/2021	LANDLORD REVIEW SET

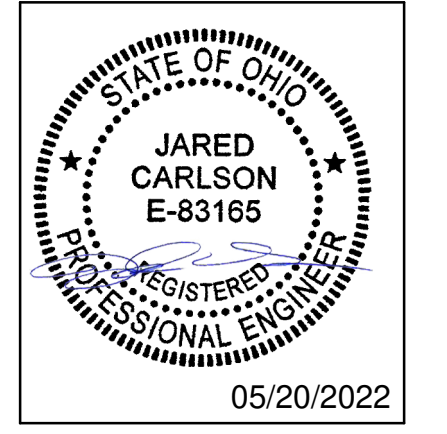

Drawing Title
MECHANICAL SPECIFICATIONS

Job No. 2150002415
Drawn Author

Scale Date 11/12/2021

Sheet No.
M592

- 3.9 AC MOTORS**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: Perform the following checks during start-up and as specified in manufacturer's instructions:
 1. Verify proper alignment, installation, and rotation.
 2. Verify properly sized overloads are in place.
 - c. Start-Up Tests: Perform the following tests, measurements, or procedures during start-up and as specified in the manufacturer's instruction:
 1. Measure voltage available to all phases. Measure amps and RPM after motor has been placed in operation and under load.
 2. Record all motor nameplate data.
- 3.10 PACKAGED HEATING AND COOLING UNITS**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Refer to AC Motors in this section.
 - c. General: Provide the services of a factory-authorized service representative to test and inspect unit installation, provide startup service, and to demonstrate and train Owner's maintenance personnel is required by the Owner.
 - d. Start-Up Checks: Perform the following inspections/checks during start-up:
 1. Test controls and demonstrate compliance with requirements. Replace damaged or malfunctioning controls and equipment.
 2. Install new filters after start-up.
- 3.11 TERMINAL UNITS**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: Perform the following inspections/checks during start-up:
 1. After construction is completed, including painting if applicable, clean unit exposed surfaces.
 2. Clean factory-finished surfaces. Repair any marred or scratches surfaces with manufacturer's touch-up paint.
 3. Verify adequate access for maintenance.
 4. Check power and control voltages.
 5. Check rotation of fan where applicable.
 6. Check operation of water leak sensors.
 7. Check calibration and operation of the controlling elements.
 8. Check control valves for required close-off and full position.
 9. Install new filter units for terminals requiring same.
- 3.12 FANS**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. General: Provide the services of a factory-authorized service representative to test and inspect exhaust fan installation, provide startup service, and to demonstrate and train Owner's maintenance personnel is required by the Owner.
 - c. Start-Up Checks: Perform the following inspections/checks during start-up:
 1. Inspect the field assembly of components and installation of the units, piping, ductwork, and electrical connections.
 2. Clean unit cabinet interiors to remove foreign material and construction dirt and dust. Vacuum clean fan wheel, fan cabinet, coils entering air face. Ensure volatile irritants are contained and kept out of occupied spaces.
 3. Adjust and lubricate dampers and linkages for proper damper operation.
 4. Verify the unit is secure on mountings and supporting devices and connections for ductwork, and electrical are complete. Verify proper thermal overload protection is installed in motors, starters, and disconnects.
 5. Ensure vibration isolation integrity is maintained with the fan installation and associated connections.
 6. Lubricate bearings, pulleys, belts, and other moving parts with factory-recommended lubricants.
 7. Stroke all dampers to ensure free and full travel.
- 3.13 DUCTWORK ACCESSORIES**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: Perform the following checks during start-up and as specified:
 1. Cleaning: Clean factory-finished surfaces. Repair any marred or scratches surfaces with manufacturer's touch-up paint.
 - c. Start-Up Tests: In addition to specifications, perform the following as a minimum:
 1. Operate installed ductwork accessories to demonstrate compliance with requirements. Test for air leakage while system is operating. Repair or replace faulty accessories, as required to obtain proper operation and leak proof performance.
 2. Label access doors in accordance with Division 21 Section "Mechanical Identification"
 3. Adjusting: Adjust ductwork accessories for proper settings, install fusible links in fire dampers and adjust for proper action.

END OF SECTION 23

9. COMMISSIONING OF MECHANICAL SYSTEMS
Commissioning of HVAC System

- A. PART 1 GENERAL**
- 1.1 SUMMARY**
- a. Section includes Cx process requirements for the following HVAC systems, assemblies, and equipment:
 1. Air handling units (Supply fans, return fan, packaged units, roof top units, specialized fans)
 2. Exhaust fans
 3. Fan coil units and terminal units
 4. Condensing units
 5. Make-Up air units
 6. Ductwork and piping
 - b. Related Requirements:
 1. Section 019113 "General Commissioning Requirements" for general Cx process requirement and CxA responsibilities.

- 1.2 INFORMATIONAL SUBMITTALS**
- a. Construction Checklists: Draft construction checklists will be created by CxA for Contractor review.
 - b. Construction Checklists: Installation and Performance test checklists for systems, assemblies, subsystems, equipment, and components to be part of the Cx process and according to requirement in Section 019113 "General Commissioning Requirements".
 1. Refrigerant piping, including the following:
 - a. Refrigerant piping, fittings, and specialties.
 - b. Refrigerant charge.
 - c. General duty and specialty valves.
 - d. Meters and gauges.
 2. Air distribution systems, including the following:
 - a. Supply, return, and exhaust systems.
 - b. Metal ducts, liners, and fittings.
 - c. Nonmetal ducts and fittings.
 - d. Air-duct accessories, including volume dampers, fire and smoke dampers, turning vanes, sound attenuators, and flexible connectors.
 3. Kitchen exhaust system, including the following:
 - a. Exhaust and makeup air system.
 - b. Metal ducts, liners, and fittings.
 - c. Air-duct accessories, including volume dampers, fire and smoke dampers, turning vanes, sound attenuators, and flexible connectors.
 - d. Duct-mounted access doors and panels.
 4. Make-Up air unit
 5. Air-handling equipment, including the following:
 - a. Fans and motors.
 - b. Indoor air-handling units with and without coils, dampers, and filters.
 - c. Outdoor air-handling units with and without coils, dampers, and filters.

- B. PART 3 EXECUTION**
- 3.1 CONSTRUCTION CHECKLISTS**
- a. Complete detailed construction checklists (prefunctional checklists) prepared by the CxA for HVAC systems, assemblies, subsystems, equipment, and components.
 1. Air and hydronic distribution systems, including the following:
 - a. Supply, return, outdoor-air, and exhaust-air distribution systems.
 - b. Automatic dampers.
 - c. Control valves.
 2. Heating and cooling terminal and unitary equipment, including the following:
 - a. Unit heaters.
 - b. Fan coil units.
 - c. Electric heating.
 - 3. TAB verification.

- 3.2 CONSTRUCTION CHECKLIST REVIEW**
- a. Review and provide written comments on draft construction checklists. CxA will create required draft construction checklists and provide item to Contractor.
 - b. Return draft construction checklist review comments within 5 days of receipt.
 - c. When review comments have been resolved, the CxA will provide final construction checklists marked "Approved for Use, (date)".
 - d. Use only construction checklists marked "Approved for Use, (date)".

- 3.3 Cx TESTING PREPARATION**
- a. Certify that HVAC systems, subsystems, and equipment have been installed, calibrated, and started and that they are operating according to the Contract Documents and approved submittals.
 - b. Set systems, subsystems, and equipment into operating mode to be tested according to approved test procedures (for example, normal shutdown, normal auto position, normal manual position, unoccupied cycle, and alarm conditions).

- 3.4 Cx TESTS COMMON TO HVAC SYSTEMS**
- a. Comply with construction checklist requirements, including installation checks, startup, and performance tests requirements for HVAC systems and equipment.
 - b. Measure capacities and effectiveness of systems, assemblies, subsystems, equipment and components, including operational and control functions, to verify compliance with acceptance criteria.
 - c. Coordinate schedule with, and perform Cx activities at the direction of CxA.
 - d. Provide technicians, instrumentation, tools, and equipment to perform and document the following:
 1. Construction checklist verification tests.
 2. Construction checklist verification tests demonstrations
 3. Cx test demonstrations.

- 3.5 START-UP DOCUMENTATION COMMON TO ALL SYSTEMS**
- a. The following Start-Up Documentation (Checklists and Tests) shall be considered common to all systems:
 1. Checkout shall proceed from lower level devices to larger components to the entire system operation.
 2. Verify labeling is affixed per specification and visible.
 3. Verify prerequisite procedures are done.
 4. Inspect for damage and ensure none is present.
 5. Verify system is installed per the manufacturer's recommendations.
 6. Verify system has undergone Start-Up per the manufacturer's recommendations.
 7. Verify that access is provided for inspection, operation and repair.
 8. Verify that access is provided for eventual replacement of the equipment.
 9. Verify that record drawings, submittal data and O&M documentation accurately reflect the installed systems.
 10. Verify all gauges and test ports are provided as required by contract documents and manufacturer's recommendations.
 11. Verify all recorded nameplate data is accurate.
 12. Verify that the installation ensures safe operation and maintenance.
 13. Verify all rotating and moving parts are properly lubricated.
 14. Verify specified replacement material/stock has been provided as required by the Contract Documents.
 15. Verify all monitoring and ensure all alarms are active and set per requirements.

- 3.6 MECHANICAL IDENTIFICATION**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: Perform the following checks:
 1. Verify all valve tags, piping, duct, and equipment labeling corresponds with drawings and indexes and meets requirements specified. Correct any deficiencies for all piping and duct system.
 2. Adjusting: Relocate any mechanical identification device which has become visually blocked by work of this division or other divisions.
 3. Cleaning: Clean face of identification devices, and glass frames of valve charts.

- 3.7 MECHANICAL INSULATION**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: Examine all piping, systems and equipment specified to be insulated.
 1. Ensure quality of insulation. Patch and repair all insulation damaged after installation.
 2. Ensure the integrity of vapor barrier around all cold surfaces.

- 3.8 PIPING GENERAL**
- a. Include all applicable "Start-Up Checks Common to All Systems".
 - b. Start-Up Checks: These procedures apply to all installed piping systems, including underground site utilities and adequate isolation valves for required service.
 1. Inspect all piping for proper installation, adequate support (with appropriate vibration isolation where applicable) and adequate isolation valves for required service.
 2. Provide notifications of pipe cleaning and flushing activities.
 3. Flush and clean all piping and clean all strainers. Provide documentation of all related procedures.
 4. Ensure adequate drainage is provided at low points and venting is provided at high points.
 5. Ensure facilities to effectively drain and fill the system are in place.
 6. Ensure air is thoroughly removed from the system as applicable.
 7. Provide notification of pressure testing.
 8. Pressure and/or leak test all applicable systems in accordance with the requirements in the applicable Division 23 specification.
 9. Sterilize applicable piping systems as specified in the individual sections and as required by regulatory authorities.
 10. Submit pressure test reports that document the pressure testing results with certification of the results. Include drawings/diagrams indicating sections of pipe that are tested with the corresponding report.
 11. Set and adjust fill, pressure, or level controls to the required setting.

ROOFTOP UNIT CONTROL MATRIX. Table with columns: CONTROL FEATURE, UNITS, RTU-1 DINING SETPOINT OR Y/N, RTU-2 KITCHEN SETPOINT OR Y/N, NOTES. Rows include SETPOINTS, PROGRAMMED CONTROL FEATURES, SAFETIES, INTERLOCKS, AND ALARMS, and DIV. 23 CONTRACTOR SHALL PROVIDE CONTROL PANEL(S), WIRING, THERMOSTAT(S), TEMPERATURE SENSOR(S), HUMIDISTAT(S), AND/OR CO2 SENSOR(S) WHERE SHOWN ON THE DRAWINGS AND AS REQUIRED TO FACILITATE THE SCHEDULED CONTROL MODULES AND SEQUENCES OF OPERATION.

ROOFTOP UNIT SCHEDULE (DX COOLING, NATURAL GAS HEAT). Table with columns: MARK, MANUFACTURER, MODEL, NOMINAL TONS, UNIT TYPE, SUPPLY FAN (CFM, ESP, BHP, VFD), COOLING COIL (TH, SH, EAT, LAT, REFR, MIN EFF, MIN NO, MIN OUT, NOM INPUT, MIN EFF, EAT, LAT, MIN NO, MIN OUT), HEAT EXCHANGER (MIN OIA, VIPH, MCA, MOCP, DISC, STARTER), WEIGHT (LBS), NOTES. Includes RTU-1 and RTU-2 units.

ROOFTOP UNIT SCHEDULE (DX COOLING, NATURAL GAS HEAT). Table with columns: MARK, MANUFACTURER, MODEL, UNIT TYPE, SUPPLY FAN (CFM, ESP, BHP, VFD), COOLING COIL (TH, SH, EAT, LAT, REFR, MIN EFF, MIN NO, MIN OUT, NOM INPUT, MIN EFF, EAT, LAT, MIN NO, MIN OUT), HEAT EXCHANGER (MIN OIA, VIPH, MCA, MOCP, DISC, STARTER), WEIGHT (LBS), NOTES. Includes RTU-2 unit.

AIR CURTAIN SCHEDULE. Table with columns: MARK, SERVICE AREA, MANUFACTURER, MODEL, UNIT SPECS (LENGTH, MAX AIRFLOW, HEATING CAPACITY, MOTOR), VIPH/HZ, NOTES. Includes AC-1 unit.

FAN COIL UNIT SCHEDULE (HEAT PUMP). Table with columns: MARK, MFR, MODEL, SUPPLY FAN (CFM, ESP, NOM, TH, SH), COOLING COIL (EAT, LAT, REFR, MIN OUT, AMBIENT, EAT, LAT), HEAT PUMP HEATING COIL (MIN OIA, VIPH, MCA, MOCP, DISC), WEIGHT (LBS), NOTES. Includes FCU-1 unit.

BUILDING AIR BALANCE SUMMARY NORMAL OPERATION. Table with columns: UNIT NO., SUPPLY (CFM), OUTDOOR (CFM), EXHAUST (CFM), PERCENT OAVSA. Includes RTU-2, RTU-1, FCU-1, KEF-1, KEF-2, KEF-3, KEF-4, EF-1, and TOTAL.

NATURAL GAS-FIRED INFRARED HEATERS. Table with columns: MARK, MANUFACTURER, MODEL, HEATER LENGTH, DIMENSIONS (L x W x H (IN.)), HEATING CAPACITY (MBH), MIN. HTG. EFFICIENCY, MIN. NO. STAGES, GAS PRESS. (MIN/MAX), CLEARANCE TO COMBUSTIBLES (FT), WEIGHT (LBS), NOTES. Includes BH 1-7 unit.

HEAT PUMP CONDENSING UNIT SCHEDULE. Table with columns: MARK, SERVICE, MANUFACTURER, MODEL, REFR. TYPE, COOLING CAPACITY (TH, AMBIENT, MIN EFF, CAP, AMBIENT, MIN EFF, COP 47°F), HEATING CAPACITY (MCA, MOCP, VIPH), ELECTRICAL, WEIGHT (LBS), NOTES. Includes CU-1 unit.

UNIT HEATER SCHEDULE (ELECTRIC). Table with columns: MARK, MANUFACTURER, MODEL, OUTPUT (MBH), OUTPUT (KW), MIN. NO. OF STAGES, CFM, MAX AMPS, VIPH, NOTES. Includes EUH-1 and EUH-2 units.

PROJECT DESIGN CONDITIONS. Table with columns: CLIMATE CONDITIONS (WEATHER STATION, CLIMATE ZONE, HEATING (DB), COOLING (DB/MCWB)), BUILDING (MONDAY-FRIDAY, SATURDAY, SUNDAY, HOLIDAY), SPACE / UNIT DESCRIPTION, SET POINTS (COOLING / DE-HUMIDIFICATION, HEATING, HUMIDIFICATION, ZONE VENTILATION RESET), SPACE OPERATING HOURS (M.F., SAT, SUN), NOTES.

GRILLE, REGISTER, AND DIFFUSER SCHEDULE. Table with columns: MARK, MANUFACTURER, SERVICE, MODEL, CONSTRUCTION MATERIAL, FACE LOCATION, MOUNTING TYPE, FACE SIZE (IN), MAX. NC, NOTES. Includes CEG, CRG, CSD1, CSD2, CSO3, WRG, WSR units.

OUTSIDE AIR REQUIREMENTS, IMC-2015 (IP). Table with columns: SYSTEM DESIGNATION, SYSTEM TAB NAME OR LIST 'SINGLE', SINGLE-ZONE SYSTEM ASSOCIATED VENTILATION ZONE, SINGLE ZONE WORST CASE SYSTEM VENTILATION EFFECTIVENESS [E2], MULTI-ZONE SYSTEMS ONLY SYSTEM VENTILATION EFFICIENCY [EV], FLOOR AREA SERVED BY SYSTEM [A2] (SF), SYSTEM AVERAGED AREA-BASED OUTDOOR AIR RATE (CFM/SF), SYSTEM POPULATION (PEOPLE), SYSTEM AVERAGED PEOPLE-BASED OUTDOOR AIR RATE (CFM/PERSON), REQUIRED OA INTAKE [V0] (CFM), REQUIRED DCV OA INTAKE [V0] (CFM), DESIGN OA INTAKE FLOW [V0] (CFM), NOTES.

MECHANICAL SCHEDULES. Table with columns: Job No., Drawn, Scale, Date, Sheet No., M601. Includes drawing title, scale, date, and sheet number.

JARED P. CARLSON 5/20/2022 1:33:45 PM C:\Revit\Projects\2150002415_MEP_V01_andrew.pettus_20220519161918.rvt

COMcheck Software Version 4.1.5.1
Mechanical Compliance Certificate

Project Information

Energy Code: 90.1 (2010) Standard
Project Title: Shake Shack
Location: Dublin (Franklin), Ohio
Climate Zone: 5a
Project Type: New Construction

Construction Site: Dublin, OH
Owner/Agent: Shake Shack
Designer/Contractor: Henderson Engineers Inc. Lenexa, KS

Mechanical Systems List

Quantity System Type & Description

1 RTU-1 (Single Zone):
Heating: 1 each - Other, Gas, Capacity = 184 kBtu/h
No minimum efficiency requirement applies
Cooling: 1 each - Single Package DX Unit, Capacity = 118 kBtu/h, Air-Cooled Condenser, Air Economizer
Proposed Efficiency = 11.50 SEER, Required Efficiency: 11.00 SEER
Fan System: RTU-1 | Quiescing - Compliance (Brake HP method): Passes
Fans:
RTU1 Supply, Constant Volume, 3200 CFM, 1.0 motor nameplate hp, 1.1 design brake hp (1.1 max. BHP)
1 FCU-1 (Single Zone):
Cooling: 1 each - Split System, Capacity = 11 kBtu/h, Air-Cooled Condenser
Proposed Efficiency = 19.00 SEER, Required Efficiency: 13.00 SEER
Fan System: FCU-1 | Office - Compliance (Motor nameplate HP method): Passes
Fans:
FCU1 Supply, Constant Volume, 420 CFM, 0.1 motor nameplate hp
1 DOAS-1 (Single Zone):
Heating: 1 each - Other, Gas, Capacity = 291 kBtu/h
No minimum efficiency requirement applies
Cooling: 1 each - Single Package DX Unit, Capacity = 264 kBtu/h, Air-Cooled Condenser, Air Economizer
Proposed Efficiency = 10.00 SEER, Required Efficiency: 9.80 SEER + 9.8 PLV
Fan System: DOAS-1 | Kitchen & BOH - Compliance (Brake HP method): Passes
Fans:
DOAS1 Supply, Constant Volume, 4900 CFM, 5.0 motor nameplate hp, 3.5 design brake hp (3.5 max. BHP)

Mechanical Compliance Statement

Compliance Statement: The proposed mechanical design represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 90.1 (2010) Standard requirements in COMcheck Version 4.1.5.1 and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Andrew Pettus - Mechanical Designer
Name - Title: Andrew Pettus, Mechanical Designer
Signature: [Signature]
Date: 10/14/2021

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 1 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Mechanical Rough-In Inspection	Plans Verified Value	Field Verified Value	Complies?	Comments/Assumptions
6.4.4.1.2 [ME8]	HVAC ducts and plenums insulated. Where ducts or plenums are installed in or under a slab, verification may need to occur during Foundation Inspection.	R_____	R_____	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.4.1.3 [ME9]	HVAC piping insulation thickness. Where piping is installed in or under a slab, verification may need to occur during Foundation Inspection.	_____ in.	_____ in.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.4.1.4 [ME41]	Thermally ineffective panel surfaces of sensitive heating panels have insulation >= R-3.5.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.4.2.1 [ME10]	Ducts and plenums sealed based on static pressure and location.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.4.2.2 [ME11]	Ductwork operating >3 in. water column requires air leakage testing.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.4.2.2 [ME11]	Ductwork operating >3 in. water column requires air leakage testing.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
6.4.4.2.2 [ME11]	Ductwork operating >3 in. water column requires air leakage testing.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.1.6.5 1.1.6.5.1 [ME12]	Air economizers provided where required, meet the requirements for design capacity, control signal, ventilation controls, high-limit shut-off, integrated economizer control, and provide a means to relieve excess outside air during operation.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
6.5.1.6.5 1.1.6.5.1 [ME12]	Air economizers provided where required, meet the requirements for design capacity, control signal, ventilation controls, high-limit shut-off, integrated economizer control, and provide a means to relieve excess outside air during operation.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	
6.5.2.3 [ME19]	Dehumidification controls provided to prevent reheating, recirculating, mixing of hot and cold airstreams or concurrent heating and cooling of the same airstream.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.3.3 [ME42]	Multiple zone VAV systems with DDC of individual zone boxes have static pressure setpoint reset controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 5 of 10
OH0000Energy\COMcheck.cck

COMcheck Software Version 4.1.5.1
Inspection Checklist

Energy Code: 90.1 (2010) Standard

Requirements: 100.0% were addressed directly in the COMcheck software

Text in the "Comments/Assumptions" column is provided by the user in the COMcheck Requirements screen. For each requirement, the user certifies that a code requirement will be met and how that is documented, or that an exception is being claimed. Where compliance is itemized in a separate table, a reference to that table is provided.

Section # & Req.ID	Plan Review	Complies?	Comments/Assumptions
4.2.2.4.4 4.2.1.6.7 [PR2]	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the mechanical systems and equipment and document where exceptions to the standard are claimed. Load calculations per acceptable engineering standards and handbooks.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
4.2.2.4.4 1.1.8.4.1 2.8.7 [PR6]	Plans, specifications, and/or calculations provide all information with which compliance can be determined for the electrical systems and equipment and document where exceptions are claimed. Feeder conductors sized in accordance with approved plans and branch circuits sized for maximum drop of 3%.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.7.2.4 [PR3]	Detailed instructions for HVAC systems commissioning included on the plans or specifications for projects >=50,000 ft2.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 2 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Mechanical Rough-In Inspection	Plans Verified Value	Field Verified Value	Complies?	Comments/Assumptions
6.5.3.3 [ME42]	Multiple zone VAV systems with DDC of individual zone boxes have static pressure setpoint reset controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply. See the Mechanical Systems list for values.
6.5.3.3 [ME42]	Multiple zone VAV systems with DDC of individual zone boxes have static pressure setpoint reset controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.
6.5.4.1 [ME25]	HVAC pumping systems >10 hp designed for variable fluid flow.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.6.1 [ME56]	Exhaust air energy recovery on systems meeting Table 6.5.6.1.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.7.1.1 [ME32]	Kitchen hoods >=5,000 cfm have make up air >=50% of exhaust air volume.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.7.1.2 [ME46]	Conditioned supply air to space with a kitchen hood shall not exceed the greater of a) supply flow required to meet space heating or cooling, or b) hood exhaust flow minus the available air transfer from available spaces.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.7.1.2 [ME46]	Conditioned supply air to space with a kitchen hood shall not exceed the greater of a) supply flow required to meet space heating or cooling, or b) hood exhaust flow minus the available air transfer from available spaces.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
6.5.7.1.2 [ME46]	Conditioned supply air to space with a kitchen hood shall not exceed the greater of a) supply flow required to meet space heating or cooling, or b) hood exhaust flow minus the available air transfer from available spaces.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.7.1.5 [ME49]	Approved field test used to evaluate design air flow rates and demonstrate proper capture and containment of kitchen exhaust systems.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.7.2 [ME33]	Fume hoods exhaust systems >=15,000 cfm have VAV hood exhaust and supply systems direct make-up air or heat recovery.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.8.1 [ME34]	Unenclosed spaces that are heated use only radiant heat.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 6 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Footings / Foundation Inspection	Complies?	Comments/Assumptions
6.4.3.8 [F03]	Freeze protection and snow/ice melting system sensors for future connection to controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 3 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Mechanical Rough-In Inspection	Plans Verified Value	Field Verified Value	Complies?	Comments/Assumptions
6.5.9 [ME5]	Hot gas bypass limited to: <=240 kBtu/h - 50% >240 kBtu/h - 25%			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.9 [ME5]	Hot gas bypass limited to: <=240 kBtu/h - 50% >240 kBtu/h - 25%			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.5.9 [ME5]	Hot gas bypass limited to: <=240 kBtu/h - 50% >240 kBtu/h - 25%			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 7 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Mechanical Rough-In Inspection	Plans Verified Value	Field Verified Value	Complies?	Comments/Assumptions
6.4.1.4.6 4.1.5 [ME1]	HVAC equipment efficiency verified. Non-IEA HVAC equipment labeled as meeting 90.1.	Efficiency: _____	Efficiency: _____	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	See the Mechanical Systems list for values.
6.4.3.4.1 [ME3]	Stair and elevator shaft vents have motorized dampers that automatically close.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
6.4.3.4.2 6.4.3.4.3 [ME4]	Outdoor air and exhaust systems have motorized dampers that automatically shut when not in use and meet maximum leakage rates. Check gravity dampers where allowed.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.4.5 [ME39]	Enclosed parking garage ventilation has automatic contaminant detection and capacity to stage or modulate fans to 50% or less of design capacity.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
6.4.3.4.4 [ME5]	Ventilation fans >0.75 hp have automatic controls to shut off fan when not required.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.9 [ME3]	Demand control ventilation provided for spaces >500 ft2 and >=40 people/1000 ft2 occupant density and served by systems with air side economizer, auto modulating outside air damper control, or design airflow >=3,000 cfm.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.
6.4.3.10 [ME40]	Single zone HVAC systems with fan motors >=5 hp have variable airflow controls. Air conditioning equipment with a cooling capacity >=110,000 Btu/h has variable airflow controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.
6.4.3.10 [ME40]	Single zone HVAC systems with fan motors >=5 hp have variable airflow controls. Air conditioning equipment with a cooling capacity >=110,000 Btu/h has variable airflow controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.
6.4.3.10 [ME40]	Single zone HVAC systems with fan motors >=5 hp have variable airflow controls. Air conditioning equipment with a cooling capacity >=110,000 Btu/h has variable airflow controls.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met. See the Mechanical Systems list for values.
6.4.4.1.1 [ME7]	Insulation exposed to weather protected from damage. Insulation outside of the conditioned space and associated with cooling systems is vapor resistant.			<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 4 of 10
OH0000Energy\COMcheck.cck

Section # & Req.ID	Rough-In Electrical Inspection	Complies?	Comments/Assumptions
8.4.2 [EL10]	At least 50% of all 125 volt 15- and 20-amp receptacles are controlled by an automatic control device.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
10.4.1 [EL9]	Electric motors meet requirements where applicable.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)

Project Title: Shake Shack
Data file name: \\hei-kc.com\fs\jobs\Lenexa\Programs\P-T\Shake Shack\2150002415 Shake Shack 1372 - Dubli Page 8 of 10
OH0000Energy\COMcheck.cck

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REMARKS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #1
1	01/14/2022	ADDENDUM #2
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

NO. DATE REMARKS
REVISIONS

STATE OF OHIO
JARED CARLSON
E-83165
REGISTERED PROFESSIONAL ENGINEER
05/20/2022

Drawing Title
MECHANICAL ENERGY CODE COMPLIANCE

Job No. 2150002415
Drawn: AJP

Scale: N.T.S.
Date: 11/12/2021

Sheet No.
M630


Section # & Req.ID	Final Inspection	Complies?	Comments/Assumptions
6.4.3.1.2 [F13]	Thermostatic controls have a 5 °F deadband.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.2 [F12]	Temperature controls have setpoint overlap restrictions.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.1.1 [F12]	HVAC systems equipped with at least one automatic shutdown control.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.2.2 [F12]	Setback controls allow automatic restart and temporary operation as required for maintenance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.4.3.7 [F16]	When humidification and dehumidification are provided to a zone, simultaneous operation is prohibited.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.7.2.1 [F17]	Furnished HVAC as-built drawings submitted within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.7.2.2 [F18]	Furnished O&M manuals for HVAC systems within 90 days of system acceptance.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
6.7.2.3 [F19]	An air and/or hydronic system balancing report is provided for HVAC systems serving zones >3,000 ft ² of conditioned area.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.
6.7.2.4 [F10]	HVAC control systems have been tested to ensure proper operation, calibration and adjustment of controls.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Requirement will be met.
10.4.3 [F14]	Elevators are designed with the proper lighting, ventilation power, and standby mode.	<input type="checkbox"/> Complies <input type="checkbox"/> Does Not <input type="checkbox"/> Not Observable <input type="checkbox"/> Not Applicable	Exception: Requirement does not apply.

Additional Comments/Assumptions:

1 High Impact (Tier 1) 2 Medium Impact (Tier 2) 3 Low Impact (Tier 3)


Project Title: Shake Shack Report date: 10/14/21
Data filename: \\hni-kc.com\rs\jobs\Leneka\Programs\T\Shake Shack\2150002415 Shake Shack 1372 - Dubl Page 9 of 10
OH000EnergyCOMcheck.cck

Project Title: Shake Shack Report date: 10/14/21
Data filename: \\hni-kc.com\rs\jobs\Leneka\Programs\T\Shake Shack\2150002415 Shake Shack 1372 - Dubl Page 10 of 10
OH000EnergyCOMcheck.cck

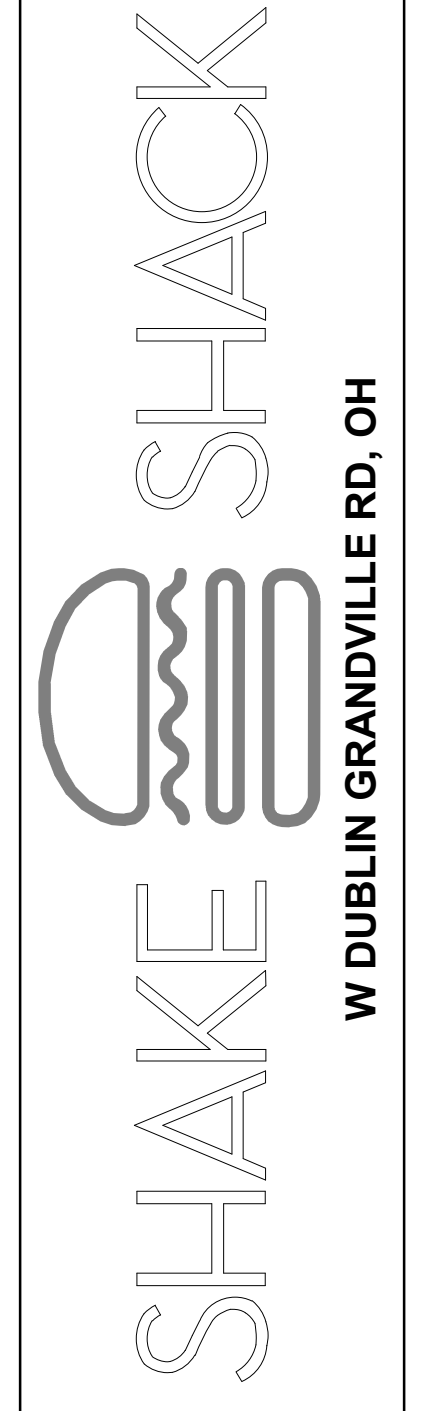

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

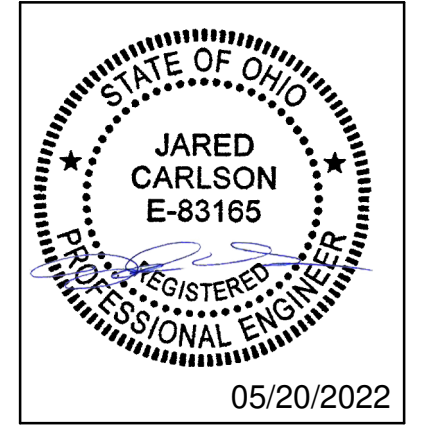


Drawing Title
MECHANICAL ENERGY CODE COMPLIANCE

Job No. 2150002415 Drawn AJP

Scale N.T.S. Date 11/12/2021

Sheet No.
M631

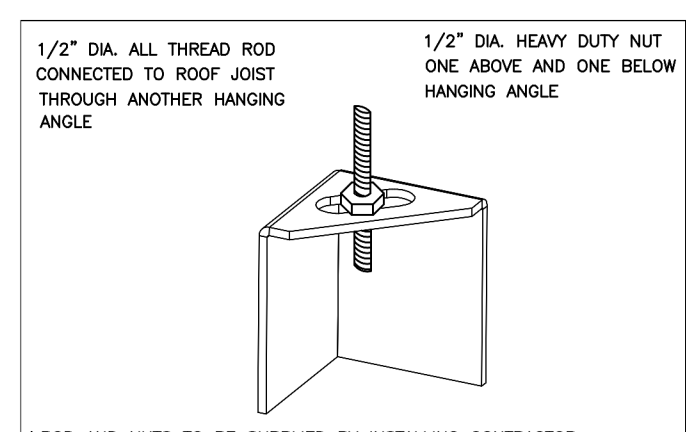

HANGING ANGLE DETAILS

HOOD STYLE / MODEL	45° DEGREES cfm/ft.	60° DEGREES cfm/ft.	70° DEGREES cfm/ft.
CANOPY ND-2	150	200	250
CANOPY ND-2 w/ END PANELS	105	140	175
SLOPED SMD-2	228	294	-
ISLAND ND-2W	269	300	350
ISLAND ND-2I	346	422	475

ETL HOOD LISTING DETAIL

EXHAUST CFM = LENGTH OF HOOD X CFM/FT. (LAMB)
SUPPLY CFM = EXHAUST CFM X PERCENTAGE REQUIRED
TOTAL DUCT AREA (sq. in.) = 144 x CFM / FPM
DUCT LENGTH = TOTAL DUCT AREA / DUCT WIDTH

*CAPTIVEAIRE VENTILATOR DUCT SIZES ARE CALCULATED USING AN EXHAUST VELOCITY OF 1000-1200 FPM AND A SUPPLY VELOCITY OF 1000 FPM.

CALCULATIONS UTILIZED

CAPTIVE-AIRE HOODS BUILT IN COMPLIANCE WITH:

BUILDING CODES

CAPTIVE-AIRE HOODS HAVE OPTIONAL CLEARANCE REDUCTION SYSTEMS AVAILABLE AS FOLLOWS:

MATERIAL	CLEARANCE	REDUCTION SYSTEM
NON-COMBUSTIBLE	NONE REQUIRED	
LIMITED-COMBUSTIBLE	3" UNINSULATED STANDOFF	
COMBUSTIBLE	1" INSULATED STANDOFF	

CLEARANCE TO COMBUSTIBLES

INSTALLATION


- ALL ELECTRICAL "FIELD" CONNECTIONS AND RELATED INTERCONNECTIONS BY ELECTRICAL CONTRACTORS.
- ALL PLUMBING "FIELD" CONNECTIONS AND RELATED INTERCONNECTIONS BY PLUMBING CONTRACTORS.
- HANGING BRACKETS LOCATED AND WELDED AS SHOWN ON PLANS. ALL OTHER HANGER MATERIALS PROVIDED BY INSTALLING CONTRACTORS.
- ALL CONNECTIONS FROM CAPTIVEAIRE HOOD PER MECHANICAL CONTRACTOR'S PLANS.
- COOKING EQUIPMENT TO SHUT OFF IN EVENT OF FIRE.
- EXHAUST FANS TO TURN ON IN EVENT OF FIRE.
- ALL LIGHT FIXTURES SHOWN INSTALLED BY CAPTIVEAIRE ARE FACTORY PROVIDED. INTERCONNECTIONS BETWEEN HOODS AND TO SWITCHES ARE BY ELECTRICAL CONTRACTOR.
- LAMPS FOR LIGHT FIXTURES BY INSTALLING CONTRACTORS.
- SEISMIC RESTRAINTS ARE RESPONSIBILITY OF INSTALLING CONTRACTOR.
- INSTALLING CONTRACTORS ASSUME ALL RELATED RESPONSIBILITY FOR VERIFICATION OF DIMENSIONAL DATA CONTAINED ON THESE DOCUMENTS FOR ACCURACY, INTERPRETATION AND ADMINISTRATION OF CODE REQUIREMENTS IN EFFECT PRIOR TO ANY RELEASE FOR PRODUCTION OF EQUIPMENT SHOWN.

BALANCE

- KITCHEN HOODS MUST BE BALANCED WITH KITCHEN.
- KITCHEN SHALL BE NEGATIVE WITH RESPECT TO DINING AREA.
- RESTAURANT SHALL BE POSITIVE WITH RESPECT TO AMBIENT PRESSURE.

ADDITIONAL

- WRITTEN HOOD DIMENSIONS HAVE PRECEDENCE OVER SCALE.
- SHOWN AND APPROVED COPIES OF THIS DOCUMENT MUST BE RECEIVED BY THE FACTORY PRIOR TO COMMENCEMENT OF FABRICATION.

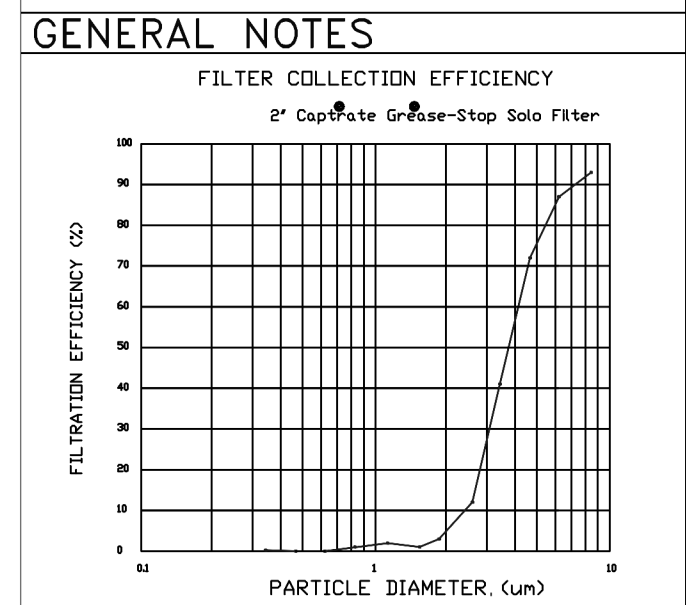

VERIFY CEILING HEIGHT

HEIGHT REQUIRED TO VERIFY THAT HOOD FITS SPACE AND TO SIZE THE ENCLOSURE PANELS.

CUSTOMER APPROVAL TO MANUFACTURE:

Approved as Noted

Approved with NO Exception Taken

Revise and Resubmit

SIGNATURE _____

Your Title _____ Date _____

HOOD INFORMATION - JOB#5272745

HOOD NO	TAG	MODEL	MANUFACTURER	LENGTH	MAX COOKING TEMP	TYPE	APPLIANCE DUTY	DESIGN CFM/FT	TOTAL EXH CFM	EXHAUST PLENUM RISER(S)				HOOD CONSTRUCTION	HOOD END TO END	HOOD ROW	
										WIDTH	LENG	HEIGHT	SP				
1	GRILL	3650 BD-2	CAPTIVEAIRE	4' 0"	600 DEG	I	HEAVY	175	700	8"	8"	4"	700	1575	-0.574"	430 SS WHERE EXPOSED	ALDNE
2	GRILL	3650 BD-2	CAPTIVEAIRE	4' 0"	600 DEG	I	HEAVY	175	700	8"	8"	4"	700	1575	-0.574"	430 SS WHERE EXPOSED	ALDNE
3	FRYER	3650 BD-2	CAPTIVEAIRE	4' 0"	600 DEG	I	HEAVY	175	700	8"	8"	4"	700	1575	-0.574"	430 SS WHERE EXPOSED	ALDNE
4	FRYER	3650 BD-2	CAPTIVEAIRE	4' 0"	600 DEG	I	HEAVY	175	700	8"	8"	4"	700	1575	-0.574"	430 SS WHERE EXPOSED	ALDNE




HOOD INFORMATION

HOOD NO	TAG	TYPE	FILTER(S)		EFFICIENCY @ 7 MICRONS	QTY	LIGHT(S)		UTILITY CABINET(S)		FIRE SYSTEM	HOOD HANGING WEIGHT	
			QTY	HEIGHT			LENGTH	TYPE	WIRE GUARD	LOCATION			SIZE
1	GRILL	CAPTRATE SOLD FILTER	2	16"	20"	85% SEE FILTER SPEC	1	RECESSED ROUND	NO			YES	205 LBS
2	GRILL	CAPTRATE SOLD FILTER	2	16"	20"	85% SEE FILTER SPEC	1	RECESSED ROUND	NO			YES	205 LBS
3	FRYER	CAPTRATE SOLD FILTER	2	16"	20"	85% SEE FILTER SPEC	1	RECESSED ROUND	NO			YES	205 LBS
4	FRYER	CAPTRATE SOLD FILTER	2	16"	20"	85% SEE FILTER SPEC	1	RECESSED ROUND	NO			YES	205 LBS

HOOD OPTIONS

HOOD NO	TAG	OPTION
1	GRILL	FIELD WRAPPER 29.00" HIGH FRONT, LEFT, RIGHT.
		RIGHT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
		LEFT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
2	GRILL	FIELD WRAPPER 29.00" HIGH FRONT, LEFT, RIGHT.
		RIGHT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
		LEFT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
3	FRYER	FIELD WRAPPER 29.00" HIGH FRONT, LEFT, RIGHT.
		RIGHT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
		LEFT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
4	FRYER	FIELD WRAPPER 29.00" HIGH FRONT, LEFT, RIGHT.
		RIGHT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.
		LEFT QUARTER END PANEL 26" TOP WIDTH, 0" BOTTOM WIDTH, 26" HIGH 430 SS.

FOR QUESTIONS, CALL THE
Eastern PA Mechanical
REGION 108
PHONE: (267) 504-4126
EMAIL: reg108@captiveaire.com

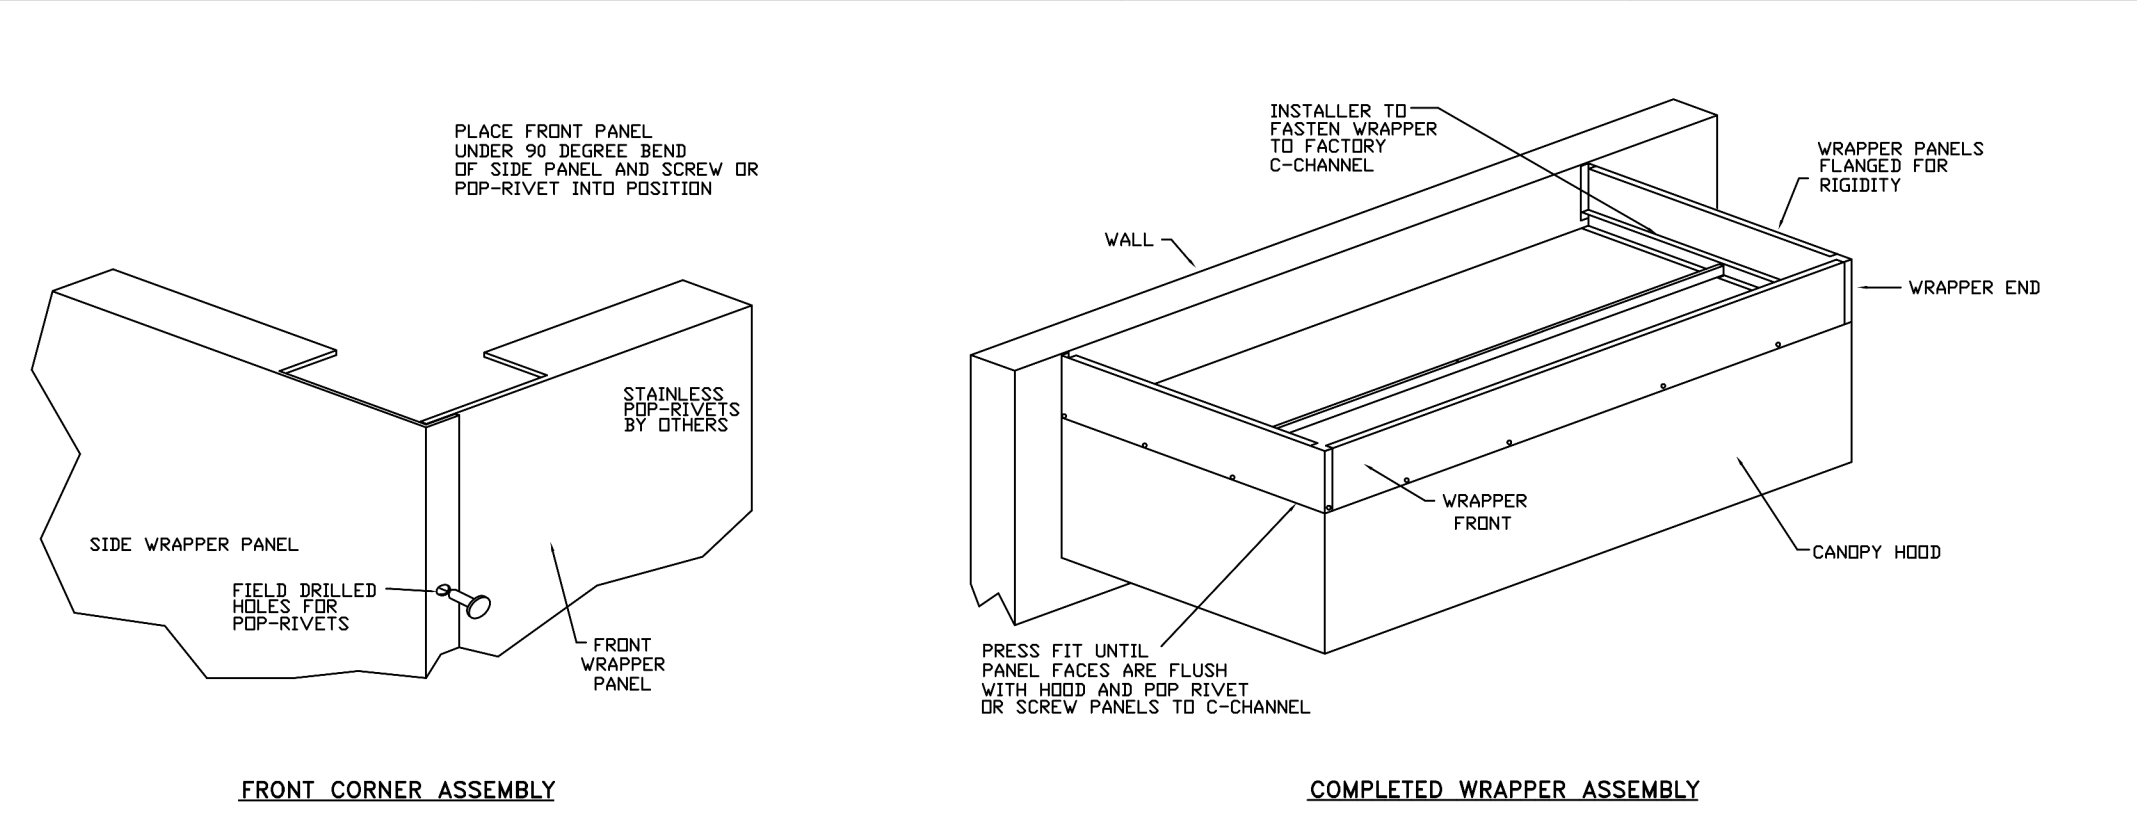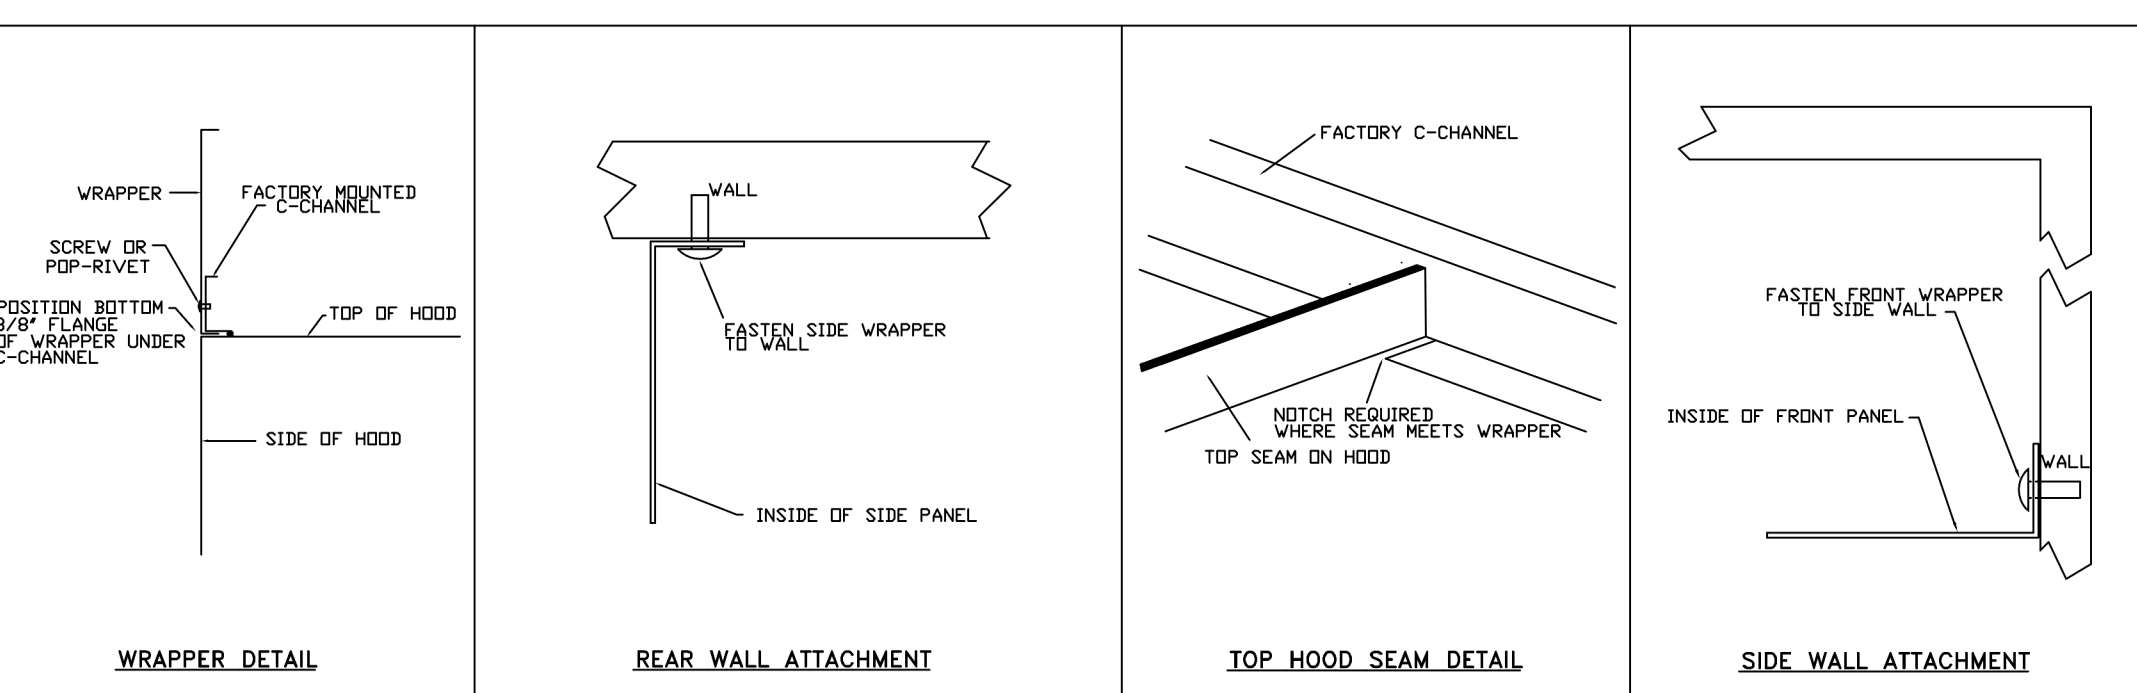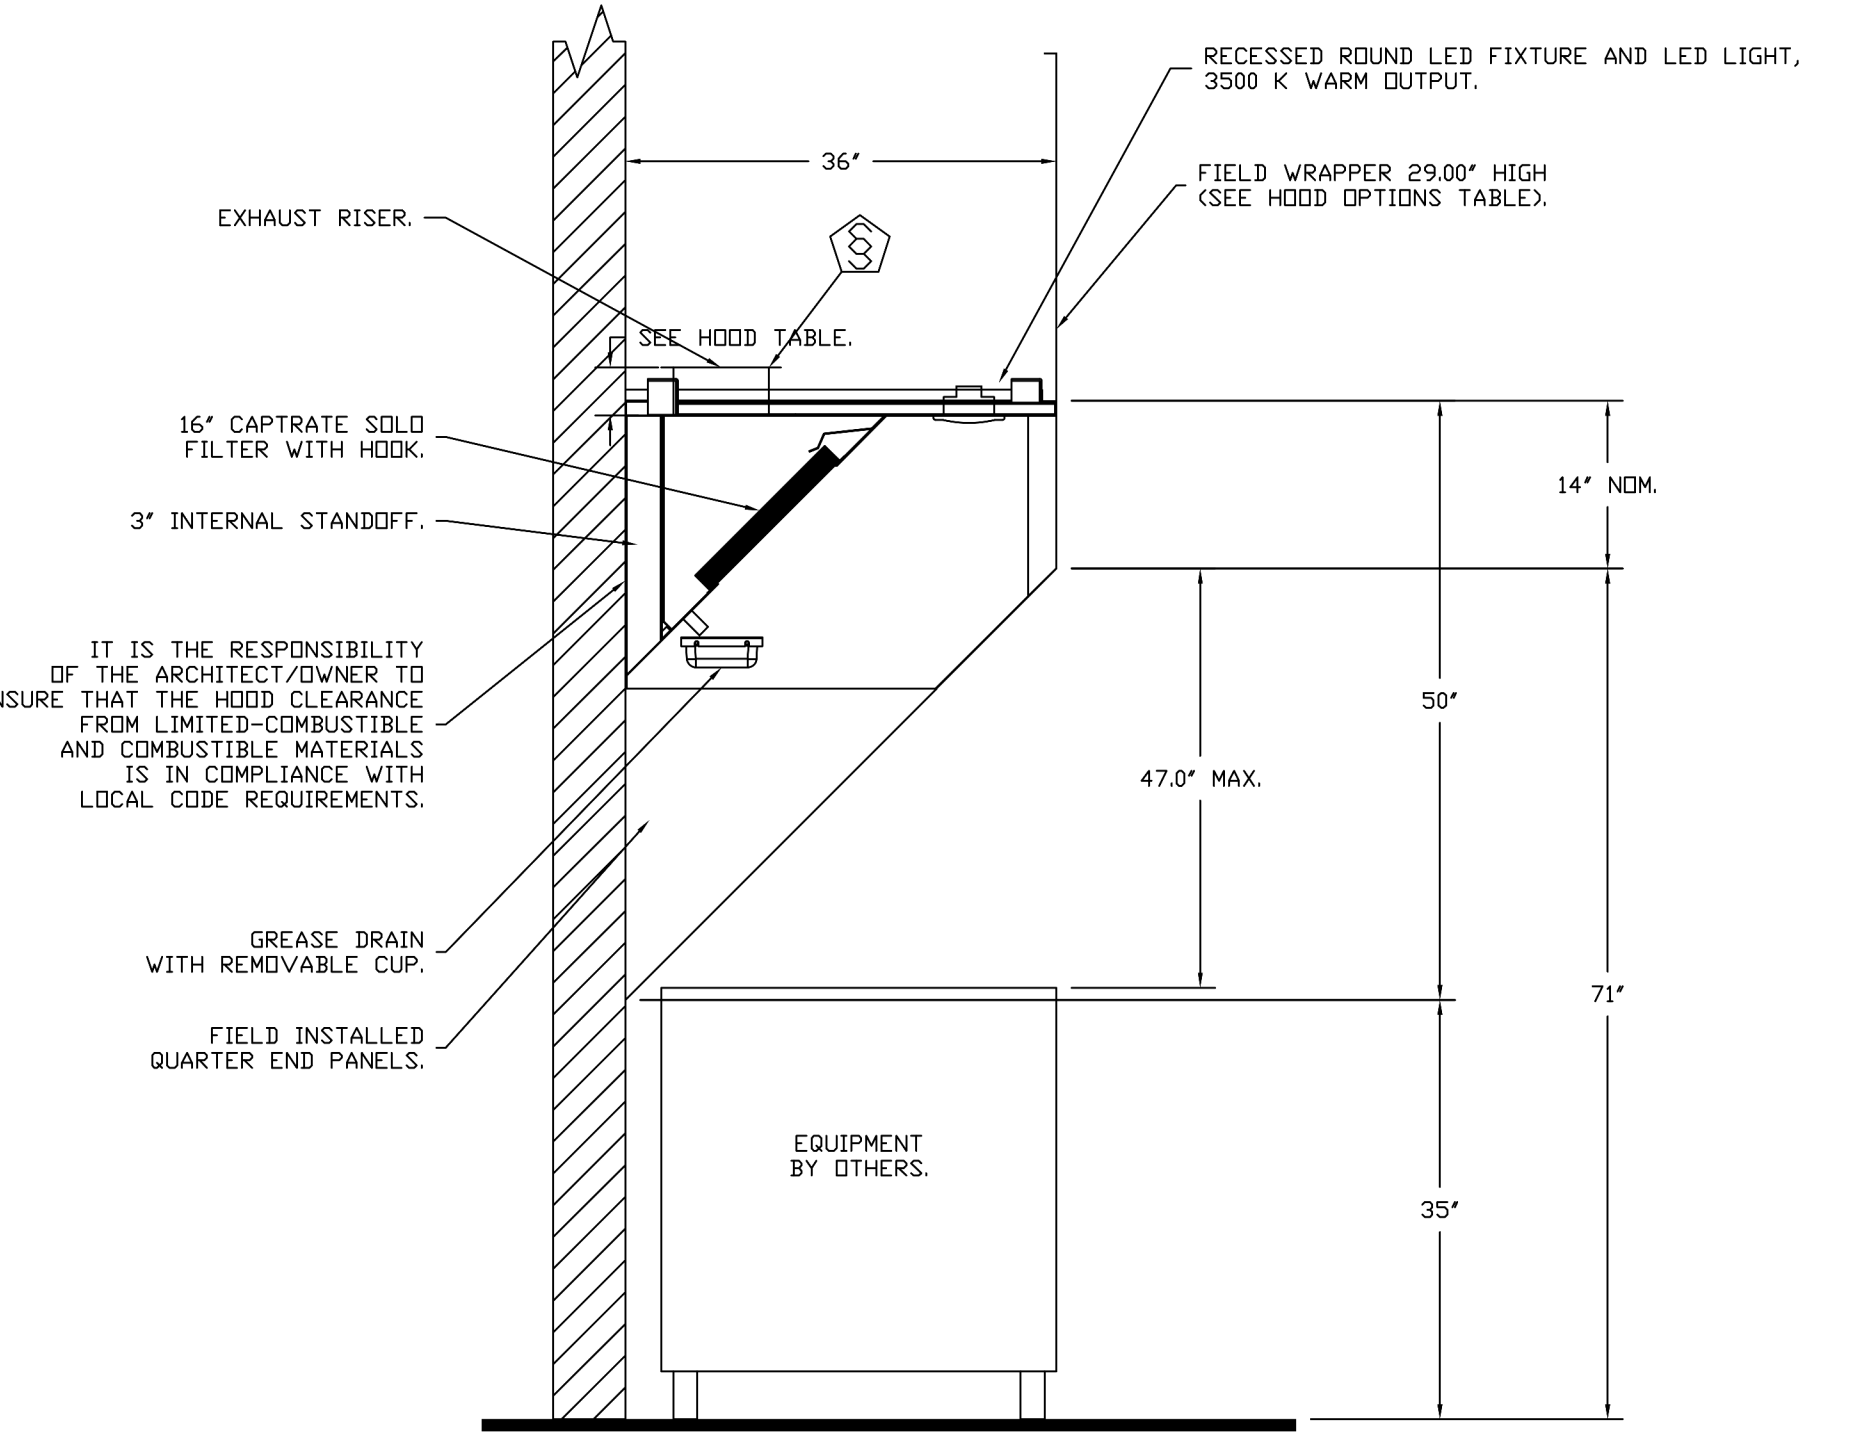

REVISIONS

NO.	DESCRIPTION	DATE
1		
2		
3		

CAPTIVEAIRE

Eastern PA Mechanical

PO Box 2620, 1 Union Ave, Bala Cynwyd, PA 19004 PHONE: (267) 504-4126 EMAIL: reg108@captiveaire.com

Shack Shack-1372 - Dublin, OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: Joe Shilba
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 1

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY


Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
Scale N.T.S.


Drawn By Joe Shilba
Date 11/12/2021

Sheet No.
M701


NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

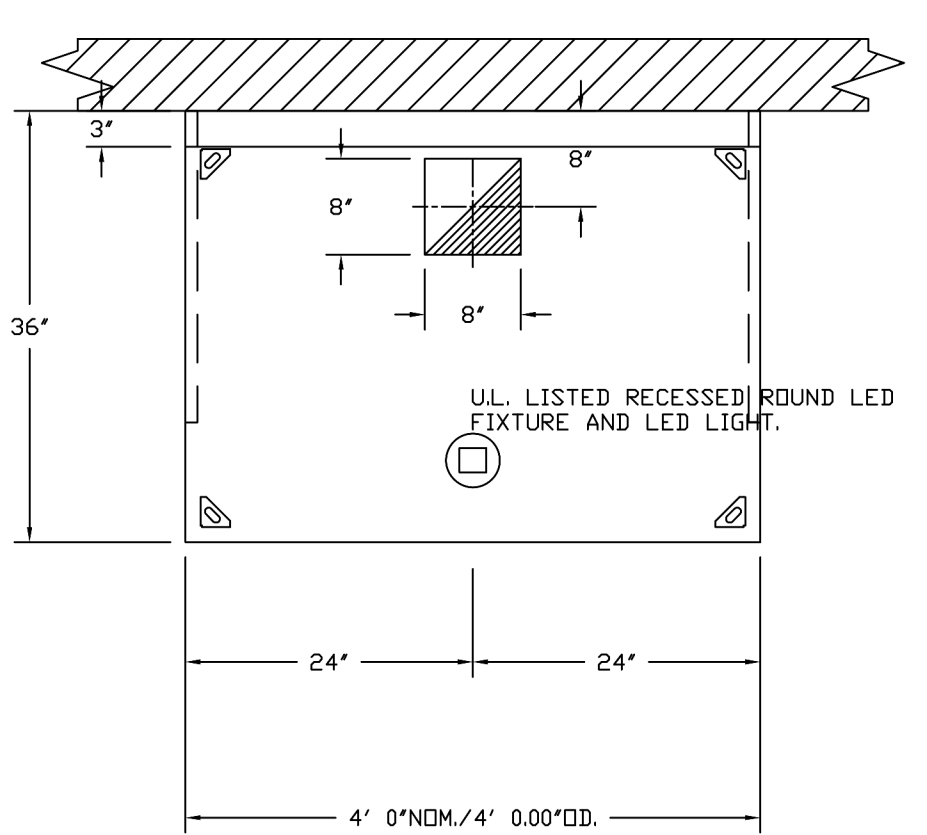


PLAN VIEW - HOOD #1 (GRILL)
4' 0.00' LONG 3650BD-2

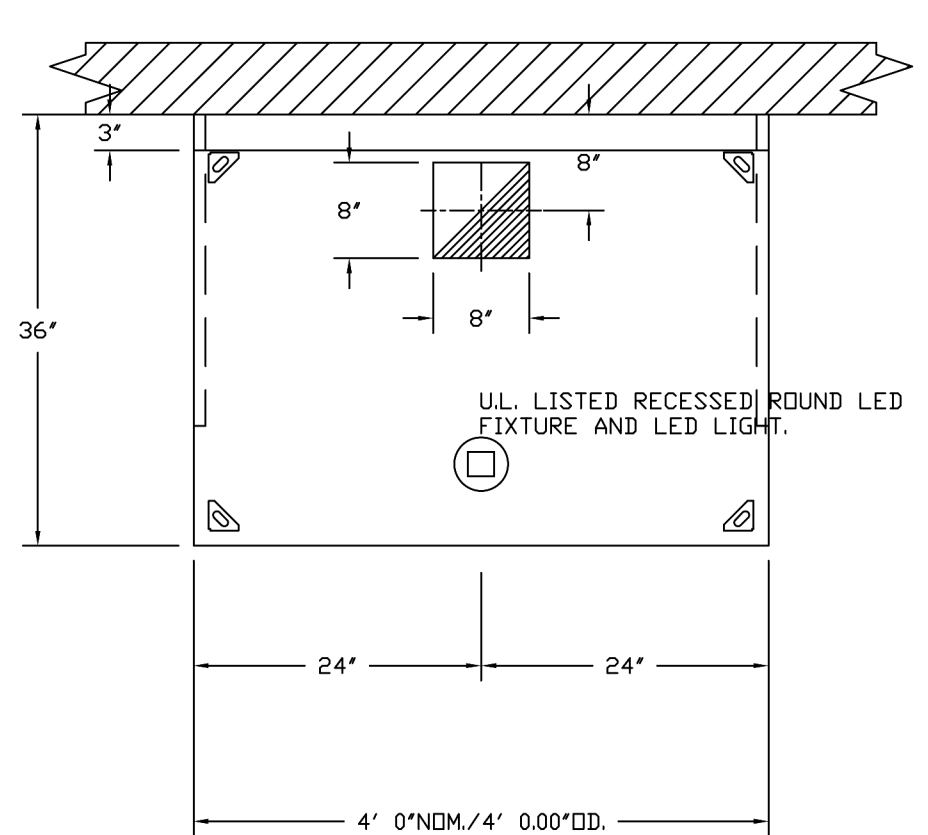

PLAN VIEW - HOOD #2 (GRILL)
4' 0.00' LONG 3650BD-2

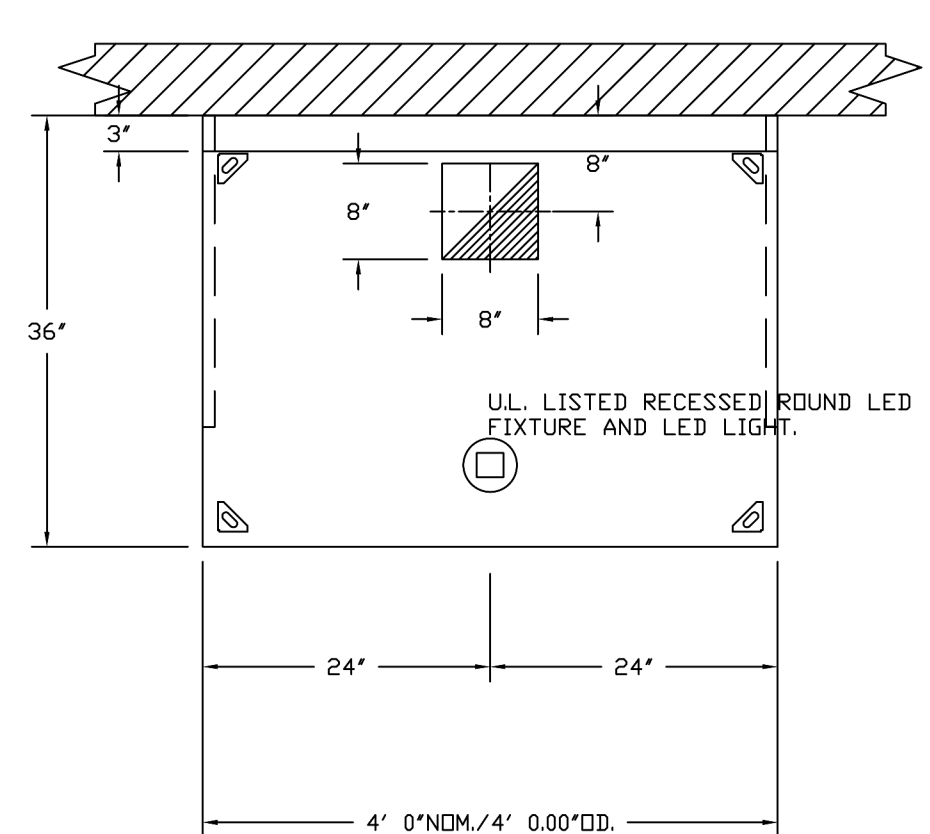

PLAN VIEW - HOOD #3 (FRYER)
4' 0.00' LONG 3650BD-2

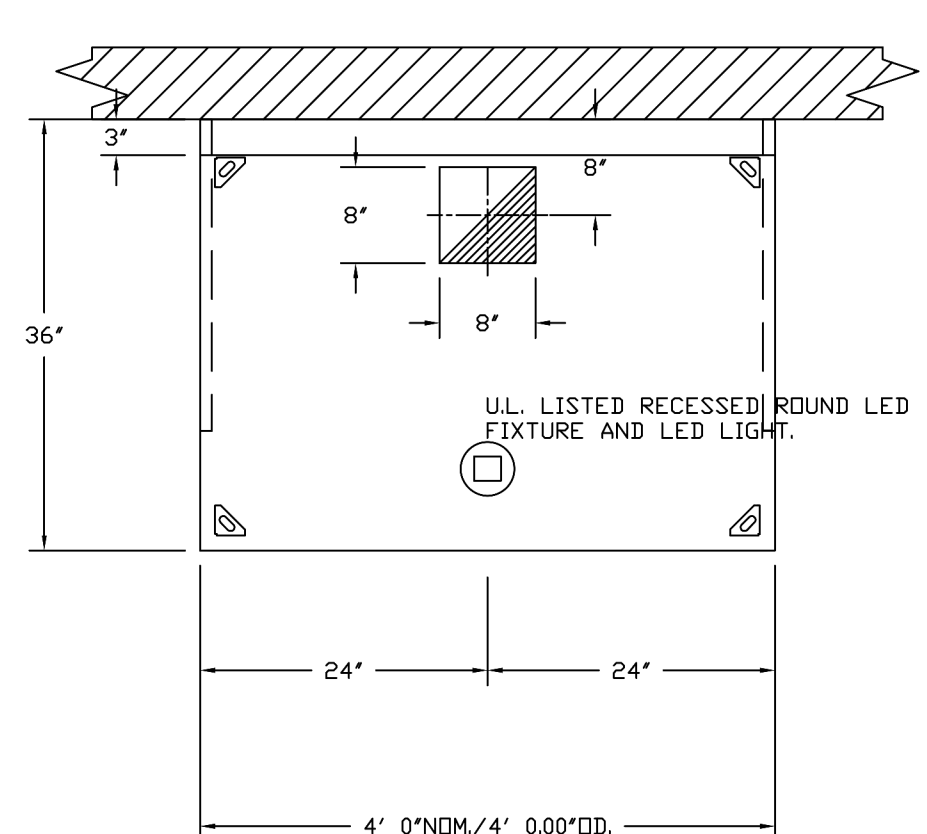

PLAN VIEW - HOOD #4 (FRYER)
4' 0.00' LONG 3650BD-2

HVAC DISTRIBUTION NOTE
SUPPLY DIFFUSERS WITHIN TEN (10) FEET OF THE EXHAUST HOOD SHOULD BE LOW-VELOCITY / NON-DIRECTIONAL

REVISIONS	
DESCRIPTION	DATE

CAPTIVE
Eastern PA Mechanical
www.captiveaire.com
PO Box 2620, 1 Union Ave, Bala Cynwyd, PA, 19004 PHONE: (267) 504-4126 EMAIL: reg108@captiveaire.com

Shack Shack-1372 - Dublin, OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: Joe.shilba
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 2

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without written consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
Drawn Author

Scale N.T.S.
Date 11/12/2021

Sheet No.
M702

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

FIRE SYSTEM INFORMATION - JOB#5102345

FIRE SYSTEM NO	TAG	TYPE	SIZE	FLOW POINTS	INSTALLATION	
					SYSTEM	LOCATION ON HOOD
1		ANSUL R102	3.0/3.0/3.0/3.0	32	12"x24"x42" WALL-MT	N/A

GAS VALVE(S)


FIRE SYSTEM NO	TAG	TYPE	SIZE	SUPPLIED BY
1		MECHANICAL	2.000	CAPTIVEAIRE SYSTEMS

NOTES


- FIELD PIPE DROPS AS SHOWN
- SLEEVING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS.
- RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.
- MAXIMUM 9 ELBOWS IN SUPPLY LINE.
- MINIMUM 72 INCHES OF AGENT LINE FROM TANK TO FIRST NOZZLE COVERING A RANGE, FRYER, OR WOK TO REFLECT GENERAL PIPING REQUIREMENTS.
- IF APPLICABLE, PRE-PIPED CHARBROILER DROPS ARE SHIPPED LOOSE.
- FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.
- APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.
- THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS.

JOB #: 5102345.
JOB NAME: SHACK SHACK-1372 -DUBLIN,OH.

SYSTEM SIZE: ANSUL-3.0/3.0/3.0/15-WC - TOTAL FP REQUIRED: 36.
HOOD # 1 4' 3.00" LONG x 36" WIDE x 50" HIGH.
RISER # 1 SIZE: 8" x 8".
HOOD # 1 METAL BLOW-OFF CAPS INCLUDED.
HOOD # 2 4' 3.00" LONG x 36" WIDE x 50" HIGH.
RISER # 1 SIZE: 8" x 8".
HOOD # 2 METAL BLOW-OFF CAPS INCLUDED.
HOOD # 3 3' 9.00" LONG x 36" WIDE x 50" HIGH.
RISER # 1 SIZE: 8" x 7".
HOOD # 3 METAL BLOW-OFF CAPS INCLUDED.
HOOD # 4 3' 9.00" LONG x 36" WIDE x 50" HIGH.
RISER # 1 SIZE: 8" x 7".
HOOD # 4 METAL BLOW-OFF CAPS INCLUDED.

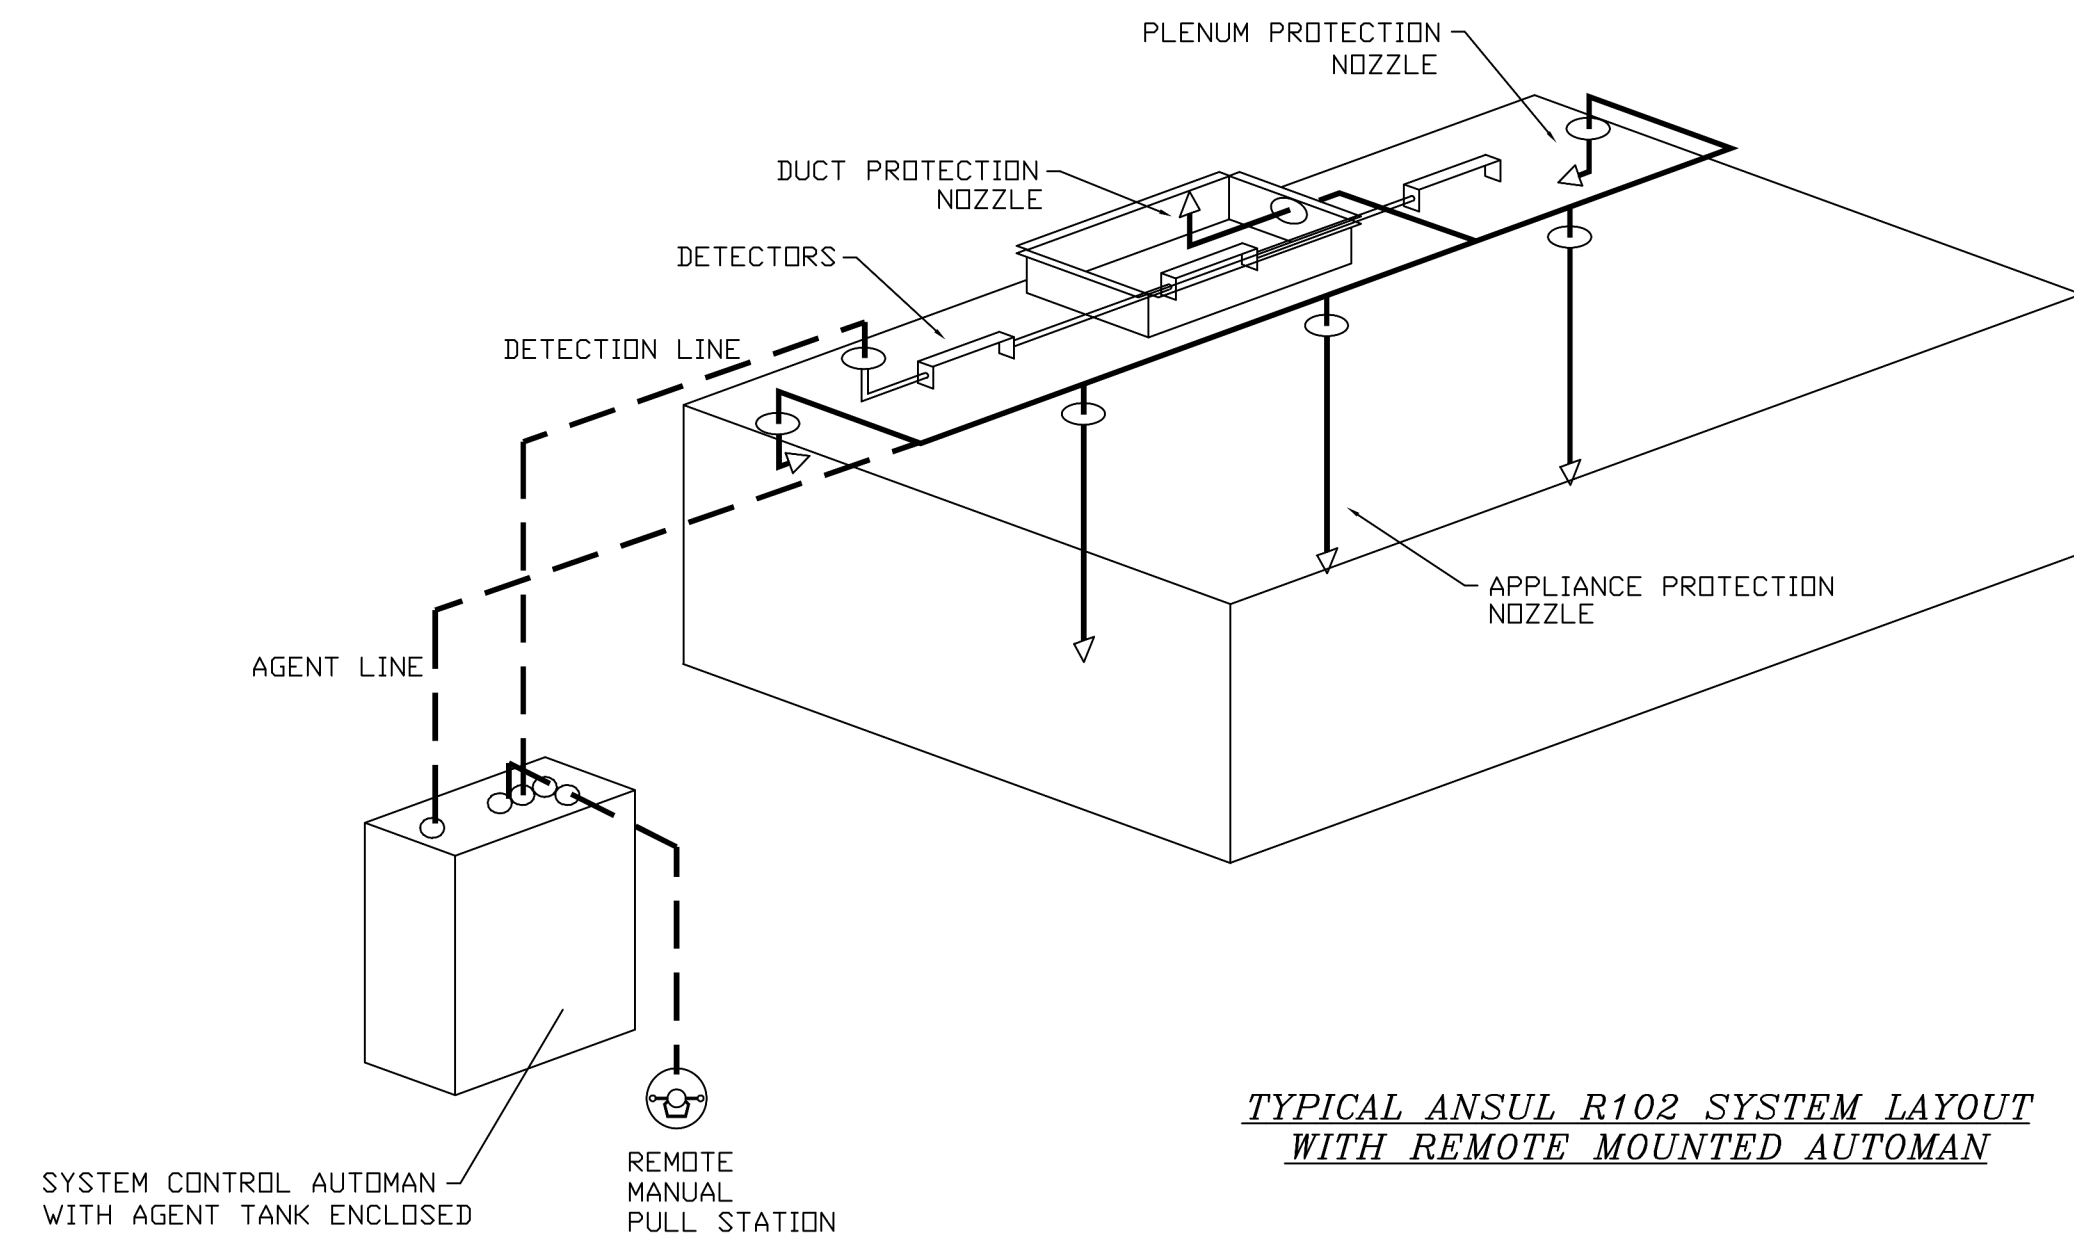

TYPICAL ANSUL R102 SYSTEM LAYOUT WITH REMOTE MOUNTED AUTOMAN

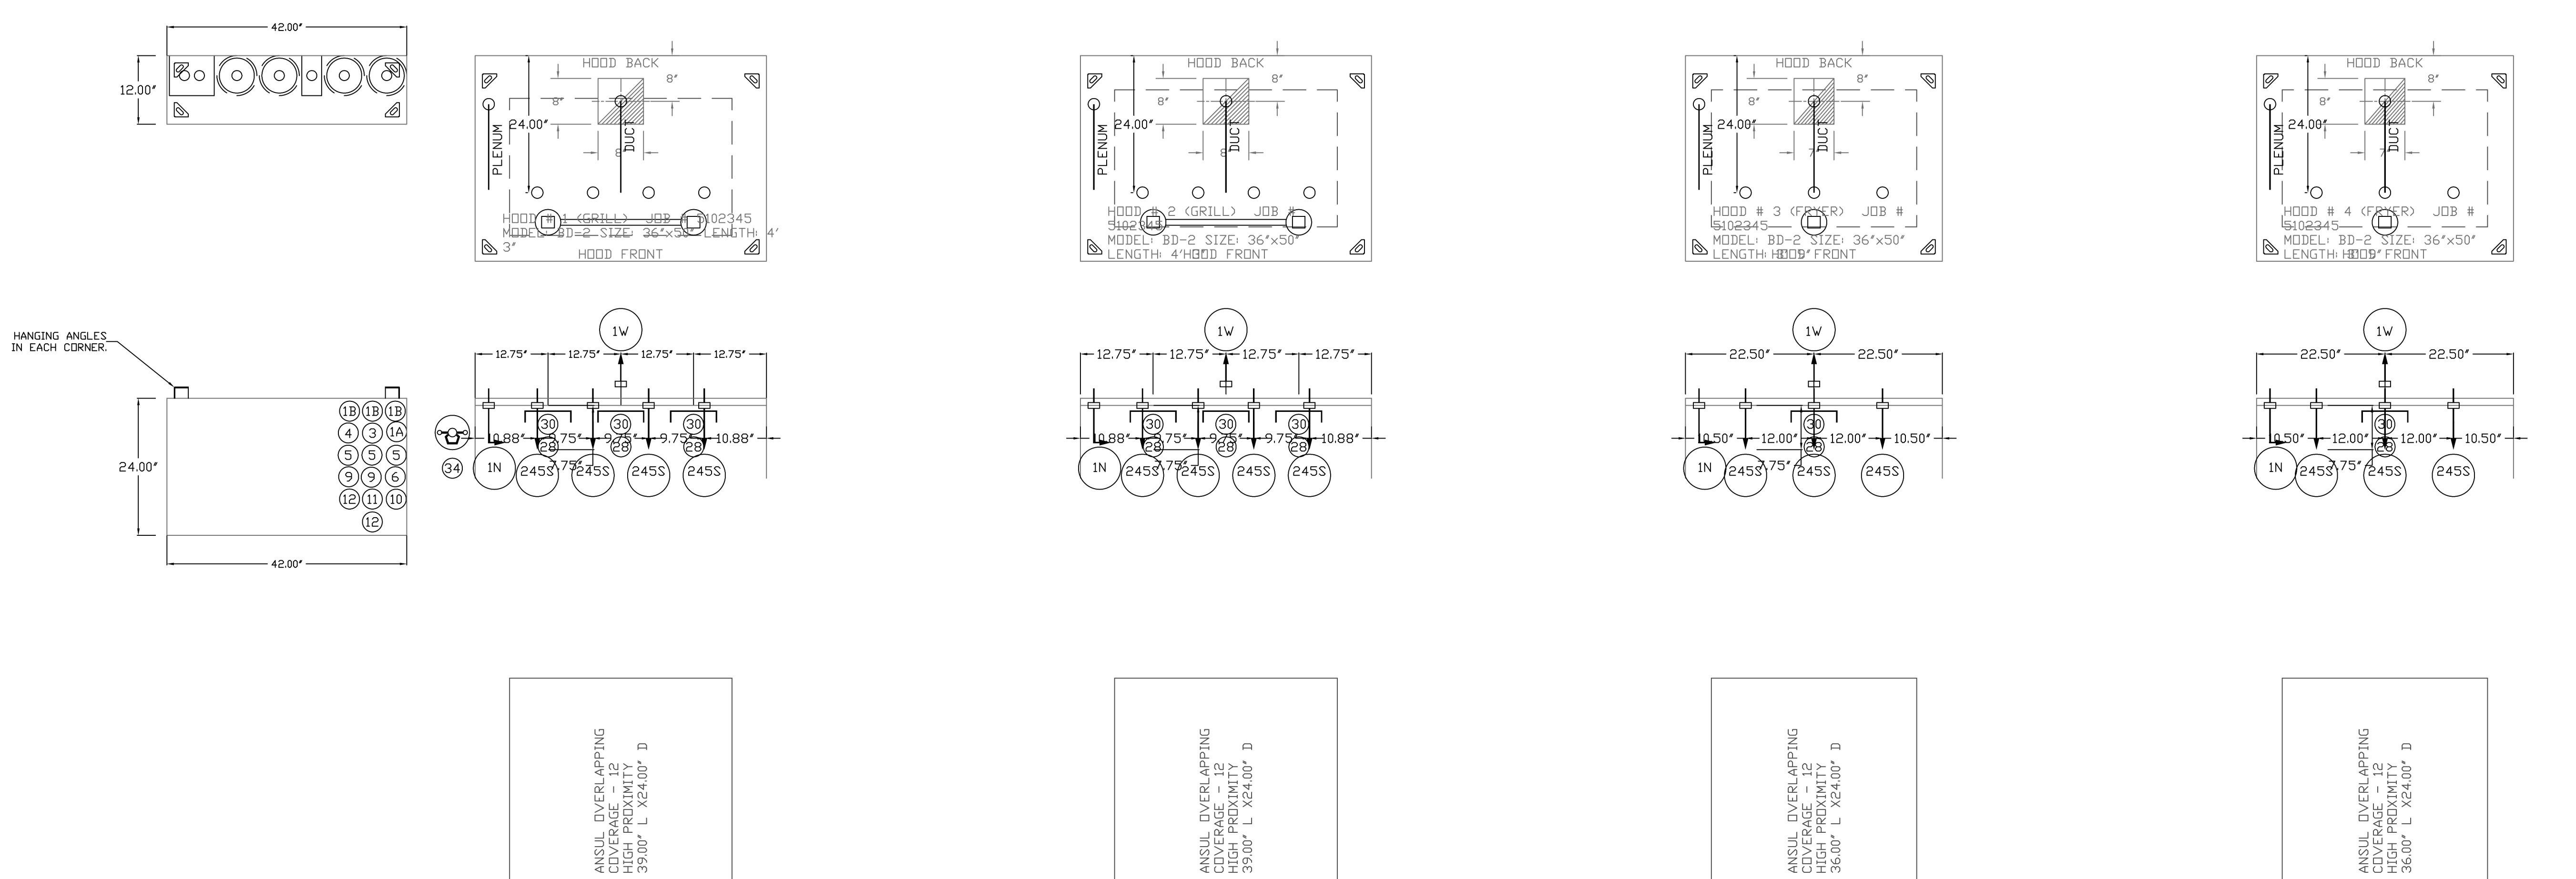

ANSUL OVERLAPPING COVERAGE - 12 HIGH PROXIMITY 39.00' L X 24.00' D

ANSUL OVERLAPPING COVERAGE - 12 HIGH PROXIMITY 39.00' L X 24.00' D

ANSUL OVERLAPPING COVERAGE - 12 HIGH PROXIMITY 36.00' L X 24.00' D

ANSUL OVERLAPPING COVERAGE - 12 HIGH PROXIMITY 36.00' L X 24.00' D

REVISIONS	
DESCRIPTION	DATE

CAPTIVEAIRE
www.captiveaire.com
Eastern PA Mechanical
PO Box 2500, 1 Union Ave, Bala Cynwyd, PA, 19004 PHONE: (267) 504-4126 EMAIL: reg108@captiveaire.com

Shack Shack-1372 -Dublin,OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: joe.shilba
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO. 3

SHAKE SHACK
W DUBLIN GRANDVILLE RD, OH

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without written consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVEAIRE DRAWINGS

Job No. 2150002415
Drawn Author

Scale N.T.S.
Date 11/12/2021

Sheet No.
M703

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

EXHAUST FAN INFORMATION - JOB#5272745

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	MANUFACTURER	CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	DISCHARGE VELOCITY	WEIGHT (LBS)	SDNES
2	KEF-1	1	DU50HFA	CAPTIVEAIRE	700	1.000	1411	TEAD-ECM	0.500	0.2890	1	208	3.8	266 FPM	82	14.2
3	KEF-2	1	DU50HFA	CAPTIVEAIRE	700	1.000	1411	TEAD-ECM	0.500	0.2890	1	208	3.8	266 FPM	82	14.2
4	KEF-3	1	DU50HFA	CAPTIVEAIRE	700	1.000	1429	TEAD-ECM	0.500	0.2910	1	208	3.8	266 FPM	82	14.5
5	KEF-4	1	DU50HFA	CAPTIVEAIRE	700	1.000	1429	TEAD-ECM	0.500	0.2910	1	208	3.8	266 FPM	82	14.5

DOAS/RTU FAN SCHEDULE - JOB#5272745

FAN UNIT NO	TAG	QTY	DOAS/RTU MODEL #	MANUFACTURER	BLOWER	RETURN AIR CFM	MAX OUTSIDE AIR CFM	TOTAL CFM	ESP	HP	BHP	PHASE	VOLT	MCA	MDCP	WEIGHT (LBS)
1	DDAS-1	1	CASRTU3-1.400-24-20T-DDAS	CAPTIVEAIRE	24P-3	2400	2500	4900	1.000	7.500	4.9190	3	208	98.4A	110A	2675

DOAS/RTU COOLING SCHEDULE


FAN UNIT NO	TAG	COMPRESSDR	OUTDOOR FAN			INDOOR COIL		OUTSIDE AIR DB TEMP	OUTSIDE AIR WB TEMP	MIXED AIR DB TEMP	MIXED AIR WB TEMP	LEAVING DB TEMP	LEAVING WB TEMP	LEAVING DP TEMP	TOTAL CAPACITY	SENSIBLE CAPACITY	LATENT CAPACITY	REHEAT LEAVING DB TEMP	REHEAT LEAVING WB TEMP	DESIRED REHEAT CAPACITY	MAX REHEAT CAPACITY	REHEAT LEAVING RELATIVE HUMIDITY	MOISTURE REMOVAL RATE	IEER				
TONNAGE	VOLTAGE	PHASE	MOTOR VOLTAGE	MOTOR Ø	MOTOR FREQUENCY	MOTOR QTY	RWS	FACE AREA																				
1	DDAS-1	20	190-240	3	200-240	3	60	3	7	11.9	SOFT	95.0°F	78.0°F	85.2°F	70.9°F	54.4°F	53.8°F	53.4°F	264.0 MBH	163.1 MBH	100.9 MBH	75.0°F	62.5°F	109 MBH	129.6 MBH	50	89.2 LBS/HR	18.2

DOAS/RTU HEATING SCHEDULE

FAN UNIT NO	TAG	INPUT BTUs	OUTPUT BTUs	TEMP RISE	REQUIRED INPUT GAS PRESSURE	GAS TYPE	BURNER EFFICIENCY(%)
1	DDAS-1	363825	291060	55°F	7 IN. W.C. - 14 IN. W.C.	NATURAL	80

FAN OPTIONS

FAN UNIT NO	TAG	QTY	DESCRIPTION
1	DDAS-1	1	INLET PRESSURE GAUGE, 0-35"
		1	MANIFOLD PRESSURE GAUGE, 0 TO 10" WC, 1 FURNACE
		1	RTU TOTAL CFM MONITORING
		1	SINGLE POINT ELECTRICAL CONNECTION FOR RTU 750VA TRANSFORMER USED. IF A NON-DCV PREWIRE CONTROLS THIS UNIT, THE #28, #47, "MA", OR "E2" PREWIRE OPTION MUST BE SELECTED. DOES NOT PROVIDE SUPPLY STARTER IN PREWIRE
		1	CASLINK BUILDING MONITORING SYSTEM - INTERNET OR CELLULAR CONNECTION REQUIRED
		1	2" MERV 13 FILTERS FOR RTU3 (QTY. 4)
		1	2" MERV 8 FILTERS FOR RTU3 (QTY. 4)
		1	OVERHEAT STAT
		1	VFD FACTORY MOUNTED AND WIRED IN RTU COMMERCIAL CONTROL VESTIBULE
		1	COMMERCIAL SMOKE DETECTOR/ALARM INTERLOCK - ALARM SUPPLIED BY OTHERS
		1	OCCUPIED SCHEDULING
		1	CLOGGED FILTER SWITCH - NOTIFICATION ON HMI
		1	RTU3 CONVENIENCE OUTLET (GFCI), 15 AMP - REQUIRES SEPARATE 120V CONNECTION. INCLUDES RECEPTACLE, COVER AND J-BOX
		1	20 TON MODULATING COOLING OPTION, 208/230V. R410A REFRIGERANT, VARIABLE SPEED COMPRESSOR, ECM CONDENSING FANS
		1	20 TON MODULATING REHEAT OPTION - SPACE DEWPOINT CONTROL
		1	RTU INTAKE/RETURN DAMPER - MANUAL CONTROL VIA HMI
		1	REMOTE TEMPERATURE AND HUMIDITY SPACE SENSOR
		1	VAV PACKAGE W/ MANUAL/DDC CONTROL (S71 VFD INCLUDED)
		1	LOAD REACTOR MOUNTED IN FAN
		1	RTU ECONDMIZER - DIFFERENTIAL ENTHALPY CONTROL
1	POWERED EXHAUST FOR RTU3 - MANUAL CONTROL		
1	RTU3 ECONDMIZER BAROMETRIC RELIEF		
1	RTU3 DOWN RETURN		
1	RTU3 DOWN DISCHARGE		
2	KEF-1	1	5 YEAR ENTIRE UNIT PARTS WARRANTY, 10 YEAR ENTIRE UNIT PARTS WARRANTY WITH REMOTE MONITORING AND CAPTIVEAIRE SERVICE CONTRACT, 25 YEAR STAINLESS STEEL FURNACE PARTS WARRANTY (SEE ADDITIONAL DETAILS)
		1	GREASE BDX
		1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS
		1	ECM WIRING PACKAGE - PWM SIGNAL FROM ECPM03 PREWIRE (TELCO MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
3	KEF-2	1	GREASE BDX
		1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS
		1	ECM WIRING PACKAGE - PWM SIGNAL FROM ECPM03 PREWIRE (TELCO MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
		1	GREASE BDX
4	KEF-3	1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS
		1	ECM WIRING PACKAGE - PWM SIGNAL FROM ECPM03 PREWIRE (TELCO MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
		1	GREASE BDX
		1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS
5	KEF-4	1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS
		1	ECM WIRING PACKAGE - PWM SIGNAL FROM ECPM03 PREWIRE (TELCO MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
		1	GREASE BDX
		1	FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS

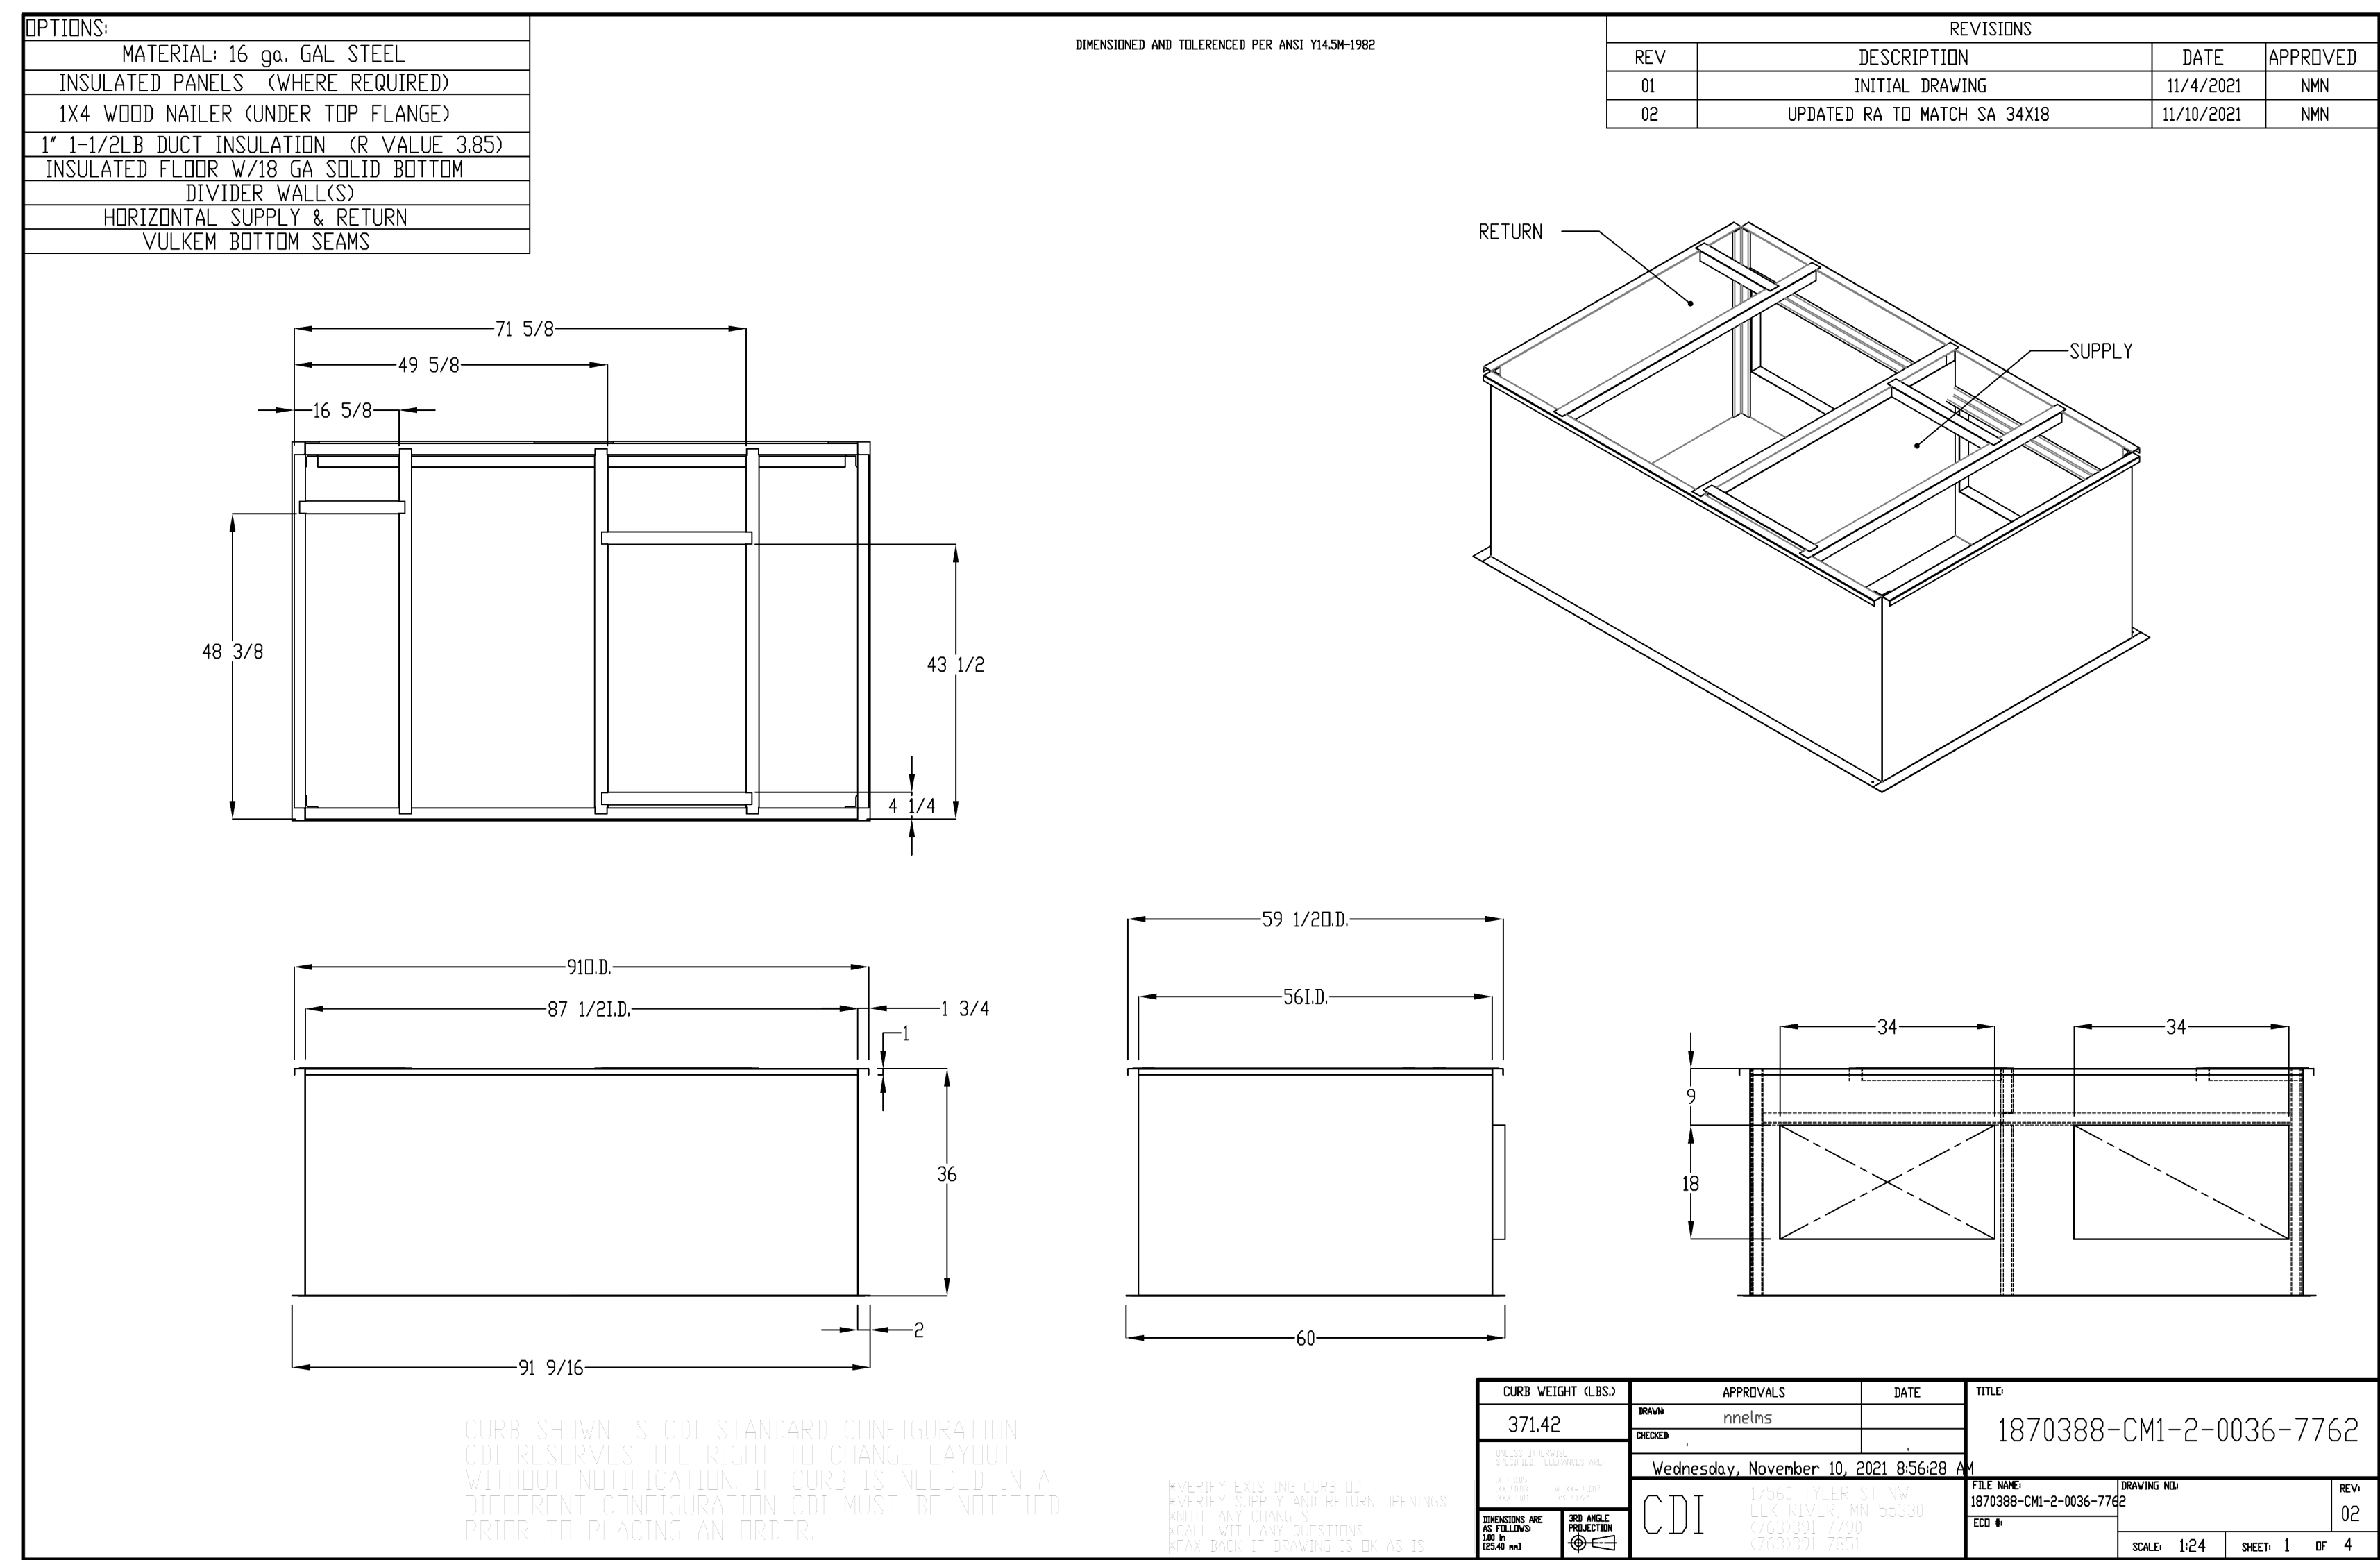

CURB ASSEMBLIES

NO	DN FAN	TAG	WEIGHT	ITEM	SIZE
1	# 1		68 LBS	CURB	59.500"W X 91.000"L X 12.000"H ALONG WIDTH, RIGHT INSULATED.
2	# 2	KEF-1	31 LBS	CURB	19.500"W X 19.500"L X 20.000"H ALONG LENGTH, RIGHT VENTED HINGED.
3	# 3	KEF-2	31 LBS	CURB	19.500"W X 19.500"L X 20.000"H ALONG LENGTH, RIGHT VENTED HINGED.
4	# 4	KEF-3	31 LBS	CURB	19.500"W X 19.500"L X 20.000"H ALONG LENGTH, RIGHT VENTED HINGED.
5	# 5	KEF-4	31 LBS	CURB	19.500"W X 19.500"L X 20.000"H ALONG LENGTH, RIGHT VENTED HINGED.

REVISIONS

CAPTIVE

Eastern PA Mechanical

PO Box 2501, 1 Union Ave, Bala Cynwyd, PA, 19004 PHONE: (267) 504-4128 EMAIL: reg108@captivair.com

Shack Shock-1372 - Dublin, OH-R3

AMLIN, OH, 43002

DATE: 1/13/2022

DWG.#: 5272745

DRAWN BY: Joe.shilba

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 4

FIELD VERIFICATION
 Contractor shall verify all signed dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.

COPYRIGHT
 Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
 Drawn Author

Scale N.T.S.
 Date 11/12/2021

Sheet No.
M704

NOTE:
 THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aiv Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aiv Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aiv Group Architects, Inc.

NO.	DATE	REMARKS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
Drawn Author

Scale N.T.S.
Date 11/12/2021

Sheet No.
M705

REVISIONS	
DESCRIPTION	DATE








Shack Shack-1372 -Dublin, OH-R3
AMLIN, OH, 43002



DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: Joe.Shibo
SCALE: 3/4" = 1'-0"
MASTER DRAWING

SHEET NO. 5

Eastern PA Mechanical
www.captiveaire.com
PO Box 2520, 1 Union Ave, Bala Cynwyd, PA, 19004 PHONE: (267) 504-4128 EMAIL: reg108@captiveaire.com

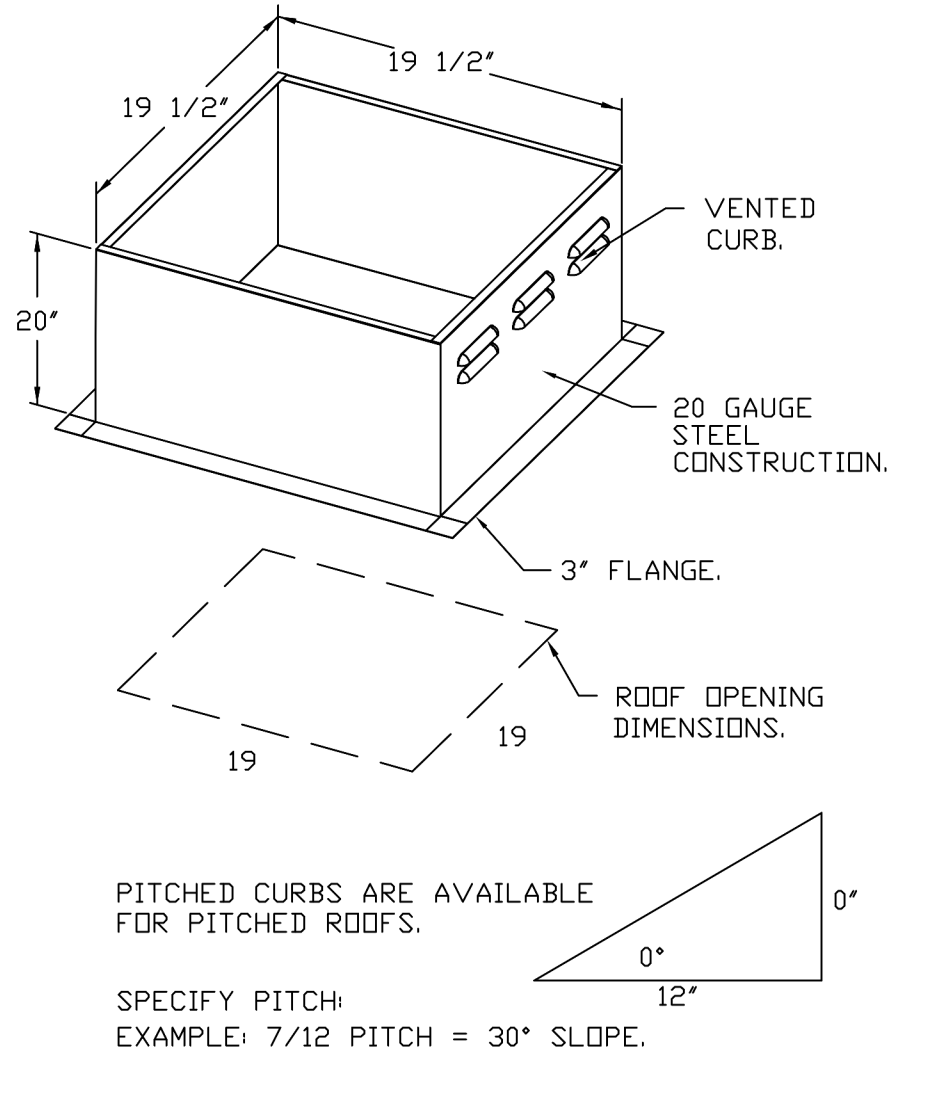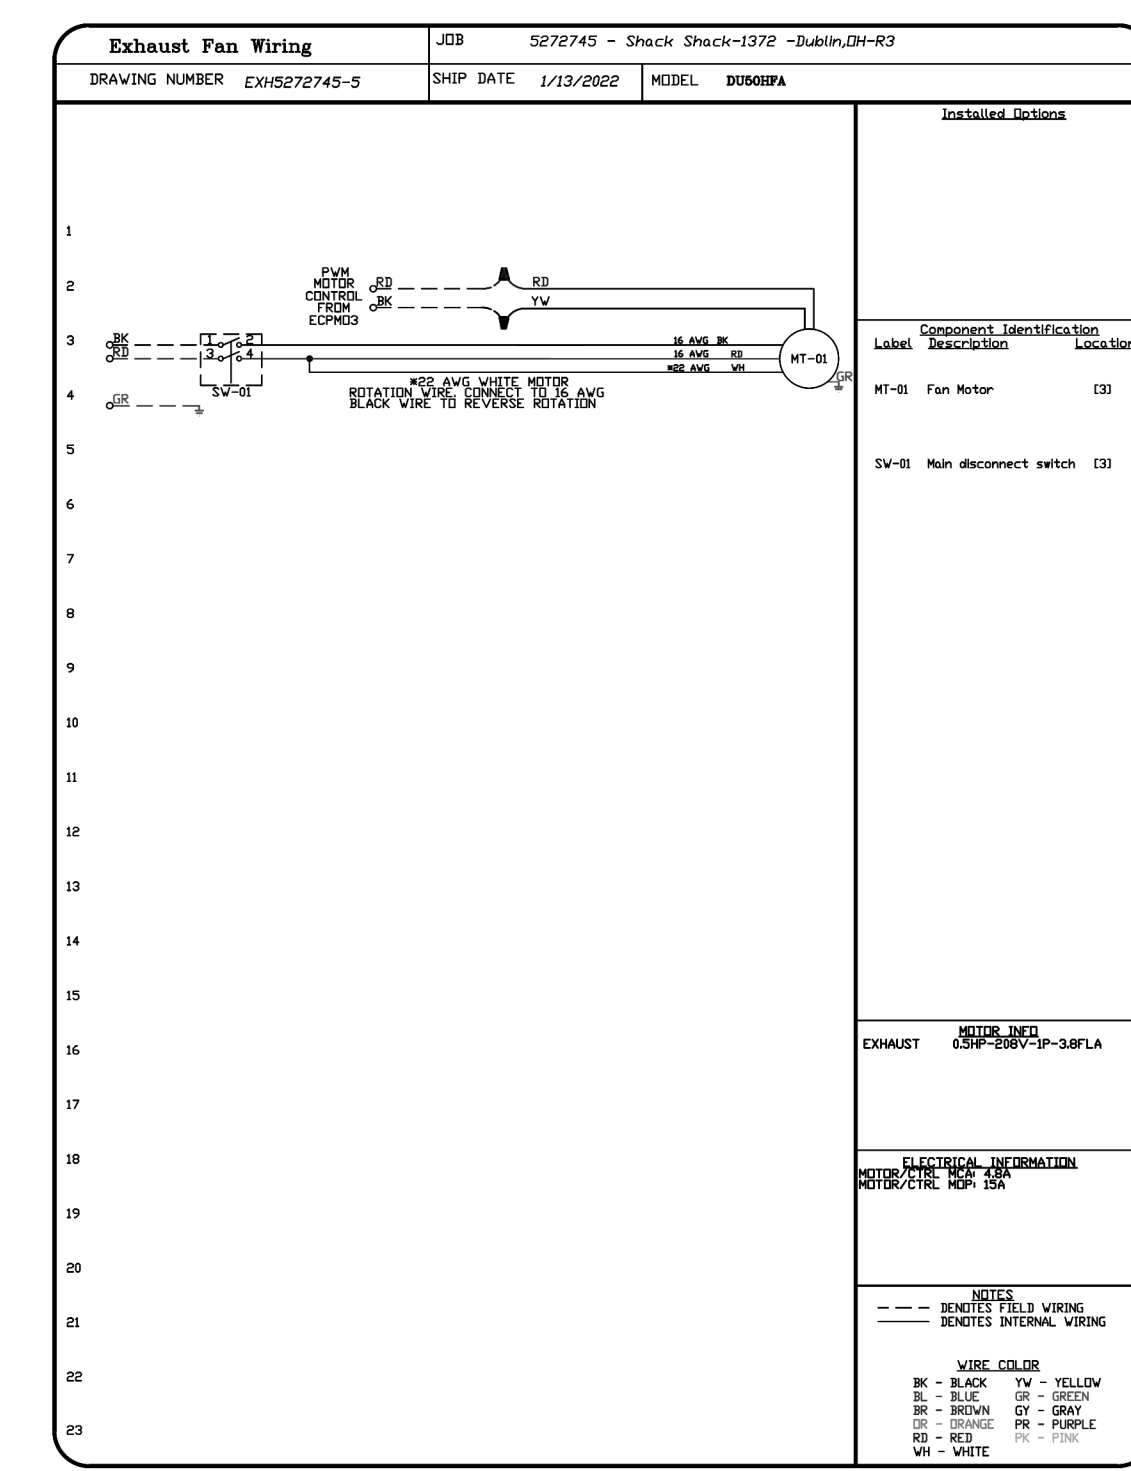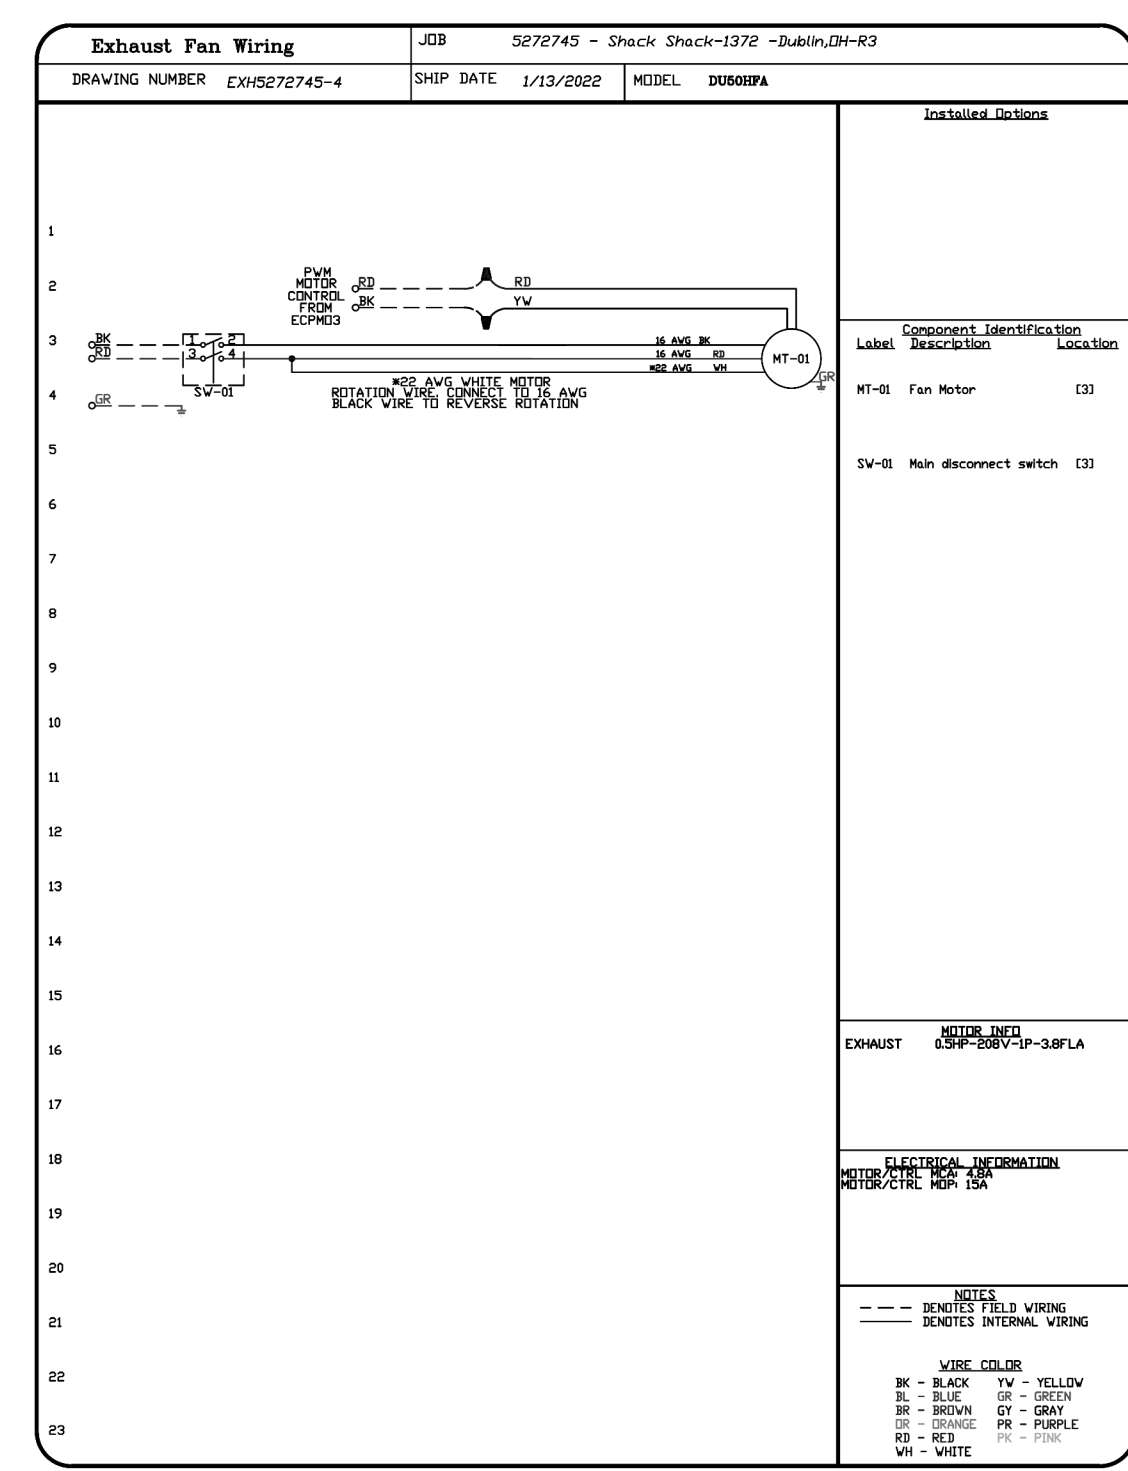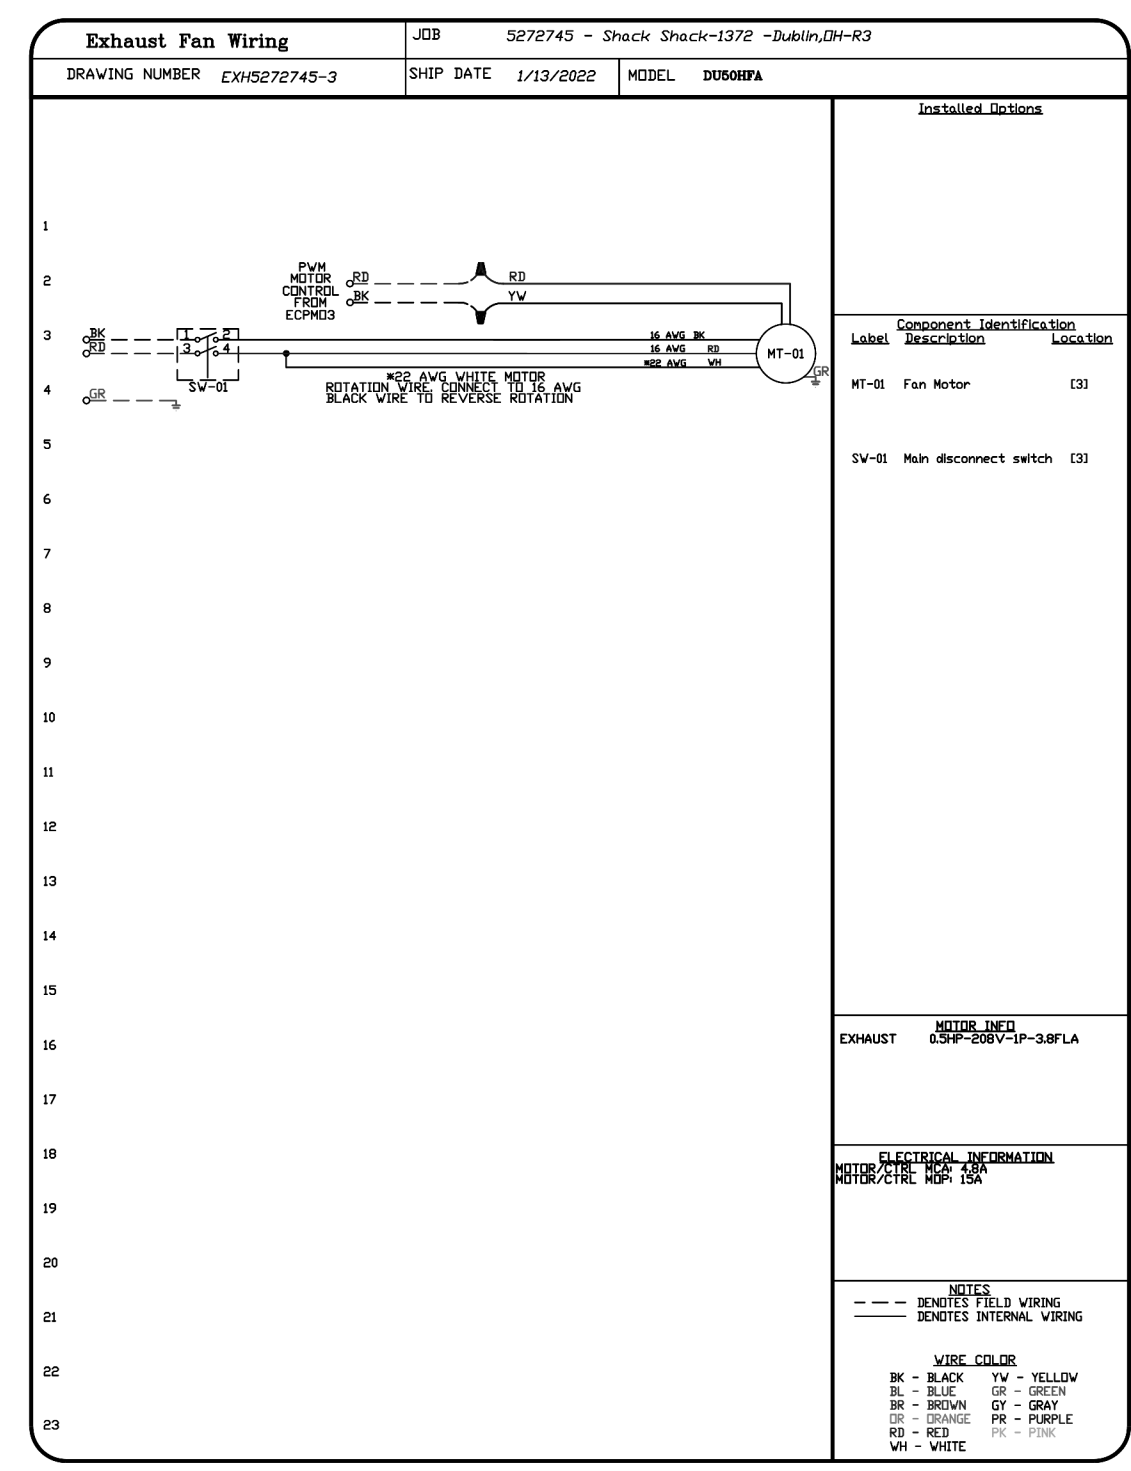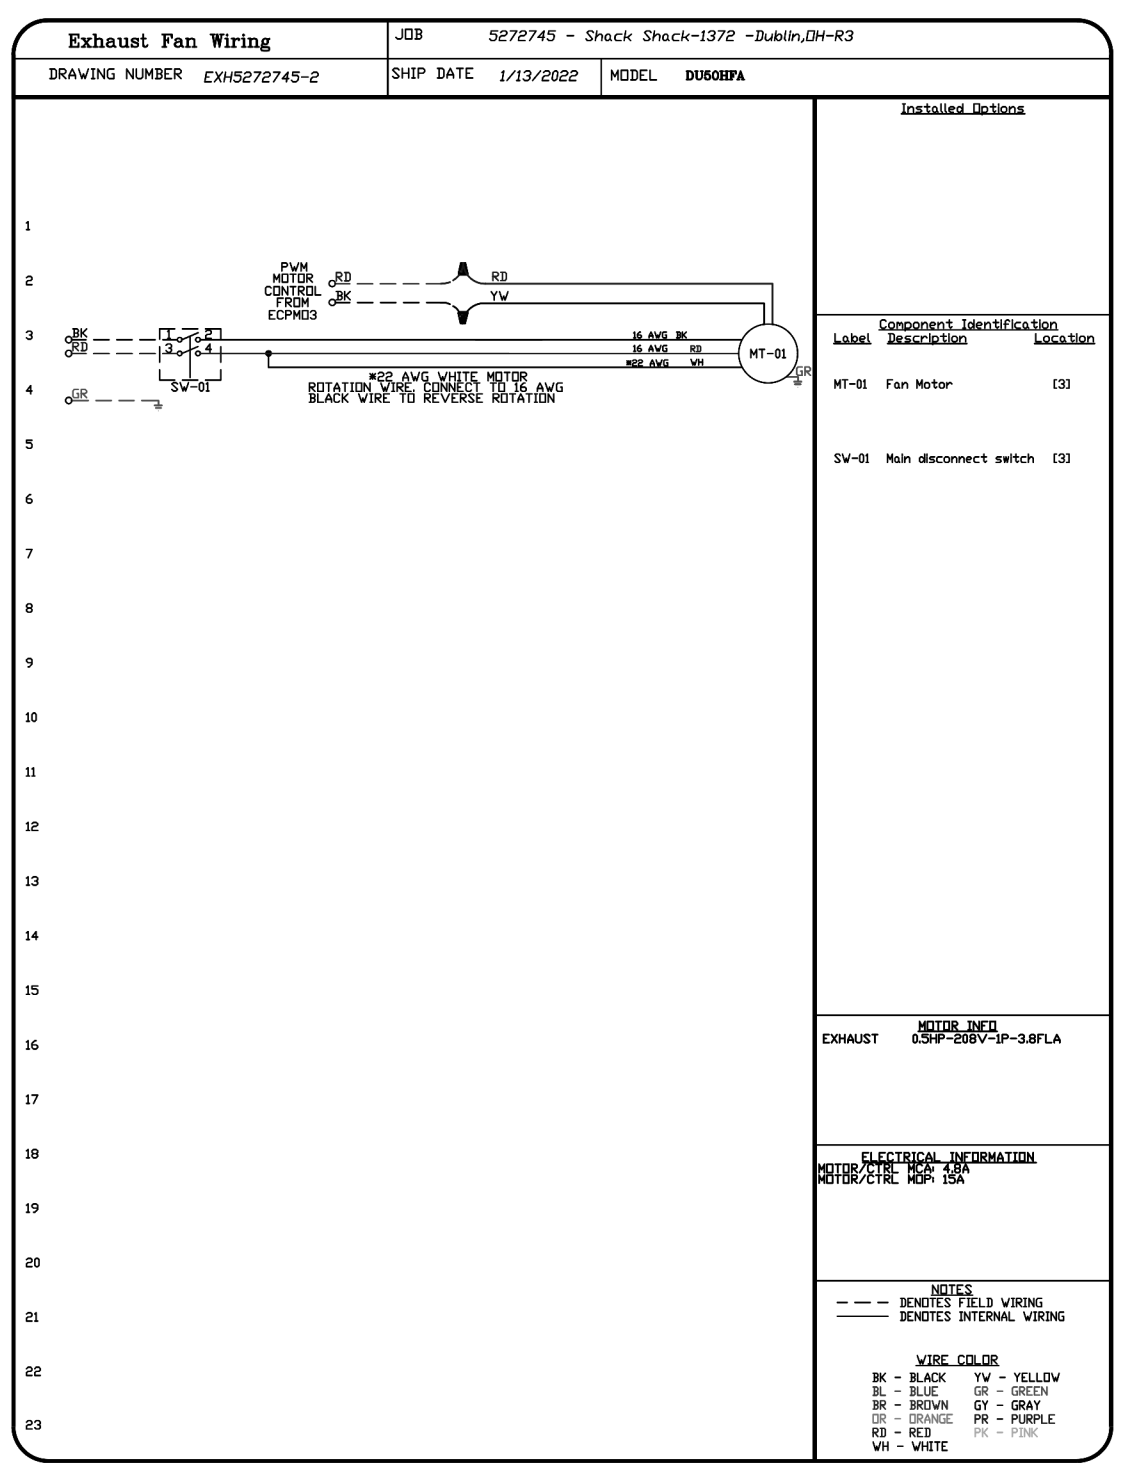


FANS #2 (KEF-1), #3 (KEF-2), #4 (KEF-3), #5 (KEF-4) - DUSQIFA EXHAUST FAN

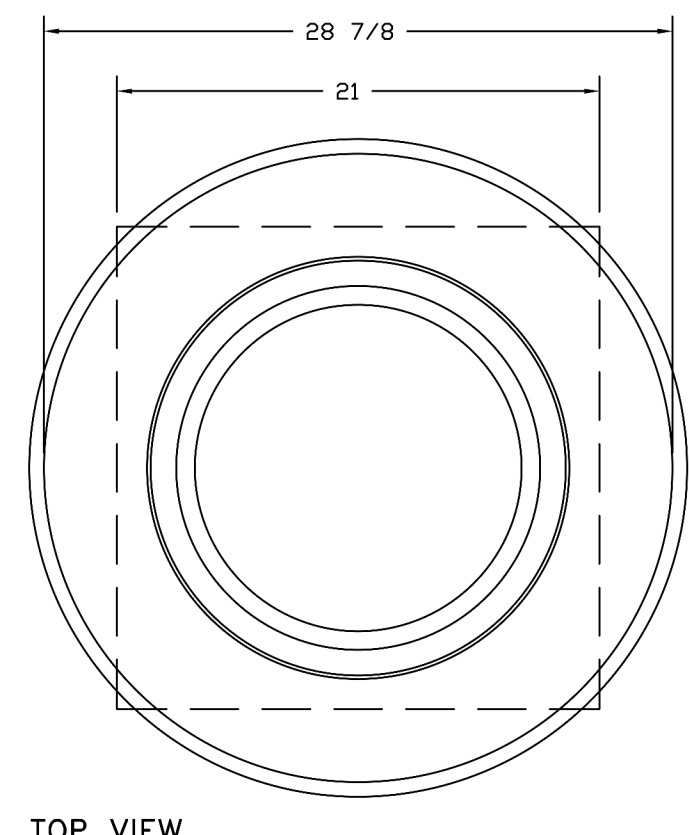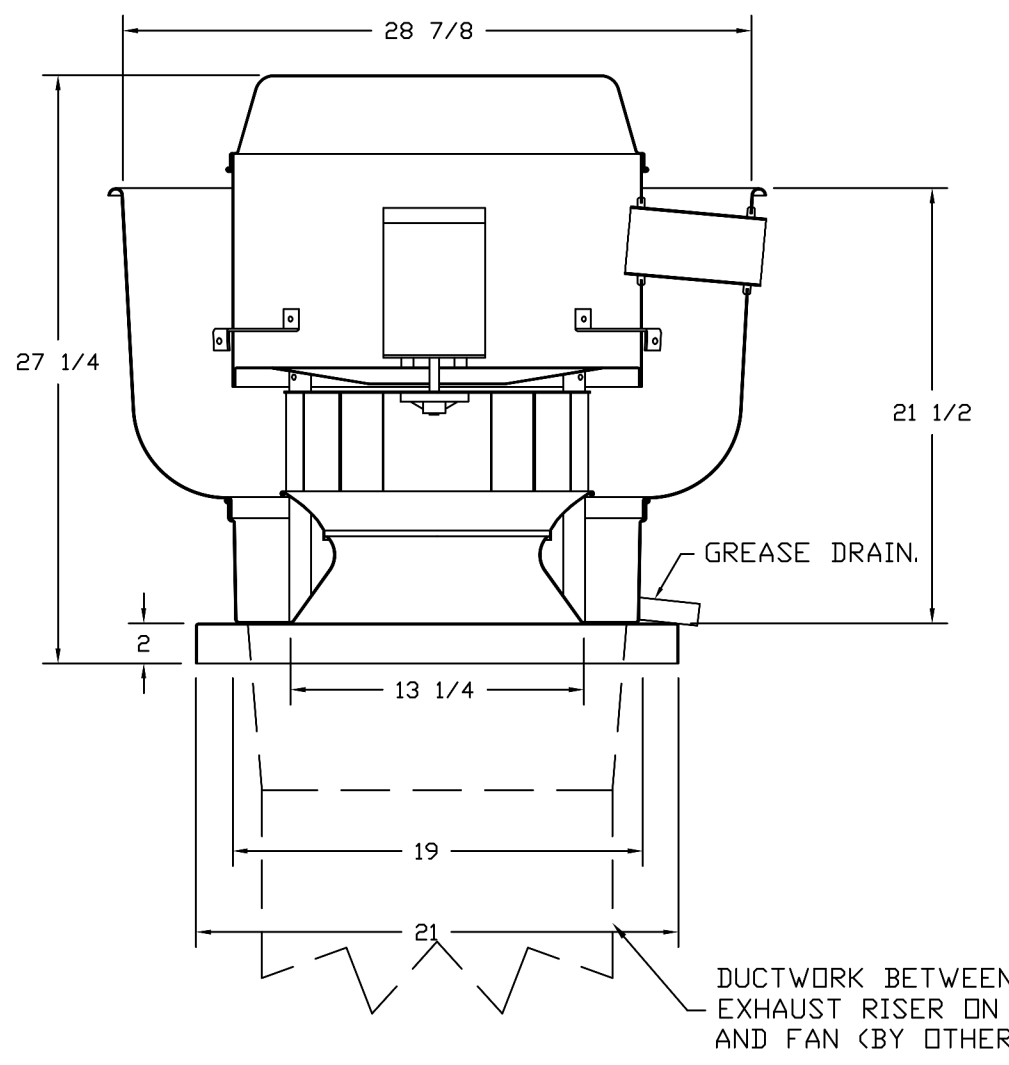

TOP VIEW

- FEATURES:**
- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
 - ROOF MOUNTED FANS.
 - RESTAURANT MODEL.
 - UL705 AND UL762 AND ILC-S645
 - VARIABLE SPEED CONTROL.
 - INTERNAL WIRING.
 - THERMAL OVERLOAD PROTECTION (SINGLE PHASE).
 - HIGH HEAT OPERATION 300°F (149°C).
 - GREASE CLASSIFICATION TESTING.
 - NEMA 3R SAFETY DISCONNECT SWITCH.
- NORMAL TEMPERATURE TEST**
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.
- ABNORMAL FLARE-UP TEST**
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.
- OPTIONS**
- GREASE BOX.
 - FAN BASE CERAMIC SEAL - INSTALLED AT PLANT - FOR GREASE DUCTS.
 - ECM WIRING PACKAGE - PWM SIGNAL FROM SPEED PREVIEW (TELCD MOTOR), ECM ROTATION.
 - 2 YEAR PARTS WARRANTY.

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

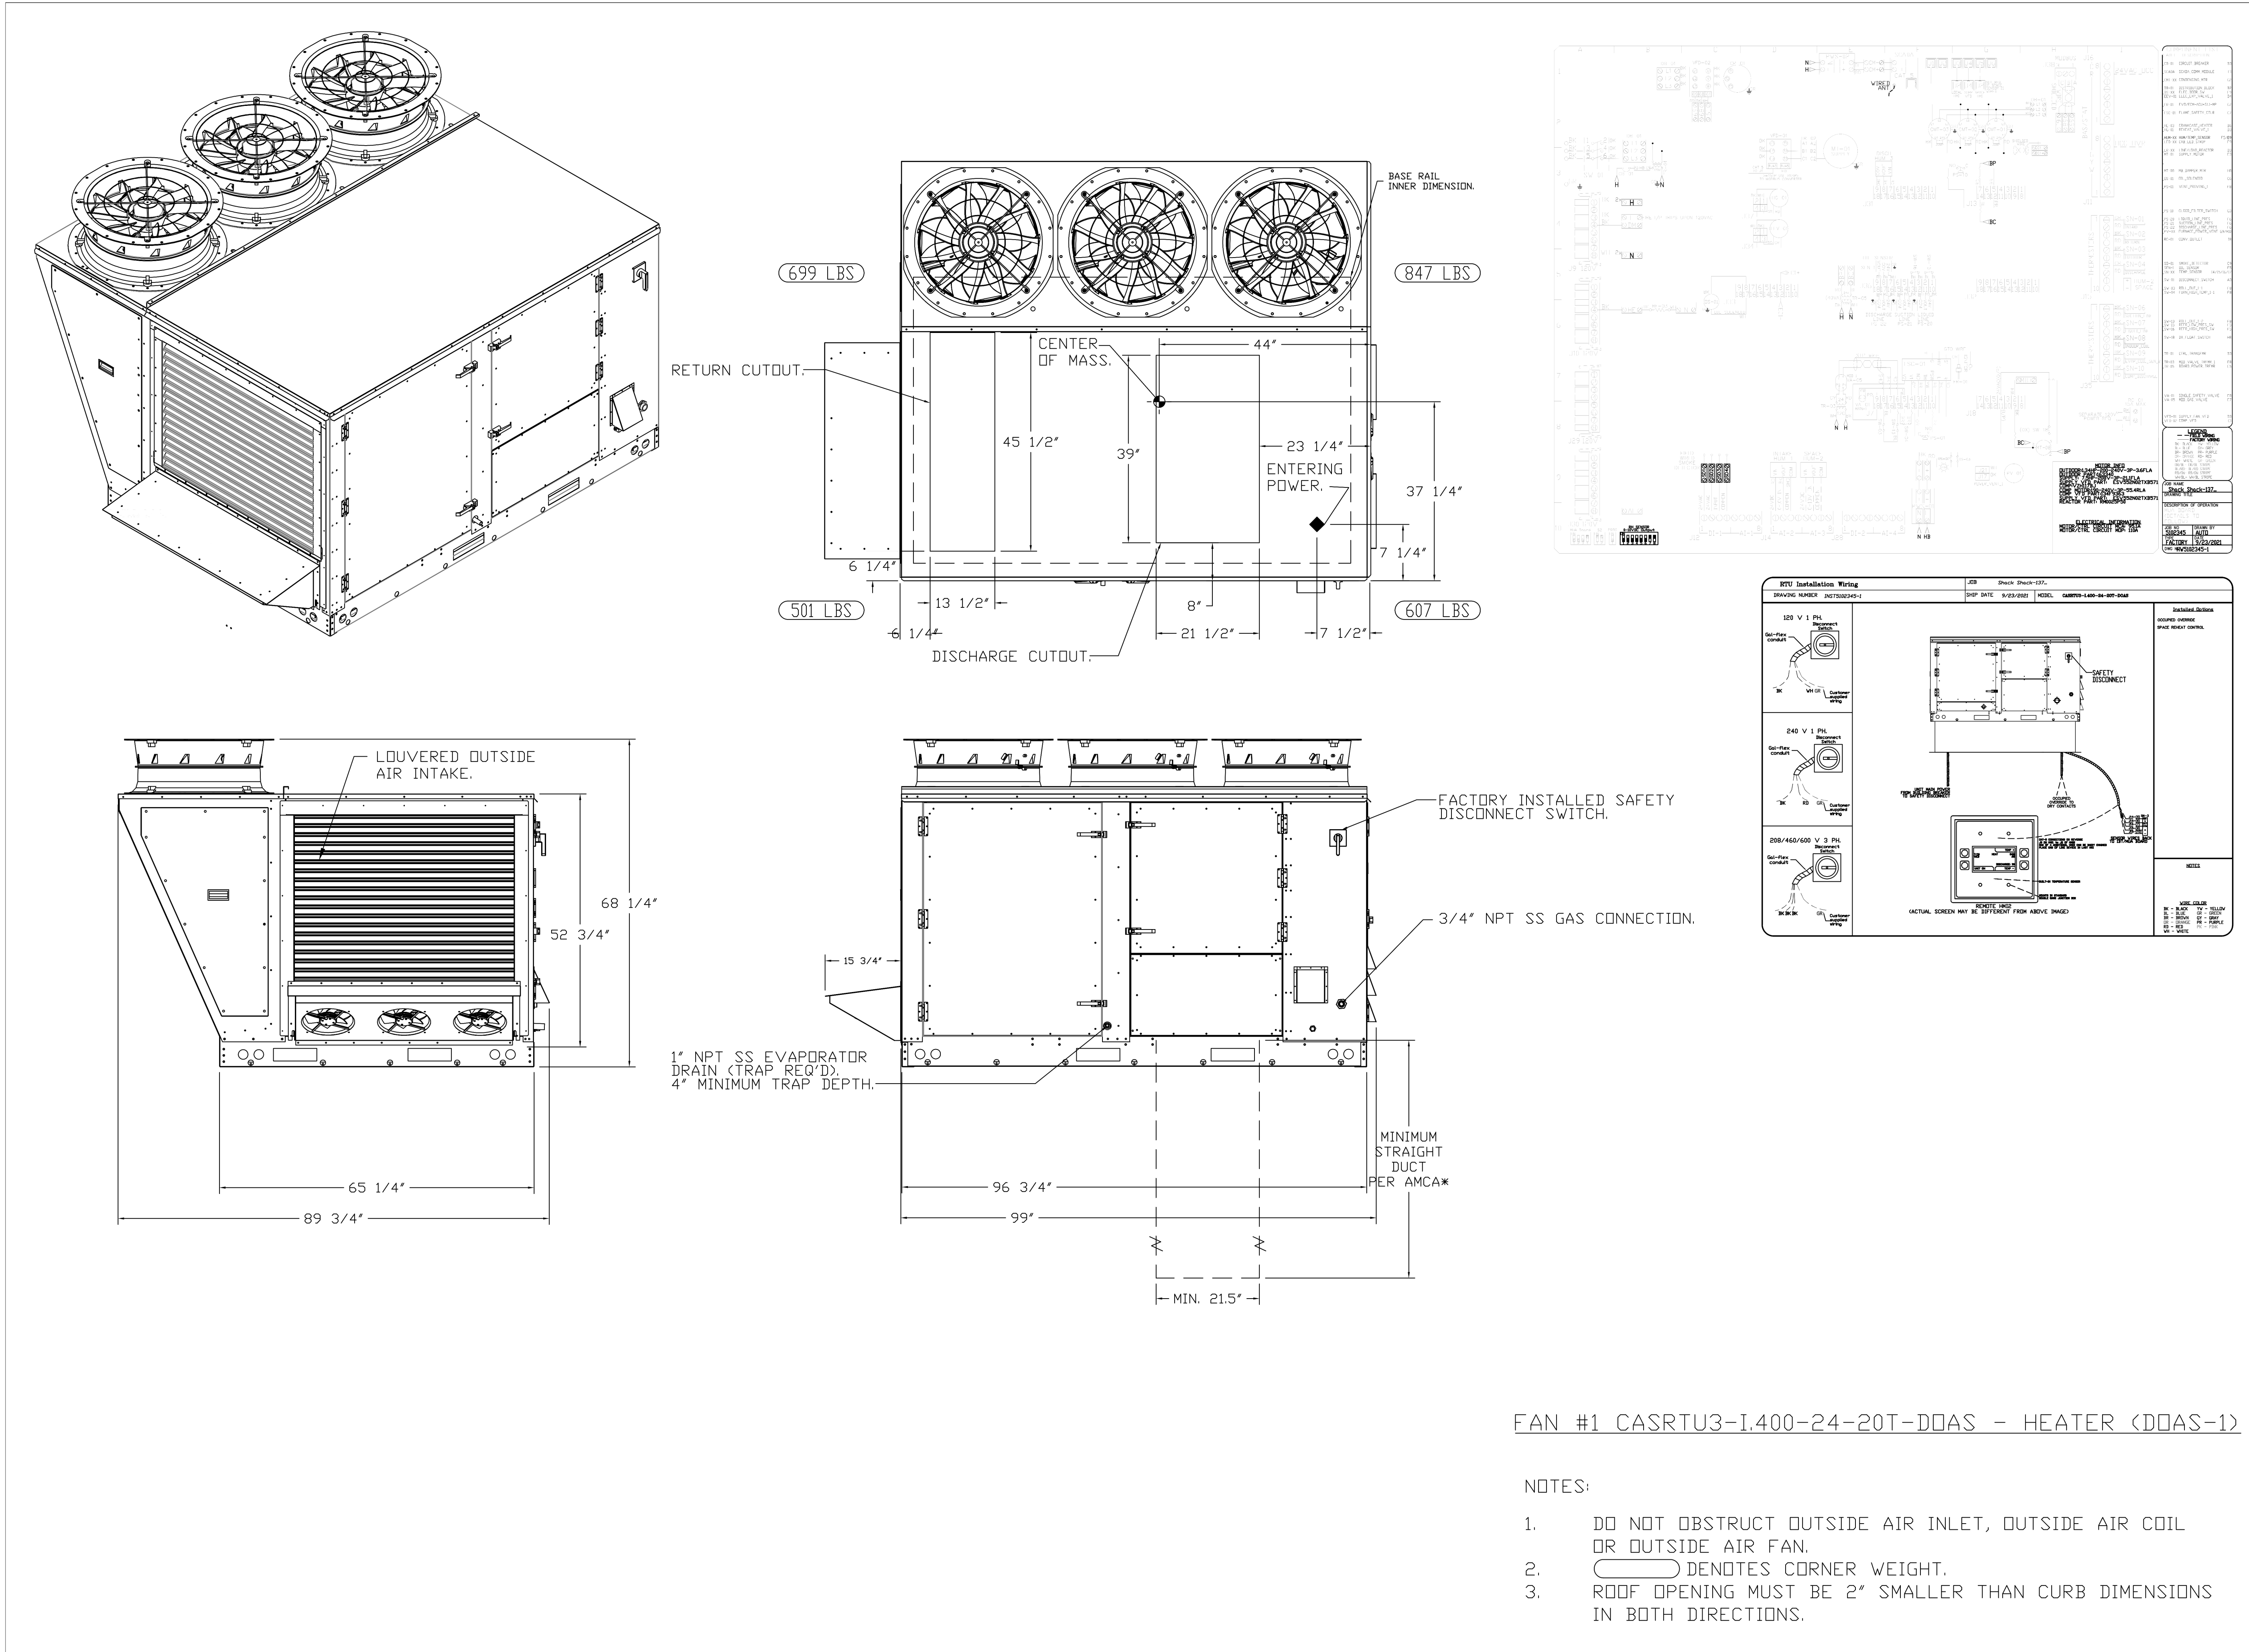

REVISIONS	
DESCRIPTION	DATE

CAPTIVE
Eastern PA Mechanical
www.captiveaire.com
PO Box 2520, 1 Union Ave, Bala Cynwyd, PA, 19004 PHONE: (267) 504-4126 EMAIL: res108@captiveaire.com

Shack Shack-1372 -Dublin, OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: Joe Shilka
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 6

FAN #1 CASRTU3-I.400-24-20T-DDAS - HEATER (DDAS-1)

- NOTES:
- DO NOT OBSTRUCT OUTSIDE AIR INLET, OUTSIDE AIR COIL OR OUTSIDE AIR FAN.
 - DENOTES CORNER WEIGHT.
 - ROOF OPENING MUST BE 2" SMALLER THAN CURB DIMENSIONS IN BOTH DIRECTIONS.

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	PERMIT/BID
	10/25/2021	LANDING REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVE AIRE DRAWINGS


Job No. 2150002415
Scale N.T.S.

Drawn Author
Date 11/12/2021

Sheet No.
M706

ELECTRICAL PACKAGE - JOB#5272745







NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTIDN	FANS CONTROLLED					
				LOCATION	QUANTITY		FAN TAG	TYPE	HP	VOLTS	FLA	
1		SC-140110MA	WALL MOUNT IN SS BOX (14" W x 19" H x 6" D)	05 - SS WALL MOUNT BOX	1 LIGHT 1 FAN	SMART CONTROLS THERMOSTATIC CONTROL w/ RELAY DIVERT WITH SUPPLY	KEF-1	EXHAUST	1	0.500	208	3.8
							KEF-2	EXHAUST	1	0.500	208	3.8
							KEF-3	EXHAUST	1	0.500	208	3.8
							KEF-4	EXHAUST	1	0.500	208	3.8

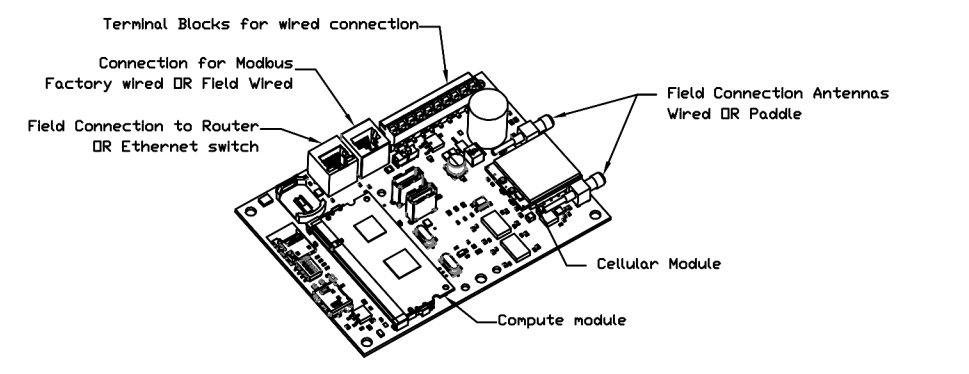

CASink Monitor and Control
Head control panel to support communications to cloud-based Building Management System.
Head Control Panel to allow cloud-based Building Management System to monitor real time parameters outlined as MONITOR on the points list.
Head Control Panel to allow cloud-based Building Management System to control parameters outlined as CONTROL on the points list.
Head Control Panel to allow cloud-based Building Management System to implement SETPOINT ECONOMIZER control strategies for fully integrated Building Management.

MONITORING AND CONTROL POINTS LIST

DCP Packages	Function	DC Packages	Function
Room Temperature	MONITOR	Room Temperature(s)	MONITOR
Duct Temperature	MONITOR	Duct Temperature(s)	MONITOR
RTU Discharge Temperature	MONITOR	RTU Discharge Temperature	MONITOR
Return RTU Discharge Temperature	MONITOR	Return RTU Discharge Temperature	MONITOR
Fan Speed	MONITOR	Controller Faults	MONITOR
Fan Amperage	MONITOR	Fan Faults	MONITOR
Fan Pressure	MONITOR	Fan Trips	MONITOR
VFD Faults	MONITOR	VFD Faults	MONITOR
Controller Faults	MONITOR	VFD Filter Cap Percentages	MONITOR
Fan Faults	MONITOR	Fan Conditions	MONITOR
Fan Status	MONITOR	CO2 New System	MONITOR
VFD Faults	MONITOR	Building Pressure	MONITOR
VFD Filter Cap Percentages	MONITOR	Fan Status(s)	MONITOR & CONTROL
Fan Conditions	MONITOR	Light Status(s)	MONITOR & CONTROL
CO2 New System	MONITOR	Push Button	MONITOR & CONTROL
Building Pressure	MONITOR		
Prep Temp Button	MONITOR & CONTROL		
Fan Status	MONITOR & CONTROL		
Light Status	MONITOR & CONTROL		
Push Button	MONITOR & CONTROL		

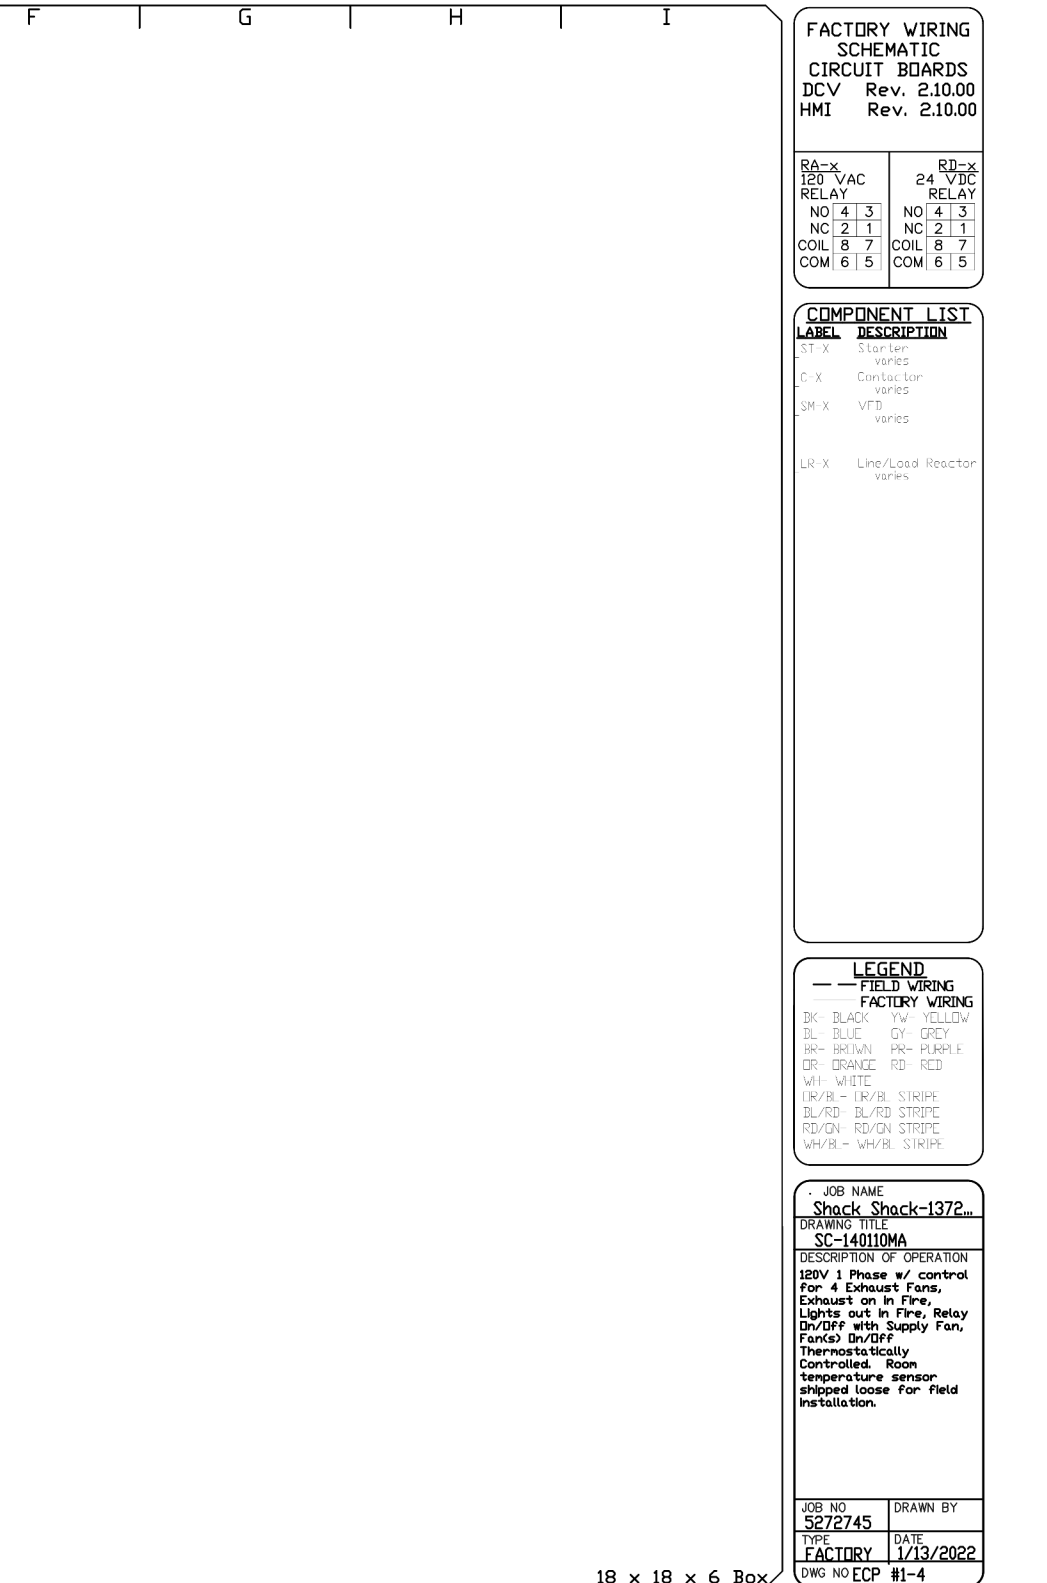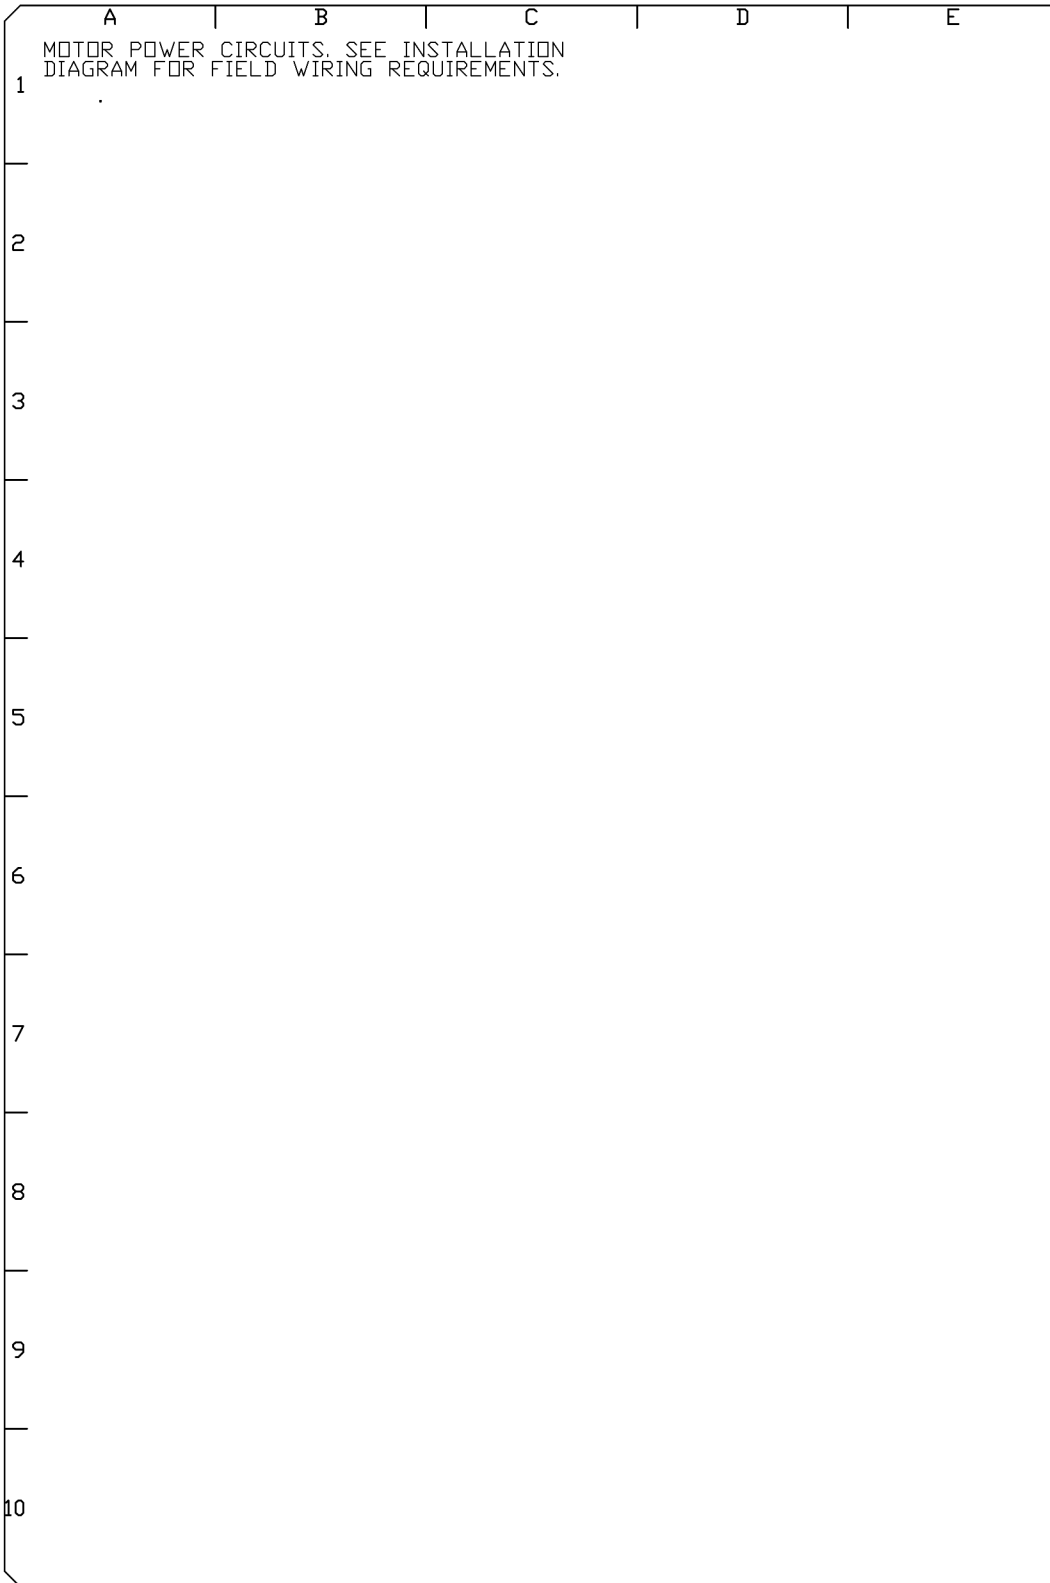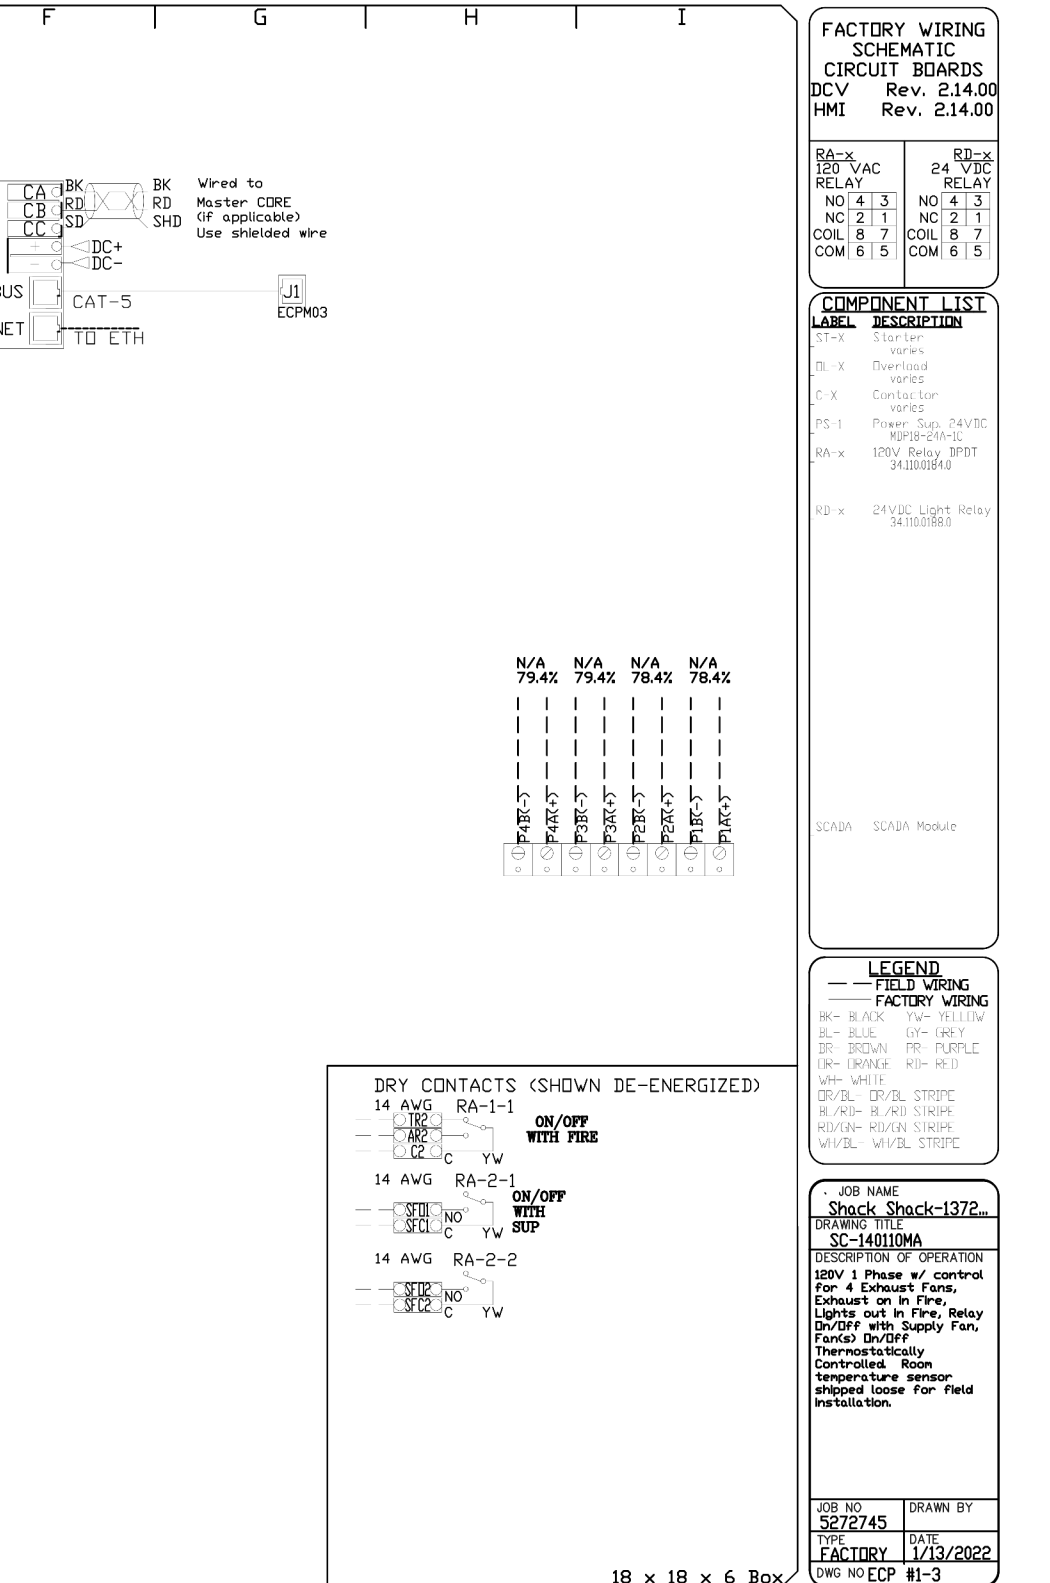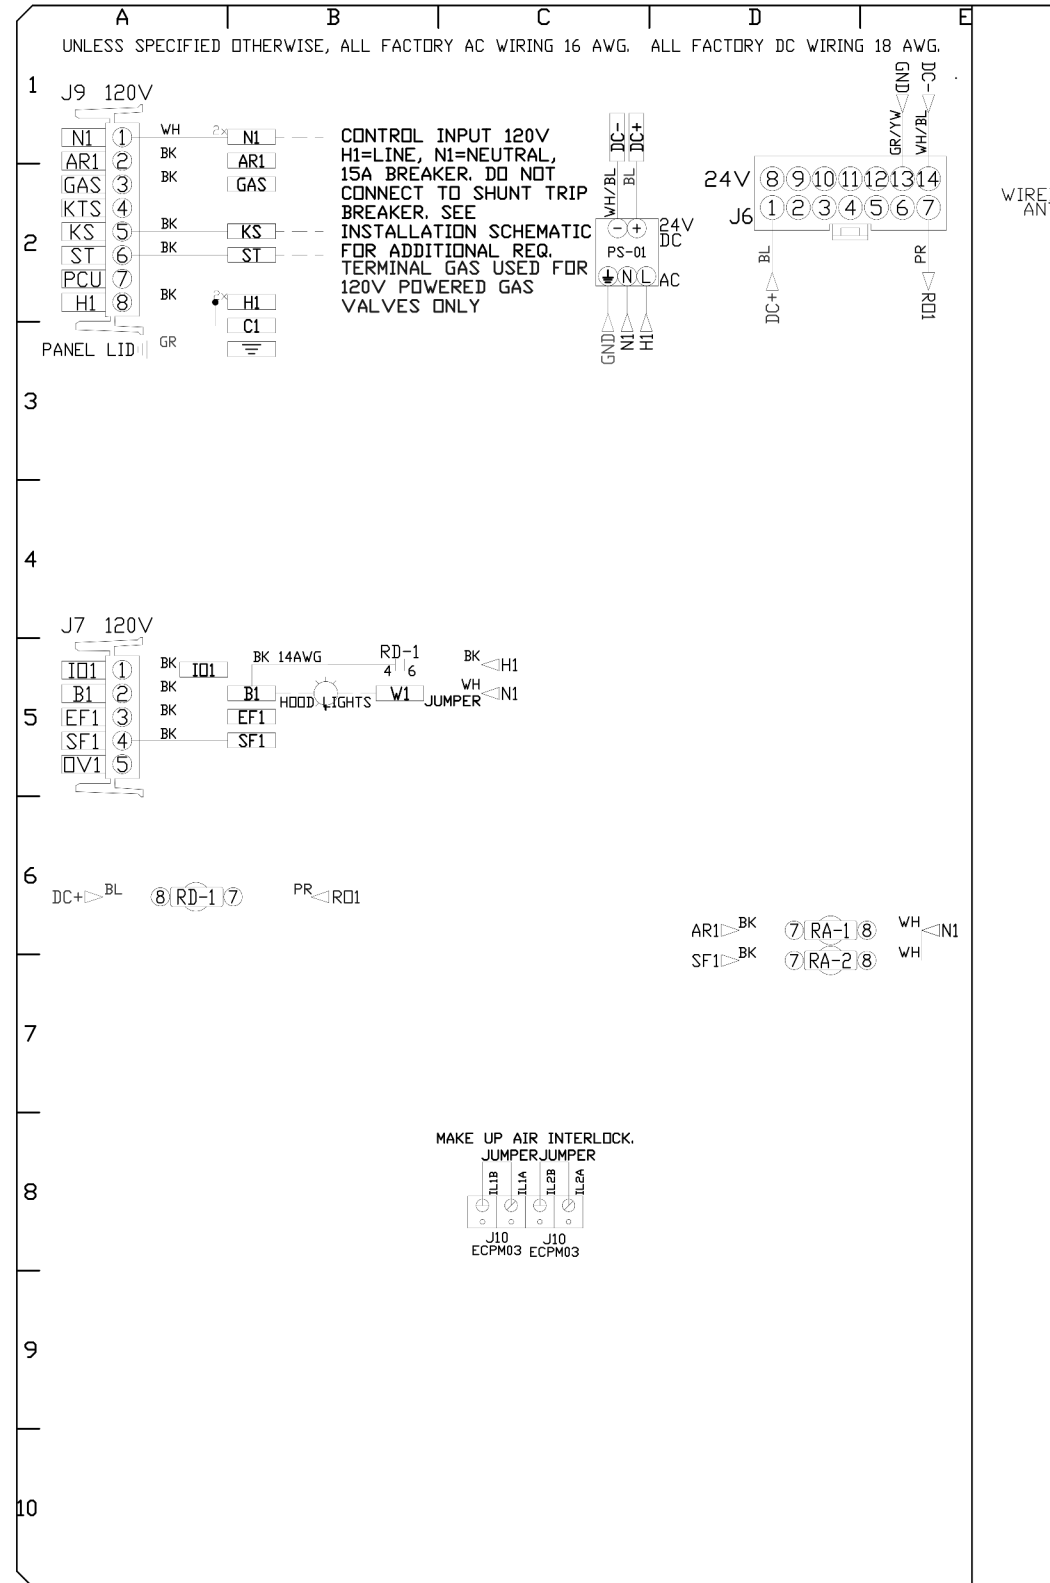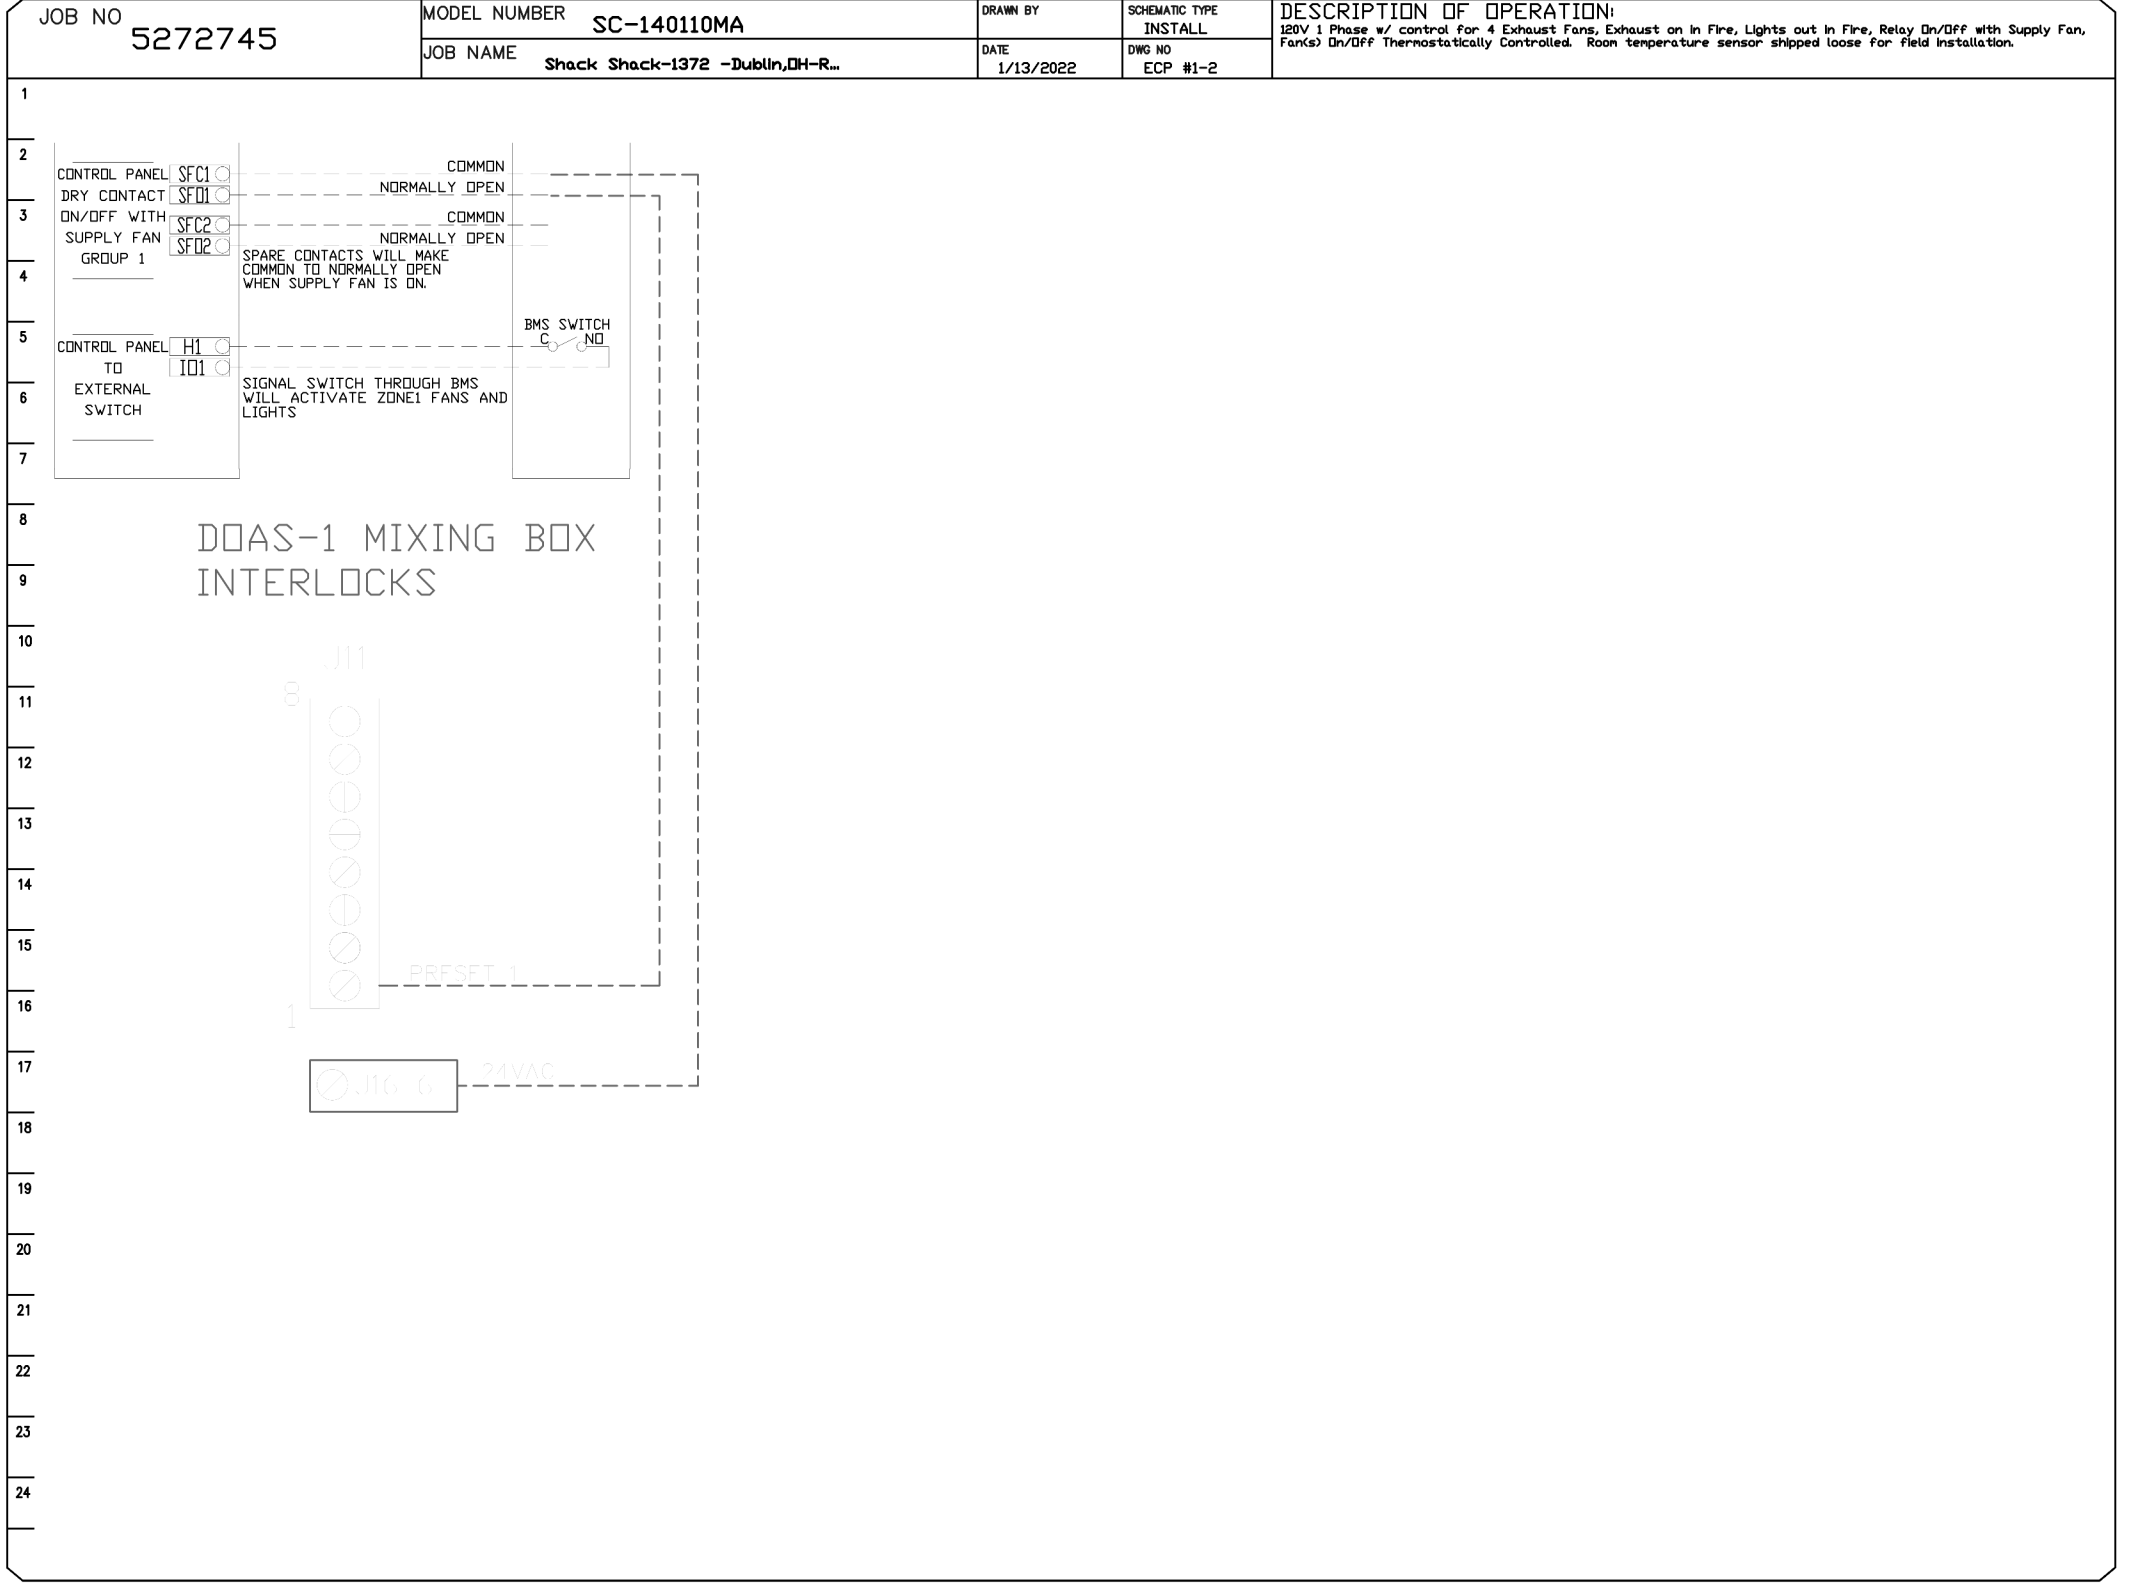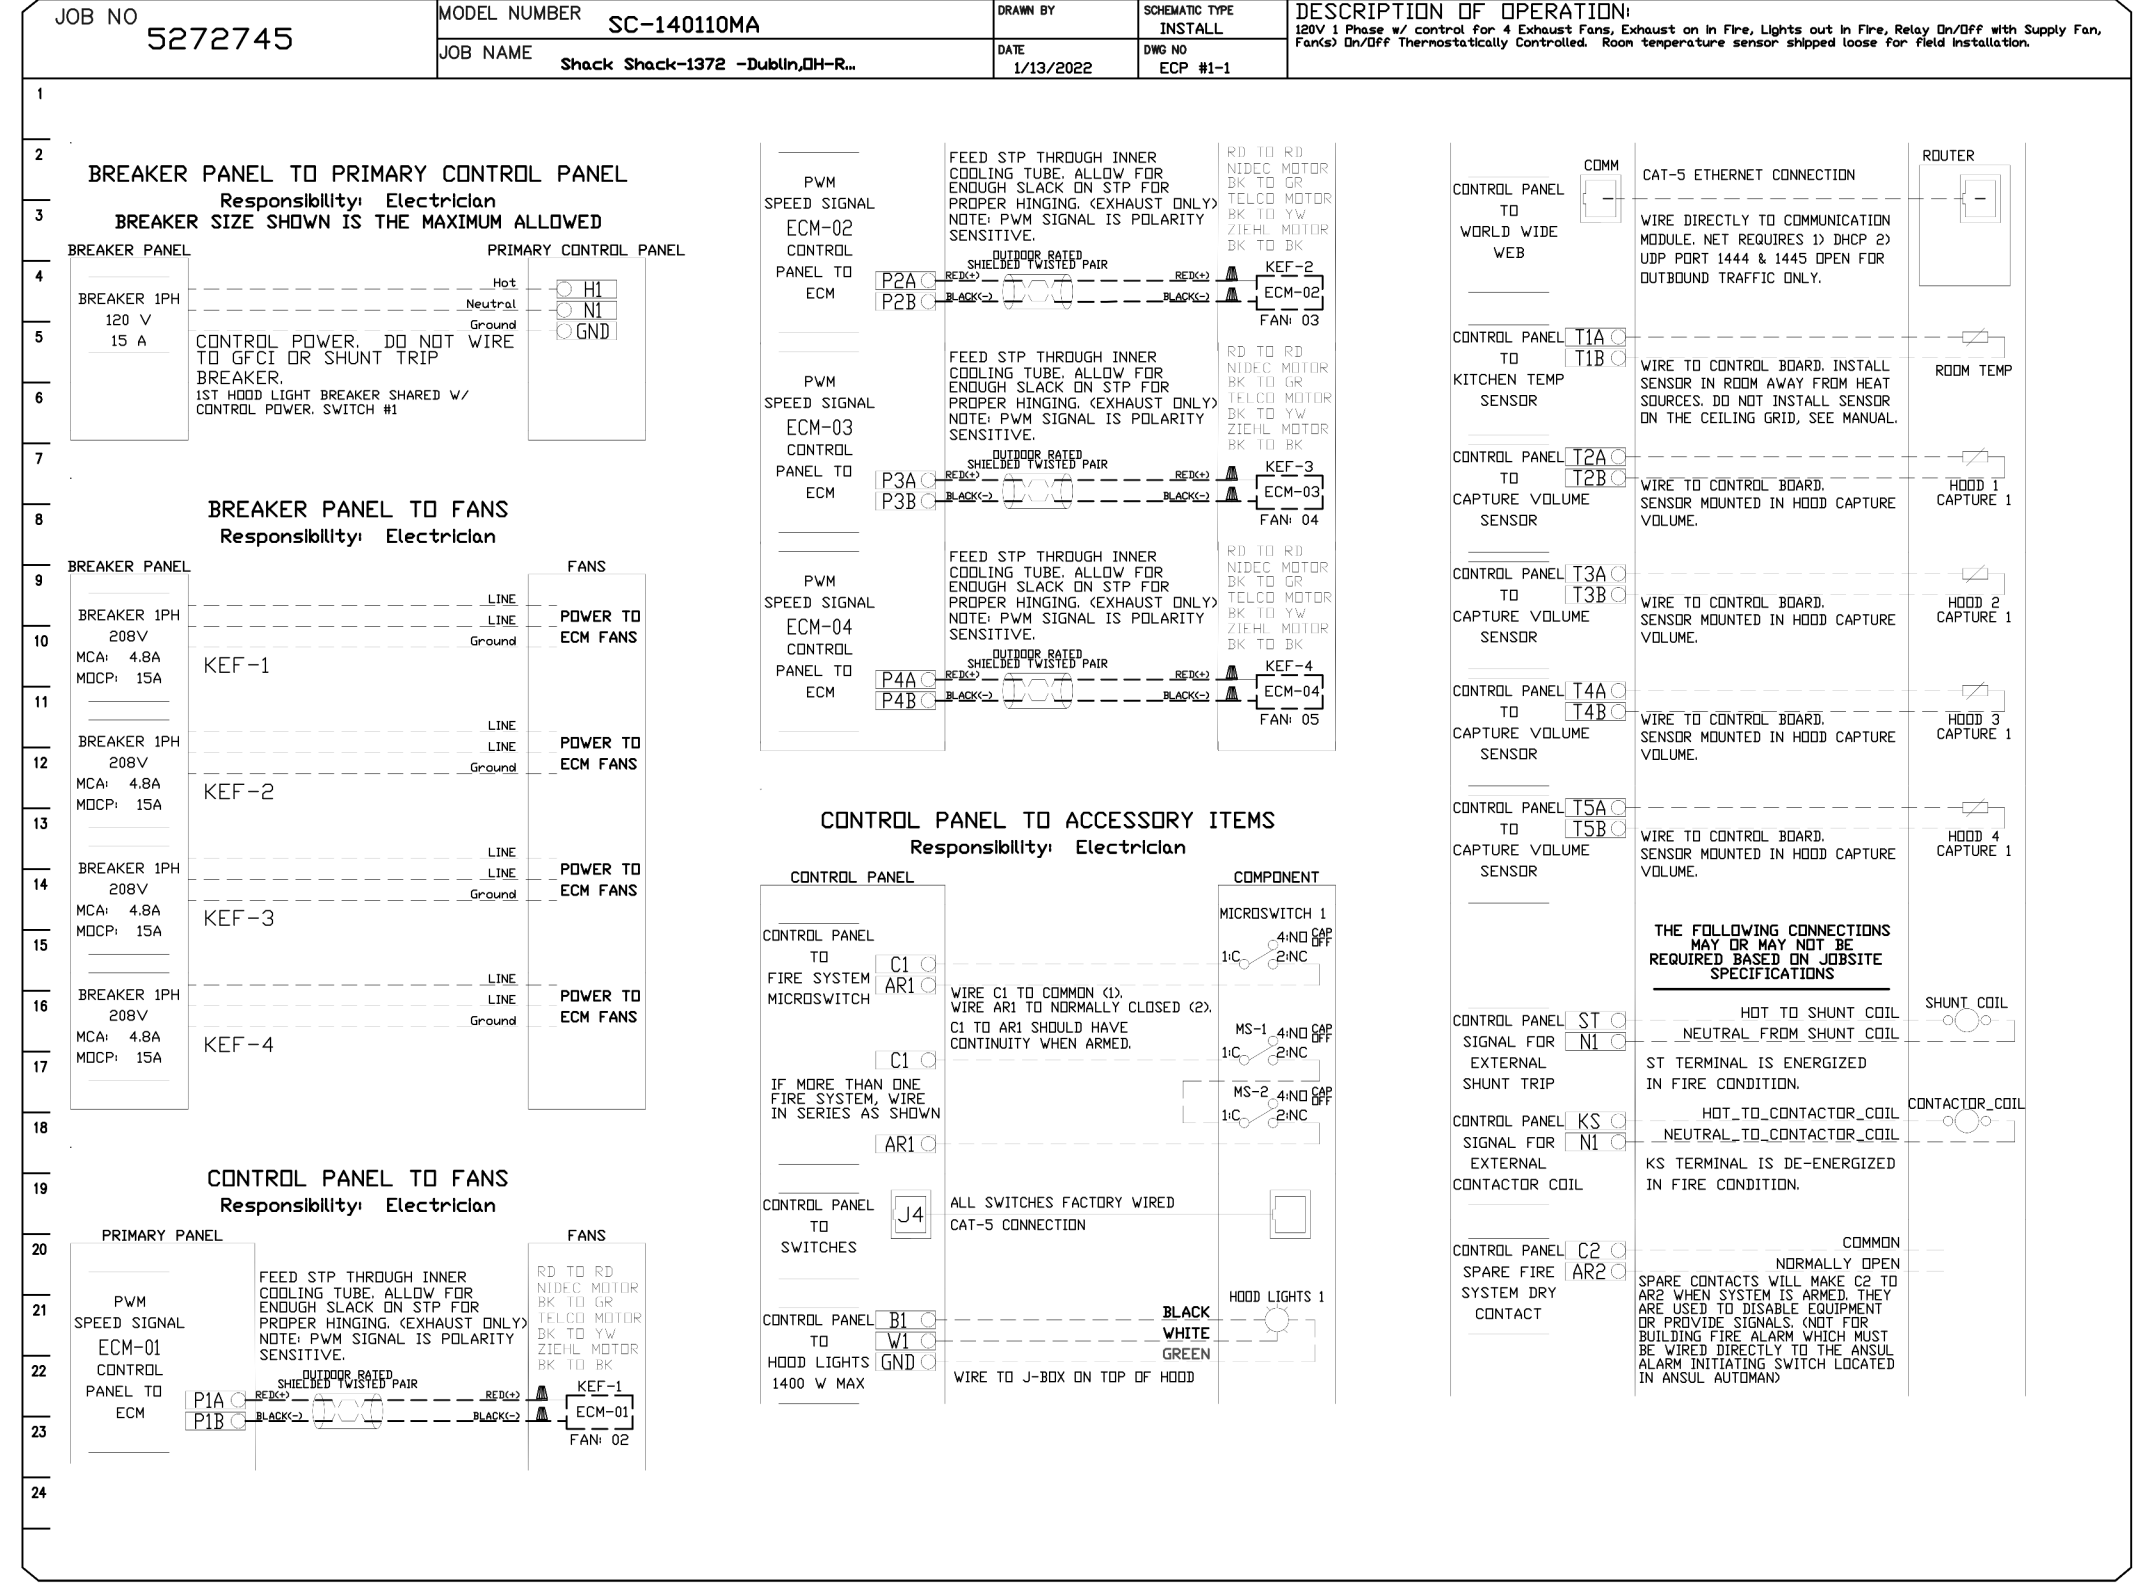

REVISIONS

NO	DATE	DESCRIPTION
1		
2		
3		
4		
5		

CAPTIVE
Eastern PA Mechanical
www.captiveaire.com
PO Box 2520, 1 Union Ave, East Croydon, PA 19024 PHONE: (267) 504-1726 EMAIL: rfg108@captiveaire.com

Shack Shack-1372 - Dublin, OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022
DWG.#: 5272745
DRAWN BY: Joe Shilba
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 7

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.
COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without the consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	PERMIT/BID LANDLORD REVIEW SET
	10/25/2021	LANDLORD REVIEW SET

FOR REFERENCE ONLY

Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
Scale N.T.S.


Drawn By: Author
Date: 11/12/2021

Sheet No.
M707

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.

CRIMSON+ CONTROL DETAILS

LOW VOLTAGE & INTERLOCKS (SEE SCHEMATICS FOR LINE VOLTAGE)

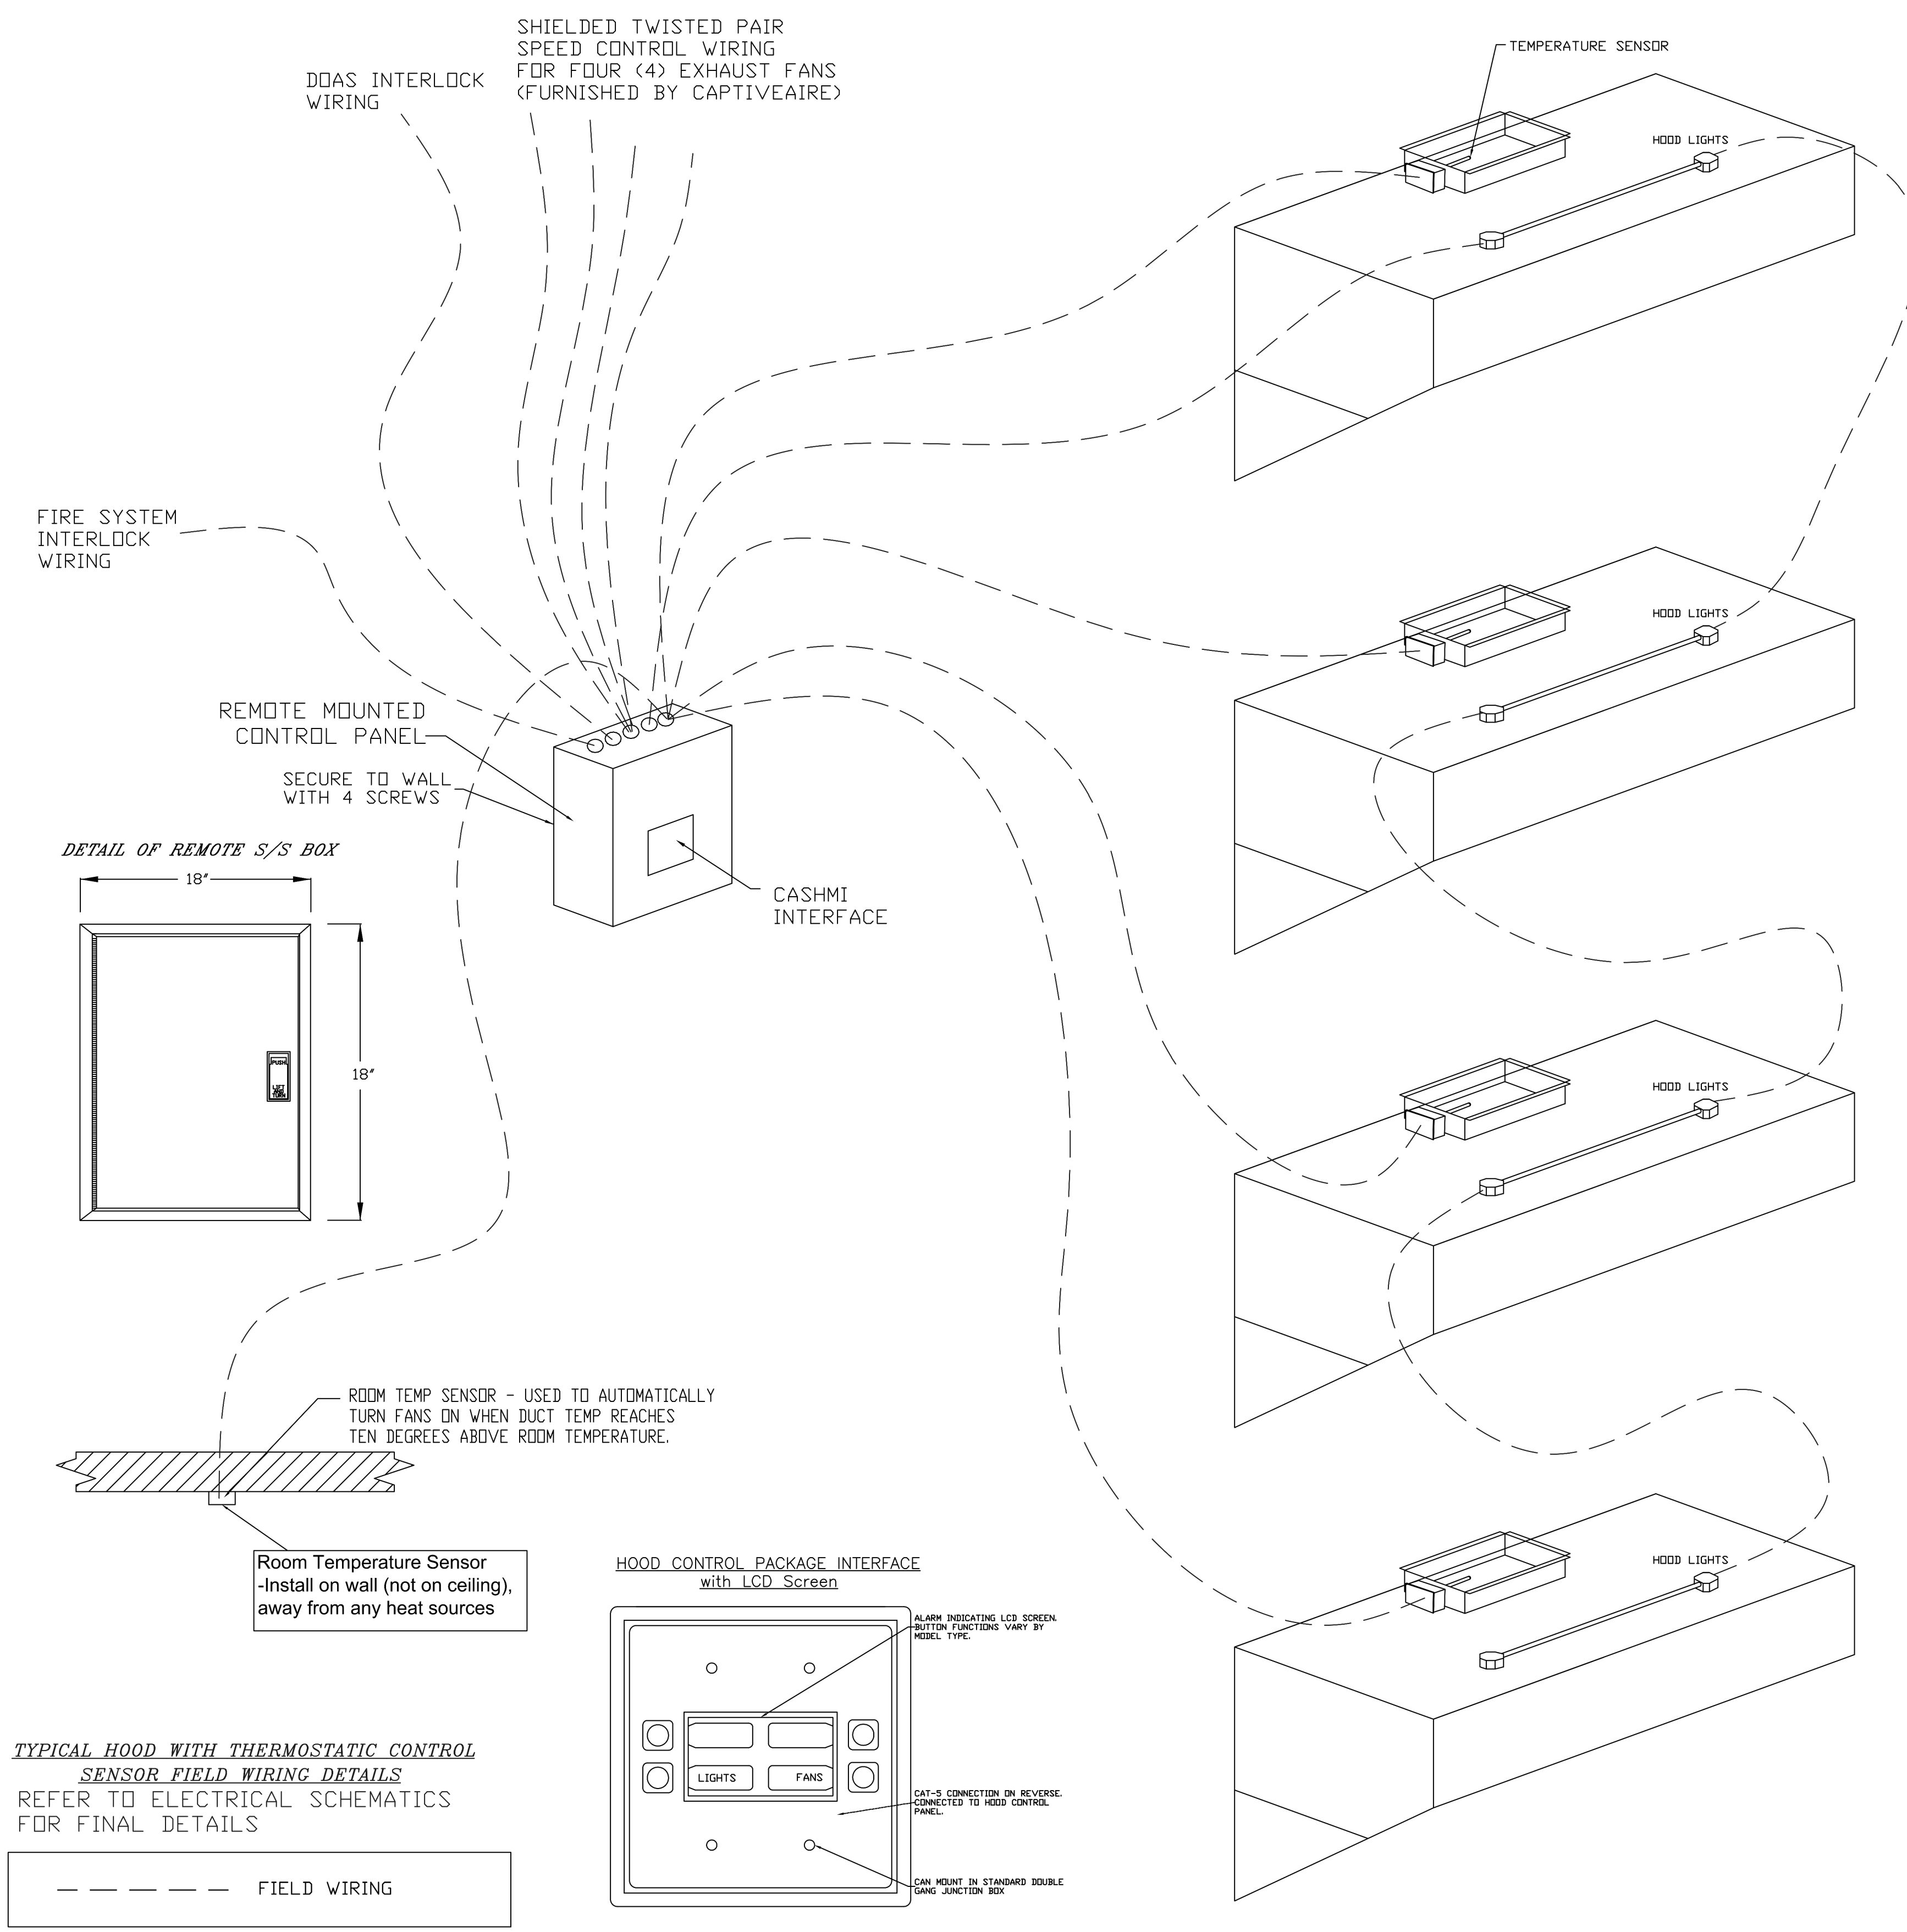

SC- Specification:

The Electrical Package, typically FP, is designed to thermostatically activate the exhaust fans for an exhaust hood whenever elevated temperatures are sensed in the exhaust system. This option will meet the requirements of IMC 507.2.1.1 by providing a thermostat(s) mounted in the duct or hood riser to sense increased exhaust temperatures. Controls shall be listed by ETL (UL 508A). The control enclosure shall be NEMA 1 rated and listed for installation inside of the exhaust hood utility cabinet. The control enclosure may be constructed of stainless steel or painted steel.

Temperature probes(s) located in the duct riser shall be constructed of Stainless Steel. A room temperature sensor is also provided for field installation in the kitchen space in order to start the fan(s) based on the temperature differential between the room and the exhaust air in the duct, rather than fixed set-points. The system is factory pre-set to activate the fans at 10 deg F° above the room temperature.

Once the duct temperature reaches the activation point, the exhaust fans will be activated. The controls also provide hysteresis to prevent cycling of the fans after the cooking appliances have been turned off and the heat in the exhaust system is reduced. The hysteresis is factory set 2 degrees and will keep the exhaust running until the temperature falls 2 degrees below the activation set point. A hysteresis timer also exists to keep the fans running for at least 30 min after being activated by the temperature rise.

The activation and hysteresis settings may be field adjusted on the board LCD interface located inside the control enclosure to meet application needs. The panel is factory configured to shut down supply fans, turn on the exhaust fans and turn off the hood lights in a fire condition.

REVISIONS	
DESCRIPTION	DATE



Shack Shack-1372 - Dublin, OH-R3
AMLIN, OH, 43002

DATE: 1/13/2022


DWG.#: 5272745

DRAWN BY: Joe Shilba

SCALE: 3/4" = 1'-0"

MASTER DRAWING


SHEET NO. 8

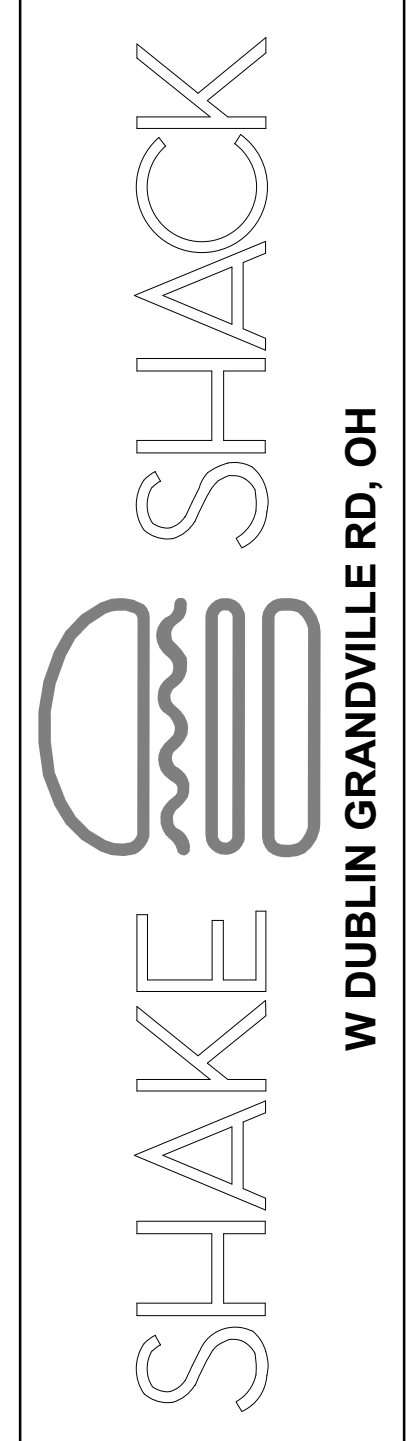

FIELD VERIFICATION
Contractor shall verify all figured dimensions and conditions at the job site and notify Aria Group Architects, Inc. of any dimensional errors, omissions or discrepancies before beginning or fabricating any work. Do not scale these drawings.

COPYRIGHT
Aria Group Architects, Inc. shall retain all common law, statutory and other reserved rights. These drawings and related documents shall not be duplicated, disclosed or otherwise used without written consent of Aria Group Architects, Inc.

NO.	DATE	REVISIONS
3	05/20/2022	ISSUE FOR CONSTRUCTION
2	01/25/2022	ADDENDUM #2
1	01/14/2022	ADDENDUM #1
	11/15/2021	ISSUE FOR PERMIT/BID
	10/25/2021	LANDLORD REVIEW SET

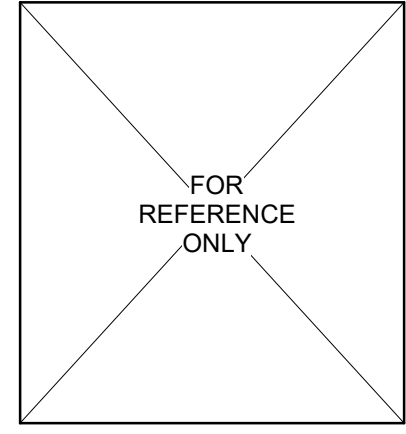

Drawing Title
CAPTIVE AIRE DRAWINGS

Job No. 2150002415
Drawn Author

Scale N.T.S.
Date 11/12/2021

Sheet No.
M708

NOTE:
THE DOCUMENTATION CONTAINED ON THIS SHEET WAS NOT PREPARED BY HENDERSON ENGINEERS AND IS INCLUDED IN THIS SET FOR REFERENCE ONLY. HENDERSON ENGINEERS REVIEWED THE DOCUMENTATION ON THIS SHEET FOR GENERAL COMPLIANCE WITH DESIGN INTENT. SUPPLIER IS RESPONSIBLE THAT ALL FURNISHED EQUIPMENT ON THIS SHEET COMPLIES WITH APPLICABLE LOCAL, STATE, AND FEDERAL LAWS, CODES, AND REGULATIONS.