REGULATORY AGENCIES & UTILITIES

ZONING DEPARTMENT:	HAMILTON TOWNSHIP 2090 GREENWOOD AVENUE PO BOX 00150 HAMILTON, NJ 08650 CONTACT: BILL CALLAHAN E: WCALLAHAN@HAMILTONNJ.COM T: 609.890.3666	BUILDING DEPARTMENT:	HAMILTON TOWNSHIP 2090 GREENWOOD AVENUE PO BOX 00150 HAMILTON, NJ 08650 CONTACT: BILL CALLAHAN E: WCALLAHAN@HAMILTONNJ.COM T: 609.890.3666	HEALTH DEPARTMENT:	HAMILTON TOWNSHIP 2090 GREENWOOD AVENUE PO BOX 00150 HAMILTON, NJ 08650 CONTACT: LISA SURTEES E: ISURTEES@HAMILTONNJ.COM T: 609.890.3666
FIRE DEPARTMENT:	HAMILTON TOWNSHIP 2090 GREENWOOD AVENUE PO BOX 00150 HAMILTON, NJ 08650 CONTACT: BILL CALLAHAN E: WCALLAHAN@HAMILTONNJ.COM T: 609.890.3666	WATER UTILITY:	AQUA NJ 10 BLACK FOREST ROAD HAMILTON, NJ 08691 T: 877.987.2782	SEWER UTILITY:	HAMILTON SEWER DEPARTMENT 300 HOBSON AVE. HAMILTON, NJ 08610 T: 609.581.4140
NATURAL GAS UTILITY:	PSE&G 20 COMMERCE DRIVE #400 CRANFORD, NJ 07016 T: 800.436.7734	ELECTRICAL UTILITY:	PSE&G 20 COMMERCE DRIVE #400 CRANFORD, NJ 07016 T: 800.436.7734	TELEPHONE UTILITY:	VERIZON T: (800) 201-1542

PROJECT INFORMATION

LANDLORD:	TONY PABLI SITE CENTERS E: APAVLI@SITECENTERS.COM T: (216) 755-6730	TENANT:	CHIPOTLE MEXICAN GRILL PO BOX 182566 COLUMBUS, OH 43218-2566 E: E.YU@CHIPOTLE.COM T: (201) 988-9572	ARCHITECT:	GREENBERG FARROW 92 EAST MAIN STREET SUITE 410 SOMERVILLE, NJ 08876 NISHANT PATEL - ARCHITECTURAL PROJECT MANAGER NPATEL@GREENBERGFARROW.COM T: (732) 207-4861
MECHANICAL ELECTRICAL PLUMBING ENGINEER:	POLARIS CONSULTING ENGINEERS, PC 214W MAIN STREET, SUITE 208 MOORESTOWN, NJ 08057 CONTACT: STEPHEN CONNLAIN E: SCONNLAIN@POLARISCE.COM P: (856) 778-5400	STRUCTURAL ENGINEER:	GREENBERG FARROW 92 EAST MAIN STREET, SUITE 410 SOMERVILLE, NJ 08876 CONTACT: JASON KOFFKE JKOFFKE@GREENBERGFARROW.COM T: (732) 537-0811 M: (732) 354-1461		

UTILITY COORDINATOR

NOTE to GC:
FOR ALL WATER, SEWER, NATURAL GAS, & ELECTRICITY UTILITIES CONTACT:

HDGROUP, INC.
295 LUNA LN.
ERIE, CO 80516
CONTACT: MELISSA BALCERAK
MBALCERAK@HUNTERDEVELOPMENTGROUP.COM
T: (972) 396-8409
F: (214) 291-5597

Store Number: 4064

HAMILTON NJ

555 MARKETPLACE BLVD, HAMILTON TOWNSHIP NJ, 08691

ABBREVIATIONS

℄	CENTER LINE
(E)	EXISTING CONSTRUCTION
(N)	NEW CONSTRUCTION
@	AT
Ø	DIAMETER OR ROUND
AFF	ABOVE FINISH FLOOR
ALUM	ALUMINUM
ARCH	ARCHITECT(URAL)
ASS	ALARM SYSTEM SUPPLIER
BD	BOARD
BLDG	BUILDING
CMU	CONCRETE MASONRY UNIT
CO2	CO2 SUPPLIER
CO2AS	CO2 ALARM SUPPLIER
CS	CHEMICAL SUPPLIER
DIM	DIMENSION(S)
EA	EACH
EL	ELEVATION (VERTICAL HEIGHT)
ELEC	ELECTRIC(AL)
ELEV	ELEVATION
EQ	EQUAL
EXT	EXTERIOR
FC	FOR CONSTRUCTION
FRP	FIBERGLASS REINFORCED PANEL
FRT	FIRE RETARDANT-TREATED
GA	GAUGE
GALV	GALVANIZED
GC	GENERAL CONTRACTOR
GYP	GYPSUM
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	HOOD SUPPLIER
HVAC	HEATING AND VENTILATING
ICP	INITIAL COST PROJECTION
IFP	IN FOR PERMIT
INT	INTERIOR
MAX	MAXIMUM
MECH	MECHANICAL
MFR	MANUFACTURER
MIN	MINIMUM
MISC	MISCELLANEOUS
MSS	MUSIC SYSTEMS SUPPLIER
N.I.C.	NOT IN CONTRACT
NO	NUMBER
OC	ON CENTER
OSB	ORIENTED STRAND BOARD
POS	POINT OF SALE
PREP	PREPARATION
PVC	POLYVINYL CHLORIDE
QT	QUARRY TILE
R	RADIUS
RTU	ROOF TOP UNITS
SIM	SIMILAR
SPS	SODA POP SUPPLIER
SS	SUPPORT SIGNAGE
STR	STRUCTURE
T	TENANT
T.B.D.	TO BE DETERMINED, SEE FIELD REFERENCE MANUAL
TAB	TENANT'S TEST & BALLANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
THS	TENANT'S HARDWARE SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TS	TENANT'S SAFE SUPPLIER
TSS	TENANT'S SMART SAFE SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SUPPLIER
TYP	TYPICAL
U.N.O.	UNLESS NOTED OTHERWISE
UPS	UNINTERRUPTED POWER SUPPLY
VAR	VARIES
VIF	VERIFY IN FIELD
W/	WITH
WA	WASHROOM ACCESSORIES
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	WATER HEATER SUPPLIER
WS	TENANT'S WINDOW SHADE SUPPLIER

GRAPHIC SYMBOLS

- EXTERIOR ELEVATION MARKER (1 / SP101 / 1)
- INTERIOR ELEVATION MARKER (1 / A101 / 1)
- SECTION MARKER (SIM / 1 / A101)
- SECTION / DETAIL (SIM / 1 / A101)
- VIEW LABEL (1 / A101 **View Name** View Scale)
- COLUMN GRID LABEL (0)
- ROOM NAME & NUMBER (Room name / 101)
- REVISION NUMBER (1)
- DOOR NUMBER (1i)
- MISCELLANEOUS EQUIPMENT NUMBER (XX.X)
- KITCHEN EQUIPMENT NUMBER (XX.X)
- FURNITURE NUMBER (XX.X)
- WASHROOM ACCESSORIES NUMBER (X)
- WALL TAG (W1)
- LEVEL TARGET
- NORTH ARROW
- DIMENSION TARGET
- FINISH TAG (P1)

VICINITY MAP


555 Marketplace Blvd, Hamilton Township, NJ 08691



TRUE

VICINITY MAP (1 / G000) 6" = 1'-0"

KEY PLAN



PLAN

KEY SITE PLAN (2 / G000) 1" = 80'-0"

SCOPE OF WORK

TENANT INTERIOR AND EXTERIOR ALTERATION TO AN EXISTING SHELL BUILDING

GROUP	TENANT	USE
PREVIOUS USE:	NORTH FORK BAK	B
PROPOSED USE:	CHIPOTLE MEXICAN GRILL	A-2

PROJECT NOTES

1. ALL CONSTRUCTION SHALL COMPLY WITH APPLICABLE BUILDING CODES AND LOCAL RESTRICTIONS. CONTRACTORS MUST COMPLY WITH CONTRACTOR REGISTRATION REQUIREMENTS OF ALL GOVERNING AUTHORITIES. ALL REQUIRED CITY/COUNTY/STATE PERMITS (BUILDING, ETC.) SHALL BE ACQUIRED AND PAID FOR BY THE GENERAL CONTRACTOR.
2. APPROVED PLANS SHALL BE KEPT IN A PLAN BOX AND SHALL NOT BE USED BY WORKERS. ALL CONSTRUCTION SETS SHALL REFLECT SAME INFORMATION. CONTRACTOR SHALL MAINTAIN ONE COMPLETE SET OF PLANS ON THE PREMISES IN GOOD CONDITION AT ALL TIMES. THIS SHALL INCLUDE ALL ADDENDA AND CHANGE ORDERS.
3. THE CONTRACTOR SHALL FIELD VERIFY ALL CONDITIONS AND DIMENSIONS PRIOR TO STARTING ANY WORK AND SHALL BE RESPONSIBLE FOR ALL WORK AND MATERIALS INCLUDING THOSE FURNISHED BY SUBCONTRACTORS AND OWNER.
4. DISCREPANCIES BETWEEN PORTIONS OF THE CONTRACT DOCUMENTS, DRAWINGS AND SPECIFICATIONS ARE NOT INTENDED. THE CONTRACTOR IS TO CLARIFY ANY SUCH DISCREPANCIES WITH THE OWNER PRIOR TO COMMENCING WORK.
5. STATED DIMENSIONS TAKE PRECEDENCE OVER GRAPHICS. DO NOT SCALE DRAWINGS TO DETERMINE LOCATIONS. THE OWNER SHALL BE NOTIFIED OF ANY SUCH DISCREPANCIES IN WRITING PRIOR TO CONTINUING WITH WORK.
6. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO LOCATE ALL EXISTING UTILITIES WHETHER SHOWN HEREIN OR NOT AND TO PROTECT THEM FROM DAMAGE. THE CONTRACTOR SHALL BEAR THE EXPENSE OF REPAIR OR REPLACEMENT OF UTILITIES OR OTHER PROPERTY DAMAGED BY OPERATIONS IN CONJUNCTION WITH THE EXECUTION OF THE WORK.
7. GENERAL CONTRACTOR TO REFER TO THESE DOCUMENTS AS WELL AS SPECIFICATIONS FOR IDENTIFICATION OF ALL OWNER SUPPLIED ITEMS. ALL ITEMS NOT MARKED AS 'OWNER SUPPLIED' ARE TO BE SUPPLIED BY GENERAL CONTRACTOR. UNLESS NOTED OTHERWISE, ALL ITEMS ARE TO BE INSTALLED BY GENERAL CONTRACTOR.
8. FOR CONSTRUCTION DETAILS NOT SHOWN, USE THE MANUFACTURER'S APPROVED SHOP DRAWINGS / DATA SHEETS IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.
9. GENERAL CONTRACTOR IS RESPONSIBLE FOR CLEAN-UP.
10. GENERAL CONTRACTOR SHALL FAMILIARIZE THEMSELVES WITH ALL LANDLORD REQUIREMENTS AND SHALL ADHERE TO LANDLORD REQUIREMENTS PERTAINING TO CONSTRUCTION. THIS INCLUDES CONSTRUCTING BARRICADES, NOISE LEVEL, TRASH REMOVAL, ETC.
11. WHEN CONTRACTOR ACCEPTS DELIVERY OF ALL ITEMS NOTED ON PLANS, WHETHER IN CONTRACT OR NOT IN CONTRACT, HE SHALL BE RESPONSIBLE FOR LOSS AND/OR DAMAGE TO THESE ITEMS.
12. DURING ALL PHASES OF WORK, DO NOT DISTURB THE DELIVERIES AND FUNCTIONS OF ADJACENT AND NEIGHBORING TENANTS.
13. ALL IN-WALL WOOD BLOCKING TO BE FIRE-RETARDANT TREATED.

DRAWING INDEX AND REVISIONS

Browser Sorting	SHEET NO.	SHEET NAME	REVISION 1	2	3	4	5	6
17 Plumb	P300	RISER DIAGRAMS		●				
17 Plumb	P400	PLUMBING DETAILS		●				
17 Plumb	P401	PLUMBING DETAILS		●				
ELECTRICAL								
18 Elec	E010	ELECTRICAL SPECIFICATIONS		●				
18 Elec	E100	LIGHTING PLAN		●				
18 Elec	E101	LIGHTING CONTROLS		●				
18 Elec	E102	SITE POWER PLAN		●				
18 Elec	E110	POWER PLAN		●				
18 Elec	E120	HVAC POWER PLAN		●				
18 Elec	E600	PANEL SCHEDULES		●				
18 Elec	E700	ELECTRICAL INTERIOR ELEVATIONS		●				
18 Elec	E701	ELECTRICAL INTERIOR ELEVATIONS		●				
18 Elec	E710	ELECTRICAL DETAILS		●				
18 Elec	EN100	ENERGY COMPLIANCE FORMS		●				

DRAWING INDEX AND REVISIONS

Browser Sorting	SHEET NO.	SHEET NAME	REVISION 1	2	3	4	5	6
GENERAL								
00 General	G000	COVER SHEET		●	●			
00 General	G001	PROJECT DATA & LIFE SAFETY PLAN		●	●			
00 General	G002	ACCESSIBILITY REQUIREMENTS		●	●			
00 General	G010	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G011	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G012	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G013	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G014	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G015	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G016	ARCHITECTURAL SPECIFICATIONS		●	●			
00 General	G017	ARCHITECTURAL SPECIFICATIONS		●	●			
CIVIL								
01 CIVIL	C1.0	SITE DEMOLITION PLAN		●	●			
01 CIVIL	C2.0	SITE LAYOUT PLAN		●	●			
01 CIVIL	C3.0	SITE GRADING PLAN		●	●			
01 CIVIL	C4.0	SITE CONSTRUCTION DETAILS		●	●			
01 CIVIL	C4.1	SITE CONSTRUCTION DETAILS		●	●			
DEMOLITION								
03 Arch	D101	DEMOLITION PLAN		●	●			
03 Arch	D102	DEMOLITION ELEVATIONS		●	●			
SITE PLAN								
03 Arch	SP100	ARCHITECTURAL SITE PLAN		●	●			
ARCHITECTURAL								
05 Arch	A101	SLAB WORK PLAN		●	●			
05 Arch	A102	DEMISED PREMISES PLAN		●	●			
05 Arch	A110	ARCHITECTURAL FLOOR PLAN		●	●			
05 Arch	A120	FINISH PLAN		●	●			
05 Arch	A130	FF&E PLAN		●	●			
05 Arch	A131	FF&E SCHEDULES		●	●			
05 Arch	A132	FF&E SCHEDULES		●	●			
05 Arch	A140	ARCHITECTURAL ROOF PLAN		●	●			
05 Arch	A201	REFLECTED CEILING PLAN		●	●			
05 Arch	A202	REFLECTED CEILING PLANS - ENLARGED		●	●			
05 Arch	A210	CEILING DETAILS		●	●			
05 Arch	A211	LIGHTING DETAILS		●	●			
05 Arch	A301	EXTERIOR ELEVATIONS		●	●			
05 Arch	A501	ARCHITECTURAL WALL TYPES		●	●			
05 Arch	A502	INTERIOR SECTIONS		●	●			
05 Arch	A601	DOOR & HARDWARE SCHEDULE		●	●			
05 Arch	A602	STOREFRONT DETAILS		●	●			
05 Arch	A701A	ELEVATIONS - INTERIOR DINING		●	●			
05 Arch	A701B	ELEVATIONS - INTERIOR DINING		●	●			
05 Arch	A702	ELEVATIONS - INTERIOR KITCHEN		●	●			
05 Arch	A710	RESTROOM DETAILS		●	●			
05 Arch	A801	FINISH DETAILS		●	●			
05 Arch	A802	TILE DETAILS		●	●			
STRUCTURAL								
14 Stru	S000	GENERAL NOTES		●	●			
14 Stru	S001	STRUCTURAL DEMOLITION FDN PLAN & ELEVATIONS		●	●			
14 Stru	S100	EXISTING FOUNDATION PLAN		●	●			
14 Stru	S101	EXISTING ROOF FRAMING PLAN		●	●			
14 Stru	S200	FDN & SLAB SECTIONS & DETAILS		●	●			
14 Stru	S300	ROOF FRAMING SECTIONS & DETAILS		●	●			
14 Stru	S301	SECTIONS AND DETAILS		●	●			
14 Stru	S400	WALL SECTIONS AND DETAILS		●	●			
FIRE PROTECTION								
15 Fire	F100	FIRE PROTECTION PLAN		●	●			
HVAC								
16 Mech	M010	MECHANICAL SPECIFICATIONS, SYMBOLS & GENERAL INFORMATION		●	●			
16 Mech	M100	HVAC PLAN		●	●			
16 Mech	M101	HVAC ROOF PLAN		●	●			
16 Mech	M401	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M402	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M403	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M404	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M405	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M406	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M407	CAPTIVEAIRE DRAWINGS		●	●			
16 Mech	M600	HVAC SCHEDULES		●	●			
16 Mech	M700	HVAC DETAILS		●	●			
16 Mech	M701	HVAC DETAILS		●	●			
PLUMBING								
17 Plumb	P010	PLUMBING SPECIFICATIONS		●	●			
17 Plumb	P100	PLUMBING SUPPLY PLAN		●	●			
17 Plumb	P102	PLUMBING WASTE & VENT PLAN		●	●			
17 Plumb	P200	PLUMBING FIXTURE SCHEDULE		●	●			

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000


Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

COVER SHEET

G000

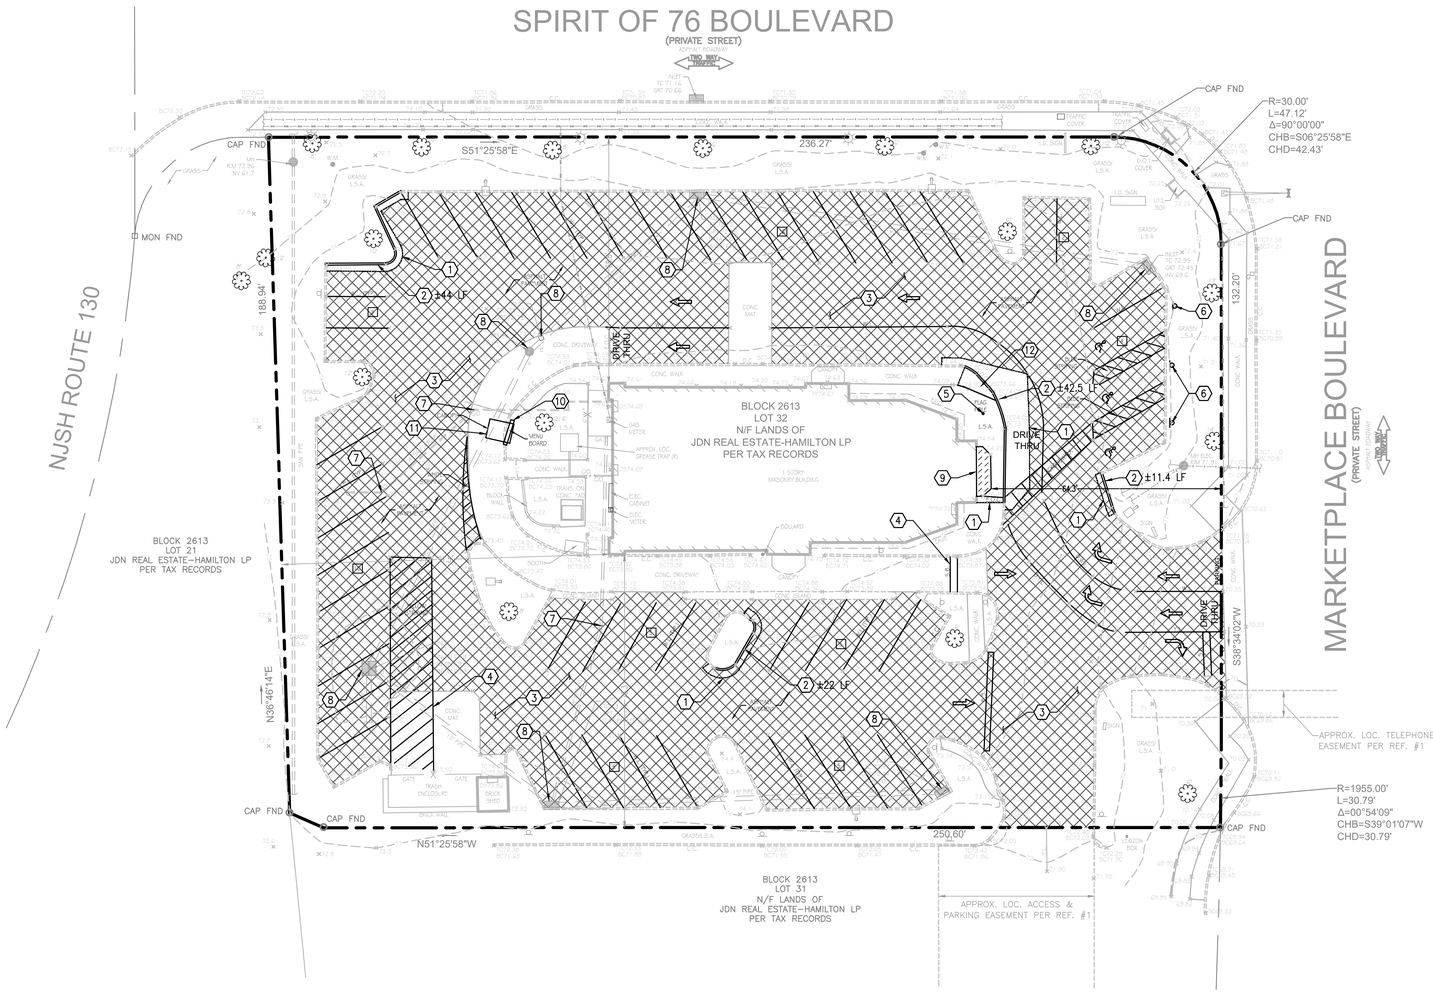

SITE DEMOLITION PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE DEMOLITION NOTES

1. ANY DEMOLITION IS TO BE PERFORMED IN STRICT CONFORMANCE WITH APPLICABLE MUNICIPAL, COUNTY AND STATE, AND/OR GOVERNING BODY'S STANDARDS.
2. THE DEMOLITION PLAN SHALL BE DONE IN CONJUNCTION WITH THE GEOTECHNICAL INVESTIGATION REPORT.
3. EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED AT ALL TIMES DURING DEMOLITION.
4. THE PURPOSE OF THIS DRAWING IS TO CONVEY THE OVERALL SCOPE OF WORK AND IT IS NOT INTENDED TO COVER ALL DETAILS OR SPECIFICATIONS REQUIRED TO COMPLY WITH GENERALLY ACCEPTED DEMOLITION PRACTICES.
5. THE DEMOLITION PLAN IS INTENDED TO SHOW REMOVAL OF KNOWN SITE FEATURES AND UTILITIES AS SHOWN ON THE SURVEY. THERE MAY BE OTHER SITE FEATURES, UTILITIES, STRUCTURES, AND MISCELLANEOUS ITEMS BOTH BURIED AND ABOVE GROUND THAT ARE WITHIN THE LIMITS OF WORK THAT MAY NEED TO BE REMOVED FOR THE PROPOSED PROJECT THAT ARE NOT SHOWN HEREON. THE CONTRACTOR IS RESPONSIBLE FOR THE REMOVAL OF SUCH ITEMS AT NO ADDITIONAL COST TO THE OWNER.
6. THE CONTRACTOR SHALL CONTACT RESPECTIVE UTILITY COMPANIES PRIOR TO DEMOLITION TO COORDINATE DISCONNECTION AND REMOVAL OF EXISTING UTILITIES WITHIN THE AREA OF WORK.
7. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ANY DAMAGE TO EXISTING UTILITIES THAT ARE INTENDED TO CONTINUE TO PROVIDE SERVICE WEATHER THESE UTILITIES ARE SHOWN ON THE PLAN OR NOT.
8. UPON DISCOVERY OF ANY UNDERGROUND TANKS, CONTRACTOR SHALL IMMEDIATELY NOTIFY THE OWNER'S REPRESENTATIVE. NO REMOVAL OF TANKS SHALL OCCUR UNTIL AUTHORIZED BY OWNER.
9. BUILDING AND APPURTENANCES DESIGNATED FOR DEMOLITION SHALL NOT BE DISTURBED BY THE CONTRACTOR UNTIL THEY HAVE BEEN FURNISHED WITH NOTICE TO PROCEED BY THE OWNERS. AS SOON AS SUCH NOTICE HAS BEEN GIVEN, THE CONTRACTOR SHALL PERFORM THE DEMOLITION, UNDER THE DIRECTION OF THE OWNER'S REPRESENTATIVE.
10. DEBRIS SHALL NOT BE BURIED ON THE SUBJECT SITE. ALL UNSUITABLE MATERIAL AND DEBRIS SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN ACCORDANCE WITH ALL CITY, STATE, AND FEDERAL LAWS AND ORDINANCES.
11. ALL MATERIAL, EXCEPT THAT BELONGING TO A PUBLIC UTILITY COMPANY OR DENOTED FOR SALVAGE, SHALL BECOME PROPERTY OF THE CONTRACTOR. THE CONTRACTOR SHALL NOTIFY THE OWNER OF WATER, ELECTRIC, OR GAS METERS WHEN THE METERS ARE READY FOR REMOVAL, AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR DISCONNECTING ALL UTILITIES IN COMPLIANCE WITH LOCAL REQUIREMENTS. TRANSFORMERS TO BE DISCONNECTED AS REQUIRED FOR BUILDING DEMOLITIONS.
12. AS SOON AS DEMOLITION WORK HAS BEEN COMPLETED, THE FINAL GRADE OF BACKFILL IN DEMOLITION AREAS SHALL BE COMPACTED PER THE GEOTECHNICAL REPORT TO PRESENT A NEAT, WELL DRAINED APPEARANCE, AND TO PREVENT WATER FROM DRAINING UNNECESSARILY ONTO ADJACENT PROPERTIES. CONTRACTOR SHALL GRADE SITE TO EXISTING STORM DRAINAGE SYSTEM TO REMAIN ON SITE.
13. EXISTING TREES TO REMAIN SHOULD BE PROTECTED FROM DAMAGE DURING DEMOLITION AND CONSTRUCTION.
14. THE CONTRACTOR IS TO COORDINATE WORK IN THE PROJECT TO ENSURE ACCESS TO ADJACENT PROPERTIES AT ALL TIMES.
15. THE USE OF EXPLOSIVES SHALL NOT BE PERMITTED.
16. CONTRACTOR TO IMPLEMENT APPROPRIATE TRAFFIC CONTROL MEASURES PER LOCAL CODE.

SITE DEMOLITION CALLOUTS

(#)

1. SAWCUT EXISTING PAVEMENT (FULL DEPTH)
2. REMOVE EXISTING CONCRETE CURB
3. MILLING EXISTING ASPHALT PAVEMENT (2-INCH) FOR OVERLAY
4. REMOVE STRIPING OVER CONCRETE PAVEMENT
5. REMOVE EXISTING FLAG POLE
6. RELOCATE EXISTING HANDICAP SIGN (SEE SITE LAYOUT FOR RELOCATIONS)
7. EXISTING SANITARY SEWERAGE STRUCTURE TO BE PROTECTED DURING CONSTRUCTION
8. EXISTING STORM DRAINAGE STRUCTURE TO BE PROTECTED DURING CONSTRUCTION
9. REMOVE PORTION OF EXISTING BUILDING (REFER TO ARCHITECTURAL DRAWINGS)
10. REMOVE EXISTING MANU BOARD
11. REMOVE EXISTING CANOPY
12. REMOVE RAMP

SITE DEMOLITION LEGENDS

- PROPERTY LINE
- EXISTING BUILDING
- EXISTING CONCRETE CURB
- EXISTING CONCRETE SIDEWALK
- EXISTING ELECTRICAL LINE
- EXISTING GAS LINE
- EXISTING STORM LINE
- EXISTING SANITARY LINE
- SAWCUT EXISTING PAVEMENT (FULL DEPTH)
- REMOVE EXISTING CURB
- DEMOLISH BUILDING STOREFRONT (REFER TO ARCH.
- MILL AND OVERLAY EXISTING ASPHALT PAVEMENT

REFERENCE

1. EXISTING SITE CONDITIONS AND TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN ARE BASED ON PLAN ENTITLED "BOUNDARY & TOPOGRAPHIC SURVEY – LOT 32, BLOCK 2613 – 555 MARKETPLACE BOULEVARD, TOWNSHIP OF HAMILTON, MERCER COUNTY, STATE OF NEW JERSEY", PREPARED BY GALLAS SURVEYING GROUP, DATED 1/4/2021.

www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN
PROJECT MANAGER
R. SCOTT
QUALITY CONTROL
R. SCOTT
DRAWN BY
J. CHU


PROJECT NAME
CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32

PROJECT NUMBER
20210067.0

SHEET TITLE
SITE DEMOLITION PLAN

SHEET NUMBER
C-1.0
NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\jmcott\AppData\Local\Temp\AcPublish_11348\20210067.0 Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:55am by jmcott

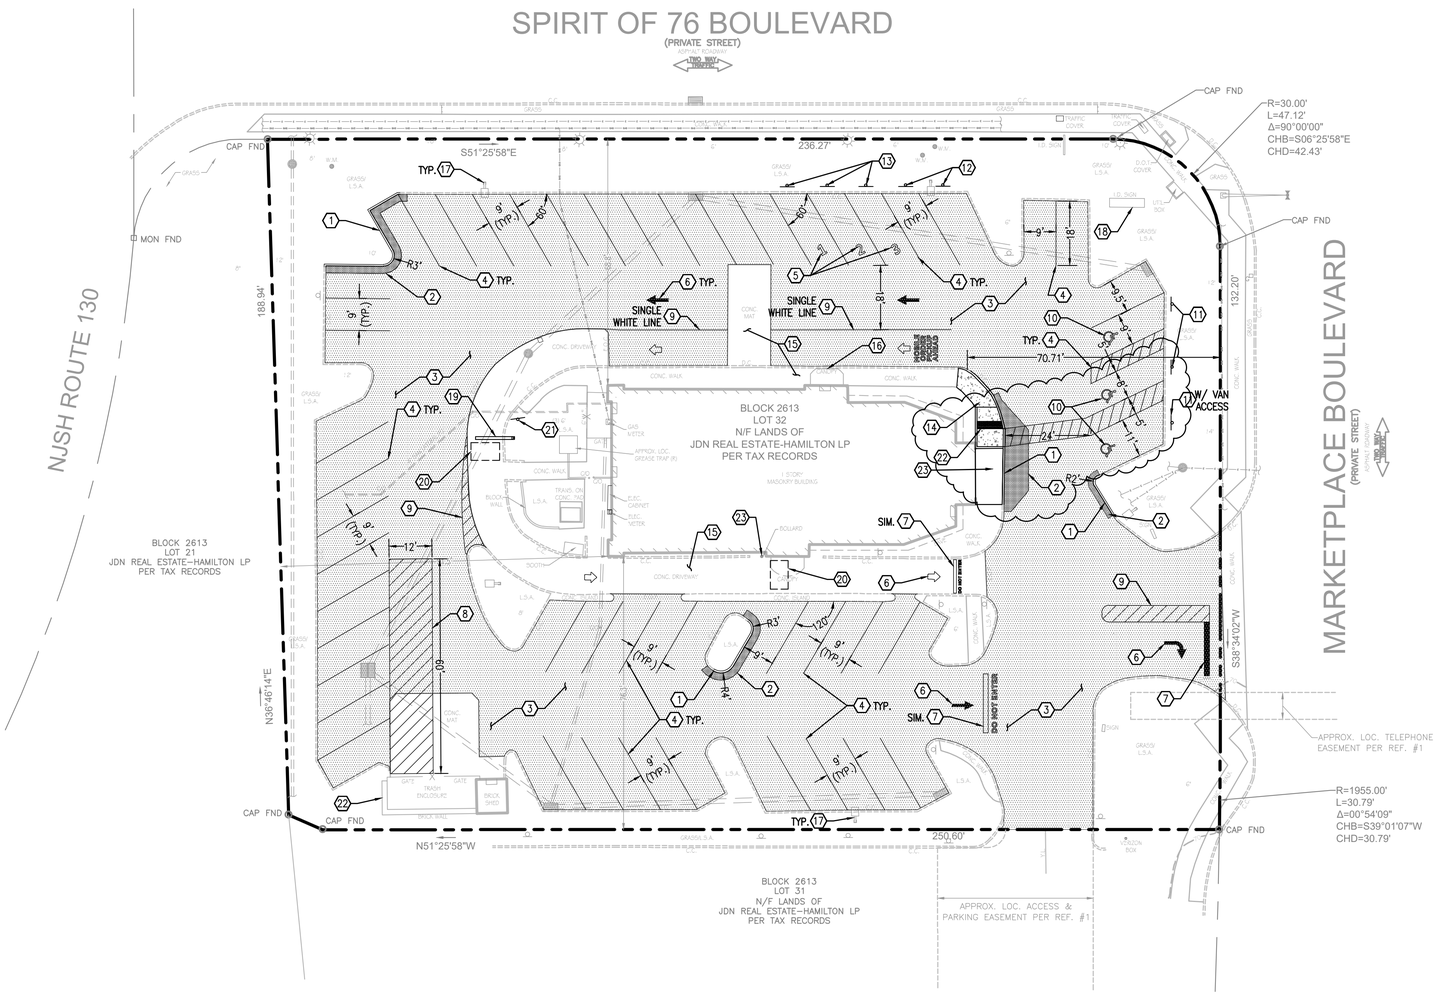

SITE LAYOUT PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE LAYOUT NOTES

1. CONTRACTOR MUST SECURE ALL NECESSARY PERMITS PRIOR TO STARTING WORK.
2. IF THE CONTRACTOR IN THE COURSE OF WORK, FINDS ANY DISCREPANCIES BETWEEN THE PLANS AND THE PHYSICAL CONDITIONS OF THE SITE, OR ANY OTHER ERRORS OR OMISSIONS IN THE PLANS OR IN THE LAYOUT, THE ENGINEER SHALL BE NOTIFIED IN WRITING, AND THE ENGINEER WILL PROMPTLY VERIFY THE SAME. ANY WORK DONE AFTER SUCH A DISCOVERY, UNTIL AUTHORIZED, WILL BE AT THE CONTRACTOR'S RISK.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL SETBACKS, EASEMENTS, AND DIMENSIONS SHOWN HEREON BEFORE BEGINNING CONSTRUCTION.
4. ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE TO THE STATE AND LOCAL GOVERNMENT AGENCY'S LATEST CONSTRUCTION SPECIFICATIONS AND DETAILS.
5. ALL ACCESSIBLE (ADA) SITE FEATURES SHALL BE CONSTRCUTED TO MEET ALL FEDERAL, STATE, AND LOCAL GUIDELINES.
6. THE CONTRACTOR SHALL CAREFULLY PRESERVE BENCHMARKS, REFERENCE POINTS AND STAKES.
7. ALL DIMENSIONS ARE MEASURED FROM FACE OF BUILDING, CURB, AND WALL UNLESS OTHERWISE SPECIFIED ON PLANS.
8. CONTRACTOR SHALL MAINTAIN THE SITE IN A MANNER SO THAT WORKMEN AND PUBLIC SHALL BE PROTECTED FROM INJURY, AND ADJOINING PROPERTIES ARE PROTECTED FROM DAMAGE.
9. CONTRACTOR IS RESPONSIBLE FOR DAMAGE TO ANY EXISTING ITEMS AND/OR MATERIAL INSIDE OR OUTSIDE CONTRACT LIMITS DUE TO CONSTRUCTION OPERATIONS.
10. ALL STREET SURFACES, DRIVEWAYS, CULVERTS, CURB AND GUTTERS, ROADSIDE DRAINAGE DITCHES AND OTHER STRUCTURES THAT ARE DISTURBED OR DAMAGED IN ANY MANNER AS A RESULT OF CONSTRUCTION SHALL BE REPLACED OR REPAIRED IN ACCORDANCE WITH THE SPECIFICATIONS.
11. CONTRACTOR TO REPLACE ANY CURBS, SIDEWALKS, LANDSCAPING, ETC. THAT IS DISTURBED DURING CONSTRUCTION OUTSIDE LIMITS OF DISTURBANCE.
12. CONTRACTOR TO REPAIR OR REPLACE ANY EXISTING CURBS THAT ARE DAMAGED WITHIN THE AREA OF WORK.
13. ALL ROAD WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE STATE AND LOCAL GOVERNMENT AGENCY SPECIFICATIONS.

SITE LAYOUT CALLOUTS

(#)

1. STANDARD CONCRETE CURB
2. FULL DEPTH PAVEMENT RESTORATION
3. MILLING AND OVERLAY EXISTING ASPHALT PAVEMENT
4. PAVEMENT MARKING – PARKING STRIPING
5. PAVEMENT MARKING – CHIPOTLE PULL–IN PARKING STRIPING
6. PAVEMENT MARKING – TRAFFIC ARROW
7. PAVEMENT MARKING – STOP BAR
8. PAVEMENT MARKING – TEMPORARY LOADING AREA
9. PAVEMENT MARKING – LANE DIVIDER
10. PAVEMENT MARKING – ADA PARKING STRIPING & SYMBOL
11. SIGN POST – ADA PARKING SPACE (RELOCATED)
12. SIGN POST – CHIPOTLE MOBILE PICK–UP PARKING
13. SIGN POST – CHIPOTLE PULL–IN PARKING
14. CONCRETE SIDEWALK
15. REPAIR EXISTING CONCRETE AS NEEDED
16. RE–PAINT EXISTING RAILING (COLOR DIRECTED BY OWNER)
17. RE–PAINT AND RE–LAMP EXISTING LIGHT POLES
18. REMOVE EXISTING MONUMENT SIGNAGE AND REPLACE WITH NEW SIGNAGE
19. CLEARANCE BAR
20. LOOP DETECTOR (REPAIR CONCRETE PAVEMENT AS NEEDED)
21. MOBILE ORDER PICK–UP BOARD
22. RE–PAINT EXISTING DUMPSTER TO MATCH CHIPOTLE COLOR SCHEME (COLOR DIRECTED BY OWNER)
21. RE–PAINT EXISTING BOLLARD (COLOR DIRECTED BY OWNER)
22. ADA RAMP PER STANDARD DETAILS
23. LANDSCAPE AREA

SITE LAYOUT LEGENDS

- PROPERTY LINE
- PROPOSED CONCRETE CURB
- PROPOSED FULL DEPTH PAVEMENT RESTORATION
- PROPOSED PAVEMENT OVERLAY (2–INCH)
- PROPOSED CONCRETE PAVEMENT
- RELOCATED/PROPOSED SIGN POST
- PAVEMENT PARKING – ADA PARKING SYMBOL
- PAVEMENT PARKING – TRAFFIC ARROW

www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN
PROJECT MANAGER
R. SCOTT
QUALITY CONTROL
R. SCOTT
DRAWN BY
J. CHU

PROJECT NAME

CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32


PROJECT NUMBER
20210067.0

SHEET TITLE
SITE LAYOUT PLAN

SHEET NUMBER
C-2.0

NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\rscott\AppData\Local\Temp\AcPublish_11348\20210067.0 Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:50am by rscott

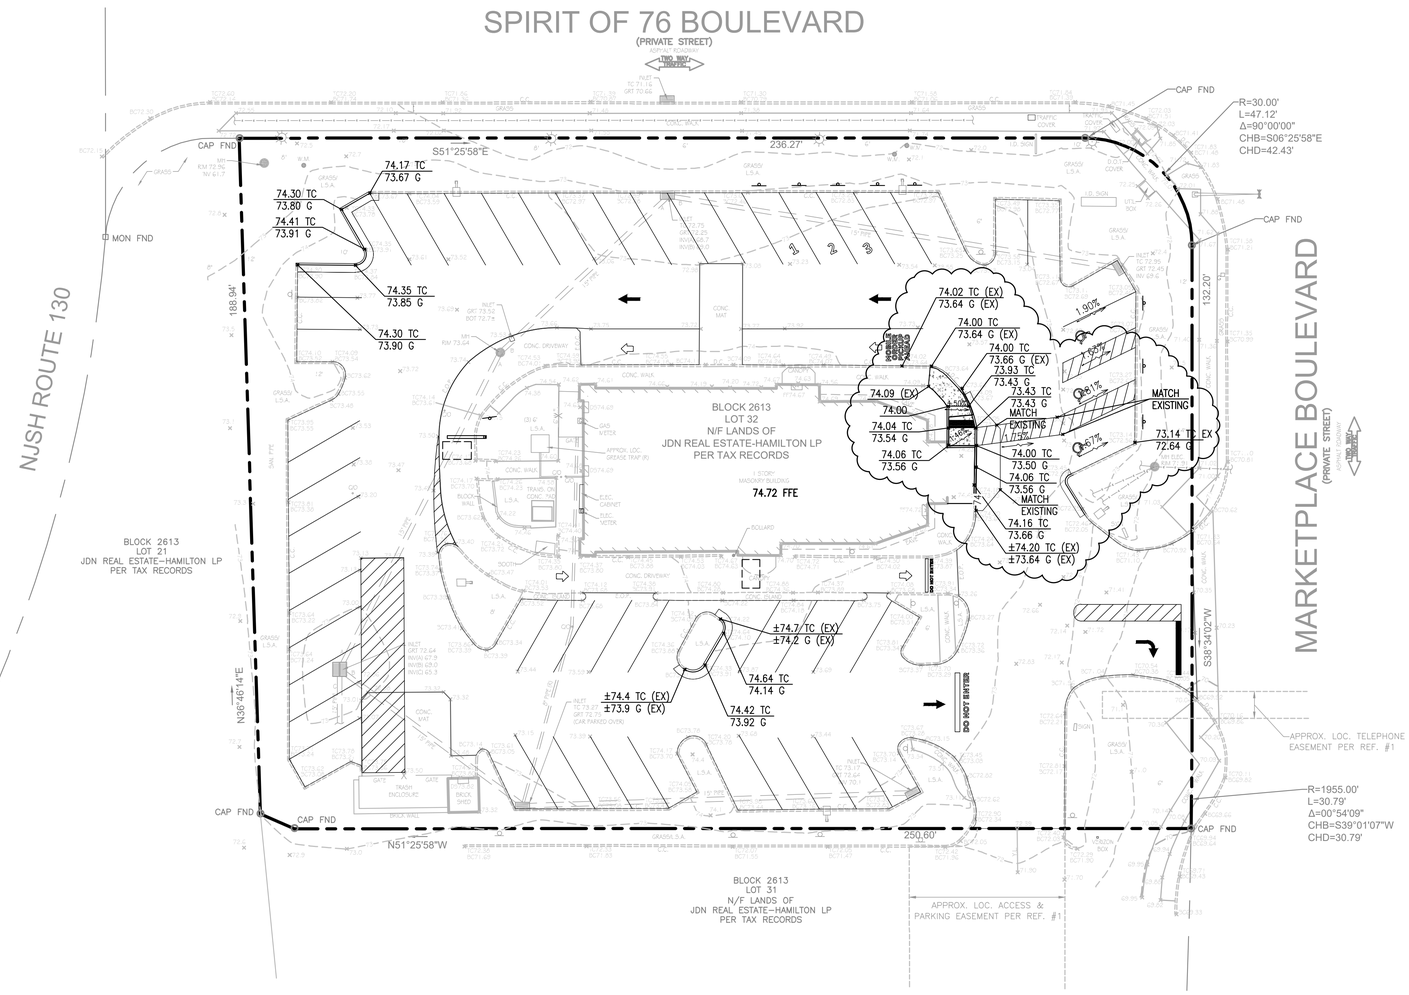

SITE GRADING PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE GRADING NOTES

1. ALL GRADING AND SITE PREPARATION SHALL CONFORM WITH SPECIFICATIONS CONTAINED IN THE GEOTECHNICAL REPORT.
2. ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE TOWNSHIP'S LATEST CONSTRUCTION SPECIFICATIONS AND DETAILS.
3. PRIOR TO ANY EXCAVATION OF THE PROJECT SITE, THE CONTRACTOR SHALL NOTIFY THE TOWNSHIP 48 HOURS PRIOR TO THE START OF CONSTRUCTION.
4. THE CONTRACTOR SHALL CAREFULLY PRESERVE BENCHMARKS, REFERENCE POINT AND STAKES.
5. ALL INDICATED ELEVATIONS ARE FINISHED ELEVATIONS.
6. FIELD VERIFY LOCATIONS, SIZES AND ,IF APPLICABLE, INVERTS OF EXISTING UTILITIES FOR PROPOSED CONNECTIONS PRIOR TO CONSTRUCTION.
7. LOCATE AND PROTECT ALL UTILITIES ASSOCIATED WITH THE PROJECT PRIOR TO CONSTRUCTION.
8. INSTALL SOIL EROSION CONTROL MEASURES BEFORE BEGINNING SITE WORK. THESE MEASURES SHOULD BE MAINTAINED THROUGHOUT CONSTRUCTION.
9. MAINTAIN PROPER SITE DRAINAGE AT ALL TIMES DURING CONSTRUCTION. PREVENT STORMWATER FROM RUNNING INTO OR STANDING IN EXCAVATED AREAS.
10. INSTALL ALL APPROPRIATE TREE PROTECTION MEASURES PRIOR TO GRADING.
11. ALL CUT AND FILL SLOPE SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED.
12. ALL EXCAVATION SHALL INCLUDE CLEARING, STRIPPING AND STOCKPILING TOPSOIL, REMOVING UNSUITABLE MATERIALS, CONSTRUCTION FILLS, AND THE FINAL SHAPING AND TRIMMING O THE LINES AND GRADES SHOWN ON THE PLANS.
13. STRIP AND STOCKPILE TOPSOIL. SPREAD FOUR (4) INCHES MINIMUM OF TOPSOIL ON LANDSCAPE AREAS AND REMOVE EXCESS TOPSOIL FROM SITE. PREPARE SUB-GRADE FOR PAVEMENT AND CURB AND BACKFILL CURBS AFTER CURB CONSTRUCTION.
14. PROVIDE AND INSTALL TOPSOIL IN DISTURBED AREAS THAT ARE PROPOSED LANDSCAPE AREAS.
15. THE PAVEMENT SUBGRADE AND BASE COURSE MATERIAL SHALL BE INSPECTED AND APPROVED BY THE ENGINEER OR OWNER REPRESENTATIVE PRIR TO CONSTRUCTION OF THE BASE AND SURFACE COURSES THEREON.
16. CONTRACTOR SHALL PROVIDE POSITIVE DRAINAGE TO ALL INLETS AND CATCH BASINS.
17. IF AREAS ARE DISTURBED BEYOND PROPOSED GRADES BY NEGLIGENCE OF THE CONTRACTOR, THE CONTRACTOR SHALL BE HELD RESPONSIBLE, FOR ANY RE-GRADING OR REPAIR TO MATCH ORIGINAL EXISTING CONDITIONS.
18. CONTRACTOR TO VERIFY THE SLOPE OF THE EXISTING HANDICAP RAMP AND ADJACENT SIDEWALK TO MEET THE CURRENT ACCESSIBILITY STANDARDS. NON-COMPLIANT RAMPS AND SIDEWALK SIDEWALK AREAS SHALL BE REMOVED AND REPLACED AT ACCEPTABLE GRADES.

SITE GRADING LEGENDS

- 72 — EXISTING ELEVATION CONTOUR
- ×73.57 EXISTING SPOT ELEVATION
- 74 — PROPOSED ELEVATION CONTOUR
- 74.00 PROPOSED SPOT ELEVATION

TC: TOP OF CURB
G: BOTTOM OF CURB
(EX): MATCH EXISTING GRADE

GF
www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN

PROJECT MANAGER
R. SCOTT

QUALITY CONTROL
R. SCOTT

DRAWN BY
J. CHU

PROJECT NAME

CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32

PROJECT NUMBER
20210067.0

SHEET TITLE
SITE GRADING PLAN

SHEET NUMBER
C-3.0

NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\rscott\AppData\Local\Temp\AcPublish_11348\20210067D Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:55am by rscott

APPLICABLE BUILDING CODE

BUILDING CODE:	2021 INTERNATIONAL BUILDING CODE, NJ EDITION
MECHANICAL CODE:	2021 INTERNATIONAL MECHANICAL CODE
PLUMBING CODE:	2021 NATIONAL STANDARD PLUMBING CODE, NJ EDITION
FIRE CODE:	2018 INTERNATIONAL BUILDING CODE, NJ EDITION
ELECTRICAL CODE:	2020 NATIONAL ELECTRICAL CODE (NFPA 70)
FUEL CODE:	2021 INTERNATIONAL FUEL CODE
ENERGY CODE:	ASHRAE 90.1-2019
ACCESSIBILITY CODE:	ICC/ANSI A117.1-2017 / 2010 ADAAG

NJ UCC REHABILITATION SUBCODE

CONSTRUCTION TYPE AND USE CLASSIFICATION

OCCUPANCY GROUP	A-2 (ASSEMBLY)
TYPE OF CONSTRUCTION	VB - EXISTING
AREA	4,218 SF
NUMBER OF STORIES	1
FIRE SPRINKLER	NON-SPRINKLERED

FIRE RESISTANCE RATING REQUIREMENTS

2021 INTERNATIONAL BUILDING CODE, TABLE 601 AND TABLE 602

CONSTRUCTION ELEMENT:		REQUIRED	PROVIDED
PRIMARY STRUCTURAL FRAME:		0	EXISTING TO REMAIN
BEARING WALLS:	EXTERIOR	0	EXISTING TO REMAIN
	INTERIOR	0	EXISTING TO REMAIN
NON BEARING WALLS AND PARTITIONS - EXTERIOR:	FIRE SEPARATION DISTANCE < 5'	1 HRS	NOT APPLICABLE
	FIRE SEPARATION DISTANCE ≥ 5', < 10'	1 HRS	NOT APPLICABLE
	FIRE SEPARATION DISTANCE ≥ 10', < 30'	0	NOT APPLICABLE
	FIRE SEPARATION DISTANCE ≥ 30'	0	EXISTING TO REMAIN
NON BEARING WALLS AND PARTITIONS - INTERIOR:		0	0
FLOOR CONSTRUCTION		0	EXISTING TO REMAIN
ROOF CONSTRUCTION		0	EXISTING TO REMAIN
SEPARATION OF DIFFERENT TENANCIES (508.4)	A USE TO M USE	1 HRS	NOT APPLICABLE
	A USE TO A USE	0 HRS	NOT APPLICABLE

1. ELEMENTS NOTED AS EXISTING TO REMAIN ARE NOT PROPOSED TO BE ALTERED AS PART OF THE SCOPE OF WORK.

OCCUPANT LOAD CALCULATIONS

PER TABLE 1004.5 AND SECTION 1004.6

SPACE	LEGEND	OCCUPANCY	SF/ OCCUPANT	AREA	OCCUPANT LOAD
KITCHEN		KITCHEN	1/ 200 (GROSS)	1420 SF	9 ACTUAL (8 CALCULATED)
WAITING		ASSEMBLY (STANDING)	1/ 5 (NET)	50 SF	10
DINING		FIXED SEATS	BY ACTUAL COUNT	1878 SF	68
TOTAL OCCUPANCY					87 ACTUAL (86 CALCULATED)
COVERED PATIO					12
NON OCCUPIABLE [1]				870 SF	
TOTAL AREA				4,218 SF	

1. NON OCCUPIABLE AREA INCLUDES WALLS, PARTITIONS, COLUMNS, FURRED-IN SPACES, FIXED CABINETS, EQUIPMENT, AND ACCESSORY SPACES SUCH AS CLOSETS, MACHINE AND EQUIPMENT ROOMS, TOILETS, STAIRS, HALLS, CORRIDORS, ELEVATORS AND SIMILAR UNOCCUPIED SPACES.

SEATING CALCULATIONS

TOTAL INTERIOR SEATING COUNT : 68 [1]
ACCESSIBLE SEATING REQUIRED : 4
ACCESSIBLE SEATING PROVIDED : 4

TOTAL COVERED PATIO SEATING COUNT : 12 [2]
ACCESSIBLE SEATING REQUIRED : 1
ACCESSIBLE SEATING PROVIDED : 1

1. AS PER 2017 ICC ANSI A117.1-2009: 5% OF SEATING IS REQUIRED TO BE ACCESSIBLE (68X 0.05 = 3.4 = 4). AS SUCH, OF THE 68 SEATS,4 ACCESSIBLE SEATS ARE PROVIDED.
2. AS PER 2017 ICC ANSI A117.1-2009: 5% OF SEATING IS REQUIRED TO BE ACCESSIBLE (12X 0.05 = 0.6 = 1). AS SUCH, OF THE 12 SEATS, 1 ACCESSIBLE SEAT IS PROVIDED.

EXIT REQUIREMENTS

PER TABLE 1017.2 AND SECTION 1005.3.2 (NON SPRINKLERED SYSTEM)

OCCUPANCY	DESIGNATION	MAX. TRAVEL DISTANCE	INCHES PER OCCUPANT	WIDTH REQUIRED	WIDTH PROVIDED
ASSEMBLY	A-2	200	0.2	17.4 INCHES	DOOR(1A) 68 AND DOOR(2) 33 INCHES DOOR(3) 39 INCHES


1. AS PER IBC SECTION 1006.2.1, COMMON PATH OF EGRESS TRAVEL IN THE KITCHEN AREA SHALL NOT EXCEED 75 FEET
2. REQUIRED WIDTH = 87 (OCCUPANT LOAD) X 0.2 = 17.4

PLUMBING FIXTURES

2021 NATIONAL STANDARD PLUMBING CODE- NJ EDITION (TABLE 7.21.1)

TOTAL OCCUPANTS = 80	URINAL	WATER CLOSETS		LAVATORIES	
	MALE	MALE	FEMALE	MALE	FEMALE
TYPE OF OCCUPANCY = RESTAURANT (A-2)	1-50	1-50	1-50	1-50	1-50
REQUIRED	0	1	1	1	1
PROVIDED	0	1	1	1	1

1. PER SECTION 7.21.2 (b) WHERE THE OCCUPANT LOAD IS BASED ON THE EGRESS REQURIEMENTS OF THE BUILDING SUBCODE, THE NUMBER OF OCCUPANTS FOR PLUMBING PURPOSES SHALL BE PERMITTED TO BE REDUCED TO TWO-THIRDS OF THAT FOR FIRE OR LIFE SAFETY PURPOSES. 99 X 2/3 = 66. HOWEVER, PER SECTION 7.21.2 (e) IN OCCUPANCIES HAVING ESTABLISHED SEATING, THE NUMBER OF OCCUPANTS FOR PLUMBING PURPOSES SHALL NOT BE LESS THAN THE NUMBER OF SEATS. 68 + 12 = 80
2. PER 7.21.1 (4). WHEREVER BOTH SEXES ARE PRESENT IN APPROXIMATELY EQUAL NUMBERS, MULTIPLY THE TOTAL CENSUS BY 50% TO DETERMINE THE NUMBER OF PERSONS OF EACH SEX TO BE PROVIDED.
3. PER 7.21.1 (2). DRINKING FOUNTAINS ARE NOT REQUIRED IN RESTAURANTS OR OTHER FOOD SERVICE ESTABLISHMENTS OF DRINKING WATER SERVICE IS AVAILABLE. DRINKING WATER IS NOT REQUIRED FOR CUSTOMERS WHERE NORMAL OCCUPANCY IS SHORT TERM.

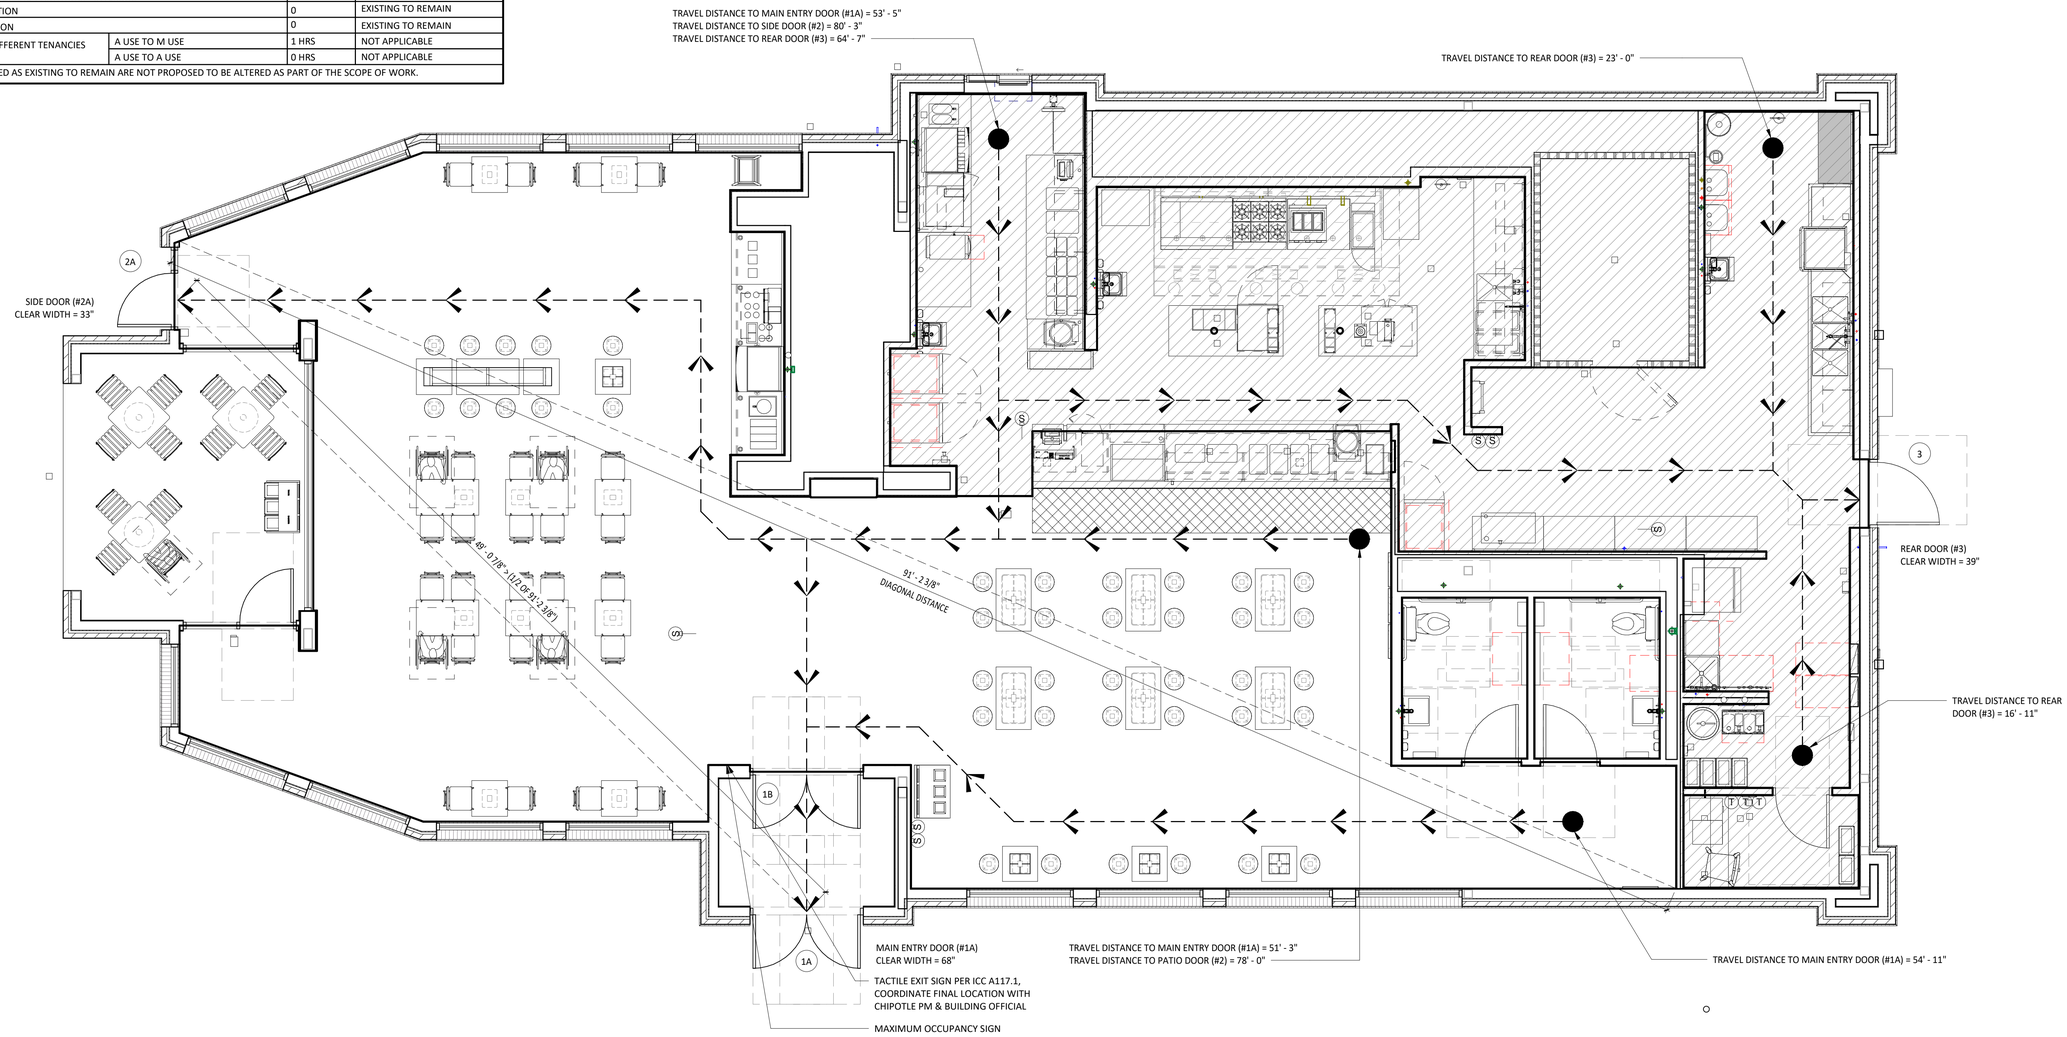

1 G001 **LIFE SAFETY PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000


Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

PROJECT DATA &
LIFE SAFETY PLAN


G001




HINGED DOORS | **SLIDING DOOR** | **DOOR SHIELDS**



PULL SIDE- FRONT APPROACH | **PULL SIDE- HINGE APPROACH** | **PULL SIDE- LATCH APPROACH**

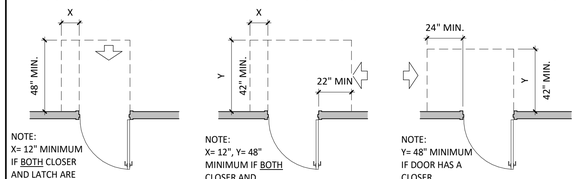


PUSH SIDE- FRONT APPROACH | **PUSH SIDE- HINGE APPROACH** | **PUSH SIDE- LATCH APPROACH**





SLIDING/ FOLDING DOOR- FRONT APPROACH | **SLIDING/ FOLDING DOOR- SLIDE APPROACH** | **SLIDING/ FOLDING DOOR- LATCH APPROACH**


ACCESSIBLE DOOR REQUIREMENTS

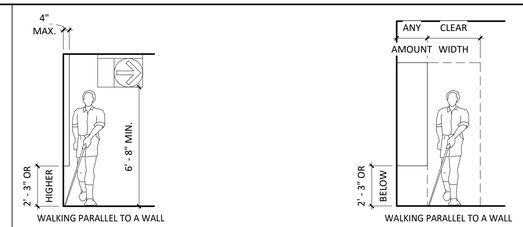


PROTRUDING OBJECTS

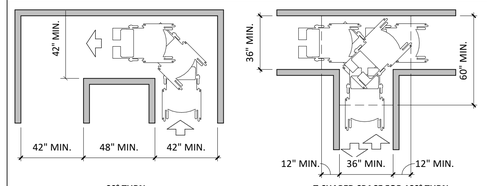


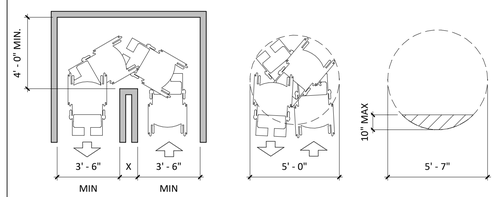


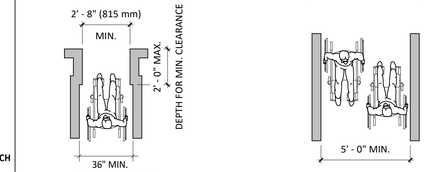

PATH OF TRAVEL

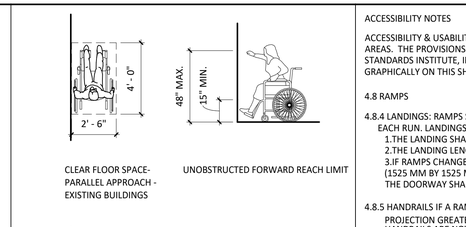

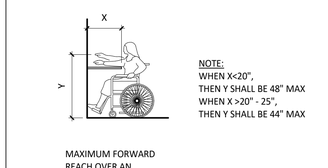

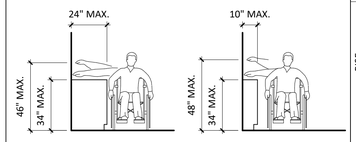

OBSTRUCTED HIGH SIDE REACH

ACCESSIBLE REACH

ACCESSIBILITY NOTES

ACCESSIBILITY & USABILITY FOR THE PHYSICALLY HANDICAPPED SHALL BE PROVIDED IN PUBLIC AREAS. THE PROVISIONS SHALL COMPLY WITH THE REQUIREMENTS OF THE AMERICAN NATIONAL STANDARDS INSTITUTE, INC. (ANSI A 117.1) AS REQUIRED BY THE BUILDING CODE, SHOWN GRAPHICALLY ON THIS SHEET AND IN NOTES BELOW.

4.8 RAMPS

4.8.4 LANDINGS: RAMPS SHALL HAVE LEVEL LANDING AT THE BOTTOM AND TOP OF EACH RAMP, AND EACH RUN. LANDINGS SHALL HAVE THE FOLLOWING FEATURES:
1.THE LANDING SHALL BE AT LEAST AS WIDE AS THE RAMP RUN LEADING TO IT.
2.THE LANDING LENGTH SHALL BE A MINIMUM OF 60" (1525 MM) CLEAR.
3.IF RAMPS CHANGE DIRECTION AT LANDINGS, THE MINIMUM LANDING SIZE SHALL BE 60" BY 60" (1525 MM BY 1525 MM) 4. IF A DOORWAY IS LOCATED AT A LANDING, THE AREA IN FRONT OF THE DOORWAY SHALL COMPLY WITH 4.13.6.

4.8.5 HANDRAILS IF A RAMP RUN HAS A RISE GREATER THAN 6" (150 MM), OR A HORIZONTAL PROJECTION GREATER THAN 72" (1830 MM), THEN IT SHALL HAVE HANDRAILS ON BOTH SIDES. HANDRAILS ARE NOT REQUIRED ON CURB RAMPS. HANDRAILS SHALL HAVE THE FOLLOWING FEATURES:
1.HANDRAILS SHALL BE PROVIDED ALONG BOTH SIDES OF RAMP SEGMENTS. THE INSIDE HANDRAIL ON SWITCHBACK OR DOGLEG RAMPS SHALL ALWAYS BE CONTINUOUS.
2.IF HANDRAILS ARE NOT CONTINUOUS, THEY SHALL EXTEND AT LEAST 12" (305 MM) BEYOND THE TOP, AND BOTTOM OF THE RAMP SEGMENT AND SHALL BE PARALLEL WITH THE FLOOR OR GROUND SURFACE.


4.30 SIGNAGE

4.30.2 CHARACTER PROPORTION.
LETTERS AND NUMBERS ON SIGNS SHALL HAVE A WIDTH-TO-HEIGHT RATIO BETWEEN 3:5 AND 1:1, AND A STROKE-WIDTH-TO-HEIGHT RATIO BETWEEN 1:5 AND 1:10, UTILIZING AN UPPER-CASE "X" FOR MEASUREMENT.

4.30.4 RAISED AND BRAILLED CHARACTERS, AND PICTORIAL SYMBOL SIGNS (PICTOGRAMS).
LETTERS AND NUMERALS SHALL BE RAISED 1/32" (0.8 MM) MINIMUM. UPPERCASE, SANS SERIF, OR SIMPLE SANS SERIF TYPE SHALL BE ACCOMPANIED WITH GRADE 2 BRAILLE. RAISED CHARACTERS SHALL BE AT LEAST 5/8" (16MM) HIGH, BUT NO HIGHER THAN A NOMINAL 2" (51MM).


4.30.7 SYMBOLS OF ACCESSIBILITY.
FACILITIES AND ELEMENTS TO BE INDENTIFIED AS ACCESSSIBLE BY 4.1, SHALL USE THE INTERNATIONAL SYMBOL OF ACCESSIBILITY.

ELEVATORS

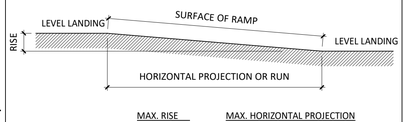

Slope	MAX. RISE in	MAX. HORIZONTAL PROJECTION ft
1:12 to< 1:16	30	30
1:16 to< 1:20	30	40


RAMP REQUIREMENTS

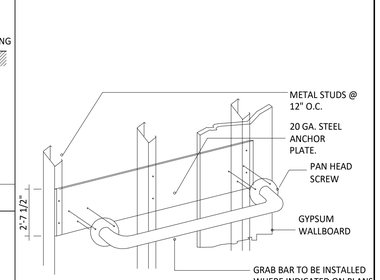



GRAB-BAR REINFORCEMENTS DETAIL

NOTE: THE LIGHTLY SHADED AREAS ARE REINFORCED TO RECEIVE GRAB BAR


REINFORCEMENT DETAIL

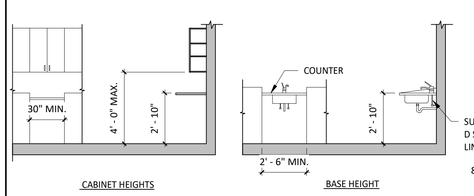


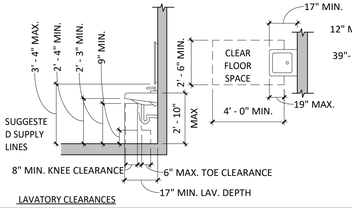

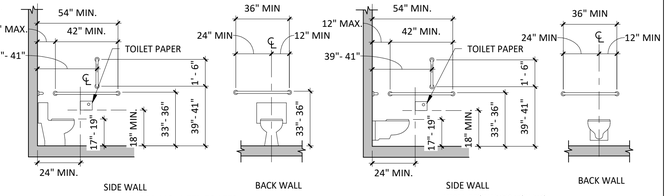


ACCESSIBILITY CLEARANCE






ACCESSIBILITY CLEARANCE

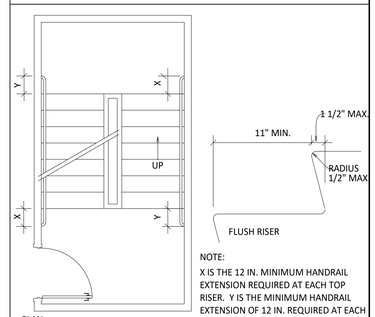

ACCESSIBLE STAIRS

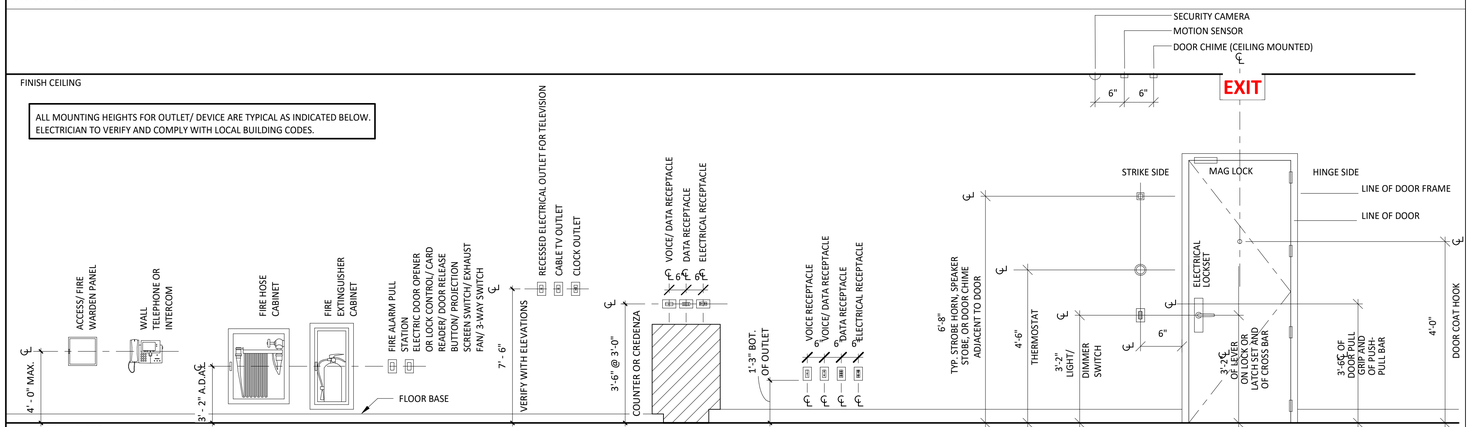

TYPICAL OUTLET/DEVICE MOUNTING HEIGHTS

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.

20210067.0

Contents:

ACCESSIBILITY REQUIREMENTS

G002

DIVISION 1 - GENERAL REQUIREMENTS

SECTION 01100 - SUMMARY

1.1 Contract Documents:

A. Contractor shall use the following Tenant provided documents in the negotiation and execution of the Work. Contact Tenant's office for copies of these documents:
1. Chipotle Instructions to Bidders.
2. Construction Contract for Chipotle Mexican Grill.

B. Definitions:
1. The term "Owner" used in these documents refers to the building Owner/Landlord.
2. The term "Tenant" used in these documents refer to the restaurant Tenant, Chipotle Mexican Grill, Inc.
3. The term "Contractor" used in these documents refers to the entity responsible for performing the Work under Construction Contract for Chipotle Mexican Grill.

1.2 Scope of Work:

A. The Work shall include construction of the site and building facilities as shown and specified in these Specifications and Drawings.

B. When required and necessary, the Tenant will provide a subsurface exploration report as an attachment the bidding documents.

SECTION 01300 - ADMINISTRATIVE REQUIREMENTS

1.1 Coordination:

A. Immediately inform the Architect of discrepancies between the information indicated in the Contract Documents and existing project conditions, and of discrepancies between information indicated on the architectural, structural, mechanical, plumbing and electrical documents.

B. Prior to fabrication and installation of new components, field verify all existing and new dimensions and installation conditions that may affect the Work. Do not scale the drawings to establish locations of items that are not located using dimensions.
1. All dimensions are to rough face of stud or centerline of structure, unless otherwise indicated.
2. Verify that all Subcontractors have reviewed and coordinated locations of their equipment and furnishings exposed to view with the architectural drawings. Review questions with the Architect.

C. Coordinate new work indicated on the Contract Documents with new work that may be provided by the Owner and Tenant under separate contracts.

D. Coordinate the work of Vendors, Contractors and Subcontractors providing fixtures, furniture and equipment identified as "by Tenant" in these drawings and specifications.
1. Notify the Tenant in timely fashion if any problems develop with the performance of these Vendors, Contractors or Subcontractors.

E. Coordinate the scheduling, sequencing, and the work of all trades and Subcontractors to assure efficient and orderly sequences of installation of interdependent construction elements.

F. Verify that the utility requirement characteristics of operating equipment are compatible with the building utility services. Coordinate work of the various specification sections having interdependent responsibilities for installing, connecting to, and placing in service such equipment.

G. Coordinate the installation and physical space requirements of plumbing, mechanical and electrical work that are indicated diagrammatically on the drawings. Follow routing shown for piping, ducts and conduit as closely as practical. Install runs parallel with and perpendicular to the line of the building. Utilize spaces as efficiently as possible to maximize accessibility for other work installation and for maintenance and for repair.
1. Conceal piping, ducts and conduit within the construction, except as otherwise indicated.
2. Coordinate locations of registers, fixtures and outlets with finish elements.

H. Coordinate completion and cleanup work of all trades and Subcontractors in preparation for Substantial Completion.

I. To minimize disruption of Tenant's activities after Tenant occupancy of the property, coordinate access to the property with the Tenant's Construction Manager for correction of defective work and work not in accordance with the Contract Documents.

1.2 Submittals:

A. Only when indicated in the specifications or drawings submit shop drawings, product data, and/or samples to the Architect, Design Manager, and Development Analyst for review. All submittals shall be made directly to the Architect by the general contractor. Only submittals for specified products will be accepted unless prior approval has been obtained for a substitution (refer to Section 01630).

Shop drawings: Submit electronic copies of each sheet of drawings. Shop drawings are original drawings prepared by the subcontractor or vendor for the purpose of conveying information to the Architect and/or Engineer on how a building element or product will be constructed in sufficient detail for the Architect and/or Engineer to determine compliance with the design intent.

In all cases one copy of the submittal shall be returned to the General Contractor. Electronic submittals for shop drawing or product data in either PDF or DWF format are acceptable for review. All submittals, regardless of format, must bear the General Contractor's stamp indicating the submittal has been reviewed and approved. Any submittal not meeting the requirements set forth will be rejected by the Architect.

Submittals shall be made with respect to the construction schedule to allow for adequate review time: allow (5) business days for review of submittals for any structural steel, canopies and trusses and allow (3) business days for review of submittals in all other divisions. Review timeline will commence from the time the submittal with General Contractor's approval stamp is received by the Architect, Design Manager, and Development Analyst.

1.3 Requests For Information

A. In the event that the general contractor, or a subcontractor, at any tier, determines that some portion of the drawings, specifications, or other contract documents requires a clarification or interpretation by the architect, the general contractor shall submit a Request For Information in writing to the architect in an electronic copy.

Requests for Information may only be submitted by the general contractor and may only be submitted to the architect. The general contractor shall clearly and concisely set forth the issue for which clarification or interpretation is sought and why a response is needed from the architect or the architect's consultants. In the Request for Information, the general contractor shall set forth an interpretation or understanding of the requirement along with an explanation of why such an understanding was reached.

B. The architect will review all Requests for Information to determine whether they are Requests for Information within the meaning of this term. If the architect determines that the document is not a request for information, it will be returned to the general contractor, un-reviewed as to content, for re-submittal in the proper form and in the proper manner.

Responses to Requests for Information shall be issued upon receipt, but no later that five (5) working days of receipt of the Request from the general contractor; unless the architect determines that a longer amount of time is necessary to provide an adequate response. If a longer amount of time is determined necessary by the architect, the architect will, within five (5) working days of receipt of the Request, notify the general contractor of the anticipated response time. If the general contractor submits a Request for Information on an activity with five (5) working days or less of float on the current project schedule the general contractor shall not be entitled to any time extension due to the time it takes the architect to respond to the Request provided that the architect responds within the parameters set forth above.

C. Responses to Requests for Information from the architect will not change any requirements of the contract documents. In the event that the general contractor believes that a response to a Request For Information will cause a change to the requirements of the contract documents, the general contractor shall immediately give written notice to the architect and the tenant stating that the general contractor considers the response to be a Change Order. Failure to give such written notice immediately shall waive the general contractor's (or any subcontractor's) right to seek additional time or cost under the Administrative Requirements of these contract documents.

SECTION 01400 - QUALITY REQUIREMENTS

1.1 Regulatory Requirements:

A. Perform all work in accordance with applicable local, state, and federal building codes, plumbing codes, mechanical codes, electrical codes, ordinances and rules and regulations governing food service establishments.

B. Comply with local, state and federal requirements governing accessibility.

C. Obtain all required demolition and erosion control permits required by authorities having jurisdiction.

1.2 Quality Control:

A. Maintain quality control over manufacturers, suppliers, products, services, site conditions and workmanship, to produce work of specified quality.

B. Comply with manufacturer's instructions and applicable trade standards.

C. Handle, install, connect, clean, condition and adjust products in strict accordance with manufacturer's instructions and complying with specified requirements.
1. Request clarification from the Architect before proceeding, where manufacturer's instructions conflict with the Contract Documents.

D. Comply with specified standards as a minimum quality for the Work, except when more stringent tolerances, codes or specified requirements indicate higher standards or more precise workmanship.

E. Perform work by persons qualified to produce workmanship of the specified quality. Secure products in place with positive anchorage devices designed, sized and installed to withstand stress, vibration, physical distortion or disfigurement.

F. All dimensions shall be considered "hold-to" dimensions unless indicated otherwise (e.g. minimum or maximum dimensions.)

1.3 Testing:

A. Employ and pay for the services of an independent testing laboratory to perform inspections, tests and other services when required.

B. Include inspection and tests as indicated in the specification sections, drawings, and as required by authorities having jurisdiction.
1. Test concrete in accordance with Section 03300 and drawing requirements.
2. Test structural steel in accordance with Section 05110 and drawing requirements.

SECTION 01500 - TEMPORARY FACILITIES AND CONTROLS

1.1 Provide temporary facilities and controls as shown and specified:

A. Codes and Standards: Provide temporary construction facilities and controls complying with all applicable local, State and Federal local laws, regulations and codes and utility company requirements.

B. Temporary Heating, Ventilating and Cooling:
1. Provide, pay for and maintain all temporary heating, ventilating and cooling equipment and facilities required during the progress of the work to protect materials, finished work, and equipment against damage from low and high temperatures and humidity.
2. Provide temporary heating, ventilating and cooling when the outside temperature and humidity is low/high enough to damage or affect in any way the performance or quality of material and product stored in the building, in any temporary storage area, or any material or product incorporated into the work.
3. Provide temporary heating, ventilating and cooling when the outside temperature and humidity is low/high enough to significantly slow or hamper effectiveness of workers and to provide suitable working conditions.

C. Temporary Electrical Lighting and Power:
1. Provide, pay for and maintain all temporary electrical service for lighting and power required during the progress of the work. Include all necessary wiring, fuses, disconnect switches, safety devices, junction boxes, panels, ground fault protections, and transformer if required. Include cost for providing temporary electric generators in the Contract Sum, if temporary electric service is not available for use during progress of the work.
2. Temporary service and lighting and power items and installations shall conform to the requirements of the NFPA National Electric Code and OSHA Occupational Safety and Health Act of 1970.

D. Water: Provide, pay for and maintain all temporary water required during the progress of the work. Include all necessary storage tanks, piping, valves, fittings, hose and hose connections during construction and testing.

E. Temporary Toilets: Provide, pay for and maintain temporary toilet facilities for use by the Contractor, Contractor's employees and all Subcontractors and Subcontractors' employees. Comply with all local requirements for installation, use and maintenance of temporary toilet facilities.

F. Barriers and Enclosures:
1. Provide temporary construction barriers in accordance with project requirements. Exercise all necessary precautions to protect adjacent properties, outside project contact limits, during progress of the work. Take special precautions to avoid damage to existing overhead and underground utilities and services owned or operated by the Owner or by public or private utility companies.
2. Provide temporary weather-tight enclosures at exterior openings to provide acceptable working conditions and protection of materials and to allow for temporary heating, ventilating and cooling.

G. Field Office, Telephone and Email:
1. Provide and maintain a temporary field office at the project site during progress of the work. A designated area within the existing building will be available for use as a temporary field office. Verify area size and location with the Tenant.
2. Maintain copies of permits, approved shop drawings, specifications, addenda and record documents at field office.
3. Provide temporary telephone service and internet service with email and photo capabilities to field office throughout progress of the work.
4. Provide weekly photographic documentation of project progression to Tenant.

H. Safety and Security
1. Provide and maintain all necessary safety provisions for protection and safety of the project work, workers and general public.
2. Provide and maintain operable fire extinguishing devices in well-marked, accessible locations throughout the project. Provide types, quantities and locations in compliance with governing codes and ordinances.
3. Provide all necessary security barriers and enclosures to protect the work and Tenant's operations from unauthorized entry of persons, vandalism and theft. Provide doors, when required, with self-closing hardware and locks.

I. Cleaning
1. During Construction: Provide an approved on-site container for the use of all Contractors and Subcontractors for the collection of waste materials, debris and rubbish. Execute periodic cleaning to keep the work, the site and adjacent properties free from accumulations of waste materials, rubbish and windblown debris, resulting from construction operations. Remove crates and cartons in which materials, equipment, or fixtures are received to on-site containers daily.
a. Maintain the property in a clean and orderly condition. Remove waste materials, debris and rubbish from the site on a daily basis and dispose of at legal disposal areas away from the site.

2. Dust Control:
a. Remove debris and rubbish from pipe chases, plenums and other similar closed or remote spaces prior to covering or enclosing the space.
b. Sweep and vacuum clean interior surfaces before start of surface finishing and painting. Continue cleaning on an as-needed basis until finishing and painting is completed.
c. Cleaning operations shall be acceptable to the Tenant's Construction Manager.

SECTION 01630 - SUBSTITUTIONS

1.1 General:

A. Products, including materials, equipment and systems described in the Contract Documents establish the standards of required function, dimension, appearance, quality and performance of the Work. Base all bids on the "Standards" indicated.

B. Requests by the Contractor for changes in products, manufacturers, fabricators, suppliers, installers, and methods of construction required by the Contract Documents are considered requests for "substitutions:" Substitutions will be considered only under the following conditions:
1. The indicated "Standard" cannot be provided within the Contract Time
2. The indicated "Standard" cannot receive necessary approval by the governing authority.
3. A substantial advantage is offered the Owner, in terms of cost, time, energy conservation or other considerations of merit as determined by the Architect.

C. Submit each request for substitution to the Architect. Identify the product, manufacturer, fabricator, supplier, installer or the fabrication or installation method to be replaced in each request. Identify related Specification Section and Drawing numbers. Provide documentation as directed by the Architect.

D. Substitutions will not be considered when indicated on shop drawings or product data submittals without separate written request, when requested directly by subcontractor, manufacturer, fabricator, or supplier, or when acceptance will require substantial revision of the Contract Documents.

E. Substitute products, manufacturers, fabricators, suppliers, and installers shall not be used for the Project without Tenant and Architect's written acceptance.

SECTION 01700 - EXECUTION REQUIREMENTS

1.1 Preparation:

A. Protection of existing construction: Use all necessary care and appropriate means and methods to protect and prevent damage to existing construction and property not part of the Contract Work. Repair and refinish or replace construction an property damaged during construction work, at Contractor's expense.

1.2 Selective Demolition: Provide selective demolition as shown and specified.

A. Preparation:
1. Coordinate work of this Section with work of various Contractors and Tenant's staff.
2. Maintain protected access at all times.
3. Erect and maintain weatherproof closures at exterior openings.
4. Erect and maintain dust-proof interior partitions to prevent spread of dust or fumes.
5. Erect and maintain barricades, enclosures, bracing, shoring, lights, warning signs and guards necessary for worker and public safety and protection of property.
6. Disconnect, remove and cap designated utility services. Identify and mark locations of disconnected and capped utilities at the project site and on Project Record Documents.
7. Notify and coordinate with the Tenant's Construction Manager and the building Owner for any demolition occurring outside the lease limit.
8. Coordinate hours of operation and construction access with the Tenant's Construction Manager and the building Owner.

B. Selective Demolition
1. Remove existing construction to accommodate new construction as indicated.
2. Perform selective demolition in an orderly, systematic and careful manner with least possible disturbance to public and adjacent property. Use of explosives is prohibited.
3. Immediately remove from the site and legally dispose of demolished materials, except as indicated otherwise. Do not burn or bury materials on the project site.

1.3 Cleaning

A. Final Cleaning: Perform final cleaning upon completion of project work.
1. Remove waste and surplus materials, rubbish, tools, equipment and temporary construction facilities from the site.
2. Clean exterior grounds; remove stains, spills and foreign materials from paved areas, power wash and sweep clean. Rake clean landscaped surfaces of the grounds.
3. Remove temporary protection and labels not required to remain.
4. Clean all finished surfaces. Remove grease, mastic, adhesives, dust, dirt, stains, fingerprints, labels and other foreign materials from exposed interior and exterior surfaces.
a. Clean all plumbing, fire protection and electrical fixtures and equipment including ceiling area elevated ductwork and lighting fixtures.
b. Clean permanent equipment filters and replace temporary disposable filters in mechanical units used during construction.
c. Clean ducts, blowers and coils if mechanical units were operated without filters during construction.
5. Clean interior and exterior glazing and mirrors, polish transparent and glossy surfaces and clean floors with appropriate materials and equipment.
6. Remove waste, foreign material and debris from roofs, areaways and drainage systems.
7. Before Tenant occupancy, conduct an inspection, with the Tenant, of exposed interior and exterior surfaces at all work areas, to verify that the entire work is clean.

1.4 Starting and Adjusting:

A. Prior to Substantial Completion, coordinate the start-up, test and balance, placement in operation and adjustment all systems, controls and equipment to verify proper operation. All systems shall be complete and operating prior to final inspection.

1.5 Contract Closeout:

A. Operation and Maintenance Data: Submit one operation and maintenance manual, bound in 8-1/2" x 11" text pages, three D side ring capacity expansion binders with durable plastic covers.
1. Subdivide the binder contents internally with permanent dividers logically organized as described below. Provide tab titles clearly printed under reinforced laminated plastic tabs.
2. Provide a table of contents with each product or system description identified.
3. Provide a directory listing names, addresses, and telephone numbers of the project Architect/Engineer, Contractor, Subcontractors and major equipment suppliers.
4. Prepare operations and maintenance instructions arranged by system and subdivided by specification section. Identify names, addresses, and telephone numbers of project Subcontractors and suppliers. For each category, identify the following:
a. Significant design criteria.
b. List of equipment.
c. Parts list for each component.
d. Operating instructions.
e. Maintenance instructions for each equipment item and systems.
f. Maintenance instructions for special finishes, including recommended cleaning methods and materials and special precautions for identifying detrimental agents.
5. Submit operations and maintenance data to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

B. Record/As Built Documents:
1. Prepare and maintain on site one set of the following record/as built documents:
a. Contract Documents.
b. Construction Documents.
c. Change orders and other modifications to the Contract.
d. Shop drawings, product data, and samples.
e. Construction schedule.
2. Store record/as built documents separate from documents used for construction.
3. Record actual revisions to the Work, concurrently with construction progress.
4. Legibly mark and record a description of actual products installed at each specification section, including the following:
a. Manufacturer's name and product model and number.
b. Approved product substitutions or alternates utilized.
c. Changes made by addenda, change orders, and other modifications.
5. Legibly mark each item to record actual construction, including the following:
a. Measured depths of foundations in relation to finish first main floor datum.
b. Measured horizontal and vertical locations of underground utilities and appurtenances, referenced to permanent surface improvements.
c. Measured locations of internal utilities and appurtenances concealed in construction, referenced to visible and accessible features of the work.
d. Field changes of dimension and detail.
e. Details not on original Contract Document drawings.
6. Submit record/as built documents to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

C. Warranties and Bonds:
1. Compile warranties and bonds required by the Contract Documents.
2. Submit duplicate copies of warranties and bonds to the Tenant with final application for payment in accordance with Exhibit C of the Construction Contract.

D. Maintenance Materials and Spare Parts:
1. Provide extra maintenance materials and spare parts in quantities indicated in the specification sections.
2. Place in location as directed by the Tenant's Construction Manager.

DIVISION 2 - SITE CONSTRUCTION

1.1 General: Provide site construction work, including services, utilities, earthwork, paving and landscaping in accordance with the site construction work drawings and details.

2.1 Materials:

A. Stencils for pavement markings: Pavement Stencil Comapny, P: (800) 250-5547, stencils@pavementstencil.com

DIVISION 3 - CONCRETE

SECTION 03300 - CAST-IN-PLACE CONCRETE

1.1 General: Provide cast-in-place concrete work in accordance with the General Structural Notes, structural drawing and details. Follow shell building documents for specifications, joints and geotech.

A. Standards: Materials and construction shall conform to the following:
1. ACI 117 "Standard Tolerances for Concrete Construction and Materials."
2. ACI 301 "Structural Concrete for Buildings."
3. ACI 305R "Recommended Practice for Hot Weather Concreting."
4. ACI 306R "Recommended Practice for Cold Weather Concreting."
5. ACI 315 "Details and Detailing of Concrete Reinforcement."
6. ACI 318 "Building Code Requirements for Reinforced Concrete."

2.1 Materials:

A. Under Slab Vapor Retarder: Stego Industries LLC, 877-464-7834, internet www.stegoindustries.com high density polyethylene Stego Wrap (10 mil) Vapor Barrier meeting or exceeding ASTM E1745 performance criteria for Class C vapor retarders.
1. Seam Tape: High density polyethylene tape with pressure sensitive adhesive.
2. Pipe boots: Shop or site fabricated from vapor retarder material and seam tape.

B. Concrete:
1. Portland Cement: ASTM C150, Type I
2. Aggregate: ASTM C33.
3. Water: Clean and potable.
4. Reinforcement: When required, comply with drawings reinforcement requirements.
5. Compressive Strength: Minimum 3000 psi at 28 days.
6. Admixtures: All admixtures shall be approved by the Tenant's Construction Manager prior to placement in the concrete mix.

C. Topping Concrete: When required to suit installation conditions, Ardex Diama-Top of Ardex Engineered Cements (888) 512-7339, internet www.ardex.com
1. ULTRAFLOR ARDEX DIAMA-TOP, self-leveling concrete repair material.
2. Any pinholes that need to be filled shall be filled with ARDEX DIAMA-FILL filling compound for polished concrete, concrete terrazzo and other cementitious wear surfaces applied at the appropriate time during the polishing process.
3. The primer for areas to receive ARDEX DIAMA-TOP will be ARDEX EP 2000 Substrate Preparation Epoxy.
4. Installation shall be performed by factory-trained professional applicators in strict accordance with manufacturer's installation instructions.

3.1 Installation

A. Vapor Retarder: Place, protect and repair vapor retarder sheets in accordance with ASTM E1643 and manufacturer's installation instructions.
1. Provide a single layer of vapor retarder material over level compacted slab base.
2. Lap joints and seams 6 inches and seal with seam tape.
3. Seal all penetrations and repair damaged areas before concrete placement.

B. Reinforcement Place and inspect all reinforcing steel before concrete is placed.

C. Concrete Placement:
1. Place cast-in-place concrete in accordance with ACI 301 and ACI 305R and 306R recommended practices for hot weather and cold weather concreting. Do not place concrete when temperature is below 40 degrees F.
2. Wet cure concrete in accordance with ACI 301, using moist curing or moisture-retaining covers

D. Finish: Except where additional floor finish is scheduled, provide a smooth steel trowel finish.
1. Exposed concrete used as a finish floor surface shall have a smooth finished surface, uniform in texture and appearance and free of trowel marks and other defects affecting ease of maintenance.
2. Grind smooth surface defects as directed by the Tenant's Construction Manager.

E. Testing: When required, comply with drawings and specification sections testing requirements.

F. Topping Concrete: Prepare concrete floor slab substrate surfaces, prime substrate surfaces, mix, install and finish topping concrete in accordance with manufacturer's application instructions.

SECTION 033600 - RESINOUS FLOORING

1.1 General: Section includes: Decorative resinous flooring systems.

1.2 System Description:

A. Performance Requirements: Provide resinous flooring that has been manufactured and installed to maintain performance criteria stated by manufacturer without defects, damage or failure.

1.3 Quality Assurance:

A. Qualifications:
1. Installer Qualifications: Installer experienced in performing work of this section who has specialized in installation of work similar to that required for this project.
a. Installer shall be an established company with at least 3 years experience in the installation of polymer floors.
b. Contractor shall demonstrate the ability to undertake and complete the required work and furnish documentation regarding the successful completion of projects of similar size and complexity.
2. Manufacturer Qualifications: Manufacturer shall be capable of providing technical support, qualified applicators, and approval of application methods.

B. Pre-installation Meetings: Conduct a pre-installation meeting to verify flooring system specifications (color, texture, etc.), substrate analysis, and manufacturer's installation instructions.

C. Pre-installation Testing: Conduct pre-installation testing as follows:
1. Water Vapor Transmission: Calcium Chloride tests should be conducted to determine the amount of water vapor coming through the slab. The results should be compared to limitations set forth by the manufacturer.
2. Core Sample Testing: (optional) Core samples should be taken and analyzed if the installer believes there to be a problem with the integrity of the substrate that may affect flooring system performance.

1.4 Delivery, Storage & Handling:

A. Ordering: Comply with manufacturer's ordering procedures and allow for enough lead-time for custom blends so as not to interfere with construction schedules.

B. Delivery: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.

C. Storage and Protection: Store materials where they are protected from direct sunlight and harmful weather conditions. Meet manufacturer's condition for temperature, humidity, etc.

1.5 Project Conditions:

A. Environmental Requirements/Conditions: Substrate and ambient air temperatures shall be in accordance with manufacturer's requirements.

B. Temperature Requirements: Maintain air temperature in spaces where products will be installed for time period before, during and after installation as recommended by manufacturer.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G010

2.1 Materials:

A. Resinous Flooring: Manufacturer: aiflooring
   1. Contact: 1218 West 41st Street, Suite B, Tulsa, Oklahoma 74107. Phone: 918-445-0627

2.1 Flooring System:

A. System Description: Clear, thin film system 18-22 mils thick with texture agent added for slip resistance.
   1. TerraPrime: A 2 component, 100% solids clear polyamide-cured epoxy coating.
   2. TerraThane Satin: A 2 component, 90% solids polyurea clear finish coat.
   3. TerraGrip: A graded, plastic aggregate added to finish coat for slip resistance.

2.3 Product Substitutions:

A. Substitutions: No substitutions permitted.

2.4 Source Quality:

A. Source Quality: Obtain resinous materials, including patching and leveling materials from a single manufacturer.

3.1 Manufacturer's Instructions:

A. Compliance: Comply with manufacturer's product data, including product technical data sheets and application instructions.

3.2 Examination:

A. Site Verifications of Conditions: Verify substrate conditions, which have been previously installed under other sections, are acceptable for product installation in accordance with manufacturer's instructions.
   1. Before applying materials, inspect surfaces to receive new materials and report any unsatisfactory conditions. Absence of any such report shall constitute installer's acceptance of surfaces as satisfactory for installing materials.

3.3. Preparation:

A. Adjacent Surfaces Protection: Protect adjacent work areas and finish surfaces from damage during product installation.

B. Surface Preparation:
   1. Mechanical Cleaning: Concrete floor surfaces receiving polymer flooring systems shall be thoroughly cleaned and prepared by shotblasting and/or diamond grinding.
   2. Patching Damaged Substrate: Holes, voids, static cracks, and other substrate surface defects should be patched and repaired according to manufacturer's recommendations.
   3. Prepare and clean control joints well and fill with an appropriate elastomeric.

3.4 Installation:

A. Resinous Flooring Installation: The following are abbreviated guidelines that should provide for basic application steps for the installation of the systems. Detailed instructions should be obtained from the manufacturer.
   1. Patching: After substrate preparation, surface defects shall be patched according to manufacturer's recommendations.
   2. Priming: Apply aiflooring TerraPrime, 100% solids epoxy primer, at a rate of 125-150 square feet per gallon. Allow 6-12 hours (depending on temperatures) of cure before applying finish coat. Finish coat must be applied within 24 hours of TerraPrime application.
   3. Finish Coat: Apply aiflooring TerraThane Satin, 90% solids polyurea topcoat, at a rate of 200 square feet per gallon. TerraGrip should be added to the TerraThane mix at a rate of 1 pint per 3 gallon kit for slip resistance. Note that TerraThane Satin must be metered out by notched squeegee prior to rolling.

B. Cleaning: Remove temporary coverings and protection of adjacent work areas. Repair or replace damaged installed products. Clean installed products in accordance with manufacturer's instructions prior to Owner's acceptance. Remove construction debris from project site and legally dispose of debris.

3.5 Protection:

A. Protection: Protect installed product and finish surfaces from damage during construction.

SECTION 03395 - CONCRETE SEALING AND POLISHING

1.1 General: Provide a sealed and polished concrete floor finish as shown and specified.

A. Standards
   1. American Society for Testing and Materials:
      a. ASTM-C779, Standard Test Method for Abrasion Resistance of Horizontal Concrete Surfaces.
      b. ASTM G23-81, Ultraviolet Light & Water Spray
      c. ASTMC805, Impact Strength
   2. American Concrete Institute
      a. ACI 302. 1R-89, Guide for Concrete Floor and Slab Construction

B. Submittals: Provide the following:
   1. Manufacturer's product data, specifications and installation instructions. Include Material Safety Data Sheets (MSDS) and identify application requirements, curing time and safety requirements.
   2. Certified test reports, prepared by an independent testing laboratory, confirming compliance with performance criteria.
   3. Manufacturer's certification that installer is a certified applicator of special concrete floor finishes, and familiar with manufacturer's installation procedures and requirements for the specified sealed and polished concrete floor finish.
   4. Manufacturer's and installer's written acceptance of substrate surface and installation conditions.

C. Quality Assurance:
   1. Installer Qualifications:
      a. Use a certified installer and adequate number of skilled workmen who are thoroughly trained and experienced in the necessary craft.
      b. The special concrete finish manufacturer shall certify the applicator.
      c. Applicator shall be familiar with the specified requirements and the methods needed for proper performance of work of this section. Applicator shall have not less than three years successful experience installing sealed and polished floor finishes similar to those required for this project.
      d. Provide a letter of certification from special concrete finish manufacturer stating that installer is a certified applicator and is familiar with proper procedures and installation requirements required by the manufacturer.
   2. Protection: Contractor shall provide all necessary materials, means, methods and procedures acceptable to the floor finish manufacturer and required to protect the concrete floor surface and provide a suitable substrate for the installation of the specified sealed and polished concrete floor finish.

D. Project Conditions:
   1. Comply with the floor finish manufacturer's environmental limitations for substrate temperature and moisture content, ambient temperature, and humidity, ventilation and other conditions affecting the special floor finish performance.
      a. Concrete must have an average Floor Flatness rating of at least 40.
      b. Concrete must have an average Floor Levelness rating of at least 40.
      c. Concrete must be cured a minimum of 28 days or as directed by the manufacturer before application of RetroPlate can begin. Wet cure of the concrete is preferred. No concrete sealer is necessary.
      d. Application of RetroPlate shall take place prior to installation of equipment, thus providing a complete, uninhibited concrete slab for application.
   2. Before general sealer/hardener application, prepare and coat a jobsite test area of size acceptable to the Architect, to verify and approve proper surface preparation, application techniques and coverage rate.
   3. Close finished floor areas to traffic during floor finish application and after application for time period directed by the floor finish manufacturer.
   4. The completed RetroPlated slab will be covered to prevent damage by the other trades during store completion.

2.1 Materials

A. Hardening/ Sealing Agent
   1. RetroPlate 99 manufactured by Advanced Floor Products Inc. (801) 812-3420 www.retroplatesystem.com
   2. RetroGuard Stain Inhibitor
   3. Joint Filler: CreteFill Pro 75. Two component 100% solids non-staining Polyurea Elastomer.
   4. Spall Repair: Multiple minor surface defects and irregularities: Crete Fill Spall Repair: High Strength hybrid urethane, two part 100% solids.
   5. Coefficient of friction for Retroguard finish shall not be lower than .40.
   6. Manufacturer's Representative: Contact Scott Maxfield at RetroPlate for a list of Certified Applicators (888)942-3144 scott.maxfield@retroplatesystem.com

3.1 Installation

A. Surface Conditions
   1. Examine substrate, with installer present, for conditions affecting performance of finish. Correct conditions detrimental to timely and proper work. Do not proceed until unsatisfactory conditions are corrected.
   2. Verify that base slab meets finish and surface profile requirements in Division 3 Section "Cast-In-Place Concrete," and Project Conditions above.
   3. Prior to application, verify that floor surfaces are free of construction latents.

B. Application
The following RetroPlate process will be followed as listed below:
A concrete grinding machine must be used. Please proceed accordingly. The process is as follows:
   1. Floors should be started using 50, 80 or 100 grit diamond pucks depending on the condition of the slab.
   2. Clean the floor using automatic scrubber or comparable.
   3. Grind floor using 200 grit resin diamonds.
   4. Clean the floor using automatic scrubber or comparable.
   5. Apply RetroPlate 99 to floor at 200 sq. ft. per gallon, scrubbing product into the floor and allowing product to soak until turning slick. If it becomes sticky, apply water to the surface as necessary, leaving the product on the floor for at least 60 minutes.
   6. Grind floor using 400 grit resin diamonds.
   7. Clean the floor using automatic scrubber or comparable.
   8. Clean and remove any excess RetroPlate. Let the floor dry overnight.
   9. Continue the polishing process using 800 grit resin diamonds.
   10. Clean the floor using automatic scrubber or comparable.
   11. Alternately, depending on slab condition, grind floor using 1200-1500 grit resin diamonds.
   12. Clean the floor using automatic scrubber or comparable.
   13. The same process will be used for new floors as well as rehab floors. Floor prep for the rehab floors will be separate.
   14. Apply an even coat of RetroGuard Sealer with a brush, roller, or low-pressure sprayer, and when surface is dry, burnish the floor with a black burnishing pad. Apply a second coat of RetroGuard one hour after the initial application, and again burnish the floor with a black burnishing pad.
   15. Do not walk on surface for 12 hours, and do not introduce any water or moisture for at least 48 hours, allowing for proper drying and setting of RetroPlate and RetroGuard. Water will minimize the sealing properties of RetroPlate and RetroGuard.

C. Start any of the floor finish applications in presence of manufacturer's technical representative.

D. Sealing, Hardening and Polishing of Concrete Surface
   1. Concrete must be in place a minimum of 28 days or as directed by the manufacturer before application can begin.
   2. Application is to take place at least 10 days to the prior to racking and other in-store accessory installation, thus providing a complete, uninhibited concrete slab for application.
   3. Only a certified applicator shall apply RetroPlate 99. Procedures must be followed as recommended by the product manufacturer and as required to match approved test sample.
   4. Achieve waterproofing, hardening, dust-proofing, and abrasion resistance of the surface without changing the natural appearance of the concrete, except for the sheen.
   5. Polish to a level 2 shine.

E. Workmanship and Cleaning
   1. The premises shall be kept clean and free of debris at all times.
   2. Remove spatter from adjoining surfaces, as necessary.
   3. Repair damages to surface caused by cleaning operations.
   4. Remove debris from jobsite
      a. Dispose of materials in separate, closed containers in accordance with local regulations.

DIVISION 4 - MASONRY

SECTION 04810 - UNIT MASONRY ASSEMBLIES

1.1 General: Provide unit masonry assemblies as shown and specified.

A. Standards: Materials and construction shall conform to the following:
   1. ACI 530.1-02/ASCE 6-02/TMS 602-02 "Specifications for Masonry Structures."
   2. NCMA "TEK Bulletins."
   3. BIA "Technical Notes on Brick Construction."

2.1 Materials:

A. Concrete Masonry Units (CMU): Size and thickness as shown on drawings.
   1. ASTM C 90, load-bearing, normal weight, natural color CMU, properly cured at time of delivery, linear shrinkage not to exceed 0.065%.
   2. Provide special shapes where required.
   3. Provide exterior wall CMU containing an integral polymeric water-repellent admixture.
      a. Manufacturer: W. R. Grace "Dry-BlockR System Block Admix ".

B. Face Brick:
   1. Manufacturer:
      a. Endicott, (402) 729-3315, www.endicott.com (Iron Spot Brick), or as approved by architect
      b. Belden Brick Company, (330) 451-2031, www.beldenbrick.com (White Brick), or as approved by architect
   2. Type: "Face Brick C216" complying with ASTM C216, Grade SW, Type FBS. No efflorescence when tested in accordance with ASTM C67.
   3. Size: Modular size, laying three courses to 8" vertically.
   4. Color: "Alaska White Velour" or "Manganese Ironspot, Velour" as noted on Exterior Elevations
   5. Provide special shapes where required.

C. Mortar Materials:
   1. Portland cement: ASTM C150, Type I or III, natural color.
   2. Masonry cement: ASTM C91, Type indicated, natural color.
   3. Aggregate: ASTM C144, clean masonry sand.
   4. Water: Clean, fresh and potable.
   5. Provide all exterior wall masonry mortar containing an integral polymeric water-repellent admixture.
      a. Manufacturer W. R. Grace, "Dry-BlockR Integral Water-Repellent Mortar Admixture".

D. Unit Masonry Mortar Mixes: ASTM C270 proportions by volume.
   1. Face brick: Type N mortar.
   2. Dye:
      a. SGS #60A "White" by Solomon Grind Services (White)
      b. SM #750 "Silverstone" by Spec Mix (Iron Spot)

E. Reinforced Unit Masonry Grout Mixes
   1. Concrete fill: ASTM C94 3,000 psi concrete.

F. Joint Reinforcement, Wall Ties And Anchors: Finish, ASTM A-153 hot-dip galvanized
   1. Manufacturer: Hohman & Barnard, INC.
   2. Horizontal joint reinforcement: Welded ladder type with matching corners and Tee units.
      a. Single Wythe masonry: Standard single 9 gage side and cross rods. H&B - #220 Ladder-Mesh.
   3. Anchoring devices: Provide strap anchors, inserts, bolts and rods of type and size indicated.
      a. CMU to CMU: Strap anchors 1/4" x 1-1/4" x 24" steel with bent ends.
      b. CMU to structural steel: H&B - VBT - Vee Byne-Tie With Plain Steel (Tie) Used In Conjunction With H&B #359 Weld-on Ties (Anchor Rods).
   4. Masonry Veneer To Woof Framing: H&B - DW-10HS Veneer Anchor, With Adjustable 3/16" Cold-Drawn Steel Wire Tie Sections and 14 GA. Screw-On Attachment Plate.
      a. Fasteners: Self-Drilling, Self-Tapping Screws, 1-1/4" X #10, Corrosion-Resistant Coated. Provide Two (2) Screw Fasteners for each Attachment Plate.
   5. Seismic Masonry Veneer to Wood Framing: (When Required) H&B Seismic Plate Pintle HB-213S with HB-213 (T-Lok Tie)
      a. Fasteners: Seld-Drilling, Self-Tapping Screws, 1-1/4" X #10, Corrosion-Resistant Coated. Provide Two (2) Screw Fasteners For Each Attachment Plate.

G. Concealed Masonry Through-Wall Flashing: W. R. Grace "Perm-A-Barrier" self-adhering modified bituminous sheet, 40 mils thick.
   1. Termination Mastic: W.R. Grace "Bituthene Mastic."
   2. Primer: W.R. Grace "Bituthene P-300 Primer."
   3. Termination bars: Extruded aluminum or stainless steel, 1" wide and .098" thick pre-punched at 6" on center, secured with stainless steel drive pins.

H. Accessories
   1. Reinforcing bars: ASTM A615, Grade 60, deformed billet steel bars of sizes indicated.
   2. Wall weeps: Dur-O-Wal D/A 1006 "Cell Vent", clear flexible polypropylene co-polymer.
   3. Compressible joint material: Dur-O-Wal "Rapid Soft-Joint" D/A 2010.
   4. Bond breaker strips: ASTM D226 No. 15 asphalt saturated roofing felt.
   5. Cleaning agents:
      a. Face Brick and CMU: ProSoCo, Inc., "Sure Klean New Masonry Cleaners."
      b. ACMU: ProSoCo, Inc., "Sure Klean Burnished Custom Masonry Cleaner."
   6. Expansion/Control joint sealants: Polyurethane-based, elastomeric joint sealant complying with ASTM C920 and Section 07900 requirements. Color matched to adjacent surfaces.

3.1 Installation

A. Preparation
   1. Wet absorbent face brick masonry units requiring wetting, in accordance with BIA recommendations.
   2. Lay concrete masonry units dry.
   3. Establish, lines, levels and coursing. Ensure ties, anchors and flashing are correctly installed
   4. Mix mortar cementitious materials and aggregate in a mechanical mixer. Add water in amount to provide satisfactory workable consistency of mortar. Retemper mortar as required within two hours of mixing to replace water lost be evaporation. Discard mortar after two and one-half hours of initial mixing. Do not use mortar after it has started to set.

B. Installation - General:
   1. Build walls and other masonry construction to the full thickness shown. Build single wythe walls to the actual thickness of the masonry units, using units of nominal thickness shown.
   2. Cut masonry units using motor-driven masonry saws to provide clean, sharp edges. Cut units to fit adjoining work neatly. Provide 100% solid units where cores would be exposed.
   3. Cold weather construction, hot weather construction, and masonry construction tolerances: Comply with unit masonry standard ACI 530.1/ASCE 6/TMS 602 requirements.

C. Laying Masonry
   1. Layout walls in advance to ensure accurate spacing of surface bond patterns, with uniform joint widths, and to properly locate openings, movement type joints, returns and offsets. Do not use less than half-size units at corners, jambs and other locations.
   2. Lay up walls plumb and true to comply with ACI 530.1 tolerances. Provide square corners and angles, except as otherwise indicated, with courses level, accurately spaced and coordinated with other work.
   3. Pattern bond: Running bond. Do not use units with less than 4" of horizontal face dimensions at corners or jambs.
   4. Lay hollow CMU/ACMU with full mortar coverage on horizontal and vertical face shells. Bed CMU webs in mortar in starting courses. Maintain uniform 3/8" joint widths.
   5. Lay face brick and solid CMU/ACMU with completely filled bed and head joints. Do not slush head joints. Maintain uniform 3/8" joint widths.
   6. Compress and cut joints flush for masonry walls below grade or covered by other materials.
   7. Tool joints in all exposed masonry work to a concave joint.
   8. Provide interlocking masonry bond in each course at corners and intersecting walls.
   9. As the work progresses, build in masonry accessories and related items. Fill in solidly with masonry around built-in items.
      a. Bed hollow metal frame anchors in mortar and fill space between hollow metal frames and masonry solid with fine mortar grout.
      b. Provide solid masonry bearing for all lintels, beams, joists, plates and load-bearing members.
      c. Take particular care to embed all conduits and pipes within concrete masonry without fracturing exposed shells and to fit units around switch, receptacle and other boxes set in walls. Where electric conduit, outlets, switch boxes and similar items occur, grind and cut units before building in services.
      d. Install anchors, plates and related work built into masonry work.
      e. Install reinforcing steel and concrete fill where indicated. Comply with drawing details.
   10. Horizontal joint reinforcing: Provide continuous joint reinforcing at all concrete masonry walls as follows:
      a. In every second block course, 16" on center vertically, full height of wall and every block course where shown on the drawings.
      b. Lap reinforcement a full width at the corners and at intersections or use special fabricated sections.
      c. Fully embed side rods in mortar.
   11. Anchoring masonry work: Provide anchoring devices of the type indicated or required.
   12. Provide vertical expansion, control and isolation joints in masonry where indicated.
      a. When not indicated, at maximum 30'-0" on center.
      b. Locate control joints at points of natural weakness in masonry and acceptable to Architect.
      c. Joint sealant color shall match masonry materials sealed.
   13. Lintels: Install loose steel lintels furnished under structural steel work where shown. Set lintels in full bed of mortar.
   14. Flashing and weeps:
      a. Install concealed through wall masonry flashing at all wall sills, masonry openings in exterior walls with masonry above head, over all horizontal steel members built into masonry and elsewhere as indicated. Provide "drainage wall system" masonry construction.
      b. Provide end dams and positive slope to drain. Extend flashing vertically at least 8" and built into or anchor to back-up with a termination bar for a complete watertight installation.
      c. Flexible Membrane Flashing:
         1.) Install membrane flashing in accordance with manufacturer's installation instructions.
         2.) Fully adhere flashing to substrate.
         3.) Lap flashing joints a minimum of 6", seal and roll with a hand roller.
         4.) Trim bottom edge 1/4" back from exposed face of masonry.
         5.) Seal edges, seams, cuts and penetrations with manufacturer's recommended mastic.
   15. Install weeps in head joints of final course of exterior masonry wythe above flashing. Space weeps maximum of 24" on center horizontally and located to avoid door openings. Install weeps at head joints with outside face of weep material held 1/8" from the finish face of masonry unit.
   16. Install compressible joint material at lintels and horizontal steel members. Build in joint fillers and seal with elastomeric joint sealant.

D. Masonry Veneer Walls:
   1. Metal framed walls: Tie exterior masonry veneer wythe to back-up wall with individual metal ties screwed to metal stud framing.
   2. Space ties 16" on center vertically and horizontally.
   3. Maintain veneer wall cavity free of mortar droppings during masonry installation.

E. Parging:
   1. Dampen masonry walls prior to parging.
   2. Scarify each parging coat to ensure full bond to subsequent coat.
   3. Parge masonry walls in two uniform coats of mortar to a total thickness of 3/4 inch (19mm).
   4. Steel trowel surface smooth abs flat with a maximum surface variation of 1/8 inch per foot (1mm/meter).

F. Architectural Concrete Masonry Units: Install ACMU in accordance with the manufacturer's installation instructions and the following:
   1. Draw ACMU from more than one pallet at a time during installation.

G. Reinforced Concrete Masonry
   1. Reinforce and fill CMU/ACMU wall and column masonry where indicated. Fill all cores solid with concrete fill. Comply with NCMA TEK Bulletins 3-2, 3-3A and 14-2 recommendations.
      a. Comply with drawing details for reinforcing steel size and spacing.
   2. Install bond beams where indicated. Reinforce and fill units solid with concrete fill. Comply with drawing details for reinforcing steel size and spacing.

H. Repair, Pointing and Cleaning
   1. In process cleaning: Wipe off excess mortar as the work progresses. Dry brush with bristle brushes exposed masonry at the end of each day's work. Remove mortar spatters and joint ridges.
   2. Clean all exposed masonry. Cleaning agents subject to Architect's approval. Before applying any cleaning agent to the entire wall, clean a sample wall area of approximately 20 square feet in a location acceptable to the Architect. Do not proceed with final cleaning until the sample area has been allowed to dry a minimum of 3 days and the test area cleaning approved. Protect all windows, doors, louvers, metal lintels and other corrodible parts. Damaged materials and work replaced at Contractor's expense.
   3. Dry clean exposed surfaces to remove large particles of mortar using hardwood wood paddles and scrapers. Metal tools not acceptable.
   4. Presoak exposed masonry surfaces by saturating with water and flush off loose mortar and dirt.
   5. Apply cleaning solutions and clean masonry in accordance with the cleaning material manufacturer's cleaning instructions.
   6. Muriatic acid cleaning of masonry not permitted.

I. Architectural Concrete Masonry:
   1. Keep ACMU walls clean during installation. Remove excess mortar on daily basis using brushes, rags or burlap squares.
   2. Clean completed walls with detergent masonry cleaner recommended by the ACMU manufacturer. Acid cleaning agents, abrasive cleaners, tools or powders and metal cleaning tools and brushes are not permitted.
   3. After final clean down and when walls are dry, apply ACMU acrylic finish coating in accordance with ACMU manufacturer's application instructions.

DIVISION 5 - METALS

SECTION 05120 - STRUCTURAL STEEL

1.1 General: Provide structural steel in accordance with the General Structural Notes and structural drawings and details.

A. Standards: Materials and construction shall conform to following:
   1. AISC "Specification for the Design, Fabrication, and Erection of Structural Steel for Buildings."
   2. AISC "Code of Standard Practice."
   3. AWS "Structural Welding Code, D1.1-Steel."

2.1 Materials:

A. Materials compliance: When requested, submit acceptable data documenting materials compliance for each type of material required.

B. Structural Shapes: ASTM A36/A36M, 36 ksi steel.

C. Tubular Steel: ASTM A500, 46 ksi yield strength steel, cold-formed welded and seamless.

D. Structural pipe: ASTM A53, type and grade selected by the fabricator as required for design loading, standard finish, standard weight (Schedule 40) except as otherwise indicated.

E. Grout: ASTM C1107, pre-mixed, shrinkage resistant, non-metallic, non-corrosive, non-staining grout.

F. Shop paint primer: Refer to Section 09900 - Paints and Coatings.

G. Fabrication: Fabricate structural steel in accordance with AISC "Specification - Structural Steel for Buildings" and "Code of Standard Practice." Provide welded or bolted connections in accordance with the Structural Drawings connection requirements.
   1. Welding: Conform to AWS welding standards. Provide only continuous welds, spot welding is not acceptable. Grind all exposed welds smooth.
   2. Splicing: Material, if spliced, shall have maximum one splice per structural member. Perform splicing by full penetration butt-welding using AWS qualified welders and welding methods.
   3. Shop painting: Shop paint structural metal members, except members or portions of members to be embedded in concrete or masonry, surfaces and edges to be field welded and galvanized surfaces. Refer to Section 09900 - Paints and Coatings.

3.1 Installation:

A. Erection: Erect structural steel in accordance with AISC "Specification - Structural Steel for Buildings" and "Code of Standard Practice".
   1. Plumb, level and align base plates for structural members with steel shims.
   2. Grout structural steel base plates solid that bear on concrete or masonry surfaces.

B. Testing: When required, comply with drawings testing requirements.

SECTION 05400 - COLD-FORMED METAL FRAMING

1.1 General: Provide cold-formed metal framing in accordance with the General Structural Notes and structural drawings and details.

A. Standards: Materials and construction shall conform to following:
   1. AISI SG02.2-01 "Design of Cold-Formed Steel Structural Members."
   2. AWS "Structural Welding Codes, D1.3-Sheet Steel."

2.1 Materials:

A. Materials compliance: When requested, submit acceptable data documenting materials compliance for each type of material required.

B. Load-Bearing Cold-Formed Metal Framing: ASTM A1003, Gage, Grade and Type indicated.
   1. Components: Provide sizes and shapes indicated.
   2. Finish: Galvanized complying with ASTM A653, minimum G60 coating.

C. Fabrication:
   1. Cold-formed metal framing may be prefabricated into panels before erection. Fabricate panels plumb, square, true to line and braced against racking with joints welded.
      a. Provide one-piece full-length cold-formed metal framing members. Splicing not permitted.
   2. Attach and join other components by welding or screw fasteners, as indicated. Wire tying of framing components is not permitted.
   3. Cut framing to fit squarely for attachment to perpendicular members or as required for angular fit against abutting members. Hold members securely in position until properly fastened.
   4. Saw cut field cut framing. Torch cutting not acceptable.

3.1. Installation:

A. Erection: Erect cold-formed metal framing members of gage and at spacing indicated on the Structural Drawings. Align and secure studs to top and bottom runner tracks by welding or screw fasteners at both inside and outside flanges.

B. Tolerance Acceptance: Install cold-formed metal framing member as indicated on the plans. Install to 1/16" tolerance.

SECTION 05500 - METAL FABRICATIONS

1.1 General: Provide metal fabrications as shown and specified.

A. Submit shop drawings for the following:
   1. Patio Rail systems.
      a. Show thickness, size, construction and manner of assembling various members, joint locations and railing layout.
      b. Show true profiles, connections and relationship to adjoining work and methods of anchoring.

2.1 Materials

A. Materials compliance: When requested, submit acceptable data documenting materials compliance.

B. Steel Shapes: ASTM A36/A36M, 36 ksi steel.

C. Stainless Steel:
   1. Wall: 18 gage, ASTM A167, AISI Type 304 stainless steel, No. 4 finish.

D. Diamond Plate: Nominal 1/8" thick ASTM B209, Alloy 6061-T6, Aluminum Diamond Tread Plate.
   1. Wall: Bright reflective finish.
   2. Floor: Mil finish.

E. Patio Railing System
   1. Submit shop drawings including the following:
      a. Show thickness, size, construction and welding, as well as assembly drawings.
      b. Show true profiles, connections of all typical joint configurations
      c. Show installation (fastening) and proposed grout (non-gypsum base)
      d. Show gate detail and gate hardware manufacturer and model number
      e. Patio railing plan, with dimensions and panel assembly locations.
   2. Fabrication
      a. Patio rails and gate shall be fabricated from steel flat bar, 3/8" x 2 1/2", grade A36.
      b. Corner connector angles shall be 2 1/2" x 2 1/2" x 1/4" steel L angle.
      c. Gate hinges shall be a self-closing, adjustable tension type. Hinge installation shall be drilled and tapped. Permanently welded are unacceptable.
      d. Gate stop shall have a rubber cushion stop and be affixed to the active gate.
      e. All corners and joints shall be seal welded and outside joints ground smooth.
      f. All welding spatter shall be removed before sand blasting.
   3. Finish
      a. Patio railing shall be painted PPG Durethane, color 518-6 Knight's Armor. Refer to Section 09900 - Paints and Coatings for preparation.

F. Exposed Fasteners:
   1. Diamond Plate: #8 x 1" bevel headed stainless steel screw.
   2. Patio Railing:
      a. All fasteners shall be stainless steel and powder coated to match railing sections.
      b. Spacer washers separating railing sections shall be 1 1/2" diameter and 1/2" thick they shall be one piece thick washers and not comprised of stacking washers
      c. Spacer washers shall be used on all straight sections and when railing panels join at 90 degree corner angles.

G. Shop paint primer: Refer to Section 09900 - Paints and Coatings

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G011

3.1 Installation: Comply with the Architectural Drawing details and the following:

A. Exposed Fasteners:
1. Flat Metal Panels: Provide 18" vertical and horizontal pattern or spaced equally if 18" pattern does not finish evenly. Exposed fasteners shall remain unpainted in natural factory supplied finish.
2. Diamond Plate: Provide counter sunk fasteners at perimeter of panels at 2'-0" on center maximum as well as fully adhering to surface.

B. Stainless Steel:
1. Wall:
a. Clean stainless steel panel with mineral spirits.
b. Install stainless steel panels with Henry 117 oil based adhesive applied to wall with 1/8" notch tooth trowel.
c. Trim seams as indicated on the Drawings. No exposed fasteners.

C. Diamond Plate:
1. Wall: Mount over plywood substrate w/ flush exposed fasteners.
2. Floor: Provide continuous bead of silicone sealant to back side perimeter of plate prior to installation.
3. Mount with exposed fasteners. Provide continuous bead of silicone sealant to perimeter of plate after installation.

D. Patio Railing System:
1. Railing posts shall be set 6" deep into a core drilled hole, 4"-6" diameter
2. Railing posts shall be grouted in using non gypsum quick set grout.
3. Railing posts shall be set in grout plumb and level, with a tolerance of 1/8" in 4 feet.

E. Hand-inspect all joints and edges of installed metal materials. Unless otherwise indicated, fit exposed connections accurately together to form tight hairline joints. Grind and ease exposed joints, and edges smooth and free of burrs.

DIVISION 6 - WOOD AND PLASTICS

SECTION 06100 - ROUGH CARPENTRY

1.1 General: Provide rough carpentry work as shown and specified.

A. Standards: Materials and construction shall conform to following:
1. NIST PS-1-95 "Construction and Industrial Plywood."
2. NIST PS-2-95 "Performance Standards for Wood-Based Structural-Use Panels."
3. NIST PS-20-99 "American Softwood Lumber Standard."
4. NF&PA NDS-97 "Wood Construction and Supplement."
5. AWPA "Wood Treatment Standards."

2.1 Materials:

A. Lumber: Factory grade-marked, dressed, seasoned dimension lumber, S4S, air-dried, maximum 19% moisture content complying with PS-20, dimensions indicated.
1. Blocking, nailers and similar members: Standard Grade Western Dimension Lumber or Southern Pine species.
a. Provide preservative treated lumber, where indicated.

B. Plywood: Factory grade-marked, complying with PS-1, square edge, 5/8" thick.
1. APA-RATED SHEATHING EXP1.
a. Provide Exterior Grade (EXT) plywood, where indicated.
b. Provide fire-retardant treated plywood, where required by Building Code.

C. Oriented Strand Board (OSB): Factory grade-marked, complying with PS-2, square edge, 5/8" thick

2.2 Wood Treatment:

A. Preservative Treatment: Comply with applicable requirements of AWPA Standards C2 (Lumber).
1. Pressure preservative treat lumber with water-borne preservatives, acceptable to authorities having jurisdiction, to a minimum retention of 0.25 pcf.
2. Treat wood blocking, nailers and similar members in connection with roofing and flashing.
3. Treat wood plates, blocking, furring and similar concealed members in contact with masonry or concrete.

B. Fire-Retardant Treatment: Comply with applicable requirements of AWPA Standards C27 (Plywood). Identify "fire-retardant-treated plywood" with appropriate UL classification marking.
1. Treated materials shall meet "Interior Type A" FR-S ratings of not more than 25 for flame spread, smoke developed and fuel contributed when tested in accordance with UL 723 or ASTM E84, with no increase in flame spread and evidence of significant progressive combustion upon continuation of test for additional 30 minutes.

C. Kiln-dry all treated lumber and plywood materials after treatment to maximum 15% moisture content.

3.1 Installation:

A. Lumber: Provide wood blocking, nailers and similar members where shown and where required for attachment of other work and surface applied items. Attach to substrate as required to support applied loading.
1. Use only sound, seasoned materials of longest practical lengths and sizes to minimize joints.
2. Use materials free of warp. Make tight connections between members.

SECTION 06210 - FINISH CARPENTRY AND MILLWORK

1.1 General: Provide finish carpentry and millwork as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. AWI "Architectural Woodwork Quality Standards - 1999."

B. Doors and door hardware: Install all door hardware furnished under Division 8 specification Sections.

C. Submit shop drawings for designated millwork.
1. Include complete details, materials lists and drawings showing fabrication of typical units, unit assemblies, locations and installation details.
2. List proposed cabinet hardware to suit indicated unit use or function.
3. Identify materials required to complete work ready for installation.
4. Obtain shop drawing approval before starting fabrication.

2.1 Materials:

A. Plywood: AWI Section 200
1. Concealed use substrates: CDX, D-3 Paint Grade hardwood plywood, with aspen veneer core, 5/8" thick. (OSB is an alternative as allowed by Chipotle CM)
2. Exposed to view finishes:
a. Random plank matched or slip and swing matched spalted maple veneer on 3/4" baltic birch core, with mill option sound grade hardwood backer. Spalted maple grain to run horizontally .5 sheen matte clear waterborne finish. Panels to be provided at 47" height, with widths varying from 24" to 95".
b. 3/4" Rice Straw MDF panels (by Eureka) with digitally printed spalted maple artwork. UV white primer used on front side for printing process, and clear UV cured topcoat covers the front and backside of the panels. Panels are cut to 47" x 95" on CNC and have 7 artwork options. Similar printing process on 3/4" baltic birch core for trash surround doors.

B. Millwork: Materials and construction as detailed on the Drawings.

C. Fabrication:
1. Millwork design and fabrication details shown on the drawings indicate design intent. Unless otherwise indicated, provide manufacturer's standard fabrication methods. Indicate all proposed variations from the drawing design and fabrication details on shop drawings.
2. Fabricate millwork in accordance with AWI "Custom Grade" requirements. Where details are not shown, comply with applicable Quality Standards or with alternate details acceptable to Architect as fabricator's option.
3. Fabricate finished work properly framed, closely fit and accurately set to required lines and levels and rigidly secured in place.
4. Fabricate work straight, plumb, level and in true alignment; neatly and accurately fit, scribed and thoroughly secured. Plane and sand miters and other joints. Ease all square edges. Provide millwork clean and free from warp, twist, open joints and other defects.
5. Provide finished woodwork dressed and sanded free from machine and tool marks, abrasions, raised grain or other defects on surfaces exposed to view in finished work.

D. Finish:
1. Sayerlack Hydroplus Waterborne Clear, 5 sheen for spalted veneer
2. Perfecta UV-Cured topcoat for panels with printed artwork.

3.1 Installation

A. Install finish carpentry and millwork products plumb, level, true and straight with no distortion. Shim as required using concealed shims. Install to a tolerance of 1/8" in 8'-0" for plumb and level (including countertops) and with 1/16" maximum offset in flush adjoining surfaces, 1/8" maximum offsets in revealed adjoining surfaces.
1. Scribe and cut finish carpentry and millwork products to fit adjoining work.
2. Anchor finish carpentry and millwork items to built-in place blocking, furnished under Section 06100, or directly attach to substrate framing. Secure to grounds, blocking and nailers with countersunk, concealed fasteners and blind nailing as required for a complete installation.
3. For installation of prefinished millwork wall panels, use finish nails for exposed nailing, installed with pneumatic nailer as per the following guidelines:
a. Nailer to be set for countersunk head approximately 1/8" on the face.
b. Use 16 ga straight finish nails in 2" length
c. Provide "dab" of construction adhesive on backside of panels at regular intervals.
d. Random placement preferred, do NOT group nails together.
e. No nails closer than 2" from any edge.
f. All nails to be no greater than 16-18" apart in any direction.
g. When using digital printed MDF panels, plan the layout so adjacent panels do not have the same artwork.
4. Touch-up shop finished materials marred or damaged during delivery, storage and installation:
a. For spalted veneer panels, use custom blended polyurethane to equal Minwax "Wipe on Poly".
b. For printed artwork panels, buff with dry cloth for smudges, use lint free cloth for dust, and forliquids use cloth or sponge to absorb liquid (do not wipe) then use water saturated soft cloth with a small amount of mild soap to wipe surface clean, buff with dry cloth to remove streaks.

B. Install casework without distortion so that doors and drawers will fit openings properly and be accurately aligned. Adjust hardware to center doors and drawers in openings and to provide unencumbered operation.

C. Install plastic laminate countertops, shelving and trim. Provide work level, true to alignment, accurately fit to wall conditions and securely fastened to base units and other support systems as indicated.

SECTION 06605 - FIBERGLASS REINFORCED PLASTIC PANELS

1.1 General: Provide fiberglass reinforced plastic panels as shown and specified.

2.1 Materials:

A. Manufacturer: Marlite, (330) 343-6621, internet www.marlite.com, Email: info@marlite.com

B. Panel System: 'P6' Per Finish Schedule, Series: Standard FRP - "Marlite Class 1/A" Fiberglass Reinforced Polyester (FRP) Panels, 3/32" thick, 48" wide x full height required. Color: P100 White, Class A, pebbled matte surface texture. USDA approved for incidental food contact.
1. Panel trim: Extruded PVC, color matching panel color. Provide 1/2" x 1/2" inside corners, edge trim, and division moldings as required to complete the installation.
a. Inside Corner - M350
b. Outside Corner - M360
b. Division - M365
c. Edge - M370
2. Panel trim: Stainless Steel, color matching panel color. Provide 1-1/2" x 1-1/2" outside corners as required to complete the installation.
3. Sealant: Marlite "Silicone Sealant", white gunnable silicone sealant.
4. Panel adhesive: Marlite "C-551" water-based construction adhesive for panel application over porous surfaces.

C. Panel System: 'P2' Per Finish Schedule, Series: Standard FRP - "Marlite Class 1/A" Fiberglass Reinforced Polyester (FRP) Panels, 3/32" thick, 48" wide x full height required. Color: S100G White, smooth matte surface texture. USDA approved for incidental food contact.
1. Panel trim: Extruded PVC, color matching panel color. Provide division moldings as required to complete the installation.
a. Edge - M370
2. Sealant: Marlite "Silicone Sealant", white gunnable silicone sealant.
3. Panel adhesive: Marlite "C-551" water-based construction adhesive for panel application over porous surfaces.

D. Alternate panel spec: Color: S100 S/2/S White, smooth matte surface texture

3.1 Installation

A. Install the FRP system products using panel adhesive in accordance with the manufacturer's instructions and layout as shown in drawings.
1. Install panels plumb, level, true and straight with no distortion; providing a continuous bead of silicone sealant in best joint and trim groove and between trim and adjacent construction.
2. Provide corner trim, closure trim at intersections of dissimilar materials and moldings at abutting panels.

SECTION 07210 - BUILDING INSULATION

1.1 General: Provide building insulation as shown and specified.

2.1 Materials:

A. Extruded polystyrene foam rigid board insulation: Dow Chemical Co., 866-583-2583, internet www.dowbuildingmaterials.com
1. Type: Dow "Styrofoam" Type IV, 1.6 pcf minimum density, 25 psi compressive strength complying with ASTM C 578, R-value equal 5 per inch of thickness. Provide lengths and widths as required to coordinate with space insulated.
2. Perimeter foundation walls: Styrofoam SE, R-value indicated.

B. Glass fiber batt/blanket insulation: Owens Corning Corp., (800) 438-7465, internet www.owenscorning.com.
1. Type: Owens Corning " Thermal Batt" Type I unfaced glass fibers and binders formed into flexible blankets or batts complying with ASTM C665,. Provide lengths and widths required to coordinate with spaces insulated.
2. Exterior walls: Unfaced, R-value/thickness indicated

C. Vapor barrier membrane: Polyethylene, minimum 6 mils thick, complying with ASTM D 4397, maximum permeance rating of 0.13 perm.
1. Joint tape: Pressure sensitive tape designed for sealing joints and penetrations of above and below grade vapor barrier sheets.
2. Mounting tape: Double-faced pressure sensitive tape suitable for mounting vapor barriers to steel framing.

3.1 Installation:

A. General:
1. Install insulation in accordance with manufacturer's recommendations for conditions of installation indicated. Install insulation in single layer of required thickness over entire area to be insulated. Cut and fit tightly around obstructions. Fill all voids.
2. Install exterior wall insulation continuous behind electrical boxes, conduit, piping and ductwork.

B. Foundation perimeter walls and slabs:
1. Install rigid foam insulation vertically from top of slab to frost line or horizontally under slabs, extending a minimum 36" in from exterior walls.
2. Protect insulation from displacement and damage during backfilling and slab placement

C. Exterior Walls:
1. Install batt/blanket insulation full height at exterior wall framing. Use blanket widths and lengths that fill cavities formed by framing members and provide a friction fit between edges of insulation and metal framing members.
2. Provide galvanized wire mesh or metal strapping to provide supplementary support when required to maintain insulation in permanent proper location.

D. Vapor Barriers:
1. Install a single layer of vapor barrier membrane over the interior of exterior metal wall framing after installation of insulation. Secure with double faced tape at wall framing.
2. Provide single unspliced material height. Horizontal joints not acceptable. Minimize vertical joints. Lap vertical joints and secure in place with joints taped. Provide tape sealed contact with door frames, window frames, piping, conduit, ductwork, registers and the vapor barrier.
3. Seal all cuts and penetrations of vapor barrier membrane with tape before installing surface finishes.

SECTION 07240 -EXTERIOR INSULATION AND FINISH SYSTEM (PB)

1.1 General: Provide the exterior insulation and finish system (EIFS) as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. EIMA (EIFS Industry Members Association) Standards and Publications.
a. 101.01, 101.02, 101.03, 101.86, 105.01, 200.02.
b. EIMA "Guideline Specification for Expanded Polystyrene (EPS) Insulation board."

B. Quality Assurance:
1. System components:
a. Produced by a single manufacturer or by manufacturers approved by the EIFS system manufacturer.
b. Fire performance: Flame spread of 25 or less, smoke developed of 450 or less when tested in accordance with ASTM E84.
2. Installer Qualifications: Performed by the system manufacturer or an applicator trained and approved by the system manufacturer. During application, the work shall be inspected by system manufacturer's representative.

C. Environmental conditions: Comply with manufacturer's requirements. Do not install materials during wet or freezing weather.

2.1 Materials

A. Manufacturer: STO Corp., P: (800) 221-2397, internet www.stocorp.com
Strategic Accounts Manager: Ray Redmond, P: (616) 437-2230, rredmond@stocorp.com

B. Exterior insulation and finish system: Sto Class PB "StoTherm ci" EIFS.
1. Air/Moisture barrier: Sto Guard system.
a. Sto RapidGuard for rough opening protection, sheathing joints and inside and outside corners.
b. Sto Guard Mesh: Coated glass fiber fabric reinforcing mesh.
c. Sto Gold Coat: Waterproof Fluid Applied Air/Moisture Barrier
2. Primer/adhesive and base coat: Sto Primer/Adhesive-B, one-component, polymer modified, cement -based factory blended primer/adhesive used to attach insulation board to prepared sheathing substrates and as a base coat in Essence claddings.
3. Insulation board: ASTM C578 Type 1, nominal 1.0 lb/ft^3 expanded polystyrene meeting EIMA Guideline specifications for EPS insulation board.
4. Finish coating: Sto Essence DPR, ready-mixed 100% acrylic-based, textured wall coating.
a. Medium/Fine Sand Finish.
b. Color as indicated on the Architectural drawings from manufacturer's full color range or match custom color.
5. System warranty: 10 year labor and material.

C. Portland cement: ASTM C150, Type I or II, white or gray in color.

D. Water: Clean, potable and free of foreign matter.

E. Reinforcing mesh: Sto open-weave glass fiber fabric with alkaline resistant coating.
1. Standard mesh: Sto Mesh, nominal 4.5 oz/yd^2 fabric.
2. Ultra-High impact mesh: Sto Armor Mat, nominal 15 oz/yd^2 ultra-high impact fabric.
3. Specialty mesh:
a. Sto Detail Mesh, nominal 4.2 oz/yd^2 flexible, symmetrical, interlaced glass fiber fabric.
b. Sto Corner Mat, nominal 7.8 oz/yd^2 pre-creased, heavy-duty, glass fiber fabric.

F. Joint sealants: Polyurethane base elastomeric joint sealant complying with ASTM C920 and Section 07900 requirements.
1. Adhesion: Evaluated in accordance with ASTM C1382.
2. Color: Matching EIFS finish coating color, and visually acceptable to the Architect.

G. Accessories: Provide plastic stops and trim where indicated. Materials shall be compatible with EIFS materials and acceptable to EIFS manufacturer.
1. Starter Track: Rigid PVC plastic track with weepholes and drip edge.

3.1 Mixing

A. Mix materials in accordance with manufacturer's published instructions.
1. Mix with a clean, rust-free high speed mixer to a uniform consistency.
2. No rapid binder, anti-freeze or accelerator additives permitted.

4.1 Installation

A. Preparation:
1. Coordinate installation of roofing membrane, windows, doors and other wall penetrations to provide a continuous exterior wall air/moisture barrier.
2. Coordinate installation of windows, doors and window and door flashing to provide continuous exterior wall air/moisture barrier.
3. Install copings and joint sealants immediately after installation of the EIFS, when EIFS coatings are dry.

B. Installation: Install Sto Guard air/moisture barrier system and exterior insulation and finish system (EIFS) in strict accordance with manufacturer's installation instructions, complying with governing regulations and industry standards applicable to the work.
1. Back wrap exposed board edges with mesh.
2. Provide double wrap or corner mat reinforcing at all inside and outside corners.
3. Provide expansion joints in accordance with manufacturer's recommendations for type of substrates and systems required, and visually acceptable to the Architect.
4. Provide drainable starter track horizontal edge trim as base of wall, above windows and doors openings and beneath windows with concealed flashing.

C. Insulation and adhesive application:
1. Install insulation board with long edge horizontal using running bond pattern. Off set insulation joints with substrate joints. Stagger joints and interlock joints at corners.
2. Apply adhesive to insulation board with a stainless steel trowel notched trowel, providing vertical uniform ribbons of adhesive when board is installed. Mount insulation board on substrate. Level, align and tamp insulation in place. Provide uniform contact and bond with joints tightly butted. Rasp edges and high areas as required to produce a level, plane surface.

D. Base coat and reinforcing mesh application:
1. Apply detail mesh at corners of windows, doors, and all penetrations through the EIFS.
2. Standard mesh: Apply base coat over insulation board to a uniform 1/8 inch thickness, including high impact mesh where indicated. Embed standard reinforcing mesh into wet adhesive, lap edges at seams. Smooth surface until mesh is not visible. Allow to base coat to dry.
3. Ultra-High impact mesh: Apply base coat over insulation board to a uniform 1/8 inch thickness. Fully embed ultra-high impact reinforcing mesh into wet adhesive, butt edges at seams. Smooth surface until mesh is not visible. Allow to base coat to dry. Locate at 4'-0" wide perimeter of the rear service door to 6'-0" above grade and as indicated on Architectural drawings.

E. Apply finish coating continuously in one operation to the entire wall surface Provide a uniform finished appearance. Level and texture to the specified finish texture.

F. Install joint sealants at perimeter joints and joints within the system using elastomeric joint sealants, in accordance with drawing details and sealant manufacturer's recommendations.

SECTION 07250 - WEATHER BARRIERS

1.1 Section Includes

A. Weather barrier membrane
B. Seam Tape
C. Flashing
D. Fasteners

1.2 References

A. ASTM International
1. ASTM C920; Standard Specification for Elastomeric Joint Sealants
2. ASTM C1193; Standard Guide for Use of Joint Sealants
3. ASTM D882; Test Method for Tensile Properties of Thin Plastic Sheeting
4. ASTM D1117; Standard Guide for Evaluating Non-woven Fabrics
5. ASTM E84; Test Method for Surface Burning Characteristics of Building Materials
6. ASTM E96; Test Method for Water Vapor Transmission of Materials
7. ASTM E1677; Specification for Air Retarder Material or System for Framed Building Walls.
8. ASTM E2178; Test Method for Air Permeance of Building Materials

B. AATCC - American Association of Textile Chemists and Colorists
1. Test Method 127 Water Resistance: Hydrostatic Pressure Test

C. TAPPI
1. Test Method T-410; Grams or Paper and Paperboard (Weight per Unit Area)
2. Test Method T-460; Air Resistance (Gurley Hill Method)

1.3 Quality Assurance

A. Qualifications
1. Installer shall have experience with installation of commercial weather barrier assemblies under similar conditions.
2. Installation shall be in accordance with weather barrier manufacturer's installation guidelines and recommendations.
3. Source Limitations: Provide commercial weather barrier and accessory materials produced by single manufacturer.

1.4 Delivery, Storage and Handling

A. Refer to Section 01400 Quality Requirements.
B. Deliver weather barrier materials and components in manufacturer's original, unopened, undamaged containers with identification labels intact.
C. Store weather barrier materials as recommended by weather barrier manufacturer.

1.5 Scheduling

A. Review requirements for sequencing of installation of weather barrier assembly with installation of windows, doors, louvers and flashings to provide a weather-tight barrier assembly.
B. Schedule installation of weather barrier materials and exterior cladding within 9 months of weather barrier assembly installation.

2.1 Manufacturer

A. DuPont Building Innovations; 4417 Lancaster Pike, Chestnut Run Plaza 721, Wilmington, D19805; 1.800.44TYVEK (8-9835); http://construction tyvek.com

2.2 Materials

A. Basis of Design: Hi-performance, spunbonded polyolefin, non-woven, non perforated, weather barrier is based upon DuPont Tyvek CommercialWrap and related assembly components.

B. Performance Characteristics:
1. Air Penetration: 0.001 CFM/feet squared at 75 Pa, when tested in accordance with ASTM E2178. Type I per ASTM E1677.
2. Water Vapor Transmission: 28 perms, when tested in accordance with ASTM E96 Method B.
3. Water Penetration Resistance: 280 cm when tested in accordance with AATCC Test Method 127.
4. Basis Weight: 2.7 oz/yard squared, when tested in accordance with TAPPI Test Method T-410.
5. Air Resistance: Air infiltration at >1500 seconds, when tested in accordance with TAPPI Test Method T-460.
6. Tensile Strength: 38/35 lbs/inch, when tested in accordance with ASTM D882, Method A.
7. Tear Resistance: 12/10 lbs., when tested in accordance with ASTM D1117.
8. Surface Burning Characteristics: Class A, when tested in accordance with ASTM E 84. Flame Spread: 10, Smoke Developed: 10.

2.3 Accessories

A. Seam Tape: 3 inch wide, DuPont Tyvek Tape for commercial applications.

B. Fasteners:
1. For steel frame construction - DuPont Tyvek Wrap Cap Screws, as manufactured by DuPont Building Innovations: 1-5/8" rust resistant screw with 2-inch diameter plastic cap or manufacturer approved 1-1/4" or 2" metal gasketed washer.
2. For wood frame construction - Tyvek Wrap Caps, as manufactured by DuPont Building Innovations: #4 nails with large 1-inch plastic cap fasteners.
3. For masonry construction - masonry tap-con fasteners with Tyvek Wrap Caps as manufactured by DuPont Building Innovations: 2 inch diameter plastic cap fasteners.

C. Adhesives:
1. Provide adhesive recommended by weather barrier manufacturer.
2. Products:
a. Liquid Nails LN-109
b. Polyglaze SM 5700
c. Denso Butyl Liquid
d. 3M High Strength 90
e. SIA 655
f. Adhesives recommended by the weather barrier manufacturer.

D. Primers:
1. Provide flashing manufacturer recommended primer to assist in adhesion between substrate and flashing.
2. Product:
a. 3M High Strength 90
b. Denso Butyl Spray
c. SIA 655
d. Permagrip 105
e. ITW TACC Sta' Put SPH
f. Primers recommended by the flashing manufacturer.

E. Flashing:
1. DuPont FlexWrap, as manufactured by DuPont Building Innovations: flexible membrane flashing materials for window openings and penetrations.
2. DuPont Straightflash, as manufactured by DuPont Building Innovations: straight flashing membrane materials for flashing windows and doors and sealing penetrations such as masonry ties, etc.
3. DuPont Straightflash VF, as manufactured by DuPont Building Innovations: dual-sided straight flashing membrane materials for brick mold and non-flanged windows and doors.

3.1 Examination
A. Verify substrate and surface conditions are in accordance with weather barrier manufacturer recommended tolerances prior to installation of weather barrier and accessories.

3.2 Installation - Weather Barrier
A. Install weather barrier per regional requirements in accordance with manufacturer recommendations.
B Install weather barrier prior to installation of windows and doors.
C. Start weather barrier installation at a building corner, leaving 6-12 inches of weather barrier extended beyond corner to overlap.
D. Install weather barrier in a horizontal manner starting at the lower portion of the wall surface with subsequent layers installed in a shingling manner to overlap lower layers. Maintain weather barrier plumb and level.
E. Sill Plate Interface: Extend lower edge of weather barrier over sill plate interface 3-6 inches. Secure to foundation with elastomeric sealant as recommended by weather barrier manufacturer.
F. Window and Door Openings: Extend weather barrier completely over openings.
G. Overlap weather barrier
1. Exterior corners: minimum 12 inches.
2. Seams: minimum 6 inches.
H. Weather barrier Attachment:
1. For steel or wood frame construction - Attach weather barrier to studs through exterior sheathing. Secure using weather barrier manufacturer recommended fasteners, space 12-18 inches vertically on center along stud line, and 24 inch on center, maximum horizontally.
2. For masonry construction - Attach weather barrier to masonry. Secure using weather barrier mfr recommended fasteners, spaced 12-18 inches vertically on center and 24 inches maximum horizontally. Weather barrier may be temporarily attached to masonry using recommended adhesive, placed in vertical strips spaced 24 inches o.c., when coordinated on the project site.
I. Apply 4 inch by 7 inch piece of DuPont StraightFlash to weather barrier membrane prior to the installation cladding anchors.

3.3 Seaming

A. Seal seams of weather barrier with seam tape at all vertical and horizontal overlapping seams.
B. Seal any tears or cuts as recommended by weather barrier manufacturer.

3.4 Opening Preparation (for use with non-flanged windows - all cladding types)

A. Flush cut weather barrier at edge of sheathing around full perimeter of opening.
B. Cut a head flap at 45-degree angle in the weather barrier at window head to expose 8 inches of sheathing. Temporarily secure weather barrier flap away from sheathing with tape.

3.5 Flashing (for use with non-flanged windows - all cladding types)

A. Cut 9-inch wide DuPont FlexWrap a min of 12 inches longer than width of sill rough opening. Apply primer as required by mfr.
B. Cover horizontal sill by aligning DuPont FlexWrap edge within side edge of sill. Adhere to rough opening across sill and up jambs a minimum of 6 inches. Secure flashing tightly into corners by working in along the sill before a adhering up the jambs.
C. Fan DuPont FlexWrap at bottom corners onto face of wall. Firmly press into place. Mechanically fasten fanned edges.
D. Apply 9-inch wide strips of DuPont StraightFlash at jambs. Align flashing with interior edge of jamb framing. Start DuPont StraightFlash at head of opening and lap sill flashing down to the sill. Spray-apply primer to top 6 inches of jambs and exposed sheathing.
E. Install DuPont FlexWrap at opening head using same installation procedures used at sill. Overlap jamb flashing min 2 inches.
F. Coordinate flashing with window installation.
G. On exterior, install backer-rod in joint between window frame and flashed rough framing. Apply sealant at jambs and head. leaving sill unsealed. Apply sealants in accordance with sealant manufacturer's instructions and ASTM C 1193.
H. Position weather barrier head flap across head flashing. Adhere using 4-inch wide DuPont StraightFlash over the 45-degree seams.
I. Tape top of window in accordance with manufacturer recommendations.
J. On interior, install backer rod in joint between frame of window and flashed rough framing. Apply sealant around entire window to create air seal. Apply sealant in accordance with sealant manufacturer's instructions and ASTM C 1193.

3.6 Protection
A. Protect installed weather barrier from damage.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G012

SECTION 07512 - ROOFING SYSTEM REPAIR

1.1 General: When penetration of the existing roofing system is required to accommodate new construction, perform necessary roofing system repair.

A. Coordination: Before starting work, verify with the Tenant's Construction Manager and the Owner the following:
1. Existing roof system materials and installation methods.
2. Repair work responsibilities and warranty requirements. To maintain original warranty, where provided use original roof contractor.

B. Qualifications: Repair work shall be performed only by an experienced roofing installer approved or licensed by the existing roofing system materials manufacturer; with not less than five years of successful experience installing and repairing roofing systems similar to this projects existing roofing system.

2.1 Materials:

A. Provide and install only materials approved and recommended by the roofing manufacturer for repairing the existing roofing system.

3.1 Installation:

A. Preparation: Inspect roof surface conditions with roof manufacturer's representative to verify extent and location of any other repairs required to ensure a watertight roofing system upon completion of the repair work.

B. Make necessary repairs. Match existing roof slope, insulation materials and roofing membrane materials, except as otherwise approved by the existing roofing system manufacturer to accommodate new construction and repair work.

C. Install curb flashing furnished by mechanical and electrical trades for new roof top equipment.

SECTION 07540 - THERMOPLASTIC MEMBRANE (PVC) ROOFING

1.1 General: Provide the thermoplastic membrane (PVC) roofing system as shown and specified.

A. Standards: Materials and construction shall conform to following:
1. ASTM D5036 "Application of Adhered Poly(Vinyl Chloride) Sheet Roofing."
2. FM 1-29 Loss Prevention Data Adhered or Mechanically Attached Single Ply Membrane Roof Systems."
3. NRCA "Single-Ply Roofing Membrane."
4. UL "790 - Tests for Fire Resistance of Roof Covering Materials."

B. Installer Qualifications: An experienced roofing installer approved by roofing system manufacturer and with not less than five years of successful experience installing membrane roofing systems similar to those required for this project.

C. Deliver, store and handle roof system materials in accordance with manufacturer's recommendations to avoid damage and deterioration.
1. Comply with manufacturer's recommendations for handling and protection during installation.

D. Install roofing work only when weather conditions are in compliance with manufacturer's specific environmental requirements and conditions will permit work to be performed in accordance with manufacturer's recommendations and warranty requirements.
1. Protect adjacent materials and surfaces from damage and soiling during roofing system installation.
2. Provide special protection on completed roofing work.
3. Protect paving and structure walls adjacent to hoists before starting work.
4. Do not overload the building structure with storage of materials or installation equipment on the substrate decking.

E. Warranty
1. Contractor and roof system installer shall jointly warrant roofing materials and installation for a period of two years from the date of Substantial Completion. Warranty shall include roofing membrane, flashing, roof insulation, roofing accessories and sheet metal work provided under Section 07600.
2. Manufacturer's warranty: Submit executed copy of roofing system manufacturer's 15 year total system warranty, including labor and materials for the entire roof system. Including perimeter edge metal, Section 07600 Flashing & Sheet Metal

2.1 Materials

A. Manufacturer: Duro-Last Roofing, Inc, (614) 370-5569, Mike Suman, www.duro-last.com
1. Basis of Design Product Roofing System
a. Thermoplastic single ply membrane roofing system: DL Membrane (PVC) fully adhered, smooth surface, UL Class A fire-rated single ply membrane roofing system.
b. Thermoplastic fiber reinforced PVC membrane, not less than 40 mils (.040), complying with ASTM D4434 and membrane manufacturer's published physical properties.

B. Comparable Alternate Roof Manufacturers:
1. Versico Roofing Systems, (815) 341-3770, Chris Shermach, chris.shermach@versico.com
a. VersiFlex PVC Adhered System
2. Other comparable alternates can be considered when approved by Arch PM and Chipotle DM/CM.

C. The roof covering design must resist a wind load of 100 mph, Exposure C and shall resist impact damage based on results of tests based on the results of tests conducted in accordance with ASTM D 3746, ASTM D 4272, CGSB 37-GP-52M or FM 4470
1. Insulation cover board: Georgia-Pacific Corp. (800) 284-5347, internet www.gp.com, "Dens-Deck" nonstructural fiberglass- faced, silicone-treated gypsum core panels, 1/2"" thickness.
2. Roof insulation: Rigid closed cell polyisocyanurate boards approved by the membrane manufacturer; complying with ASTM C1289, Type II, minimum 20 psi compressive strength, aged R-value equal 5.6 per inch of thickness.
a. Provide a double layer installation. Minimum total R-value as indicated on plans.
b. Specified perimeter edge metal shall be compliant with International Building Code ANSI / SPRI ES-1, ER2 testing requirements.
3. Flashing: Roof system manufacturer's standard sheet flashing of same material, type, and color as sheet membrane. Specified perimeter edge metal will be compliant with International Building Code ANSI / SPRI ES-1, RE2 testing requirements.
4. Membrane Bonding Adhesive: Roof system manufacturer's standard membrane bonding adhesive.
5. Insulation and Cover Board Adhesive: Dow Chemical Company, (888) 868-1183, internet www.flexibeproducts.com, "INSTA-STIK Professional Roof Insulation Adhesive", a single component, moisture cured polyurethane adhesive.
6. Fasteners: Roof system manufacturer's standard fasteners for project conditions indicated.
7. Accessories: Roof system manufacturer's recommended pourable sealers, preformed penetration flashing, preformed corner flashing, seam caulk, termination bars and other accessories required for substrate surfaces and installation conditions indicated.
8. Traffic walkways: Duro-Last Roof Track II walkway pads.3.1Installation

3.1 Installation

A. Preparation:
1. Clean substrate surfaces of debris and other substances detrimental to roofing installation.
2. Correct unsatisfactory conditions before starting roofing. Roof deck surface conditions shall comply with manufacturer's requirements and be acceptable to the roofing system installer.

B. Installation:
1. General: Provide roofing system materials and installation complying with roofing system manufacturer's instructions and governing codes and regulations.
a. Mix and apply roof insulation and cover board adhesive in strict accordance with the adhesive manufacturer's installation instructions. Dispense adhesive at manufacturer's recommended application rate using approved dispensing equipment.
2. Roof insulation.
a. Extend insulation full thickness over entire surface to be insulated. Cut and fit around obstructions; fill all voids with insulation. Provide saddles and tapered edges as required to provide positive proper drainage.
b. Install and secure in place with insulation adhesive, a double layer of insulation units of the required thickness. Run long joints of insulation in continuous straight lines, perpendicular to roof slope, with end joints staggered between rows. Stagger joints of each layer of insulation. Butt edges to moderate contact. Limit joints between adjacent units to maximum 1/4".
3. Insulation cover board: Install and secure in place with insulation adhesive a single layer of insulation cover board on installed roof insulation. Secure cover board in accordance with membrane manufacturer's recommendations. Stagger joints with joints of roof insulation.
4. Thermoplastic membrane: Comply with membrane manufacturer's instructions and recommendations for handling and installing single ply membrane roofing.
a. Unroll and position roofing sheet membrane without stretching. Align top sheet with pr-marked lines on bottom sheet. Allow membrane to "relax" for at least 30 minutes before adhering, splicing and flashing.
b. Adhere membrane to insulation cover board with bonding adhesive. Broom bonded membrane to achieve maximum contact.
c. Join membrane seams using approved heat welding equipment. Check all splices for voids and repair voids with heat gun and roller.
d. When required, mechanically fasten membrane at roof perimeter, curb flashing and similar penetrations in accordance with manufacturer's installation instructions.
e. Flash and make weathertight all equipment curbs, pipes, conduits, drains and other penetrations or projections through sheet roofing using roofing system manufacturer's recommended flashing materials, accessories and procedures.
5. Install roof accessories and traffic walkways in accordance with manufacturer's instructions.
6. Install sheet metal work furnished under section 07600.

SECTION 07600 - FLASHING AND SHEET METAL

General:

A. Standards: Materials and construction shall conform to following:
1. SMACNA "Architectural sheet Metal Manual- 1993."
B. Installation: Performed under Section 07540 work.

1.1 Pre-manufactured perimeter edge metal and accessories

Manufacturer: Duro-Last Roofing / Exceptional Metals, Inc, (800) 248-0280, Jason Dark, www.Duro-Last.com

A. Duro-Last / Exceptional Metals Snap Coping made of 24-gauge galvalume, cover provided with Kynar architectural finish providing a 35 year finish warranty. Meets ANSI/SPRI ES-1 2003 method RE-2 testing requirements. (Color - Refer to Exterior Elevations)
B. Duro-Last / Exceptional Metals Vinyl backed scupper. Scupper profile & size indicated Fig 1-20.

1.2 General: Miscellaneous sheet metal

A. Standards: Materials and construction shall conform to following:
1. SMACNA "Architectural sheet Metal Manual- 1993."
B. Installation: Performed under Section 07540 work.

2.1 Materials:

A. Galvanized steel: ASTM A653 commercial quality sheet steel with 0.2% copper, G90 hot-dip galvanized. Gage indicated.
1. Scuppers: Minimum 16 gage.
2. Coping/Wall caps: Minimum 18 gage.
B. Aluminum sheet: ASTM B209 alloy 3003, temper as required for forming and performance. Thickness indicated.
1. Conductor Boxes: Minimum 0.040"thickness.
2. Downspouts: Minimum 0.025"thickness.
C. Joint sealers: One-component silicone elastomeric joint sealant complying with ASTM C920. Color matched to sheet metal finish.
D. Metal accessories: Provide sheet metal fasteners, clips, straps, anchoring devices and similar accessory units as required for installation of work, matching or compatible with material installed, non-corrosive, size and gage as required for performance and acceptable to the Architect.
E. Fabrication: Shop fabricate sheet metal work to comply with profiles and sizes indicated and to comply with standard industry standards as shown by SMACNA in the "Architectural Sheet Metal Manual."
1. Conductor boxes: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-25.
2. Scuppers: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated Fig 1-20.
3. Downspouts: SMACNA Chapter 1 - Roof Drainage Systems. Profile and size indicated. Installation Fig. 1-31 with strap hanger Fig. 1-35.
4. Formed coping/wall caps: SMACNA Chapter 3 - Copings. Design Fig 3-1. Profile and size indicated with Fig. 3-3 butt joints and concealed back-up plates. Install formed copings with continuous cleat fasteners similar to Fig 3-1 at exposed face and screw fasteners with washers space maximum 24" on center at roof side.

3.1 Installation:

A. Preparation: Coordinate sheet metal work with other work for the correct sequencing of items which make up the entire roof system of weatherproofing and rain drainage:
B. Installation: Comply with SMACNA "Architectural Sheet Metal Manual" recommendations, drawing details and approved shop drawings for installation of the work.
1. Anchor sheet metal items securely in place by methods indicated, providing for thermal expansion. Conceal fasteners and expansion provisions whenever possible. Install joint sealants where required.
2. Set units true to lines and levels indicated. Install work with sealed laps, joints and seams that will be permanently watertight and weatherproof. Bed flanges of sheet metal work in thick coat of roofing cement or sealant compatible with roofing membrane.
3. Separate sheet metal work from dissimilar metals and treated wood materials. Provide rosin-sized paper slipsheet over treated wood.
4. Fabricate, support and anchor conductor boxes and downspouts to withstand thermal expansion, stresses and full loading by ice or water without damage, deterioration or leakage.

SECTION 076113 - SHEET METAL WALL PANELS

1.1 General:

A. Standards:
1. Furnish all labor, material, tools, equipment and services for all preformed fascia and wall panels as indicated, in accord with provisions of Contract Documents.
2. Completely coordinate with work of all other trades.
3. Although such work is not specifically indicated, furnish and install all supplementary or miscellaneous items, appurtenances and devices incidental to or necessary for a sound, secure and complete installation.

B. Related work specified elsewhere:

1. Structural steel: Section 05100
2. Steel joists: Section 05200 or 05400
3. Flashing and sheet metal: Section 07600

1.2 Quality Assurance:

A. Applicable standards:
1. SMACNA: "Architectural Sheet Metal Manual" Sheet Metal and Air Conditioning Contractors National Association, Inc.
2. AISC."Steel Construction Manual" American Institute of Steel Construction.
3. AISI: "Cold Form Steel Design Manual: American Iron and Steel Institute.
4. ASTM A792-83-AZ50: Specifications for steel sheet, aluminum-zinc alloy coated (galvanized) by the hot dip process, general requirements (Galvalume).

B. Manufacturer's qualifications:
1. Manufacturer has a minimum of three years experience in manufacturing metal wall systems of this nature. Panels specified in this section shall be produced in a factory environment (not job site roll formed) with fixed base roll forming equipment assuring the highest level of quality control. A letter from the manufacturer certifying compliance will accompany the product material submittals.

1.3 Product Delivery, Storage and Handling

A. Delivery: Deliver metal wall system to job site properly packaged to provide protection against transportation damage.
B. Handling: Exercise extreme care in unloading, storing and erecting metal wall system to prevent bending, warping, twisting and surface damage.
C. Storage: Store all materials and accessories above ground on well skidded platforms. Store under waterproof covering. Provide proper ventilation of metal wall system to prevent condensation build up between each panel or trim/ flashing component.

2.1 Materials

A. Metal wall system profile:
1. Shadow Rib: 3 inch deep x 16 inch width with 1 1/2 inch deep x 5 1/4 inch wide fluting
B. Metal wall system style:
1. Fluted face
2. Concealed fasteners
C. Gauge: 24 gauge
D. Substrate: Per Plans
E. Texture: Smooth
F. Finish: Premium thermoset silicone polyester (20 year warranty)
G. Color: Polar White, to be painted per Exterior Elevations
H. Acceptable Manufacturer: MBCI Houston, Texas (281) 445-8555.

3.1 Surface Conditions

A. Examination:
1. Inspect installed work of other trades and verify that such work is complete to a point where this work may continue.
2. Verify that installation may be made in accordance with approved shop drawings and manufacturer's instructions.

3.2 Installation

A. Install metal wall system system so that it is weathertight, without waves, warps, buckles, fastening stresses or distortion.
B. Install metal wall system in accordance with manufacturer's instructions and shop drawings.
C. Provide concealed anchors at all panel attachment locations.
D. Install panels plumb, level and straight with seams parallel, conforming to design as indicated.

3.3 Cleaning, Protection

A. Dispose of excess materials and remove debris from site.
B. Clean work in accordance with manufacturer's recommendations.
C. Protect work against damage until final acceptance. Replace or repair to the satisfaction of the architect and work that becomes damaged prior to final acceptance.
D. Touch up minor scratches and abrasions.

3.4 Field Painting

A. Refer to section 09900 on G017
B. Follow manufacturer's technical bulletin for Precoated Signature 200 MBCI wall panels.

Section 07900 – JOINT SEALERS

1.1 General: Provide joint sealers as shown and specified.

A. Standards:Comply with ASTM C 920 requirements.

B. Application: Performed by skilled, experienced joint sealer applicators.

2.1 Materials:

A. Poly urethane sealants:
1. Tremco Commercial Sealants (800) 321-7906, internet www.tremcosealants.com,
a. "Dymonic FC" One component, fast skinning, Low Modulus Polyurethane.
b. "Dymeric 240 FC" Multi Component, gun grade, chemically curing, tintable fast setting polyurethane sealant.
2. Sonneborn, (724) 756-9582, internet www.sonneborn.com
a. Color pack for polyurethane multi component, gun grade chemically curing sealant.

B. Silicone Sealants:
1. General Electric Silicones, (800) 295-2392, internet www.gesilicones.com
a. "SCS1700 Sanitary – Mold/Mildew Resistant Silicone", one component 100% silicone, fungicidal based sealant.
b. "SCS2700 Silpruf Silicone" one component medium modulus, natural cure silicone all purpose sealant.
c. "Silglaze II SCS2800- Glazing Sealant" one component, 100% silicone based sealer.
d. "GE Paintable Silicone" one component paintable silicone.
e. "SCS1009 Silicone Sealant" one-component acetoxy silicone for general purpose sealing and bonding
2. Dow Corning Silicones, (989)496-4000, www.dowcorning.com
a. "Dow 795" – one component, medium modulus, natural cure silicone.

C. Firestopping Sealants: 3M Fire Protection Products, (800) 328-1687, internet www.3M.com/firstop
1. "3M Fire Barrier CP 25WB+ Caulk" or approved equal

D. Joint backing: Non-absorptive, non-staining compressible, non-gassing, polyethylene foam backer rod compatible with joint sealants.

3.1 Installation:

A. Preparation: Clean and prepare joints prior to installing sealers:
1. Wipe shipping oils from surfaces to be sealed. Remove protective films and/or install joint backer rod if joint is larger than ¼" in width.

B. Installation: Install joint sealant materials in strict accordance with manufacturer's installation instructions.
1. Apply sealants in a uniform, continuous bead without gaps or air pockets. Hand tool and finish all joints so that a smooth, small, lip free uniform line is created along the substrate being shot. Remove any excess materials from tooled edges and ends of joint.
2. Install joint sealants to a depth no more than ½ the width of the joint.
3. Install sealants by proven techniques that result in sealants directly contacting and fully wetting joint substrates, completely filling recesses provided for each joint configuration, and providing uniform, cross-sectional shapes and depths relative to joint widths which allow optimum sealant movement capability.
4. Immediately, after sealant application, and prior to time skinning or curing begins, tool sealants to form smooth, uniform beads of configuration indicated to eliminate air pockets, and to ensure contact and adhesion of sealant with sides of joint. Remove excess sealants from surfaces adjacent to joint. Do not use tooling agents which discolor sealants or adjacent surfaces or are not approved by sealant manufacturer.
5. Clean off excess sealants or sealant smears adjacent to joints as work progresses by methods and with cleaning materials approved by manufacturers of joint sealers and of products in which joints occur.

4.1 Sealant Schedule:

A. Kitchen Area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Ceiling grid to FRP wall panels
2. Base of FRP wall panels to T.O. specified base material.
3. Walk in cooler walls to FRP wall panels.
4. Stainless closure pieces at cooler walls to FRP wall panels.
5. FRP/stainless corner guards to FRP wall panels.
6. Ceiling tile pipe penetrations.
7. Wall pipe penetrations and/or escutcheons perimeters. (water & gas lines).
8. Mop sink stainless surround perimeter to walls.
9. FRP closure panel, at top of cooler, to cooler walls.
10. FRP wall panels to hollow metal door frames.
11. Coke line bundle to PVC cap.
12. FRP inside corner pieces to FRP wall panels. Both sides of corner piece.
13. Battery backup cover panel to FRP.
14. Faucet's to FRP wall panels.
15. FRP wall panels to quarry tile cove base.
16. FRP to aluminum plate at walk thru.
17. Menu board light bracket to ceiling.
18. Mop sink base at quarry tile.
19. All sinks (multi-compartment, hand, mop and prep) to FRP/tile walls.
20. Paper towel dispensers & soap dispensers to FRP/tile walls.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Stainless closer pieces, at sides of cooler walls - to cooler walls.
2. Stainless or aluminum plate closure pieces to diamond plate at cooler walls.
3. Diamond plate panel seam joints.
4. Diamond plate perimeter to cooler walls.
5. Base of diamond plate to quarry tile cove base.
6. Stainless closure panel, at top of cooler walls, to cooler walls.
7. Top of quarry tile cove base to cooler walls at inside of cooler.
8. Cooler wall/diamond plate penetrations.
9. Cooler door hinges and handles to diamond plate. DO NOT caulk door locking unit.
10. Stainless wrap at hollow metal door frame.
11. Stainless mop surround to stainless corners on mop sink.
12. Base of stainless corner pieces to schlutter strip at base.
13. Exit door threshold perimeters. To frame and floor, interior and exterior.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
1. Base of hollow metal door jambs to quarry tile floor.

B. Managers Office:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Ceiling grid to FRP wall panels.
2. Perimeter of manager's desk to FRP wall panels.
3. Hollow metal door frame to FRP wall panels.
4. Top and ends of coat hanger bracket to FRP walls.
5. Base of FRP wall panels to quarry tile base.
6. Ceiling tile wire/pipe penetrations.
7. FRP inside corners to FRP wall panels. Both sides of corner piece.
8. Base of FRP wall panels to quarry tile.

- Provide a continuous bead of black or light bronze (use color of safe) GE SCS2000 silicone at the following locations:
1. Base of safe to floor.

C. Cooking Area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Top of wall tile to sheetrock ceiling.
2. Ceiling diffusers perimeters to sheetrock ceiling.
3. Ceiling pipe penetrations.
4. Wall tile to aluminum walk thru surround.
5. Tile wall penetrations/escutcheons perimeters.
6. FRP wall panels to sheetrock ceilings.
7. FRP wall panels to aluminum end wall plates.
8. FRP inside corners to FRP wall panels. Both sides of corner piece.
9. Sink to white wall tile.
10. Paper towel dispenser/soap dispenser to white tile.
11. POS/Serving counter to wall tile.
12. Stainless shelf behind grill to wall tile.
13. Faucets to ceramic wall tile.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Joint between hood and closure skirt.
2. Joint between hood support and hood. Both sides.
3. Connection joint between stainless shelf behind grill.
4. Hood to tile walls & sheetrock ceiling.
5. Hood gusset to wall tile on both sides.
6. Sink to bronze wall tile.
7. Paper towl dispenser/soap dispenser to bronze tile.
8. DML counter to bronze tile.

- Provide a continuous bead of dark gray GE SCS2000 at the following locations:
1. Base of equipment to concrete curbs/quarry tile.

- Provide a continuous bead of bronze GE SCS2097 at the following locations:
1. Ceramic tile inside corners.
2. Ceramic tile to aluminum end wall plates.

D. Restrooms:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Top of FRP to sheetrock ceiling or top of FRP trim to sheetrock wall.
2. Perimeter of toilets/urinals to floor or FRP.
3. Perimeter of mirror to FRP.
4. Sink to wall.
5. Perimeter of paper towel/garbage unit to wall.
6. Toilet paper/napkin disposals units to walls.
7. Stainless shelf to wall.
8. Wall penetrations under sink and or escutcheons to perimeters.
9. Hollow metal door frames to FRP.
10. Base of FRP wall panels to top of wall base.
11. FRP inside corners to FRP wall panels.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
1. Base of black rubber wall base to floor.

- Provide a continuous bead of dark gray GE SCS2000 silicone at the following locations:
1. Base of hollow metal door frames to floor.

E. Dining area:
- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Wall tile to sheetrock walls.
2. Perimeter of aluminum storefront/windows/entrances to sheetrock walls.
3. Wainscot wall panels (Stonewood or other) to painted walls.
4. Diffuser/louvers perimeters to sheetrock walls.
5. Hollow metal door frames to painted walls - if needed.
6. Frame of service line counter to tile (joint to be caulked behind front face panels of counter).
7. Wall tile at serving line wall to POS counter.

- Provide a continuous bead of black GE SCS2000 silicone at the following locations:
1. Base of black rubber to floor (concrete or quarry tile) and gyp. bd. wall.
2. Wainscot (Stonewood or other) wall panels to sill of aluminum storefront/ windows.
3. Vertical joints of wainscot (Stonewood or other) wall panels to frames/painted walls/tile (ONLY if joint is uneven or plywood is showing).
4. Stonewood panels at serve line.

- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Base of garbage surround to floor.

- Provide a continuous bead of Dow 795 silicone at the following locations:
1. Sill of aluminum storefronts to concrete or tile floor. Color to be determined per store to match storefront (Charcoal/Anodized Aluminum/Dark Bronze).

F. Utensil Counter:
- Provide a continuous bead of aluminum GE SCS1009 silicone at the following locations:
1. Stainless countertop to backsplash. Horizontal & vertical joints.
2. Base of Coke machine to countertop.
3. Perimeter of tea drain tray to countertop.
4. Stainless backsplash to white tile walls/painted walls.

- Provide a continuous bead of white GE SCS1700 silicone at the following locations:
1. Coke line bundle to PVC cap.

G. Fire Rated Walls:
- Provide a continuous bead of 3M 25WB+ at the following locations:
1. Wall/ceiling penetrations in rated walls.

H. Exterior Joints:
- Provide a continuous bead of Tremco Dymeric limestone urethane sealant at the following locations:
1. Sidewalk/concrete expansion joints.

- Provide a continuous bead of Dow 795 silicone or Tremco Dymeric 240 FC at the following locations:
1. Hollow metal door frames.
2. EIFS to abutting services.
3. Penetrations in EIFS.
4. Face brick or block control joints.
5. Perimeter of Aluminum Storefronts.
*Colors to be determined per store to match adjacent material colors. Verify with Chipotle Construction Manager and Architect.
- For "Fog" EIFS use Tremco - "Natural White"
- For "Knight's Armor" EIFS use Sonneborn - "Charcoal Gray" #276-U
- For white brick use Tremco - "China White"
- Provide a continuous bead of aluminum GE SCS1009 silicone at the following location:
1. CO2 fill port stainless box.
2. Faucet for hose. (Please note: color to be determined per store. Verify with Chipotle Construction Manager and Architect).

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: JBA
Checked: JB

Project No.

20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G013

DIVISION 8 - DOORS AND WINDOWS

SECTION 08110 - STEEL DOORS AND FRAMES

1.1 General: Tenant to provide steel doors and frames as shown and specified.

A. Standards: Materials and construction shall conform to the following:
1. ANSI A250.8-2009 "Specifications for Standard Steel Doors and Frames."
2. ANSI A250.11-01 "Erection Instructions for Steel Frames."
3. SDI 122-99 " Installation for Standard Steel doors and Frames.

B. Manufacturer: A member of the Steel Door Institute (SDI).

2.1 Materials:

A. Steel Doors:
1. Interior: Heavy-duty Level 2, physical performance B, Model 2 seamless construction, ASTM A1008, 18 gage cold-rolled steel face sheets, manufacturer's standard core.

2. Exterior: Extra heavy-duty Level 3, physical performance A, Model 2 seamless construction, ASTM A1008, 16 gage cold-rolled steel face sheets; tops and bottoms closed with flush galvanized steel caps, manufacturer's standard plastic foam insulating core.

B. Steel Frames: ASTM A1008, 16 gage cold-rolled steel.
1. Provide combination buck, jamb and trim type frames for 1-3/4" thick doors, unless otherwise indicated.
2. Interior and exterior frames: Set-up welded type with mitered corners, reinforced, fully seam welded with exposed welds ground smooth.

C. Door and frame fabrication:
1. Provide cutouts for mortised hardware, accurately located and made to fit hardware. Provide closer reinforcement for all doors with surface mounted door closers.
2. Punch frames and factory install rubber door silencers.
3. Provide minimum three anchors of suitable design for each jamb.
4. Provide floor clip on bottom of each jamb. Provide angle spreaders at bottom of each set-up frame.

D. Shop painting: Clean and paint exposed surfaces of steel door and frame units. Apply one baked-on shop coat of rust-inhibitive prime paint in accordance with ANSI A250.10, unless doors and frames are used at the restrooms or as indicated on door hardware and finish schedule. Provide a uniformly finished surface ready to receive finish paint.

3.1 Installation:

A. Install frames plumb, level, rigid, and in true alignment as recommended in ANSI A250.11.

B. Install doors plumb and in true alignment and fastened to achieve the maximum operational effectiveness and appearance as recommended in SDI 122.

SECTION 084113 - ALUMINUM-FRAMED ENTRANCES AND STOREFRONTS

1.1 General: Provide aluminum entrances and storefronts as shown and specified.

1.2 Related Documents:

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this section.

B. Standards: Materials and construction shall conform to the following:
1. AAMA SFM-1-87 "Aluminum Storefront and Entrance Manual."

1.3 Summary:

A. Section Includes:
1. Kawneer Architectural Aluminum Storefront Systems, including perimeter trims, stools, accessories, shims and anchors, and perimeter sealing of storefront units.
a. Types of Kawneer Aluminum Storefront include:
(1.) Trifab 601T Storefront System - 2" x 6" nominal dimension; Thermal; Center-Set
(2.) Trifab VG 451T Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set

2. Kawneer Aluminum Entrances, glass and glazing, and components
a. Types of Kawneer Aluminum Entrances include:
(1.) 500 Swing Door; Wide stile, 5" vertical face dimension, 1-3/4" depth, high traffic applications or as indicated on Drawings.

3. Kawneer Tube for Feature Exterior Slat Wall

4. Alternate Storefront Systems only when approved by Arch PM and Chipotle DM.
a. YKK
(1.) YES 60 TU Storefront System - 2" x 6" nominal dimension; Thermal
(2.) YES 45 TU Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
b. Oldcastle
(1.) Series 6000XT Storefront System - 2" x 6" nominal dimension; Thermal
(2.) Series 3000 Thermal MultiPlane Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
c. US Aluminum
(1.) Series FT601 - 2" x 6" nominal dimension; Thermal
(2.) Series FT451 - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
d. EFCO
(1.) Series 406 (T) Storefront System - 2" x 6-1/2" nominal dimension; Thermal
(2.) Series 403 (T) Storefront System - 2" x 4-1/2" nominal dimension; Thermal
e. Wausau
(1.) TU24650 Storefront System - 2" x 6-1/2" nominal dimension; Thermal
(2.) TU24000 Storefront System - 2" x 4-1/2" nominal dimension; Thermal

1.4 Performance Requirements:

A. General Performance: Aluminum-framed storefront system shall withstand the effects of the following performance requirements without exceeding performance criteria or failure due to defective manufacture, fabrication, installation, or other defects in construction;
1. Design Wind Loads: Determine design wind loads applicable to the Project from basic wind speed indicated in miles per hour, according to ASCE 7, Section 6.5, "Method 2-Analytical Procedure," based on mean roof heights above grade indicated on Drawings.
a. Basic Wind Speed (MPH): Determine to meet local codes listed on A000
b. Importance Factor: (1.00)
c. Exposure Category (A, B, C, D): Determine to meet local codes listed on A000

B. Storefront System Performance Requirements:
1. Wind loads: Provide storefront system; include anchorage, capable of withstanding inward and outward wind load design pressures meeting local codes listed on sheet A000.
2. Air Infiltration:
a. Air Infiltration for storefront frame system: The test specimen shall be tested in accordance with ASTM E 283. Air infiltration rate shall not exceed 0.06 cfm/ft. sq. at a static air pressure differential of 6.24 psf.
b. Air Infiltration for storefront entrances: For single acting offset pivot or butt hung entrances in the closed and locked position, the test specimen shall be tested in accordance with ASTM E 283 at a pressure differential of 6.24 psf (300 Pa) for single doors and 1.567 psf (75 PA) for pairs of doors. A single 3'0" x 7'0" entrance door and frame shall not exceed 0.50 cfm per square foot. A pair of 6'0" x 7'0" entrance doors and frame shall not exceed 1.0 cfm per square foot.
3. Water Resistance: The test specimen shall be tested in accordance with ASTM E 331. There shall be no leakage at a minimum static air pressure differential of 8 psf as defined in AAMA 501.
4. Uniform Load: A static air design load of 20 psf shall be applied in the positive and negative direction in accordance with ASTM E 330. There shall be no defection in excess of L/175 of the span of any framing member. At a structural test load equal to 1.5 times the specified design load, no glass breakage or permanent set in the framing members in excess of 0.2% of their clear spans shall occur.
5. Thermal Transmittance (U-factor): When tested to AAMA Specification 1503, the thermal transmittance (U-factor) shall be not more than:
a. Glass to Exterior - 0.47 (low-e)
6. Condensation Resistance (CRF): When tested to AAMA Specification 1503, the condensation resistance factor shall not be less than:
a. Glass to Exterior - 70 frame and 69 glass (low-e)
7. Sound Transmission Class (STC) and Outdoor-Indoor Transmission Class (OITC): When tested to AAMA Specification 1801 and in accordance with ASTM E1425 and ASTM E90, the STC and OITC Rating shall not be less than:
a. Glass to Exterior - 38 (STC) and 31 (OITC)

1.5 Submittals:

A. Product Data: Include construction details, material descriptions, dimensions of individual components and profiles, hardware, finishes, and installation instructions for each type of aluminum frame storefront system and storefront entrance doors indicated.

B. Shop Drawings: Include plans, elevations, sections, details, hardware, and attachments to work, operational clearances and installation details.

C. Samples for Initial Selection: For units with factory-applied color finishes including samples of hardware and accessories involving color section.

1.6 Quality Assurance

A. Installer Qualifications: An installer which has had successful experience with installation of the same or similar units required for the project and other projects of similar size and scope

B. Manufacturer Qualifications: A manufacturer capable of providing aluminum framed storefront system that meet or exceed performance requirements indicated and of documenting this performance by inclusion of rest reports, and calculations.

C. Source Limitations: Obtain aluminum framed storefront system and storefront entrance doors through one source from a single manufacturer.

D. Product Options: Drawings indicate size, profiles, and dimensional requirements of aluminum framed storefront system and are based on the specific system indicated. Do not modify size and dimensional requirements.
1. Do not modify intended aesthetic effects, as judged solely by Architect, except with Architect's approval. If modifications are proposed, submit comprehensive explanatory data to Architect for review.

1.7 Project Conditions:

A. Field Measurements: Verify actual dimensions of a aluminum framed storefront openings by field measurements before fabrication and indicate field measurements on Shop Drawings.

1.8 Warranty

A. Manufactures Warranty: Submit, for Owner's acceptance, manufacturer's standard warranty.
1. Warranty Period: Two (2) years from Date of Substantial Completion of the project provided however that the Limited Warranty shall begin in no event later than six months from date of shipment by manufacturer.

2.1 Manufacturers:

A. Manufacturer: Kawneer Company Inc., Contact: Doug Hess, Phone: 317-771-9265; email:doug.hess@arconic.com

1. Basis-of-Design Product Storefront Framing:
a. Trifab 601T (thermal) Storefront System
i. 2" x 6" System Dimensions
ii. Glass: Exterior (Center-Set)
b. Trifab 451T (thermal) Storefront System
i. 2" x 4-1/2" System Dimensions
ii. Glass: Exterior (Front-Set)

2. Basis-of-Design Product Storefront Entrances:
a. The door stile and rail face dimensions of the 500-Wide Stile entrance door will be as follows or as indicated on Drawings: Door: 500; Vertical Stile: 5"; Top Rail: 5"; Bottom Rail: 10"
b. Major portions of the door members to be 0.125" nominal in thickness and glazing molding to be 0.05" thick.
c. Glazing gaskets shall be either EPDM elastometric extrusions or a thermoplastic elastomer.
d. Provide adjustable glass jacks to help center the glass in the door opening.

3. Basis-of-Design Product Feature Exterior Slat Wall:
a. Kawneer Tube #027881 (1" x 3"), capped at top and bottom
i. Alternate Exterior Slat Wall only when approved by Arch PM and Chipotle DM.
1. Architechural Fabrication

B. Alternate Storefront Systems only when approved by Arch PM and Chipotle DM.
1. YKK
a. YES 60 TU Storefront System - 2" x 6" nominal dimension; Thermal
b. YES 45 TU Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
2.. Oldcastle
a. Series 6000XT Storefront System - 2" x 6" nominal dimension; Thermal
b. Series 3000 Thermal MultiPlane Storefront System - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
3.. US Aluminum
a. Series FT601 - 2" x 6" nominal dimension; Thermal
b. Series FT451 - 2" x 4-1/2" nominal dimension; Thermal; Front-Set
4. EFCO
a. Series 406 (T) Storefront System - 2" x 6-1/2" nominal dimension; Thermal
b. Series 403 (T) Storefront System - 2" x 4-1/2" nominal dimension; Thermal
5. Wausau
a. TU24650 Storefront System - 2" x 6-1/2" nominal dimension; Thermal
b. TU24000 Storefront System - 2" x 4-1/2" nominal dimension; Thermal

2.2 Materials:

A. Provide aluminum entrances and storefront matching the existing building aluminum entrances and storefronts, unless otherwise indicated.

B. Aluminum Frame Extrusions: Alloy and temper recommended by aluminum storefront manufacturer for strength, corrosion resistance, and application of required finish and not less than 0.070" wall thickness at any location for the main frame and complying with ASTM B 221: 6063-T6 alloy and temper.

C. Aluminum Storefront Entrance Extrusions:Alloy and temper recommended by aluminum-framed glass door manufacturer for strength, corrosion resistance, and application of required finish and not less than 0.090" wall thickness at any location for the main frame and sash members.

D. Fasteners: Aluminum, nonmagnetic stainless steel or other materials to be non-corrosive and compatible with aluminum window and door members, trim hardware, anchors, and other components.

E. Anchors, Clips, and Accessories: Aluminum, nonmagnetic stainless steel, or zinc-coated steel or iron complying with ASTM B 633 for SC 3 severe service conditions, or other suitable zinc coating; provide sufficient strength to withstand design pressure indicated.

F. Reinforcing Members: Aluminum, nonmagnetic stainless steel, or nickel/chrome-plated steel complying with ASTM B 456 for Type SC 3 severe service conditions, or zinc-coated steel or iron complying with ASTM B 633 for SC 3 severe service conditions or other suitable zinc coating; provide sufficient strength to withstand design pressure indicated.

G. Sealant: For sealants required within fabricated storefront system, provide permanently elastic, non-shrinking, and non-migrating type recommended by sealant manufacturer for joint size and movement.

H. Tolerances: Reference to tolerances for wall thickness and other cross-section dimensions of storefront members are nominal and in compliance with AA Aluminum Standard Data.

2.3 Storefront Framing System:

A. Thermal Barrier: Thermal Break shall be designed in accordance with AAMA TIR-A8 and tested in accordance with AAMA 505.
1. Kawneer IsoLock Thermal Break with a 1/4" separation consisting of a two-part chemically curing, high-density polyurethane, which is mechanically and adhesively joined to aluminum storefront sections.

B. Brackets and Reinforcements: Manufacturer's standard high-strength aluminum with non-staining, nonferrous shims for aligning system components.

C. Fasteners and Accessories: Manufacturer's standard corrosion-resistant, non-staining, non-bearing fasteners and accessories compatible with adjacent materials. Where exposed shall be stainless steel.

D. Perimeter Anchors: When steel anchors are used, provide insulation between steel material and aluminum material to prevent galvanic action.

E. Packing, Shipping, Handling and Unloading: Deliver materials in manufacturer's original, unopened, undamaged containers with identification labels intact.

F. Storage and Protection: Store materials protected from exposure to harmful weather conditions. Handle storefront material and components to avoid damage. Protect storefront material against damage from elements, construction activities, and other hazards before, during and after storefront installation.

2.4 Glazing Systems:

A. Glazing: As specified in Section 08800 - Glazing.

B. Glazing Gaskets: Manufacturer's standard compression types; replaceable, extruded EPDM rubber.

C. Spacers and Setting Blocks: Manufacturer's standard elastomeric type.

D. Bond-Breaker Tape: Manufacturer's standard TFE-fluorocarbon or polyethylene material to which sealants will not develop adhesion.

E. Glazing Sealants: For structural-sealant-glazed systems, as recommended by manufacturer for joint type, and as follows:
1. Structural Sealant: ASTM C 1184, single-component neutral-curing silicone formulation that is compatible with system components with which it comes in contact, specifically formulated and tested for use as structural sealant and approved by a structural-sealant manufacturer for use in aluminum-framed systems indicated.
a. Color: Black
2. Weatherseal Sealant: ASTM C 920 for Type S, Grade NS, Class 25, Uses NT, G, A, and O; single-component neutral-curing formulation that is compatible with structural sealant and other system components with which it comes in contact; recommended by structural-sealant, weatherseal-sealant, and aluminum-framed-system manufacturers for this use.
a. Color: Matching structural sealant.

2.5 Entrance Door Systems:

A. Entrance Door Hardware: As specified in Section 08710 Door Hardware.

2.6 Accessory Materials:

A. Joint Sealants: For installation at perimeter of aluminum-framed systems, as specified in section 07900 - Joint Sealers

2.7 Storefront Framing Fabrication:

A. Framing Members, General: Fabricate components that, when assembled, have the following characteristics:
1. Profiles that are sharp, straight, and free of defects or deformations.
2. Accurately fit joints; make joints flush, hairline and weatherproof.
3. Means to drain water passing joints, condensation within framing members, and moisture migrating within the system to exterior.
4. Physical and thermal isolation of glazing from framing members.
5. Accommodations for thermal and mechanical movements of glazing and framing to maintain required glazing edge clearances.
6. Provisions for field replacement of glazing.
7. Fasteners, anchors, and connection devices that are concealed from view to greatest extent possible.

B. Mechanically Glazed Framing Members: Fabricate for flush glazing without projecting stops.

C. Structural-Sealant-Glazed Framing Members: Include accommodations for using temporary support device to retain glazing in place while structural sealant cures.

D. Storefront Framing: Fabricate components for assembly using manufacturers standard installation instructions.

E. After fabrication, clearly mark components to identify their locations in Project according to Shop Drawings.

2.8 Storefront Entrance Door Fabrication:

A. Fabricate aluminum-framed glass entrance doors in sizes indicated. Include a complete system for assembling components and anchoring doors.

B. Fabricate aluminum-framed glass doors that are reglazable without dismantling perimeter framing.
1. Door corner construction shall consist of mechanical clip fastening, SIGMA deep penetration plug welds and 1-1/8" long fillet welds inside and outside of all four corners. Glazing stops shall be hook-in type with EPDM glazing gaskets reinforced with non-stretchable cord.
2. Accurately fit and secure joints and corners. Make joints hairline in appearance.
3. Prepare components with internal reinforcement for door hardware.
4. Arrange fasteners and attachments to conceal from view.

C. Weather Stripping: Provide weather stripping locked into extruded grooves in door panels or frames as indicated on manufactures drawings and details.

2.9 Aluminum Finishes:

A. Finish designations prefixed by AA comply with the system established by the Aluminum Association for designating aluminum finishes.

B. Factory Finishing:
1. Kawneer Permafluor (70% PVDF), AAMA 2605, Fluoropolymer Coating (Color: Charcoal or as noted on Drawings)
2. Finishing for alternate storefront specifications to be verified by Arch PM and Chipotle DM
a. YKK "Charcoal" UC99477, Superior Painted Finishes
b. All others to be verified with samples and submittals to Arch PM

2.10 Brake Metal Trim:

A. Shop Drawings: Show layout and elevations, dimensions and thickness of panels, connections, details and location of joints, sealants and gaskets, method of anchorage, number of anchors, supports, reinforcement, trim, flashings, and accessories.
1. Show actual field measurements on shop drawings.
2. Differentiate between shop and field fabrication.
3. Indicate substrates and adjacent work with which the fabrications must be coordinated.
4. Include large-scale details of anchorages and connecting elements.
5. Include large-scale or schematic exploded or isometric diagrams to fully explain flashing at a scale of not less than 1-1/2 inches per 12 inches (1:10)

2.11 Formed Metal Fabrications - General:

A. Shop assembly: Preassemble items to greatest extent possible. Minimize field splices and field assembly. Disassemble only as necessary for transportation and handling. Mark items clearly for assembly and installation.

B. Coordinaton: Match dimensions and attachement of formed metal items to adjacent construction. Produce integrated assembles. Closely fit joints; align edges and flat surfaces unless indicated otherwise.

C. Forming: Profiles indicated. Maximize lenghts. Fold exposed edges to form hem indicated or ease edges to radius indicated with cocealed stiffener. Provide flat, flush surfaces without cracking or grain seperation at bends.

D. Reinforcement: Increase metal thickness; use concealed stiffeners, backing materials or both. Provide stretcher leveled standard of flatness and stiffness required to maintain flatness and hold adjacent items in flush alignment.

E. Anchors: Straps, plates and anchors as required to support and anchor items to adjacent construction.

F. Supports: Miscellaneous framing, mounting, clips, sleeves, fasteners and accessories required for installation.

G. Welding and brazing: Weld or braze joints continuously. Grind smooth, fill or dress to produce smooth, flush, exposed surfaces. Do not discolor metal. Grind Smooth, polish, and restore damaged finishes to required condition.
1. Ease exposed edges to small uniform radius.
2. Welded joints.
a. Carbon Steel: Perform welding in accordance with AWS D1.1/D1.1M.
b. Stainless Steel: Perform welding in accordance with AWS D1.6/D1.6M
3. Brass/Bronze Brazed Joints:
a. Perform torch brazing in accordance with AWS C3.4M/C3.4
b. Perform induction brazing in accordance with AWS C3.5M/C3.5
c. Perform resistance brazing in accordance with AWS C3.9M/C3.9

H. Performance requirements;
1. Thermal Movements:
a. Allow for thermal movements in exterior metal fabrications due to temperature changes. Prevent buckling, opening of joints, overstressing of components, failure of connections, and other detrimental effects.
b. Temperature Change Range: 120 degrees F (67 degrees C), ambient; 180 degrees F (100 degrees C), on material surfaces.
2. Corrosion: Prevent galvanic action and other forms of corrosion by isolating metals and other materials from direct contact with incompatible materials.

2.12 Formed Metal Fabrications - Sheet Metal

A. Closures, Trim, and Fill Panels:
1. Form Closures from type and thickness of metal indicated.
2. Conceal fasteners when possible.
3. Drill and tap holes for securing to other surfaces.
4. Provide gaskets where indicated or needed for continuous seal at adjacent surfaces.
5. Miter or cope at corners and reinforce with bent metal plate. Form tigh joints.

2.13 Materials

A. Genaral: Provide sheet metal without pitting, seam marks, roller marks, stains, discolorations, or other imperfections exposed to view on finished units.
B. Galvanized Steel Sheet: ASTM A653/A653M, G90 (Z275) coating. 14 gauge min. thick base material.
C. Anchors, Clips, and Accessories: Use one of the following:
1. Stainless steel complying with ASTM A276/A276M, ASTM A480/A480M, or ASTM A666.
2. Steel complying with ASTM A36/A36M and hot-dipped galvanized to ASTM A153/A153M.
3. Steel complying with ASTM A36/A36M and hot-dipped galvenized to ASTM A123/A123M Coating Grade 35
4. Interior locations: Carbon steel; zinc coated in accordance with ASTM B633 or ASTM F1941/F1941M, Class Fe/Zn 5.
5. Exterior Locations or in contact with Stainless Steel:
a. Bolts: Stainless steel; ASTM F593, Group 1 (A1)
b. Nuts: Stainless steel; ASTM F594.
6. Structural Anchors: Provide anchors where work is indicated to comply with design loads.
a. Type: Provide chemical or torque controled expansion anchors.
b. Capacity: When tested according to ASTM E488/E488M; four times the load imposed when installed in concrete.
7. Nonstructural Anchors: Provide powder-actuated fasteners where work is not indicated to comply wit design loads. Provide size and number required for load, installation, and as recommended by manufacturer, unless indicated otherwise.
D. Fasteners, General: Same basic metal and alloy as formed metal sheet unless indicated otherwise. Do not use metals incompatible with the materials joined.
E. Gaskets: As required to seal joints in decorative formed metal and remain airtight; as recommended in writing by decorative formed metal manufacturer.

2.14 Finishes

A. Finishes, General: Comply with NAAMM AMP 500-06
1. Complete mechanical finishes befor fabrication. After fabrication, finish joints, bends, abrasions and surface blemishes to match sheet.
2. Protect mechanical finishes on exposed surfaces from damage.
3. Apply organic and anodic finishes to formed metal after fabrication unless indicated otherwise.
4. Appearance: Limit variations in appearance of adjacent to one-half the range represented in approved samples. noticeable variations in the same piece are not acceptable. Install components in the range of approved samples to minimize contrast.
B. Galvanized Steel Finishes:
1. Repair Galvanized Surfaces: Clean welds and abraded areas and repair galvanizing to comply with ASTM A780/A780M
2. Color: As shown on the drawings.
3. Factory Prime: Apply shop primer to pepared surfaces of items where field painting after installation indicated, unless indicated otherwise. Comply with requirements in SSPC-PA1
4. High Performance Organic Coatings: AAMA 2604; multiple coats, thermally cured fluoropolymer system.

3.1 Examination:

A. Examine openings, substrates, structural support, anchorage, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of work. Verify rough opening dimensions, levelness of sill plate and operational clearances. Examine wall flashings, vapor retarders, water and weather barriers, and other built-in components to ensure a coordinated, weather tight framed aluminum storefront system installation.
1. Masonry Surfaces: Visibly dry and free of excess mortar, sand, and other construction debris.
2. Wood Frame Walls: Dry, clean, sound, well nailed, free of voids, and without offsets at joints. Ensure that nail heads are driven flush with surfaces in opening and within 3 inches of opening.
3. Metal Surfaces: Dry; clean; free of grease, oil, dirt, rust, corrosion, and welding slag; without sharp edges or offsets at joints.
4. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 Installation:

A. Comply with Drawings, Shop Drawings, and manufacturer's written instructions for installing aluminum framed storefront system, aluminum swing storefront entrance doors, accessories, and other components.

B. Install aluminum framed storefront system and storefront doors level, plumb, square, true to line, without distortion or impeding thermal movement, anchored securely in place to structural support, and in proper relation to wall flashing and other adjacent construction.

C. Set sill members and door threshold in bed of sealant or with gaskets, as indicated, for weather tight construction.

D. Install aluminum framed storefront system and components to drain condensation, water penetrating joints, and moisture migrating within sliding door to the exterior. Refer to section 07900 - Joint Sealers.

E. Separate aluminum and other corrodible surfaces from sources of corrosion or electrolytic action at points of contact with other materials.

F. Install aluminum storefront framing system glass and glazing, in accordance with section 08800 and the manufacturer's requirements.

3.3 Adjusting, Cleaning, and Protection:

A. Clean aluminum surfaces immediately after installing aluminum framed storefronts. Avoid damaging protective coatings and finishes. Remove excess sealants, glazing materials, dirt, and other substances.

B. Clean glass immediately after installation. Comply with glass manufacturer's written recommendations for final cleaning and maintenance. Remove nonpermanent labels, and clean surfaces.

C. Remove and replace glass that has been broken, chipped, cracked, abraded, or damaged during construction period.

SECTION 085619 - PASS-THRU WINDOW

1.1 General: Provide door hardware as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. ASTM A240 - Heat-Resisting Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels.
2. ASTM A653 - Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy-Coated (Galvannealed) by the Hot-Dip Process.
3. ASTM B209 - Aluminum and Aluminum-Alloy Sheet and Plate.
4. ASTM B221 - Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes.
5. ASTM B580 - Standard Specification for Anodic Oxide Coatings on Aluminum.
6. ASTM B680 - Standard Test Method for Seal Quality of Anodic Coatings on Aluminum by Acid Dissolution.
7. ASTM C1048 - Heat-Treated Flat Glass--Kind HS, Kind FT Coated and Uncoated Glass.
8. ASTM C1172 - Standard Specification for Laminated Architectural Flat Glass.
9. ASTM E774 - Standard Specification for Sealed Insulating Glass Units.
10. Aluminum Association AA DAF-45 - Designation System for Aluminum Finishes.

B. Quality Assurance:
1. Manufacturer Qualifications: Minimum of 25 years successful experience continuously manufacturing pass-thru windows.
2. Installer Qualifications: Installer shall have five years experience manufacturing and fabricating windows of similar type and scope as those specified in this section.

2.1 Materials:

A. Acceptable Manufacturers. Arch PM to verify required manufacturer per Tenant's assignment.
1. Quikserv; Toll Free: 1.800.388.8307; Email: sales@quikserv.com; Web: https://www.quikserv.com/
2. ReadyAccess; Toll Free: 1.800.621.5045; Email: ready@ready-access.com; Web: https://www.ready-access.com

B. No substitutions allowed. Requirements for manufacturer, design, grade, function, finish, size and other distinctive qualities of each type of door hardware are indicated on the drawings.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G014

2.2 In-Line Side Sliding Automatic Window and Air Curtain

A. Standard Custom Side Sliding Windows – Arch PM to verify manufacturer with Tenant.

• Quikserv Custom Automatic Side Sliding Window (Model: SST-4035E-CHIPOTLE): 45 -1/2"W x 41-3/4"H window with 17-3/4" tall transom and (2) sidelights at 29 1/4"W x 41-3/4"H; Complete Unit Size 104"W x 59-1/2"H

1. Service Opening: 19"W x 29-3/4"H
2. Finish: Dark Bronze Anodized
3. Glass: 1" Clear Tempered unit + Low E (Solarban 60e) for fixed and moving panel, sidelights and transom
4. 'CHIPOTLE' package includes pre-wired air curtain with relay to sync operation with window.
   a. Arch PM to verify if heated or ambient air curtain is required per Tenant assignment. Air Curtain mounts to transom.
      i. Heated Air Curtain: Model: QSV1025EJ-040-BK
      ii. Ambient Air Curtain: Model: QSK1025AA-BK
5. Refer to interior elevations (A700s) for direction of opening for ordering.

• ReadyAccess Automatic Side Sliding Window: 47 -1/2"W x 43-1/2"H window with 16" tall transom and (2) sidelights at 28 1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H

1. Service Opening: 19"W x 35"H
2. Finish: Dark Bronze Anodized
3. Glass: 3/4" Clear Tempered unit + Low E (Solarban 70XL) for fixed & moving panel, sidelights and transom
4. Arch PM to verify if heated or ambient air curtain is required per Tenant assignment.
   a. Heated Air Curtain: Model: AA300 (replaces transom)
   b. Ambient Air Curtain: Model: AA100 (split transom)
5. Refer to exterior elevations (A300s) for direction of opening for ordering.

B. Alternate California Code Option

1. ReadyAccess: Window 47-1/2" W x 35-3/4"H with double-split transom for air curtain and 10" and (2) sidelights at 28-1/4"W x 59-1/2"H; Complete Unit Size 104"W x 59-1/2"H
   a. Service Opening:15-1/4"W x 28"H, limited to meet CA code.
   b. Ambient Air Curtain, AA100, and relay switch kit included with the West Coast Window package.

2. Quikserv Model: SS-4035-E-CHIPOTLE-CALI, same as above except as noted.
   a. Service Opening: 28"W x 15-3/8"H, limited to meet CA code.
   b. 'CHIPOTLE' package includes pre-wired ambient air curtain with relay to sync operation with window Model: QSK1025AA-BK. Air curtain mounts to transom.

C. Alternate Impact-Resistant and Florida Product Approved Option, Miami Dade Horizontal Bi-Parting Impact Slider

1. Quikserv Model: BP-7241E-IP-CHIPOTLE, Complete Unit Size: 72"W x 41"H.
   a. Service Opening: 29-1/2"W x 27"H
   b. Rough Opening: 72-1/2"W x 41-1/2"H
   c. Glass: Impact Resistant Glass
   d. 'CHIPOTLE' package includes ambient air curtain
      i. Ambient Air Curtain: Model: QSK1025AA-BK, Part Number: 9345.
      ii. Do not mount directly to window, mount on wall above.
   e. Miami-Dade NOA #18-0814.02

2.3 Electrical Requirements

A. Quikserv Electrical Windows: 120V / 60 Hz, 20-amp branch circuit, single phase. Power supplied through base of window. Conforms to UL Standard 325 – Certified to CAN/CSA C22.2 NO. 247. Confirm with Electrical Drawings.

1. Heated Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE)
   a. Separate 230V circuit and Power Supply required for heated air curtain. Air curtain pre-wired through window frame with power supply routed to base of window. Confirm with Electrical Drawings.
2. Ambient Air Curtain for Custom Side Sliding Window (Model: SS-4035-E-CHIPOTLE) and Alternate California Code Option: Model: SS-4035-E-CHIPOTLE-CALI
   a. Separate circuit not required. Window pre-wired to power and sync operation with air curtain.
3. Ambient Air Curtain for Alternate Impact-Resistant and Florida Product Approved Option (Model: BP-7241E-IP-CHIPOTLE):
   a. Connect to main control board on window to power and synchronize operation with opening and closing of window.

B. ReadyAccess Electrical Windows: 115V / 60 Hz, 15-amp dedicated circuit required. Run power to header on fixed panel side.

1. AA300 Heated Air Curtain
   a. Separate 208V /60 hz /40-amp single phase circuit required.
2. AA100 Ambient Air Curtain (Standard and CA window)
   a. Separate 120V / 60hz / 15-amp single phase circuit required. Run power to center of window above header.

3.1 Installation

A. Install in accordance with manufacturer's instructions.
B. Install pass-thru windows plumb, level, square, true to line, and without warp or rack. Maintain dimensional tolerances and alignment with adjacent Work.
C. Install thermal isolation where components penetrate or disrupt building insulation. Pack fibrous insulation in shim spaces at perimeter of assembly to maintain continuity of thermal barrier.
D. Install pass-thru window components weathertight.
E. Anchor pass-thru windows securely in place to supports. Use attachment methods permitting adjustment for construction tolerances, irregularities, alignment, and expansion and contraction.
F. Separate aluminum from other metal surfaces with bituminous coatings or other means approved by Architect.
G. Coordinate installation of related sheet metal flashing as specified in Section 07 62 00 - Sheet Metal Flashing and Trim.
H. Install perimeter joint sealants as specified in Section 07 91 23 - Backer Rods.

SECTION 08710 - DOOR HARDWARE

1.1 General: Provide door hardware as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A117.1-2009 Accessible and Usable Buildings and Facilities.
   2. ANSI/BHMA A156 Series Builders Hardware

B. Quality Assurance:
   1. Codes and standards: Provide hardware complying with local Building Code requirements and the Tenant's standards for keying and security systems.
   2. Project scheduling: Performed by an Architectural Hardware Consultant (AHC).
   3. Package each item of hardware and each lockset, complete with all screws, anchors, installation instructions and templates. Identify package indexing with corresponding item number of the hardware schedule.
   4. After hardware schedule acceptance, provide necessary templates or physical hardware to required trades for cutting, reinforcing, or preparing their products to receive hardware. Furnish templates to metal door manufacturer's.

2.1 Materials:

A. No substitutions allowed. Requirements for manufacturer, design, grade, function, finish, size and other distinctive qualities of each type of door hardware are indicated on the drawings.

B. Review the keying system with the Tenant and provide the type required.

3.1 Installation

A. Install each hardware item in strict accordance with manufacturer's installation instructions and recommendations. Securely fasten all attached parts. Fit faces of mortised parts snug and flush. Verify operating parts move freely and smoothly without binding or sticking, without excessive clearance.

B. Set units level, plumb and true to line and location. Adjust and reinforce attachment substrate as required for proper installation and operation. Drill and countersink units that are not factory prepared for anchorage fasteners. Space fasteners and anchors in accordance with industry standards.

C. Mount hardware units at heights indicated in DHI "Recommended Locations for Builders Hardware", unless otherwise required to comply with requirements of governing codes and regulations. Conform to ANSI A117.1 and ADAGG guidelines for accessibility.
   1. Top Butts: 5 inches; top of butt from head of frame.
   2. Middle Butts: 3'-2", centerline from finish floor.
   3. Bottom Butts: 5 inches; finish floor to bottom of butt.
   4. Locks: centerline from finish floor per hardware schedule.
   5. Knobs: 3'-2", centerline from finish floor.
   6. Pulls: centerline from finish floor per hardware schedule.
   7. Pushes: centerline from finish floor per hardware schedule.

SECTION 08800 - GLAZING

1.1 General: Provide glass and glazing as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. CPSC 16 CFR Part 1201 (1-91)"Safety Standard for Architectural Glazing Materials."
   2. GANA "Glazing Manual - 1990."

B. Quality Assurance:
   1. Codes and standards: Provide type of glass and glazing products that comply with ANSI Z97.1 and testing requirements of 16 CFR Part 1201 for category II materials. Comply with all applicable codes, standards and regulations that control safety glazing materials and installation.
   2. System Performance: Provide glass and glazing that has been produced, fabricated and installed to withstand normal thermal movement, wind loading and, where applicable, impact loading, without failure including loss or breakage of glass, failure of glazing sealants or gaskets to remain watertight and airtight, deterioration of glass and glazing materials and other defects in the work.
   3. Installation: Performed only by experienced glaziers.

C. Warranty:
   1. Insulating glass: Five years from date of installation against defects that materially obstruct vision through the glass or affect thermal and physical integrity.

2.1 Materials:

A. Glass:
   1. Float Glass (FG): 1/4" thick clear float glass.
   2. Tempered Glass (TG): 1/4" and 1/2" thick clear, tempered safety glass, free-of-tong marks.
   3. Insulating Glass (IGL): 1" thick clear, low-e tempered sealed glass; 1/4" thick interior and exterior glass lites with 1/2" aluminum desiccated dual sealed air space; with the following characteristics:
      a. Low-emissivity coating on #2 surface.
      b. Visible Light Transmittance: 64% - 70%
      c. Visible Light Reflectance - Outdoors: 9%-11%
      d. Solar Energy Transmittance: 32%-34%
      e. Solar Energy Reflactance-Outdoors: 30%-34%
      f. U-Value - Winter Night: 0.29
      g. U-value - Summer days: 0.28
      h. Solar Heat gain Coefficient: 0.25-0.39
      i. Shading Coefficient: 0.43-0.45
      j. Manufacturers/Products:
         i. AGC/Comfort Ti-AC40, or similar to meet code
         ii. Sun Guard/SN-68, or similar to meet code
         iii. PPG/Solarban 60, or similar to meet code
         iv. Viracon/VE1-2M, or similar to meet code
   4. Spandrel Glass (SG) 1/4" thick, Spandrel Ceramic Glass, (Color: GrayBlack or as noted on drawings) by Old Castle Building Envelope (439) 666-2000, Contact: Doug Dewar
   5. Frosted Window Film, 3M Dusted Crystal Translucent Window Film. Apply on the interior side of glazing.

B. Glazing Materials:
   1. Glazing Sealants: Provide elastomeric glazing sealants suitable for applications indicated; compatible with one another and with other materials they will contact, complying with ASTM C920.
   2. Glazing Tape: Provide preformed, non-staining and non-migrating elastomeric tape, as recommended by tape and glass manufacturers for application indicated, complying with ASTM C 1281.
   3. Glazing gaskets: Provide manufacturer's standard snap-on aluminum stops and neoprene, vinyl or EPDM glazing gaskets.
   4. Provide setting blocks, spacers and edge blocks of material, size, and shape complying with referenced glazing standard, and compatible with surfaces contacted in installation.

C. Fabrication: Factory fabricate and size all glass.

3.1 Installation

A. Preparation:
   1. Field verify measurements and conditions of installation.
   2. Examine all details. Provide proper fitting to details indicated.
   3. Glazing channel dimensions shown are intended to provide for necessary bite on glass, minimum edge clearance and adequate glazing materials thickness, with reasonable tolerances. Adjust as required by job conditions at time of installation.

B. Install glass and glazing in accordance with the GANA "Glazing Manual" and glass manufacturer's recommendations.
   1. Install insulating glass units to comply with recommendations by Sealed Insulating Glass Manufacturers Association (SIGMA).

C. Install setting blocks of proper size at quarter points of sill rabbet. Provide spacers as required.

D. Install glazing sealants, tapes and gaskets in accordance with manufacturer's recommendations. Set glass without springing and install securely to prevent rattling or breakage.

E. Protect glass from breakage during remaining construction. Do not remove non-permanent labels until final acceptance.

DIVISION 9 -- FINISHES

SECTION 09260 - GYPSUM BOARD SYSTEMS

1.1 General: Provide gypsum board systems as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. GA 214-90 "Levels of Gypsum Board Finish."
   2. GA-216 "Specifications for Application and Finishing of Gypsum Board."
   3. USG "SA923 Drywall/Steel Framed Systems."

2.1 Materials:

A. Manufacturer: United States Gypsum Co. (USG), (800) 874-4968, internet www.usg.com.

B. Metal framing: Comply with ASTM C 754 and ASTM C 645 for materials and sizes.
   1. Partition metal framing:
      a. Studs: Galvanized steel, C-shaped, sizes indicated, 20 gage "ST20"
      b. Runners: Match studs, type recommended by stud manufacturer for floor and ceiling support of studs. Provide flexible ceiling runners for full height metal stud framed partitions continuous from floor to underside of structural members or deck above.

C. Ceiling and Soffit metal framing/suspension systems:
   1. Small areas: Metal stud framing of appropriate size and gage for spans indicated.
   2. Large areas: Furring channel "Grillage" or "Direct Suspension System" designed for concealed support of gypsum board ceilings, of proper type for use indicated.
   3. Furring members: 20 gage, galvanized steel screw type, hat-shaped furring.

D. Gypsum board panels: USG "Sheetrock" complying with ASTM C1396, tapered edge face panels, 48" wide, in maximum lengths available to minimize end joint conditions, 5/8" thick.
   1. General use panels: Sheetrock Regular panels.
   2. Fire rated panels: Sheetrock Firecode Core panels.
   3. Water-resistant: panels: Sheetrock HUMITEK panels.

E. Cement board: USG DUROCK Cement Board, 5/8" thick x manufacturer's standard width, complying with ANSI A118.9, and in maximum lengths available to minimize end-to-end butt joints.

F. Fasteners: USG Type "S" bugle head screws for metal framing, USG Type "W" bugle head screws for wood framing, manufacturer's recommended length for panel thickness indicated.

G. Trim: Galvanized steel with knurled and perforated flanges. USG Dur-A-Bead corner bead, No. 200B casing bead metal trim, No. 093 Control Joint.

H. Joint treatment: USG Joint Treatment System, utilizing "Sheetrock Brand Joint Tape", and "Sheetrock Brand Setting-Type (DURABOND)" compound for tape bedding and topping.

I. Adhesives: USG "Sheetrock Brand Setting-Type (DURABOND) 210 or 90" compound for tape bedding and topping.

J. Acoustical sealant: USG Sheetrock Acoustical Sealant, water-base type, gunnable sealant for sealing sound-rated gypsum board systems.

K. Sound attenuation insulation: USG Thermafiber unfaced 3-1/2" thick, mineral fiber insulating batts/blankets; standard lengths and widths required to coordinate with spaces insulated.

3.1 Installation

A. Install metal wall and partition framing and ceiling suspension/ support systems in accordance with USG Bulletin SA 923 and complying with ASTM C754.
   1. Ceiling suspension/ support systems: Metal furring system/direct suspension or steel stud framing system.
   2. Wall and partition framing:
      a. Install steel studs per schedule or at spacing indicated with bottom and top runner tracks anchored to substrates. Provide flexible ceiling runner tracks at full height partitions.
      b. Terminate partition stud system 4" above ceilings, except where indicated to be extended to structural support or roof deck above. Brace tops of partition framing to structure or roof deck at maximum 4'-0" on center spacing.
      c. Frame openings more than 2'-0" wide with two 20 gage studs at each jamb.
      d. Coordinate the installation of supplementary blocking and nailers, provided under Section 06100 work, to support shelving, millwork, toilet accessories, and similar work that cannot be adequately supported by gypsum board alone.

B. Application and Finishing: Install and finish gypsum board to comply with ASTM C 840 and Gypsum Association GA 216 "Recommended Specifications for the Application and Finishing of Gypsum Board."
   1. Screw fasten all gypsum board panels.
   2. Metal Trim: Install metal corner beads at external corners of gypsum board work and metal trim wherever edge of gypsum board would be exposed. Use longest practical lengths.
   3. Control Joints: Locate and install control joints in accordance with USG Bulletin SA923 "Good Design Practice" recommendations.

C. Acoustical Treatment:
   1. Where sound-attenuation insulation is indicated, seal gypsum board construction at perimeters, control joints, junction boxes, openings and penetrations with a continuous bead of acoustical sealant including a bead at both faces of partitions.
   2. Install sound attenuation insulation at scheduled partitions and ceilings. Install insulation in single layer of required thickness. Extend full thickness over entire area to be insulated. Cut and fit tight around obstructions. Fill all voids.
   3. At openings and cutouts, fill open spaces between edges of gypsum board and fixtures, cabinets, ducts, and other flush or penetrating items, with continuous bead of acoustical sealant.
   4. Seal sides and backs of electrical boxes to completely close up openings and joints with a bead of acoustical treatment.

D. Finishing:
   1. Comply with manufacturer's instructions for mixing, handling, and application of materials. Apply treatment at joints both directions, at flanges of trim accessories, penetrations of gypsum board (electrical boxes, piping, and similar work), fastener heads, surface defects, and elsewhere as indicated. Apply in manner that will result in each of these items being concealed when applied decoration has been completed.
   2. Apply joint tape at joints between gypsum boards, except where trim accessories are indicated.
   3. Interior Exposed Gypsum Board Finish: Level 5 Finish.
      a. Locations: Typical for all walls and ceilings, unless otherwise indicated
      b. Finish interior gypsum board by applying the following joint compounds in four coats (not including prefill of openings in base), and sand between coats and after last coat:
      c. Embedding and First Coat: Setting-type joint or taping compound.
      d. Fill (Second) Coat: Setting-type topping compound.
      e. Fill (Third) Coat: Setting-type topping compound.
      f. Finish (Fourth) Coat: Skim coat entire surface.

   4. Interior Concealed Gypsum Board: Level 3 Partial Finishing.
      a. Finish concealed gypsum board construction that requires finishing same as exposed gypsum board construction, except the third coat and sanding can be omitted.

E. Cement Board: Install cement board as a 16" high base at all kitchen and kitchen cook line wall types as indicated on drawings.

SECTION 092816 - GLASS-MAT FACED GYPSUM BACKING BOARDS

1.1 General: Provide Fiberglass-mat faced, moisture resistant gypsum backer board as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ASTM C840 Standard Specification for Application and Finishing of Gypsum Board.
   2. ASTM C1002 Standard Specifiation for Steel Self Piercing Tapping Screws for the Application of Gypsum Panel Products or Metal Plaster Bases to Wood Studs or Steel Studs
   3. ASTM C1178 Standard Specification for Glass Mat Water-Resistant Gypsum Backing Panel
   4. ASTM D3273 Standard Test Method for Resistance to Growth of Mold on the Surface of Interior Coatings in an Environmental Chamber
   5. ASTM D6329 Standard Guide for Developing Methodology for Evaluating the Ability of Indoor Materials to Support Microbial Growth Using Static Environmental Chambers.
   6. ASTM E96 Standard Test Methods for Water Vapor Transmision of Materials
   7. Tile Council of North America, Inc. (TCNA): TCA Handbook for Ceramic Tile Installation, Current Edition.

2.1 Materials:

A. Manufacturer: Georgia-Pacific Gypsum LLC, (800) 225-6119, internet: www.buildgp.com

B. Fiberglass-Mat Faced Gypsum Backing Board: DensShield Fireguard Tile Backing Board complying with ASTM C1178, Type X, Square edges, 4' wide in maximum lengths available to minimize end joint conditions, 5/8" thick. Surfacing: Coated fiberglass mat on face, back and long edges.
   1. General use panels: 5/8" DensShield Fireguard Tile Backer, Georgia-Pacific Gypsum.

C. Fasteners: Screws meeting ASTM C1002, with corrosion resistant treatment. Size and type per manufactuer's recommendations:
   1. Walls (Steel Frame): Bungle head, fine thread, sharp point rust resistant drywall screw
   2. Walls (Walls Frame): Bungle head, coarse thread, sharp point rust resistant screw

D. Metal Framing, Trim, joint treatment, adhesives, acoustical sealant, and sound attenuation insulation: Refer to Section 09260 Gypsum Board Systems

3.1 Installation

A. Install DenShield at all tile walls excluding hood area as indicated on drawings.

B. General: Install in accordance with ASTM C840, manufacturer's recommendations and TCA Handbook for Ceramic Tile Installation.
   1. Manufacturers Recommendations: refer to Current "Product Catalog", Georgia Pacific Gypsum.
      a. Attach DensShield Tile Backer with grey side facing the interior. Tile should be applied on the grey coated side of DensShield Tile Backer. Cut panel to required size and make cutouts. Fit ends and dges closely. Do not leave gaps between panels.
      b. DensShield Tile Backer may be cut by using a utility knife to score, then snap, working from the grey face side.
      c. For walls, when used as a tile substrate a minimum 20-gauge steel or wood framing should be spaced no greater than 24" o.c. for 5/8" DensShield Tile Backer. Board can be applied horizontally or vertically.
      d. Fasteners shall be spaced 6" o.c. for walls for wood and steel framing. Do not countersink. Drive fasteners flush with grey coated surface. See manufacturer installation Fastener Guide for proper selection.
      e. In all corners, imbed with a bead of flexible sealant when installing panels into corner. Apply self-adhesive 2" wide fiberglass mesh tape and bed tape on all joints and corners with material used to set tiles.
      f. Caulk or seal fixture/plumbing penetrations and abutments to dissimilar materials.
      g. Do not use all purpose joint compound or tape in wet areas.
      h. Do not apply DensShield Tile Backer directly to concrete or masonry block. Framing or furring of the walls is necessary.
      i. DensShield Tile Backer should not be used for exterior installations.
      j. DensShield Tile Backer panels should not be used as a base for nailing and mechanical fastening.
      k. DensShield Tile Backer has a built in moisture barrier. Never install vapor retarders directly behind DensShield Tile Backer panels. In retrofit applications, some paints or other wall coverings may constitute a vapor barrier; remove or effectively penetrate these coverings prior to installing DensShield Tile Backer panels.

C. Refer to Section 09260 Gypsum Board Systems for additional installation and sound treatment instructions

SECTION 09330 - QUARRY TILE

1.1 General: Provide quarry tile flooring and base as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A137.1 "Ceramic Tile."
   2. TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

A. Manufacturers:
   1. Quarry Tile: Daltile, (877) 556-5728, internet: http://daltile.com
      a. For ordering purposes, email all orders to chipotle@daltile.com
   2. Waterproofing, Setting and Grouting Materials:
      a. Setting and Grouting Materials and Tile Base Membrane: Mapei
         i. For ordering purposes, email all orders to chipotle@daltile.com
         ii. For technical questions, contact Mapei, (800) 992-6273, internet: www.mapei.com

B. Quarry Tile: Daltile 6" x 6" x 1/2" Quarry Textures with 5" base as scheduled on finish plan and appropriate trim; Color: "Ashen Gray" 0T03
   1. Entire Kitchen Area: Provide non-abrasive finish quarry tile.
   2. Rest Rooms: Provide non-abrasive finish quarry tile.
   3. Outside Corner Cove Base (Kitchen): #QC-(L or R)-3565 5" x 6"
   4. Inside Corner Cove Base: #QB-3565 1" x 5"
   5. Bullnose Coveless Base: #Q-1665, 6" x 6"
   6. Bullnose Corner Coveless Base: #QCRL-1665, 6" x 6"

C. Waterproofing for elevated floor slabs: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane
D. Setting Adhesive: Mapei, Ultraflex 3, Color: Gray
E. Grout: Mapei, Keraopxy IEG CQ, Color: #9, "Gray", 1/4" grout joints.
F. Quarry Tile Base Membrane: Mapei, Mapelastic AquaDefense, Premium Waterproofing and Crack Isolation Membrane

3.1 Installation

A. Preparation: Clean substrate surfaces, scheduled to receive quarry tile, thoroughly and remove all coatings that may impair bond.
   1. Center tile fields both directions in each floor area. Adjust layout to minimize tile cutting. Avoid tile less than one-half size. Locate cuts to be least conspicuous.
   2. Maintain units uniformly "in plane." Provide straight, uniform joint widths and grout lines.

B. Elevated Floor Slabs: Install waterproofing membrane at elevated floor slab surfaces scheduled to receive quarry tile floor finish. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
   1. Extend waterproofing up vertical wall surfaces minimum 10" high.
   2. Extend membrane down into floor drain flanges to assure continuous waterproofing at drainage points.

C. Wet Areas: Install waterproofing membrane at all quarry tile wall base. Install membrane materials in accordance with manufacturer's installation instructions to produce a waterproof membrane of uniform minimum 30 mil thickness bonded securely to substrate.
   1. Extend waterproofing up all vertical wall surfaces receiving quarry tile base minimum 10" high. Extend waterproofing membrane 10" minimum horizontally from all vertical wall surfaces receiving quarry tile base.

D. Installation: Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
   1. Floors: Latex-portland cement mortar on concrete; TCA detail F113 and ANSI A108.5, grout ANSI A108.10.
   2. Base: Latex-portland cement mortar on cement board.

SECTION 09340 - CERAMIC TILE

1.1 General: Provide ceramic wall tile as shown and specified.

A. Standards: Materials and installation shall conform to the following:
   1. ANSI A137.1 "Ceramic Tile."
   2. TCA "Handbook for Ceramic Tile Installation."

2.1 Materials:

A. Manufacturers:
   1. Ceramic Tile and Accent Tile: Daltile, P: (877) 556-5728, internet: http://daltile.com
      a. For ordering purposes, email all orders to chipotle@daltile.com

B. Ceramic Tile: Series - Color Wheel Glazed Ceramic:
   1. Kitchen Tile or as noted in plans
      a. Color - Arctic White 0190, Semi-Gloss, Size - 4 x 16, Pattern - Stacked Bond
   2. Accent Tile
      a. Color - Chipotle Brick Metallic 1.0 #9999710686, Size - 3 x 12, Pattern - Stacked Bond
      b. Alternate Accent Tile only when approved by Arch PM and Chipotle DM
         i. Series - Remedy, Color - Alchemy RD25, Size - 2 x 9, Pattern - Stacked Bond
         ii. Series - Marrazzi, Color - Artesen AT25, Size - 2 x 4, Pattern - Brickjoint Mosaic

C. Setting Adhesive: Thinset Mortar, Mapei, Ultraflex LFT - Gray

D. Grout:
   1. Kitchen Tile or as noted in plans
      a. Mapei, Series - Flexcolor CQ - Gray #09, 1/8" grout joints.
   2. Accent Tile
      a. Mapei, Series - Flexcolor CQ - Chocolate #07, 1/8" grout joints.

3.1 Installation

A. Preparation: Clean substrate surfaces scheduled to receive ceramic tile thoroughly and remove all coatings that may impair bond.
   1. Protect surrounding work from damage.
   2. Remove any curing compounds or other contaminates.
   3. Vacuum clean surfaces and damp clean.
   4. Install cementitious backer board or glass-mat faced gypsum backing board as indicated in drawings in accordance with ANSI A108.11 and board manufacturer's instructions. Tape joints and corners, cover with skim coat of dry-set mortar to a feather edge.
   5. Prepare substrate surfaces for adhesive installation in accordance with adhesive manufacturer's instructions.

B. Kitchen:
   1. Install, grout and clean ceramic tile in accordance with referenced TCA installation details and ANSI standard specifications for setting methods scheduled.
   2. Lay tile in horizontal stack bond, following detail drawings for layout considerations. Horizontal rows of tile shall be full-height courses, unless noted otherwise.
   3. Arrange pattern so that a full tile or joint is centered on each wall horizontally and that no tile less than 1/2 width is used at the ends of the wall. Exception: when one end of the wall is a tile-to-gypsum board transition. Do not interrupt tile pattern through openings.
   4. Use specified stainless steel corner guards at tile-to-tile and tile-to-FRP outside corners.
   5. Use corner bead of 100% silicone sealant, color to match grout, at inside corners where tile meets tile.
   6. Use corner bead of 100% silicone sealant, white, at inside corners where tile meets paint gyp. board, tile meets FRP or tile meets aluminum.
   7. Cut and fit tile to penetrations through tile, leaving sealant joint space. Place tile joints uniform in width, subject to variance in tolerance allowed in tile size. Make joints watertight, without voids, cracks, escess mortar, or excess grout.
   8. Sound tile after setting. Replace hollow sounding units.
   9. Keep expansion joints free of adhesive or grout. Allow tile to set for a minimum of 48 hours prior to grouting. Apply sealant to junction of tile and dissimilar materials and junction of dissimilar planes. Refer to section 07900 Joint Sealers.
   10. Clean tile and grout surfaces.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G015

SECTION 09510 - SUSPENDED CEILING SYSTEMS

1.1 General: Provide acoustical ceiling systems as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. CISCA "Acoustical Ceilings - Use and Practice."
2. ASTM C635.
3. ASTM C636.

B. Related Sections:
1. 09515 Cementitious Wood Fiber Acoustical Panels: Suspension system.

2.1 Materials:

A. Manufacturer:
1. USG Interiors, Inc., (800) 950-3839, www.usg.com
2. Pittcon Industries, (800) 637-7638, www.pittconindustries.com

B. Ceiling Panels: USG "Sheetrock Lay-In ClimaPlus No. 3270" ceiling panels with white, stipple texture, vinyl facing, 24" x 48" x 1/2".

C. Light Pocket: Pittcon "LP-700-800", White, Height of cove should be field verified by GC to end on a full tile height.
1. Light pocket can have up to 6 week lead time and should be ordered as soon as possible.
2. Light pocket endcap should only be installed when the end of the cove is not against a wall.

D. Suspension System: Provide intermediate duty, structural class, direct hung systems adequate to support light fixtures, ceiling diffusers and other normal accessories.
1. Exposed "Tee" Grid System for use with Lay-In Ceiling panels: USG "Donn DX System" non-fire rated with 15/16" exposed face, cold-rolled galvanized steel with aluminum face cap, white paint finish on exposed surfaces. Provide hemmed edge aluminum wall angles, 15/16" exposed leg, white paint finish matching exposed grid.
2. Concealed "Tee" Grid System for use with Painted Gypsum Board Ceilings & Soffits or with Cementitious Wood Fiber Acoustical Panels (Tectum): USG "DGLW" Heavy Duty Drywall Suspension System with 1 5/8" deep by 1 1/2" wide main tees and 1 1/2" deep by 1 1/2" wide cross tees.
3. Hanger Wire: No. 12 SWG galvanized steel wire.
4. Heavy Duty "Tee" Grid System for use with Felt Baffle Ceiling System: USG Donn Brand DX/DXL with 15/16" wide face tees, color: black

3.1 Installation

A. Install acoustical ceiling materials and suspension systems in strict accordance with manufacturer's recommendations, complying with governing regulations and industry standards applicable to the work.

B. Suspension system installation shall be laser leveled with a maximum surface leveling tolerance of 1/8" in 12'-0".

C. Install exposed Tee suspension systems with main tees nominally 12 ft long spaced 48 in O.C. and cross tees nominally 4 feet long spaced 24 in O.C.

D. Install concealed Tee suspension systems with main tees nominally 12 ft long spaced 24 inches O.C. and cross tees nominally 2 ft long spaced 48 in O.C.

E. Hanger wire shall be spaced 48" O.C. along main tees, at all four corners of light fixtures (where applicable), at midpoint of cross tees adjacent to light fixtures and duct outlets, and adjacent to main tee splices.

F. Secure wire hangers by looping and wire-tying either directly to building structure or to hangers that are secure and appropriate for substrate.

G. Provide edge trim molding at perimeter of acoustical ceiling installation and intermediate vertical surfaces. Use maximum lengths. Miter trim corners to Provide tight, accurate joints. Connect moldings securely to substrate surfaces.

SECTION 09653 - RUBBER WALL BASE

1.1 General: Provide resilient rubber wall base as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. ASTM D 2240 Rubber - 85 Shore A

2.1 Materials:

A. Manufacturer: Johnsonite, Inc., (800) 899-8916, internet: www.johnsonite.com
1. Basis-of-Design Product Rubber Wall Base:
a. Resilient Rubber:
1. .125" (3.17 mm) Thickness
2. "Black" color
3. Straight (toeless) or coved as specified on finish plan
4. Inside and outside corners with 4" returns.

B. Alternate Wall Base only when approved by Arch PM and Chipotle DM.
1. Vinyl Wall Base
a. .125" (3.17 mm) Thickness
b. "Black" color
c. Straight (toeless) or coved as specified on finish plan
d. Inside and outside corners with 4" returns.

C. Setting Adhesive
1. For porous surface applications: Johnsonite 960 Acrylic Cove Base Adhesive
2. For non-porous surface applications: Johnsonite 946 Contact Bond Adhesive or polymer based alternative

3.1 Installation:

A. Preparation: Clean substrate surfaces scheduled to receive resilient rubber and vinyl wall base thoroughly and remove all coatings that may impair bond. A uniform temperature of at least 65 degrees Fahrenheit shall be maintained for 24 hours before, during and after the installation is completed. The wall base and adhesives shall be conditioned in the same manner. Coiled wall base shall be uncoiled and lay flat for at least 24 hours at 65 degrees Fahrenheit prior to installation. Floor and walls shall be clean, dry, and free of dust, all paints, wallpaper, and all other foreign material, which may affect proper adhesive bonding. Wall base may be installed on interior plaster, gypsum wall board, concrete, masonry, mineral-reinforced cement board or similar porous surfaces. Wall base shall not be installed on surfaces that will be exposed to drastic temperature changes or moisture.

B. Application: Use a 1/8" square notch trowel to apply adhesive. Allow adhesive to set up and then apply wall base in accordance with manufacturer's instructions.

SECTION 09770 - SPECIAL WALL SURFACING - PHENOLIC INTERIOR WALL PANELS

1.1 General: Provide Stonewood solid phenolic panels and accessories for interior walls and millwork as shown and specified.

1.2 Related Sections:

A. Section 05400 - Cold Formed Metal Framing

B. Section 06210 - Finish Carpentry and Millwork

C. Section 07900 - Joint Sealers

D. Section 09260 - Gypsum Board Systems

1.3 Standards: Materials and construction shall conform to the following:

A. ASTM D638 - 10 Standard Test Method for Tensile Properties of Plastics.

B. ASTM D790 - 10 Standard Test Methods for Flexural Properties of Unreinforced and Reinforced Plastics and Electrical Insulating Materials.

C. ASTM E84 - 12 Standard Test Method for Surface Burning Characteristics of Building Materials.

D. NEMA Standards Publication LD3-2005. High pressure decorative laminates.

1.4 Design/Performance Requirements:

A. Design and size of wall panel assemblies including wall panels, mounting system to support weight of panels.

B. Allow for thermal movements from ambient and surface temperature changes by preventing buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base calculations on expected movement of material as defined in fabrication guidelines.

1.5 Quality Assurance:

A. Manufacturer's Qualifications:
1. Sufficient plant facilities to provide quality and quantity of materials as required without delaying progress of work.
2. Minimum of 40 years of experience in paper saturation of phenolic resin, and producing phenolic paper laminate.

B. Fabricator:
1. Fabricated by the manufacturer, and/or;
2. Contracted by the customer, minimum 5 years' experience in fabrication work for the size and complexity of the projects.

C. Installer
1. Proven professional installer with a minimum of 5 years of documented experience.
2. Approved by the manufacturer.

1.6 Delivery, Storage and Handling:

A. Refer to Section 01400 Quality Requirements.

B. Delivery: Deliver materials in manufacturer's original unopened containers/packages, with labels clearly identifying product name, manufacturer, color/texture and weight.

C. Storage:
1. Keep panels dry and stored indoors in original packaging until installation.
2. Store Stonewood panels on a smooth, dry, flat surface, making sure there are no bends or bowing in the load.
3. Do not store directly on cold concrete floors as moisture may migrate.
4. Do not store under heating units or air conditioning units.
5. Keep load stored within outer wrap until use. Remove pallet straps once load is moved to storage area.
6. Reseal plastic wrap if partial load is used.
7. Keep foam dividers in place.

D. Handling:
1. Handle materials in accordance with manufacturer's instructions.
2. Protect materials during handling to prevent damage.
3. When moving sheets, lift evenly to avoid dragging panels across each other and scratching the surface. PLEASE TAKE CARE NOT TO SCRATCH THE SURFACE OF THE PANEL DURING HANDLING, MACHINING AND INSTALLATION.

1.7 Warranty:

A. Limited Warranty: Fibbers warrants Stonewood for a period of 10 years. Refer to www.stonewoodpanels.com for details.

1.8 Project Conditions:

A. Environmental Limitations: Buildings are to be fully enclosed prior to installation with sufficient heat (70 degrees) and ventilation consistent with good working conditions for finish work.

B. Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not install products under environmental conditions outside manufacturer's absolute limits.

C. Field Measurements: Verify locations of structural members and wall opening dimensions by field measurements before composite wall panel fabrication and indicate field measurements on Shop Drawings.

2.1 Manufacturer:

A. Fiberesin Industries, Inc. PO Box 808, Oconomowoc, WI 53066. Phone: (262) 567-4427, Fax: (262) 567-4814, Web Site: www.stonewoodpanels.com Email: info@fiberesin.com

B. Made in the United States from materials sourced in the USA.

2.2 Application:

A. Apply Solid Phenolic Laminate Wall Panels at walls and other surfaces as indicated on the Drawings. Phenolic Wall Panels are architectural wall panels applied over a sheathed stud wall or other solid blocking per Drawings.

2.3 Interior Stonewood:

A. Material: Solid phenolic laminate panel w/o overlay.
B. Color: Black ND
C. Finish: Matte
D. Standard Size: 48"x96", fabricator to trim height to 47"
E. Panel Thickness: 5/16", 1/2"
F. Panel Core: HR Black

2.4 Minimum Material Properties

A. NEMA Requirements:

Description	NEMA Requirements	
Dimensional Change:	3.11	
Length (Machine Direction)	0.3% Maximum	0.25%
Width (Cross Direction)	0.7% Maximum	0.50%
Density (PCF)	82	

B. Mechanical Properties:

Property	NEMA Requirements	
Flexural Strength ASTM D-790		
MD (psi)	18,000	20,000
CD (psi)	12,000	16,000
Flexural Modulus ASTM D-790		
MD (psi)	1.6x10^6	2.0 x10^6
CD (psi)	1.4x10^6	1.5x10^6
Tensile Modulus ASTM D-638		
MD (psi)	18,000	18,000
CD (psi)	12,000	13,000

C. Fire Resistance:

	Class A (0.250")	Class B (0.250")
Flame Spread Index - ASTM E-84 (BLDG):	5	30
Smoke Developed Values - ASTM E-84 (BLDG):	5	105
Fire Rating (Standard Product is Class B):	A	B

D. Manufacturing Tolerance:

Thickness (.156 to .375)	+/- .020
Thickness (above .375 to 1.000)	+/- .030
CNC Shaped Size (Length - Width)	+/- .020
Drill Diameter	+/- .003
Drill Depth	+/- .020
CNC Hole to Hole	+/- .020
CNC Hole to Edge (1 Oper)	+/- .020
CNC Hole to Edge (2 Oper)	+/- .030
Routing - (Slots Width and Length)	+/- .015
Routing - (Slots Depth)	+/- .020

2.5 Accessories (Fasteners):

A. Panel Fasteners: #10 x 1-1/4" flat phillips head black oxide wood screws to be used with wood blocking and #10 x 1-1/4" flat phillips head black oxide sheet metal screws to be used with sheet metal blocking as recommended by the manufacturer.
B. Provide exposed fasteners with heads matching color of composite wall panels by means of factory-applied coating.
C. Fasteners shall by designed to withstand effects of dead load and accommodate hydrothermal expansion/contraction of panel.
D. Wall Panel Accessories: Provide components required for a complete composite wall panel assembly including trim, flashings, sealants, gaskets, fillers, closure strips, and similar items. Match material and finish of composite wall panels unless otherwise indicated.

3.1 Manufacturer's Execution Instructions:

A. Compliance: Comply with manufacturer's/fabricator's/supplier's product data, handling and installation instruction/manual, shop drawings, shipping container/package ticket identification, etc.

3.2 Examination:

A. Verify correct panels received including dimension, tolerance, color/texture.
B. Verify correct attachment system received for the specific project/job.
C. Verify all the documents including shop drawing and installation guidelines.
D. Verify installation conditions are satisfactory to receive work of this section before the commencement
E. Verify substrate installation is complete, flat, and true to plane.
F. If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.

3.3 Preparation:

A. Field Measurements: Verify prior to fabrication and installation of the cladding panel.
B. Protect surrounding areas and surfaces to preclude damage during work of this section.
C. Lay out work before beginning installation as necessary for true, plumb and aligned panel installations.
D. Verify locations of joints and panel lengths.

3.4 Installation:

A. Conform to manufacturer's instructions and provisions of shop drawings.
B. Install to allow hydro-thermal expansion/contraction.
C. Use appropriate techniques/tools to work with the panel.
D. Do not force to fit, do not bend, stretch/compress.
E. Make cutting and fitting neat, square, and true. Where required cut, de-burr edges, and clean filings from adjacent surfaces.
F. Do not install damaged or questionable panels.
G. Install solid phenolic wall panels plumb and level and accurately spaced.
H. Anchor panels and other components of the work securely in place, with provisions for thermal and structural movement.
I. Shim or otherwise plumb substrates receiving composite wall panels.
J. Do not use construction adhesives to apply wall panels directly to substrates or wall board. Use mechanical fasteners only.

3.5 Erection Tolerances:

A. Shim and align composite wall panel units within installed tolerance of 1/4 inch in 20 feet, non-accumulative, on level, plumb, and location lines as indicated and within 1/8 inch offset of adjoining faces and of alignment of matching profiles.

3.6 Field Quality Control:

A. Manufacturer's Field Service: Provide field services to ensure product installation is in accordance with manufacturer's/fabricator's /supplier's instructions and installation manual, shop drawings etc.

3.7 Adjusting:

A. Correct identified defects and irregularities.
B. Replace damaged soiled, and discolored work.

3.8 Cleaning:

A. Leave installation clean and free from residue and debris from work of this Section.
B. Panels best cleaned with warm soapy water and rinsed with clear water; allowed to dry fully.

SECTION 09900 - PAINTS AND COATINGS

1.1 General: Provide paints and coatings as shown and specified.

A. Provide surface preparation, prime, intermediate and finish coatings for interior and exterior and existing scheduled surfaces and items.

B. Provide Tenant-selected finishes and colors for all exposed surfaces, unless otherwise indicated.

1.2 Related Documents:

A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this section.

1.3 Summary:

A. This section includes surface preparation and field painting of the following:
1. Exposed exterior items and surfaces.
2. Exposed interior items and surfaces.
3. Surface preparation, priming, and finish coats specified in this Section are in addition to shop priming and surface treatment specified in other Sections.

1.4 Quality Assurance:

A. Applicator Qualifications: Engage an experienced applicator that has completed painting system applications similar in material and extent to that indicated for this Project with a record of successful in-service performance.

B. Source Limitations: Obtain block fillers, primers and undercoat materials for each coating system from the same manufacturer as the finish coats.

C. Provide lead free prime and finish coatings. All top coatings shall be mold and mildew resistant.

1.5 Delivery, Storage and Handling:

A. Deliver materials to the Project Site in manufacturer's original, unopened packages and containers bearing manufacturer's name and label, and the following information:
1. Product name or tile of material.
2. Product description (generic classification or binder type).
3. Manufacturer's stock number and date of manufacture.
4. Contents by volume, for pigment and vehicle constituents.
5. Thinning instructions.
6. Application instructions.
7. Color name and number.
8. VOC content

B. Store materials not in use in tightly covered containers in a well-ventilated area at a minimum ambient temperature of 45 degrees F (7 degrees C). Maintain containers used in storage in a clean condition, free of foreign materials and residue.
1. Protect from freezing. Keep storage area neat and orderly. Remove oily rags and waste daily. Take necessary measures to ensure that workers and work areas are protected from fire and health hazards resulting from handling, mixing and application.

1.6 Project Conditions

A. Apply water-based paints only when the temperatures of surfaces to be painted and surrounding air temperatures are between 50 and 90 degrees F (10 and 32 degrees C) unless otherwise stated on the technical data bulletin.

B. Apply solvent-thinned paints only when the temperature of surfaces to be painted and surrounding air temperatures are between 45 and 95 degrees F (7.2 and 35 degrees C).

C. Do not apply paint in snow, rain, fog, or mist, or when the relative humidity exceeds 85 percent, or at temperatures less than 5 degrees F (3 degrees C) above the dew point, or to damp or wet surfaces.
1. Painting may continue during inclement weather if surfaces and areas to be painted are enclosed and heated within temperature limits specified by manufacturer during application and drying periods.

2.1 Manufacturers:

A. Products: Subject to compliance with requirements, provide one of the products in the paint schedules.

B. Manufacturers Names: The following manufacturer is referred to in the paint schedule by use of shortened versions of the name, which is shown below:
1. PPG Industries, Inc.
2. Materials - No substitutions allowed.

2.2 Paint Materials, General

A. Material Compatibility: Provide block fillers, primers, undercoats, and finish-coat materials that are compatible with one another and the substrates indicated under conditions of service and application, as demonstrated by manufacturer based on testing and field experience.

B. Material Quality: Provide manufacturer's best-quality "professional" paint material of the various coating types specified. Paint-material containers not displaying manufacturer's product identification will not be acceptable.

Colors: Color guided selected by owner and will be strictly adhered too, unless otherwise noted.

C. Exterior Coatings:

Exterior Ferrous Metals:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from steel surface. Uniformly roughen surface with 150-grit paper. Remove all dust before solvent cleaning by the use of stiff bristle brush.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Application: Conventional or HVLP (high volume low pressure)

Exterior and Interior Gas Piping:

Preparation: Remove all visible oil, grease, soil, rust and all other soluble contaminates from pipe surface. Remove all dust before solvent cleaning by the use of stiff bristle brush.
Prime: (1) Coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) Coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils
Application: Conventional or HVLP (high volume low pressure)

Exterior Patio Railing:

Preparation: Remove all visible oil, grease, soil, loose paint, rust and all other soluble contaminates from steel surface. Remove all dust before solvent cleaning SSPC-SP1 by the use of stiff bristle brush. SSPC-SP3 may be required as a more aggressive preparation to remove loose mill scale, loose rust, loose paint and other loose detrimental foreign matter from the surface. Performance is better with more aggressive preparation.
Prime: (1) coat PPG; 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Finish: (1) coat PPG; 95-3300 Durathane DTM Urethane Mastic (250 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Prefinished Metal Wall Panels:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-603XI Alkali Resistant Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:
Prime: (1) coat XIM Primer Bond - Applied at a dry film thickness of not less than 1.5 to 2.0 mils.
Finish: (2) coats PPG; 90-1110 Series Pitt-Tech Satin DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:
Prime: (1) coat PPG; 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.
Finish: (2) coats PPG; 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC):
Prime: (1) coat PPG; Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.
Finish: (2) coats PPG; Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Exterior Galvanized Metal:

Preparation: Before applying primer or other surface treatments, clean galvanized metal surface to SSPC-SP1 that could impair bond of the various coatings. Remove oil, grease and soap film before priming use of Krud Kutter Metal Clean & Etch may be required on bare or new galvanized. Surface must be clean, dry and free of contaminants, including salt deposits. Additional prep may be needed to SSPC-SP2. Schedule cleaning and painting so dust and other contaminants from the cleaning process will not fall on wet, newly painted surfaces.

Note: Some selected areas of bare concrete surfaces will require (1) coat of Perma Crete 4-503 Concrete Primer before steel installation over all concrete surfaces.

Owner Option 1:
Prime: (1) coat PPG; 6-209 SpeedHide Galvanized Metal Primer (400 g/L VOC): Applied at a dry film thickness of not less than 3.0 to 5.0 mils.
Finish: (2) coats PPG; 4216 Plus HP Series Pitt-Tech Plus Semi-Gloss DTM Industrial Enamels (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 2:
Prime: (1) coat PPG; 97-245 Pitt-Guard DTR Epoxy Mastic Primer (263 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 7.0 mils.
Finish: (2) coats PPG; 95-3300 Durathane Urethane Mastic (240 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.

Owner Option 3 (Low VOC);
Prime: (1) coat PPG; Amerlock 2 Fast Dry VOC Compliant Epoxy (84 g/L VOC): Applied at a dry film thickness of not less than 4.0 to 6.0 mils.
Finish: (2) coats PPG; Amershield VOC Aliphatic Urethane (84 g/L VOC): Applied at a dry film thickness of not less than 5.0 to 8.0 mils.

Application: Conventional or HVLP (high volume low pressure) be done with conventional spray or airless equipment or brush or roller.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G016

Exterior CMU Primer:

CMU Preparation: Mortar should cure for at least 30 days and preferably 90 days prior to priming. Fill block with an appropriate block filler. Surfaces previously coated with water thinned cement-based paint must be prepared with extra care. If the material appears to be adhering tightly, a masonry sealer may be applied to seal the surface. Check adhesion by applying a piece of masking tape. If the sealer peels off and has loose particles, remove all chalking or crumbling material, re-seal and re-check adhesion.

Field Preparation: Surfaces to be coated must be dry, clean, sound, and free from all contamination including loose and peeling paint, dirt, grease, oil, wax, concrete curing agents and bond breakers, chalk, efflorescence, mildew, rust, product fines, and dust. Remove loose paint, chalk, and efflorescence by wire brushing, scraping, sanding, and/or pressure washing. Putty all nail holes and caulk all cracks and open seams. Sand all glossy, rough, and patched surfaces. Feather back all rough edges to sound surface by sanding.

Prime: (2) Coats PPG; Speedhide Interior/Exterior Masonry Hi Fill Latex Block Filler

Application: Brush, Roll or Spray

Exterior Stucco/EIFS Surfaces (including wet areas):

Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions and/or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 4-603 Perma-Crete Alkali Resistant Primer (100 g/L VOC): Applied at a dry film thickness of not less than 1.2 to 1.9 mils.
Finish: (2) coats PPG; 4-22 Perma-Crete Hi-Build Acrylic (100 g/L VOC): Applied at a dry film thickness of not less than 3.2 to 5.8 mils.
Application: Airless spray with back roll using 3/4" nap roller.

Exterior Wood:

Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions and or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 17-921 Seal Grip Primer Sealer (100 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Finish: (2) coats PPG; 70-501 Manor Hall Exterior Semi-Gloss or PPG Acri-Shield Semi-Gloss PP649 (50 g/L VOC): Applied at a dry film thickness of not less than 1.5 to 3.0 mils.
Application: Brush, Roll or Spray

D. Interior Coatings:

Interior Metals: (Doors, door frames, where indicated)
Preparation: Remove all visible rust, oil, grease, soil and all other foreign substances with cleaning solutions and/or scrapers. Allow to dry and sand all areas that need smoothing and dust off.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils. (Repaints only require spot prime on bare metal surfaces.)
Finish: (2) coats PPG; V-50-410 Breakthrough Semi-gloss Sheen Acrylic (250 g/L VOC): Applied at a dry film thickness of not less than 1.4 to 2.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Metals: (Metal Deck if indicated on Finish Plan)
Preparation: Remove all visible rust, oil, grease, soil and all other foreign substances with cleaning solutions and allow to dry before priming.
Prime: (1) coat PPG; 4020PF Series Pitt-Tech Plus Int/Ext DTM Acrylic Industrial Primer (90 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils. (Primer only required on unpainted decking or to spot prime bare areas in decking.)
Finish: (2) coats PPG; 90-1110 Pitt-Tech Plus Satin Acrylic (100 g/L VOC): Applied at a dry film thickness of not less than 2.0 to 4.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Gyp. Bd.:
Preparation: Remove all visible oil, grease, soil and all other foreign substances with cleaning solutions. Fill hairline cracks, holes and other defects with filler compatible with finish coats. Sand smooth all areas filled and/or areas to make a smooth overall finish.
Prime: (1) coat PPG; 9-900 Pure Performance Acrylic Primer (0 g/L VOC): Applied at a dry film thickness of not less than 1.4 to 2.0 mils. (Spot prime required only on repaint projects.)
Finish: (2) coats PPG; Pure Performance Zero VOC Eggshell 9-500 Series, sheen as shown on finish plan: Applied at a dry film thickness of not less than 1.5 to 2.0 mils.
Application: Conventional spray, HVLP or Airless spray. Touch-ups shall be done with conventional spray or airless equipment or brush or roller.

Interior Wood Trim and Plywood - Clear Polyurethane Finish:
(Plywood finishes shall be shop applied in a controlled environment)

Shop Preparation: Scuff sand between coats.

Shop Finish: (2) coat, ML Campbell Krystal conversion varnish, Clear Dull Sheen
Application: Spray

Field Preparation: All cuts in field are to be sanded smooth. Scuff sand between coats.

Field Finish: (2) coat, ML Campbell High Performance Pre-Cat Lacquer, Clear Dull Sheen
Application: Wipe on with t-shirt rag.

Exterior Traffic Safety Marking.:
Preparation: All surfaces must be clean, dry and free from oil, grease, antifreeze, loose sand, aggregate and chipping/peeling existing striping. Any curing compounds used on new concrete must be mechanically abraded off prior to striping. When striping on freshly sealed surfaces use caution as some sealers can affect the curing and adhesion of traffic paint. When in doubt, always test adhesion.

For complete drying and minimum dirt retention when striping parking lots, the lots should be closed to traffic for two hours minimum after painting. New asphalt and concrete should be allowed to cure for a minimum of 14 days to maximize adhesion and durability.
Owner Option 1:
Finish: (1) coat PPG; A-2886B Type II, White Zone Marking - Applied at a dry film thickness of not less than 8.6 mils.

Owner Option 2:
Finish: (1) coat PPG; A-2886B Type II, Yellow Zone Marking - Applied at a dry film thickness of not less than 8.6 mils

Application: Applying a test strip to determine dry to no- pickup time when the humidity is higher than 65%. Cone whenever necessary.
- Do not heat paint in striping system above 60 C.
- Do not apply when temperatures are below 3 C.
- Do not apply when rain is forecast.
- Do not apply when temperatures are near or below the dew point or rain is forecast within 1 hour.
- Do not thin more than 5% with acetone and then use immediately.
- Do not apply if temperature is expected to fall below freezing for 6 hours after application of paint.

Application Equipment: Apply with a high quality brush, roller, or by airless spray equipment.

Airless Spray: Pressure 2000 psi, tip 0.015" - 0.021"Spray equipment must be handled with due care and in accordance with manufacturer's recommendation. High-pressure injection of coating s into the skin by airless equipment may cause serious injury.
Brush: Polyester/Nylon Brush
Roller: All-purpose nap roller cover.

E. Color Guide: Refer to Finish Plan and drawings for exact location of all colors.

WHERE	WHAT	COLOR	SHEEN	FINISH TAG
Exterior Traffic Safety Marking	PPG A-2886B Type II, Low VOC Acrylic Fast Dry Solvent	PPG White Zone Marking	Satin	N/A
Exterior Traffic Safety Marking	PPG A-2886B Type II, Low VOC Acrylic Fast Dry Solvent	PPG Yellow Zone Marking	Satin	N/A
Exterior Galvanized Metal, Flashing and Prefinished Metal Wall Panels	PPG Pitt-Tech Plus Satin Acrylic Finish 90-1110 Series	PPG 1001-6 "Knight's Armor"	Satin	N/A
Exterior (Roof Mounted) Gas Piping	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	Yellow	Semi-Gloss	N/A
Exterior and Interior Gas Piping, Where Exposed	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	Match surrounding finishes/verify with architect	Semi-Gloss	N/A
Exterior CMU Primer	PPG Speedhide Interior/Exterior Masonry Hi Fill Latex Block Filler	White	Flat	N/A
Exterior CMU	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Ferrous Metals	PPG Pitt-Tech Plus Semi-Gloss Acrylic Finish 4216 Plus HP Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Wood	PPG Manor Hall Acrylic Semi-Gloss 70-501 Series or PPG Acri-Shield Acrylic Semi-Gloss PP649 Series	PPG 1001-6 "Knight's Armor"	Semi-Gloss	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1001-6 "Knight's Armor"	Flat	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1010-2 "Fog"	Flat	N/A
Exterior Stucco and EIFS Patio and Wet Areas	PPG Perma-Crete High Build Acrylic Topcoat 4-22 Series	PPG 1058-7 "Autumn Ridge"	Flat	N/A
Interior Doors, Door Frames, Rails and Rail Frames, Where Specified	PPG Breakthrough 50 Acrylic Satin	PPG V51-90 Black	Satin	D1
Interior Ferrous Metals, Where Specified	PPG Breakthrough 250 Acrylic Eggshell V50-410 Series	PPG 1013-5 "Victorian Pewter"	Eggshell	N/A
Dining Room and Hallway Gyp. Bd.	PPG Pure Performance Zero VOC Semi-Gloss 9-500 as indicated on finish plan	PPG 1001-3 "Thin Ice"	Semi-Gloss	P4
Dining Room and Hallway Gyp. Bd.	PPG Pure Performance Zero VOC Eggshell 9-310 as indicated on finish plan	PPG 1001-3 "Thin Ice"	Eggshell	P3
Dining Room and Hallway Gyp. Bd. Ceiling	PPG Pure Performance Zero VOC Flat 9-100 Series or PPG Speedhide 6-4110XI Flat	PPG 1041-1 "Moonlit Snow"	Flat	C3
Restroom, Cooking, Kitchen and Serving Area Soffit Gyp. Bd.	PPG Pure Performance Zero VOC Eggshell 9-500 Series	PPG 1041-1 "Moonlit Snow"	Eggshell	C3
Interior Metal Roof Deck and Metal Columns	PPG Pitt-Tech Plus Satin Acrylic Finish 90-1110 Series	PPG 1013-5 "Victorian Pewter"	Satin	C1
Patio Railing	Durethane DTM Urethane 95-3300 Series	PPG 1001-6 "Knight's Armor"	Gloss	N/A

3.1 Installation:

A. Examination:
1. Verify that site environmental conditions are appropriate for application of coatings specified.
2. Immediately prior to coating application, ensure that surfaces to receive coatings are dry.
3. Ensure that moisture-retaining substrates to receive coatings have moisture content within tolerances allowed by coating manufacturer, using moisture measurement techniques recommended by coating manufacturer.
4. Immediately prior to coating application, examine surfaces to receive coatings for surface imperfections and for contaminants which could impair performance or appearance of coatings, including but not limited to, loose primer, rust, scale, oil, grease, mildew, algae, or fungus, stains or marks, cracks, indentations, or abrasions.
5. Correct the above conditions and any other conditions which could impair performance or appearance of coatings in accordance with specified surface preparation procedures before proceeding with coating application.

B. Preparation:
1. Do not start work until surfaces to be finished are in proper condition to produce finished surfaces of uniform, satisfactory appearance.
2. Stains and Marks: Remove completely, if possible, using materials and methods recommended by coating manufacturer; seal with shellac or other coating acceptable to paint manufacturer stains and marks that might bleed through paint finishes which cannot be completely removed.
3. Remove or protect hardware, electrical plates, mechanical grilles and louvers, lighting fixture trim, and other items not indicated to receive coatings which are adjacent to surfaces to receive coatings.
4. Remove mildew from impervious surfaces by scrubbing with solution of disodium phosphate and bleach. Rinse with clean water and allow substrate to thoroughly dry.
5. For specific substrate preparation, see individual specifications.
6. Provide necessary staging, ladders, shield, protective coverings and drop cloths. Protect floors, walls and adjacent work and materials. Remove and properly replace temporary protection and coverings removed from any part of the work or finish. Repair damage at Contractor's expense.

C. Application:
1. General: Mix, prepare and apply paint according to manufacturer's written instructions.
   a. Use applicators and techniques best suited for substrate and type of material being applied.
   b. Do not apply high-performance coatings over dirt, rust, scale, grease, moisture, scuffed surfaces, or conditions detrimental to forming a durable coating film.
   c. Coating surface treatments, and finishes are indicated in the coating system descriptions.
   d. Provide finish coats compatible with primers used.
   e. The term "exposed surfaces" includes areas visible when permanent or built-in fixtures, convector covers, grilles, covers for finned-tube radiation, and similar components are in place. Extend coatings in these areas, as required, to maintain system integrity and provide desired protection.
2. Application Procedures: Apply coatings by brush, roller, spray, or other applicators according to manufacturer's written instructions.
   a. The number of coats and film thickness required is the same regardless of application method.
   b. Completed Work: Match approved Samples for color, texture, and coverage. Remove, refinish, or recoat work that does not comply with specified requirements as directed by Tenant. Paints and coatings work is subject to acceptance by the Tenant.
   c. Keep brushes and rollers clean, free from contamination and suitable for the finish required.
   d. Unless otherwise indicated, allow exterior paints to dry for 48 hours and interior paints to dry for 24 hours between coats.
   e. Sand lightly and remove dust between coats to achieve required finish.
   f. Finished surfaces shall be uniform in finish and color and free of brush marks, sagging, holidays, corduroy and other imperfections. Coverage and hide shall be complete.
   g. Edges of paint or finish adjoining other materials or colors shall be sharp and clean without overlapping. Cut paint in neatly around glass or other edges.
   h. Paints and coatings work is subject to acceptance by the Tenant. Correct unsatisfactory work not complying with these specifications as directed by the Tenant.

D. Cleaning:
1. After completing painting, clean glass and paint spattered surfaces. Remove spattered paint by washing and scraping without scratching or damaging adjacent finished surfaces.

E. Protection:
1. Protect work of other trades, whether being painted or not, against damage from painting. Correct damage by cleaning, repairing or replacing, and repainting, as approved by Architect / Tenant.
2. Provide "Wet Paint" signs to protect newly painted finishes. After completing painting operations, remove temporary protective wrappings provided by others to protect their work.
3. After work of other trades is complete, touch up and restore damaged or defaced painted surfaces.

F. Maintenance: Furnish extra paint materials from the same production run as the materials applied in the quantities described below. Package paint materials in unopened, factory-sealed containers for storage and identify with labels describing contents. Deliver extra materials to the Tenant.
1. Provide one gallon of paint and wood stain of each type and color required for maintenance purposes. Provide original, unopened, labeled containers with color samples and a list of project use.

DIVISION 10 - SPECIALTIES

SECTION 10522 - PORTABLE FIRE EXTINGUISHES

1.1 General: Provide portable fire extinguishers as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. NFPA 10 "Standard for Portable Fire Extinguishers.

2.1 Materials:

A. Provide minimum 10 lb. capacity fire extinguishers in quantity and type complying with local code and fire regulations requirements.
1. Provide new fire extinguishers fully loaded, tested, UL and FM labeled and listed and ready for use.
2. Provide manufacturer's recommended mounting brackets and hardware.

3.1 Installation:

A. Install fire extinguishers in accordance with manufacturer's installation instructions, at heights and locations acceptable to the local fire regulations enforcement authority

SECTION 10700 - EXTRUDED ALUMINUM CANOPY

1.1 General: Provide canopies as shown and specified.

A. Standards: Materials and installation shall conform to the following:
1. AWS, D1.1 - Structural Welding Code - Steel
2. AMMA, Aluminum Finishes AAMA 2604 (FGIA 2604) - Powder Coat

B. Quality Assurance
1. Shop Drawings: To be created under the guidance of a professional engineer. Site Specific stamped drawing may be required by the manufacturer based on location. Drawings must indicate size, material and finish. Include plan, elevations and sections to clearly outline the canopy locations. Include installation procedures, details of joints, attachments and clearances.
   a. Submit within 15 days after contract award.
2. Color charts showing manufacturer's full range of colors from standard line including Chipotle's custom "charcoal" color match to prototypical window mullion system.

2.1 Manufacturers:

A. Architectural Fabrication, Inc. – Manufacturer is located at 2100 E. Richmond Avenue, Fort Worth, TX 76104. P: (800) 962-8027. E: chipotle@arch-fab.com, W: www.arch-fab.com
B. Substitutions are acceptable assuming they comply with this specification, are submitted based on Quality Assurance and Division1 - Section 01100 requirements and have minimum 10 years experience, and only when approved by Arch PM and Chipotle DM.
1. Awnex, Contact: Katie Dicks, P: 770-704-7140 x151, E: katie@awnexinc.com
2. Uni-Structures, Contact: Dana Fredericks, P: 678-974-1773
3. API, Contact: Jade Moore-Esposito, P: 813-925-0144, E: jesposito@americanproducts.com

2.2 Materials:

A. Specifications are based on Architectural Fabrication, Inc. - Helios Canopy Patent #9,976,310
1. Framing: Gutter fascia, tube, angles: 6063-T6 alloy extruded aluminum. Gutter to be notched in the back to allow steel support arms to pass through.
2. Decking: Extruded aluminum 8" wide deck pan in 6063-T6 or 6063-T5 alloy (Roll form is not acceptable)
3. Steel Support Arms: 3" x 3" x .250" Steel tube support arms w/ 8" w x 5"h x 1/2" thick steel plate welded to the back. Must manufacture steel arm in manner to leave room for LED enclosure at back of canopy.
4. Hardware and Fasteners: Nuts, bolts, washers, clevis pins, screws, anchors and pipe spacers to be zinc plated or galvanized steel required to suit application and per pre-engineered canopy load requirements. Typical wall anchors are minimum ½" diameter. Touch up paint must be provided for each canopy to allow for potential repairs in the field.
5. Flashing: Shall be minimum 0.040-inch aluminum, fabricated to prevent leakage and sealed with Novaflex metal roof sealant in custom color match. Another equivalent sealant is acceptable.
6. LED Enclosure: Each canopy is to have a preformed aluminum LED enclosure along the back edge of the canopy finished in the same powder coat as the canopy. 1" nominal inside width, and a minimum aluminum sheet thickness of .063".
7. Scuppers: Drainage for canopy is (2) aluminum scuppers located at the front of the canopy per drawings. See finish below for details.
8. Finish: All aluminum shall be powder coat finish per FGIA 2604 (aka AAMA 2604). Steel shall be commercially blasted, then coated with a zinc rich primer, and finally the top coat of super polyester powder (2604 compliant) applied.

3.1 Installation:

1. Install canopies per manufacturer's written instructions and videos, and as indicated on architectural drawings
2. Locate and place canopies level, plumb and at indicated alignment with adjacent work.
3. Use concealed anchors where possible.
4. Repair damaged finishes so no evidence remains of corrective work. Return items to the factory that cannot be refinished in the field. Make required alterations and refinish entire unit or provide new units.
5. Protect galvanized and nonferrous-metal surfaces from corrosion or galvanic action by applying a coating of bituminous paint or elastomeric coating on surfaces that will be in contact with concrete, masonry or dissimilar metals.

DIVISION 11- NOT APPLICABLE

DIVISION 12- FURNISHINGS

SECTION 12495 - WINDOW SHADES

1.1 General: Provide window shades as shown and specified.

A. Standards: Shade fabric material shall meet the requirements of the following:
1. NFPA 701 Flame Test and California US Title 19 for flame retardant materials.

B. Field measure window openings and verify installation conditions prior to window shade fabrication

C. Warranty:
1. 5 years against defects in materials and workmanship.
2. 1 year for service call repairs and adjustments.

2.1 Materials:

A. Manufacturer: Insolroll Window Shading Systems, Inc. (800) 447-5534, internet www.insolroll.com

B. Window Shades: Insolroll 2000 Solar Screen Shades, manual operation.
1. Solar Screen Shade Fabric: Insolroll woven fiberglass yarn, 5% openness, Charcoal/Bronze color.
2. Provide manufacturer's recommended mounting brackets and hardware.

C. Fabrication: Unless otherwise indicated, fabricate window shade units to completely fill existing window openings from jamb to jamb and from head to 42" AFF or the nearest horizontal mullion from 40"-44" AFF.
1. Adjustment system controlled by plastic bead chain on polyester cord. Multi-banded steel spring clutches keep shade in desired position.
2. Roller tube 2" extruded aluminum, sized to minimize deflection.
3. Fabric attached to roller tube using two-sided adhesive tape.
4. Fabric bottom hem RF heat sealed pocket with enclosed hem bar.

3.1 Installation:

A. Install window shades level and plumb in accordance with manufacturer's installation instructions and drawing details. Provide units securely anchored in place with recommended hardware and accessories to provide smooth operation without binding.

DIVISIONS 13 - 14 - NOT APPLICABLE

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2022
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: JBA
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SPECIFICATIONS

G017

GENERAL DEMOLITION NOTES

1.	DEMOLISHED MATERIALS SHALL BECOME THE GENERAL CONTRACTOR'S PROPERTY AND SHALL BE REMOVED FROM THE SITE WITH FURTHER DISPOSITION AND RECYCLED BY THE GENERAL CONTRACTOR'S OPTION, UNLESS NOTED OTHERWISE.
2.	SURVEY THE CONDITION OF THE BUILDING TO DETERMINE WHETHER REMOVING ANY ELEMENT MIGHT RESULT IN STRUCTURAL DEFIICIENCY OR UNPLANNED COLLAPSE OF ANY PORTION OF THE STRUCTURE OR ADJACENT STRUCTURES DURING SELECTIVE DEMOLITION.
3.	PERFORM SURVEYS AS THE WORK PROGRESSES TO DETECT HAZARDS RESULTING FROM SELECTIVE DEMOLITION ACTIVITIES.
4.	MAINTAIN EXISTING UTILITIES TO REMAIN IN SERVICE AND PROTECT THEM AGAINST DAMAGE DURING SELECTIVE DEMOLITION OPERATIONS.
5.	CONDUCT DEMOLITION OPERATIONS AND REMOVE DEBRIS TO ENSURE MINIMAL INTERFERENCE WITH ROADS, STREETS, WALKS, AND OTHER ADJACENT OCCUPIED AND USED FACILITIES. REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS. PROMPTLY DISPOSE OF DEMOLISHED MATERIALS. PROMPTLY DISPOSE OF DEMOLISHED AMTERIALS. DO NOT ALLOW DEMOLISHED MATERIALS TO ACCUMULATE ON SITE.
6.	PROVIDE TEMPORARY WEATHER PROTECTION, DURING INTERVAL BETWEEN DEMOLITION, REMOVAL OF EXISTING EXTERIOR CONSTRUCTION AND NEW CONSTRUCTION TO ENSURE THAT NO WATER DAMAGE OCCURS TO STRUCTURE OR INTERIOR AREAS.
7.	TOTAL SCOPE OF DEMOLITION MAY NOT BE COVERED ON THIS SHEET. REVIEW ALL SHEETS IN THIS DRAWING SET TO DETERMINE TOTAL SCOPE OF DEMOLITION.
8.	REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS.
9.	TRANSPORT DEMOLISHED MATERIALS OFF OWNER'S PROPERTY AND LEGALLY DISPOSE OF THEM.
10.	CLEAN ALL HORIZONTAL SURFACES OF ACCUMULATED DUST AND DEBRIS.
11.	ALL DEMOLITION ITEMS ON THIS SHEET TO BE PERFORMED BY CHIPOTLE'S GENERAL CONTRACTOR, UNLESS NOTED OTHERWISE.
12.	COORDINATE ALL DEMOLITION ACTIIVTY WITH BUILDING OWNER'S REPRESETATIVE. SOME DEMOLITION ACTIVIITES MAY BE REQUIRED TO BE PERFORMED ON PREMIUM TIME.
13.	CONTRACTOR SHALL TAKE ADEQUATE PRECAUTIONS TO PROTECT ALL ADJACENT AND REMAINING BUIDLING COMPONENTS.
14.	EXISTING FOUNDATIONS TO BE PROTECTED AND UNDISTURBED. UNLESS OTHERWISE NOTED.
15.	ALL SALVAGED ITEMS, INCLUDING BUT NOT LIMITED TO LINES, ELECTRICAL PANELS, MAIN COPPER CONDUIT, ETC. SHALL BE CAREFULLY DISASSEMBLED/DISCONNECTED AND STORED IN A SECURE LOCATION FOR POSSIBLE REUSE.
16.	IDENTIFIED SELECTIVE DEMOLITION IS FOR REFERENCE ONLY. ADDITIONAL DEMOLITION MAY BE REQUIRED TO ACCOMMODATE NEW LAYOUT; REFER TO NEW WORK PLANS AND ELEVATIONS. ALL DIMENSIONS SHOWN SHOULD BE VERIFIED IN THE FIELD.
17.	MAINTAIN EXISTING SPRAY-ON FIREPROOFING OF EXISTING STRUCTURE AND FIRE RATED ASSEMBLIES. ANY COMPROMISE OF EXISTING FIRE RATING SHALL BE PATCHED AND REPAIRED TO ORIGINAL CONDITION.
18.	ANY EXISTING FINISHED SURFACES TO REMAIN THAT ARE AFFECTED BY SELECTIVE DEMOLITION SHALL BE PATCHED TO MATCH EXISITNG ADJACENT SURFACES UNLESS CONCEALED BY NEW CONSTRUCTION.
19.	UTILITIES ABANDONED SHALL BE REMOVED AND CAPPED BEHIND FINISHED SURFACES.
20.	IN SHARED SPACES WITH OTHER TENANTS, SEAL ALL INTAKE AND EXHAUST AIR PRIOR TO DEMOLITION.
21.	ALL EXISTING EXTERIOR DOORS, FRAMES AND STOREFRONT TO REMAIN, UNLESS OTHERWISE NOTED.

KEYED DEMOLITION NOTES


1	REMOVE EXISTING FLOOR FINISH THROUGHOUT THE SPACE TO THE CONCRETE SLAB BELOW. PATCH AND REPAIR ANY DAMAGED SLAB.
2	REMOVE ANY EXISTING WALL FINISH THROUGHOUT THE SPACE. PATCH AND REPAIR AS NECESSARY.
3	REMOVE ANY EXISTING SUSPENDED CEILING, INCLUDING CEILING TILE, GRID, SOFFIT AND FINISHES.
4	REMOVE ANY NON-LOAD BEARING PARTITIONS, LOW WALLS, DOORS, DOOR FRAMES AND ASSOCIATED HARDWARE ENTIRELY.
5	REMOVE PORTION OF THE EXISTING EXTERIOR WALL AND STOREFRONT AS INDICATED, PATCH AND REPAIR MASONRY OPENING TO RECEIVE NEW WALL CONSTRUCTION FOR INTERIOR PATIO AREA AS SPECIFIED AND DETAILED IN CDS
6	REMOVE EXISTING CANOPIES, PATCH AND REPAIR TO RECEIVE CMG PROTOTYPICAL CANOPY AS SPECIFIED.
7	REMOVE EXISTING METAL FASCIA. PATCH AND REPAIR TO MATCH EXTERIOR FINISHES AS SPECIFIED ON EXTERIOR ELEVATIONS.
8	REMOVE ALL EXISTING STOREFRONT, DOORS, AND WINDOWS ENTIRELY AND PREPARE THE EXISTING MASONRY OPENINGS FOR NEW STOREFRONT AND WINDOWS AS SPECIFIED.
9	REMOVE ANY EXISTING FURNITURE THAT IS NOT REMOVED BY THE LANDLORD
10	REMOVE EXISTING ROOF TOP EQUIPMENT AND ANY UNUSED DUCTWORK, PIPES, UNITS FROM THE CEILING.
11	REMOVE EXISTING CLOSET DOOR, PATCH AND REPAIR MASONRY OPENING TO RECEIVE NEW WALL CONSTRUCTION SIMILAR TO THE ADJACENT AND EXTERIOR FINISHES AS SPECIFIED
12	REMOVE EXISTING REAR DOOR. PATCH AND REPAIR MASONRY OPENING TO RECEIVE NEW CMG SERVICE DOOR AS SPECIFIED
13	REMOVE PORTION OF THE EXISTING WALL AND EXISTING DRIVE THRU WINDOW. PATCH AND REPAIR TO RECEIVE NEW CMG DRIVE THRU WINDOW.
14	REMOVE EXISTING INTERIOR ROOF HATCH AND REPLACE IT IN THE SAME LOCATION.
15	REMOVE ANY MISCELLANEOUS DEBRISE/EQUIPMENT, ETC. THROUGHOUT SPACE.

GENERAL PLAN NOTES

1.	UPON REMOVAL OF ALL EXISITNG FLOOR FINISHES SURVEY EXISTING SLAB AND PROVIDE PATCHING AND/OR FIRESTROPPING AS REQUIRED FOR PROPER SEAL AND AS REQUIRED BY CODE.
2.	UPON REMOVAL OF ALL EXISTING CEILING FINISHES, SOFFITS, ETC. SURVEY EXISING DECK FOR PENETRATIONS AND PATCH AND/OR FIRESTOP FOR PROPER SEAL AND AS REQUIRED BY CODE.
3.	GENERAL CONTRACTOR TO SCOPE EXISTING SANITARY LINES PRIOR TO PREPARING FOR NEW CONNECTIONS.

DEMOLITION LEGEND

EXISTING CONSTRUCTION TO REMAIN	
EXISTING CONSTRUCTION TO BE DEMOLISHED	— — — — — — — — — — — — — —

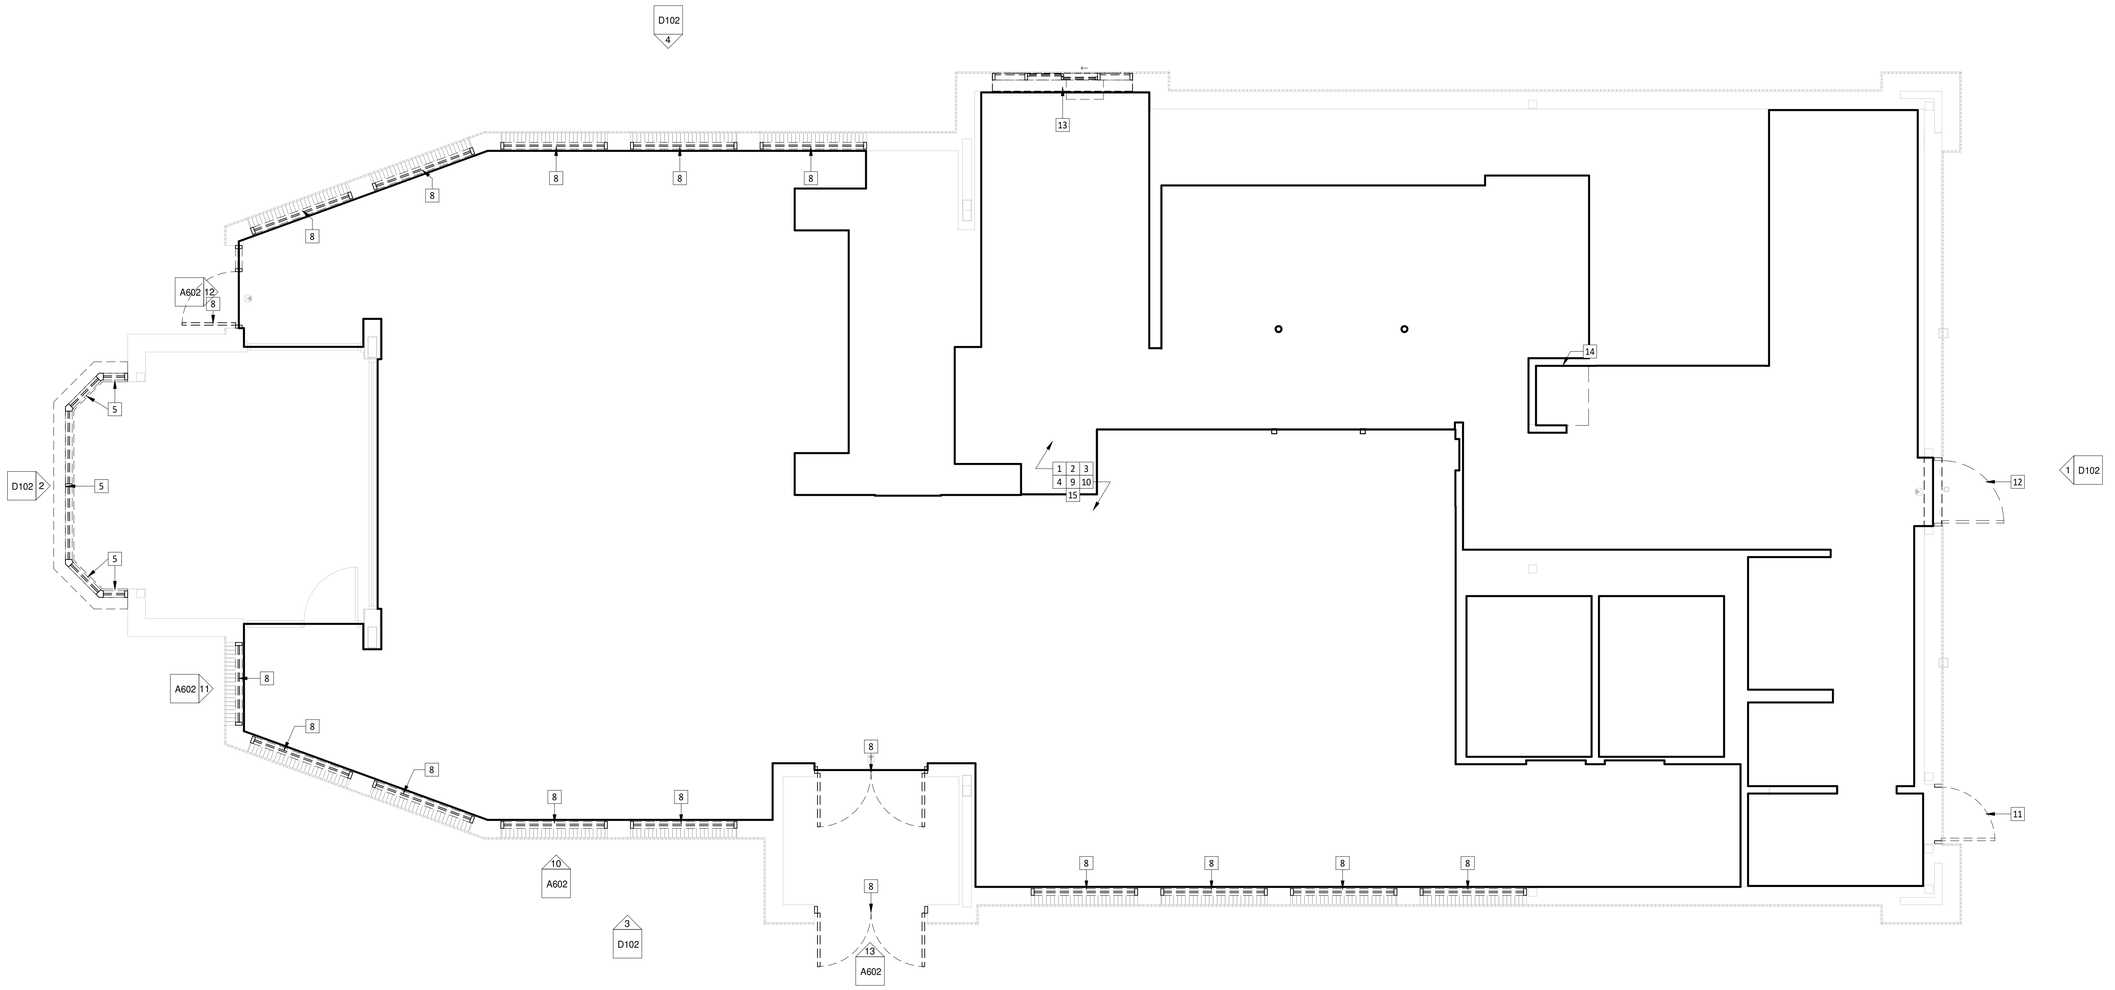

DEMOLITION PLAN
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

DEMOLITION PLAN


D101

GENERAL NOTES


1. REFER TO D101 FOR GENERAL DEMOLITION NOTES AND LEGEND

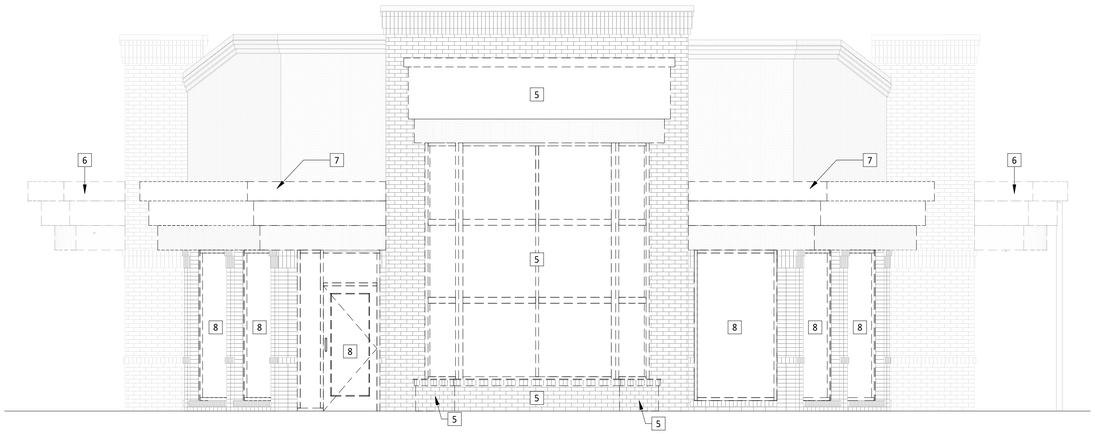


2 D102 **EXTERIOR ELEVATION - SOUTH EAST - DEMOLITION**
1/4" = 1'-0"

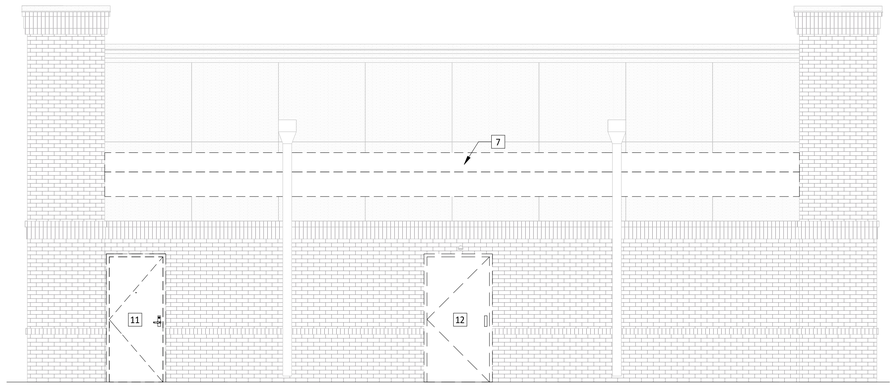

1 D102 **EXTERIOR ELEVATION - NORTH WEST - DEMOLITION**
1/4" = 1'-0"

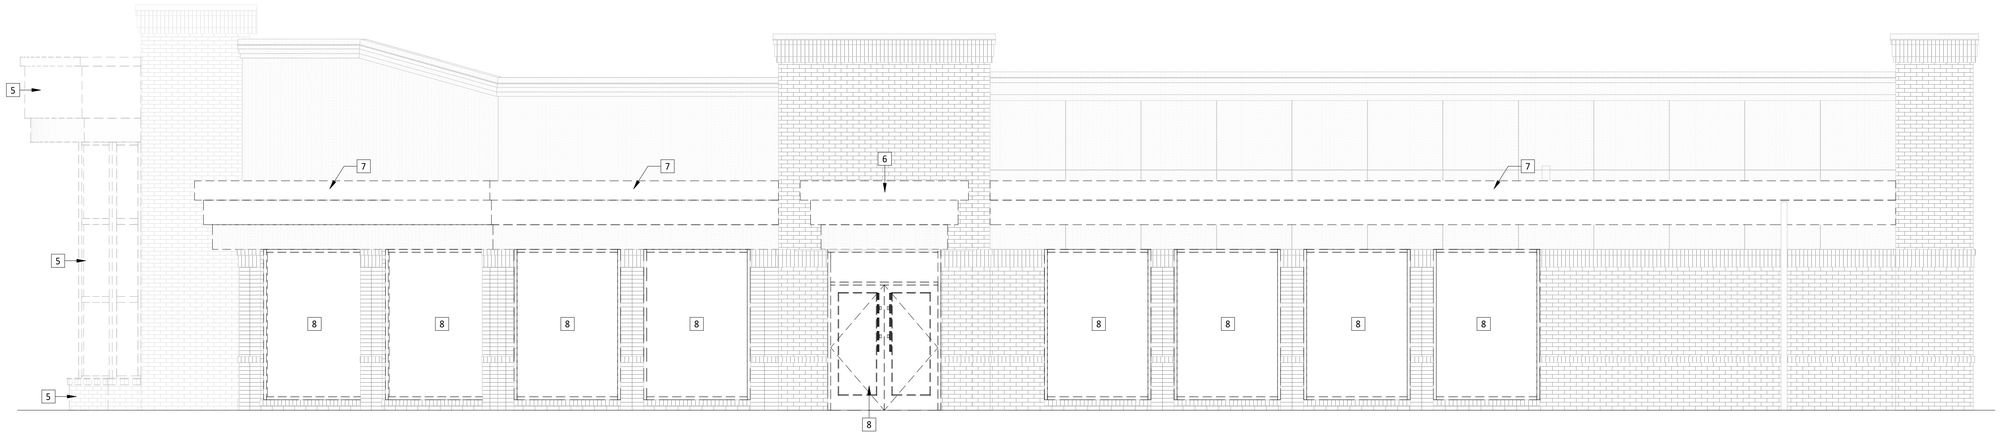

3 D102 **EXTERIOR ELEVATION - DEMOLITION**
1/4" = 1'-0"

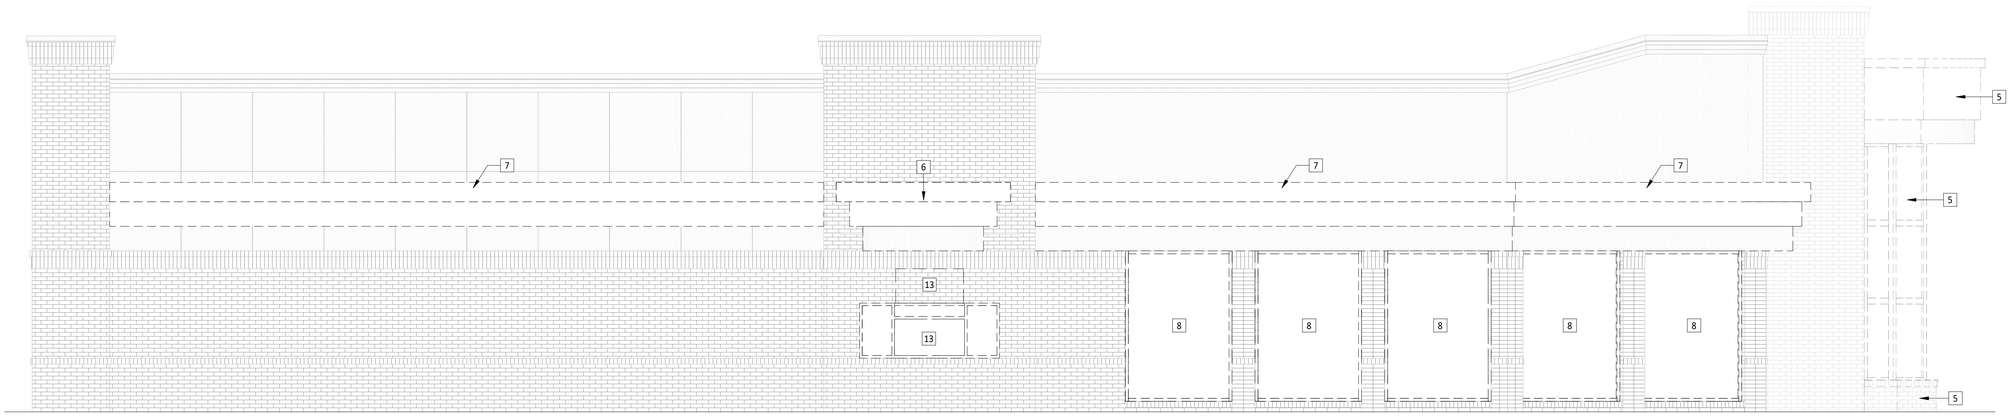

4 D102 **EXTERIOR ELEVATION - DEMOLITION**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000


Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

DEMOLITION ELEVATIONS

D102

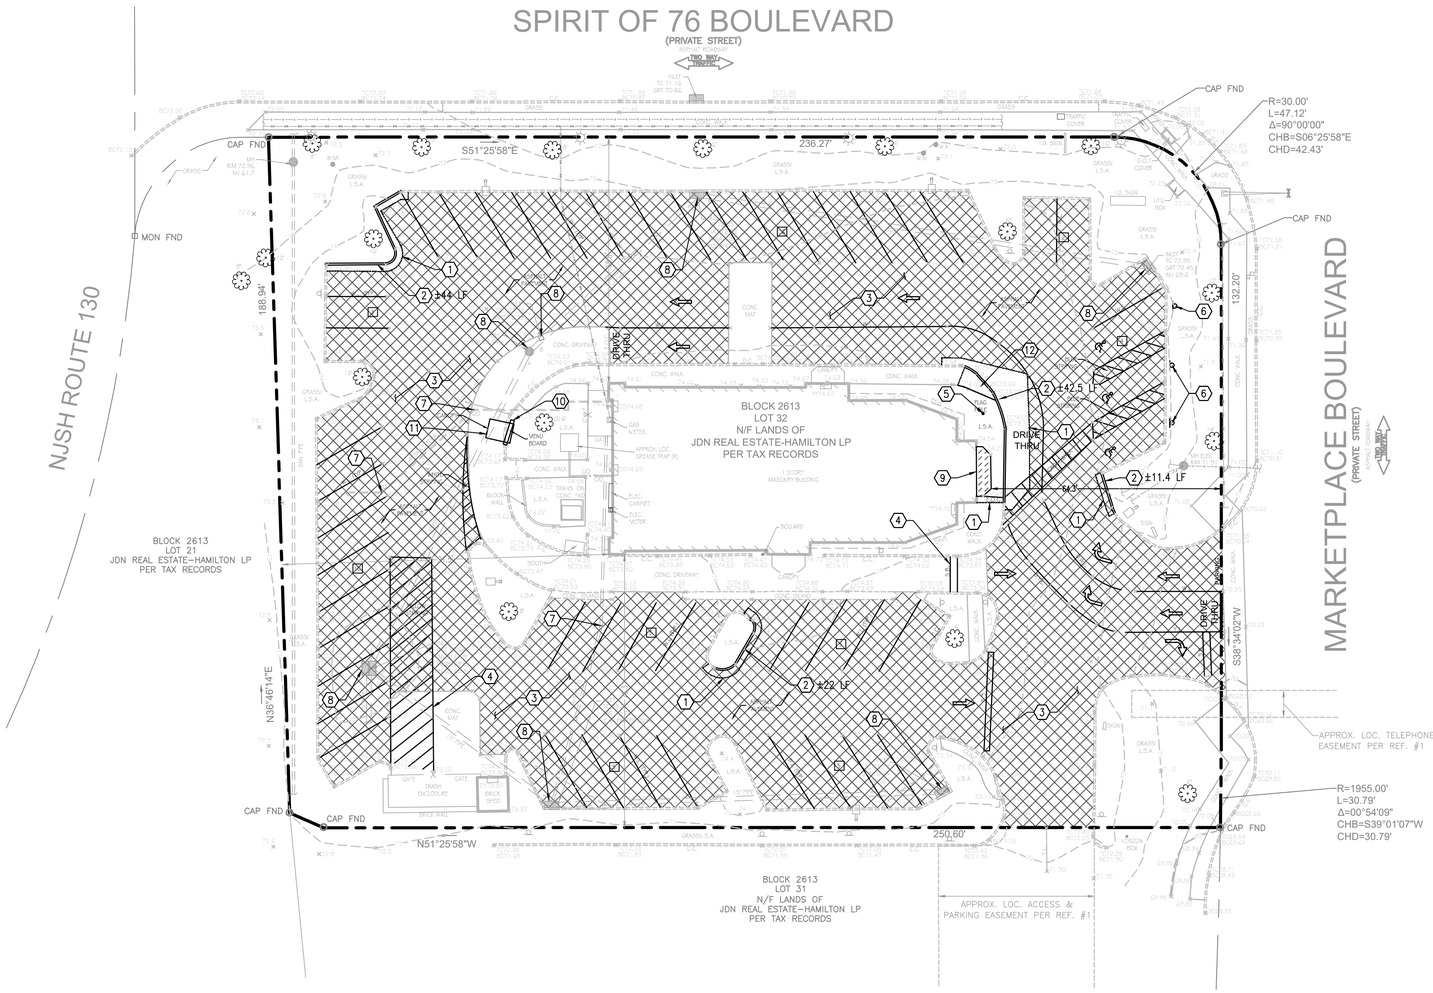

SITE DEMOLITION PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE DEMOLITION NOTES

1. ANY DEMOLITION IS TO BE PERFORMED IN STRICT CONFORMANCE WITH APPLICABLE MUNICIPAL, COUNTY AND STATE, AND/OR GOVERNING BODY'S STANDARDS.
2. THE DEMOLITION PLAN SHALL BE DONE IN CONJUNCTION WITH THE GEOTECHNICAL INVESTIGATION REPORT.
3. EROSION AND SEDIMENT CONTROL MEASURES SHALL BE MAINTAINED AT ALL TIMES DURING DEMOLITION.
4. THE PURPOSE OF THIS DRAWING IS TO CONVEY THE OVERALL SCOPE OF WORK AND IT IS NOT INTENDED TO COVER ALL DETAILS OR SPECIFICATIONS REQUIRED TO COMPLY WITH GENERALLY ACCEPTED DEMOLITION PRACTICES.
5. THE DEMOLITION PLAN IS INTENDED TO SHOW REMOVAL OF KNOWN SITE FEATURES AND UTILITIES AS SHOWN ON THE SURVEY. THERE MAY BE OTHER SITE FEATURES, UTILITIES, STRUCTURES, AND MISCELLANEOUS ITEMS BOTH BURIED AND ABOVE GROUND THAT ARE WITHIN THE LIMITS OF WORK THAT MAY NEED TO BE REMOVED FOR THE PROPOSED PROJECT THAT ARE NOT SHOWN HEREON. THE CONTRACTOR IS RESPONSIBLE FOR THE REMOVAL OF SUCH ITEMS AT NO ADDITIONAL COST TO THE OWNER.
6. THE CONTRACTOR SHALL CONTACT RESPECTIVE UTILITY COMPANIES PRIOR TO DEMOLITION TO COORDINATE DISCONNECTION AND REMOVAL OF EXISTING UTILITIES WITHIN THE AREA OF WORK.
7. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ANY DAMAGE TO EXISTING UTILITIES THAT ARE INTENDED TO CONTINUE TO PROVIDE SERVICE WEATHER THESE UTILITIES ARE SHOWN ON THE PLAN OR NOT.
8. UPON DISCOVERY OF ANY UNDERGROUND TANKS, CONTRACTOR SHALL IMMEDIATELY NOTIFY THE OWNER'S REPRESENTATIVE. NO REMOVAL OF TANKS SHALL OCCUR UNTIL AUTHORIZED BY OWNER.
9. BUILDING AND APPURTENANCES DESIGNATED FOR DEMOLITION SHALL NOT BE DISTURBED BY THE CONTRACTOR UNTIL THEY HAVE BEEN FURNISHED WITH NOTICE TO PROCEED BY THE OWNERS. AS SOON AS SUCH NOTICE HAS BEEN GIVEN, THE CONTRACTOR SHALL PERFORM THE DEMOLITION, UNDER THE DIRECTION OF THE OWNER'S REPRESENTATIVE.
10. DEBRIS SHALL NOT BE BURIED ON THE SUBJECT SITE. ALL UNSUITABLE MATERIAL AND DEBRIS SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN ACCORDANCE WITH ALL CITY, STATE, AND FEDERAL LAWS AND ORDINANCES.
11. ALL MATERIAL, EXCEPT THAT BELONGING TO A PUBLIC UTILITY COMPANY OR DENOTED FOR SALVAGE, SHALL BECOME PROPERTY OF THE CONTRACTOR. THE CONTRACTOR SHALL NOTIFY THE OWNER OF WATER, ELECTRIC, OR GAS METERS WHEN THE METERS ARE READY FOR REMOVAL, AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR DISCONNECTING ALL UTILITIES IN COMPLIANCE WITH LOCAL REQUIREMENTS. TRANSFORMERS TO BE DISCONNECTED AS REQUIRED FOR BUILDING DEMOLITIONS.
12. AS SOON AS DEMOLITION WORK HAS BEEN COMPLETED, THE FINAL GRADE OF BACKFILL IN DEMOLITION AREAS SHALL BE COMPACTED PER THE GEOTECHNICAL REPORT TO PRESENT A NEAT, WELL DRAINED APPEARANCE, AND TO PREVENT WATER FROM DRAINING UNNECESSARILY ONTO ADJACENT PROPERTIES. CONTRACTOR SHALL GRADE SITE TO EXISTING STORM DRAINAGE SYSTEM TO REMAIN ON SITE.
13. EXISTING TREES TO REMAIN SHOULD BE PROTECTED FROM DAMAGE DURING DEMOLITION AND CONSTRUCTION.
14. THE CONTRACTOR IS TO COORDINATE WORK IN THE PROJECT TO ENSURE ACCESS TO ADJACENT PROPERTIES AT ALL TIMES.
15. THE USE OF EXPLOSIVES SHALL NOT BE PERMITTED.
16. CONTRACTOR TO IMPLEMENT APPROPRIATE TRAFFIC CONTROL MEASURES PER LOCAL CODE.

SITE DEMOLITION CALLOUTS

(#)

1. SAWCUT EXISTING PAVEMENT (FULL DEPTH)
2. REMOVE EXISTING CONCRETE CURB
3. MILLING EXISTING ASPHALT PAVEMENT (2-INCH) FOR OVERLAY
4. REMOVE STRIPING OVER CONCRETE PAVEMENT
5. REMOVE EXISTING FLAG POLE
6. RELOCATE EXISTING HANDICAP SIGN (SEE SITE LAYOUT FOR RELOCATIONS)
7. EXISTING SANITARY SEWERAGE STRUCTURE TO BE PROTECTED DURING CONSTRUCTION
8. EXISTING STORM DRAINAGE STRUCTURE TO BE PROTECTED DURING CONSTRUCTION
9. REMOVE PORTION OF EXISTING BUILDING (REFER TO ARCHITECTURAL DRAWINGS)
10. REMOVE EXISTING MANU BOARD
11. REMOVE EXISTING CANOPY
12. REMOVE RAMP

SITE DEMOLITION LEGENDS

- PROPERTY LINE
- EXISTING BUILDING
- EXISTING CONCRETE CURB
- EXISTING CONCRETE SIDEWALK
- EXISTING ELECTRICAL LINE
- EXISTING GAS LINE
- EXISTING STORM LINE
- EXISTING SANITARY LINE
- SAWCUT EXISTING PAVEMENT (FULL DEPTH)
- REMOVE EXISTING CURB
- DEMOLISH BUILDING STOREFRONT (REFER TO ARCH.
- MILL AND OVERLAY EXISTING ASPHALT PAVEMENT

REFERENCE

1. EXISTING SITE CONDITIONS AND TOPOGRAPHIC INFORMATION SHOWN ON THIS PLAN ARE BASED ON PLAN ENTITLED "BOUNDARY & TOPOGRAPHIC SURVEY – LOT 32, BLOCK 2613 – 555 MARKETPLACE BOULEVARD, TOWNSHIP OF HAMILTON, MERCER COUNTY, STATE OF NEW JERSEY", PREPARED BY GALLAS SURVEYING GROUP, DATED 1/4/2021.

www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN
PROJECT MANAGER
R. SCOTT
QUALITY CONTROL
R. SCOTT
DRAWN BY
J. CHU


PROJECT NAME
CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32

PROJECT NUMBER
20210067.0

SHEET TITLE
SITE DEMOLITION PLAN

SHEET NUMBER
C-1.0
NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\jmcott\AppData\Local\Temp\AcPublish_11348\20210067.0 Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:55am by jmcott

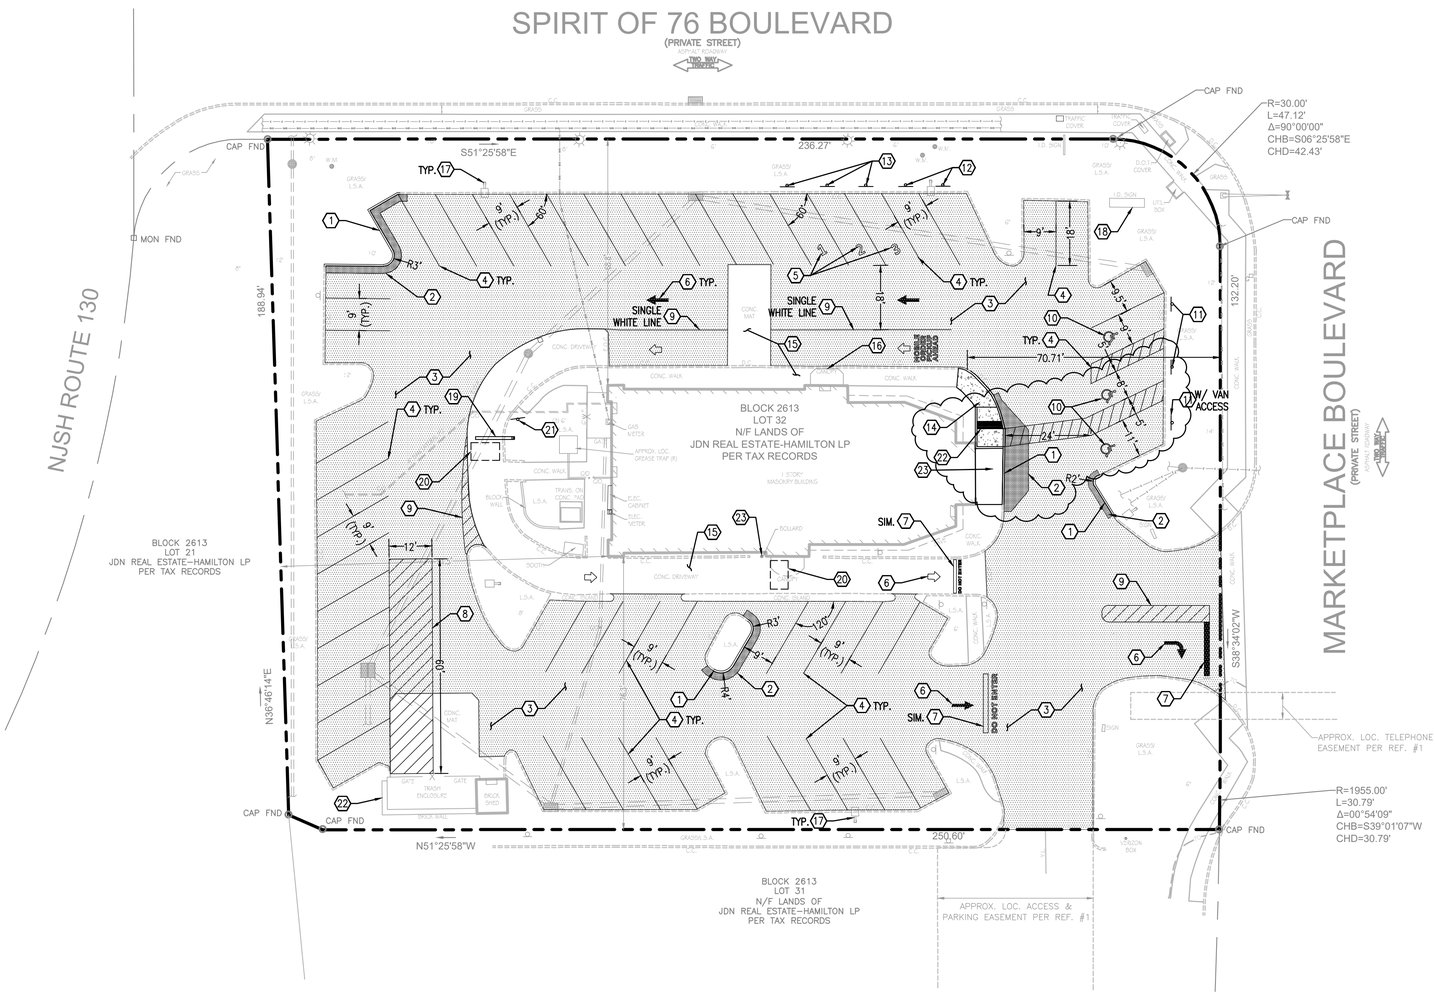

SITE LAYOUT PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE LAYOUT NOTES

1. CONTRACTOR MUST SECURE ALL NECESSARY PERMITS PRIOR TO STARTING WORK.
2. IF THE CONTRACTOR IN THE COURSE OF WORK, FINDS ANY DISCREPANCIES BETWEEN THE PLANS AND THE PHYSICAL CONDITIONS OF THE SITE, OR ANY OTHER ERRORS OR OMISSIONS IN THE PLANS OR IN THE LAYOUT, THE ENGINEER SHALL BE NOTIFIED IN WRITING, AND THE ENGINEER WILL PROMPTLY VERIFY THE SAME. ANY WORK DONE AFTER SUCH A DISCOVERY, UNTIL AUTHORIZED, WILL BE AT THE CONTRACTOR'S RISK.
3. CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF ALL SETBACKS, EASEMENTS, AND DIMENSIONS SHOWN HEREON BEFORE BEGINNING CONSTRUCTION.
4. ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE TO THE STATE AND LOCAL GOVERNMENT AGENCY'S LATEST CONSTRUCTION SPECIFICATIONS AND DETAILS.
5. ALL ACCESSIBLE (ADA) SITE FEATURES SHALL BE CONSTRCUTED TO MEET ALL FEDERAL, STATE, AND LOCAL GUIDELINES.
6. THE CONTRACTOR SHALL CAREFULLY PRESERVE BENCHMARKS, REFERENCE POINTS AND STAKES.
7. ALL DIMENSIONS ARE MEASURED FROM FACE OF BUILDING, CURB, AND WALL UNLESS OTHERWISE SPECIFIED ON PLANS.
8. CONTRACTOR SHALL MAINTAIN THE SITE IN A MANNER SO THAT WORKMEN AND PUBLIC SHALL BE PROTECTED FROM INJURY, AND ADJOINING PROPERTIES ARE PROTECTED FROM DAMAGE.
9. CONTRACTOR IS RESPONSIBLE FOR DAMAGE TO ANY EXISTING ITEMS AND/OR MATERIAL INSIDE OR OUTSIDE CONTRACT LIMITS DUE TO CONSTRUCTION OPERATIONS.
10. ALL STREET SURFACES, DRIVEWAYS, CULVERTS, CURB AND GUTTERS, ROADSIDE DRAINAGE DITCHES AND OTHER STRUCTURES THAT ARE DISTURBED OR DAMAGED IN ANY MANNER AS A RESULT OF CONSTRUCTION SHALL BE REPLACED OR REPAIRED IN ACCORDANCE WITH THE SPECIFICATIONS.
11. CONTRACTOR TO REPLACE ANY CURBS, SIDEWALKS, LANDSCAPING, ETC. THAT IS DISTURBED DURING CONSTRUCTION OUTSIDE LIMITS OF DISTURBANCE.
12. CONTRACTOR TO REPAIR OR REPLACE ANY EXISTING CURBS THAT ARE DAMAGED WITHIN THE AREA OF WORK.
13. ALL ROAD WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE STATE AND LOCAL GOVERNMENT AGENCY SPECIFICATIONS.

SITE LAYOUT CALLOUTS

(#)

1. STANDARD CONCRETE CURB
2. FULL DEPTH PAVEMENT RESTORATION
3. MILLING AND OVERLAY EXISTING ASPHALT PAVEMENT
4. PAVEMENT MARKING – PARKING STRIPING
5. PAVEMENT MARKING – CHIPOTLE PULL–IN PARKING STRIPING
6. PAVEMENT MARKING – TRAFFIC ARROW
7. PAVEMENT MARKING – STOP BAR
8. PAVEMENT MARKING – TEMPORARY LOADING AREA
9. PAVEMENT MARKING – LANE DIVIDER
10. PAVEMENT MARKING – ADA PARKING STRIPING & SYMBOL
11. SIGN POST – ADA PARKING SPACE (RELOCATED)
12. SIGN POST – CHIPOTLE MOBILE PICK–UP PARKING
13. SIGN POST – CHIPOTLE PULL–IN PARKING
14. CONCRETE SIDEWALK
15. REPAIR EXISTING CONCRETE AS NEEDED
16. RE–PAINT EXISTING RAILING (COLOR DIRECTED BY OWNER)
17. RE–PAINT AND RE–LAMP EXISTING LIGHT POLES
18. REMOVE EXISTING MONUMENT SIGNAGE AND REPLACE WITH NEW SIGNAGE
19. CLEARANCE BAR
20. LOOP DETECTOR (REPAIR CONCRETE PAVEMENT AS NEEDED)
21. MOBILE ORDER PICK–UP BOARD
22. RE–PAINT EXISTING DUMPSTER TO MATCH CHIPOTLE COLOR SCHEME (COLOR DIRECTED BY OWNER)
21. RE–PAINT EXISTING BOLLARD (COLOR DIRECTED BY OWNER)
22. ADA RAMP PER STANDARD DETAILS
23. LANDSCAPE AREA

SITE LAYOUT LEGENDS

- PROPERTY LINE
- PROPOSED CONCRETE CURB
- PROPOSED FULL DEPTH PAVEMENT RESTORATION
- PROPOSED PAVEMENT OVERLAY (2–INCH)
- PROPOSED CONCRETE PAVEMENT
- RELOCATED/PROPOSED SIGN POST
- PAVEMENT PARKING – ADA PARKING SYMBOL
- PAVEMENT PARKING – TRAFFIC ARROW

www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN
PROJECT MANAGER
R. SCOTT
QUALITY CONTROL
R. SCOTT
DRAWN BY
J. CHU

PROJECT NAME

CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32


PROJECT NUMBER
20210067.0

SHEET TITLE
SITE LAYOUT PLAN

SHEET NUMBER
C-2.0

NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\rscott\AppData\Local\Temp\AcPublish_11348\20210067.0 Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:50am by rscott

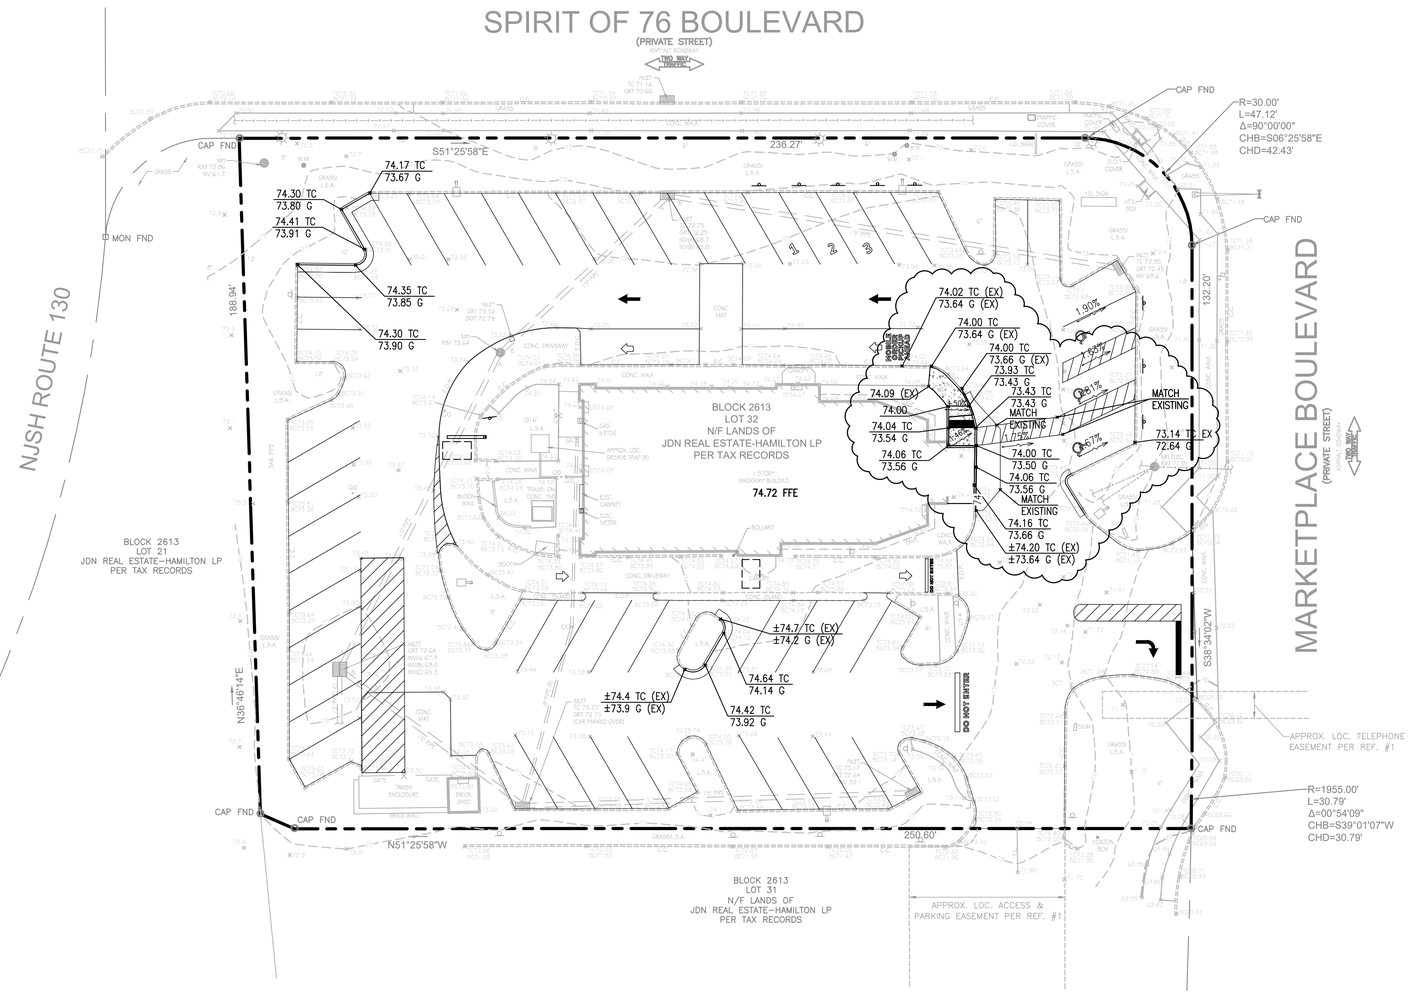

SITE GRADING PLAN

SCALE: 1"= 20'

GRAPHIC SCALE
20 0 10 20
(IN FEET)
1 inch = 20 ft.

NORTH

CALL BEFORE YOU DIG 1-800-272-1000 NEW JERSEY ONE CALL SYSTEM

SITE GRADING NOTES

1. ALL GRADING AND SITE PREPARATION SHALL CONFORM WITH SPECIFICATIONS CONTAINED IN THE GEOTECHNICAL REPORT.
2. ALL CONSTRUCTION MATERIALS AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE TOWNSHIP'S LATEST CONSTRUCTION SPECIFICATIONS AND DETAILS.
3. PRIOR TO ANY EXCAVATION OF THE PROJECT SITE, THE CONTRACTOR SHALL NOTIFY THE TOWNSHIP 48 HOURS PRIOR TO THE START OF CONSTRUCTION.
4. THE CONTRACTOR SHALL CAREFULLY PRESERVE BENCHMARKS, REFERENCE POINT AND STAKES.
5. ALL INDICATED ELEVATIONS ARE FINISHED ELEVATIONS.
6. FIELD VERIFY LOCATIONS, SIZES AND ,IF APPLICABLE, INVERTS OF EXISTING UTILITIES FOR PROPOSED CONNECTIONS PRIOR TO CONSTRUCTION.
7. LOCATE AND PROTECT ALL UTILITIES ASSOCIATED WITH THE PROJECT PRIOR TO CONSTRUCTION.
8. INSTALL SOIL EROSION CONTROL MEASURES BEFORE BEGINNING SITE WORK. THESE MEASURES SHOULD BE MAINTAINED THROUGHOUT CONSTRUCTION.
9. MAINTAIN PROPER SITE DRAINAGE AT ALL TIMES DURING CONSTRUCTION. PREVENT STORMWATER FROM RUNNING INTO OR STANDING IN EXCAVATED AREAS.
10. INSTALL ALL APPROPRIATE TREE PROTECTION MEASURES PRIOR TO GRADING.
11. ALL CUT AND FILL SLOPE SHALL BE 3:1 OR FLATTER UNLESS OTHERWISE NOTED.
12. ALL EXCAVATION SHALL INCLUDE CLEARING, STRIPPING AND STOCKPILING TOPSOIL, REMOVING UNSUITABLE MATERIALS, CONSTRUCTION FILLS, AND THE FINAL SHAPING AND TRIMMING O THE LINES AND GRADES SHOWN ON THE PLANS.
13. STRIP AND STOCKPILE TOPSOIL. SPREAD FOUR (4) INCHES MINIMUM OF TOPSOIL ON LANDSCAPE AREAS AND REMOVE EXCESS TOPSOIL FROM SITE. PREPARE SUB-GRADE FOR PAVEMENT AND CURB AND BACKFILL CURBS AFTER CURB CONSTRUCTION.
14. PROVIDE AND INSTALL TOPSOIL IN DISTURBED AREAS THAT ARE PROPOSED LANDSCAPE AREAS.
15. THE PAVEMENT SUBGRADE AND BASE COURSE MATERIAL SHALL BE INSPECTED AND APPROVED BY THE ENGINEER OR OWNER REPRESENTATIVE PRIR TO CONSTRUCTION OF THE BASE AND SURFACE COURSES THEREON.
16. CONTRACTOR SHALL PROVIDE POSITIVE DRAINAGE TO ALL INLETS AND CATCH BASINS.
17. IF AREAS ARE DISTURBED BEYOND PROPOSED GRADES BY NEGLIGENCE OF THE CONTRACTOR, THE CONTRACTOR SHALL BE HELD RESPONSIBLE, FOR ANY RE-GRADING OR REPAIR TO MATCH ORIGINAL EXISTING CONDITIONS.
18. CONTRACTOR TO VERIFY THE SLOPE OF THE EXISTING HANDICAP RAMP AND ADJACENT SIDEWALK TO MEET THE CURRENT ACCESSIBILITY STANDARDS. NON-COMPLIANT RAMPS AND SIDEWALK SIDEWALK AREAS SHALL BE REMOVED AND REPLACED AT ACCEPTABLE GRADES.

SITE GRADING LEGENDS

- 72 — EXISTING ELEVATION CONTOUR
- ×73.57 EXISTING SPOT ELEVATION
- 74 — PROPOSED ELEVATION CONTOUR
- 74.00 PROPOSED SPOT ELEVATION

TC: TOP OF CURB
G: BOTTOM OF CURB
(EX): MATCH EXISTING GRADE

GF
www.greenbergfarrow.com
1430 West Peachtree Street, NW
Suite 200
Atlanta, GA 30309
t: 404 601 4000

COPYRIGHT NOTICE
This drawing is the property of the above referenced Professional and is not to be used for any purpose other than the specific project and site names herein, and cannot be reproduced in any manner without the express written permission from the Professional.

PROJECT TEAM

ISSUE/REVISION RECORD

DATE	DESCRIPTION
2/18/22	LANDLORD REVIEW
06/09/23	SUBMITTAL
03/19/24	RAMP UPDATE

PROFESSIONAL SEAL

PROFESSIONAL LICENSE NO:
24GE05318000

PROFESSIONAL IN CHARGE
JONATHAN WITTLIN

PROJECT MANAGER
R. SCOTT

QUALITY CONTROL
R. SCOTT

DRAWN BY
J. CHU

PROJECT NAME

CHIPOTLE MEXICAN GRILL
TOWNSHIP OF HAMILTON
NEW JERSEY
555 MARKETPLACE BOULEVARD
BLOCK 2613, LOT 32

PROJECT NUMBER
20210067.0

SHEET TITLE
SITE GRADING PLAN


SHEET NUMBER
C-3.0

NOT ISSUED FOR CONSTRUCTION

Drawing Name: C:\Users\rscott\AppData\Local\Temp\AcPublish_11348\20210067D Master.dwg Last Modified: Mar 19, 2024 - 5:03pm Plotted on: Mar 20, 2024 - 11:55am by rscott


GENERAL NOTES

1. STENCILS FOR PARKING MARKINGS AVAILABLE FROM PAVEMENT STENCIL COMPANY, PHONE: (800) 250-5547, EMAIL: STENCILS@PAVEMENTSTENCIL.COM
2. NOTE: ARCHITECTURAL SITE PLAN IS FOR REFERENCE ONLY. GC TO BUILD FROM CIVIL DRAWINGS. IF THERE IS A DISCREPANCY BETWEEN ARCHITECTURE AND CIVIL, CONTACT ARCHITECT IMMEDIATELY.
3. ALL SITE WORK INCLUDING PAVING, CURBING, PARKING, PARKING LOT LIGHTING, SIDEWALKS, LANDSCAPING AND DUMPSTER ENCLOSURE ARE EXISTING U.N.O.

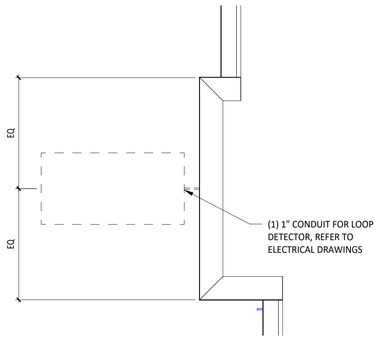


3 SP100 ARCHITECTURAL SITE PLAN DIMENSIONED

1/4" = 1'-0"

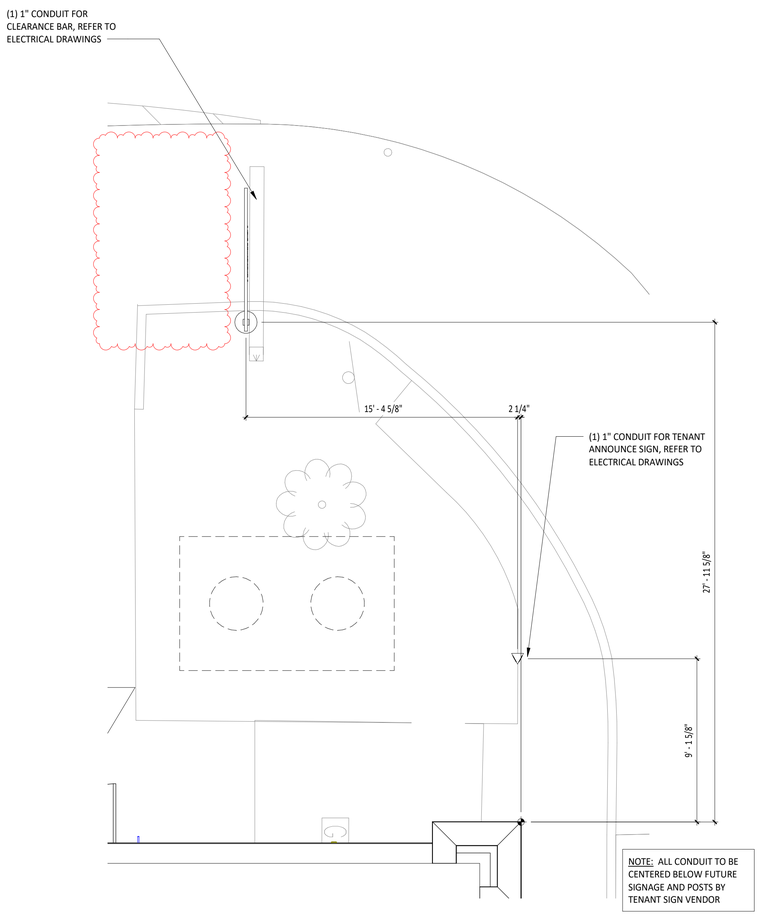

2 SP100 ARCHITECTURAL SITE PLAN DIMENSIONED

1/4" = 1'-0"

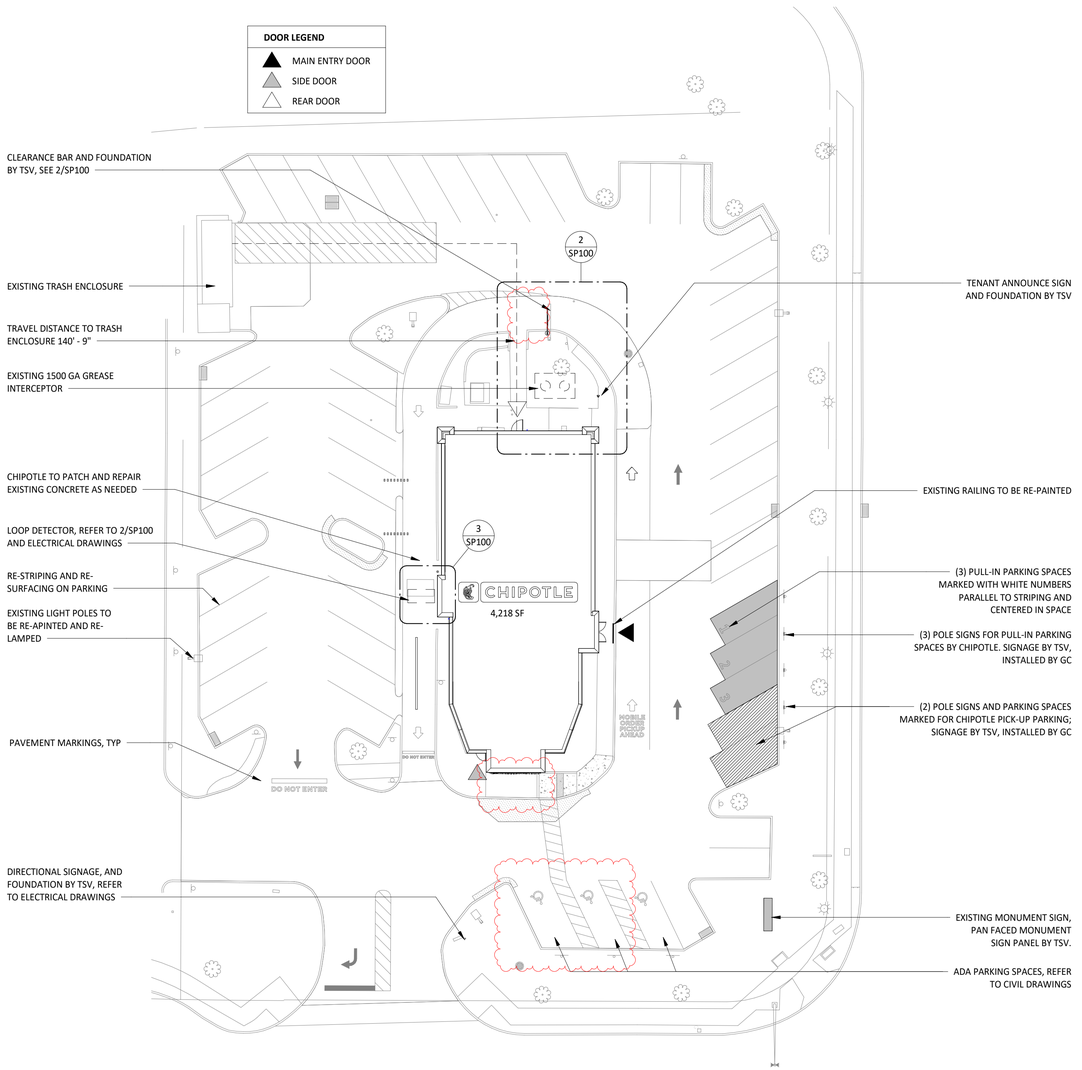

1 SP100 ARCHITECTURAL SITE PLAN

3/64" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL SITE PLAN


SP100

PLUMBING LEGEND


	FLOOR SINK
	FLOOR DRAIN
	TRENCH DRAIN

GENERAL NOTES

1.	VERIFY OVERALL INTERIOR DIMENSIONS, INTERIOR COLUMN PLACEMENTS, AND EXTERIOR WALL PENETRATIONS IN FIELD AND NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
2.	ALL DIMENSIONS ARE TO THE INSIDE FINISHED FACE OF EXISTING STUD WALLS.
3.	ALL DIMENSIONS ARE TO THE CENTERLINE OF FIXTURE UNLESS OTHERWISE NOTED.
4.	GC TO REVIEW ELECTRICAL PLANS FOR LIGHTING OR POWER STUB LOCATIONS PRIOR TO POURING SLAB.
5.	REFER TO "03300 - CAST-IN-PLACE CONCRETE" IN SPECIFICATIONS FOR CONCRETE PATCHING OR INSTALLATION INFORMATION.
6.	VERIFY PERIMETER FOUNDATION INSULATION IS EXISTING IN FIELD AND NOTIFY ARCHITECT OF ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF CONSTRUCTION.
7.	ALL TILED FLOOR TO MAINTAIN POSITIVE SLOPE TO ALL FLOOR DRAINS OF NOT GREATER THAN 2% SLOPE FOR A 4'X4' AREA U.N.O.

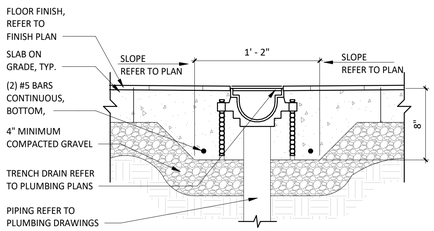


6 A101 **TRENCH DRAIN DETAIL**
1 1/2" = 1'-0"

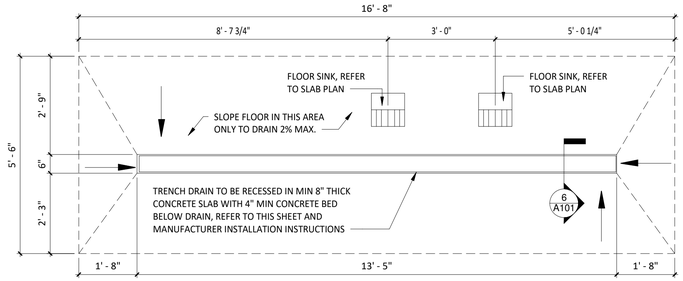

5 A101 **TRENCH DRAIN DETAIL**
1/2" = 1'-0"

4 A101 **CONCRETE CURB DETAIL**
3/4" = 1'-0"

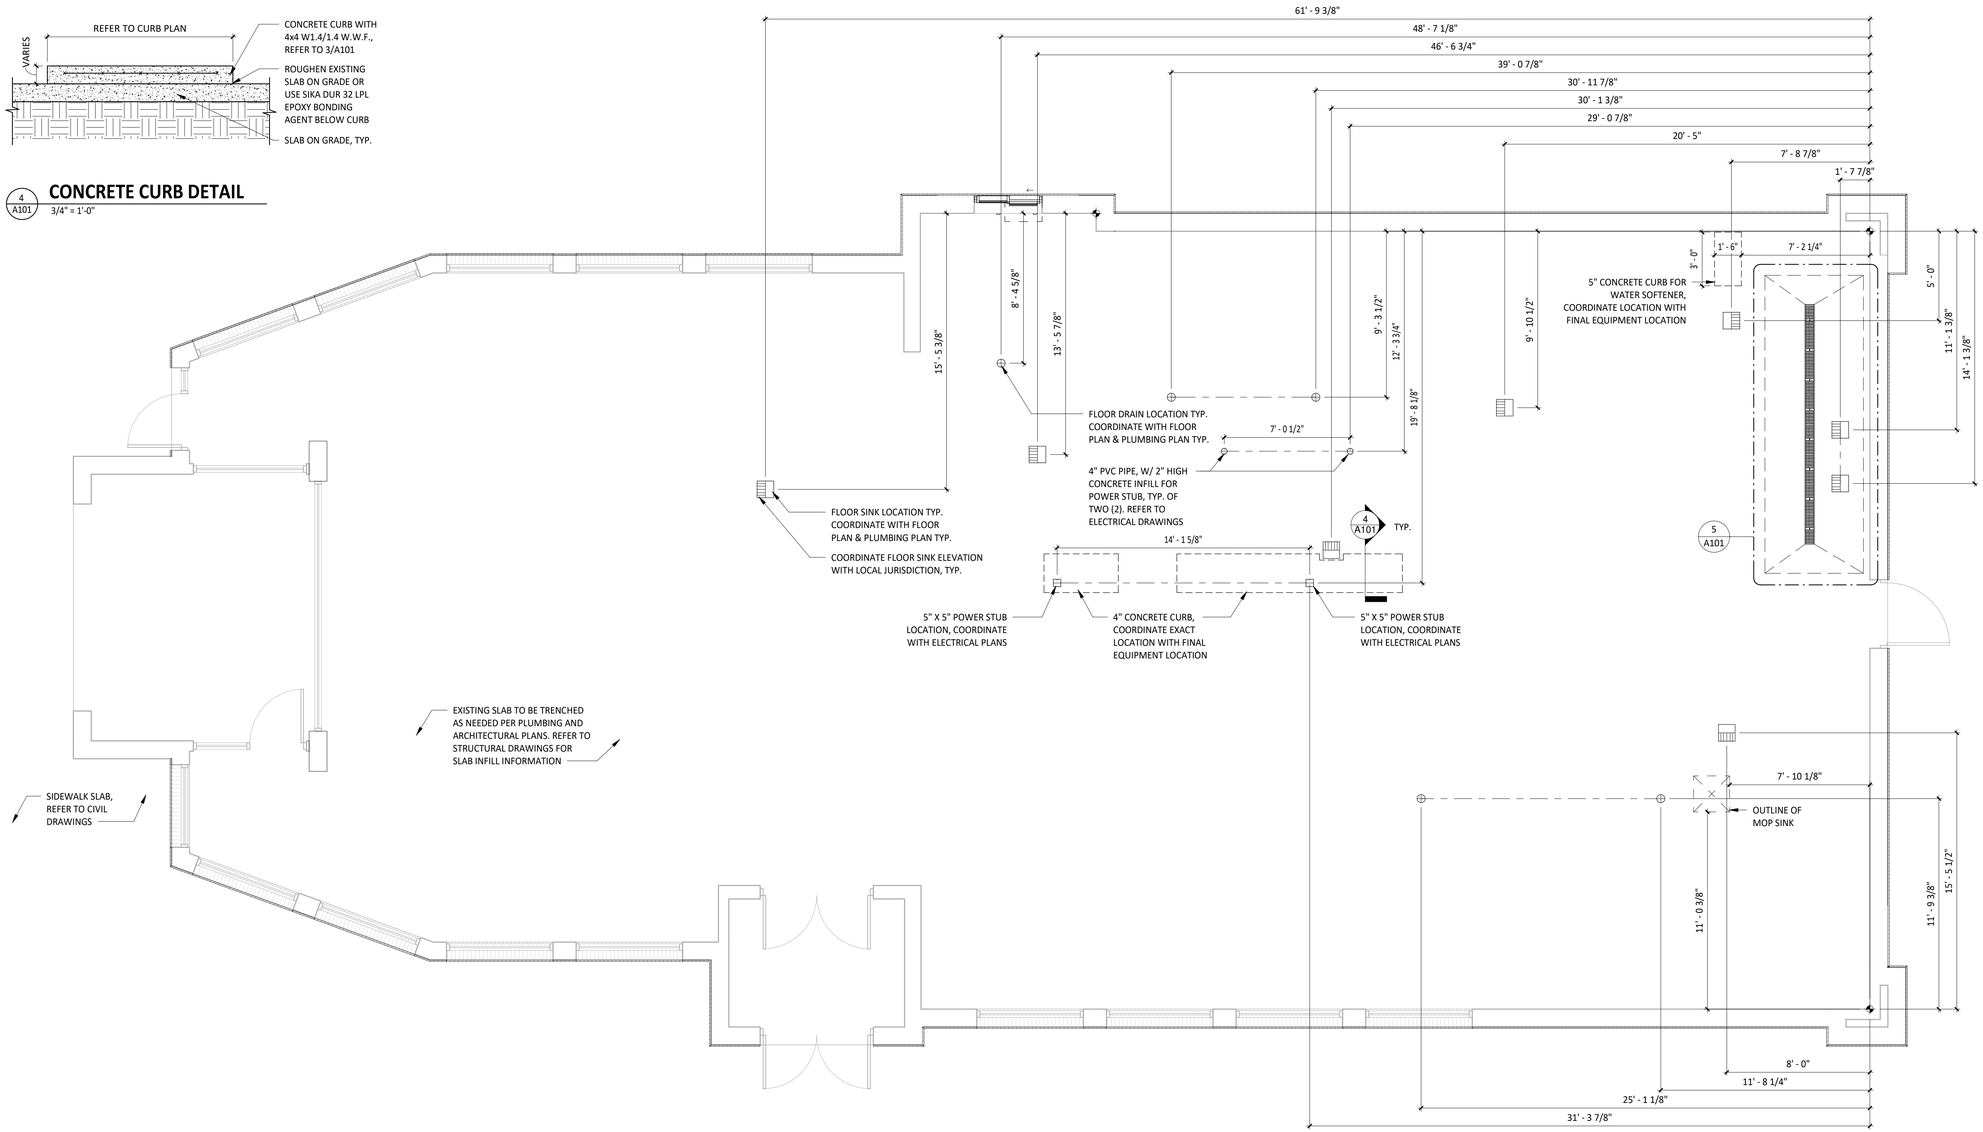

1 A101 **SLAB WORK PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000


Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

SLAB WORK PLAN


A101

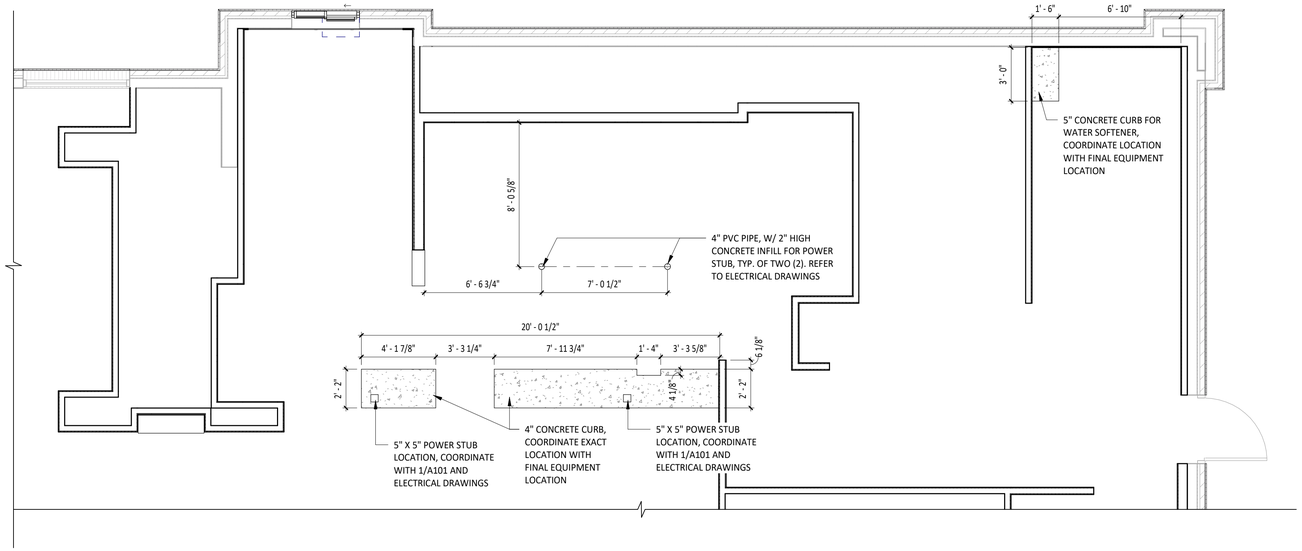

CURB PLAN

2 / A102

1/4" = 1'-0"

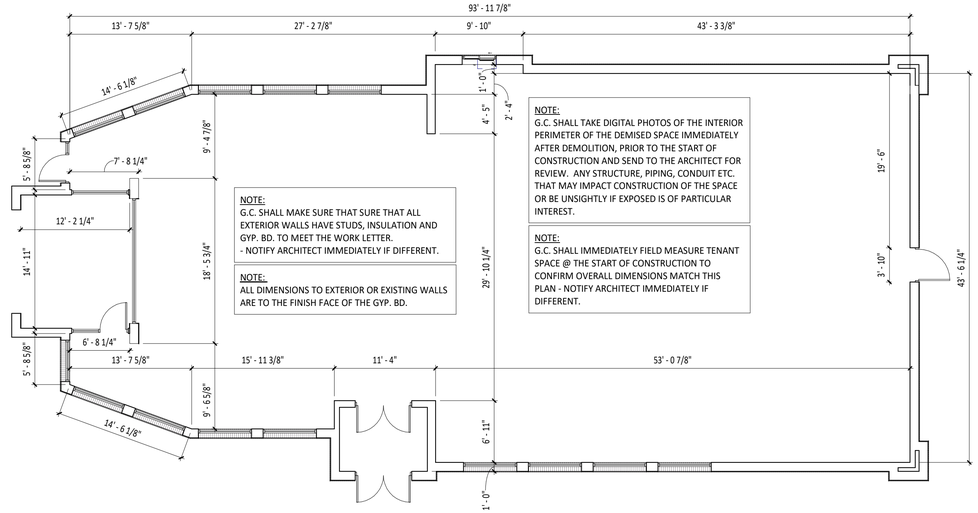

DEMISED PREMISES PLAN

1 / A102

1/8" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

DEMISED PREMISES PLAN


A102

WALL TYPE LEGEND

NEW CONSTRUCTION	
EXISTING CONSTRUCTION	
NEW CONSTRUCTION WITH SOUND BATT INSULATION	
WALK-IN COOLER	
DESIGNATES TWO (2) HOUR RATED ASSEMBLY RUN TIGHT TO DECK, REFER TO UL U#419 ON A501 FOR DETAILS.	
DESIGNATES WALLS & SHEATHING TO EXTEND TO DECK	

GENERAL NOTES

1. ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF STRUCTURE UNLESS NOTED OTHERWISE.
2. DASHED CIRCLE IN RESTROOM INDICATES 5'-0" TURNING DIAMETER REQUIRED BY ADA.
3. REFER TO WALL FINISH SCHEDULE ON A120.
4. STUD SIZES AS INDICATED ON PLAN.
5. INTERIOR DOORS ARE 4" OFF OF PERPENDICULAR WALL U.N.O.
6. IN SITUATIONS WHERE TENANT'S G.C. IS TO PROVIDE TYPE 'X' GYP. BD. FOR A RATED ASSEMBLY, THE TYPE 'X' GYP. BD. IS REQUIRED TO GO BENEATH THE SHEATHING AND FINISHES.
7. SEE SHEET A801 FOR ADDITIONAL SHEATHING BEHIND CERTAIN WALL FINISHES.
8. SEE A601 FOR DOOR TYPES.
9. TENANT'S G.C. TO PERFORM LAYOUT OF ENTIRE SPACE PRIOR TO STARTING FRAMING AND REPORT ANY DESCREPANCIES IN NOTED DIMENSIONS TO ARCHITECT AND CHIPOTLE MEXICAN GRILL'S CM PRIOR TO PROCEEDING. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
10. SEE A501 FOR WALL TYPES.
11. PROVIDE DEFLECTION TRACKS AT WALLS WHICH GO TO THE UNDERSIDE OF THE DECKING, REFER TO DETAIL 2/A501
12. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
13. DENSSHIELD TILE BACKER BOARD SHALL NOT BE INSTALLED OVER VAPOR BARRIERS AT EXTERIOR WALLS.
14. MOISTURE RESISTANT GYP. BD. SHALL BE USED IN RESTROOMS.

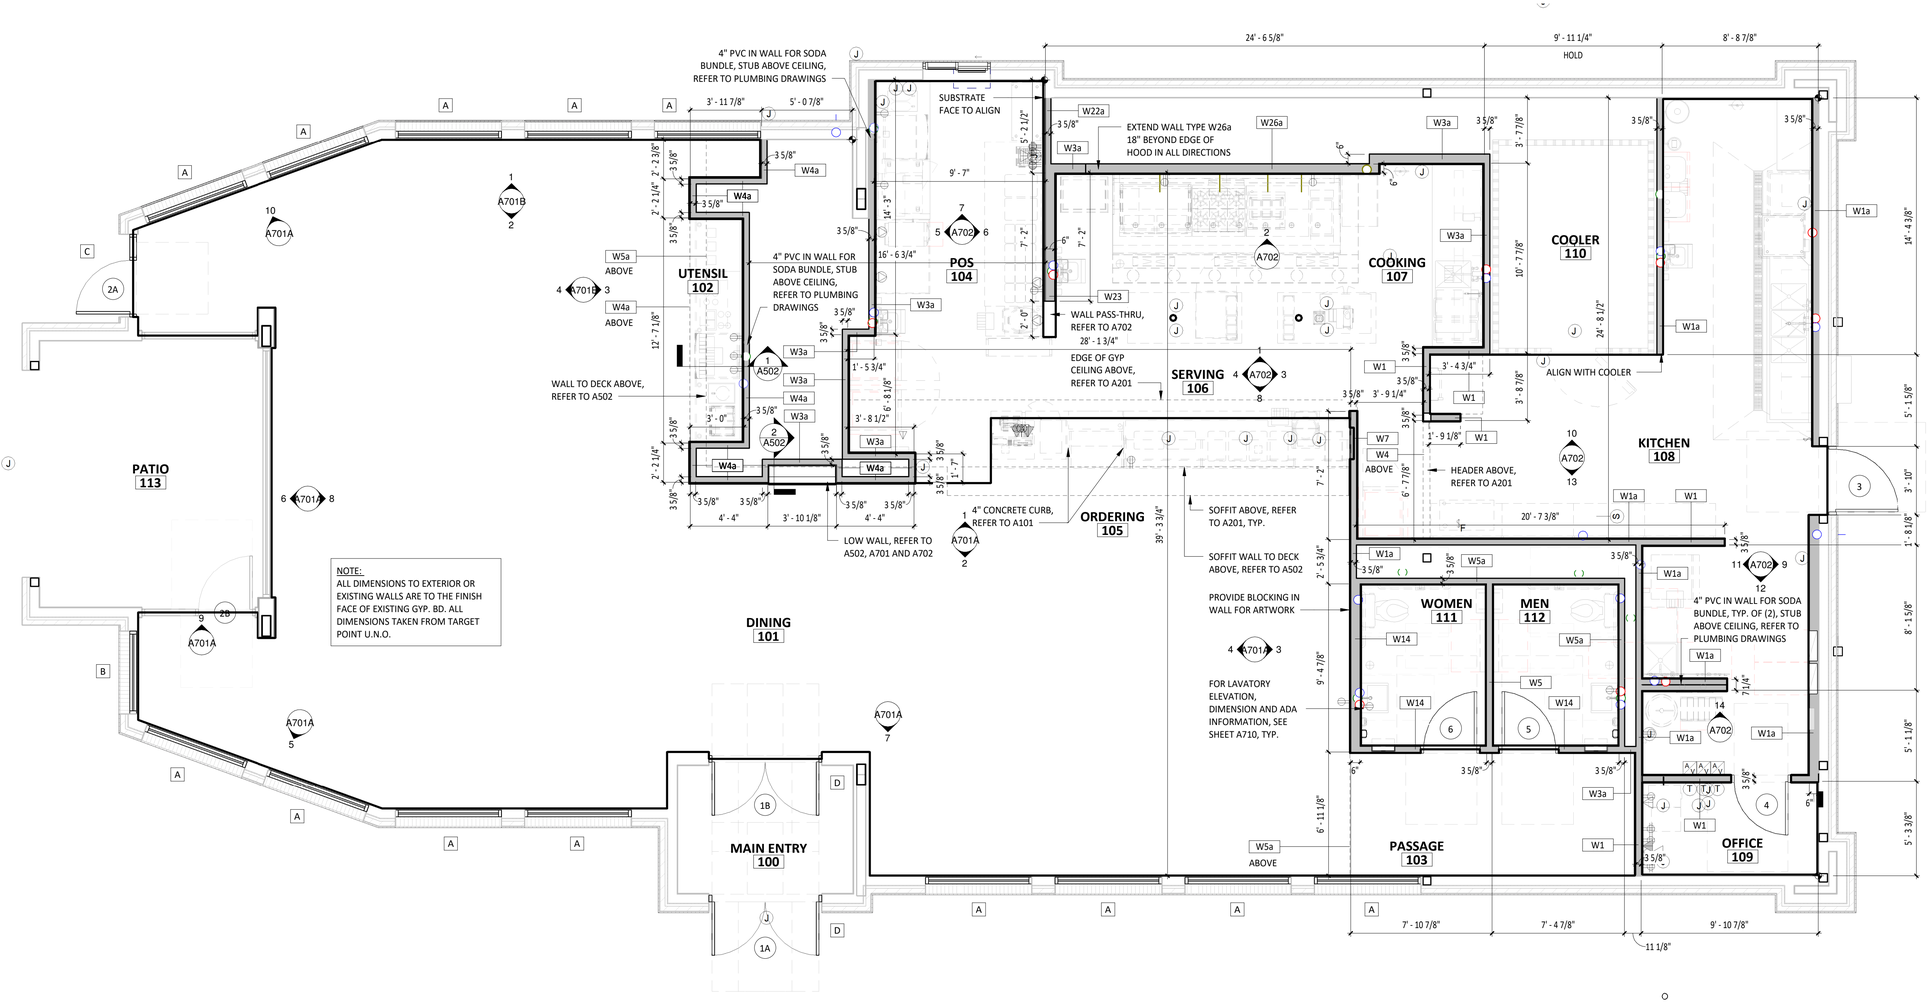

ARCHITECTURAL FLOOR PLAN

1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL FLOOR PLAN

A110

CODED NOTES

1	1-1/2" X 1-1/2" STAINLESS STEEL CORNER GUARDS TO 5'-0" AFF WITH 1-1/2" X 1-1/2" FRP CORNER TRIM ABOVE
2	SCHLUTER-QUADEC METAL CORNER, REFER TO 10&11/A802 & 11/A801.
3	ALUMINUM ENDCAPS, REFER TO 12/A802. FOR WINDOWS, REFER TO 12&13/A802
4	PROVIDE STAINLESS STEEL ON WALL TO 24" ABOVE TOP OF MOP SINK. FLASH BOTTOM EDGE OVER MOP SINK RIM. BEND STAINLESS STEEL AT INSIDE CORNER SO THERE IS NO JOINT, REFER TO 17/A801.
5	NOT USED
6	COOLER WALL PANELS AS PROVIDED BY THE COOLER MANUFACTURER HAVE A 26-GAUGE COATED AND EMBOSSED STEEL FINISH.
7	G.C. TO PROVIDE 18 GAUGE STAINLESS STEEL SHROUD AROUND EXPOSED LINES AT THE ICE MAKER.
8	PROVIDE WATERPROOFING MEMBRANE, REFER TO 4&5/A802. PROVIDE ON INTERIOR OF ALL RESTROOM WALLS, REFER TO 18/A801.
9	PROVIDE QUARRY TILE ON TOP OF CURB FOR SMART SAFE. PROVIDE BULLNOSE TILE TO LAP OVER TOP CUT EDGE OF BASE TILE, REFER TO SHEET 1/802. G.C. TO COORDINATE EXTENT OF QUARRY TILE WITH KES PRIOR TO INSTALLATION.
10	FRP CLOSURE AT COOLER AIR GAP, REFER TO 14/A801
11	NOT USED
12	OUTSIDE CORNER GUARD BY TMS, REFER TO 13/A801
13	ALIGN LOW EDGE OF RENO RAMP WITH FRONT EDGE OF EQUIPMENT CURB AND FACE OF ADJACENT WALL BASE FINISH. AT DOORS, ALIGN LOW EDGE WITH FRONT FACE OF DOOR.
14	SURFACE MOUNTED WALK OFF MAT. INSTALL PER MANUFACTURER'S SPECIFICATIONS; REFER TO 21/A801 FOR DETAILS. EXTENT OF WALK-OFF MAT AREA TO MATCH FLOOR CLEARANCE AREA REQUIRED BY ADA. TAPERED FRAME TO BE INSTALLED OUTSIDE OF ADA AREA.
15	PROVIDE TOP CORNER AT TRANSITION FROM GYP BD CEILING TO FRP WALL REFER TO 9/A210
16	4" PVC PIPE, WITH 2" HIGH CONCRETE INFILL FOR POWER STUB, TYP. OF TWO (2). REFER TO ELECTRICAL DRAWINGS
17	CONCRETE CURB FOR EQUIPMENT, WITH QUARRY TILE BASE AT EXPOSED EDGES
18	EXTENT OF QUARRY TILE FROM KITCHEN, ALIGN TILE WITH EDGE OF DOOR THRESHOLD
19	EXTENT OF RESINOUS FLOORING FROM RESTROOM

GENERAL NOTES


1. STONEWOOD WALL PANELS AND WAINSCOT PROVIDED BY TMS, INSTALL BY GC.
2. SPALTED MAPLE PANELS PROVIDED BY TMS, INSTALLED BY GC.
3. GC IS RESPONSIBLE FOR SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES).

FINISH LEGEND

FLOOR FINISHES		WALL BASE FINISHES		WALL FINISHES		CEILING/DECK FINISHES		DOOR FINISHES	
LGD. #		LGD. #		LGD. #		LGD. #		LGD. #	
F1	POLISHED CONCRETE	B1	BLACK RUBBER, COVELESS	P1	PLYWOOD, VERTICAL GRAIN	C1	OPEN TO STRUCTURE, UNPAINTED	D1	PAINT "BLACK"
F2	QUARRY TILE	B2	QUARRY TILE, COVE	P2	FIBERGLASS REINFORCED PANELS TO 4'-0" AFF (SMOOTH FINISH)	C2	STONEWOOD	D2	PAINT "KNIGHT'S ARMOR"
F3	EXTERIOR CONCRETE	B3	BLACK RUBBER, COVE	P3	GYP BD; PAINT "THIN ICE", EGGSHELL, REFER TO A701 AND A710	C3	GYP BD; PAINT "MOONLIT SNOW" (SEMI GLOSS)		
F4	SEALED CONCRETE	B4	QUARRY TILE, COVELESS	P4	NOT USED	C4	2X4 VINYL-FACED LAY-IN		
F5	RESINOUS FLOORING	B5	CERAMIC TILE	P5	CERAMIC TILE - WHITE	C5	2X2 VINYL-FACED LAY-IN		
				P6	FIBERGLASS REINFORCED PANELS (PEBBLED FINISH)	C6	FELT BLADE SLAT		
				P7	NOT USED				
				P8	CERAMIC TILE - BRONZE ACCENT 3" x 12"				
				P9	SPALTED MAPLE WALL PANEL, HORIZONTAL GRAIN				
				P10	EXISTING STOREFRONT				
				P11	STONEWOOD WALL PANEL				
				P12	EXISTING PREFINISHED BRAKE METAL				

ROOM FINISH SCHEDULE

ROOM #	ROOM NAME	FLOOR FINISH	BASE FINISH	WALL FINISH	CEILING FINISH	CEILING HEIGHT	REMARKS
100	MAIN ENTRY	F1	B1	REFER TO PLAN FOR WALL FINISHES	C1	STR/±10'-0"	SEE SHEET A701 AND SPECIFICATION SHEETS
101	DINING	F1	B1		C1 / C6	STR/±10'-0"	SEE SHEET A701 AND SPECIFICATION SHEETS
102	UTENSIL	F1	B1		C2	±8'-3 1/4"	SEE SHEET A701 AND SPECIFICATION SHEETS
103	PASSAGE	F1	B1		C3	±9'-0" / ±8'-3 1/4"	SEE SHEET A701 AND SPECIFICATION SHEETS
104	POS	F2	B2 / B4		C3/ C4	±9'-0"	SEE SHEET A702 AND SPECIFICATION SHEETS
105	ORDERING	F1	B1/B4		C1 / C3	STR / ±9-0"	SEE SHEET A701 AND SPECIFICATION SHEETS
106	SERVING	F2	B2		C3	±9'-0"	SEE SHEET A702 AND SPECIFICATION SHEETS
107	COOKING	F2	B2		C3 / C4	±9'-0"/±10'-0"	SEE SHEET A702AND SPECIFICATION SHEETS
108	KITCHEN	F2	B2		C4	±10'-0"	SEE SHEET A702 AND SPECIFICATION SHEETS
109	OFFICE	F2	B2		C4	9'-0"	EXTEND SHEATHING TO STRUCTURE
110	COOLER	F2	B2		STR	STR	CEILING HEIGHT & FINISHES PER MANUFACTURER
111	WOMEN	F5	B3		C3	8'-0"	SEE SHEET A710 AND SPECIFICATION SHEETS
112	MEN	F5	B3		C3	8'-0"	SEE SHEET A710 AND SPECIFICATION SHEETS
113	PATIO	F3	-		C5	16'-6"	-

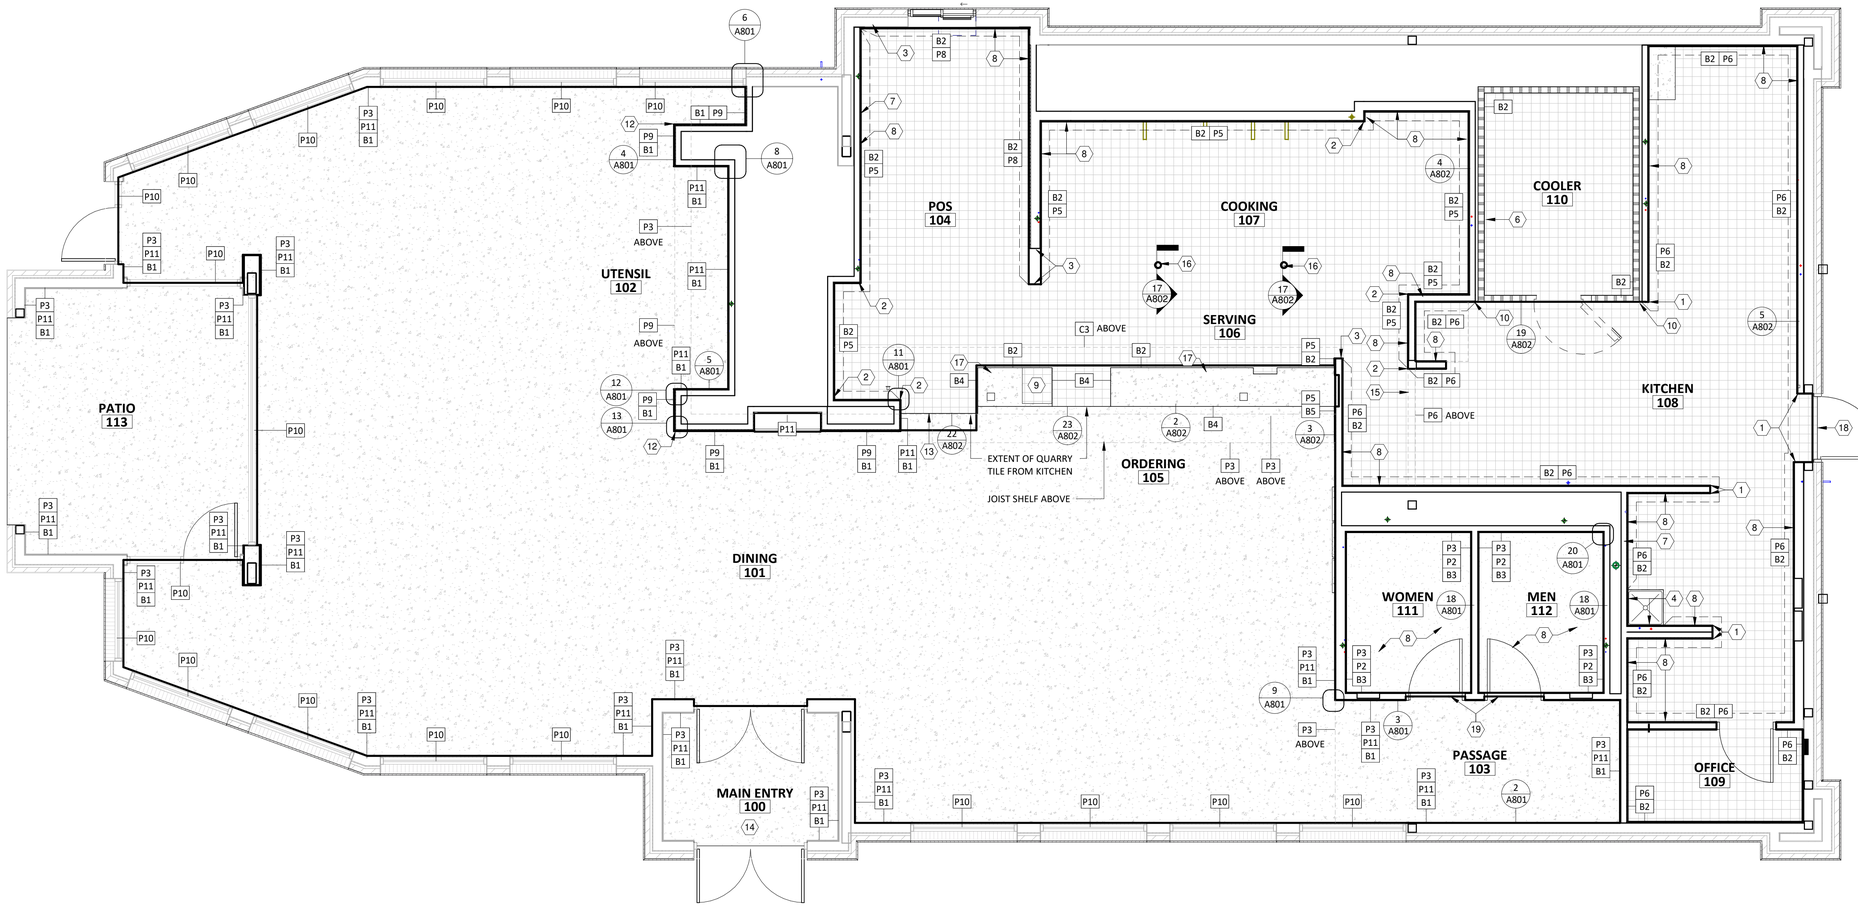

1 A120 **FINISH PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

FINISH PLAN


A120

GENERAL NOTES


1.	REFER TO SHEET A131 AND A132 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2.	ALL DIMENSIONS ARE TO FACE OF FRAMING, EDGE OF EQUIPMENT, OR CENTERLINE OF EQUIPMENT UNLESS NOTED OTHERWISE.
3.	ALL FURNITURE TO BE SQUARE/PARALLEL TO TENANT SPACE/WALLS AS SHOWN ON PLANS.

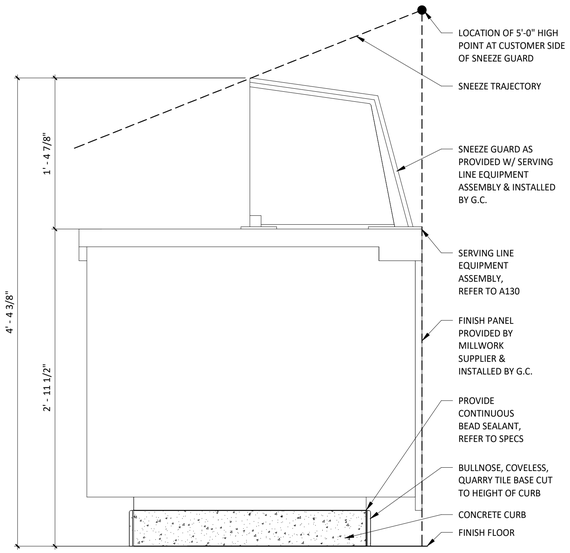


3/A130 **DETAIL @ SERVELINE SNEEZE GUARD**
1 1/2" = 1'-0"

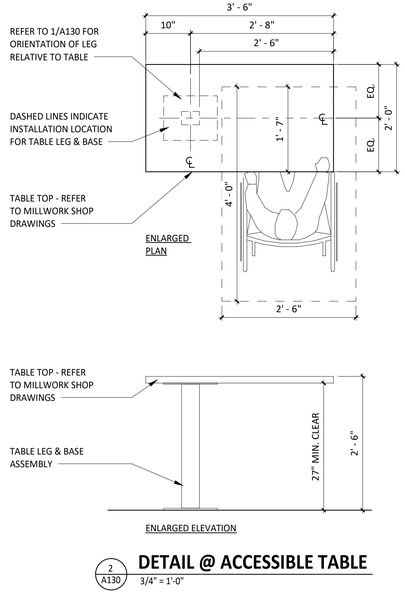


2/A130 **DETAIL @ ACCESSIBLE TABLE**
3/4" = 1'-0"

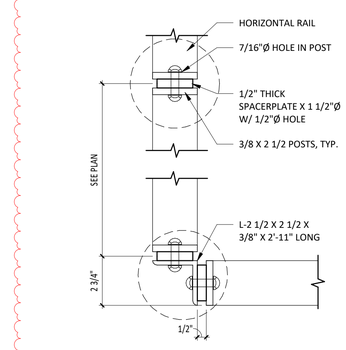

4/A130 **RAILING PLAN DETAIL**
3" = 1'-0"

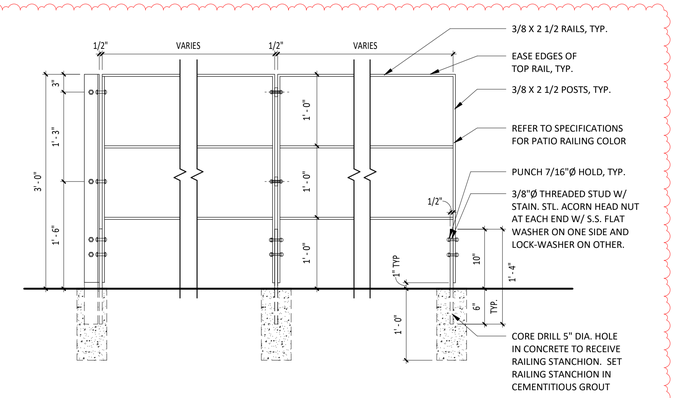

5/A130 **RAILING MOUNTING DETAIL**
1" = 1'-0"

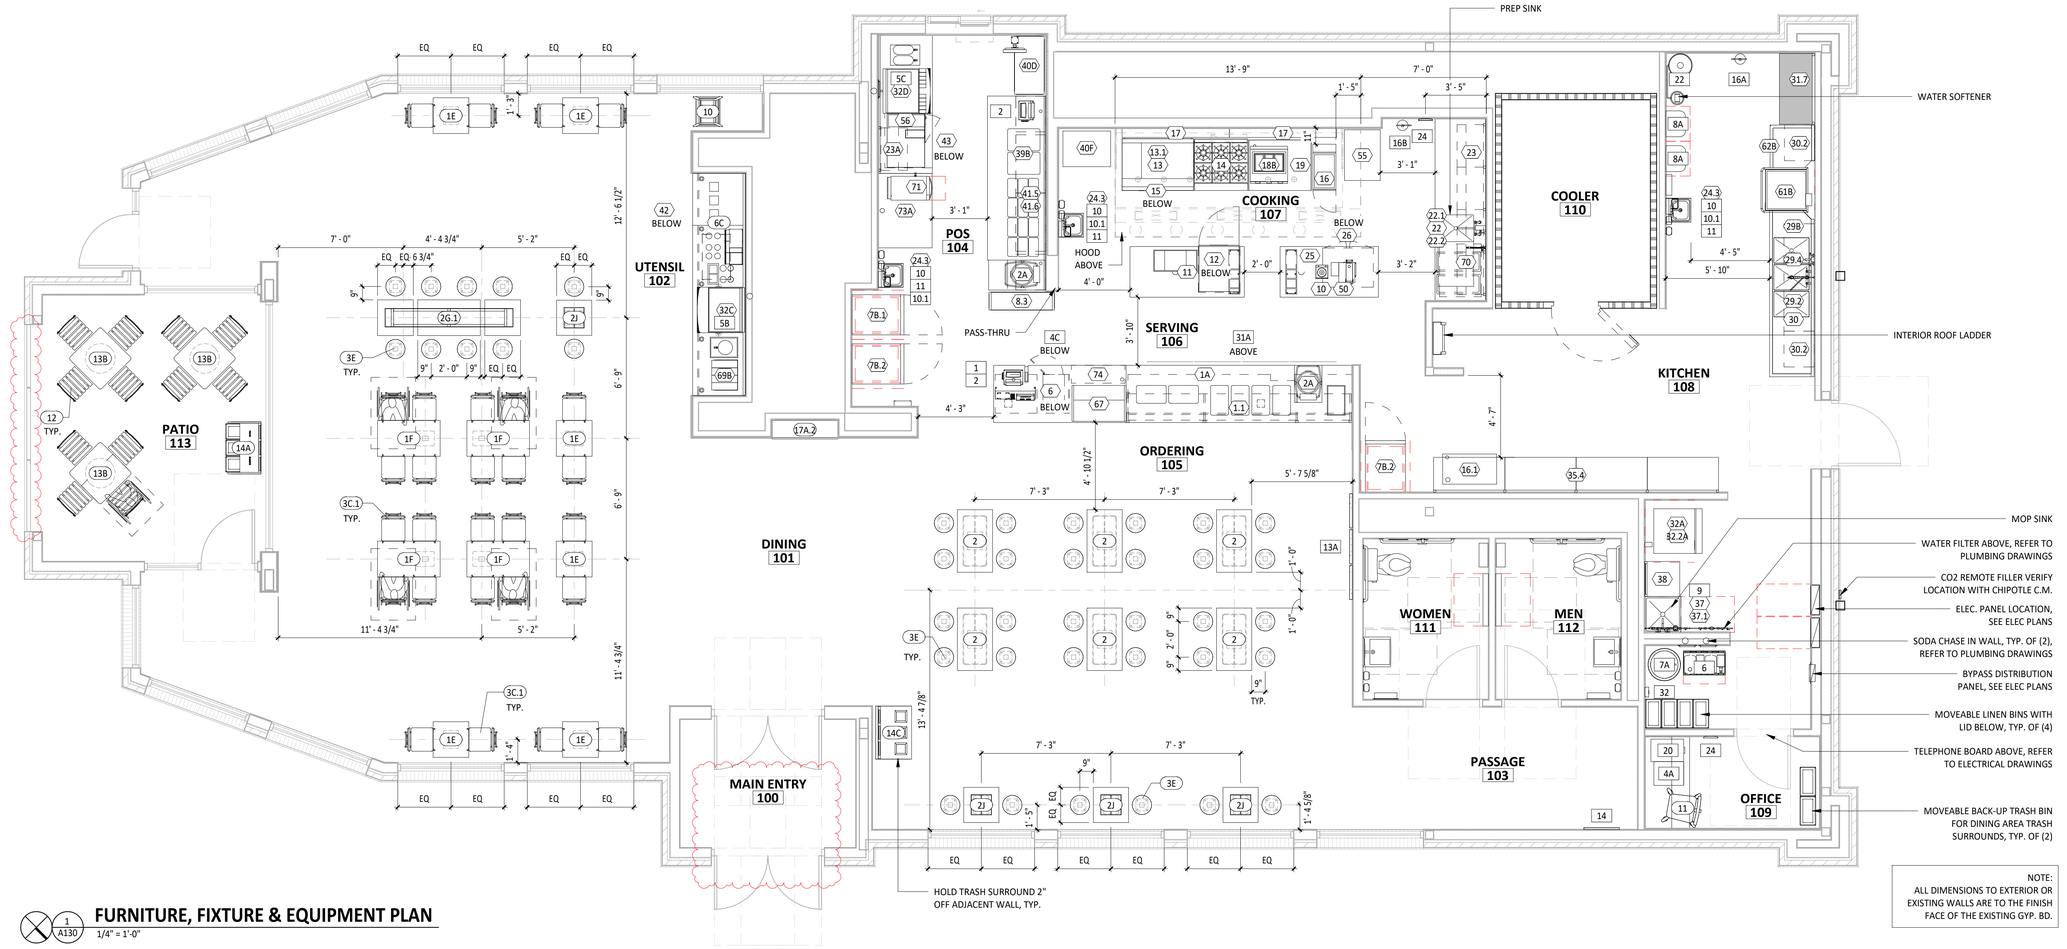

1/A130 **FURNITURE, FIXTURE & EQUIPMENT PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

FF&E PLAN

A130

KITCHEN EQUIPMENT LIST

ITEM #	DESCRIPTION	MANUFACTURER	MODEL NO.	QTY	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
							ELEC	GAS	WATER	SEWER	
1.1	Sneeze Guard Serve Line 12 Pan (Right)	BSI	Custom-R	1	TMS	TMS/GC					
1A	Front Serve Line - 12 Pan - RTD - POS Right	Delfield	12 Pan Serve Line POS RTD_241x38.5in (Right)	1	KES	KES; GC	●			●	Installed On Concrete Curb
2A	Tortilla Warmer	Caliente Industries	A2	2	KES	KES	●				GC To Store In Walk-In Cooler Until Final Installation
6	Cup Dispenser	Dispense-Rite	CHIP-ECL-3B	1	KES	KES; GC					Installed At POS Counter
7B.1	Upright Beverage Cooler, Single Door, Hinge Left	Varies	Varies - Solid Door	1	KES	KES	●				
7B.2	Upright Beverage Cooler, Single Door, Hinge Right	Varies	Varies - Solid Door	2	KES	KES	●				
8.3	M4.5 Chip Shelf	Trimark	Custom	1	KES	KES					
10	Blender	Vitamix	748	1	KES	KES	●				GC To Store In Walk-In Cooler Until Final Installation
11	Carving Station - 77x34in - Horizontal Well - Right	Delfield	77x34in Carving Station-RT	1	KES	KES	●				
12	Undercounter Refrigerator	Varies	Varies	1	KES	KES	●				
13	Grill 48in - Natural Gas - Divider Left	Woodstone	WS-PL-48-36-4-CT-Left	1	KES	KES	●	●			
13.1	Woodstone Grease Splash Guard	Nationwide Fab; Marlo Mfg	CHP-GCG-GSG	1	KES	KES					Verify If Required
14	Range 6 Burner - Natural Gas	Garland	U36-6S	1	KES	KES		●			
15	Woodstone Grill Stand 48x31in - Divider Left	Woodstone	000-PL-STAND-CASTER	1	KES	KES					
16	Fryer - Gas - Standard Efficiency	Varies	Varies	1	KES	KES	●	●			Mounted On Legs, G.C. To Pin Front Legs To Floor
16.1	Grease Caddy	Varies	Chipotle Grease Caddy - RH	1	KES	KES					
17	Cook Line Stand Off - 72x6	Nationwide Fab; Marlo Mfg	CHP-6WS-6	2	KES	KES					Mount Top of Flat Surface at 33" AFF, Install Screws at Each Stud Location, Provide Blocking To Mount To Wall
18B	Gas Rice Cooker	Woodstone	WS-RGC-60	1	KES	GC	●	●			Final Connection by GC. RE:Mechanical Drawings
19	Rice Cooker Stand - Left	Nationwide Fab; Marlo Mfg	CHP-RCS-42ES-34	1	KES	KES					
22	Prep Sink - Corner - Left	Trimark	S1-122x34-US-FF-L	1	KES	GC				●	
22.1	Prep Sink Faucet Big Flow Faucet	T&S	B-0293-01	1	KES	GC			●		
22.2	Prep Sink Vegetable Wash Faucet	T&S	B-0730	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
22.3	Prep Sink Drain Assembly	T&S	B-3950	1	KES	KES; GC				●	
23	4 Shelves - 120in Prep Sink	Amco	CHPPS120	1	KES	KES					Mount Bottom Of Standard At 50" AFF. Provide Plywood Blocking To Mount To Wall.
23A	2 Shelves - 30in	Amco	Custom	1	KES	KES					Mount Bottom Of Standard At 50" AFF. Provide Plywood Blocking To Mount To Wall.
24.3	Hand Sink Wall Mounted - Splash Both	Universal Stainless	EHS-1RL-NF	3	KES	GC				●	
24.5	Kitchen Hand Sink Faucet Splash Mount	T&S	B-1146-04	3	KES	GC			●		
25	Rice Prep Table Island 66x34	Nationwide Fabrication; Marlo Mfg	Custom Table 66x34in	1	KES	KES					
26	Hot Holding Cabinet - Double Door (Rice)	Food Warming Equipment (FWE)	HLC-1220-8-8-CHP	1	KES	KES	●				
29.2	Dish Sink Add-A-Faucet w/ Pre-Rinse	T&S	B-1033-12CRBJSK Substitute Sprayer B-0107-J-SWV	1	KES	GC			●		
29.3	Dish Sink Drain Assembly	T&S	B-3950	3	KES	KES; GC				●	
29.4	Dish Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
29B	3 Comp Sink - 18x24in Bowls - 111 3/4in	Nationwide Fabrication; Marlo Mfg	S3-30x111.75x36.5-FF	1	KES	GC				●	
30	Shelving System - 3 Comp Sink	Amco	WST1879S	1	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking
30.2	Shelving System - Dish Table	Amco	WST1879S	2	KES	KES					Mount bottom of Standard At 56"AFF. Provide Plywood Blocking. Mount Tight To Dish Machine
31.7	Drying Racks 23x48x85in - With Vented Aluminum Covers	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall
32.1A	Ice Maker - Remote Condenser	Hoshizaki	URC-5F	1	KES	KES	●				Condensing Units To Be Secured To The Roof Per Code By GC
32.1B	Ice Maker - Remote Condenser	Hoshizaki	URC-9F	1	KES	KES	●				Condensing Units To Be Secured To The Roof Per Code By GC
32.2A	Ice Maker - Storage Bin	Hoshizaki	B500SF	1	KES	KES				●	
32.3	Icemaker- Filter	Cuno	Bev 190	3	KES	KES			●		
32.4	Ice Maker - Scale Inhibitor	Cuno	CFS440-HT	3	KES	KES			●		
32A	Ice Maker For B.O.H. Ice Bin (Shorter)	Hoshizaki	KML-700MRJ	1	KES	KES	●		●		Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
32C	Ice Maker Mounted On Soda Machine - Air Cooled	Hoshisaki	KMD-530MAJ	1	KES	KES	●		●	●	Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
32D	Ice Maker Mounted On Soda Machine - Remote Air Cooled	Hoshisaki	KMD-530MRJ	1	KES	KES	●		●	●	Drain Ice Maker to Floor Sink, RE: Mech. Refrigeration By Tenant.
33	Walk In Cooler 9x12x10ft 3in - Standard	Manitowoc/Norlake	CHP912SR-RS	1	WCS	GC	●			●	Refer To Plumbing and Mechanical Drawings; Refrigeration By Tenant; Remote Exterior Compressor Unit To Be Secured To Roof Per Code By GC
34	Walk-In Cooler Shelving System - 9x12x10	Cambro (Camshelving)	CHP912ER	1	KES	KES					
35.4	Dry Storage Racks 23x192x85in	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
37	Mop Sink Faucet	T&S	B-0660-BSTR	1	KES	GC			●		
37.1	Mop Sink Chemical Faucet	T&S	B-2345-01-XX	1	KES	GC			●		GC To Provide Connection For Chemical Dispensing Equipment
38	6 Shelves - Chemical Storage Rack	Varies	Custom	1	KES	KES					Mount Bottom Of Standard At 12" AFF. Provide Plywood Blocking To Mount To Wall.
39B	DML 2.0 130in – Right – W/POS & Cash Drawer	Franke/Delfield	DML 2.0_RT-130x39	1	KES	KES	●			●	
39B.1	DML 2.0 Wall Trim Package	Franke/Delfield	DML 2.0 Trim Kit	1	KES	KES					
40D	Holding Shelf	Trimark	TGS-39X20X80-B	1	KES	KES	●				
40F	M4.5 - Filler Stand At Range	Select Stainless	24x32x36	1	KES	KES					
41.5	DML 2.0 Shelving - 130in - Top Shelf	Franke/Delfield	CH000A32	1	KES	KES					Mount Bottom Of Shelf At 74 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
41.6	DML 2.0 Shelving - 130in - Bottom Shelf	Franke/Delfield	CH000A34	1	KES	KES					Mount Bottom Of Lowest Portion Of Shelf At 54 1/2" AFF. Provide Plywood Blocking To Mount To Wall.
42	Shelving System Under Counter Beverage Station	ISS	WST1810CLR	1	KES	KES					Mounted on (4) casters, All casters to be swivel type, Front (2) casters to have brake, Located under utensil counter
43	Beverage Cooler Backbar 36in	Glasstender	LP36X-SS(X)	1	KES	KES	●				
50	Food Processor	Sammic	CA-31	1	KES	KES					
55	Filler Table - 24x34in	Trimark	TS-24x34x36-US-C	1	KES	KES					
56	Beverage Table - Chipotlane	Trimark	TS-36x92.5x36	1	KES	GC	●			●	
61B	Dish Machine (w/Pump)	Hobart	AM16SCB	1	KES	KES	●		●	●	
62B	Dish Table 30x30	Trimark	CDT-30X30X36.5-B	1	KES	GC					
65	Utility Cart (Not Shown)	Select Stainless	30SU-22-14-C4-TUBS-CUSTOM	1	KES	GC					Provided As Part Of The WIC Shelving
67	Refrigerated Counter Case, Self-Serve	Structural Concepts	CO3324R-UC	1	KES	KES					
69B	M4.0 - Simplicity Bubbler Mini-Quad	Crathco	CS-4E-16	1	KES	GC	●			●	
70	Speed Fill Faucet	T&S	B-0432 MOD	1	KES	GC			●		
71	Quesadilla Press	Turbochef	Sota Touch	1	KES	KES	●				
73A	50" TurboChef Table	Trimark	50X36X36	1	KES	KES					
74	Shelving - Under Counter - 12x36x29in	Metro	Custom	1	KES	KES					

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

FF&E SCHEDULES

A131

MISC. EQUIPMENT LIST

TAG	DESCRIPTION	QTY	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
					ELEC	GAS	WATER	SEWER	
1	Point of Sale Display	1	TMS	GC					Installed at POS Station
2	Point-Of-Sale System	2	T	TCC					Coordinate Requirements With Tenant and Elec. Drawings
4A	B-Rate (Standard Safe)	1	TS	GC					Installed in Office
4C	Smart Safe	1	TSS	TSS	●				To Be Installed On Curb Under Serveline, Bolt to Curb Under Serveline POS
5B	Soda Dispenser - With Air-Cooled Ice Maker	1	SPS	SPS	●			●	Drain to Floor Sink, Tenant Millwork Supplier to Provide (2) Adjustable Legs to Support Dispenser From Under The Utensil Counter
5C	Soda Dispenser - With Remote Air-Cooled Ice Maker	1	SPS	SPS	●			●	Drain to Floor Sink, Tenant Millwork Supplier to Provide (2) Adjustable Legs to Support Dispenser From Under The Utensil Counter
6	Soda System Syrup Rack with Carbonator on Stainless Steel Shelf	1	SPS	SPS	●		●		
7A	Bulk CO2 Tank	1	CO2	CO2	●				GC To Secure Cylinders To Wall With Grade 30 Galvanized Steel Chain At 2/3 The Height Of The Cylinder. Attach To Wall With Stainless Steel Quick Link And Screw Eye
8A	Gas Tankless Water Heater	2	GC	GC		●	●	●	Drain Water Heater To Floor Drain, RE: Mech.
9	Mop Sink, See Plumbing Drawings	1	GC	GC			●	●	See Plumbing Drawings
10	Touch-Free Soap Dispenser	3	WA	GC					
10.1	Hand Sanitizer Dispenser	3	WA	GC					
11	Paper Towel Dispenser, Bobrick B262	3	WA	GC					Provide Plywood Blocking to Mount to Wall
12	First Aid Kit	1	T	GC					Confirm Location With Chipotle CM Prior To Installation
13A	M4.0 - Artwork Panel - Plaster	1	TAS	GC					Provide Plywood Blocking to Mount to Wall
14	License Frame	1	T	GC					Provide Plywood Backing In Wall At License Frame Location, Refer To Arch. Floor Plans And Elevations For License Frame Location.
16A	Fire Extinguisher Type ABC - B456	1	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
16B	Fire Extinguisher Type K	1	GC	GC					Mount in locations specified by the Fire Marshal. Provide plywood backing at specified locations.
19	Hat & Coat Strips (Not Shown)	1	WA	GC					Provide Plywood Blocking to Mount to Wall
20	2-Drawer File Cabinet, By Tenant	1	T	T					By Tenant
22	Water Softener	1	KES	GC			●	●	See MEP Sheets For Details
24	iPAD Wall Station	2	T	GC	●				Tablet By Tenant, Refer to Electrical Drawings
28	Mop Strip (Not Shown)	1	T	GC					Provide Plywood Backing To Mount To Wall, 2 Hole At Mop Basin and 6 Hole In Kitchen
31A	21inx31in Menu System	1	TMB	GC					
32	CO2 Alarm	1	CO2AS	GC	●				Refer to Electrical Drawings for Additional Details
33A	M4.0 - Pick-Up Sign - Single Faced - Flush Mounted - Face	1	TSV	GC					

FURNITURE LIST

TAG	DESCRIPTION	QTY	FURNISHED BY	INSTALLED BY	UTILITY				REMARKS
					ELEC	GAS	WATER	SEWER	
1E	M4.0 - Table 24x24in - Rectangular Base	6	TMS	GC					
1F	M4.0 - Table 24x42in, Rectangular Base (Accessible)	4	TMS	GC					See Detail On A130
2	M4.0 - Table 24x42in, Bar Height	6	TMS	GC					
2G.1	M4.0 - Bar Height Table 8-Top, With Footrest	1	TMS	GC					One Coat Hook Per Two Seats, Confirm Mounting Location With Shop Drawings
2J	M4.0 - Bar Height Table 24x24in - Rectangular Base	4	TMS	GC					One Coat Hook Per Two Seats, Confirm Mounting Location With Shop Drawings
3C.1	M4.0 - Dining Room Chair	28	TMS	GC					
3E	M4.0 - Bar Stool - Fixed	40	TMS	GC					Align Seat With Seam Perpendicular To Table Edge
6C	M4.0 - Beverage Counter - With Trash - 4" Splash - 149"	1	TMS	GC				●	Coordinate Floor Drain Installation with Utensil Counter Installation, Bins Provided by Tundra in Smallwares Package
10	Child's High Chair	1	T	GC					
11	Office Chair, By Tenant	1	T	T					By Tenant
12	Patio Chair - Bistro	12	KES	GC					Provided by EMU America, Contact: Carol Hughes (303-744-3200)
13B	30in Square Bistro Table	3	KES	GC					Provided By EMU America, Contact: Carol Hughes (303-744-3200)
14A	3 Bin Trash/Recycling Surround - Exterior	1	TMS	GC					Bins Provided by Tundra in Smallwares Package
14C	M4.0 - 3 Bin Trash/Recycling Surround - Interior	1	TMS	GC					Bins Provided by Tundra in Smallwares Package
17A.2	MOPUS Shelving - 44"	1	TMS	GC					GC To Provide Blocking In Walls At The Ends Of The MOPUS Shelf To Secure Shelves, Wood Edge Of The Shelves To Face The Dining Room

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000


Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

FF&E SCHEDULES

A132

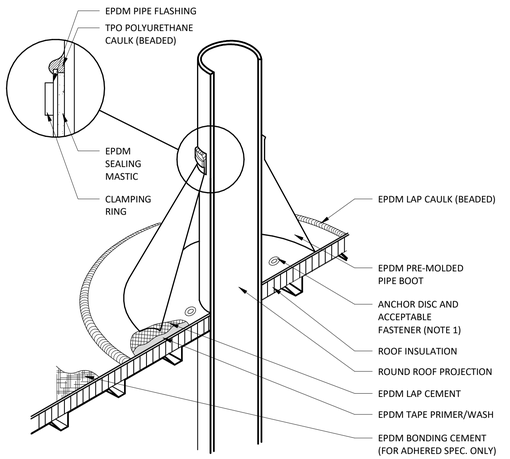


NOTE:

1. WITH MECHANICALLY FASTENED OR BALLASTED SPECIFICATIONS, MEMBRANE MUST BE MECHANICALLY ATTACHED WITH 2" (50 mm) ANCHOR DISC AND ACCEPTABLE FASTENERS (MINIMUM OF 4 PER PIPE).
2. DO NOT OVERLAP THE FLANGES FROM ADJACENT PIPE FLASHINGS.
3. ANY SEAM UNDER BOOT FLANGE TO BE TREATED AS T-JOINT.
4. BOTH SURFACES TO BE MATED MUST BE CLEANED WITH TAPE PRIMER/WASH. EPDM TAPE PRIMER/WASH MUST BE COMPLETELY DRY AND TACK FREE BEFORE APPLYING EPDM LAP CEMENT.

2 / A140 BOOT DETAIL

N.T.S.

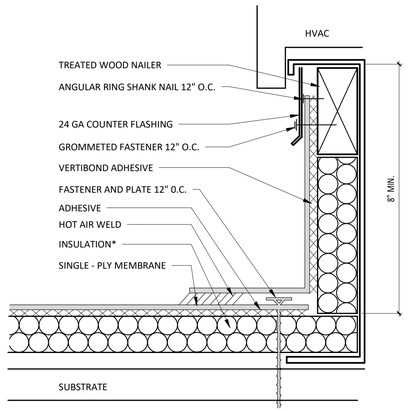


NOTES:

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS.
2. DO NOT SCALE DRAWINGS.
3. USE PREFABRICATED OUTSIDE CORNERS.
4. INSULATION MUST BE SECURELY FASTENED.
5. *GLASS - FACED POLYISO INSULATION IS OPTIONAL AND MAY NOT BE REQUIRED ON EVERY PROJECT. IF INSULATION IS NOT REQUIRED, THE MEMBRANE MUST BE ADHERED TO AN APPROVED SURFACE.

3 / A140 CURB FLASHING


N.T.S.

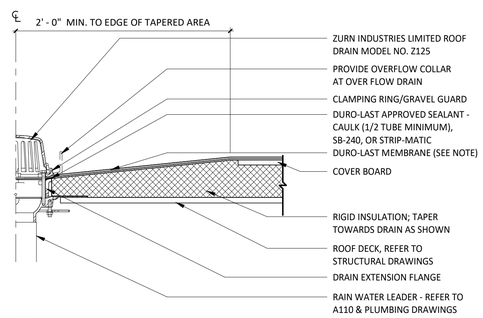

NOTE:
DURO-LAST MEMBRANE MUST EXTEND BEHOND THE INSIDE OF THE CLAMPING RING. BE SURE THE OPENING WHERE WATER PASSES THROUGH THE MEMBRANE IS NOT SMALLER THAN THE OPENING OF THE DRAIN.


4 / A140 ROOF DRAIN DETAIL

N.T.S.

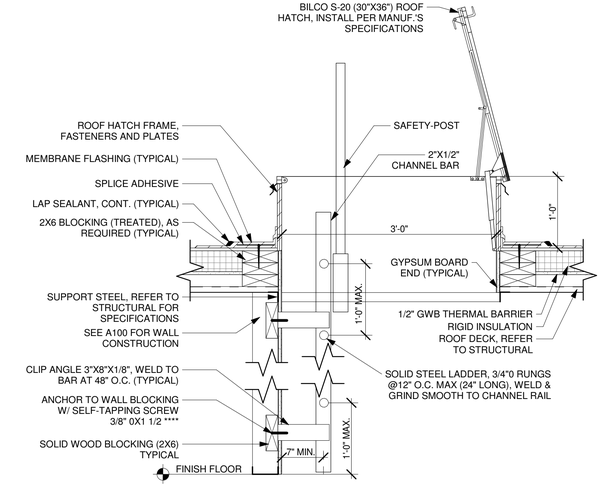

5 / A140 ROOF HATCH & LADDER

N.T.S.

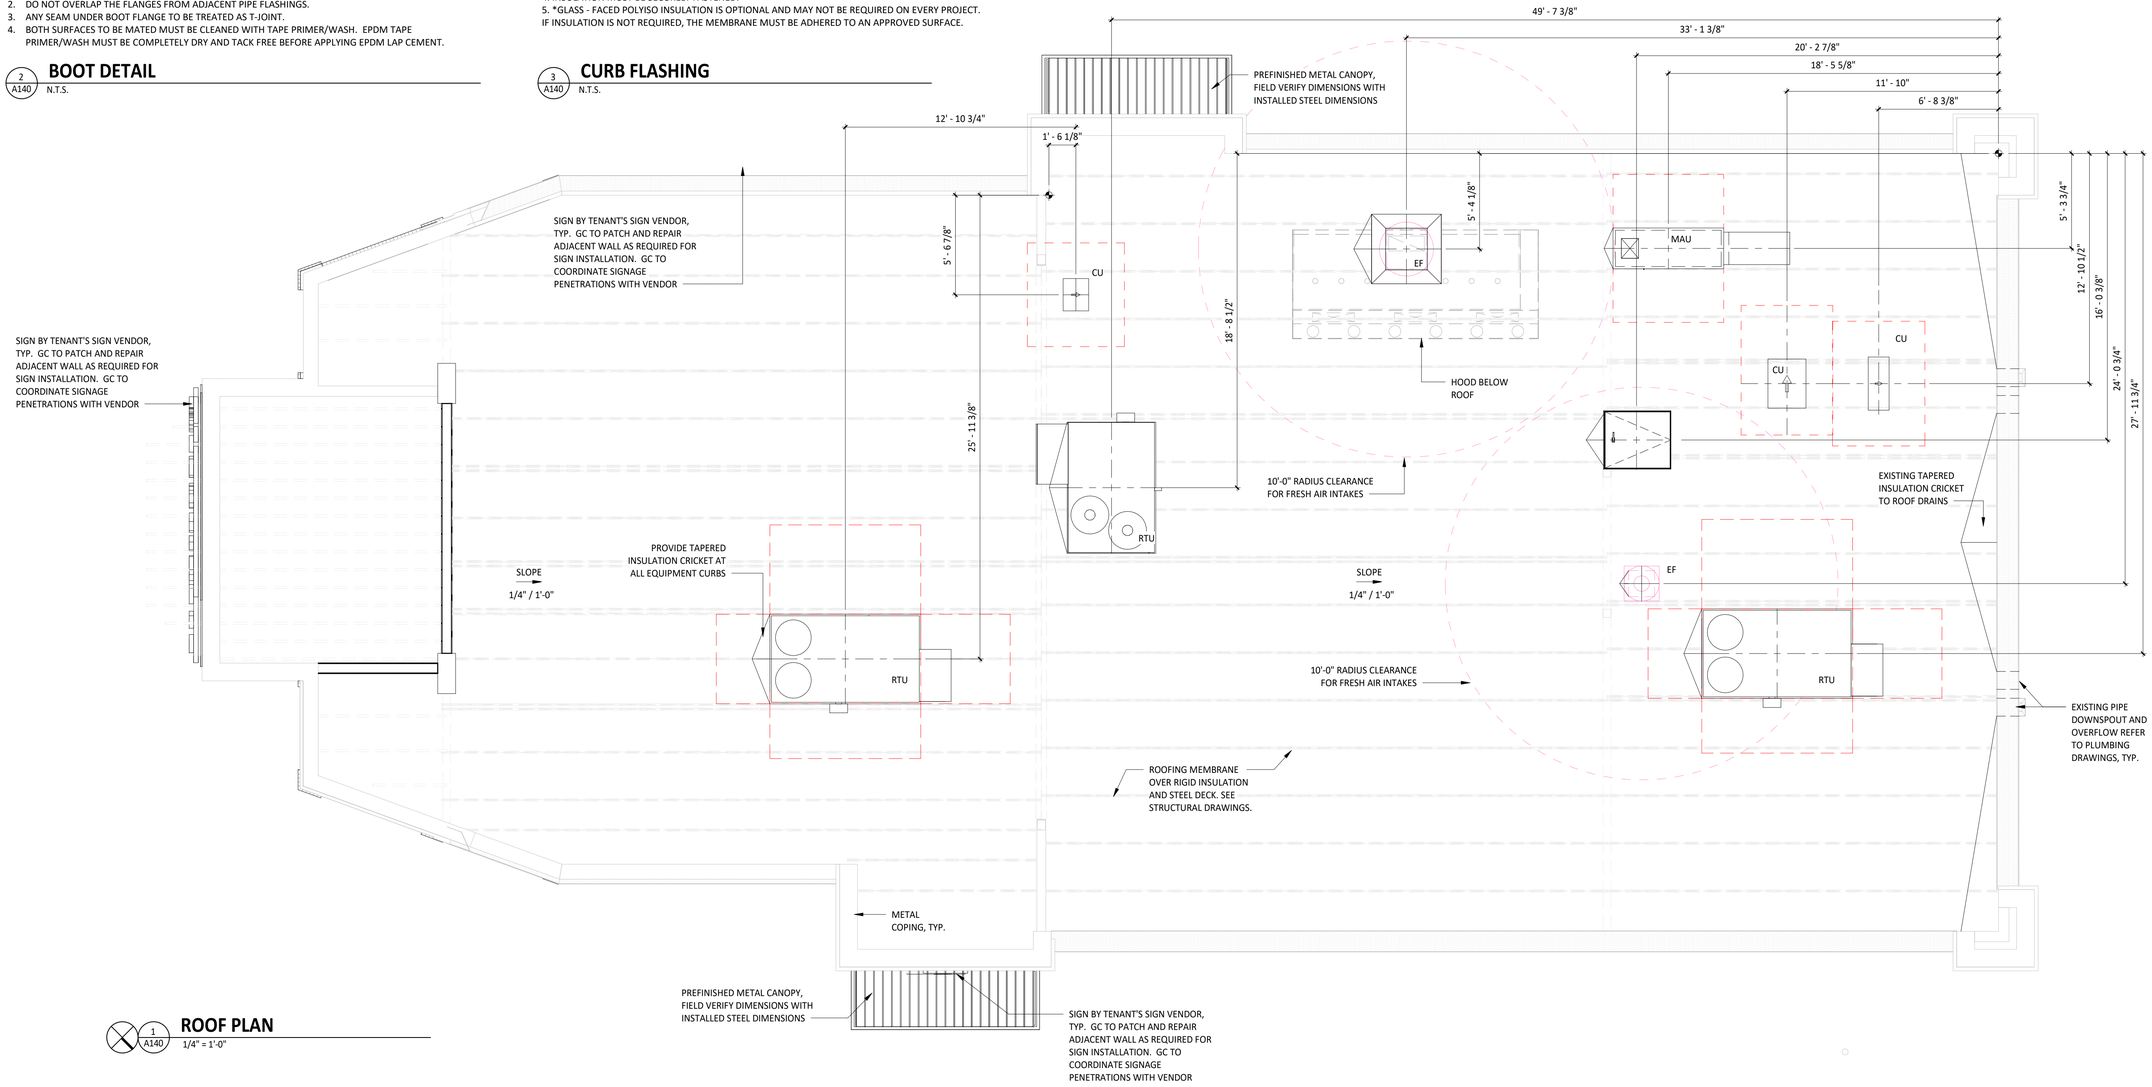

1 / A140 ROOF PLAN

1/4" = 1'-0"

Consultant:
GF
www.greenbergfarrow.com
92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ARCHITECTURAL ROOF PLAN

A140

GENERAL NOTES

1.	ALL INTERIOR LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER.
2.	ALL INTERIOR LIGHT FIXTURES AND LAMPS INSTALLED BY GC. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
3.	KITCHEN EXHAUST HOOD PROVIDED BY HS AND INSTALLED BY GC. GC TO COORDINATE PRESSURE TEST AND VIRO GUARD WITH ENVIROMATIC, INC.
4.	ANSUL BOX & FIRE SUPPRESSION SYSTEM PROVIDED BY AND INSTALLED BY HS. HOOD INTERLOCK BY GC. ELECTRICAL CONNECTION BY GC, RE: ELEC.
5.	MENU BOARD ASSEMBLY PROVIDED BY TMB, INSTALLED BY G.C.
6.	PROVIDE BLOCKING ABOVE MENU BOARD ASSEMBLY FOR INSTALLATION.
7.	REFER TO "09900 PAINTING - GENERAL" IN SPECIFICATIONS FOR FINISHES AT EXPOSED CEILING AREAS IN ADDITION TO NOTES LISTED ON THIS SHEET AND A120
8.	UNISTRUT TO BE LEFT UNPAINTED. PROVIDE MATCHING CLOSER STRIPS AND END CAPS. CLOSER STRIP TO BE APPLIED TO THE UNDERSIDE OF THE UNISTRUT.
9.	ALL HEIGHTS ARE TO BOTTOM OF FIXTURE UNLESS NOTED OTHERWISE.
10.	LIGHT DETAILS ARE LOCATED ON SHEET A210. FIXTURE AND LAMP SPECIFICATIONS ARE LOCATED ON E100.
11.	ALL UNISTRUT SUPPORTING CEILING ELEMENTS AND/ OR DUCT WORK SHALL NOT CONTAIN ANY ELECTRICAL CONDUIT. ALL ELECTRICAL CONDUIT MUST RUN IN SEPARATE UNISTRUT.
12.	ALL UNISTRUT, CONDUIT, SPRINKLER & WATER LINES SHALL BE INSTALLED TO THE BOTTOM OF THE DECK OR AS SHOWN IN DETAILS & LEFT UNPAINTED.
13.	ALL WATER LINES AND EXPOSED PCV SHALL BE INSTALLED UP IN TRUSSES AND PAINTED VICTORIAN PEWTER.
14.	ALL DIMENSIONS ARE TO FACE OF FRAMING, OR CENTERLINE OF FIXTURE UNLESS NOTED OTHERWISE.
15.	SEE ELECTRICAL DRAWINGS FOR SHATTER RESISTANT LAMP LOCATIONS.
16.	ALL EMERGENCY FIXTURES, LIGHTS AND STROBES SHALL BE ALIGNED OR CENTERED ON WALLS.
17.	FULL CERAMIC TILE COURSING SHALL TAKE PRECEDENT OVER ANY CEILING/HEADER DIMENSION INDICATED IN THE PLAN, REFER TO A120.
18.	ALL CONDUIT AND PIPE PENETRATIONS OF THE SERVING LINE SOFFIT ARE TO BE HELD TIGHT TO THE DECK. PLEASE CONSULT WITH THE CHIPOTLE CM SHOULD ANY CONFLICTS ARISE.
19.	BATT INSULATION TO BE INSTALLED ABOVE THE RESTROOM CEILING.
20.	ALL LAY-IN CEILING PENETRATIONS TO BE HELD TIGHT TO WALLS. REFER TO 10/A210 AND PLUMBING DRAWINGS FOR DETAILS.
21.	REFER TO STRUCTURAL DRAWINGS FOR HOOD SUSPENSION DETAILS.
22.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS PROVIDED BY TENANT'S LIGHT/LAMP SUPPLIER, U.N.O.
23.	ALL EXTERIOR PARKING LOT LIGHT FIXTURES AND LAMPS PROVIDED BY AND INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
24.	ALL EXTERIOR BUILDING MOUNTED AND PATIO LIGHT FIXTURES AND LAMPS INSTALLED BY G.C. CAREFULLY REVIEW LIGHTING FIXTURE SCHEDULE ON SHEET E100.
25.	SECURITY CAMERA LOCATIONS ARE ONLY APPROXIMATE LOCATIONS. FOR GUIDANCE ON THE SPECIFIC LOCATION/ORIENTATION OF THESE CAMERAS, REFER TO THE ENVYSION INSTALLATION GUIDE
26.	REFER TO A120 FOR FINISH SCHEDULE.
27.	COORDINATE PLACEMENTS OF P5 AND P6 IN MAIN DINING AREA WITH CHIPOTLE DM AT THE TIME OF INSTALLATION

LIGHT FIXTURE SCHEDULE

ITEM #	QTY	MOUNT	DESCRIPTION	REMARKS
A1	8	LAY-IN	2x2 LENSED TROFFER	SEE SHEET E100
B1	7	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B2	40	CEILING	RECESSED 6IN CAN LIGHT	SEE SHEET E100
B3	4	CEILING	M4.0 - RECESSED 6IN CAN LIGHT (BLACK)	SEE SHEET E100
C0	2	SURFACE	LOW PROFILE LED 1FT	SEE SHEET E100
C2	2	SURFACE	LOW PROFILE LED 3FT	SEE SHEET E100
C3	11	SURFACE	LOW PROFILE LED 4FT	SEE SHEET E100
C4	5	SURFACE	LOW PROFILE LED 5FT	SEE SHEET E100
E1	3	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
E2	2	VARIOUS	EMERGENCY LIGHT - SINGLE HEAD	SEE SHEET E100
E4	3	VARIOUS	WHITE EXIT LIGHT - STANDARD RED LETTERS	SEE SHEET E100
E7	8	VARIOUS	EMERGENCY LIGHT - DUAL HEAD	SEE SHEET E100
H1	8	SURFACE	VAPOR PROOF HOOD LIGHT	SEE SHEET E100
J4	2	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100
P5	15	PENDANT	M4.0 - PENDANT LIGHT	SEE SHEET E100
P6	3	PENDANT	M4.0 - MULTI-PENDANT LIGHT	SEE SHEET E100 & A701
T1	14	TRACK	TRACK LIGHTING HEAD	SEE SHEET E100
T-6	5	SUSPENDED	M4.0 - TRACK 6'	SEE SHEET E100
X9	4	SURFACE	LED CHANNEL LIGHT	SEE SHEET E100

CONDUIT GUIDELINES

SEE ELECTRICAL DRAWINGS FOR CONDUIT REQUIREMENTS. METAL CLAD CABLE AND FLEXIBLE METAL CONDUIT SHALL NOT BE INSTALLED IN AREAS EXPOSED TO VIEW UNLESS SPECIFICALLY NOTED OTHERWISE


SPEAKER SCHEDULE

ITEM #	QTY	DESCRIPTION	COLOR/FINISH	MOUNT	REMARKS
SP1	6	DINING ROOM SPEAKER	BLACK	SUSPENDED	REFER TO A201 & E110 FOR DETAILS

SECURITY SYSTEM

*REFER TO ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION

DESCRIPTION	QTY	FURNISHED BY	INSTALLED BY	UTILITIES ELEC	GAS	SEWER	WATER	REMARKS
SECURITY MONITOR	1	SSS	SSS	●				
SECURITY ALARM - MOTION DETECTORS	1	T.B.D.	T.B.D.	●				GC RESPONSIBLE FOR COORDINATING SEQUENCING OF PREWIRING WITH COMPLETION OF INTERIOR FINISHES (GYP. BD. FINISHES)
72 HR SECURITY DVR	1	SSS	SSS	●				
CLOSED CIRCUIT T.V. CAMERA - OUTDOOR	2	SSS	SSS	●				INSTALL AT 9'-6" U.N.O.
CLOSED CIRCUIT T.V. CAMERA - INDOOR	6	SSS	SSS	●				

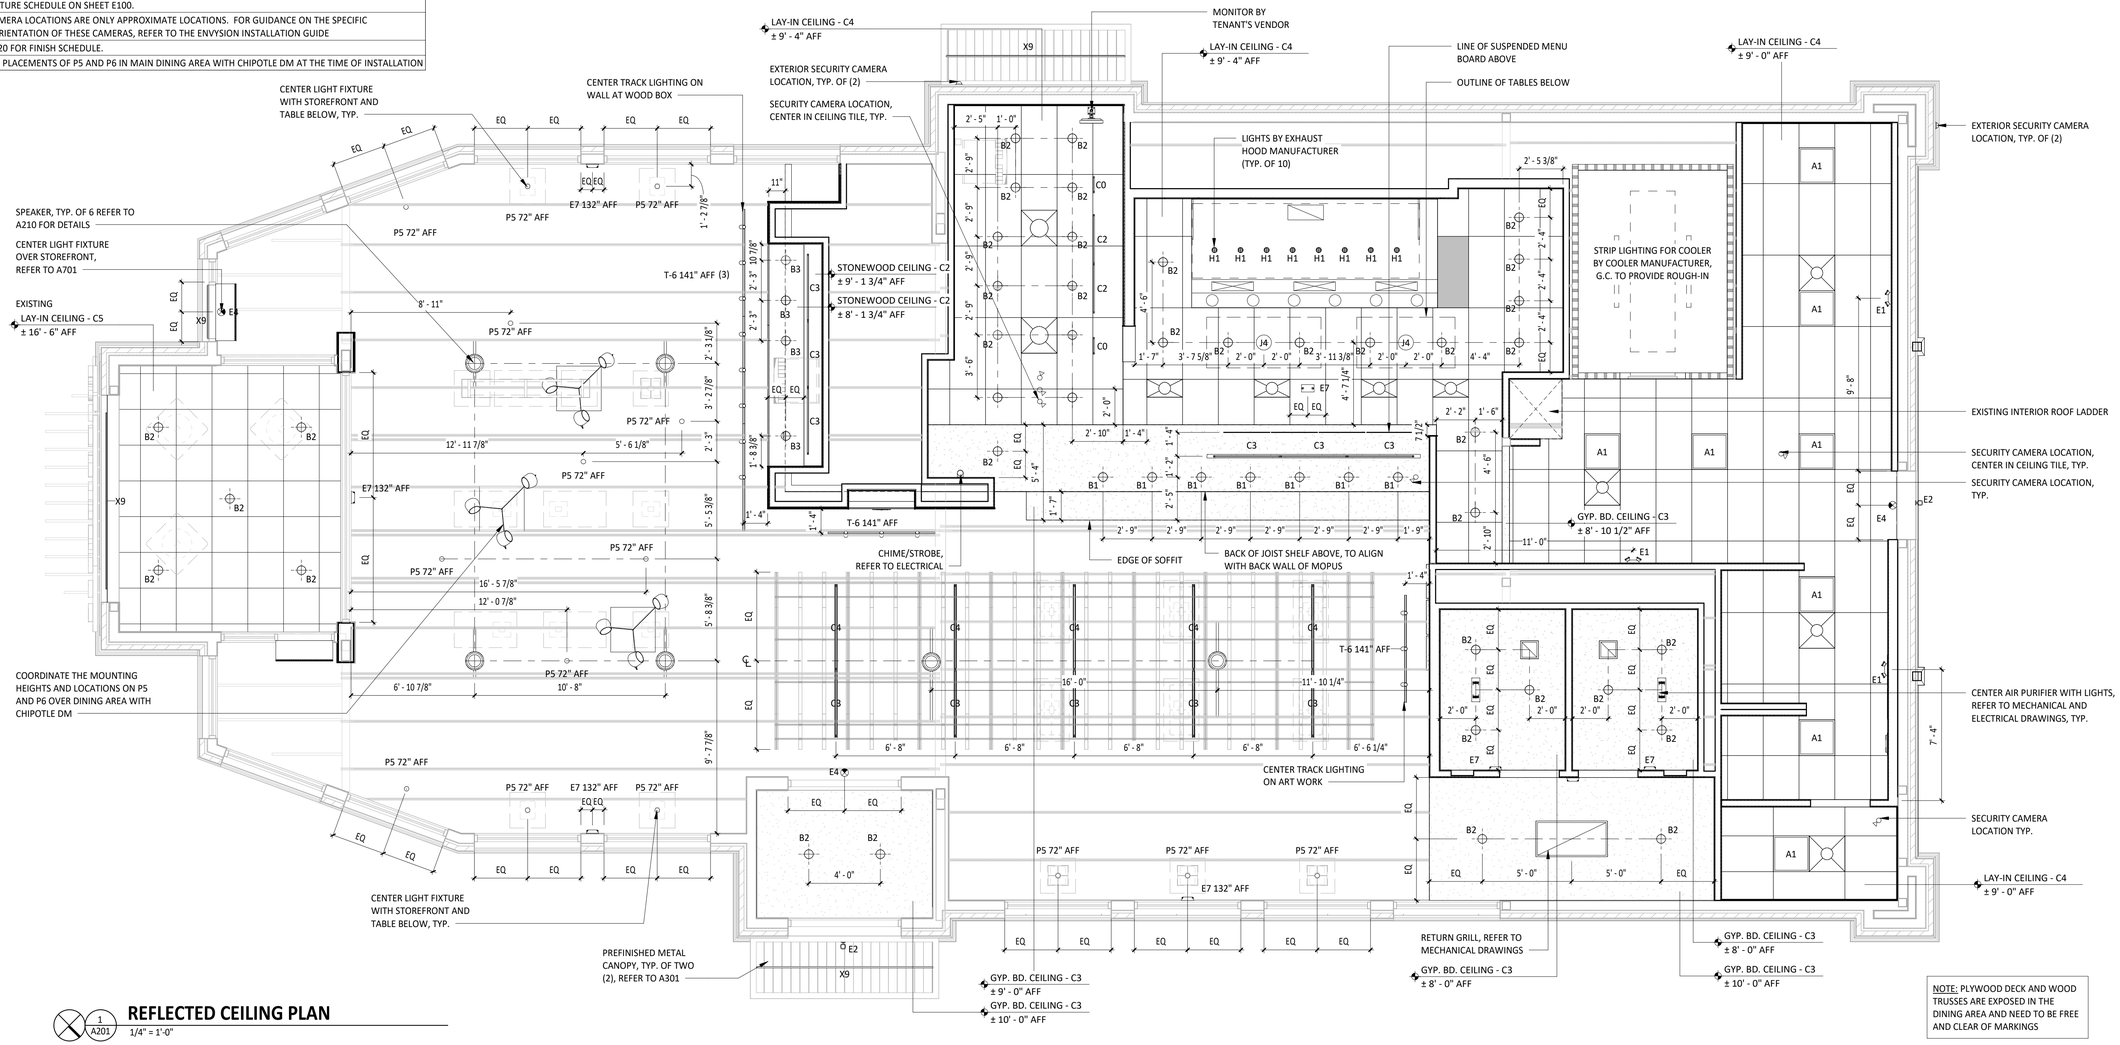

1 / A201 **REFLECTED CEILING PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ, 08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
1	02/02/2024	Revision 1

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

REFLECTED CEILING PLAN


A201

GENERAL NOTES

1. REFER TO SHEET A201 FOR GENERAL REFLECTED CEILING PLAN NOTES.

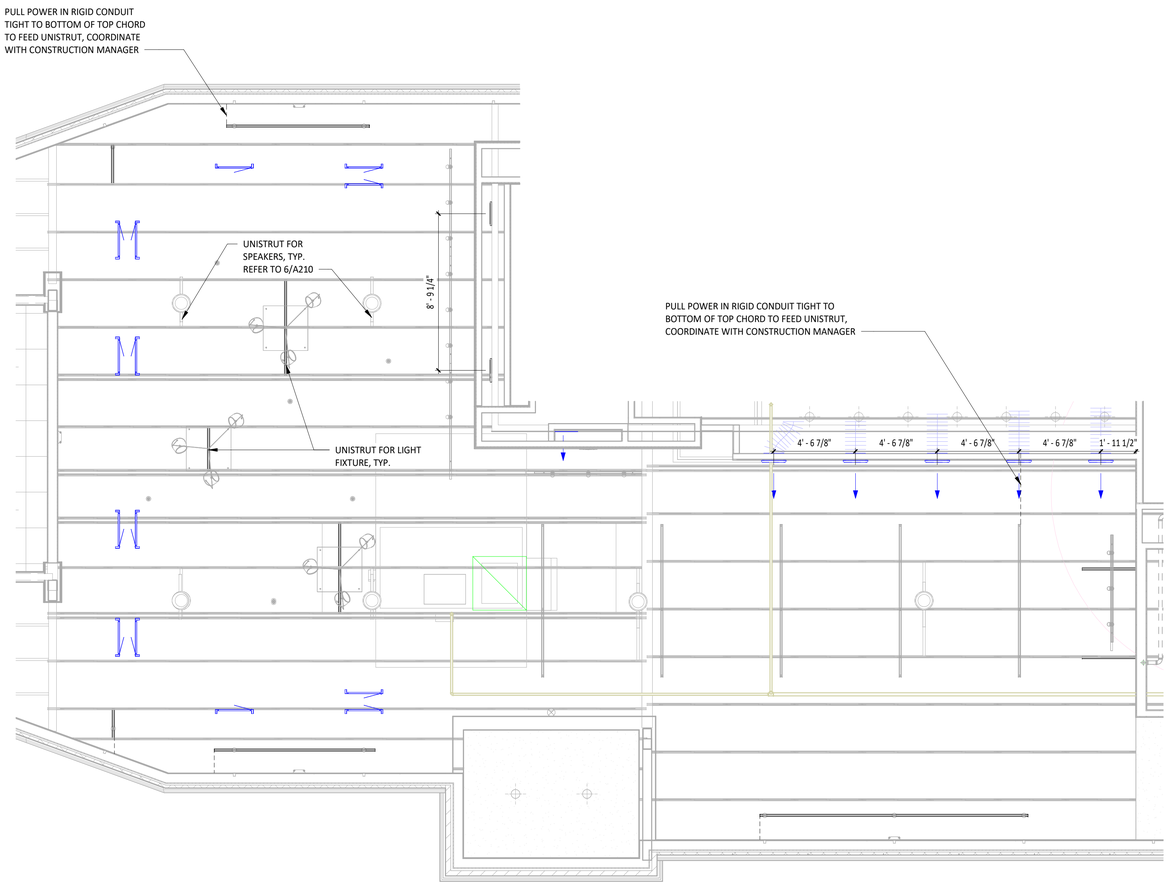

2 A202 **UNISTRUT PLAN**
1/4" = 1'-0"

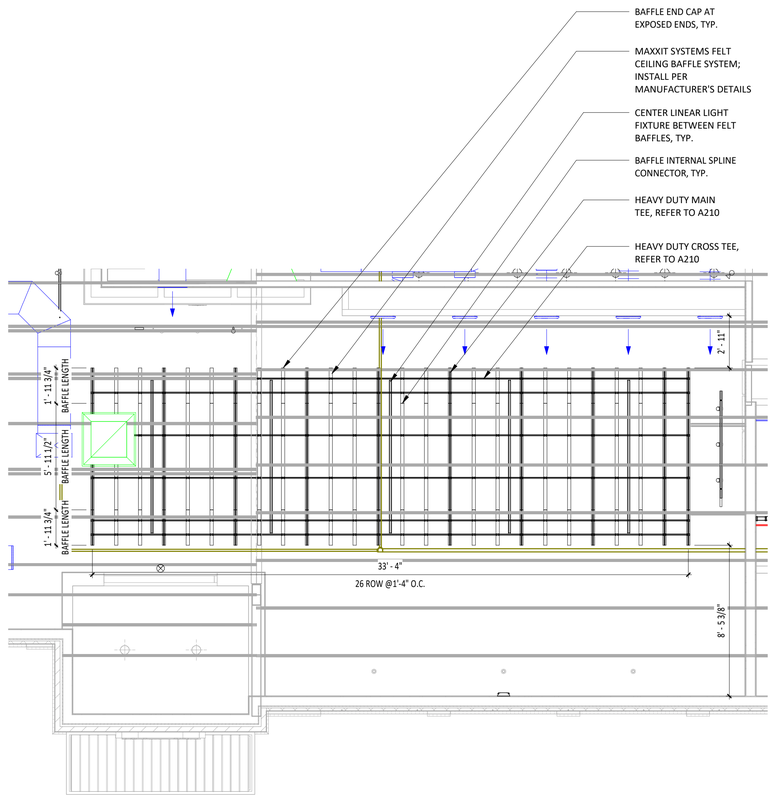

1 A202 **FELT BAFFLE PLAN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000


Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

REFLECTED CEILING PLANS - ENLARGED


A202

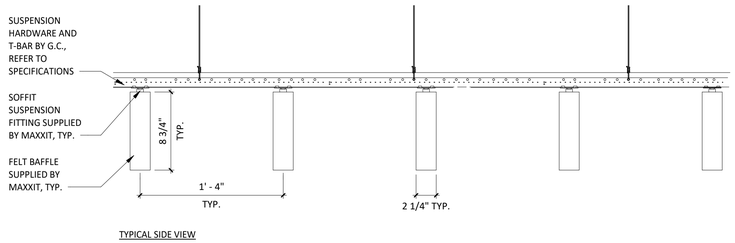


12 A210 **FELT BLADE LAYOUT**
1 1/2" = 1'-0"

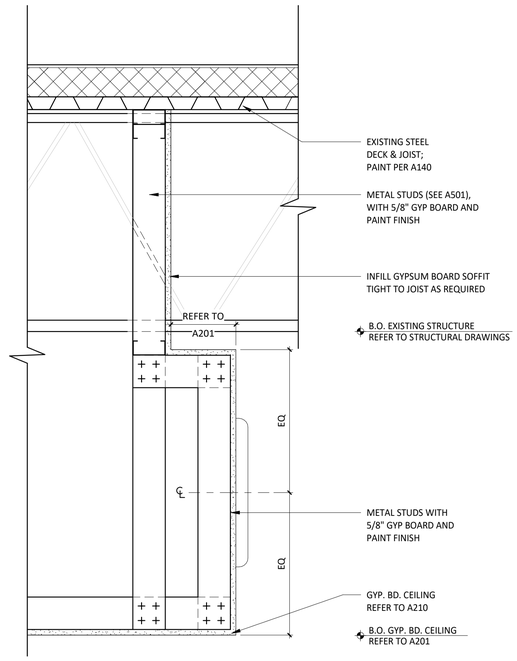


11 A210 **JOIST SHELF DETAIL**
1 1/2" = 1'-0"

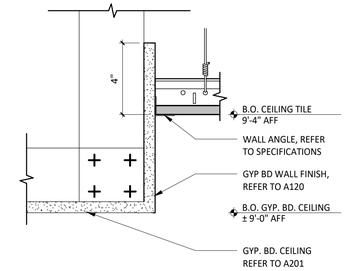


10 A210 **KITCHEN CEILING TRANSITION**
3" = 1'-0"

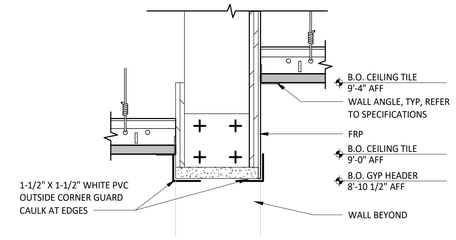


9 A210 **KITCHEN CEILING TRANSITION**
3" = 1'-0"

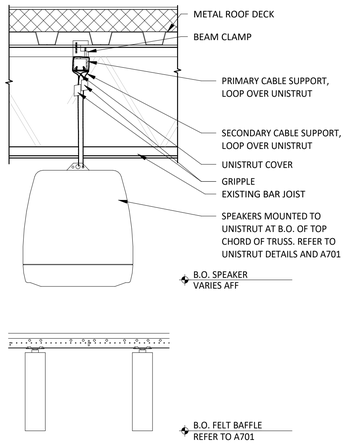


8 A210 **SUSPENDED SPEAKER DETAIL**
1 1/2" = 1'-0"

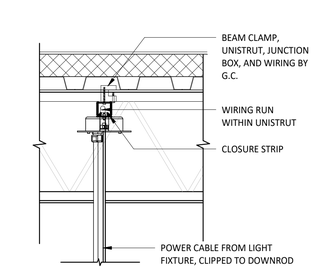


7 A210 **UNISTRUT DETAIL**
1 1/2" = 1'-0"

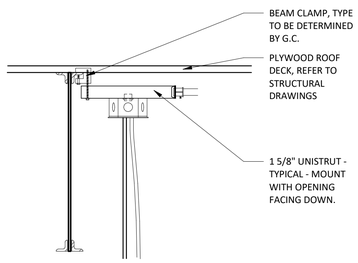


6 A210 **TYP. UNISTRUT MOUNTING DETAIL**
1 1/2" = 1'-0"

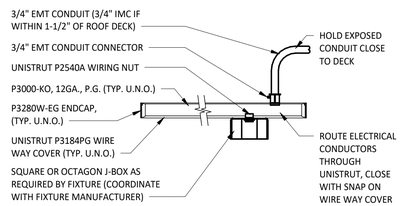


5 A210 **UNISTRUT MOUNTING DETAIL**
1 1/2" = 1'-0"

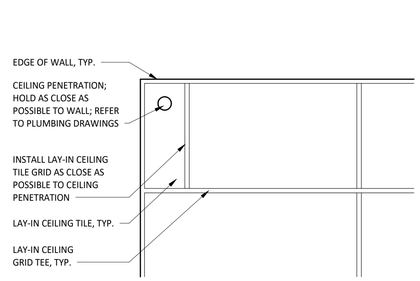


4 A210 **LAY-IN CEILING PENETRATION - PLAN DETAIL**
3/4" = 1'-0"

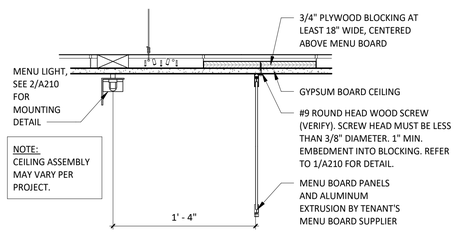

3 A210 **MENU BOARD DETAIL**
1 1/2" = 1'-0"

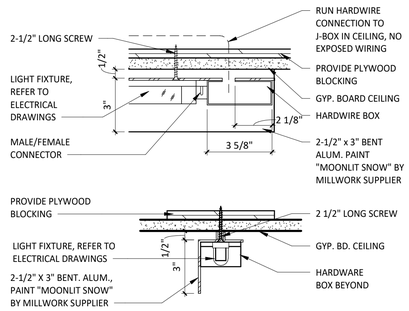

2 A210 **MENU BOARD / ACCENT LIGHT DETAILS**
3" = 1'-0"

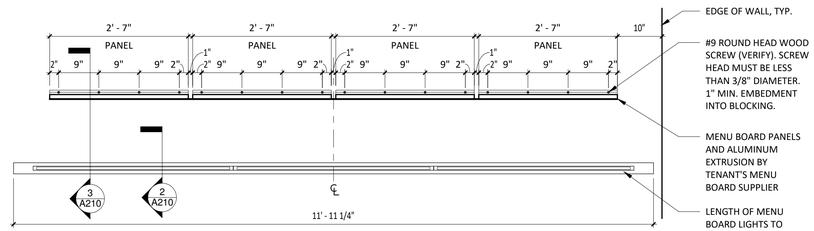

1 A210 **MENU - SCREW PATTERN PLAN**
3/4" = 1'-0"

Consultant:
GF
www.greenbergfarrow.com
92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect


Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:
CEILING DETAILS

A210

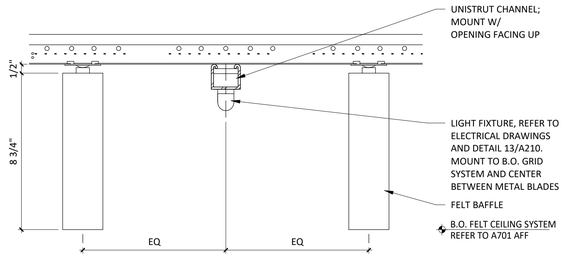


5 A211 SUSPENDED LIGHT @ FELT BLADE

3" = 1'-0"

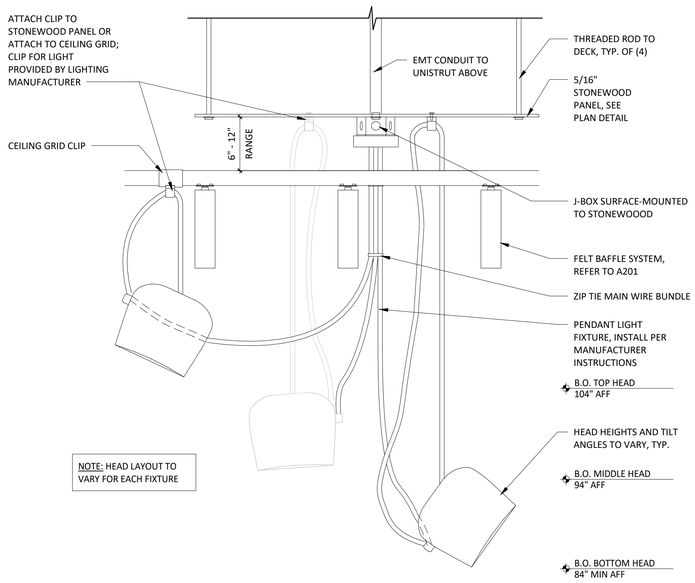


4 A211 SUSPENDED LIGHT FIXTURE @ FELT BLADES


1 1/2" = 1'-0"

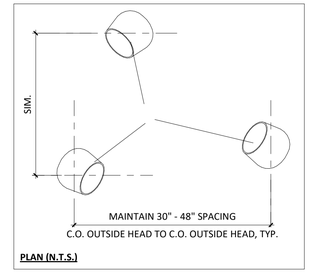


PLAN (N.T.S.)

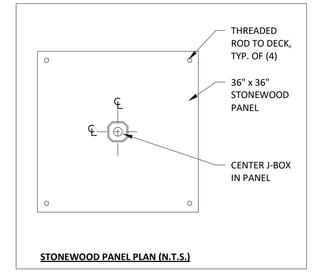

STONEWOOD PANEL PLAN (N.T.S.)




JUNCTION BOX CONDITION @ GYP. BD. CEILING

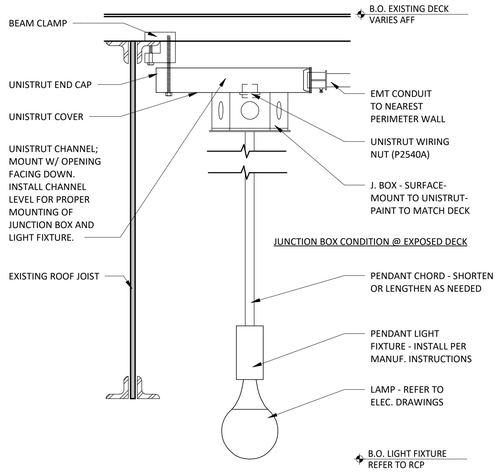


3 A211 PENDANT LIGHT

3" = 1'-0"

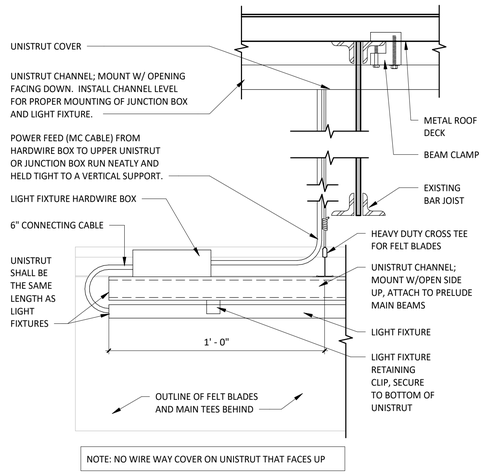

2 A211 SUSPENDED STRIP LIGHT CONNECTION DETAIL @ FELT BLADE

3" = 1'-0"

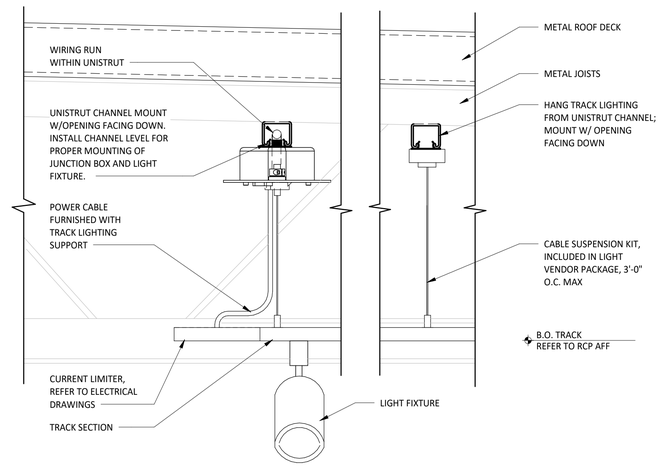

1 A211 TRACK LIGHT

3" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

LIGHTING DETAILS


A211

GENERAL NOTES


1. REFER TO EXTERIOR ELEVATIONS THIS SHEET FOR EXTERIOR SIGNAGE LOCATIONS, SIZES & DESCRIPTIONS.
2. EXTERIOR SIGNAGE PROVIDED BY TSV AND INSTALLED BY TSV. GC TO MAKE FINAL CONNECTION.
3. METAL CANOPY AND ROOF SCREEN ARE AVAILABLE FROM AMERICAN PRODUCTS, INC. (API), PHONE: (813) 925-0144, E-MAIL: BIDS@AMERICANPROD.COM

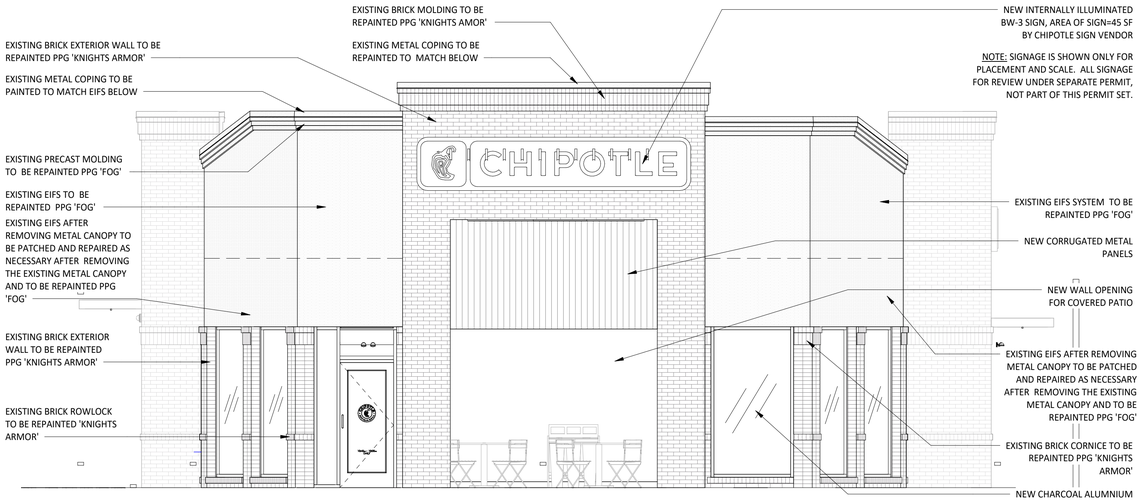


1 A301 **EXTERIOR ELEVATION - SOUTH EAST**
1/4" = 1'-0"

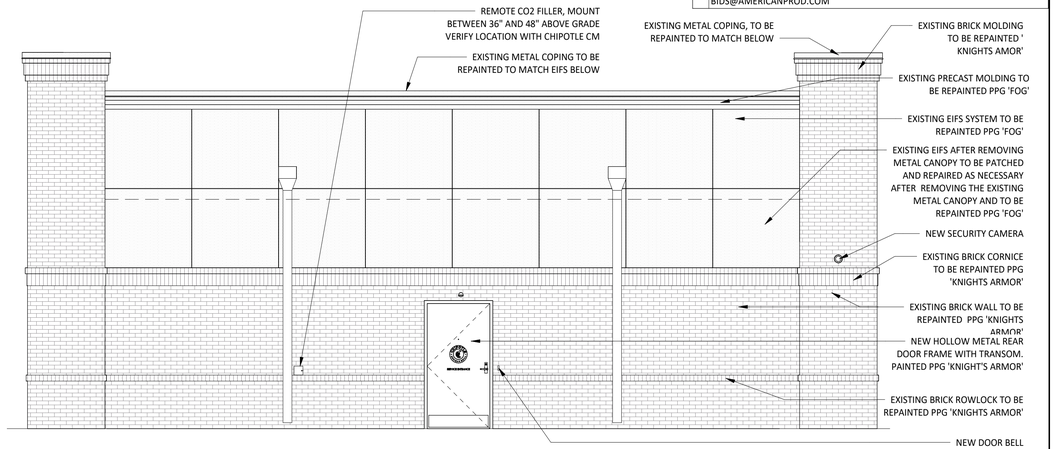

2 A301 **EXTERIOR ELEVATION - NORTH WEST**
1/4" = 1'-0"

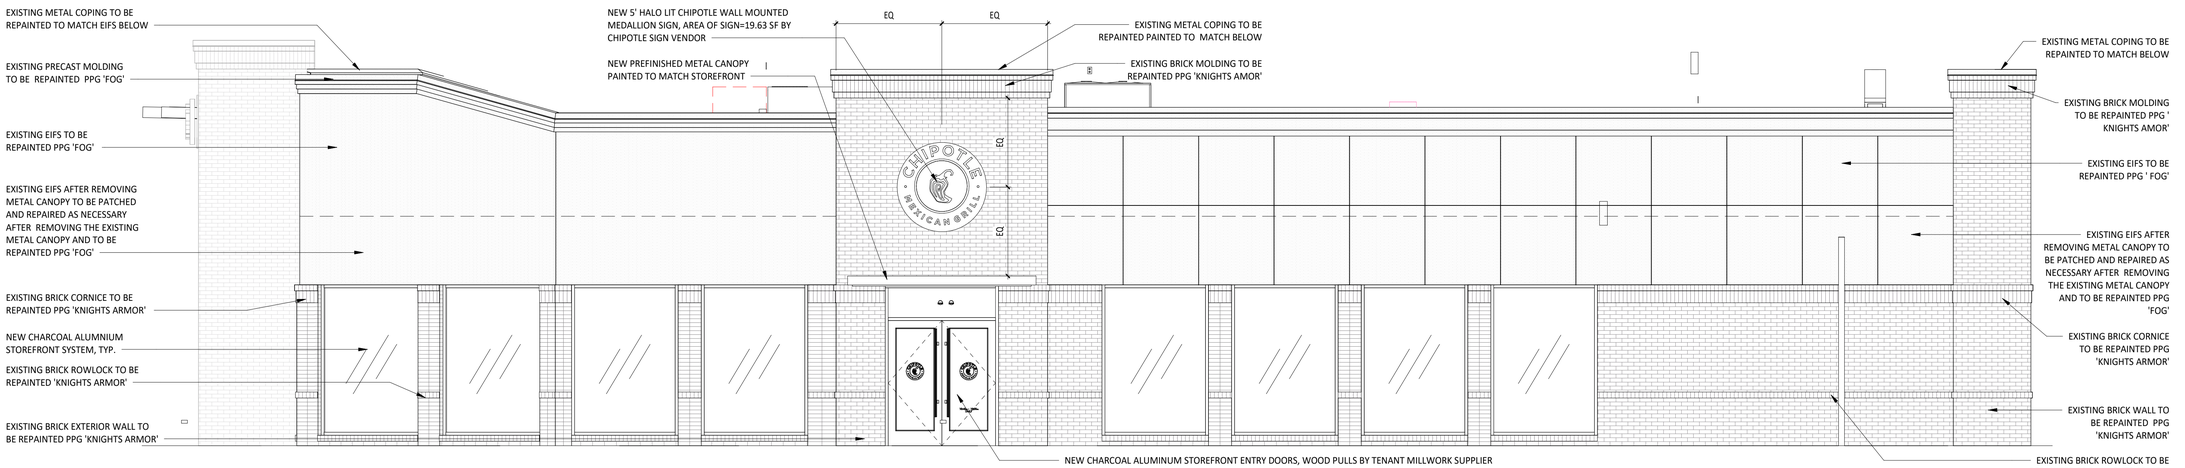

3 A301 **EXTERIOR ELEVATION**
1/4" = 1'-0"

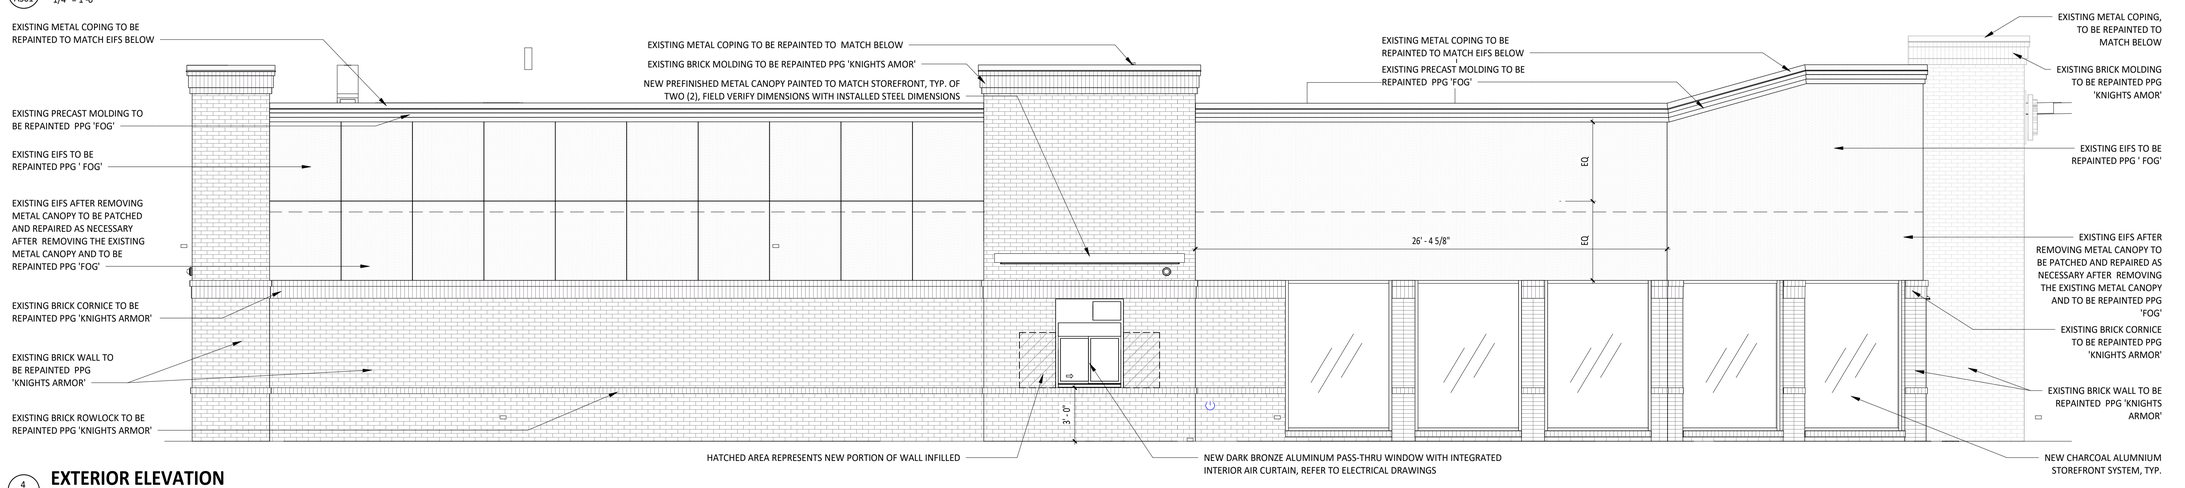

4 A301 **EXTERIOR ELEVATION**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000


Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:


EXTERIOR ELEVATIONS


A301

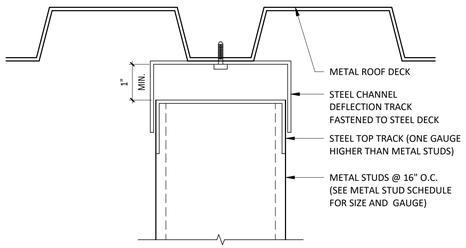

2 A501 **DEFLECTION TRACK DETAIL @ PARTITION**


6" = 1'-0"

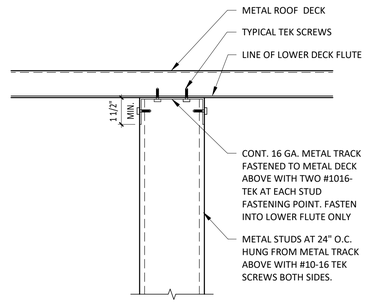

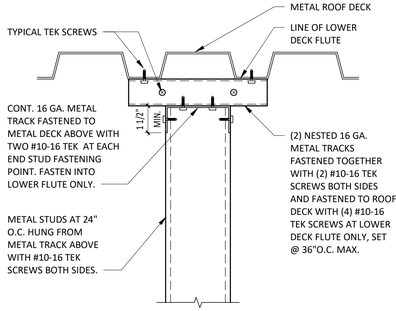

4 A501 **SOFFIT HANGING DETAIL**


3" = 1'-0"

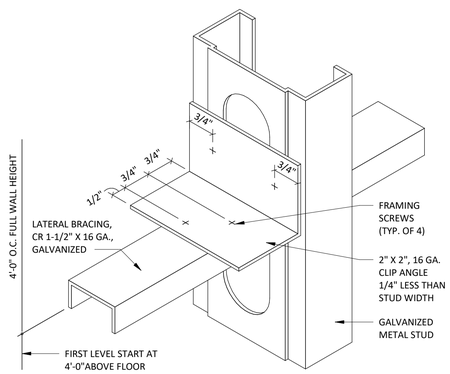

3 A501 **LATERAL BRACING DETAIL @ PARTITION**

NOT TO SCALE

Design No. U419
Nonbearing Wall Ratings — 1, 2, 3 or 4 Hr (See Items 3 & 4)



1. **Floor and Ceiling Runners —** (Not shown) — For use with Item 2 - Channel shaped, fabricated from min 25 MSG corrosion-protected steel, min width to accommodate stud size, with min 1 in. long legs, attached to floor and ceiling with fasteners 24 in. OC max.

1A. **Floor and Ceiling Runners* —** Not shown – In lieu of Item 1 **— For** use with Item 2A, proprietary channel shaped, min. 3-5/8 in. wide with 1 in. long legs, fabricated from min. 0.0150 in. (0.0146 in., min bare metal thickness) galvanized steel, attached to floor and ceiling **with fas**teners 24 in. OC. max.
DIETRICH INDUSTRIES INC—UltraSTEEL®.

1B. **Floor and Ceiling Runners —** (Not shown – In lieu of Item 1) **— For** use with Item 2A, proprietary channel shaped, min. 2-9/16 in. wide with 3/16 in. wide flanges, fabricated from min. 0.0150 in. galvanized steel, attached to floor and ceiling fasteners 24 in. OC. max.
DIETRICH INDUSTRIES INC—UltraSTEEL®.

2. **Steel Studs —** Channel shaped, fabricated from min 25 MSG corrosion-protected steel, min width as indicated under Item 4, min 1-1/4 in. flanges and 1/4 in. return, spaced a max of 24 in. OC. Studs to be cut 3/8 to 3/4 in. less than assembly height. Allowable use of studs is shown in the table below. For direct attachment of gypsum board only.
DIETRICH INDUSTRIES INC—UltraSTEEL®.

3. **Batts and Blankets* —** (Required as indicated under Item 4) — Mineral wool batts, friction fitted between studs and nanners. Min nom thickness as indicated under Item 4. See **Batts and Blankets (BKNV or BZJZ) Categories** for names of Classified companies.

4. **Batts and Blankets* —** (Optional) — Placed in stud cavities, any glass fiber or mineral wool insulation bearing the UL Classification Marking as to Surface Burning Characteristics and/or Fire Resistance. See **Batts and Blankets (BKNV or BZJZ) Categories** for names of Classified companies.

4. **Gypsum Board* —** Gypsum panels with beveled, square or tapered edges, applied vertically or horizontally. Vertical joints centered over studs and staggered one stud cavity on opposite sides of studs. Vertical joints in adjacent layers (multilayer systems) staggered one stud cavity. Horizontal joints need not be backed by steel framing. Horizontal edge joints and horizontal butt joints on opposite sides of studs need not be staggered. Horizontal edge joints and horizontal butt joints in adjacent layers (multilayer systems) staggered a min of 12 in. The thickness and number of layers for the 1 hr, 2 hr, 3 hr and 4 hr ratings are as follows:

Wallboard Protection on Each Side of Wall

Rating	Min Stud Depth, Item 2	Min Stud Depth, Item 2A	No. of Layers & Thkns of Panel	Min Thkns of Insulation (Item 3)
1	3-1/2	3-5/8	1 layer, 5/8 in. thick	Optional
1	2-1/2	3-5/8	1 layer, 1/2 in. thick	1-1/2 in.
1	1-5/8	3-5/8	1 layer, 3/4 in. thick	Optional
2	1-5/8	2-1/2	2 layers, 1/2 in. thick	Optional
2	1-5/8	2-1/2	2 layers, 5/8 in. thick	Optional
2	3-1/2	3-5/8	1 layer, 3/4 in. thick	3 in.
3	1-5/8	2-1/2	3 layers, 1/2 in. thick	Optional
3	1-5/8	2-1/2	2 layers, 3/4 in. thick	Optional
3	1-5/8	2-1/2	3 layers, 5/8 in. thick	Optional
4	1-5/8	2-1/2	4 layers, 5/8 in. thick	Optional
4	1-5/8	2-1/2	4 layers, 1/2 in. thick	Optional
4	2-1/2	2-1/2	2 layers, 3/4 in. thick	2 in.

CANADIAN GYPSUM COMPANY —1/2 in. thick Type C, IP-X2 or IPC-AR; WRC, 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRX or WRC; 3/4 in. thick Types IP-X3 or ULTRACODE
UNITED STATES GYPSUM CO—1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type SCX, SHX, WRX, IP-X1, AR, C, WRC, FRX-G, IP-AR, IP-X2, IPC-AR; 3/4 in. thick Types IP-X3 or ULTRACODE
USG MEXICO S A DE C V —1/2 in. thick Type C, IP-X2, IPC-AR or WRC; 5/8 in. thick Type AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRX, WRC or; 3/4 in. thick Types IP-X3 or ULTRACODE
When Item 6B, Steel Framing Members*, is used, Nonbearing Wall Rating is limited to 1 Hr. Min. stud depth is 3-1/2 in., min. thickness of insulation (Item 3) is 3 in., and two layers of gypsum board panels (1/2 in. or 5/8 in. thick) shall be attached to furring channels as described in Item 5. One layer of gypsum board panels (1/2 in. or 5/8 in. thick) attached to opposite side of stud without furring channels as described in Item 5.

4a. **Gypsum Board* —** (As an alternate to Item 4) — 5/8 in. thick, 24 to 54 in. wide, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 5.
CANADIAN GYPSUM COMPANY—Type SHX.
UNITED STATES GYPSUM CO—Type FRX-G, SHX.
USG MEXICO S A DE C V—Type SHX.

5. **Fasteners —** (Not shown) — For use with Item 2 - Type S or S-12 steel screws used to attach panels to studs (Item 2) or furring channels (Item 9). **Single layer systems:** 1 in. long for 1/2 and 5/8 in. thick panels or

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV) 959

1-1/4 in. long for 3/4 in. thick panels, spaced 8 in. OC when panels are applied horizontally, or 8 in. OC along vertical and bottom edges and 12 in. OC in the field when panels are applied vertically. **Two layer systems:** First layer- 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC with screws offset 8 in. from first layer.**Three-layer systems:** First layer- 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer- 2-1/4 in. long for 1/2 in., 5/8 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below. **Four-layer systems:** First layer- 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer- 2-1/4 in. long for 1/2 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 24 in. OC. Fourth layer- 2-5/8 in. long for 1/2 in. thick panels or 3 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below.

5A. **Fasteners —** (Not shown) —For use with Item 2A - Type S or S-12 steel screws used to attach panels to studs (Item 2). **Single layer systems:** 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 8-1/2 in. OC with additional screws 1 in. and 2-1/2 in. from edges of the board when panels are horizontally or 8 in. OC along vertical and bottom edges and 12 in. OC in the field when panels are applied vertically. **Two layer systems applied vertically:** First layer- 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC with screws offset 8 in. from first layer. **Two layer systems applied horizontally:** First layer- 1 in. long for 1/2 and 5/8 in. thick panels or 1-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC starting 8 in. from each edge of the board with an additional screw placed 1-1/4 in. from each edge of the board. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels or 2-1/4 in. long for 3/4 in. thick panels, spaced 16 in. OC starting 8 in. from each edge of the board with an additional screw placed 1-1/4 in. from each edge of the board with screws offset 8 in. from first layer. **Three-layer systems:** First layer- 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer- 2-1/4 in. long for 1/2 in., 5/8 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels or 3 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below. For all layers, an additional screw shall be placed 1-1/4 in. from each edge of the board. **Four-layer systems:** First layer- 1 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Second layer- 1-5/8 in. long for 1/2 in., 5/8 in. thick panels, spaced 24 in. OC. Third layer- 2-1/4 in. long for 1/2 in. thick panels or 2-5/8 in. long for 5/8 in. thick panels, spaced 24 in. OC. Fourth layer- 2-5/8 in. long for 1/2 in. thick panels or 3 in. long for 5/8 in. thick panels, spaced 12 in. OC. Screws offset min 6 in. from layer below. For all layers, an additional screw shall be placed 1-1/4 in. from each edge of the board.

6. **Furring Channels —** (Optional, not shown, for single or double layer systems) — Resilient furring channels fabricated from min 25 MSG corrosion-protected steel, spaced vertically a max of 24 in. OC. Flange portion attached to each intersecting stud with 1/2 in. long Type S-12 steel screws. Not for use with Item 4A.

6A. **Steel Framing Members (Not Shown)* —** (Optional) — Used on one or both sides, not shown, for single or double layer systems) — As an alternate to Item 6, furring channels and Steel Framing Members as described below.
a. **Furring Channels —** Formed of No. 25 MSG galv steel. 2-3/8 in. wide by 7/8 in. deep, spaced max. 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Gypsum board attached to furring channels as described in Item 5. Not for use with Item 4A.
b. **Steel Framing Members* —** Used to attach furring channels (Item 6Aa) to studs (Item 2). Clips spaced max. 48 in. OC., and secured to studs with No. 8 x 1-1/2 in. minimum self-drilling, S-12 steel screw through the center grommet. Furring channels are friction fitted into clips.
PAC INTERNATIONAL INC—Type RSIC-1.

6B. **Steel Framing Members (Optional, Not Shown)* —** As an alternate to Item 6, furring channels and Steel Framing Members on only one side of studs as described below:
a. **Furring Channels —** Formed of No. 25 MSG galv steel, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Batts and Blankets placed in stud cavity as described in Item 4. Two layers of gypsum board attached to furring channels as described in Item 4. Not for use with Item 4A.
b. **Steel Framing Members* —** Used to attach furring channels (Item 6Ba) to one side of studs (Item 2) only. Clips spaced 48 in. OC., and secured to studs with two No. 8 x 2-1/2 in. coarse drywall screws, one through the hole at each end of the clip. Furring channels are friction fitted into clips.

960 FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)

KINETICS NOISE CONTROL INC — Type Isomax

7. **Joint Tape and Compound —** Vinyl or casein, dry or premixed joint compound applied in two coats to joints and screw heads of outer layers. Paper tape, nom 2 in. wide, embedded in first layer of compound over all joints of outer layer panels. Paper tape and joint compound may be omitted when gypsum panels are supplied with a square edge.
8. **Siding, Brick or Stucco —** (Optional, not shown) — Aluminum, vinyl or steel siding, brick veneer or stucco, meeting the requirements of local code agencies, installed over gypsum panels. Brick veneer attached to studs with corrugated metal wall ties attached to each stud with steel screws, not more than each sixth course of brick.
9. **Caulking and Sealants* —** (Optional, not shown) — A bead of acoustical sealant applied around the partition perimeter for sound control.
UNITED STATES GYPSUM CO —Type AS

*Bearing the UL Classification Mark


1 A501 **U419**

N.T.S.


WALL TYPES

1. G.C. SHALL PROVIDE SOLID BLKG. IN WALLS AS NEEDED
2. REFER TO ARCHITECTURAL FLOOR PLAN FOR ALL STUD SIZES
3. REFER TO A120 FOR ALL WALL FINISHES


NOTE: ALL CONCEALED WOOD TO BE FRT RATED




W1 INTERIOR PARTITION




W1a INTERIOR PARTITION




W1ax INTERIOR PARTITION




W3a INTERIOR PARTITION




W3ax INTERIOR PARTITION




W4a INTERIOR PARTITION




W5 INTERIOR PARTITION




W5a INTERIOR PARTITION




W6 INTERIOR PARTITION




W7 INTERIOR PARTITION




W10a INTERIOR PARTITION




W11 INTERIOR PARTITION




W14 INTERIOR PARTITION




W15ax INTERIOR PARTITION



W23 INTERIOR PARTITION



W26a INTERIOR PARTITION



W28 INTERIOR PARTITION

GENERAL NOTES

REFER TO FINISH SCHEDULE AND CERAMIC TILE WALL FINISHES KEY PLAN ON SHEET A120 FOR WALL FINISHES, REFER TO FLOOR PLAN ON A110 FOR METAL STUD SIZE.

STUD SCHEDULE & NOTES

SIZE/TYPE	W/O HUNG SHELVING	W/ HUNG SHELVING
3625125-18	UP TO 12'-0"	
3625137-33	UP TO 16'-0"	UP TO 12'-0"
6005137-33	UP TO 22'-0"	UP TO 16'-0"
6005162-43	UP TO 26'-0"	UP TO 22'-0"

1. ALL HEIGHTS REFER TO UN-BRACED HEIGHTS.
2. ALL HEIGHTS BASED ON 16" O.C. SPACING.
3. BOTTOM TRACK TO BE SAME GAUGE AS STUD.
4. TOP TRACK TO BE ONE GAUGE HIGHER.

PARTITION NOTES

1. ALL METAL STUDS TO CONFORM TO LOCAL BUILDING CODES.
2. ALL STUD WALLS AND PARTITIONS REQUIRE GYP. BOARD ON BOTH SIDES FOR THE FULL HEIGHT OF THE STUDS UNLESS SPECIFICALLY DETAILED OTHERWISE.
3. ALL SUSPENDED WALLS SHALL HAVE GYP. BOARD WHICH EXTENDS 4" ABOVE THE SUSPENDED CEILING UNLESS SHOWN AND/OR NOTED OTHERWISE BY THE ARCHITECT.
4. FIRE RETARDANT PLYWOOD MAY SUBSTITUTE FOR GYP. BOARD WHERE SO DIRECTED BY THE ARCHITECT.
5. ALL STUD WALLS AND PARTITIONS SHALL HAVE CONTINUOUS LINES OF BRIDGING SPACED AT 4'-0" MAXIMUM ON CENTER. THE BRIDGING SHALL BE SECURELY FASTENED TO THE STUDS WITH EITHER SCREWS OR WELDS. REFER TO DETAILS THIS SHEET.
6. ALL STUDS SHALL BE "CEE" STUDS WITH FLANGE STIFFENERS.
7. THE MATERIALS AND DETAILS SHOWN ARE FOR TYPICAL INSTALLATIONS. WHERE THE STUD MANUFACTURER'S RECOMMENDATIONS OR LOCAL ORDINANCES ARE MORE RESTRICTIVE, THEY SHALL APPLY.
8. TYPICAL FASTENER:

A. STEEL STUDS TO STEEL STUDS OR TRACKS:
- 20 GAUGE - #8 - 18 X 1/2" TEKS WITH PHILIPS PAN HEAD - MIN. 2 PER CONNECTION
- 18/16 GAUGE - #10 - 16 X 3/4" TEKS WITH PHILIPS PAN HEAD - MIN. 3 PER CONNECTION

B. STEEL STUDS OR TRACKS TO WOOD PURLINS, GIRDERS AND BEAMS:
- #14 - 10 X 1-1/2" H.W.H. TYPE "S" METAL-TO-WOOD TEKS AT 12" O.C., 2" FROM EACH END

C. STEEL STUDS OR TRACKS TO STRUCTURAL STEEL (TUBE/WIDE FLANGE COL'S, BM'S, GIRDER'S, ETC.)
- 0.145" DIA. HILTI X-EDNI FASTENERS, 5/8" MIN, LENGTH AND MIN. OF 2 PER CONNECTION, OR 2 ROWS AT 16" O.C. FOR CONTINUOUS APPLICATIONS SUCH AS TRACKS, U.N.O.

D. PLYWOOD TO STEEL STUDS:
- #10 - 24 X 1-1/4" TEKS/3 (PLYMETALTEKS) WITH THIN WAFER HEAD - 24" O.C. FILED, 12" O.C. PERIMETER

E. GYPSUM BOARD TO STEEL STUDS:
- #7 X 1-1/4" HI-LOW TYPE "S" BUGLE HEAD SCREWS FOR 3/8" TO 5/8" GYP. BD. TO 25 GAUGE OR 20 GAUGE STUDS
- #6 X 1-1/4" TYPE S-12 BUGLE HEAD SCREWS FOR 3/8" TO 5/8" TO 18 GAUGE OR 16 GAUGE STUDS OR TRACKS
- FIELD - 12" O.C. CEILINGS, 24" O.C. WALLS
- BUTT JOINTS 12" O.C.

F. STEEL STUDS OR TRACKS TO CONCRETE:
- 0.145" DIA. HILTI X-DNI FASTENER, 1" MIN. LENGTH, 2 ROWS AT 16" O.C.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000


Drawn: DR
Checked: JB

Project No.
20210067.0


Contents:

ARCHITECTURAL WALL TYPES

A501

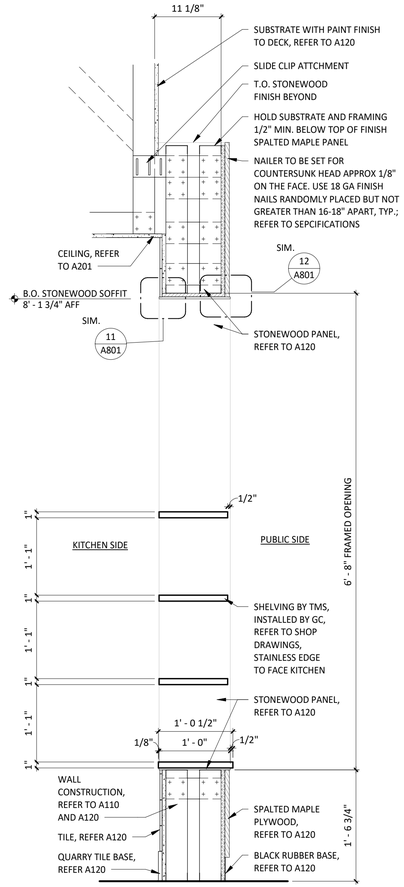

2 A502 **MOPUS SECTION - PASS THRU**
1" = 1'-0"

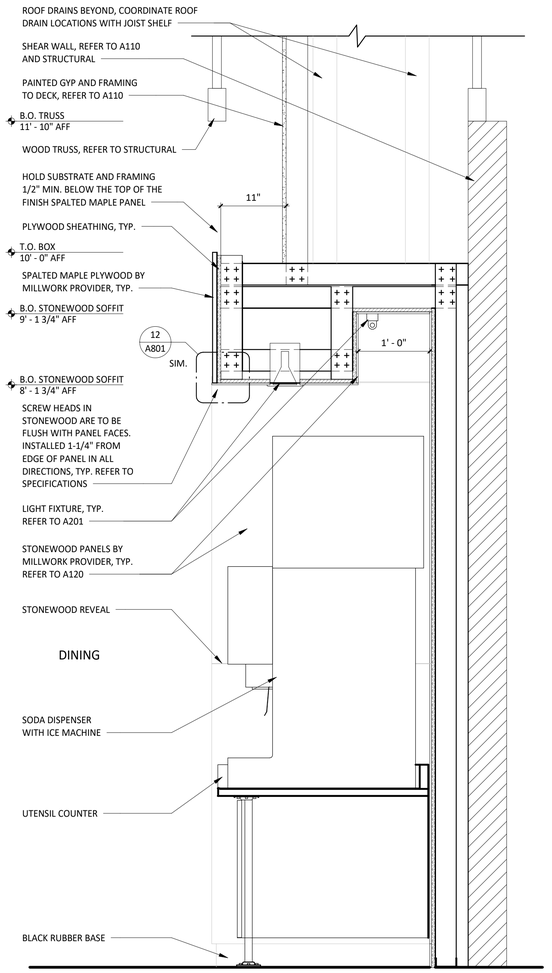

1 A502 **UTENSIL SECTION**
1" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

INTERIOR SECTIONS

A502

DOOR SCHEDULE


TAG	ROOM	DOOR STATUS *	FRAME STATUS	DOOR DESCRIPTION	DOOR WIDTH	DOOR HEIGHT	DOOR THICKNESS	DOOR TYPE	DOOR FINISH	FRAME TYPE	FRAME MATERIAL	STILE	HARDWARE SET	HARDWARE STATUS*	FIRE RATING	REMARKS
1A	MAIN ENTRY	NEW	NEW	DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	1	EXISTING		1,2,4,5
1B	MAIN ENTRY	NEW	NEW	DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	1	EXISTING		1,2,4,5
2A	DINING	NEW	EXISTING	SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	2A	EXISTING		1,3,4,5
2B	DINING	EXISTING	EXISTING	SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	2A	EXISTING		1,3,4,5
3	KITCHEN	NEW	EXISTING	HM REAR KITCHEN (STANDARD)	3' - 6"	7' - 0"	0' - 1 3/4"	D	D2 (SEE A120)	1	H.M.	-	3	EXISTING		1,4
4	OFFICE	NEW	NEW	MANAGER'S OFFICE	3' - 0"	7' - 0"	0' - 1 3/4"	C	D1 (SEE A120)	1	H.M.	-	4	NEW		
5	MEN	NEW	NEW	MENS RESTROOM (SINGLE-OCCUPANT, STANDARD)	3' - 0"	7' - 0"	0' - 1 3/4"	B	D3 (SEE A120)	1	H.M.	-	6	NEW		
6	WOMEN	NEW	NEW	WOMENS RESTROOM (SINGLE-OCCUPANT, STANDARD)	3' - 0"	7' - 0"	0' - 1 3/4"	B	D3 (SEE A120)	1	H.M.	-	5	NEW		
7	MAIN ENTRY	EXISTING	EXISTING	DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	1	EXISTING		1,2,4,5
8	MAIN ENTRY	EXISTING	EXISTING	DOUBLE STOREFRONT (WIDE STILE, WOOD PULL/PUSH)	6' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	1	EXISTING		1,2,4,5
11	DINING	EXISTING	EXISTING	SINGLE STOREFRONT (WIDE STILE, NON-OFFSET, PANIC)	3' - 0"	7' - 0"	0' - 1 3/4"	A	SEE A301	STOREFRONT	ALUM	WIDE (5")	2A	EXISTING		1,3,4,5
22		NEW		(none)	3' - 0"	1' - 0 19/32"										

REMARK NOTES


1. DOORS WITH REMARK #1 TO BE KEYED THE SAME
2. EXIT INDICATOR ARRIVES WITH SIGNS STATING "THIS DOOR TO REMAIN UNLOCKED DURING BUSINESS HOURS" AND "THIS DOOR TO REMAIN UNLOCKED WHEN THE BUILDING IS OCCUPIED". VERIFY REQUIRED SIGN WORDING WITH LOCAL JURISDICTION PRIOR TO INSTALLATION. ONE SIGN IS TO BE PLACED IN A VISIBLE LOCATION ABOVE THE DOORS.
3. THERE IS TO BE NO EXTERIOR HOLE OR CYLINDER
4. USE NON-SHRINK STRUCTURAL GROUT BED UNDER THRESHOLD
5. BLACK DOOR SWEEP TO BE USED WITH CHARCOAL, BLACK, OR BRONZE STOREFRONT. LIGHT GRAY DOOR SWEEP TO BE USED WITH CLEAR ANODIZED ALUMINUM STOREFRONT

* IF STATUS IS "EXISTING" G.C TO DETERMINE CONDITION OF EXISTING HADWARE. IF HARDWARE IS IN POOR CONDITION, PROVIDE HARDWARE IN HARDWARE SCHEDULE. CONFIRM REPLACEMENT WITH CHIPOTLE CM.

TYPICAL EXTERIOR DOOR TYPES

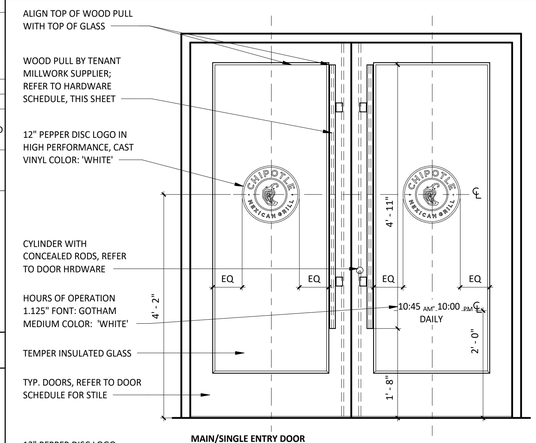

MAIN/SINGLE ENTRY DOOR

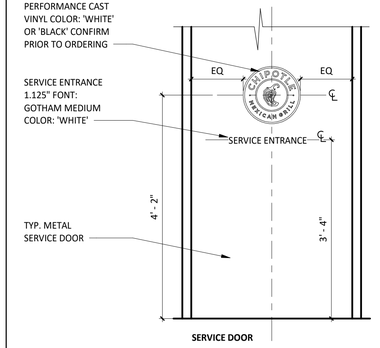

SERVICE DOOR

HARDWARE SETS

SET 1 - MAIN ENTRY - PAIR - WOOD PULL/PUSH

(2)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(2)	MORTISE CYLINDER	SCHLAGE, MODEL 80-103, BRUSHED CHROME; C.O. CYLINDER AT 34" MIN. FROM BOTTOM OF DOOR
(2)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE, (BRUSHED CHROME)
(2)	PUSH HARDWARE	1 1/2" DIAMETER WOOD PUSH, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS
(2)	PULL HARDWARE	1 1/2" DIAMETER WOOD PULL, VARIES HIGH - PROVIDED BY MILLWORK SUPPLIER. MOUNT TOP OF PULLS FLUSH WITH TOP OF GLAZING STOP IN DOOR, RE: SHOP DRAWINGS
(1)	DEADBOLT	ADAMS RITE, MODEL MS1850S-310-628
(1)	EXIT INDICATOR	ADAMS RITE, MODEL 4089-00-130
(1)	HEADER BOLT	ADAMS RITE, MODEL 4016-30-01
(1)	THRESHOLD BOLT	ADAMS RITE, MODEL 4015-18-1B
(2)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), (ALUMINUM)
(2)	DOOR STOP	IVES, MODEL FS18S (ALUMINUM)
(2)	OVERHEAD STOP	GLYNN-JOHNSON, MODEL 454S-SP28 (ALUMINUM)
(2)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	THRESHOLD	REESE, MODEL S239A-72 (SIZE 72")
(2)	SMOKE SEAL	REESE, MODEL 797B-21
(2)	DOOR SWEEP	PEMKO, MODEL SFSC-200-36 (36" DOOR),OWNER FURNISHED

SET 2A - ENTRY - SINGLE - NON-OFFSET - PANIC HARDWARE

(1)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(1)	PUSH HARDWARE	ADAMS RITE, MODEL 8801-36-628 (ALUMINUM FINISH, 36" DOOR); C.O. EXIT DEVICE AT 38" FROM BOTTOM OF DOOR
(1)	PULL HARDWARE	HAGER, MODEL 4G US32D (8" CTC), CENTER ON DOOR STILE
(1)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), (ALUMINUM)
(1)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	OVERHEAD STOP	GLYNN-JOHNSON, MODEL 454S-US32D (ALUMINUM)
(1)	THRESHOLD	REESE, MODEL S424A-36 (SIZE 36")
(1)	SMOKE SEAL	REESE, MODEL 797B-21
(1)	DOOR SWEEP	PEMKO, MODEL SFSC-200-36 (36" DOOR), OWNER FURNISHED
(1)	DOOR STOP	IVES, MODEL FS18S (ALUMINUM)

SET 3 - REAR EXIT - SINGLE

(1)	HINGE	HAGER, MODEL 780-224HD-83"-CLR
(1)	PUSH HARDWARE	FALCON, MODEL 25-R-EO-4'-US28 (SIZE 42")
(1)	PULL HARDWARE	FALCON, MODEL 510L-DANE-LHR-US26D, ALUMINUM (EXTERIOR SIDE)
(1)	RIM CYLINDER	GLS, MODEL RCIC-7-LZ-626
(1)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME)
(1)	CLOSER	DORMA, MODEL 8916-AF89P-689 (TOP JAMB), ALUMINUM
(1)	CLOSER BACK PLATE	DORMA, MODEL BP89, ALUMINUM
(1)	THRESHOLD	REESE, MODEL S239A-42, (SIZE 42")
(1)	WEATHERSTRIP	REESE, MODEL DS75C-4070
(1)	DOOR SWEEP	PEMKO, MODEL SFSC-200-42 (42" DOOR) (BLACK) OWNER FURNISHED
(1)	DOOR VIEWER	IVES, MODEL U698B26D, C.O. VIEWER AT 60" FROM BOTTOM OF DOOR
(1)	EXIT ALARM	TRINE, MODEL 206-3
(1)	DOOR SILENCERS	IVES, MODEL SR64
(1)	DOOR BUZZER	TRINE, MODEL 240
(1)	KICKPLATE	HIAWATHA, MODEL KP834-US32D

SET 4 - MANAGER'S OFFICE

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	LOCKSET	SCHLAGE, MODEL L9453L-06A-626
(1)	TEMP CORE	SCHLAGE, MODEL 80-035 INTERCHANGEABLE CORE (FINISH: BRUSHED CHROME)
(1)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	DOOR STOP	DON-JO, MODEL 1407-630, STAINLESS STEEL
(3)	DOOR SILENCERS	IVES, MODEL SR64
(1)	SECURITY WINDOW	AIR LOUVERS, MODEL VSL1212TEMPPAK SLIMLINE 12" X 12" X 1/4" LITE KIT (10" X 10" GLASS VISIBLE)

SET 5 - UNISEX 2 RESTROOM - SINGLE OCCUPANT - STANDARD

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	CLOSER	FALCON, MODEL: SC61xRW/PAxALU
(1)	LOCKSET	SCHLAGE, MODEL AL40S-NEP-626
(1)	DOOR STOP	DON-JO, 1407-630
(3)	DOOR SILENCERS	IVES, MODEL SR64
(2)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	COAT HOOK	MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF


SET 6 - UNISEX 1 RESTROOM - SINGLE OCCUPANT - STANDARD

(3)	HINGE	STANLEY, MODEL FBB179-4.5-US26 (06-8438)
(1)	CLOSER	FALCON, MODEL: SC61xRW/PAxALU
(1)	LOCKSET	SCHLAGE, MODEL AL40S-NEP-626
(1)	DOOR STOP	DON-JO, 1407-630
(3)	DOOR SILENCERS	IVES, MODEL SR64
(2)	KICKPLATE	HIAWATHA, MODEL KP834-32D
(1)	COAT HOOK	MILLS, MODEL FT6519, SUPPLIED BY WASHROOM ACCESSORIES VENDOR, MOUNT T.O. HOOK AT 47 1/2" AFF

DOOR NOTES

1. ALL EGRESS DOORS SHALL BE READILY OPENABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT.
2. LATCHES, HANDLES, PANIC BARS AND ALL DOOR HARDWARE WILL COMPLY WITH SECTION 7.2 OF NFPA 101 PER THE SPECIFICATIONS.
3. THE MANAGER HAS A KEY TO UNLOCK RESTROOM DOORS, FROM THE OUTSIDE IN CASE OF AN EMERGENCY.
4. ALL DOORS TO REMAIN UNLOCKED DURING BUSINESS HOURS.
5. SEE THIS SHEET FOR EXTERIOR DOOR SIGNAGE INFO.
6. MAXIMUM EFFORT TO OPERATE EXTERIOR OR INTERIOR DOORS WITH CLOSERS SHALL NOT EXCEED 5 POUNDS. THIS MAY BE INCREASED TO 15 POUNDS FOR FIRE-RATED DOORS.
7. ALL FRAMES, DOORS AND HARDWARE TO BE FURNISHED BY TENANT HARDWARE SUPPLIER AND INSTALLED BY TENANT G.C. CALL PETE KLIMEK WITH TWIN CITY HARDWARE AT 763-535-4660 TO ARRANGE DELIVERY. STOREFRONT DOORS ARE TO BE PROVIDED BY GC, STOREFRONT HARDWARE PROVIDED BY TENANT HARDWARE SUPPLIER.
8. THE BOTTOM 10 INCHES OF ALL DOORS SHALL HAVE A SMOOTH, UNINTERRUPTED SURFACE TO ALLOW THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.
9. ALL SUPPORT SIGNAGE INSTALLED BY G.C.
10. ALL SUPPORT SIGNAGE PROVIDED BY TENANT'S SUPPORT SIGNAGE SUPPLIER.
11. ALL HARDWARE SHALL MATCH STOREFRONT, VERIFY WITH ARCHITECT AND/OR CHIPOTLE CONSTRUCTION MANAGER PRIOR TO ORDERING.


DOOR FRAMES




1

NOTE: GC TO VERIFY THE WALL THICKNESS PRIOR TO ORDERING DOOR FRAMES.


CUSTOM WOOD PULL

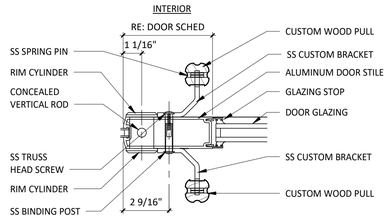

DOOR TYPES

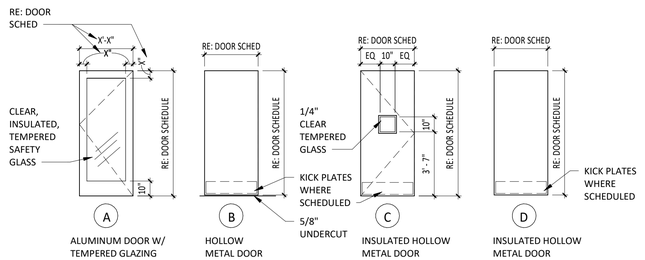

DOOR CLOSER

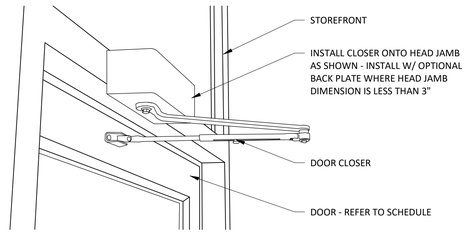

TOP JAMB MOUNT INSTALLATION. (NOTE THAT BACKPLATE IS MISSING IN THIS INSTALLATION BECAUSE HEAD JAMB IS OF ADEQUATE HEIGHT TO RECEIVE ALL MOUNTING SCREWS WITHOUT IT.) WHEN IN DOUBT ABOUT THE HEAD JAMB DIMENSION OR STABILITY, ORDER THE BACKPLATE.

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.


20210067.0

Contents:


DOOR & HARDWARE SCHEDULE

A601


STOREFRONT DETAILS

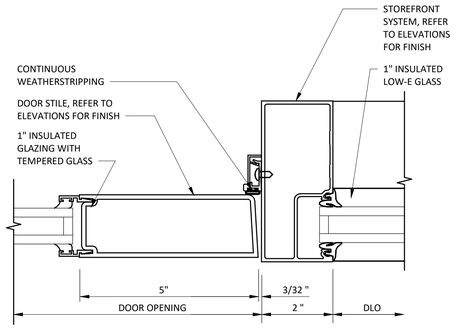


8 A602 **STOREFRONT DOOR JAMB DETAIL**
6" = 1'-0"

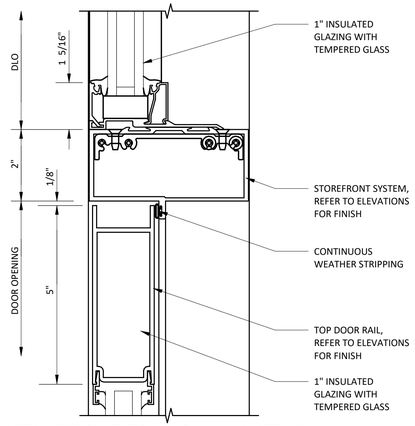


9 A602 **STOREFRONT TRANSOM BAR DETAIL**
6" = 1'-0"

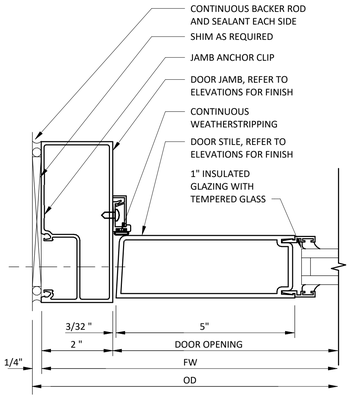


6 A602 **STOREFRONT DOOR JAMB DETAIL**
6" = 1'-0"

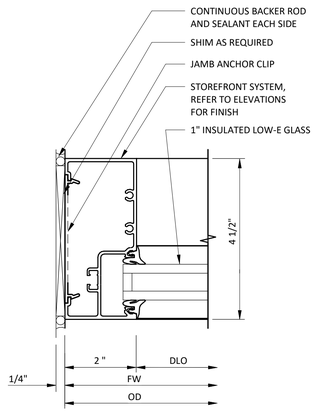


5 A602 **STOREFRONT JAMB DETAIL**
6" = 1'-0"

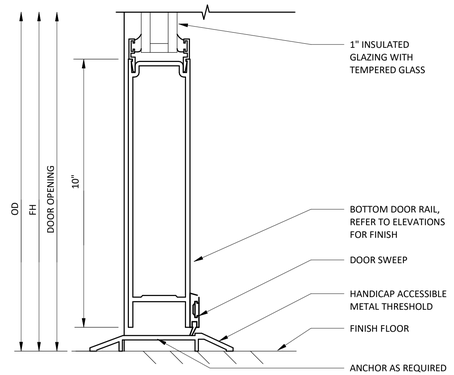


7 A602 **STOREFRONT THRESHOLD DETAIL**
6" = 1'-0"

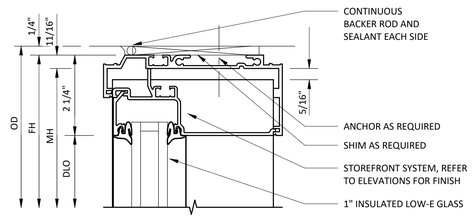

4 A602 **STOREFRONT HEAD DETAIL**
6" = 1'-0"

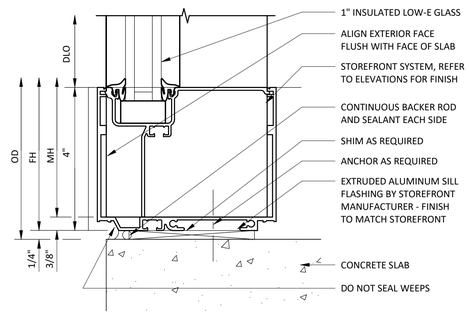

1 A602 **STOREFRONT SILL DETAIL**
6" = 1'-0"

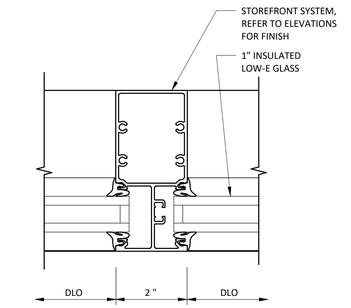


3 A602 **STOREFRONT MULLION DETAIL**
6" = 1'-0"


2 A602 **STOREFRONT TRANSOM BAR DETAIL**
6" = 1'-0"


GENERAL NOTES


1. ALL WINDOW AND DOOR GLAZING IS TO BE CLEAR / INSULATED UNLESS NOTED OTHERWISE.
2. WINDOW AND DOOR GLAZING TO BE TEMPERED AT LOCATIONS INDICATED WITH "*".
3. NEW STOREFRONT FRAMING SYSTEM TO BE SUPPLIED BY G.C. G.C. TO VERIFY FRAMING OPENING SIZES AND MATERIALS WITH ARCHITECT AND/OR CHIPOTLE CONSTRUCTION MANAGER PRIOR TO FABRICATION.
4. STOREFRONT GLAZING DESIGN IS BASED ON KAWNEER PREFINISHED ALUMINUM STOREFRONT WITH 1" INSULATED GLAZING, REFER TO SPECIFICATIONS.
5. STOREFRONT SYSTEM IS 2" x 6" NOMINAL DIMENSION; CENTER SET, U.N.O.
6. PUNCHED WINDOW SYSTEM IS 2" X 4 1/2" NOMINAL DIMENSION; FRONT SET, U.N.O.

WINDOW FRAME TYPES

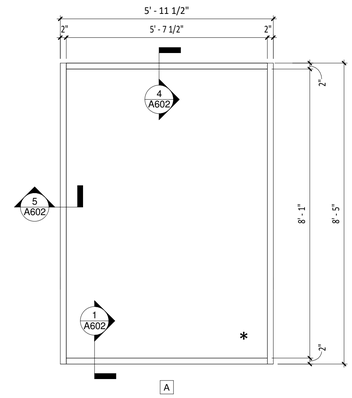

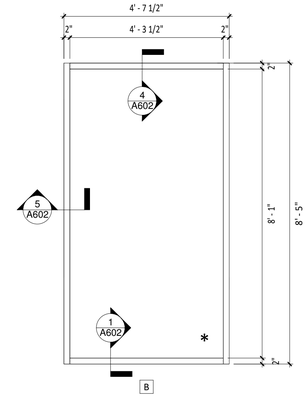

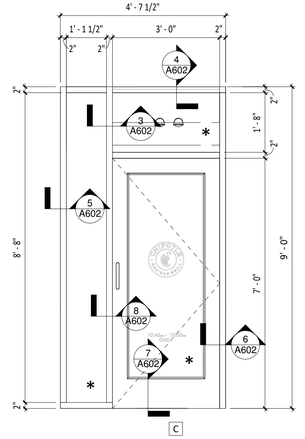

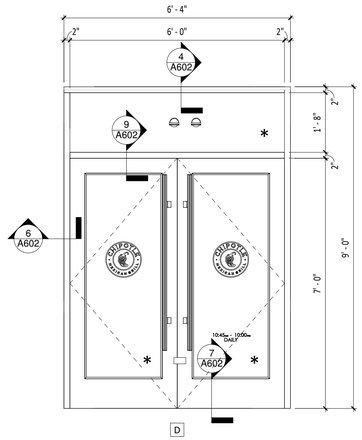

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.

20210067.0

Contents:

STOREFRONT DETAILS


A602

ELEVATION LEGEND


DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

GENERAL NOTES


1. REFER TO SHEET A131 AND A321 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2. REFER TO A120 FOR FINISH SCHEDULE.
3. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

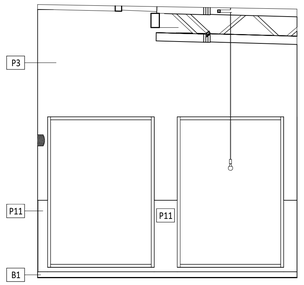


10 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

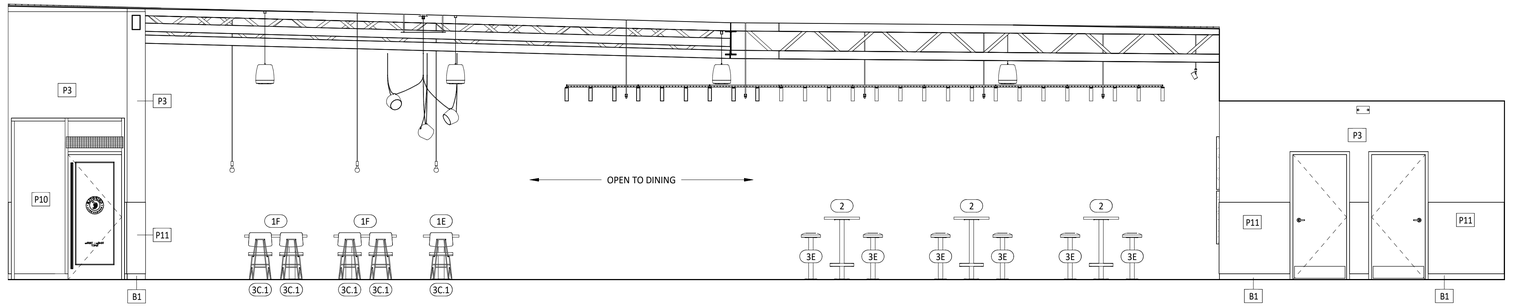


9 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

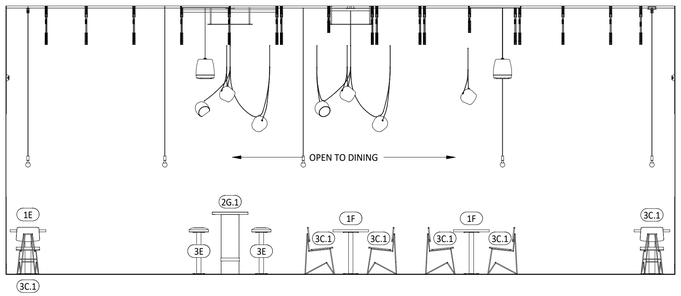


8 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

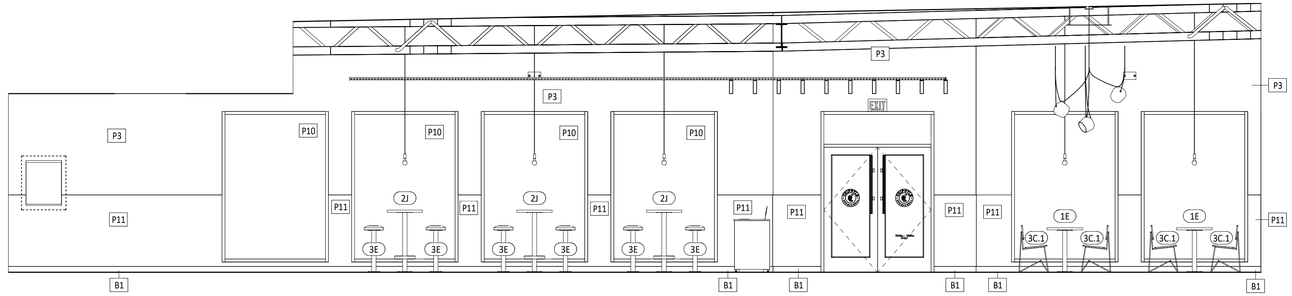


7 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

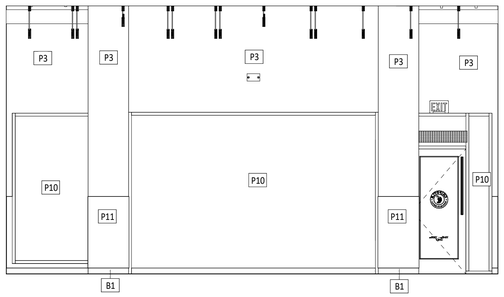


6 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

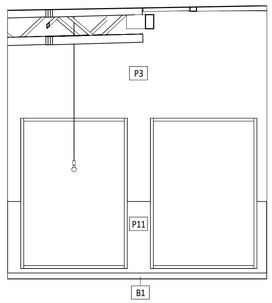


5 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

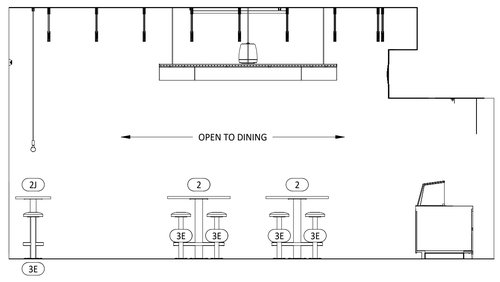


4 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

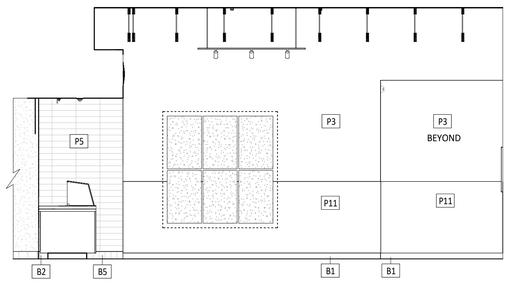

3 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

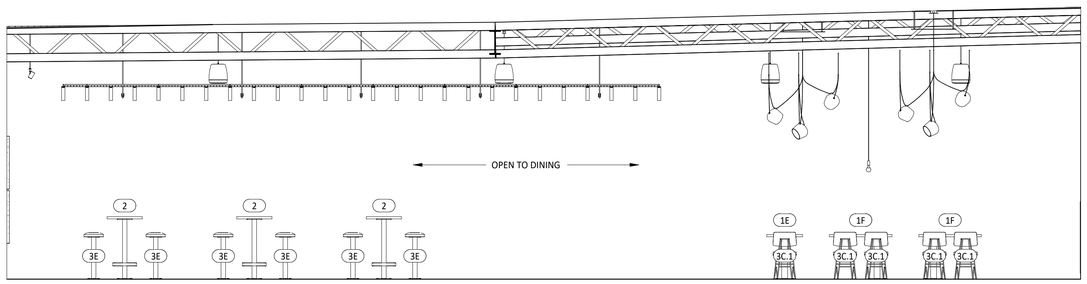

2 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

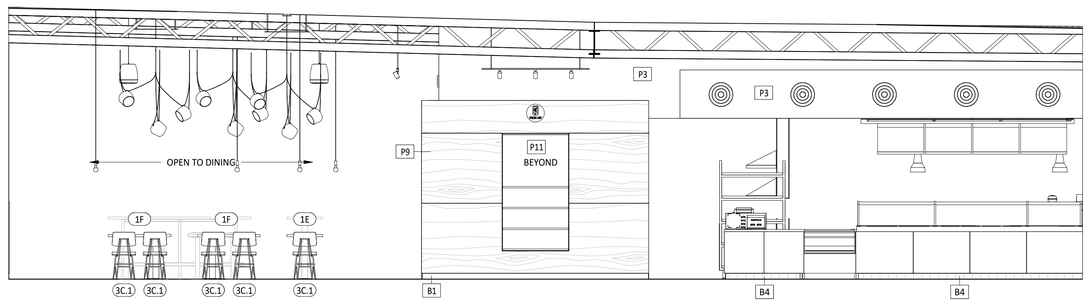

1 A701A **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ELEVATIONS - INTERIOR DINING


A701A

ELEVATION LEGEND


DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

GENERAL NOTES


1. REFER TO SHEET A131 AND A321 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2. REFER TO A120 FOR FINISH SCHEDULE.
3. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

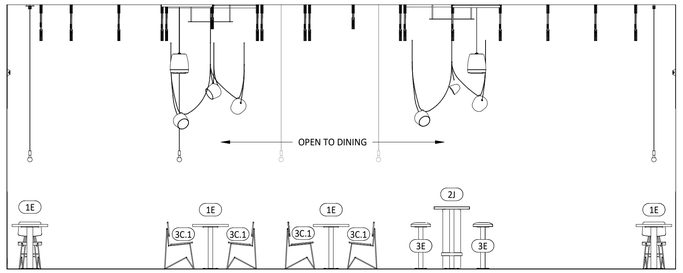


4 A701B **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

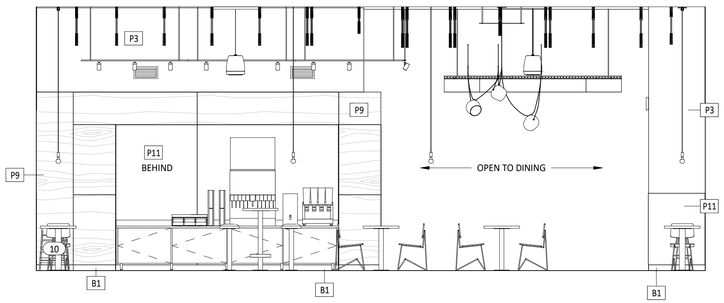

3 A701B **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

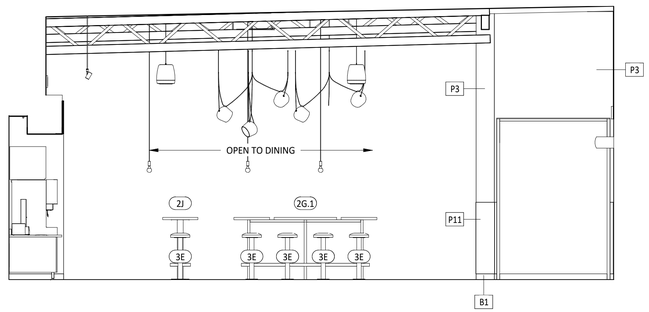

2 A701B **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

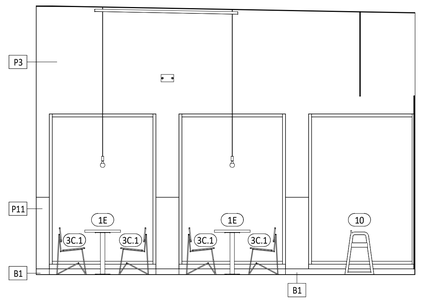

1 A701B **INTERIOR DINING ELEVATION**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
1	02/02/2024	Revision 1
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ELEVATIONS - INTERIOR DINING


A701B

ELEVATION LEGEND


DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

GENERAL NOTES

1. REFER TO SHEET A131 FOR EQUIPMENT LIST AND FURNITURE SCHEDULE.
2. PROVIDE FULL HEIGHT BLOCKING IN WALL FOR ALL SHELVING, TYP.
3. REFER TO A120 FOR FINISH SCHEDULE.
4. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

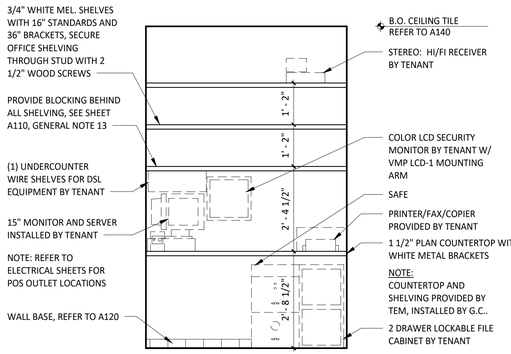


17 A702 **TYP ELEV - OFFICE SHELVING**
1/2" = 1'-0"

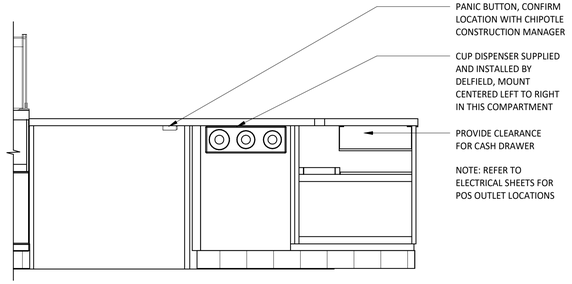


16 A702 **TYP. ELEV - POS**
3/4" = 1'-0"


*THIS DETAIL IS FOR HANDSINK ACCESSORY DIMENSIONS ONLY. FOR ACTUAL ORIENTATION OF HAND SINK AND ACCESSORIES, REFER TO KITCHEN ELEVATIONS

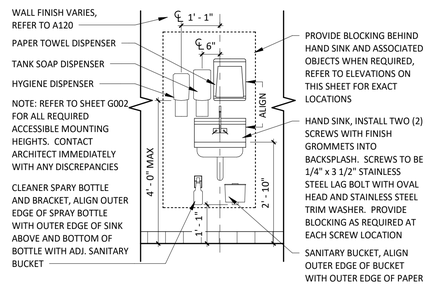


15 A702 **TYP ELEV - HAND SINK**
1/2" = 1'-0"




14 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

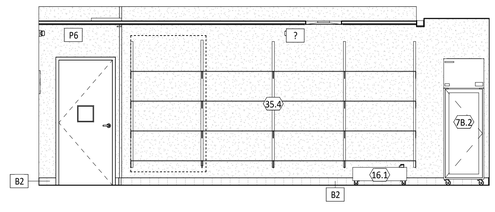


13 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"




12 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

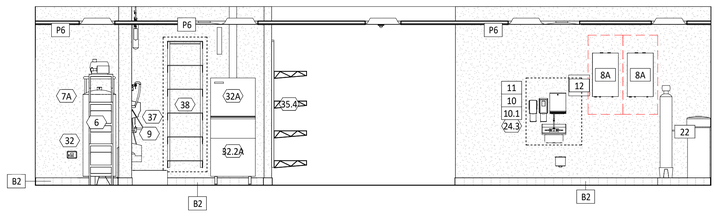


11 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

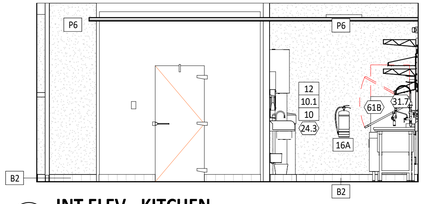

10 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

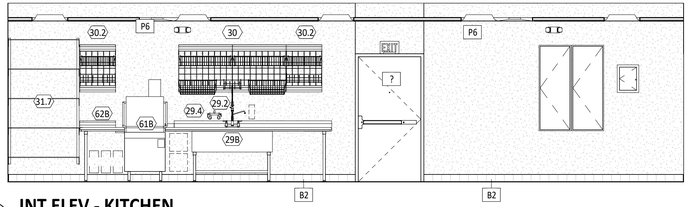


9 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

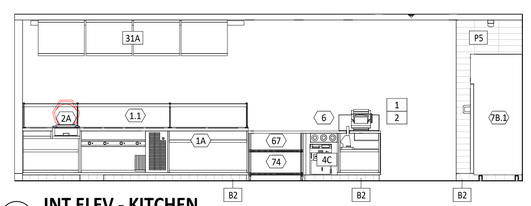


8 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"




7 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

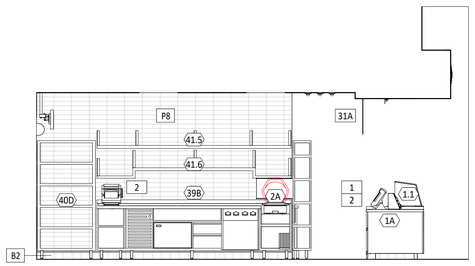


6 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

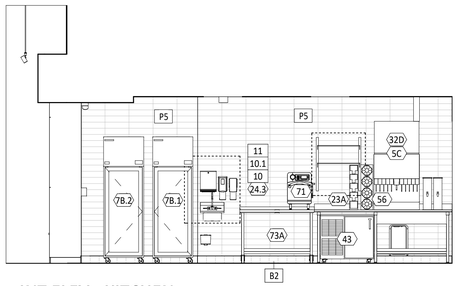


5 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

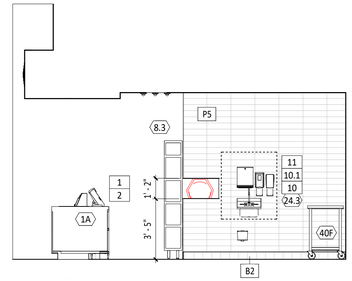


4 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

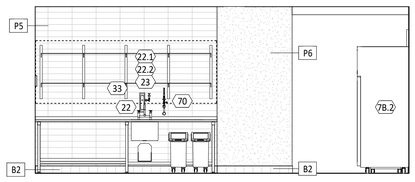

3 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

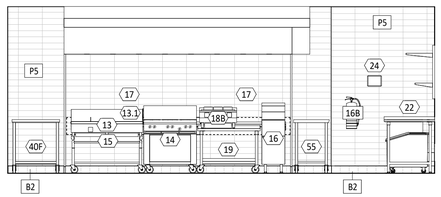

2 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

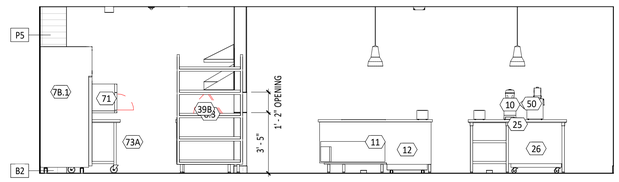

1 A702 **INT ELEV - KITCHEN**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ, 08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

ELEVATIONS - INTERIOR KITCHEN

A702

RESTROOM ACCESSORY SCHEDULE


ITEM #	DESCRIPTION	MANUF	MODEL	QTY	PROVIDED BY	INSTALLED BY	UTILITY				MOUNTING HEIGHT	REMARKS
							ELEC	GAS	WATER	SEWER		
1A	Grab Bar - 36in	ASI	3501-36	2	WA	GC					36" AFF to Top of Grasping Surface	Provide Plywood Blocking to Mount to Wall
1C	Grab Bar - 18in	ASI	3501-18	2	WA	GC					40" AFF to Centerline of Bottom Return	Provide Plywood Blocking to Mount to Wall
1D	Grab Bar - 48in	ASI	3501-48	2	WA	GC					36" AFF to Top of Grasping Surface	Provide Plywood Blocking to Mount to Wall
3	Mirror	ASI	0600B 18x36	2	WA	GC					Bottom Edge of Reflecting Surface at 40" AFF	Provide Plywood Blocking to Mount to Wall
5	Touch-Free Soap Dispenser	Purell	CS8	2	WA	GC					47 1/2" AFF to Top of Unit	
7	Recessed Toilet Paper Dispenser	ASI	0031	2	WA	GC					29" AFF to Top of Unit	Recess Mounted in Wall - Rough Opening: 6 1/4"W X 12 1/4"H X 3 3/8"D Top of Rough Opening: 29 1/4" AFF
8	Utility Shelf	ASI	0692	2	WA	GC					46" AFF To Top Of Shelf	Provide Toggle Bolts to Mount to Wall
9	Recessed Convertible Paper Towel Dispenser and Waste Receptacle, Recess Mounted in Wall	Bobrick	B-3944	2	WA	GC					Bottom of Unit at Top of Base, Bottom of Dispenser to be at 40" AFF, Recess Mounting In Wall	Rough Opening: 16"W x 54 3/4"H x 4" D. Provide Plywood Blocking to Mount to Wall
12	Napkin Disposal - Recessed	ASI	0473	2	WA	GC					Top of Rough Opening @ 29" AFF	Recess Mounted in Wall - Rough Opening: 11 1/4"W X 15 3/4"H X 4"D
14	Restroom Hand Sink	Kohler	K-2084	2	GC	GC				•	Mount Bottom of Front Edge Of The Sink At Exactly 29" AFF	
14.1	Restroom Hand Sink Faucet	T&S	EC-3102-TMV-LF-05	2	KES	GC			•			To Be Furnished With .5 GPM Aerator Installed. Thermostatic mixing valve is also included.
15	Hand Sanitizer Dispenser	Purell	ES8	2	WA	GC					Align T.O. Unit With T.O. Soap Dispenser	
16a	Surface Mounted Horizontal Baby Changing Station	Koala Care	KB200-05	2	WA	GC					Mount Bottom of Open Changing Bed at Exactly 27" AFF	GC to Provide adequate blocking to support the baby changing equipment. Blocking shall be installed in such a manner to not damage or compromise the rated assembly of the existing wall construction

GENERAL NOTES


1. ALL DIMENSIONS ARE TO FACE OF WALL FINISH UNLESS OTHERWISE NOTED.
2. REFER TO A802 FOR TILE NOTES.
3. ALL ACCESSORIES SHALL BE AS MANUFACTURED BY AMERICAN SPECIALTIES INC OR TENANT APPROVED EQUIVALENT UNLESS DESIGNATED OTHERWISE. PROVIDE SOLID FRT WOOD BLOCKING AS NECESSARY FOR INSTALLATION PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET G002 FOR ACCESSIBILITY GUIDELINES & MOUNTING HEIGHT REQUIREMENTS.
4. REFER TO A120 FOR FINISH SCHEDULE.
5. REFER TO A201 AND ELECTRICAL DRAWINGS FOR LIGHT FIXTURE SCHEDULE.

ELEVATION LEGEND

DENOTES WOOD BLOCKING IN WALL BEHIND WALL MOUNTED OBJECT U.N.O.

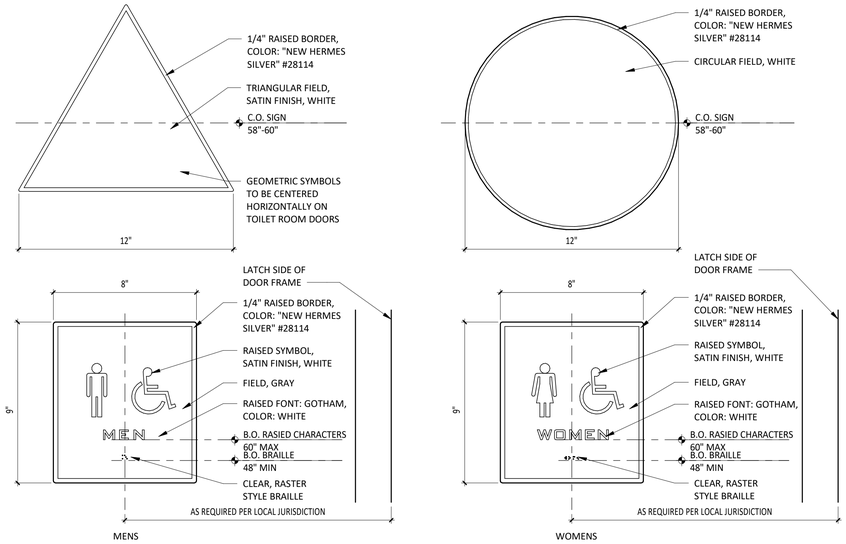


10 A710 **TYPICAL WASHROOM SIGNAGE**
3" = 1'-0"

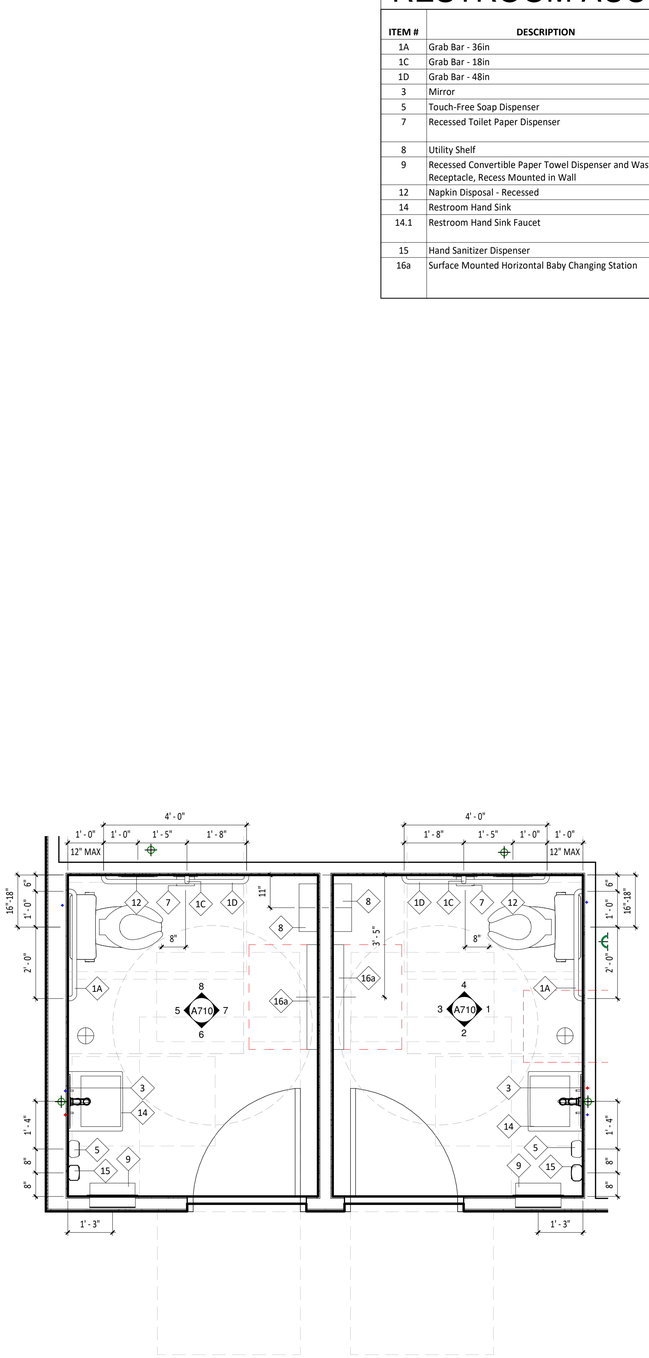


NOTE: ALL DIMENSIONS TO FACE OF FINISH, U.N.O.


9 A710 **ENLARGED PLAN**
1/2" = 1'-0"




8 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"




7 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"




6 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"




5 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"




4 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"



3 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"



2 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"



1 A710 **RESTROOM ELEVATION**
1/4" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AI01713000

Drawn: DR
Checked: JB


Project No.
20210067.0

Contents:


RESTROOM DETAILS

A710


NOTE: ALL CONCEALED WOOD TO BE FRT RATED




20 A801 **PLAN - RR FRP INSIDE CORNER**
6" = 1'-0"

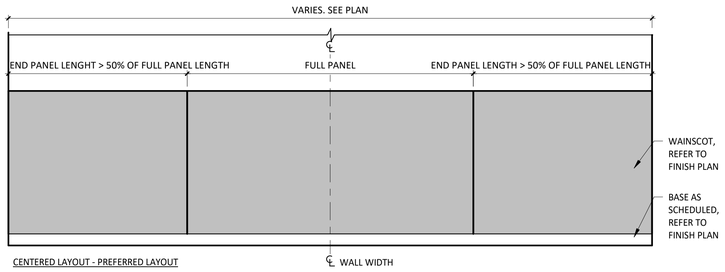


16 A801 **WAINSCOT LAYOUT**
1/2" = 1'-0"

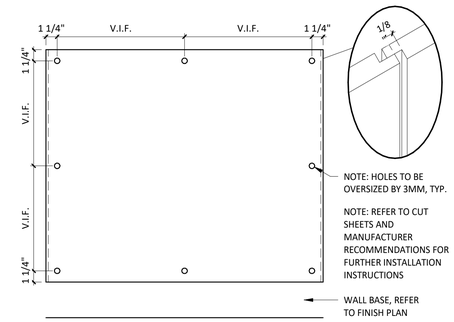

19 A801 **WAINSCOT DETAILS**
1 1/2" = 1'-0"

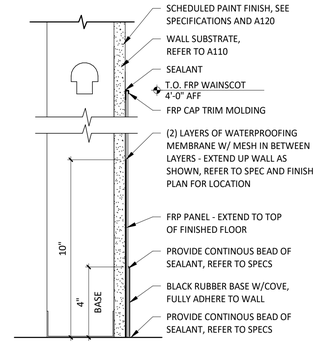


18 A801 **SECTION @ RR FRP WAINSCOT W/RUBBER BASE**
3" = 1'-0"

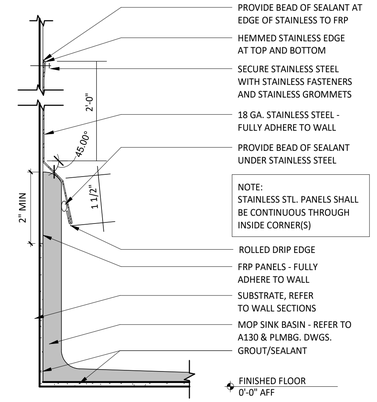


17 A801 **SECTION @ MOP SINK**
6" = 1'-0"


15 A801 **NOT USED**
N.T.S.

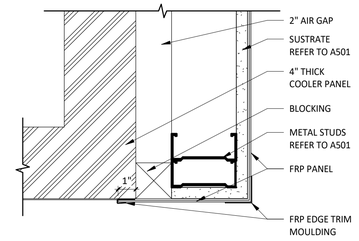


14 A801 **PLAN - FRP CLOSER @ COOLER**
3" = 1'-0"



13 A801 **PLAN - WOOD TO WOOD CORNER**
3" = 1'-0"

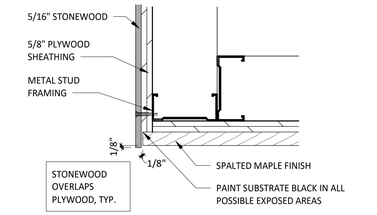


12 A801 **PLAN - WOOD TO STONEWOOD CORNER**
3" = 1'-0"




11 A801 **PLAN - STONEWOOD TO TILE CORNER**
3" = 1'-0"


10 A801 **NOT USED**
N.T.S.

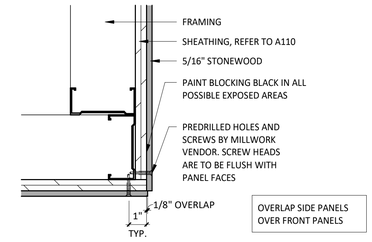


9 A801 **PLAN - STONEWOOD CORNER @ WAINSCOT**
3" = 1'-0"

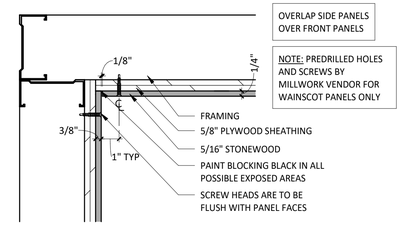


8 A801 **PLAN - STONEWOOD INSIDE CORNER**
3" = 1'-0"

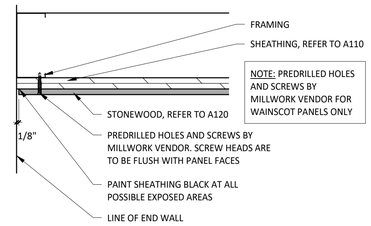


7 A801 **PLAN - STONEWOOD END CONDITION**
3" = 1'-0"

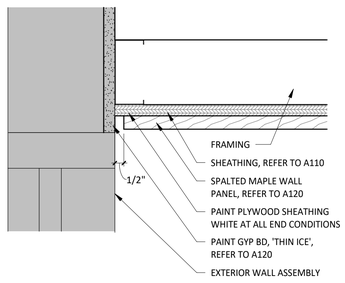


6 A801 **PLAN - WOOD END CONDITION**
3" = 1'-0"

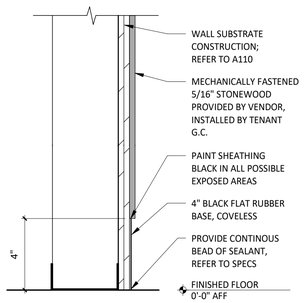


5 A801 **SECTION @ STONEWOOD**
3" = 1'-0"

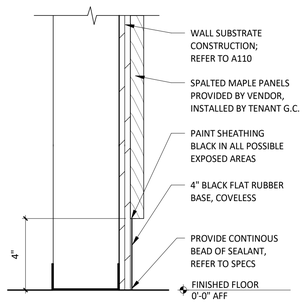

4 A801 **SECTION @ SPALTED MAPLE**
3" = 1'-0"

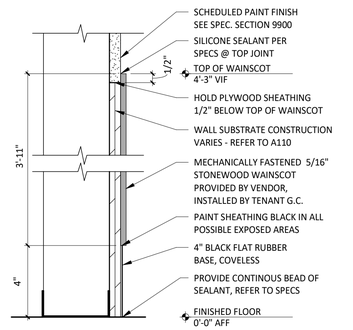

3 A801 **SECTION @ WAINSCOT**
3" = 1'-0"

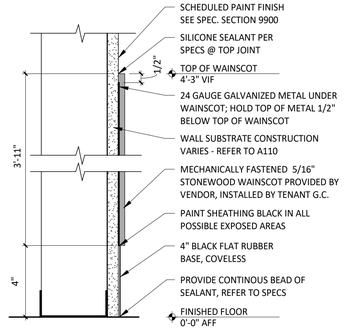

2 A801 **SECTION @ WAINSCOT**
3" = 1'-0"

1 A801 **NOT USED**
3" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	08/26/2021	ICP SET
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.

20210067.0


Contents:

FINISH DETAILS


A801

GENERAL NOTES


1.	TILE INSTALLER SHALL COORDINATE WITH GENERAL CONTRACTOR AND PROVIDE LAYOUT OF ALL WALL TILE PRIOR TO INSTALLATION. GENERAL CONTRACTOR SHALL PREPARE WALLS AS TO NOT HAVE ANY CUT TILES IN EITHER DIRECTION (HORIZONTALLY OR VERTICALLY) ON ANY WALLS. LAYOUT SHALL BE APPROVED BY CHIPOTLE CM PRIOR TO INSTALLATION. CONTRACTOR SHALL CONTACT ARCHITECT OF ANY DISCREPANCIES IN DIMENSIONS FOR DIRECTION PRIOR TO INSTALLATION. FAILURE TO ADHERE TO THESE REQUIREMENTS RESULTING IN ANY REMEDIATION REQUIRED TO MEET DESIGN INTENT WILL BE AT CONTRACTOR'S COST.
2.	IF REQUIRED TO CUT TILES, CONTRACTOR TO MEASURE OVERALL WALL WIDTH AND DETERMINE WHICH SOLUTION WILL ALLOW FOR THE GREATER THAN 25% TILE WIDTH AT WALL TERMINATIONS.
3.	UNLESS OTHERWISE NOTED, ALL WALL TILES SHOULD BE CENTERED ON THE WIDTH OF THE WALL PER DETAIL 1 OR 2.
4.	THERE SHOULD NEVER BE ANY CUT TILES VERTICALLY BETWEEN THE BASE AND THE CEILING. REFER TO A120 AND A201.

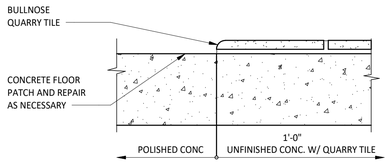


23 A802 **FLOOR TRANSITION @ READY TO DRINK**
3" = 1'-0"

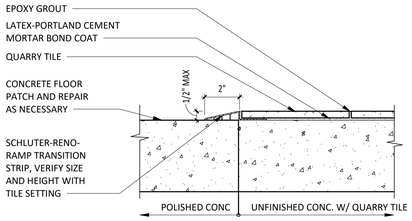


22 A802 **FLOOR TRANSITION W/ RAMP**
3" = 1'-0"

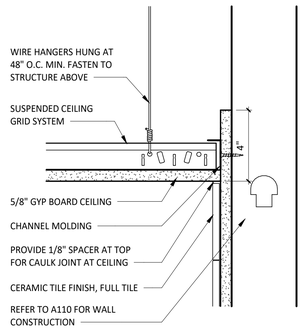


21 A802 **TILE DETAIL @ GYP BD CEILING**
3" = 1'-0"

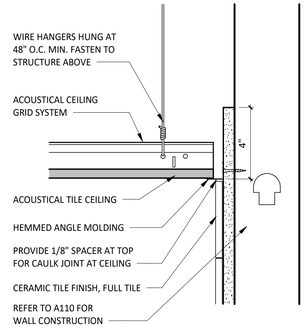


20 A802 **TILE DETAIL @ SUSPENDED CEILING**
3" = 1'-0"

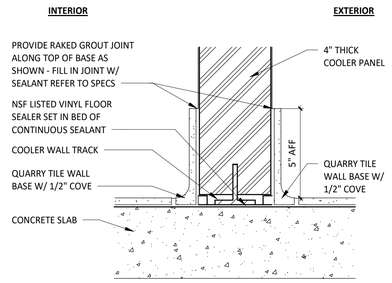


19 A802 **COOLER WALL @ QT**
3" = 1'-0"

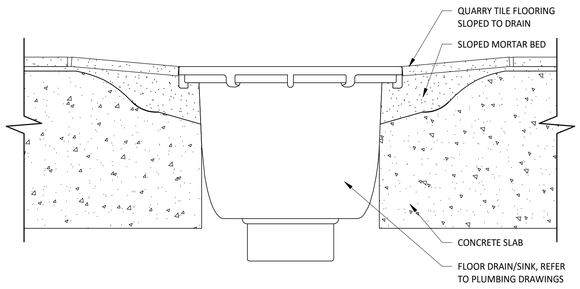


18 A802 **TYPICAL QT FLOOR DRAIN/SINK DETAIL**
3" = 1'-0"

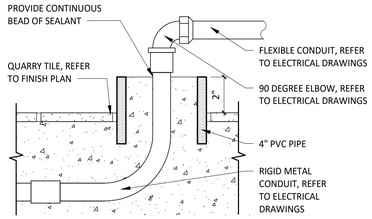


17 A802 **STUB SECTION DETAIL UNDER TABLES**
3" = 1'-0"

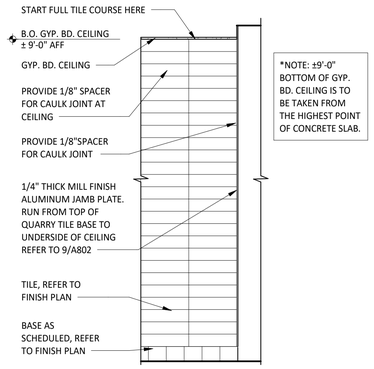


16 A802 **KITCHEN WALL ENDCAP TILE LAYOUT**
1/2" = 1'-0"

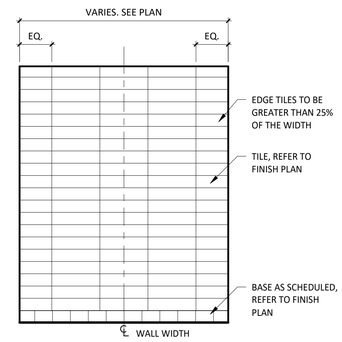


15 A802 **TILE CENTERED LAYOUT**
1/2" = 1'-0"

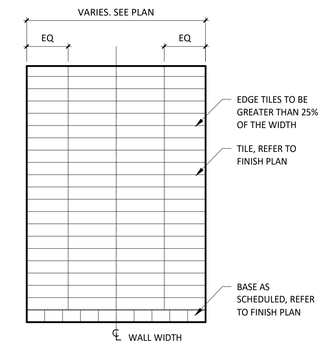


14 A802 **JOINT CENTERED LAYOUT**
1/2" = 1'-0"

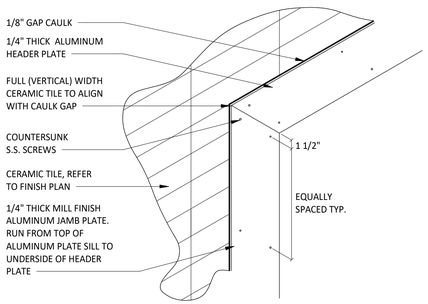


13 A802 **TILE DETAIL @ ALUMINUM PLATE HEADER**
1" = 1'-0"




12 A802 **ALUMINUM PLATE @ JAMB/HEAD/SILL**
3" = 1'-0"



11 A802 **TILE TO TILE OUTSIDE CORNER**
6" = 1'-0"




10 A802 **TILE TO FRP OUTSIDE CORNER**
6" = 1'-0"




9 A802 **TILE TO TILE INSIDE CORNER**
6" = 1'-0"


8 A802 **NOT USED**
3" = 1'-0"

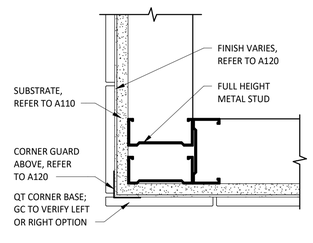


7 A802 **QT BASE - OUTSIDE CORNER (KITCHEN)**
3" = 1'-0"




6 A802 **QT BASE - ENDCAP**
3" = 1'-0"

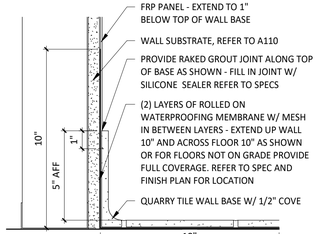


5 A802 **QT BASE @ FRP**
3" = 1'-0"



4 A802 **QT BASE @ CERAMIC TILE**
3" = 1'-0"



3 A802 **CERAMIC TILE BASE**
3" = 1'-0"

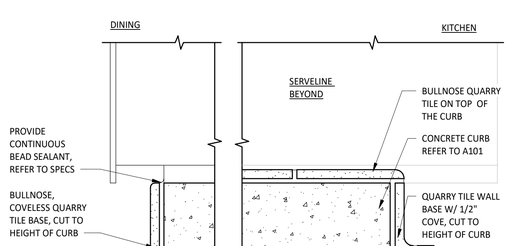

2 A802 **QT @ CURB**
3" = 1'-0"

1 A802 **QT @ CURB**
3" = 1'-0"

Consultant:

GF

www.greenbergfarrow.com

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
HAMILTON NJ
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ,
08691

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/2023	LANDLORD SET
	07/14/2023	PERMIT SET
2	02/16/2024	BID SET
3	03/25/2024	CONSTRUCTION SET

Architect

Robert James Warshefski Jr.
License No. 21AIO1713000

Drawn: DR
Checked: JB

Project No.
20210067.0

Contents:

TILE DETAILS

A802

GENERAL:

A. THE FOLLOWING NOTES ARE APPLICABLE TO ALL DRAWINGS IN ADDITION TO THE PROJECT SPECIFICATIONS. THE GENERAL NOTES TAKE PRECEDENCE OVER THE SPECIFICATIONS.
B. APPLICABLE STRUCTURAL CODE - THE 2021 INTERNATIONAL BUILDING CODE, NEW JERSEY EDITION.
C. THE CONTRACTOR SHALL USE MATERIALS AND EMPLOY CONSTRUCTION METHODS IN ORDER TO COMPLY WITH THE DRAWINGS AND SPECIFICATIONS. WHERE A CONFLICT OCCURS, THE STRICTEST DESIGN SHALL GOVERN. ENGINEER'S REVIEW OF SHOP DRAWINGS, PRODUCT DATA, ETC. DOES NOT RELIEVE THE CONTRACTOR FROM MEETING ALL REQUIREMENTS OF THE CONTRACT DOCUMENTS. THE CONTRACTOR SHALL INFORM THE ENGINEER IN WRITING OF ANY SPECIFIC DEVIATIONS AND OBTAIN ENGINEER'S WRITTEN APPROVAL FOR THE SPECIFIC DEVIATION.
D. THE CONTRACTOR SHALL PROVIDE HIS/HER SCHEDULE FOR SUBMITTAL OF SHOP AND ERECTION DRAWINGS UPON COMMENCEMENT OF THE PROJECT SO AS TO FACILITATE THE TIMELY FLOW OF INFORMATION BETWEEN ALL PARTIES.
E. THE STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH CIVIL, ARCHITECTURAL, MECHANICAL, FIRE SPRINKLER, AND ELECTRICAL DRAWINGS. THE CONTRACTOR IS RESPONSIBLE FOR COORDINATION OF ALL REQUIREMENTS INTO THE SHOP DRAWINGS AND CONSTRUCTION.
F. THE STRUCTURE SHOWN ON THESE DRAWINGS IS STRUCTURALLY SOUND ONLY IN ITS COMPLETED FORM. THE CONTRACTOR IS RESPONSIBLE TO FURNISH AND INSTALL ALL TEMPORARY SUPPORTS, SUCH AS TEMPORARY GUYS, BEAMS, FALSEWORK, CRIBBING OR OTHER ELEMENTS REQUIRED FOR THE ERECTION OPERATIONS. THE TEMPORARY SUPPORTS SHALL BE SUFFICIENT TO SECURE THE BARE FRAMING OR ANY PORTION THEREOF AGAINST LOADS THAT ARE LIKELY TO BE ENCOUNTERED DURING ERECTION, INCLUDING THOSE THAT RESULT FROM ERECTION OPERATIONS. ALL TEMPORARY BRACING AND/OR SUPPORT REQUIRED SHALL BE BASED ON THE CONTRACTOR'S CONSTRUCTION METHODS AND SEQUENCE OF CONSTRUCTION. THE CONTRACTOR SHALL TEMPORARILY SHORE AND BRACE ALL EARTH, FORMS, CONCRETE, STEEL, WOOD, MASONRY, TO RESIST GRAVITY, SEISMIC, THERMAL, CONSTRUCTION AND MISCELLANEOUS LOADS DURING CONSTRUCTION. THE CONTRACTOR SHALL HIRE AND PAY A PROFESSIONAL STRUCTURAL ENGINEER REGISTERED IN THE STATE WHERE THE PROJECT IS LOCATED TO DESIGN AND INSPECT ALL TEMPORARY SHORING AND BRACING.
G. THE CONTRACTOR IS RESPONSIBLE FOR LIMITING THE AMOUNT OF CONSTRUCTION LOAD IMPOSED ON THE EXISTING STRUCTURAL FRAMING. CONSTRUCTION LOADS SHALL NOT EXCEED THE DESIGN CAPACITY OF THE FRAMING AT THE TIME THE LOADS ARE IMPOSED.
H. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO FOLLOW ALL APPLICABLE SAFETY CODES AND REGULATIONS DURING ALL PHASES OF CONSTRUCTION.
I. CONNECTIONS OF ALL ITEMS SUPPORTED BY THE STRUCTURE ARE THE RESPONSIBILITY OF THE DISCIPLINES THAT ARE MAKING THESE ATTACHMENTS. THESE ATTACHMENTS SHALL BE DESIGNED TO RESIST ALL GRAVITY, WIND, WIND UPLIFT, SEISMIC, THERMAL LOADS, ETC.
J. WHERE A DETAIL, TYPICAL DETAIL, SECTION, TYPICAL SECTION OR A NOTE IS SHOWN FOR ONE CONDITION, IT SHALL APPLY FOR ALL LIKE OR SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
K. CONDITIONS SHOWN OR NOTED AS EXISTING ARE BASED ON INFORMATION VISUALLY OBSERVED OR FROM INFORMATION PROVIDED BY OTHERS OR EXISTING DRAWINGS AVAILABLE AT THE TIME WHEN DRAWINGS WERE PREPARED. NO WARRANTY IS IMPLIED AS TO THE ACCURACY OF THESE EXISTING CONDITIONS. CONTRACTOR SHALL VERIFY ALL EXISTING STRUCTURAL MEMBER SIZES AND/OR REINFORCING SHOWN HEREIN COMPLIES WITH ACTUAL SIZES AND/OR CONDITION IN THE FIELD. ANY DISCREPANCY SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE STRUCTURAL ENGINEER OF RECORD FOR REVIEW PRIOR TO COMMENCING ANY WORK.
L. ANY DETERIORATION OF EXISTING STRUCTURAL MEMBERS SHALL BE REPORTED TO THE STRUCTURAL ENGINEER OF RECORD IMMEDIATELY UPON NOTICE OF THE DETERIORATION PRIOR TO COMMENCING ANY WORK.
M. CONTRACTOR SHALL VERIFY WELDABILITY OF EXISTING STEEL WHEN WELDED CONNECTIONS ARE UTILIZED. REPORTS OF THE WELDABILITY OF THE MATERIALS SHALL BE SUBMITTED TO THE STRUCTURAL ENGINEER OF RECORD PRIOR TO COMMENCING ANY WELDING.
N. THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS AND CONDITIONS OF EXISTING CONSTRUCTION PRIOR TO COMMENCING FABRICATION AND ERECTION.
O. THE CONTRACTOR SHALL CONDUCT A VISUAL SITE SURVEY BEFORE COMMENCING ANY CONSTRUCTION. THE SURVEY SHALL THOROUGHLY DOCUMENT EXISTING CONDITIONS OF CONSTRUCTION THAT MAY BE IMPACTED BY THE NEW CONSTRUCTION. DOCUMENTATION SHALL INCLUDE, BUT NOT BE LIMITED TO, ANY NOTICEABLE DISTRESS AND/OR CONSTRUCTION DEFICIENCIES. THE CONTRACTOR SHALL MONITOR THE CONDITIONS OF THE EXISTING CONSTRUCTION (STRUCTURES, UTILITIES, ETC.) DURING THE COURSE OF CONSTRUCTION. ANY DAMAGE TO EXISTING CONSTRUCTION AND ITS SUBSEQUENT REPAIR SHALL BE THE SOLE COST AND RESPONSIBILITY OF THE CONTRACTOR.
P. UNLESS NOTED, SUBMIT SHOP DRAWINGS OF ALL FABRICATED MATERIALS FOR REVIEW. DESIGN DRAWINGS SHALL NOT BE REPRODUCED FOR USE AS SHOP DRAWINGS. SHOP DRAWINGS WILL NOT BE REVIEWED UNLESS THEY WERE CHECKED, BEAR THE INITIAL OF THE CHECKER AND ARE STAMPED "APPROVED" BY THE GENERAL CONTRACTOR.
Q. ALL REQUIRED TESTING REPORTS SHALL BE AVAILABLE AT THE JOB SITE.
R. EQUIPMENT WEIGHTS SHOWN ON THE STRUCTURAL DRAWINGS ARE MAXIMUM OPERATING WEIGHT INCLUDING CURBS AND APPURTENANCES. THE CONTRACTOR SHALL VERIFY AND BRING TO THE ATTENTION OF THE ENGINEER ANY DEVIATIONS.

DESIGN CRITERIA

A. BUILDING RISK CATEGORY — II

B. GRAVITY LOADS

ROOF DEAD LOAD	SEE S101
SNOW LOADS	SEE S101
LIVE LOAD	SEE S101

C. LATERAL LOADS

WIND LOADS

DESIGN WIND LOAD

DESIGN WIND SPEED	114 MPH (ULT) / 97 MPH (BASIC)
WIND EXPOSURE	'B'
WIND IMPORTANCE FACTOR	I_W = 1.00
INTERNAL PRESSURE COEFF	+/- 0.18

SEISMIC

SEISMIC DESIGN CATEGORY	B
S_S = 0.214	S_{DS} = 0.229g
S_1 = 0.051	S_{D1} = 0.082g

PLYWOOD ROOF SHEATHING:

A. 5/8" (OR THICKNESS TO MATCH EXISTING THICKNESS) APA PLYWOOD RATED SHEATHING, PS1, 40/20, C-D, EXPOSURE 1.
B. LONG SIDE OF PLYWOOD PANEL SHALL BE PERPENDICULAR TO THE SUPPORT.
C. MINIMUM SIZE OF CONNECTION SHALL BE 10d NAILS TO WOOD. UNLESS NOTED, MAXIMUM SPACING OF CONNECTION 6" AT ENDS OF PANEL AND 12" AT INTERMEDIATE SUPPORT.
D. CONTRACTOR SHALL CONFIRM WITH ROOFING MANUFACTURER, MINIMUM SHEATHING THICKNESS AND EDGE SUPPORT REQUIREMENTS WHEN ROOFING IS TO BE GUARANTEED BY A PERFORMANCE BOND.

ANCHORING SYSTEM:

A. UNLESS NOTED, ALL ANCHORS IN CONCRETE AND GROUTED MASONRY WALLS SHALL BE CARBON STEEL HILTI KWIK BOLTS 3(ICC-ES EST-2302) OR EQUIVALENT ICC APPROVED POST INSTALLED ANCHOR. UNLESS NOTED, EMBEDMENT (E) FOR HILTI KWIK BOLTS (NOT INCLUSIVE OF THREADS) SHALL BE AS FOLLOWS: 1/4" DIA. - 2", 3/8" DIA. - 2- 1/2", 1/2" DIA. - 3-1/2", 5/8" DIA. - 4", 3/4" DIA. - 4-3/4", AND 1" DIA. - 6". EMBEDMENT FOR ALTERNATE ANCHORS SHALL BE DETERMINED TO DEVELOP THE SAME SHEAR AND TENSION CAPACITY OF THE HILTI KWIK BOLTS.
[HOLE DEPTH (HD) = (E) + (DIAMETER)].
UNLESS NOTED, ALL ANCHORS IN GROUTED MASONRY WALLS SHALL BE HILTI HIT HY-150 OR ITW RAMSET/RED HEAD EPCON SYSTEM EPOXY AS OUTLINED IN "B".
B. EPOXY ANCHORING SHALL BE USED WHERE SPECIFICALLY SHOWN ON THE STRUCTURAL DRAWINGS, OR WHEN APPROVED IN ADVANCE BY THE STRUCTURAL ENGINEER.
C. WHERE REQUIRED, EPOXY ANCHORING SHALL BE INSTALLED USING ONE OF THE FOLLOWING PRODUCTS:
1. HILTI HIT HY-200 SAFE SET SYSTEM WITH HILTI HIT-Z ROD (ICC ESR-3187) TYPICAL U.N.
2. HILTI HIT HY-200 SAFE SET SYSTEM WITH HILTI HOLLOW DRILL BIT (TE-CD OR TE-YD) WITH HILTI HAS-E THREAD ROD (ICC ESR-3187).
3. HILTI HIT HY-200 SAFE SET SYSTEM WITH HILTI HAS THREADED ROD (ICC ESR-3187)
4. HILTI HIT-HY 70 MASONRY ADHESIVE ANCHORING SYSTEM (ICC ESR-3342) WITH HILTI HAS-E OR REINFORCING STEEL CONFORMING TO ASTM A-615, GRADE 60 (U.N.). THE APPROPRIATE SIZE SCREEN TUBE SHALL BE USED PER THE MANUFACTURER'S REQUIREMENTS.
5. ANCHORS RODS USED FOR EPOXY ANCHORING WALL BE THE TYPE SPECIFIED IN THE REFERENCED ICC REPORT. THE ANCHOR SIZE SHALL BE AS INDICATED ON THE PLANS AND/OR DETAILS. THE ANCHOR ROD EMBEDMENT SHALL BE AS PER THE TABLE BELOW UNLESS OTHERWISE NOTED ON THE PLANS AND/OR DETAILS. IF A CONFLICT EXISTS BETWEEN THE TABLE AND DRAWINGS, USE THE DEEPER EMBEDMENT.
6. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND THE CURRENT ICC REPORT.
7. SPECIAL INSPECTION SHALL BE PROVIDED IN ACCORDANCE WITH THE BUILDING CODE.

STANDARD EMBEDMENT DEPTH UNO			
ANCHOR SIZE	ANCHORING SYSTEM		
	HILTI HIT HY 200 WITH HIT Z ROD	HILTI HIT HY 200 WITH HAZ ROD	REBAR
#3 OR 3/8"Ø	4 1/2"	2 7/8"	3 3/8"
#4 OR 1/2"Ø	6"	3 1/2"	4 1/2"
#5 OR 5/8"Ø	7 1/2"	4"	5 5/8"
#6 OR 3/4"Ø	8 1/2"	5 1/4"	6 3/4"
#7 OR 7/8"Ø		N/A	7 7/8"
#8 OR 1"Ø		N/A	9"

D. UNLESS NOTED, ANCHOR SPACING (AS) AND ANCHOR EDGE DISTANCE (ED) SHALL BE AS PUBLISHED BY THE MOST CURRENT APPROVED HILTI REPORT IN ORDER TO DEVELOP MAXIMUM WORKING LOAD.
E. MASONRY WALLS RECEIVING ANCHORS SHALL BE GROUTED AND SHALL HAVE ATTAINED DESIGN STRENGTH PRIOR TO ANCHORING. PROVIDE MINIMUM EDGE DISTANCE THAT IS REQUIRED TO DEVELOP THE MAXIMUM WORKING LOAD PUBLISHED BY HILTI REPORT.
F. ALL ANCHORS SHALL BE INSTALLED AS PER MANUFACTURER'S INSTRUCTIONS AND UNDER MANUFACTURER'S SUPERVISION IN ORDER TO DEVELOP THE PUBLISHED WORKING LOADS. NO REINFORCING SHALL BE CUT OR DAMAGED UPON INSTALLATION OF ANY ANCHORS. SPECIAL INSPECTION IS REQUIRED.
G. MINIMUM CONCRETE COMPRESSIVE STRENGTH REQUIRED AT TIME OF INSTALLATION OF ANY ANCHOR SHALL BE 3000 PSI.
H. MINIMUM GROUT FILL MASONRY COMPRESSIVE STRENGTH REQUIRED AT TIME OF INSTALLATION OF ANY ANCHORS SHALL BE 2000 PSI.
I. ALTERNATE EQUIVALENT ICC APPROVED POST INSTALLED ANCHORAGE SYSTEMS MUST MEET OR EXCEED THE CAPACITY AND REQUIREMENTS OF THE ABOVE NOTED ANCHORS. ALTERNATE ANCHOR SYSTEMS (ICC ESR COMPLIANT FOR RELEVANT BUILDING CODE, LOAD RESISTANCE, INSTALLATION CATEGORY, COMPREHENSIVE INSTALLATION INSTRUCTIONS, CREEP, IN-SERVICE TEMPERATURE AND INSTALLATION TEMPERATURE, ETC.) MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD PRIOR TO USE. THE CONTRACTOR SHALL PROVIDE SIGNED AND SEALED CALCULATIONS FROM A REGISTERED ENGINEER WHERE THE PROJECT IS LOCATED THAT DEMONSTRATE THE PROPOSED ANCHORS MEET OR EXCEED THE CAPACITY OF THE SPECIFIED ANCHORS.

CONCRETE:

A. WORK ON THIS PROJECT SHALL CONFORM TO ACI 301-10 PUBLISHED BY THE AMERICAN CONCRETE INSTITUTE, FARMINGTON HILLS, MICHIGAN EXCEPT AS MODIFIED BY THESE CONTRACT DOCUMENTS.
B. CONCRETE SHALL CONFORM WITH ACI BUILDING CODE 318-LATEST EDITION AND SHALL HAVE A 28-DAY COMPRESSIVE STRENGTH, DENSITY, AND WATER/CEMENT IN ACCORDANCE WITH THE FOLLOWING:

	STRENGTH (PSI)	DENSITY (PCF)	MAX W/C	AIR CONTENT (%)
FOUNDATIONS	4,500	145	0.45	5-7
TOPPING SLAB	5,000	145	0.40	3 MAX

C. UNLESS NOTED, CEMENT SHALL CONFORM TO ASTM C150, TYPE I OR II. (SLUMP OF CONCRETE SHALL NOT EXCEED 4" UNLESS A WATER-REDUCING ADMIXTURE IS USED. THE SLUMP OF CONCRETE PRIOR TO ADDITION OF A WATER-REDUCING ADMIXTURE SHALL NOT EXCEED 4". THE SLUMP OF CONCRETE CONTAINING A WATER-REDUCING ADMIXTURE SHALL NOT EXCEED 8".
D. CONCRETE CURING SHALL COMPLY WITH ACI 308R. CURING PROCESS SHALL START IMMEDIATELY FOLLOWING FINISHING. REFERENCE SPECIFICATION FOR ADDITIONAL INFORMATION.
E. HOT WEATHER CONCRETING: SPECIAL PRECAUTIONS RECOMMENDED BY ACI 305 SHALL BE TAKEN WHEN THE AMBIENT TEMPERATURE IS ABOVE 90 DEGREES FAHRENHEIT OR WHEN MAXIMUM RATE OF EVAPORATION IN THE CONCRETE EXCEED 0.2 LB/SF/HR. THIS RATE IS AFFECTED BY AIR TEMPERATURE, RELATIVE HUMIDITY, CONCRETE TEMPERATURE AND WIND VELOCITY (SEE ACI 305, FIGURE 2.1.5). AFTER FINISHING CONCRETE, USE LIGHT FOG SPRAY UNTIL CURING METHOD IS IMPLEMENTED.
F. COLD WEATHER CONCRETING: WHEN, FOR MORE THAN THREE (3) CONSECUTIVE DAYS, THE MEAN DAILY TEMPERATURE DROPS BELOW 40 DEGREES FAHRENHEIT, SPECIAL MATERIALS AND PROCEDURES SHALL BE PROVIDED DURING PLACING AND CURING OF CONCRETE PER ACI 306.
G. CURING AND HOT AND COLD WEATHER CONCRETING PROCEDURES ARE GIVEN AS A GUIDE ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO PREVENT CONCRETE DAMAGE AND CRACKS. DAMAGED OR CRACKED CONCRETE SHALL NOT BE ACCEPTED.
H. REINFORCEMENT SUPPORTS SHALL BE IN ACCORDANCE WITH ACI 301. MASONRY SHALL NOT BE USED TO SUPPORT REINFORCING. IF CONCRETE PLACEMENT IS BY PUMPING, THE PIPELINES AND PIPELINE SUPPORT SYSTEM MUST BE SUPPORTED ABOVE AND INDEPENDENT FROM THE CHAIRED REINFORCEMENT BY "CHAIN-CHAIRS OR OTHER MEANS". THERE MUST BE NO CONTACT, DIRECT OR INDIRECT WITH CHAIRED REINFORCEMENT.
I. ALL FIELD TESTING SHALL BE PERFORMED BY A CERTIFIED ACI FIELD TECHNICIAN.
J. CONDUITS AND PIPES OF ALUMINUM SHALL NOT BE EMBEDDED IN STRUCTURAL CONCRETE UNLESS EFFECTIVELY COATED OR COVERED TO PREVENT ALUMINUM-CONCRETE REACTION OR ELECTROLYTIC ACTION BETWEEN ALUMINUM AND STEEL.

CONCRETE (cont'd):

K. CONCRETE MIX TO CONTAIN CL95 MACRO FIBERS BY PNA CONSTRUCTION TECHNOLOGIES AT A RATE OF 7.5 POUNDS PER CUBIC YARD USED AS PER THE MANUFACTURER'S RECOMMENDATIONS. (NEW TOPPING SLAB ONLY)

REINFORCING STEEL:

A. REINFORCING STEEL SHALL CONFORM TO ASTM A-615, GRADE 60 (U.N.) AND GRADE 40 FOR #3 AND SMALLER BARS. GRADE 60 REINFORCING MAY NOT BE RE-BENT OR FIELD BENT WITHOUT APPROVAL OF THE ENGINEER OF RECORD.
B. WELDED WIRE REINFORCING SHALL CONFORM TO ASTM A-1064 (ASTM 1022 FOR STAINLESS STEEL), MINIMUM LAP SHALL BE 8" U.N. EPOXY-COATED STEEL WELDED WIRE REINFORCEMENT SHALL CONFORM TO ASTM A-884, MINIMUM LAP SHALL BE 8" U.N.
C. NO TACK WELDING OF REINFORCING IN THE FIELD WILL BE PERMITTED.
D. ALL DETAILING, FABRICATION AND PLACING OR REINFORCING BARS, UNLESS OTHERWISE NOTED, SHALL CONFORM TO ACI 318-14, "BUILDING CODE REQUIREMENTS FOR STRUCTURAL CONCRETE" AND THE LATEST ACI "MANUAL OF STANDARD PRACTICE FOR DETAIL REINFORCED CONCRETE STRUCTURES".

COLD FORMED STEEL FRAMING (LIGHT GAUGE STEEL STUDS AND JOISTS):

A. METAL STUDS AND JOISTS SHOWN ON THE DRAWINGS SHALL HAVE EQUIVALENT AREA, SECTION MODULUS AND MOMENT OF INERTIA EQUAL TO OR LARGER THAN CLARK WESTERN FRAMING SYSTEMS STUDS AND JOISTS.
B. DESIGN, FABRICATIONS AND ERECTION SHALL CONFORM TO AISI "SPECIFICATIONS FOR THE DESIGN OF COLD FORMED STEEL STRUCTURAL MEMBERS", AND ASTM STANDARD C 955, "STANDARD SPECIFICATION FOR LOAD BEARING (TRANSVERSE AND AXIAL) STEEL STUDS, RUNNERS (TRACKS), AND BRACING OR BRIDGING FOR SCREW APPLICATION OF GYPSUM BOARD AND METAL PLASTER BASES" AND ASTM STANDARD C1007, "STANDARD SPECIFICATION FOR INSTALLATION OF LOAD BEARING (TRANSVERSE AND AXIAL) STEEL STUD AND RELATED ACCESSORIES", LATEST EDITIONS.
C. GALVANIZED MATERIAL:
1. ALL GALVANIZED STUDS, JOISTS AND ACCESSORIES 12, 14 AND 16 GAUGE, SHALL BE FORMED FROM STEEL THAT CORRESPONDS TO THE MINIMUM REQUIREMENTS OF ASTM A1003, GRADE D WITH A MINIMUM YIELD OF 50,000 PSI.
2. ALL GALVANIZED 18 AND 20 GAUGE STUDS AND JOISTS, TRACK, BRIDGING, END CLOSURES AND ACCESSORIES SHALL BE FORMED FROM STEEL THAT CORRESPONDS TO THE REQUIREMENTS OF ASTM A1003, GRADE A WITH A MINIMUM YIELD OF 33,000 PSI.
3. ALL GALVANIZED STUDS, JOISTS, TRACK, BRIDGING AND ACCESSORIES SHALL BE FORMED FROM STEEL HAVING A G-60 GALVANIZED COATING MEETING THE REQUIREMENTS OF ASTM A525.
4. ALL WELDS SHALL BE IN ACCORDANCE WITH AWS D1.3 AND SHALL BE TOUCHED UP WITH A ZINC-RICH PAINT.
D. UNLESS NOTED, ALL SCREWS OR PINS SHALL BE NON-CORROSIVE NO. 10-16 (D=.190") OR LARGER. PENETRATION OF JOINED MATERIAL SHALL NOT BE LESS THAN 3 EXPOSED THREADS. (DO NOT USE STAINLESS STEEL OR COPPER COATED FASTENERS).
E. UNLESS NOTED, TRACKS SHALL BE SAME DEPTH AS STUDS OR JOISTS AND EQUAL OR THICKER GAUGE THAN STUDS OR JOISTS. TRACKS SHALL BE CONNECTED TO SUPPORTS AT 16" O.C. MAXIMUM. STUDS OR JOISTS SHALL BE CONNECTED TO TRACKS AT EACH SIDE.
F. THE QUANTITY OF STUDS AND JOISTS DISPLACED OR CUT FOR OPENING SHALL BE PLACED HALF ON EACH SIDE OF OPENING.

STRUCTURAL STEEL:

A. CONFORM TO AISC MANUAL OF STEEL CONSTRUCTION, FOURTEENTH EDITION. MATERIALS:
ASTM A36, FY = 36 KSI
ASTM A992, FOR WIDE FLANGE MEMBERS
ASTM A500, GRADE B, FY = 46 KSI FOR SQUARE AND RECTANGULAR HOLLOW STRUCTURAL SECTIONS (HSS).
ASTM A53, TYPE S, GRADE B, FY = 35 KSI FOR PIPES.
ASTM A325 HIGH STRENGTH BOLTS.
ASTM A307, GRADE A, FOR HOOKED ANCHOR BOLTS.
ASTM F1554 GRADE 36 FOR THREADED ROD ANCHORS
ASTM A563 GRADE A HEAVY HEX NUTS FOR ANCHOR RODS
B. THE CONNECTIONS FOR ANY PORTION OF THE STRUCTURE NOT INDICATED ON THE DRAWINGS SHALL BE DESIGNED BY THE FABRICATOR. STANDARD CONNECTIONS SHALL BE USED WHENEVER POSSIBLE. ALL SHOP CONNECTIONS SHALL BE WELDED OR HIGH STRENGTH BOLTED. FIELD CONNECTIONS SHALL BE HIGH STRENGTH BOLTED WHENEVER POSSIBLE. UNLESS NOTED, USE 3/4" DIAMETER ASTM A-325N BOLTS INSTALLED IN ACCORDANCE WITH AISC.
C. STRUCTURAL STEEL SHALL RECEIVE ONE (1) SHOP COAT OF RUST INHIBITIVE PRIMER. STEEL EXPOSED TO WEATHER AFTER CONSTRUCTION IS COMPLETED SHALL BE GALVANIZED. MEMBERS TO BE GALVANIZED SHALL BE DETAILED AND FABRICATED TO PROVIDE FOR FLOW AND DRAINAGE OF PICKLING FLUIDS AND ZINC AND TO PREVENT PRESSURE BUILD-UP IN ENCLOSED PARTS.
D. PLACEMENT TOLERANCE FOR ANCHOR BOLTS SHALL BE IN ACCORDANCE WITH AISC CODE OF STANDARD PRACTICE (LATEST EDITION).

WOOD FRAMING:

A. CONFIRM TO NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION, PUBLISHED BY THE AMERICAN FOREST AND PAPER ASSOCIATION (AF & PA).
B. UNLESS NOTED, USE DOUGLAS FIR - LARCH, 19% MAXIMUM M.C. AS FOLLOWS:
SUBPURLINS, PLATES AND BLOCKING: No.2
JOISTS, PURLINS, BEAMS AND HEADERS: No.1/2 Fb = 850 PSI (MIN)
PARALLAM PSL 1.8E (MIN.) (FOR PSL PLUS ALSO) WITH Fb = 2400 PSI, Fv = 190 PSI, E = 1.8x10^6 PSI
C. WOOD IN CONTACT WITH CONCRETE, MASONRY, OR SOIL OR EXPOSED TO THE WEATHER OR NOT FULLY PROTECTED FROM MOISTURE SHALL BE NATURALLY DURABLE OR PRESERVATIVE- TREATED WOOD.
D. WOOD USED ABOVE GROUND AND NEAR THE GROUND SURFACE SHALL BE IN CONFORMANCE WITH THE REQUIREMENTS OF IBC 2012, SECTION 2304.11.2.
E. END OF WOOD GIRDERS ENTERING EXTERIOR MASONRY OR CONCRETE WALLS SHALL BE PROVIDED WITH A MINIMUM 1/2" AIR SPACE ON TOP, SIDES AND END, UNLESS NATURALLY DURABLE OR PRESERVITIVE-TREATED WOOD IS USED.
F. METAL CONNECTORS SHALL BE FASTENED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS TO DEVELOP THE MAXIMUM PUBLISHED CAPACITY.
G. THE QUANTITY OF WALL STUDS DISPLACED OR CUT FOR OPENING SHALL BE PLACED ADJACENT TO AND ATTACHED TO JAMBS, HALF ON EACH SIDE OF OPENING.
H. BLOCKING SHALL BE INSTALLED BETWEEN FLOOR JOIST AND ROOF JOIST AT 10'-0" O.C. MAXIMUM AND ABOVE SUPPORTS, U.N.O.
I. UNLESS NOTED, ALL NAILS SHALL BE COMMON NAILS IN ACCORDANCE WITH FEDERAL SPECIFICATIONS FF-N-105B. WHERE CONNECTIONS ARE NOT SHOWN ON THE DRAWINGS, COMPLY WITH NAILING SCHEDULE ON THIS DRAWING. ALL NAILS AT NON AIR CONDITIONED/HEATED AREA SHALL BE GALVANIZED.
J. FOR WOOD TO WOOD CONNECTIONS, SPACING OF THE NAILS SHALL NOT BE LESS THAN THE PENETRATION OR THE LEAST WOOD MEMBER THICKNESS. EDGE OR END DISTANCE SHALL BE MINIMUM 1/2 THE NAIL SPACING.
K. TOE NAILS SHALL BE DRIVEN AT AN ANGLE OF 30 DEGREES TO THE VERTICAL FACE OF PIECE AND BE STARTED AT 1/3 THE NAIL LENGTH FROM THE END OF THE PIECE.
L. ALL BOLTS SHALL BE ASTM A307, FURNISHED WITH STANDARD NUT AND WASHER.
M. LAG SCREWS AND WOOD SCREWS SHALL COMPLY WITH A.N.S.I. B18.

Consultant:

GF

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700


Drawn: SB
Checked: JK

Project No.
20210067.0


Contents:

GENERAL NOTES


S000A

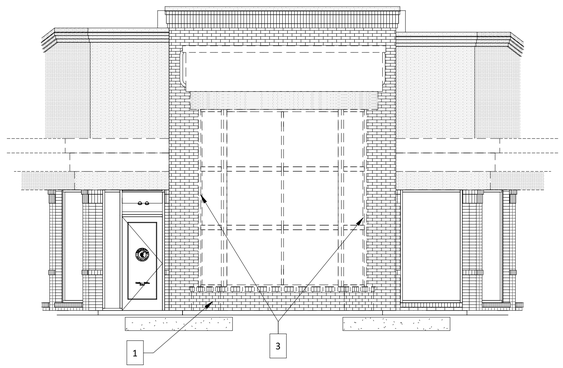

2 / S001 **EXTERIOR ELEVATION - WEST**
3/16" = 1'-0"

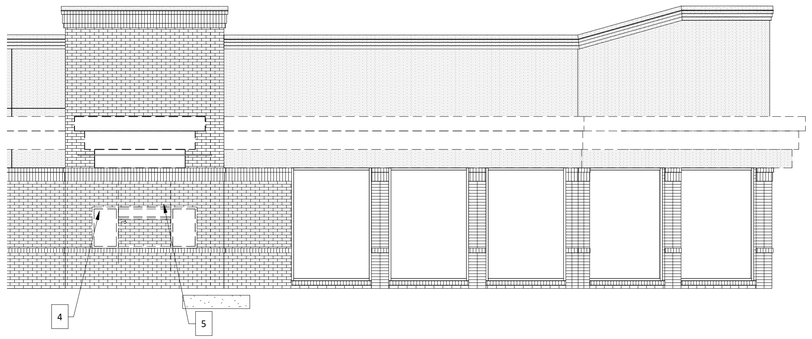

3 / S001 **EXTERIOR ELEVATION - NORTH**
3/16" = 1'-0"

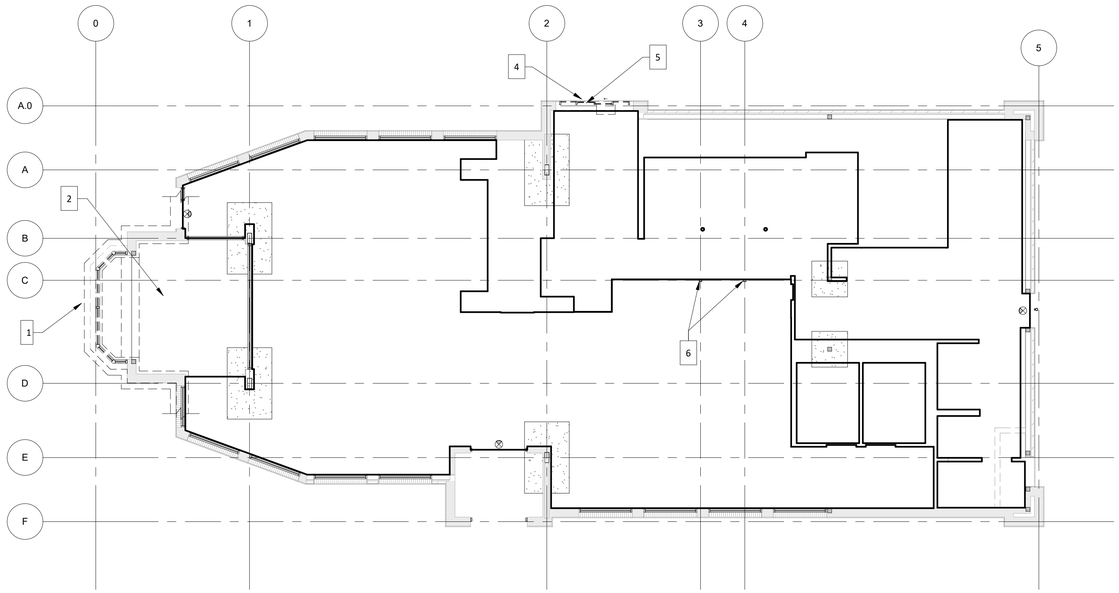

1 / S001 **STRUCTURAL DEMOLITION FOUNDATION PLAN**
1/8" = 1'-0"

GENERAL PLAN NOTES

1.	UPON REMOVAL OF ALL EXISITNG FLOOR FINISHES SURVEY EXISTING SLAB AND PROVIDE PATCHING AND/OR FIRESTROPPING AS REQUIRED FOR PROPER SEAL AND AS REQUIRED BY CODE.
2.	UPON REMOVAL OF ALL EXISTING CEILING FINISHES, SOFFITS, ETC. SURVEY EXISING DECK FOR PENETRATIONS AND PATCH AND/OR FIRESTOP FOR PROPER SEAL AND AS REQUIRED BY CODE.
3.	GENERAL CONTRACTOR TO SCOPE EXISTING SANITARY LINES PRIOR TO PREPARING FOR NEW CONNECTIONS.
4.	(E) INDICATES EXISTING FRAMING, (N) INDICATES NEW MEMBERS.

GENERAL DEMOLITOIN NOTES


1.	DEMOLISHED MATERIALS SHALL BECOME THE GENERAL CONTRACTOR'S PROPERTY AND SHALL BE REMOVED FROM THE SITE WITH FURTHER DISPOSITION AND RECYCLED BY THE GENERAL CONTRACTOR'S OPTION, UNLESS NOTED OTHERWISE.
2.	SURVEY THE CONDITION OF THE BUILDING TO DETERMINE WHETHER REMOVING ANY ELEMENT MIGHT RESULT IN STRUCTURAL DEFIICIENCY OR UNPLANNED COLLAPSE OF ANY PORTION OF THE STRUCTURE OR ADJACENT STRUCTURES DURING SELECTIVE DEMOLITION.
3.	PERFORM SURVEYS AS THE WORK PROGRESSES TO DETECT HAZARDS RESULTING FROM SELECTIVE DEMOLITION ACTIVITIES.
4.	MAINTAIN EXISTING UTILITIES TO REMAIN IN SERVICE AND PROTECT THEM AGAINST DAMAGE DURING SELECTIVE DEMOLITION OPERATIONS.
5.	CONDUCT DEMOLITION OPERATIONS AND REMOVE DEBRIS TO ENSURE MINIMAL INTERFERENCE WITH ROADS, STREETS, WALKS, AND OTHER ADJACENT OCCUPIED AND USED FACILITIES. REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS. PROMPTLY DISPOSE OF DEMOLISHED MATERIALS. PROMPTLY DISPOSE OF DEMOLISHED AMTERIALS. DO NOT ALLOW DEMOLISHED MATERIALS TO ACCUMULATE ON SITE.
6.	PROVIDE TEMPORARY WEATHER PROTECTION, DURING INTERVAL BETWEEN DEMOLITION, REMOVAL OF EXISTING EXTERIOR CONSTRUCTION AND NEW CONSTRUCTION TO ENSURE THAT NO WATER DAMAGE OCCURS TO STRUCTURE OR INTERIOR AREAS.
7.	TOTAL SCOPE OF DEMOLITION MAY NOT BE COVERED ON THIS SHEET. REVIEW ALL SHEETS IN THIS DRAWING SET TO DETERMINE TOTAL SCOPE OF DEMOLITION.
8.	REMOVE & TRANSPORT DEBRIS IN A MANNER THAT WILL PREVENT SPILLAGE ON ADJACENT SURFACES AND AREAS.
9.	TRANSPORT DEMOLISHED MATERIALS OFF OWNER'S PROPERTY AND LEGALLY DISPOSE OF THEM.
10.	CLEAN ALL HORIZONTAL SURFACES OF ACCUMULATED DUST AND DEBRIS.
11.	ALL DEMOLITION ITEMS ON THIS SHEET TO BE PERFORMED BY CHIPOTLE'S GENERAL CONTRACTOR, UNLESS NOTED OTHERWISE.
12.	COORDINATE ALL DEMOLITION ACTIIVTY WITH BUILDING OWNER'S REPRESETATIVE. SOME DEMOLITION ACTIVIITES MAY BE REQUIRED TO BE PERFORMED ON PREMIUM TIME.
13.	CONTRACTOR SHALL TAKE ADEQUATE PRECAUTIONS TO PROTECT ALL ADJACENT AND REMAINING BUIDLING COMPONENTS.
14.	EXISTING FOUNDATIONS TO BE PROTECTED AND UNDISTURBED. UNLESS OTHERWISE NOTED.
15.	ALL SALVAGED ITEMS, INCLUDING BUT NOT LIMITED TO LINES, ELECTRICAL PANELS, MAIN COPPER CONDUIT, ETC. SHALL BE CAREFULLY DISASSEMBLED/DISCONNECTED AND STORED IN A SECURE LOCATION FOR POSSIBLE REUSE.
16.	IDENTIFIED SELECTIVE DEMOLITION IS FOR REFERENCE ONLY. ADDITIONAL DEMOLITION MAY BE REQUIRED TO ACCOMMODATE NEW LAYOUT; REFER TO NEW WORK PLANS AND ELEVATIONS. ALL DIMENSIONS SHOWN SHOULD BE VERIFIED IN THE FIELD.
17	ANY EXISTING FINISHED SURFACES TO REMAIN THAT ARE AFFECTED BY SELECTIVE DEMOLITION SHALL BE PATCHED TO MATCH EXISITNG ADJACENT SURFACES UNLESS CONCEALED BY NEW CONSTRUCTION.
18	UTILITIES ABANDONED SHALL BE REMOVED AND CAPPED BEHIND FINISHED SURFACES.
19	IN SHARED SPACES WITH OTHER TENANTS, SEAL ALL INTAKE AND EXHAUST AIR PRIOR TO DEMOLITION.
20	GC TO CONFIRM WITH LANDLORD ANY REQUIREMENTS FOR TESTING AND DISPOSAL OF POSSIBLE CONTAMINATED SOILS AND/OR HAZARDOUS MATERIALS PRIOR TO REMOVAL OR PENETRATION OF EXISTING SLAB.

DEMOLITION LEGEND

EXISTING CONSTRUCTION TO REMAIN	———
EXISTING CONSTRUCTION TO BE DEMOLISHED	- - -

FOUNDATION AND SLAB PLAN NOTES:

1. REF SHEET S000A FOR GENERAL NOTES AND SPECIAL INSPECTIONS FOR ADDITIONAL INFORMATION.
2. FOR METAL STUD FRAMING AT CEILING AND INTERIOR WALLS, SEE THE ARCH DWGS.
3. THE GENERAL CONTRACTOR TO FIELD VERIFY THE SIZES AND LOCATIONS OF THE EXISTING CONSTRUCTION BEFORE ORDERING OF MATERIALS AND CONSTRUCTION. ANY DEVIATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER OF RECORD IMMEDIATELY.
4. REFER TO ARCHITECTURAL DWGS FOR ALL NEW INTERIOR STUD WALL DETAILS, LOCATIONS, AND DIMENSIONS.
5. FOR EXTENT OF DEMOLITION REFERENCE STRUCTURAL AND ARCHITECTURAL DEMOLITION DRAWINGS
6. FOR SLAB ON GROUND INFILL AT TRENCH FOR NEW UTILITIES, REFERENCE SECTION 1/S200.
7. FOR TYPICAL DETAIL AT NEW FLOOR DRAIN/SINK IN EXISTING SLAB ON GROUND, REF X & X/Sxxx RESPECTIVELY.
8. EXISTING PLANS AND ANALYSIS ARE BASED ON THE FOLLOWING STRUCTURAL DRAWINGS PREPARED BY JMP ARCHITECTS (DATED 03/14/03 REV1 BUILDING DEPT. COMMENTS.
   - S-1.0 FOUNDATION PLAN
   - S-2.0 ROOF FRAMING PLAN
   - S-3.0 SECTIONS AND DETAILS
   - S-4.0 SECTIONS AND DETAILS
   - S-5.0 SECTIONS AND DETAILS
   - S-6.0 GENERAL NOTES
9. FOR TYPICAL NEW CONCRETE CURB OR PAD DETAIL, REFERENCE ARCH DWG A101.
10. T/(E) SLAB REF. ELEVATION = 0'-0"
11. (N)/(E) BRICK LINTEL ANGLE TO HAVE A MINIMUM BEARING OF 6", EXTERIOR LINTEL TO BE GALVANIZED.
12. 2" INFILL/TOPPING SLAB W/ EPOXY-COATED 6x6 x W1.4 x W1.4 AT MID-DEPTH OF SLAB. PROVIDE CONTRACTION JOINTS IN THE NEW TOPPING SLAB AT A MAXIMUM OF 4' - 0" O.C. IN EACH DIRECTION. JOINTS SHALL BE 1/4" WIDE BY 1/2" DEEP TOOLED "V" JOINT WITH A 1/8" MINIMUM RADIUS EDGE. JOINTS SHALL NOT BE SAW CUT. ALL CONTRACTION JOINTS SHALL BE SEALED WITH SIKAFLEX 1CSL JOINT SEALANT INSTALLED AS PER THE MANUFACTURER'S RECOMMENDATIONS. RECOMMENDED JOINT LAYOUT RATIO IS 1.5:1.0 MAX. SEE DETAIL 6/S200, TYP.

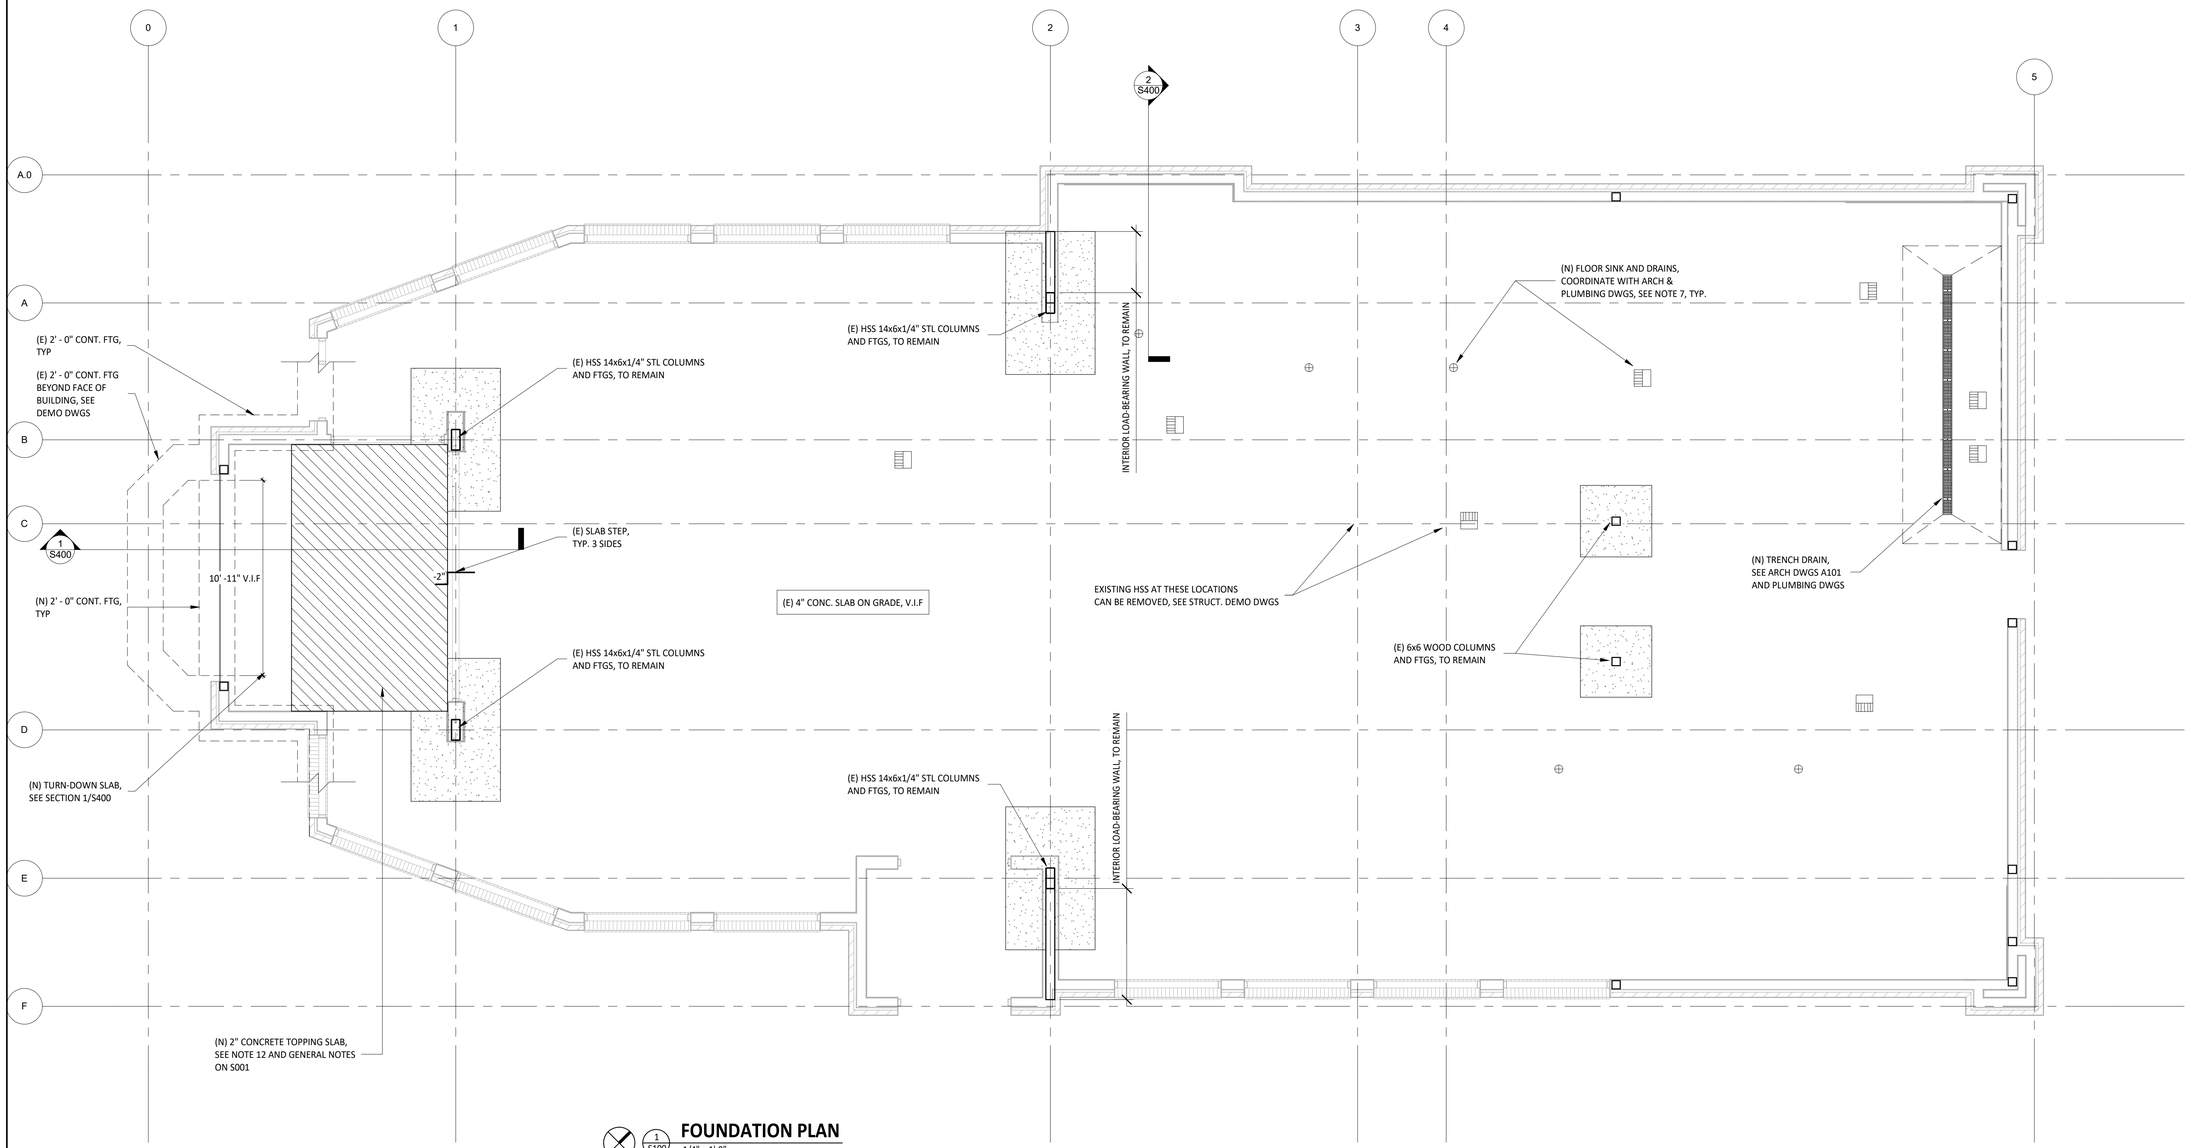

FOUNDATION PLAN

1 S100 — 1/4" = 1'-0"

Consultant:

GF

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064

555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700

Drawn: SB
Checked: JK

Project No.
20210067.0

Contents:

FOUNDATION PLAN

S100

PLAN NOTES:

1. REF SHEET S000A FOR GENERAL NOTES AND SPECIAL INSPECTIONS.
2. REF 4/S300 FOR TYPICAL PARTITION WALL SUPPORT PARALLEL TO ROOF FRAMING DETAIL.
3. REF 5/S300 FOR TYPICAL PARTITION WALL SUPPORT PERPENDICULAR TO ROOF FRAMING DETAIL.
4. THE GENERAL CONTRACTOR TO FIELD VERIFY THE SIZES AND LOCATIONS OF THE EXISTING WOOD FRAMING BEFORE ORDERING OF MATERIALS AND CONSTRUCTION. ANY DEVIATIONS SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER OF RECORD IMMEDIATELY.
5. (E) INDICATES EXISTING MEMBERS, (N) INDICATES NEW MEMBERS.
6. FOR DIMENSIONED LOCATIONS OF RTU'S SEE ARCH ROOF PLAN.
7. EXISTING CONDITIONS, ELEVATIONS, SIZES, ETC. MUST BE FIELD VERIFIED BY CONTRACTOR BEFORE COMMENCING CONSTRUCTION (BEFORE DEMOLITION, PREPARING SHOP DRAWINGS, ORDERING MATERIALS, ETC.) ANY DEVIATION SHALL BE BROUGHT TO THE ATTENTION OF THE STRUCTURAL ENGINEER OF RECORD IMMEDIATELY.
8. FOR INTERMITTENT DUCT SUPPORTS AT EXISTING ROOF, COORD WITH MECHANICAL DRAWINGS.
9. EXISTING PLANS AND ANALYSIS ARE BASED ON THE FOLLOWING STRUCTURAL DRAWINGS PREPARED BY JMP ARCHITECTS (DATED 03/14/03 REV1 BUILDING DEPT. COMMENTS)
   - S-1.0 FOUNDATION PLAN
   - S-2.0 ROOF FRAMING PLAN
   - S-3.0 SECTIONS AND DETAILS
   - S-4.0 SECTIONS AND DETAILS
   - S-5.0 SECTIONS AND DETAILS
   - S-6.0 GENERAL NOTES
10. ALL ELEVATIONS REFERENCED FROM FROM GROUND FLOOR ELEVATION OF 0'-0" FOR REFERENCE ONLY.
11. APPROXIMATE WEIGHT OF MEP EQUIPMENT ARE SHOWN. VERIFY ALL LOADS, LOCATIONS, DIMENSIONS SHOWN ON PLAN, AND CURB SIZES WITH MECHANICAL CONTRACTOR PRIOR TO FABRICATION. HANGER SUPPORT OF UNIT BY OTHERS.
12. DUCT/CONDUIT FOR ROOF TOP EQUIPMENT TO FIT BETWEEN EXISTING ROOF FRAMING. DO NOT DAMAGE EXISTING WOOD FRAMING AND EXISTING TRUSS BRIDGING AND BRACING. SEE 2/S300 FOR ADDITIONAL INFORMATION.
13. COORDINATE UNISTRUT SUPPORT AND HANGER ROD LOCATIONS FOR HUNG KITCHEN HOOD WITH THE ARCHITECTURAL DRAWINGS AND HOOD MANUFACTURER SHOP DRAWING.
14. AT EXISTING ROOF OPENING TO BE FILLED, INSTALL NEW PLYWOOD ROOF SHEATHING OVER EXISTING ROOF OPENING. SEE GENERAL NOTES ON S000 FOR ADDITIONAL INFORMATION. ADD ADDITIONAL 2x6 BLOCKING AT 1/3 POINTS OF EXISTING OPENING TO BE INFILLED FOR 3 SPAN SUPPORT OF NEW PLYWOOD SHEATHING.
15. FOR NEW ROOF TOP EQUIPMENT THAT REQUIRES CURB SUPPORT, REF DETAILS 1 AND 2/S300 (TYP).
16. FOR CONNECTION DETAIL AT DUCT/MOUNTED LIGHT OR SPEAKER TO EXISTING WOOD FRAMING, SEE DETAILS 7 & 8/S300 AND ARCH/MEP DRAWINGS FOR LOCATIONS.
17. PROVIDE 2x FLAT BLOCKING BETWN TRUSSES ABOVE AND BELOW DUCT WORK THAT RUN BETWEEN TRUSSES. 2x BLOCKING FOR FASTENING OF (N) PLYWOOD, SEE GENERAL NOTES.
18. BASED ON GF'S UNDERSTANDING OF THE EXISTING DRAWING AND ADDITIONAL EQUIPMENT WEIGHTS, IT IS GF'S OPINION THAT SOME OF THE EXISTING ROOF FRAMING MEMBERS WILL NEED TO BE REINFORCED FOR THE ADDITIONAL WEIGHT OF THE NEW EQUIPMENT AS SHOWN ON THE "EXISTING ROOF FRAMING PLAN". OTHER EXISTING FRAMING MEMBERS ARE CAPABLE OF SUPPORTING THE ADDITIONAL WEIGHT OF THE NEW EQUIPMENT WITHOUT THE NEED FOR REINFORCING OF THE EXISTING FRAMING.

NAILING SCHEDULE

CONNECTION	NAILING
1. JOIST TO SILL OR GIRDER, TOENAIL	3-8d#
2. BRIDGING TO JOIST, TOENAIL EACH END	2-8d#
3. 1"x6" SUBFLOOR OR LESS TO EACH JOIST, FACE NAIL	2-8d#
4. WIDER THAN 1"x6" SUBFLOOR TO EACH JOIST, FACE NAIL	3-8d#
5. 2" SUBFLOOR TO JOIST OR GIRDER, BLIND AND FACE NAIL	2-16d#
6. SOLE PLATE TO JOIST OR BLOCKING, FACE NAIL	16d @ 16" O.C.
6A. SOLE PLATE TO JOIST OR BLOCKING AT BRACED WALL PANEL	3-16d @ 16" O.C.
7. TOP PLATE TO STUD, END NAIL	2-16d#
8. STUD TO SOLE PLATE	4-8d#, TOENAIL OR 2-16d#, END NAIL
9. DOUBLE STUDS, FACE NAIL	16d @ 24" O.C.
10. DOUBLED TOP PLATES, FACE NAIL	16d @ 16" O.C.
11. BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE, TOE NAIL	3-8d#
12. RIM JOIST TO TOP PLATE, TOE NAIL	8d @ 6" O.C.
13. TOP PLATES, LAPS AND INTERSECTIONS, FACE NAIL	2-16d#
14. CONTINUOUS HEADER, TWO PIECES	16d# @ 16" O.C. ALONG EA EDGE
15. CEILING JOISTS TO PLATE, TOENAIL	3-8d#
16. CONTINUOUS HEADER TO STUD, TOENAIL	4-8d#
17. CEILING JOISTS, LAPS OVER PARTITIONS, FACE NAIL	3-16d#
18. CEILING JOISTS TO PARALLEL RAFTERS, FACE NAIL	3-16d#
19. RAFTER TO PLATE, TOENAIL	3-8d#
20. 1" BRACE TO EACH STUD AND PLATE, FACE NAIL	2-8d#
21. 1"x8" SHEATHING OR LESS TO EACH BEARING, FACE NAIL	3-8d#
22. WIDER THAN 1"x8" SHEATHING TO EACH BEARING, FACE NAIL	3-8d#
23. BUILT-UP CORNER STUDS	16d# @ 24" O.C.
24. BUILT-UP GIRDER AND BEAMS	20d# @ 32" O.C. @ TOP & BOTT & STAGGERED ON OPP. SIDES, 2-20d# @ ENDS & @ EA SPLICE

NAILING SCHEDULE

CONNECTION	NAILING
25. 2" PLANKS	16d# @ EACH BEARING
26. ROOF RAFTER TO 2-BY RIDGE BEAM, TOE NAIL OR FACE NAIL	2-16d#
27. JOIST TO BAND JOIST, FACE NAIL	3-16d#
28. LEDGER STRIP, FACE NAIL EACH JOIST	3-16d#
29. PLYWOOD AND PARTICLE BOARD:	
SUBFLOOR, ROOF AND WALL SHEATHING (TO FRAMING):	
1/2" AND LESS	6d@*
19/32"-3/4"	8d# OR 6d@
7/8" - 1"	8d@
1-1/8" - 1-1/4"	10d# OR 8d@
COMBINATION SUBFLOOR-UNDERLAYMENT (TO FRAMING)	
3/4" AND LESS	6d@
7/8" - 1"	8d@
1-1/8" - 1-1/4"	10d# OR 8d@
30. PANEL SIDING (TO FRAMING):	
1/2" OR LESS	6d

COMMON OR BOX NAILS MAY BE USED EXCEPT WHERE OTHERWISE STATED.

@ - COMMON OR DEFORMED SHANK.
# - COMMON.
$ - DEFORMED SHANK.
* - FOR ROOF SHEATHING, 8d NAILS (2~8"x0.113") ARE THE MINIMUM REQUIRED FOR WOOD STRUCTURAL PANELS, U.N.O.

EXISTING ROOF LOADS

DEAD LOADS
- ROOF = 20 PSF

ROOF LIVE LOADS
- FLAT ROOF LIVE LOAD = 20 PSF

SNOW LOADS
- GROUND SNOW LOAD, Pg = 30 PSF
- FLAT ROOF SNOW LOAD = 19 PSF

AS PER EXISTING DRAWINGS, SEE PLAN NOTE 9.


EQUIPMENT WEIGHTS

UNIT NAME	WEIGHT (LBS)
MAU-1	560*
(E) RTU-1	1,420*
(E) RTU-2	1,410*
RTU-3	1,417*
EF-1	220*
EF-2	81*
CU-1	200
CU-2	100
CU-3	100

* - WEIGHTS INCLUDE UNIT AND CURB

ROOF TRUSS REINFORCEMENT TABLE

JOIST REINF. MARK	DESCRIPTION
A	WEB REINFORCING FULL LENGTH, SEE SEE 6/S301
B	TOP & BOTT CHORD REINFORCING TO BE INSTALLED, FULL LENGTH OF JOIST U.N.O., SEE 4/S301
C	SEAT REINFORCING TO BE INSTALLED, SEE 5/S301

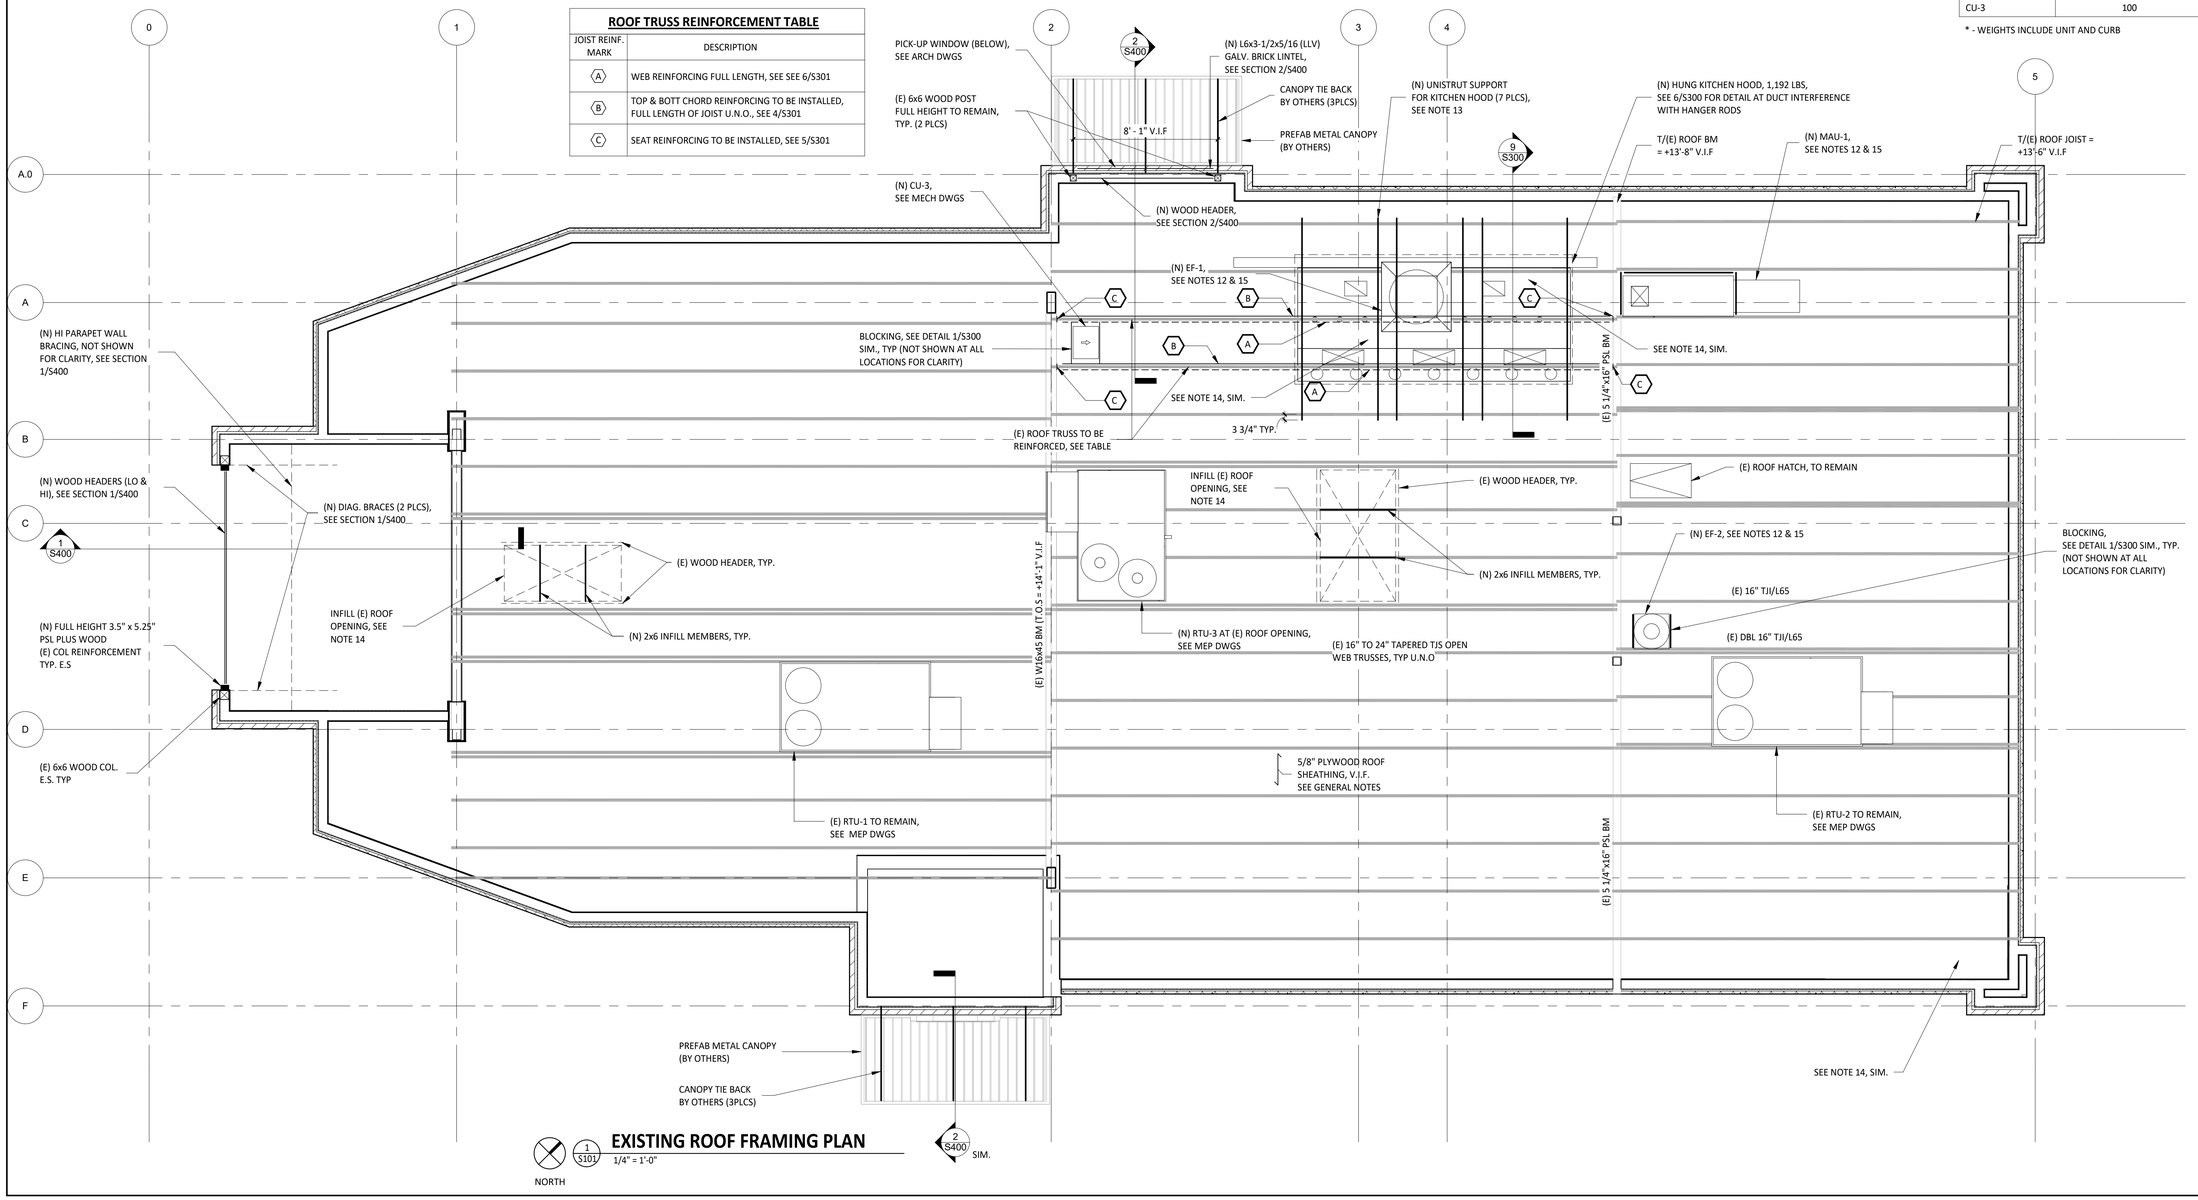

EXISTING ROOF FRAMING PLAN

1/4" = 1'-0"

Consultant:

GF

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700


Drawn: SB
Checked: JK

Project No.
20210067.0

Contents:


EXISTING ROOF FRAMING PLAN

S101

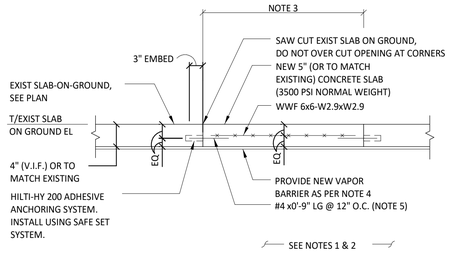


NOTES:
1. BACKFILL AROUND NEW PIPING WITH CRUSHED AGGREGATE/COMPACTED FILL/OR SAND TO OBTAIN SUBGRADE MODULUS ≥ 150 PCI. RESTORE STONE BEDDING IF DISTURBED. 6" MIN 3/4" COMPACTED CRUSHED STONE GRANULAR FILL.
2. SEE ARCH AND PLUMBING DWGS FOR NEW UNDERSLAB PIPING, LOCATIONS.
3. REMOVE (E) CONCRETE SLAB FOR PLACEMENT OF UNDERSLAB PIPING/ UTILITY.
4. PROVIDE NEW VAPOR BARRIER TO MATCH EXISTING IF ONE IS FOUND BELOW EXISTING SLAB ON GRADE. TAPE AND SEAL AT EDGES AS REQUIRED TO RESTORE INTEGRITY OF VAPOR BARRIER, COORDINATE WITH ARCH DWGS.
5. INSTALL ANCHOR 12" FROM CORNERS OF OPENING.

1 S200 SLAB ON GROUND INFILL AT NEW PIPE TRENCH
3/4" = 1'-0"

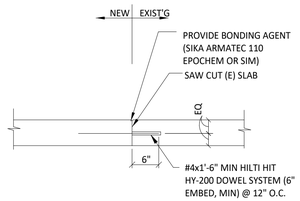


2 S200 TYP. DOWEL DETAIL
1/16" = 1'-0"

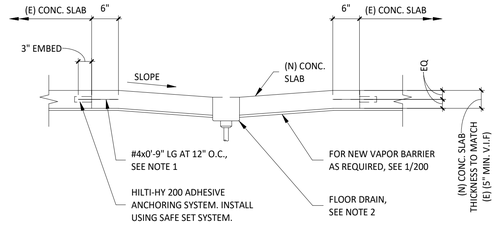


NOTES:
1. INSTALL ANCHORS 12" FROM CORNERS OF OPENING.
2. REF. PLAN FOR LOCATIONS OF FLOOR DRAIN. SEE ARCH DWGS FOR DIMENSIONS.

3 S200 TYPICAL FLOOR DRAIN AT EXISTING SLAB ON GROUND
3/4" = 1'-0"

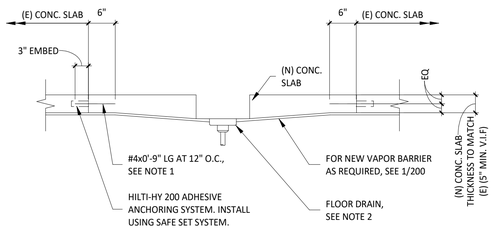

NOTES:
1. INSTALL ANCHORS 12" FROM CORNERS OF OPENING.
2. REF. PLAN FOR LOCATIONS OF FLOOR SINK. SEE ARCH DWGS FOR DIMENSIONS.


4 S200 TYPICAL FLOOR SINK AT EXISTING SLAB ON GROUND
3/4" = 1'-0"

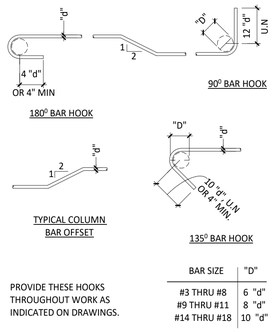

BAR SIZE	"D"
#3 THRU #8	6 "d"
#9 THRU #11	8 "d"
#14 THRU #18	10 "d"

1. PROVIDE THESE HOOKS THROUGHOUT WORK AS INDICATED ON DRAWINGS.

5 S200 TYPICAL REINFORCING BAR BENDS DETAIL
3/4" = 1'-0"



NOTES:
1. CLEAN THE CONCRETE SUBSTRATE PER NEW SEALANT MANUFACTURER'S RECOMMENDATIONS AND USING COMPRESSED AIR OR OTHER APPROVED MEANS TO REMOVE DUCT OR OTHER FOREIGN MATERIALS.
2. PRIME THE ENTIRE SURFACE OF THE JOINT. ALLOW FOR PRIMER TO CURE PROPERLY PRIOR TO INSTALLING SEALANT. APPLY BACKER ROD TO JOINT PRIOR TO PRIMING.
3. D = W/2 (1/4" MIN.)
4. SEALANT FOR SLAB JOINTS USE SIKAFLEX-1C SL.

6 S200 TYPICAL JOINT SEALANT DETAIL
3/4" = 1'-0"

Consultant:
GF
92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700


Drawn: SB
Checked: JK

Project No.
20210067.0

Contents:


FDN & SLAB SECTIONS AND DETAILS

S200

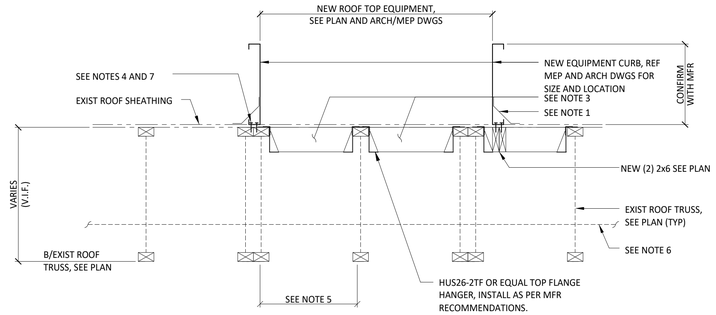


NOTES:
1. REFERENCE ARCH FOR FLASHING AT CURBS AND CURB SUPPORTS.
2. PATCH AND REPAIR ROOF PENETRATION AS PER ARCH DRAWINGS. ALUMINUM FLASHING MUST BE COATED TO PREVENT DIRECT CONTACT WITH P.T. WOOD OR USE STAINLESS STEEL AS AN ALTERNATIVE WITH APPROVAL FROM ARCH. SEE ARCH DWGS FOR ADD'L INFO.
3. AT EACH SUPPORT END OF NEW EQUIPMENT CURB, INSTALL FULL DEPTH DOUBLE 2x BLOCKING BETWEEN EXIST ROOF TRUSS TOP CHORD. INSTALL WITH (3) 8d TOE NAILS EACH END TO EXIST ROOF TRUSS, U.N.O.
4. RECOMMENDED, FASTENER FOR NEW CURB TO EXIST/NEW BLOCKING/ROOF TRUSS, USE SIMPSON #10 SD10212 SCREWS AT 12" O.C. STAGGERED (2) ROWS (3 MIN PER SIDE) OR AS PER CURB MANUFACTURER'S REQUIREMENTS. THE STRICTEST DESIGN SHALL GOVERN.
5. MAX NEW DUCT PENETRATION THRU EXISTING ROOF TRUSS NOT TO EXCEED CLEAR DISTANCE BETWEEN TRUSSES (I.E. DO NOT DAMAGE TRUSSES).
6. NAIL (E) PLYWOOD SHEATHING TO PERIMETER BLOCKING AND/OR TRUSS TOP CHORD WITH 8d NAILS AT 6" O.C. MAX, TYP.

1 S300 NEW ROOF UNIT ON CURB SUPPORT
3/4" = 1'-0"

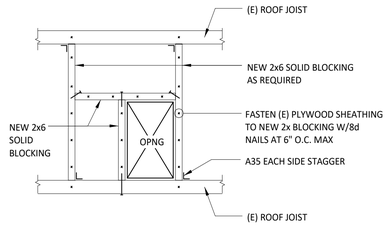


NOTES:
1. (E) PLYWOOD SHEATHING NOT SHOWN FOR CLARITY. REMOVE EXISTING ROOFING AND PLYWOOD WOOD FOR INSTALLATION OF NEW 2x BLOCKING

2 S300 NEW DUCT PENETRATION THROUGH ROOF
3/4" = 1'-0"

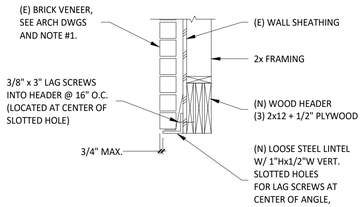


NOTES:
1. FOR (N) WEEPS AND FLASHING, SEE ARCH DWGS


3 S300 LOOSE STEEL LINTEL DETAIL
3/4" = 1'-0"

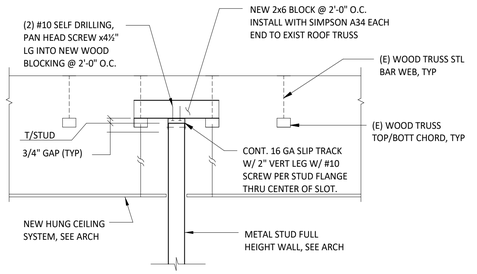


4 S300 SUPPORT PARALLEL TO WOOD BEAMS
3/4" = 1'-0"

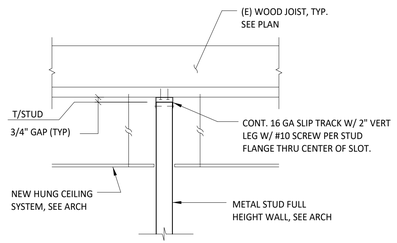

5 S300 SUPPORT PERPENDICULAR TO WOOD BEAMS
3/4" = 1'-0"

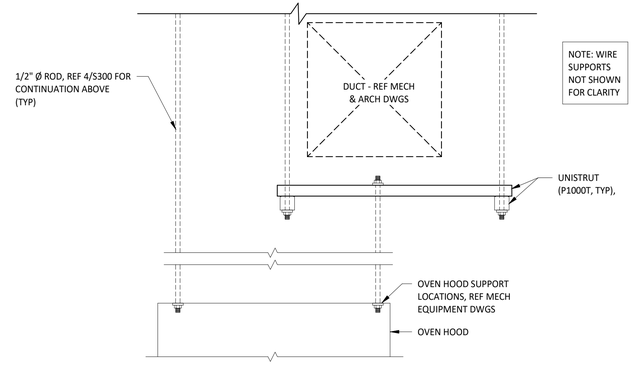


6 S300 OVEN HOOD SUPPORT SECTION AT DUCT INTERFERENCE
3/4" = 1'-0"

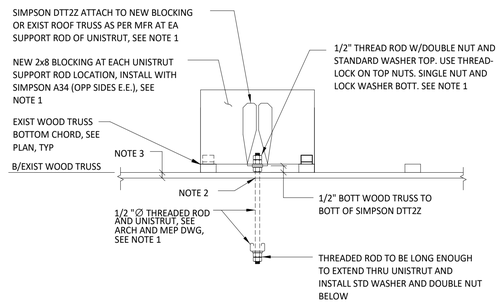


NOTES:
1. REF ARCH AND MEP DWGS FOR LOCATION OF UNISTRUT SUPPORTS. COORDINATE LAYOUT AND SUPPORT OF UNISTRUT FOR LIGHTING SUPPORTS PRIOR TO INSTALLATION OF STRUCTURAL SUPPORTS SHOWN IN DETAIL AND NEW CEILING.
2. COORDINATE FIRE-STOP INSTALLATION AND/OR DETAILS WITH ARCH DWGS, IF APPLICABLE.
3. SEE ARCH DRAWINGS FOR LOCATIONS WHERE NEW SHEATHING IS TO BE INSTALLED, SEE NOTE 2. ALL OTHER AREAS, REF ARCH DWGS FOR NEW HUNG CEILING SYSTEM.

7 S300 CONNECTION DETAIL AT UNISTRUT TO EXIST WOOD BEAMS
3/4" = 1'-0"

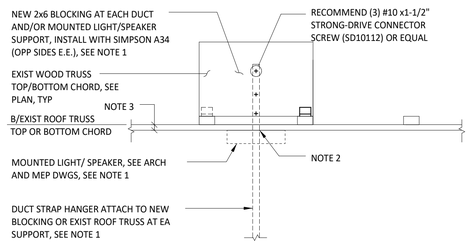

NOTES:
1. REF ARCH AND MEP DWGS FOR LOCATION OF DUCT SUPPORTS AND/OR MOUNTED LIGHT/SPEAKERS. COORDINATE LAYOUT AND SUPPORT FOR LIGHTING AND/OR DUCT SUPPORTS PRIOR TO INSTALLATION OF STRUCTURAL SUPPORTS SHOWN IN DETAIL AND NEW CEILING SHEATHING.
2. COORDINATE FIRE-STOP INSTALLATION AND/OR DETAILS WITH ARCH DWGS, IF APPLICABLE.
3. SEE ARCH DRAWINGS FOR LOCATIONS WHERE NEW SHEATHING IS TO BE INSTALLED, SEE NOTE 2. ALL OTHER AREAS, REF ARCH DWGS FOR NEW HUNG CEILING SYSTEM. NOT APPLICABLE AT WOOD TRUSS TOP CHORD.

8 S300 CONNECTION DETAIL AT DUCT/MOUNTED LIGHT OR SPEAKER
3/4" = 1'-0"

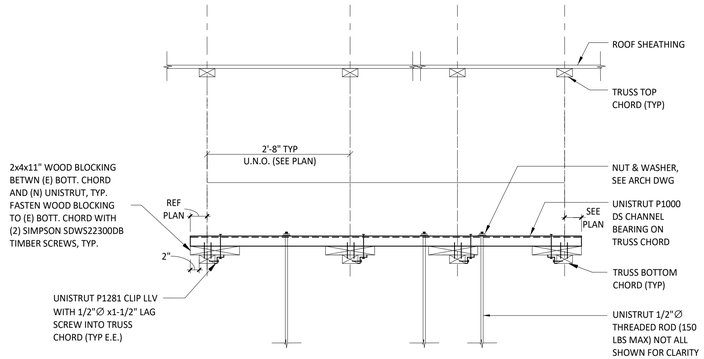

9 S300 KITCHEN HOOD SUPPORT DETAIL
3/4" = 1'-0"

Consultant:

GF

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700


Drawn: SB
Checked: JK

Project No.
20210067.0

Contents:


ROOF FRAMING
SECTIONS & DETAILS

S300

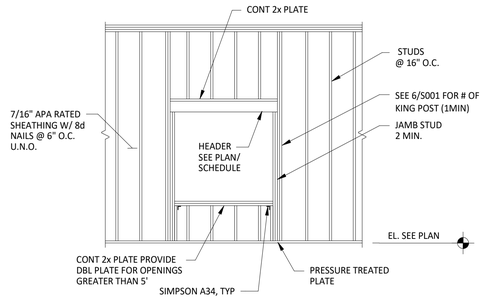


1/S301 TYPICAL WALL AND OPENING CONSTRUCTION

3/4" = 1'-0"

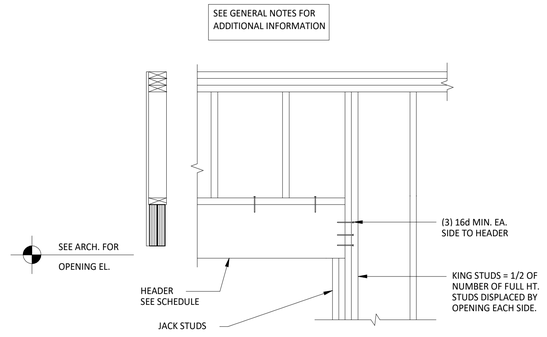


2/S301 TYPICAL WOOD HEADER CONSTRUCTION

3/4" = 1'-0"

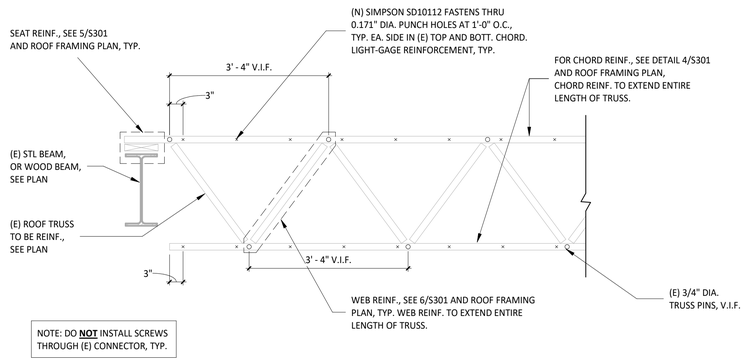


3/S301 TYPICAL TRUSS REINF. ELEVATION

N.T.S.

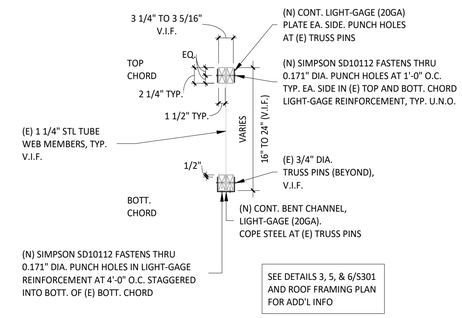


4/S301 REINF. FOR TOP & BOTT CHORD

3/4" = 1'-0"

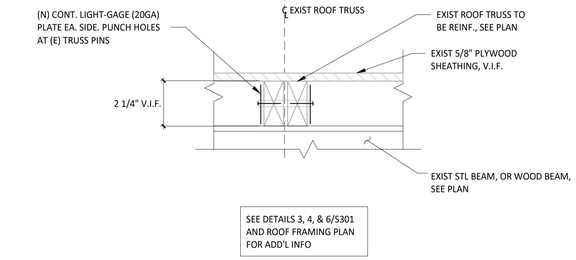

5/S301 TRUSS SEAT REINF. DETAIL

3/4" = 1'-0"

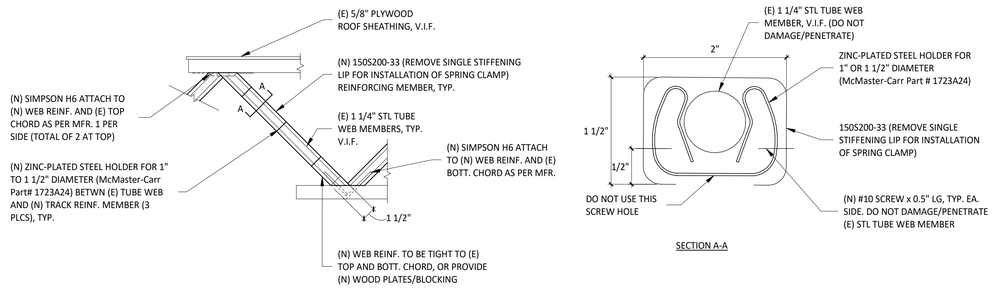

6/S301 CRIMPED WEB REINFORCMENT

3/4" = 1'-0"

Consultant:

GF

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700

Drawn: SB
Checked: JK


Project No.

20210067.0

Contents:

SECTIONS AND
DETAILS


S301

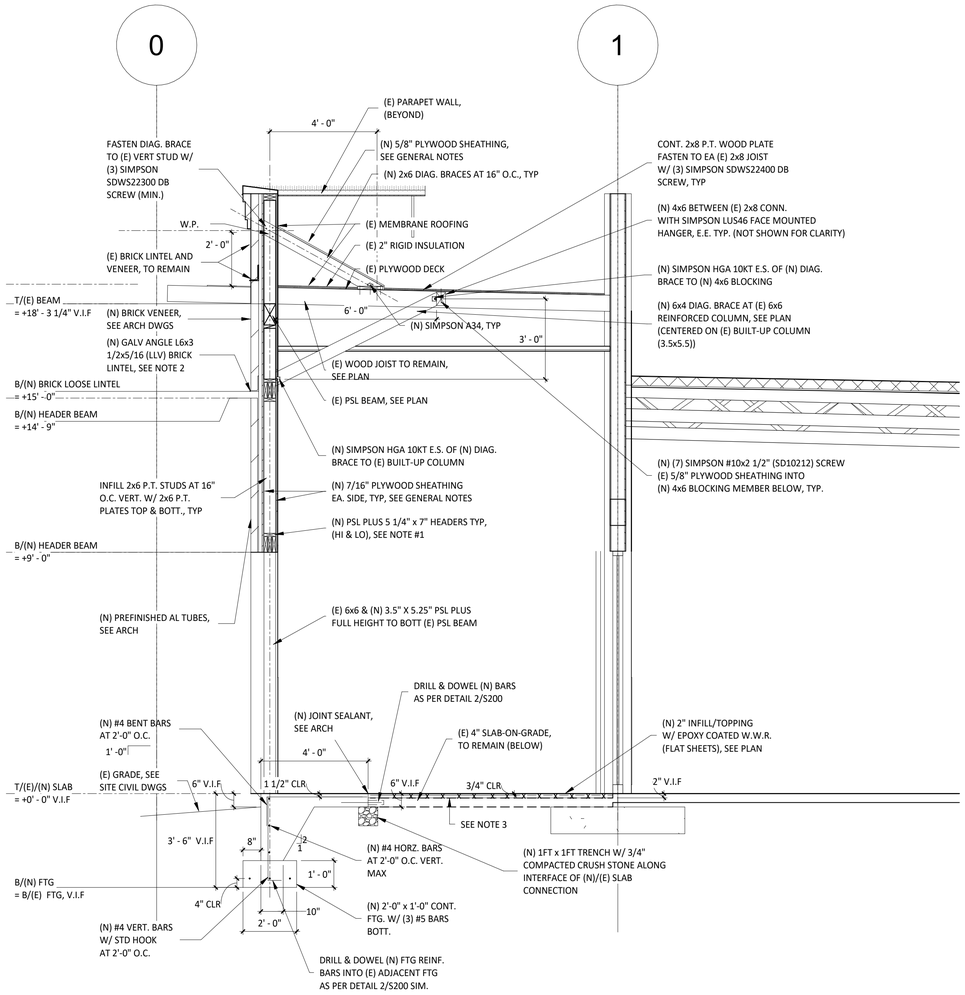

NOTES:
1. ALT. HEADER TO PSL PLUS - (3) 2x12 P.T. + (2) 1/2" PLYWOOD, SEE DETAILS, 1 & 2/S301. CONNECT TO (N)/(E) WOOD POST W/ SIMPSON HH6 EA. SIDE. PROVIDE 1/4" SHIM FOR PSL PLUS MEMBERS.
2. MINIMUM BEARING 8" ON (E) BRICK LINTEL. LINTEL IS DESIGNED TO CARRY BRICK OR LIGHTER WALL CONSTRUCTION ONLY. LINTELS ARE NOT DESIGNED TO CARRY ANY ROOF LOAD. WHERE UNEQUAL ANGLE IS USED, PLACE LONG LEG VERTICAL. ALL EXTERIOR LINTELS TO BE GALVANIZED. SEE DETAIL 3/S300 FOR ADD'L INFO.
3. ROUGHEN SURFACE OF (E) SLAB TO REMAIN. PROVIDE BONDING AGENT BETWEEN (N)/(E) CONCRETE SLABS, SEE DETAIL 2/S200 SIM., TYP.

1 S400 WALL SECTION AT PLAYGROUND

3/8" = 1'-0"

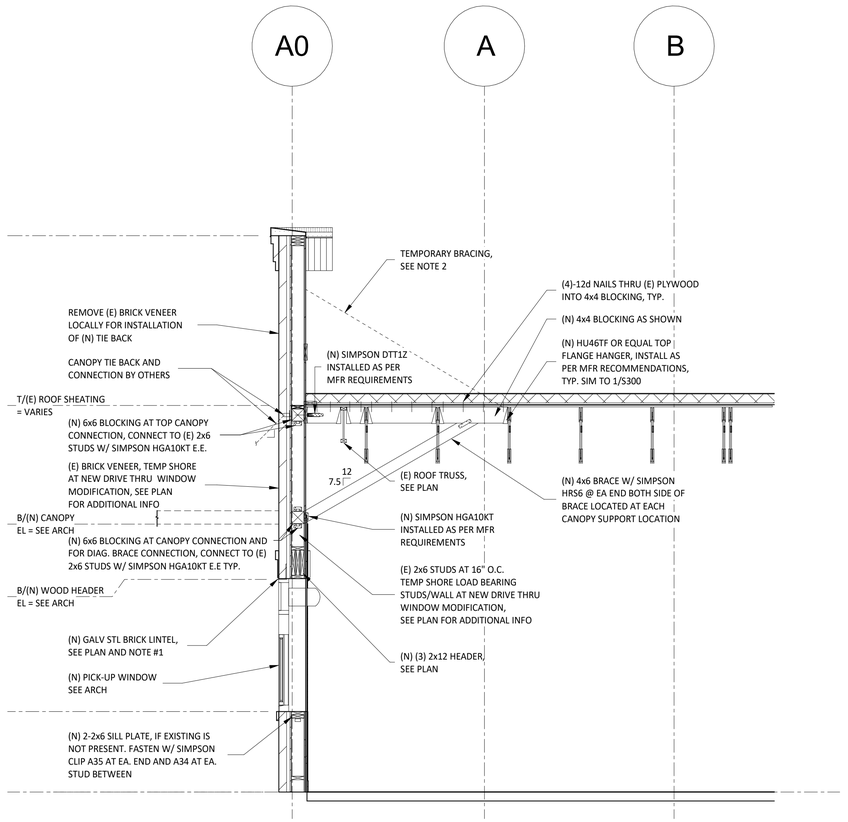

NOTES:
1. MINIMUM BEARING 8" ON (E) BRICK, EA END TYP. LINTEL IS DESIGNED TO CARRY BRICK OR LIGHTER WALL CONSTRUCTION ONLY. LINTELS ARE NOT DESIGNED TO CARRY ANY ROOF LOAD. WHERE UNEQUAL ANGLE IS USED, PLACE LONG LEG VERTICAL. ALL EXTERIOR LINTELS TO BE GALVANIZED. SEE DETAIL 3/S300 FOR ADD'L INFO.
2. GC TO PROVIDE TEMPORARY BRACING AT (E) PARAPET WALL, PRIOR TO REMOVAL OF (E) HEADER OR BRICK LINTEL BELOW TO LIMIT ROTATATION/MOVEMENT, SEE DEMO DWGS.

2 S400 WALL SECTION AT DRIVE THRU WINDOW

3/8" = 1'-0"

Consultant:

92 East Main Street, Suite 410
Somerville, New Jersey 08876
t: 732.537.0811

COPYRIGHT 2019
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2482
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD,
HAMILTON TOWNSHIP NJ
08609

Issue Record:

REV.	DATE	DESCRIPTION
	06/09/23	LL SET
	07/14/23	PERMIT SET
2	02/16/24	BID SET
3	03/25/24	CONSTRUCTION SET

Professional Seal

JASON W. KOFFKE
Professional Engineer
License No. 24GE05548200
Greenberg Farrow C.O.A. No. 24GA28079700

Drawn: SB
Checked: JK

Project No.

20210067.0

Contents:

WALL SECTIONS AND DETAILS

S400

ELECTRICAL SPECIFICATIONS

SECTION 16011 TEMPORARY & PERMANENT ELECTRICAL SERVICE
PART 1 GENERAL
1.1 RELATED DOCUMENTS
A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
1.2 SUMMARY
A. This section includes temporary lighting and power with luminaries, panelboards, circuit breakers. and enclosures.
B. Related sections include the following:
1. Division 16 Section "Grounding",
2. Division 16 Section "Wiring Devices"
3. Division 16 Section "Circuit Breakers"
4. Division 16 Section "Panel boards"
1.3 DEFINITIONS
A. GFCI: Ground fault current interruptor.
B. RMS: Root Mean Square
C. SPDT: Single Pole, Double Throw
1.4 USE CHARGES
A. General: Cost or use charges for temporary facilities are not chargeable to Owner, Architect, or Engineer and shall be included in the Contract Sum. Allow other entities to use temporary services and facilities without cost, including, but not limited to, the following:
1. Owner's construction forces.
2. Occupants of Project.
3. Architect.
4. Engineer.
5. Testing agencies.
6. Personnel of authorities having jurisdiction.
B. Permanent Service: Coordinate with building owner and utility company to establish permanent service upon completion of the project. Contractor shall pay for all permits, aid-to-construction charges, and related fees associated with the new service.
1.5 NOTIFICATION
A. Coordinate with owner to provide 72 hour written notification to other tenants of any power interruptions. Notification shall state the estimated time and duration of the electrical outage.
1.6 QUALITY ASSURANCE
A. Standards: Comply with ANSI A10.6, NECA's 'Temporary Electrical Facilities," and NFPA 241.
1. Trade Jurisdictions: Assigned responsibilities for installation and operation of temporary utilities are not intended to interfere with trade regulations and union jurisdictions.
2. Electric Service; Comply with NECA, NEMA and UL standards and regulations for temporary electric service. Install service to comply with NFPA 70.
3. Comply with OSHA standards and regulations.
PART 2 PRODUCTS
2.1 MATERIALS
A. Electrical Outlets: Properly configured, NEMA-polarized outlets to prevent insertion of 110- to 120-V plugs into higher-voltage outlets; equipped with ground-fault circuit interrupters, reset button, and pilot light.
B. Power Distribution System Circuits: Where permitted and overhead and exposed for surveillance, wiring circuits, not exceeding 125-V ac, 20-A rating, and lighting circuits may be nonmetallic sheathed cable.
C. Main panelboard with disconnect.
D. Temporary lighting.
E. 120 volt receptacles with overcurrent protection.
F. Enclosures. NEMA AB 1 and NEMA KS 1 to meet environmental conditions of installed location.
1. Outdoor Locations: NEMA 250, Type 3R.
PART 3 EXECUTION
3.1 INSTALLATION
A. Electric Power Service: Provide weatherproof, grounded electric power service and distribution system of sufficient size, capacity, and power characteristics during construction period. Include meters, transformers, and overload-protected disconnecting means.
1. Install power distribution wiring overhead and rise vertically where least exposed to damage.
B. Electric Distribution: Provide receptacle outlets adequate for connection of power tools and equipment.
1. Provide waterproof connectors to connect separate lengths of electrical power cords if single lengths will not reach areas where construction activities are in progress. Do not exceed safe length-voltage ratio.
2. Provide metal conduit, tubing, or metallic cable for wiring exposed to possible damage. Provide rigid steel conduits for wiring exposed on grades, floors, decks, or other traffic areas.
3. Provide metal conduit enclosures or boxes for wiring devices.
4. Provide 4-gang outlets, spaced so 1 DO-foot (30-m) extension cord can reach each area for power hand tools and task lighting. Provide a separate 125-V ac, 20-A circuit for each outlet.
C. Lighting: Provide temporary lighting with local switching that provides adequate illumination for construction operations and traffic conditions.
1. Install and operate temporary lighting that fulfills security and protection requirements without operating entire system.
2. Provide one 100-W incandescent lamp every 50 feet (15 m) in traffic areas.
3. Install exterior-yard site lighting that will provide adequate illumination for construction operations, parking and traffic conditions, and signage visibility when the Work is being performed.
4. Install lighting for Project identification sign.
END OF SECTION 16011

SECTION 16060 - GROUNDING AND BONDING
PART 1 - GENERAL
1.1 SUMMARY
A. This Section includes grounding of electrical systems and equipment. Grounding requirements specified in this Section may be supplemented by special requirements of systems described in other Sections.
1.2 QUALITY ASSURANCE
A. Testing Agency Qualifications: Testing agency as defined by OSHA in 29 CFR 1910.7 or a member company of the International Electrical Testing Association and that is acceptable to authorities having jurisdiction.
1. Testing Agency's Field Supervisor: Person currently certified by the International Electrical Testing Association to supervise on-site testing specified in Part 3.
B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
1. Comply with UL 467.
PART 2 - PRODUCTS
2.1 GROUNDING CONDUCTORS
A. For insulated conductors, comply with Division 16 Section "Wiring Methods."
B. Material: Copper.
C. Equipment Grounding Conductors: Insulated with green-colored insulation.
D. Grounding Electrode Conductors: Stranded cable.
E. Bare Copper Conductors: Comply with the following:
1. Solid Conductors: ASTM B 3.
2. Assembly of Stranded Conductors: ASTM B 8.
2.2 CONNECTOR PRODUCTS
A. Comply with IEEE 837 and UL 467; listed for use for specific types, sizes, and combinations of conductors and connected items.
PART 3 - EXECUTION
3.1 APPLICATION
A. Use only copper conductors.
B. In raceways, use insulated equipment grounding conductors.
C. Equipment Grounding Conductor Terminations: Use bolted pressure clamps.
D. Grounding Bus: Install in electrical and telephone equipment rooms, in rooms housing service equipment, and elsewhere as indicated.
1. Use insulated spacer; space 1 inch from wall and support from wall 6 inches above finished floor, unless otherwise indicated.
2. At doors, route the bus up to the top of the door frame, across the top of the doorway, and down to the specified height above the floor.
3.2 EQUIPMENT GROUNDING CONDUCTORS
A. Comply with NFPA 70, Article 250, for types, sizes, and quantities of equipment grounding conductors, unless specific types, larger sizes, or more conductors than required by NFPA 70 are indicated.
3.3 INSTALLATION
A. Grounding Conductors: Route along shortest and straightest paths possible, unless otherwise indicated. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.
3.4 CONNECTIONS
A. General: Make connections so galvanic action or electrolysis possibility is minimized. Select connectors, connection hardware, conductors, and connection methods so metals in direct contact will be galvanically compatible.
B. Equipment Grounding Conductor Terminations: For No. 8 AWG and larger, use pressure-type grounding lugs. No. 10 AWG and smaller grounding conductors may be terminated with winged pressure-type connectors.
C. Tighten screws and bolts for grounding and bonding connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A.
D. Compression-Type Connections: Use hydraulic compression tools to provide correct circumferential pressure for compression connectors. Use tools and dies recommended by connector manufacturer. Provide embossing die code or other standard method to make a visible indication that a connector has been adequately compressed on grounding conductor.
END OF SECTION 16060

SECTION 16100 - WIRING METHODS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Summary: Building wire and cable and associated splices, connectors, and terminations for wiring systems rated 600 V and less, and twisted-pair cable; and raceways and boxes.
PART 2 - PRODUCTS
2.1 WIRES AND CABLES
A. Connectors and Splices: Wiring connectors of size, ampacity rating, material, and type and class for application and for service indicated.
2.2 RACEWAYS
A. Wireways: Screwed cover type, with manufacturers standard finish.
B. Outlet and Device Boxes: Sheet metal boxes, except use cast-metal boxes at exterior, interior exposed, and interior damp locations.
C. Pull and Junction Boxes: Sheet metal boxes, except use nonmetallic boxes with gasketed covers at exterior and interior damp locations.
2.3 ENCLOSURES
A. Hinged-Cover Enclosures: NEMA 250, steel enclosure with continuous hinge cover and flush latch. Finish inside and out with manufacturer's standard enamel.
B. Cabinets: NEMA 250, Type 1, unless otherwise indicated.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install wires and cables according to the NECA's "Standard of Installation.
B. Wiring at Outlets: Install with at least 12 inches of slack conductor at each outlet.
C. Conceal wiring, unless otherwise indicated, within finished walls, ceilings, and floors.
D. Boxes and Enclosures: In damp or wet locations use NEMA 250, Type 4, stainless steel.
E. Use raceway fittings compatible with raceway and suitable for use and location. For intermediate steel conduit, use threaded rigid steel conduit fittings, unless otherwise indicated.
F. Raceways Embedded in Slabs: Install in middle third of the slab thickness where practical, and leave at least 1 -inch concrete cover.
G. Install exposed raceways parallel to or at right angles to nearby surfaces or structural members, and follow the surface contours as much as practical.
H. Join raceways with fittings designed and approved for the purpose and make joints tight. Use bonding bushings or wedges at connections subject to vibration. Use bonding jumpers where joints cannot be made tight. Use insulating bushings to protect conductors.
I. Install pull wires in empty raceways. Use No. 14 AWG zinc-coated steel or monofilament plastic line having not less than 200-lb tensile strength. Leave not less than 18 inches of slack at each end of the pull wire.
J. Install raceway sealing fittings where required by the NEC and at wiring entrances to refrigerated spaces. Locate at suitable, approved, accessible locations and fill them with UL-listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces.
K. Stub-up Connections for Equipment: Extend conductors to equipment with intermediate metal conduit; flexible metal conduit may be used 6 inches above the floor.
L. Install a separate green ground conductor in surface metal raceway from the junction box supplying the raceway to receptacle and fixture ground terminals.
3.2 IDENTIFICATION MATERIALS AND DEVICES
A. Install at locations for most convenient viewing without interference with operation and maintenance of equipment.
B. Coordinate names, abbreviations, colors, and other designations used for electrical identification with corresponding designations indicated in the Contract Documents or required by codes and standards. Use consistent designations throughout Project.
C. Identify raceways and cables with color banding as follows:
1. Bands: Pretensioned, snap-around, colored plastic sleeves or colored encircling conduit, and place adjacent bands of two-color markings in contact, side by side.
2. Band Locations: At changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.
3. Colors: As follows:
a. Telecommunication System: Green and yellow.
D. Color-code System secondary service, feeder, and branch-circuit conductors throughout the secondary electrical system as follows:
120/208V
1. Phase A: Black
2. Phase B: Red
3. Phase C: Blue
4. Neutral: White
5. Ground: Green
END OF SECTION 16100

SECTION 16140 - WIRING DEVICES
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Comply with NEMA WD 1.
C. Comply with NFPA 70.
PART 2 - PRODUCTS
2.1 DEVICES
A. General: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction.
B. Color: Per Material Schedule on sheet E010.
C. Receptacles: Heavy- Duty grade, NEMA WD6, Configuration 5-20R unless otherwise indicated.
D. Ground-Fault Circuit Interrupter Receptacles: integral duplex receptacle; for installation in box without an adapter. Feed-through type, with a 2-3/4-inch- deep outlet
E. Isolated-Ground Receptacles: to the green grounding screw isolation from mounting strap. Equipment grounding contacts connected only terminal of the device with inherent electrical
F. Snap Switches: Heavy-duty, quiet type.
G. Wall Plate: Per Material Schedule on sheet E010.
H. Floor Service Fittings: Modular, above-floor, dual-service units suitable for wiring method used.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install devices and assemblies plumb and secure.
B. Mount devices flush, with long dimension vertical, of receptacles on top unless otherwise indicated. under single, multigang wall plates.
C. Protect devices and assemblies during painting.
D. Install wall plates when painting is complete.
END OF SECTION 16140

SECTION 16410 - ENCLOSED SWITCHES AND CIRCUIT BREAKERS
PART 1 GENERAL (Not Applicable)
PART 2 PRODUCTS
2.1 SWITCHES
A. Enclosed, Nonfusible Switch: NEMA KS 1, Type HD, with lockable handle.
2.2 CIRCUIT BREAKERS
B. Enclosed, Molded-Case Circuit Breaker: NEMA AB 1, with thermal-magnetic trip unless otherwise indicated.
1. Characteristics: Frame size, trip rating, number of poles, and auxiliary devices as indicated.
2. Interrupting Rating: PER DRAWINGS
3. Thermal-Magnetic Circuit Breakers, 225 A and Larger: Trip units fixed
4. Current-Limiting Trips: Let-through ratings less than NEMA FU 1, Class RK-5.
5. Enclosure: NEMA AB 1, Type 1, unless otherwise specified or required to meet environmental conditions of installed location.
PART 3 - EXECUTION
3.1 TESTING
C. Perform visual and mechanical inspections and electrical tests stated in NETA ATS.
END OF SECTION 16410

SECTION 16442 - PANELBOARDS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Comply with NFPA 70.
C. Comply with NEMA PB 1.
PART 2 - PRODUCTS
2.1 PANELBOARDS AND LOAD CENTERS
A. A. Manufacturers: Subject to compliance with requirement, provide products by one of the following:
1. Panelboards, Overcurrent Protective Devices, Controllers, Contactors, and Accessories:
a. Square D Co.
b. Eaton Corp.; Cutler-Hammer Products.
c. General Electric Co.; Electrical Distribution & Control Div.
d. Siemens Energy & Automation.
B. Recessed, NEMA PB 1, Type 1.
1. Load Center Capacity: as shown on drawings.
2. Front: Secured to box with concealed trim clamps.
3. Doors: With concealed hinges, flush catches, and tumbler locks, all keyed alike.
4. Bus: Hard drawn copper of 98 percent conductivity.
C. Molded-Case Circuit Breakers: NEMA AB 1, plug-in type, Single-handle for multipole circuit breakers. Appropriate for application, including Type SWD for repetitive switching lighting loads and Type HACR for heating, air-conditioning, and refrigerating equipment.
D. Contactors: NEMA ICS 2, Class A combination contactors.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install panelboards and accessory items according to NEMA PB 1.1. Indicate installed circuit loads in English and Spanish on a typed circuit directory after balancing panelboard loads.
B. Mounting Heights: Top of trim 74 inches above finished floor, unless otherwise indicated.
C. Future Circuit Provisions at Flush Panel boards: Stub four empty 3/4-inch conduits from panelboard into accessible or designated ceiling space.
D. Wiring in Panelboard Gutters: Arrange conductors into groups, bundle and wrap with wire ties according to NEC guidelines.
E. Tighten electrical connectors and terminals, including grounding connections, according to manufacturer's published torque-tightening values. Where manufacturer's torque values are not indicated, use those specified in UL 486A.
F. Perform visual and mechanical inspections and electrical tests stated In NETA ATS.
END OF SECTION 16442

SECTION 16500 - LIGHTING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals:
B. Fixtures, Emergency Lighting Units, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction.
C. Coordinate ceiling-mounted luminaires with ceiling construction, mechanical work, and security and fire-prevention features mounted In ceiling space and on ceiling.
PART 2 - PRODUCTS
2.1 FIXTURES AND FIXTURE COMPONENTS, GENERAL
A. Metal Parts: Free from burrs, sharp corners, and edges. Steel, unless otherwise indicated. Form and support to prevent warping and sagging.
B. Doors, Frames, and Other Internal Access: Smooth operating, free from light leakage under operating conditions, and arranged to permit re-lamping without use of tools. Arrange doors, frames, lenses, diffusers, and other pieces to prevent accidental falling during re-lamping and when secured in operating position.
C. Lenses, Diffusers, Covers, and Globes: 100 percent virgin acrylic plastic or annealed crystal glass, unless otherwise indicated.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Set units level, plumb, and square with ceiling and walls, and secure.
B. Support for Recessed and Semirecessed Grid-Type Fixtures: Install ceiling support system rods or wires at a minimum of 4 rods or wires for each fixture, located not more than 6 inches from fixture corners.
C. Support for Suspended Fixtures: Support according to manufacturers' recommendations.
D. Lamping: Where specific lamp designations are not indicated, lamp units according to manufacturer's written instructions.
END OF SECTION 16500

ELECTRICAL ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
C	CONDUIT
(E)/EXT'G	EXISTING
G	GROUND
GFCI	GROUND FAULT CURRENT INTERRUPTER
IG	ISOLATED GROUND
JB	JUNCTION BOX
NL	NIGHT LIGHT
S	SURFACE MOUNTED
UNO	UNLESS NOTED OTHERWISE
WP	WEATHERPROOF

SUPPLIER/VENDOR ABBREVIATIONS

CO2AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
LL	LANDLORD
MSS	TENANT'S MUSIC SYSTEM SUPPLIER
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST & BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TPS	TENANT'S PANELBOARD SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SANITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

ELECTRICAL SYMBOLS

- CONDUIT CONCEALED ABOVE THE CEILING, IN A WALL, OR IN A RACEWAY
- CONDUIT CONCEALED BELOW THE SLAB
- A-6 — HOME-RUN TO PANELBOARD AND CIRCUIT NUMBER SHOWN
- # — PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
- X/Y/Z — DISCONNECT SWITCH: X = SWITCH RATING; Y = FUSE SIZE (NF = NON-FUSED); Z = NUMBER OF POLES
- J — JUNCTION BOX
- ELECTRIC PANELBOARD
- $ — GENERAL PURPOSE 1-POLE SWITCH
- $ M — MANUAL STARTER WITH PILOT LIGHT
- $ WP — WEATHER-PROOF SWITCH
- $ D — WALL MOUNTED DIMMER SWITCH
- $ OC — OCCUPANCY SENSOR ACTIVATED WALL SWITCH
- NEMA 5-20R 1-PLEX RECEPTACLE
- NEMA 5-20R DUPLEX RECEPTACLE
- NEMA 5-20R DOUBLE-DUPLEX RECEPTACLES
- IG/GFI — NEMA 5-20R DUPLEX COMBINATION ISOLATED GROUND/GFI RECEPTACLE PASS & SEYMOUR MODEL#2095IGTRGRY(GRAY)
- OTHER RECEPTACLE - SEE PLAN FOR RATING AND TYPE
- JUNCTION BOX FOR RJ-45 DATA OUTLETS. PROVIDE 1" CONDUIT WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- DOUBLE GANG JUNCTION BOX FOR RJ-45 DATA OUTLETS. PROVIDE 1" CONDUITS WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- JUNCTION BOX FOR RJ-11 TELEPHONE OUTLETS. PROVIDE 1" CONDUIT WITH PULL STRING FROM J-BOX TO ABOVE OFFICE CEILING. TERMINATE CONDUIT WITH CONDUIT BUSHING.
- KP — SECURITY SYSTEM KEYPAD: SEE ELECTRICAL POWER PLAN FOR MORE INFORMATION. (3)
- CO — CARBON MONOXIDE DETECTOR

MATERIAL SCHEDULE

CATEGORY	APPLICATION	ALLOWABLE MATERIALS
CONDUCTORS	#10 AWG AND SMALLER	SOLID CU. TYPE THHN/THWN OR XHHW
	#8 AWG AND LARGER	STRANDED CU, TYPE THHN/THWN OR XHHW
	FIELD-MADE CORD (EXPOSED INDOOR LOCATIONS)	TYPE SO OR SJO SERVICE CORD WITH CU CONDUCTORS
CONDUIT	OUTDOOR, EXPOSED OR CONCEALED	INTERMEDIATE METAL CONDUIT
	CONNECTION TO VIBRATING EQUIPMENT, EXPOSED WET OR DAMP LOCATIONS	LIQUIDTIGHT FLEXIBLE METAL CONDUIT
	INDOOR, EXPOSED	ELECTRICAL METALLIC TUBING U.N.O.
	INDOOR, WITHIN 1-1/2" OF ROOF DECK	INTERMEDIATE METAL CONDUIT
	INDOOR, CONCEALED ABOVE GRADE	ELECTRICAL METALLIC TUBING, FLEXIBLE METAL CONDUIT, OR METAL CLAD CABLE
	CONNECTION TO VIBRATING EQUIPMENT (EXPOSED INDOOR DRY LOCATIONS)	FLEXIBLE METAL CONDUIT
	LOW VOLTAGE, INDOOR ABOVE GRADE	ELECTRICAL METALLIC TUBING
	LOW OR LINE VOLTAGE, BELOW GRADE	RIGID NONMETALLIC CONDUIT (PVC SCH. 40)
WIRING DEVICES	IN KITCHEN, OFFICE, OR NON-PUBLIC SPACES	GRAY DEVICE WITH STAINLESS STEEL COVER PLATE
	ON DRYWALL IN DINING ROOM	WHITE DEVICE WITH WHITE COVER PLATE
	ON RICHLITE, HOT ROLLED STEEL, OR OTHER BLACK FINISHES	BLACK DEVICE WITH BLACK COVER PLATE
	IN RESTROOMS	WHITE DEVICE WITH WHITE COVER PLATE
	IG OR IG/GFCI RECEPTACLES	GRAY DEVICE WITH STAINLESS STEEL COVER PLATE

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ 08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER: 21008

SHEET TITLE: ELECTRICAL SPECIFICATIONS

SHEET NUMBER: E-010

2024-DB#2/P#1-2

GENERAL LIGHTING NOTES:

A. ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH 2020 NATIONAL ELECTRICAL CODE WITH LOCAL AMENDMENT AND IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION. SEE SHEET G-001 FOR THE PREVAILING CODES.

B. WIRING SHALL BE TWO #12, #12 GROUND IN 3/4" CONDUIT UNLESS NOTED OTHERWISE.

C. INDIVIDUAL CONDUIT HOME RUNS SHOWN SHALL NOT BE CONSOLIDATED.

D. INSTALL WALL SWITCHES AT 48" AFF TO CENTER OF SWITCH AND RECEPTACLES AT 18" AFF TO CENTER OF RECEPTACLE UNLESS NOTED OTHERWISE.

E. INSTALL CONDUIT CONCEALED ABOVE THE CEILING, IN WALLS, OR IN RACEWAYS.

F. ALL EXPOSED CONDUITS SHALL BE INSTALLED 1/2" FROM THE WALL.

G. ANY EXISTING CONDITIONS INDICATED ARE BASED ON INFORMATION PROVIDED BY OTHERS AND POSSIBLE LIMITED FIELD VERIFICATION. THE CONTRACTOR SHALL ADJUST FOR ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE OWNER.

H. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, REVIEW EXISTING CONDITIONS AGAINST THE PLANS, AND FAMILIARIZE HIMSELF WITH THE WORK PRIOR TO BIDDING AND START OF THE WORK.

I. THE CONTRACTOR IS RESPONSIBLE FOR DEMOLITION OF EXISTING EQUIPMENT, DEVICES, AND LUMINAIRES AS INDICATED AND/OR AS REQUIRED TO ALLOW FOR INSTALLATION AND CONSTRUCTION OF THE NEW WORK. REMOVE ALL EQUIPMENT, DEVICES, LUMINAIRES, CONDUITS, SUPPORTS, HANGERS, ETC. THAT ARE NOT SHOWN AND ARE REQUIRED TO BE REMOVED IN ORDER TO COMPLETE THE NEW WORK.

J. RECESSED BOXES AND CONDUITS CONCEALED WITHIN WALLS OR FLOORS THAT ARE TO REMAIN ARE PERMITTED TO BE ABANDONED IN PLACE ONLY IF THE OPENINGS ARE PATCHED AND THE CONDUCTORS ARE REMOVED.

K. THE OWNER SHALL HAVE FIRST SALVAGE RIGHT ON ALL DEMOLISHED EQUIPMENT, DEVICES, LUMINAIRES, AND MATERIALS. THE CONTRACTOR SHALL DISPOSE OF ALL DEMOLISHED EQUIPMENT, DEVICES, LUMINAIRES, AND MATERIALS THE OWNER REJECTS.

L. MAINTAIN CONTINUITY OF EXISTING CIRCUITS AS REQUIRED TO PROVIDE POWER TO REMAINING EQUIPMENT, DEVICES, AND LUMINAIRES THAT ARE NOT BEING REMOVED.

M. SEE PANEL SCHEDULES FOR INFORMATION ON CIRCUITS THAT ARE TO BE ROUTED THROUGH CONTACTORS OR RELAYS FOR CONTROL.


N. LUMINAIRES MARKED "EX" ARE EXISTING LUMINAIRES THAT ARE TO REMAIN IN PLACE. ALL EXISTING LUMINAIRES WITHIN THE LIMITS OF CONSTRUCTION SHALL BE REPAIRED TO A LIKE-NEW CONDITION, THOROUGHLY CLEANED, AND RELAMPED. ANY EXISTING LUMINAIRES THAT ARE DAMAGED BEYOND REPAIR SHALL BE REPLACED WITH AN IDENTICAL LUMINAIRE.

O. PROVIDE LABELING CALLED FOR IN THE ELECTRICAL PLANS USING ENGRAVED PHENOLIC PLATES (WHITE WITH BLACK LETTERING) ON WALL IMMEDIATLEY ABOVE RECEPTACLES.

P. THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.

Q. CIRCUIT EMERGENCY LIGHTS, ILLUMINATED EXIT SIGNS AND NIGHTLIGHTS AHEAD OF LOCAL SWITCHES.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
1	INSTALL WALL MOUNTED LIGHTING OVERRIDE SWITCH AND CONNECT TO LCP. SEE SHEET E-101.
2	CONNECT TO RELAY CIRCUIT INDICATED NEXT TO THE FIXTURE TAG THROUGH THE LIGHTING CONTROL PANEL (LCP) UNLESS NOTED OTHERWISE.
3	WALL MOUNT THE EMERGENCY LIGHT FIXTURE AT 6" BELOW THE CEILING UNLESS NOTED OTHERWISE.
4	VERIFY MOUNTING HEIGHT OF EXIT SIGN PRIOR TO ROUGH IN. EXIT SIGN MUST BE VISIBLE FROM AREA SERVED AFTER BUILDING SYSTEMS HAVE BEEN INSTALLED. SEE ARCHITECTURAL ELEVATIONS FOR FURTHER INFORMATION.
5	INSTALL LED DRIVERS FURNISHED WITH THE X9 LED STRIP LIGHTS ON THE WALL 6" ABOVE THE CEILING IN AN ACCESSIBLE LOCATION. PROVIDE LOW VOLTAGE WIRING FROM LED DRIVER TO THE X9 LIGHT FIXTURES AS SHOWN.
6	INSTALL LIGHT FIXTURES FURNISHED WITH THE WALK-IN COOLER. PROVIDE UNSWITCHED CONDUCTOR FROM LIGHTING CIRCUIT TO WALK-IN COOLER LIGHTING J-BOX AND FROM J-BOX TO LIGHT FIXTURES AS SHOWN. CONDUIT BETWEEN LIGHT FIXTURES SHALL BE ROUTED ON THE INTERIOR OF THE WALK-IN COOLER. SEAL INTERIOR AND EXTERIOR OF CONDUITS WHERE THEY PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.
7	PROVIDE UNISTRUT AS SHOWN ON THE ARCHITECTURAL RCP PER THE ARCHITECTURAL UNISTRUT DETAIL. TYPICAL.
8	CONNECT EXTERIOR LIGHTING CIRCUIT TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL PER DETAIL 1/E-101.
9	INSTALL WALL-MOUNTED OCCUPANCY SENSOR FURNISHED BY LIGHTING SUPPLIER AT 42"AFF. ADJUST OCCUPANCY SENSOR TO PROVIDE AUTOMATIC ON/AUTOMATIC OFF OPERATION WITH A FIXED TIME OF 30 MINUTES AND WITH BOTH THE PASSIVE INFRARED AND ULTRASONIC SENSORS ENABLED.
10	INSTALL WALL-MOUNTED DIMMERS ABOVE PANELBOARDS 6" ABOVE LAY-IN CEILING FOR CONTROL OF DINING ROOM OVERHEAD STRIP LED AND PENDANT LIGHTS. CONNECT DIMMERS TO RELAYS SHOWN THROUGH THE LIGHTING CONTROL PANEL. SET DIMMERS AT 50%.
11	CONNECT DINING ROOM (RELAY CIRCUITS R4 & R5) OVERHEAD STRIP LED LIGHTS TO THE RELAY INDICATED THROUGH THE CORRESPONDING WALL-MOUNTED DIMMER INSTALLED ABOVE THE PANELBOARDS.
12	INSTALL LIGHTING CONTROL SYSTEM PER DETAIL 1/E-101.
13	INSTALL CHIME/STROBE FURNISHED WITH VEHICLE DETECTION SYSTEM ON WALL 12" BELOW CEILING AND CONNECT TO VEHICLE DETECTOR SYSTEM PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

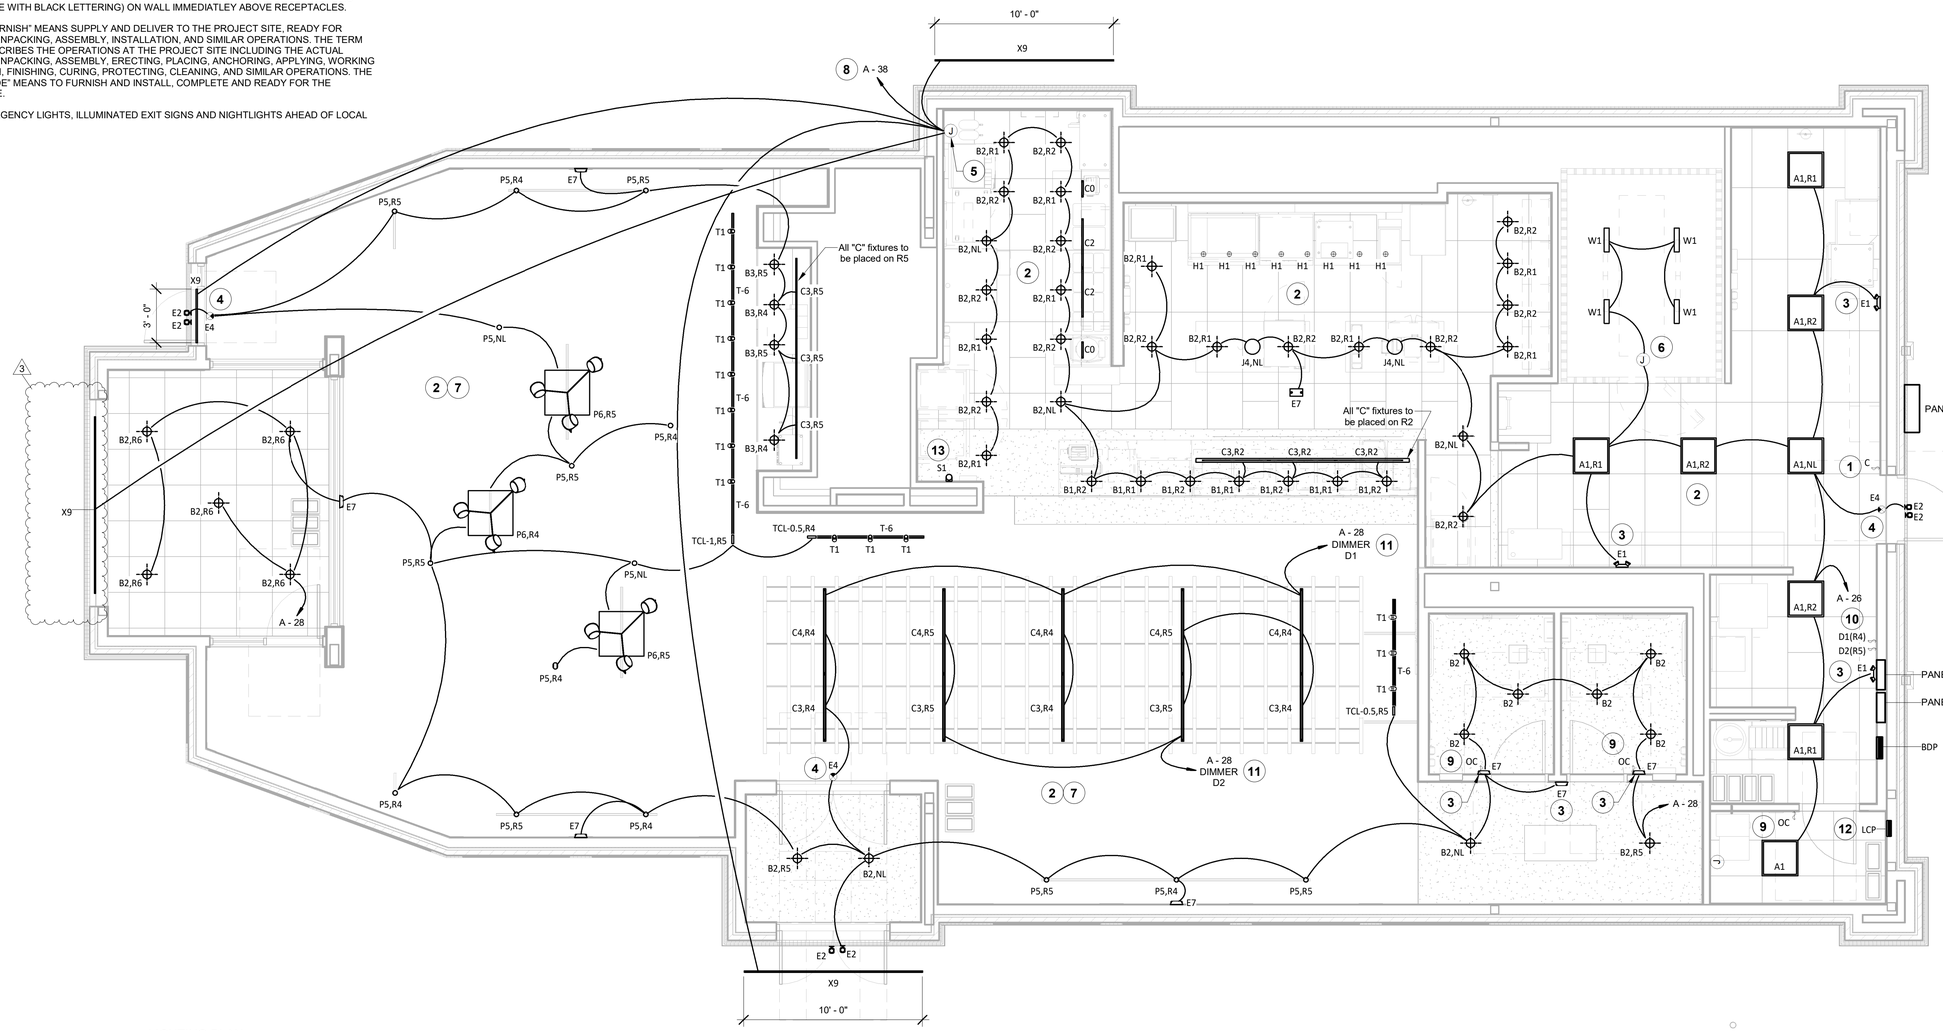

1 LIGHTING PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
1	02.02.2024	REVISION 1
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
LIGHTING PLAN

SHEET NUMBER:
E-100

LIGHTING FIXTURE SCHEDULE

TAG	COUNT	DESCRIPTION	MOUNTING	VOLTAGE	WATTS	BASIS FOR DESIGN			REMARKS
						MANUFACTURER	MODEL	LAMP	
A1	8	2x2 LED LENSED TROFFER	LAY-IN	120 V	30 W	NORA LIGHTING	NPDBL-E22/334 W	INTEGRAL 3000K LED	COMPATIBLE WITH 0-10V DIMMING, FACTORY LOCKED TO 3000K
B1	7	RECESSED 6IN CAN LIGHT	CEILING	120 V	17 W	NORA LIGHTING	NHIC-6G24ATFL W/ NTM-57W/M1 TRIM	(1) 17W ECOSTORY ECO-PAR38C-17-GU24-27K-25 D LED (25°-2700K) W/ GU 24 BASE	
B2	40	RECESSED 6IN CAN LIGHT W/ LED TRIM	CEILING	120 V	17 W	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC-65130WW LED TRIM	INTEGRAL 3000K LED	LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
B3	4	RECESSED 6IN CAN LIGHT W/ BLACK LED TRIM	CEILING	120 V	12 W	NORA LIGHTING	NHIC-6G24ATFL WITH NLCBC2-65127BB LED TRIM	INTEGRAL 3000K LED	BLACK LED TRIM FURNISHED WITH GU24 SOCKET ADAPTER
C0	2	LOW PROFILE LED - 1 FT	SURFACE	120 V	5 W	HERA LIGHTING	EL/LED/12/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C2	2	LOW PROFILE LED - 3 FT	SURFACE	120 V	12 W	HERA LIGHTING	EL/LED/34/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C3	11	LOW PROFILE LED - 4 FT	SURFACE	120 V	15 W	HERA LIGHTING	EL/LED/46/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
C4	5	LOW PROFILE LED - 5 FT	SURFACE	120 V	18 W	HERA LIGHTING	EL/LED/59/WW	INTEGRAL 3000K LED	FURNISHED WITH COVERS, CONNECTORS, AND ONE HARDWIRE BOX OR CORD/PLUG PER SECTION
E1	3	EMERGENCY LIGHT - DUAL HEAD	VARIOUS	120 V	2 W	EXITRONIX	LED-90	INTEGRAL LED	90 MINUTE BATTERY BACKUP
E2	6	EXTERIOR REMOTE EMERGENCY LIGHT	VARIOUS	4 V	1 W	EXITRONIX	MLED1-B-WP	INTEGRAL LED	LOW VOLTAGE REMOTE EMERGENCY LIGHT POWERED BY REMOTE-CAPABLE EXIT SIGN WITH MOUNTING PLATE
E4	3	WHITE EXIT SIGN WITH EMERGENCY LIGHT -STANDARD RED LETTERS	VARIOUS	120 V	2 W	EXITRONIX	CLED-U-WH	INTEGRAL LED	90 MINUTE BATTERY BACKUP WITH INTEGRAL EMERGENCY LIGHT, REMOTE HEAD CAPABLE
E7	8	EMERGENCY LIGHT	VARIOUS	120 V	2 W	EXITRONIX	EV2	INTEGRAL LED	90 MINUTE BATTERY BACKUP
H1	8	VAPOR PROOF HOOD LIGHT	SURFACE	120 V	15 W	FURNISHED W/ HOOD	FURNISHED W/ HOOD	(1) TCP L16A19N1527K	INSTALL LAMP FURNISHED SEPARATELY BY LIGHTING SUPPLIER
J4	2	DECORATIVE PENDANT	PENDANT	120 V	9 W	BARNLIGHT	BLE-C-CPT10-ASH-100-SBK-100-CAW	GREEN CREATIVE 9A19DIM/827/GU24/R	WITH BLACK LAMPSHADE, BLACK CORD, AND OAK LAMPHOLDER
P5	15	PENDANT	PENDANT	120 V	5 W	HI-LITE MFG	H-LC-91/CB12-91/20W LBL	TCP FG25D4027CCQ	ADJUST CORD LENGTH FOR MOUNTING HEIGHT CALLED FOR IN ARCHITECTURAL DRAWINGS
P6	3	DECORATIVE DINING ROOM PENDANT	PENDANT	120 V	30 W	BARNLIGHT	BLE-C-JGT-133-35630-3	INTEGRAL LED	HARDWIRED SET OF (3) AIM BLACK WITH MULTIPCANOPY AND 9M CABLES
S1	1	DRIVE-UP PICK-UP WINDOW CHIME/STROBE	WALL	16 V	0 W	FEDERAL SIGNAL	SLMS00B W/ SLMBW-012-024	INTEGRAL	SET SWITCH A TO "CHIME 1 SINGLE" (11011) AND SWITCH B TO "CHIME 2 SINGLE" (00111)
T1	14	TRACK HEAD	TRACK	120 V	10 W	JUNO	R605L 30K 90CRI PDIM WFL BL	INTEGRAL LED	BLACK CYLINDER TRACK HEAD W/ UNIVERSAL 120V TRAC ADAPTER AND WIDE FLOOD BEAM
T-6	5	TRACK (6 FT)	SURFACE	120 V	0 W	JUNO	T 6FT BL	N/A	SINGLE CIRCUIT, BLACK FINISH. FURNISH WITH CONNECTORS TO ACHIEVE ARRANGEMENT SHOWN ON PLANS. TRIM AS REQUIRED FOR LENGTHS SHOWN.
TCL-0.5	2	TRACK CURRENT LIMITER (60W)	SURFACE	120 V	0 W	JUNO	TCLFM11 BL W/ TCLCB 0.5A BLCK	N/A	BLACK CURRENT LIMITING END FEED WITH CIRCUIT BREAKER
TCL-1	1	TRACK CURRENT LIMITER (120W)	SURFACE	120 V	0 W	JUNO	TCLFM11 BL W/ TCLCB 1A BLCK	N/A	BLACK CURRENT LIMITING END FEED WITH CIRCUIT BREAKER
W1	4	WIC LED LIGHT	SURFACE	120 V	29 W	FURNISHED W/ WIC	FURNISHED W/ WIC	INTEGRAL LED	WET-RATED COOLER FIXTURE
X9	4	EXTERIOR LED CHANNEL LIGHT	SURFACE	120 V	4.5W/FT	PARADIGM LED	AMC-2410-S W/ OPAL LENS AND END CAPS	FLEXSR-45-30-67-24	FURNISHED W/ REMOTE-MOUNTED NEMA 3R LED DRIVER. SEE PLAN FOR LENGTHS.

LIGHTING FIXTURE SCHEDULE GENERAL NOTES

A. SEE THE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT LIGHT FIXTURE LOCATIONS.
B. SEE THE ARCHITECTURAL LIGHTING DETAILS FOR LIGHT FIXTURE CONSTRUCTION DETAILS.

LIGHTING CONTROL PANEL SCHEDULE: LCP


RELAY	PANEL	CIRCUIT	AREA SERVED	CONTROL	TIME ON	TIME OFF	DIMMER CONTROL	NOTES
R1	A	26	KITCHEN A	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R2	A	26	KITCHEN B	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R3			SPARE				N/A	SINGLE POLE (NC)
R4	A	28	DINING ROOM A	TIMECLOCK	10:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R5	A	28	DINING ROOM B	TIMECLOCK	10:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R6	A	28	EXTERIOR PATIO LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R7	A	22	RESTROOM EXHAUST FAN	TIMECLOCK	7:00:00 AM	12:00:00 AM	N/A	SINGLE POLE (NC)
R8			EXT. LIGHTING/SIGNAGE	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R9	A	36	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R10	A	37	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R11	A	39	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R12	A	40	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R13	A	41	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R14	A	42	EXTERIOR SITE LIGHTING	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R15			EXTERIOR PYLON SIGN	TIMECLOCK	SUNSET - 1 HR	12:00:00 AM	N/A	SINGLE POLE (NC)
R16			SPARE	TIMECLOCK			N/A	SINGLE POLE (NC)

LIGHTING CONTROL PANEL SCHEDULE NOTES

A. DUPLICATE PANEL SCHEDULE AND PERMANENTLY INSTALL WITHIN THE LIGHTING CONTROL PANEL.

LIGHTING CONTROL COMPONENTS SCHEDULE

	DESCRIPTION	QUANTITY	FURNISHED BY	INSTALLED BY	MANUFACTURER	MODEL	REMARKS
LCP	nLIGHT LIGHTING CONTROL PANEL	1	TLS	GC	ACUITY	ARP INTENC16 NLT 165PR MVOLT FM DTC	16 RELAY PANEL FOR ON/OFF CONTROL WITH FLUSH MOUNT ENCLOSURE, AND DIGITAL TIME CLOCK
$C	WALL-MOUNTED OVERRIDE SWITCH	1	TLS	GC	ACUITY	nPODMA 4P	SEE LIGHTING CONTROL DIAGRAM FOR SWITCH CONFIGURATION
$D	WALL-MOUNTED DIMMER SWITCH	2	TLS	GC	COOPER	SAL06P-W	SLIDE DIMMER COMPATIBLE WITH UP TO 300W LED LIGHTING. SET AT 50%. IF DINING ROOM LIGHTS FLICKER AT THIS DIMMER SETTING THEN GC SHALL PROVIDE LUTRON DVCL-253P DIMMER AS REPLACEMENT.
$OC	WALL-MOUNTED LINE VOLTAGE OCCUPANCY SENSOR	3	TLS	GC	HUBBELL	LHMTS 1-N-WH	WHITE DUAL TECHNOLOGY SINGLE RELAY WITH 1 BUTTON AND NEUTRAL WIRING

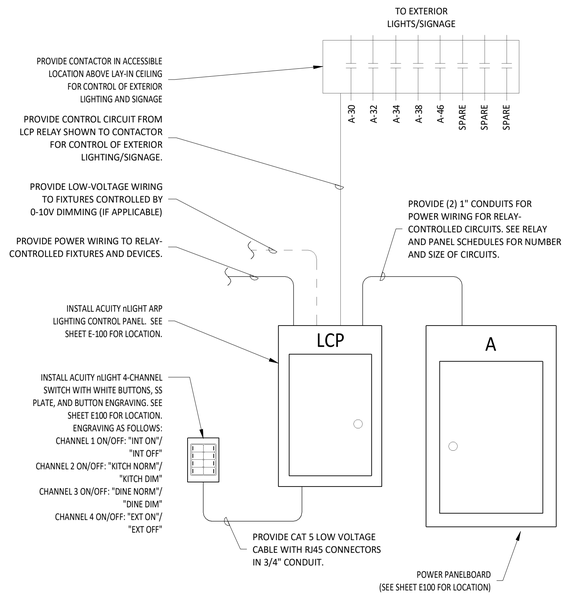

1 ELEC-LIGHTING CONTROL DIAGRAM
NOT TO SCALE

SEQUENCE OF OPERATIONS

A. EMERGENCY LIGHT FIXTURES, EXIT SIGNS, LOCALLY-SWITCHED FIXTURES, AND FIXTURES DESIGNATED AS NIGHT LIGHTS ARE NOT CONTROLLED THROUGH THE RELAY PANEL.
B. ALL TIMES NOTED SHALL BE LOCAL TIME AND SHALL AUTOMATICALLY ADJUST FOR DAYLIGHT SAVINGS TIME, IF APPLICABLE.
C. ALL KITCHEN LIGHTING CIRCUITS AND RESTROOM EXHAUST FAN CIRCUIT (R1, R2, R7) SHALL BE ENERGIZED FROM 7:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
D. ALL DINING ROOM LIGHTING CIRCUITS (R4 & R5) SHALL BE ENERGIZED FROM 10:00AM UNTIL MIDNIGHT AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
E. EXTERIOR LIGHTING/SIGNAGE RELAY (R8) SHALL BE ENERGIZED FROM ONE HOUR BEFORE SUNSET UNTIL ONE HOUR AFTER CLOSING AND SHALL BE DE-ENERGIZED AT OTHER TIMES.
F. OVERRIDES: WHEN ONE OF THE OVERRIDE BUTTONS IS PRESSED THE SYSTEM WILL GO INTO OVERRIDE MODE FOR THE DURATION NOTED BELOW OR UNTIL THE NEXT SCHEDULED EVENT. FOLLOWING THIS PERIOD THE RELAYS WILL RETURN TO THE CURRENT SCHEDULED CONDITON. DURING THIS OVERRIDE TIME THE CORRESPONDING LAMP WILL ILLUMINATE ON THE OVERRIDE BUTTON.
G. INTERIOR (CHANNEL 1): WHEN THE INTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 1) RELAYS R1, R2, R4, R5, AND R7 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
H. KITCHEN DIMMING (CHANNEL 2): WHEN THE KTICHEN NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 2) RELAYS R1 & R2 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
I. DINING DIMMING (CHANNEL 3): WHEN THE DINING NORMAL/DIM OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 3) RELAY R4 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
J. EXTERIOR (CHANNEL 4): WHEN THE EXTERIOR OVERRIDE ON OR OFF BUTTON IS PRESSED (CHANNEL 4) RELAY R8 WILL BE ENERGIZED OR DE-ENERGIZED FOR A DURATION OF ONE (1) HOUR.
K. VERIFY THAT TIME, TIME ZONE AND LONGITUDE/LATITUDE ARE SET CORRECTLY ON LCP. VERIFY WITH STORE OPERATIONS THAT THE ON/OFF TIMES ARE COMPATIBLE WITH THE STORE OPERATING HOURS PRIOR TO TURNOVER.

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ 08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
LIGHTING CONTROLS

SHEET NUMBER:
E-101

2024-DB#2/P#1-2

GENERAL POWER AND SYSTEMS NOTES (APPLIES TO ALL SHEETS):

A. ELECTRICAL WORK SHALL BE DONE IN ACCORDANCE WITH 2020 NATIONAL ELECTRICAL CODE (2020 NEC) WITH LOCAL AMENDMENTS AND IN ACCORDANCE WITH THE AUTHORITY HAVING JURISDICTION. SEE SHEET G-001 FOR THE PREVAILING CODES.

B. WIRING SHALL BE TWO #12, #12 GROUND IN 3/4" CONDUIT UNLESS NOTED OTHERWISE.

C. INDIVIDUAL CONDUIT HOME RUNS SHOWN SHALL NOT BE CONSOLIDATED.

D. INSTALL WALL SWITCHES AT 48" AFF TO CENTER OF SWITCH AND RECEPTACLES AT 18" AFF TO CENTER OF RECEPTACLE UNLESS NOTED OTHERWISE.

E. INSTALL CONDUIT CONCEALED ABOVE THE CEILING, IN WALLS, OR IN RACEWAYS.

F. ALL EXPOSED CONDUITS SHALL BE INSTALLED 1/2" FROM THE WALL.

G. COORDINATE ALL KITCHEN EQUIPMENT REQUIREMENTS AND DEVICE LOCATIONS WITH THE FOODSERVICE CONTRACTOR PRIOR TO ROUGH-IN. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE TO PROVIDE THE APPROPRIATE DISCONNECTING MEANS FOR, AND TO MAKE THE FINAL CONNECTION TO, ANY HARDWIRED EQUIPMENT. THE ELECTRICAL CONTRACTOR IS ALSO RESPONSIBLE TO PROVIDE AN APPROPRIATE CORD AND PLUG FOR ANY CORD-AND-PLUG CONNECTED EQUIPMENT THAT IS NOT EQUIPPED WITH AN INTEGRAL CORD AND PLUG.

H. ANY EXISTING CONDITIONS INDICATED ARE BASED ON INFORMATION PROVIDED BY OTHERS AND POSSIBLE LIMITED FIELD VERIFICATION. THE CONTRACTOR SHALL ADJUST FOR ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE OWNER.

I. THE CONTRACTOR SHALL VISIT THE PROJECT SITE, REVIEW EXISTING CONDITIONS AGAINST THE PLANS, AND FAMILIARIZE HIMSELF WITH THE WORK PRIOR TO BIDDING AND START OF THE WORK.

J. THE CONTRACTOR IS RESPONSIBLE FOR DEMOLITION OF EXISTING EQUIPMENT, DEVICES, AND LUMINAIRES AS INDICATED AND/OR AS REQUIRED TO ALLOW FOR INSTALLATION AND CONSTRUCTION OF THE NEW WORK. REMOVE ALL EQUIPMENT, DEVICES, LUMINAIRES, CONDUITS, SUPPORTS, HANGERS, ETC. THAT ARE NOT SHOWN AND ARE REQUIRED TO BE REMOVED IN ORDER TO COMPLETE THE NEW WORK.

K. RECESSED BOXES AND CONDUITS CONCEALED WITHIN WALLS OR FLOORS THAT ARE TO REMAIN ARE PERMITTED TO BE ABANDONED IN PLACE ONLY IF THE OPENINGS ARE PATCHED AND THE CONDUCTORS ARE REMOVED.

L. THE OWNER SHALL HAVE FIRST SALVAGE RIGHT ON ALL DEMOLISHED EQUIPMENT, DEVICES, LUMINAIRES, AND MATERIALS. THE CONTRACTOR SHALL DISPOSE OF ALL DEMOLISHED EQUIPMENT, DEVICES, LUMINAIRES, AND MATERIALS THE OWNER REJECTS.

M. MAINTAIN CONTINUITY OF EXISTING CIRCUITS AS REQUIRED TO PROVIDE POWER TO REMAINING EQUIPMENT, DEVICES, AND LUMINAIRES THAT ARE NOT BEING REMOVED.

N. SEE PANEL SCHEDULES FOR INFORMATION ON CIRCUITS THAT ARE TO BE ROUTED THROUGH CONTACTORS OR RELAYS FOR CONTROL.

O. PROVIDE LABELING CALLED FOR IN THE ELECTRICAL PLANS USING ENGRAVED PHENOLIC PLATES (WHITE WITH BLACK LETTERING).

P. THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.

Q. PROVIDE 1" CONDUIT WITH PULLSTRING FROM EACH JUNCTION BOX FOR TELEPHONE OR DATA JACK TO ABOVE OFFICE CEILING. SEE MATERIAL SCHEDULE ON E-010 FOR ALLOWABLE CONDUIT MATERIALS. PROVIDE CONDUITS WITH MINIMAL ELBOWS AND TERMINATE ABOVE OFFICE CEILING WITH CONDUIT BUSHING.

KEYNOTES FOR SITE POWER PLAN	
1	INSTALL VEHICLE DETECTION LOOP FURNISHED BY TLS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. ALIGN DETECTOR LOOP TO BE CENTERD ON THE PICK-UP WINDOW.
2	CONNECT ANNOUNCE SIGN TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 1/E-101. SEE DETAIL 4 THIS SHEET FOR SITE CONDUITS.
3	CONNECT DIRECTIONAL SIGN TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL PER DETAIL 1/E-101. SEE DETAIL 4 THIS SHEET FOR SITE CONDUITS.
4	PROVIDE EMPTY CONDUIT WITH PULL STRING TO CLEARANCE BAR. SEE DETAIL 4 THIS SHEET FOR SITE CONDUITS.
5	1" SPARE LOW VOLTAGE CONDUIT. SEE DETAIL 4 THIS SHEET FOR MORE INFORMATION.
6	1" SPARE LINE VOLTAGE CONDUIT. SEE DETAIL 4 THIS SHEET FOR SITE CONDUITS.
7	INTERIOR J-BOXES AT 11'-0" AFF FOR LINE VOLTAGE AND LOW VOLTAGE SITE WIRING. SEE DETAIL 4 THIS SHEET FOR MORE INFORMATION.
8	EXISTING SHED AND IRRIGATION CIRCUITS TO BE RECIRCUITED TO NEW CHIPOTLE PANEL 'A'. VERIFY EXACT QUANTITY OF CIRCUITS IN FIELD. EXTEND WIRING FROM OLD PANEL LOCATION TO NEW PANEL 'A'.
9	EXISTING SITE LIGHTING CIRCUITS TO BE RECIRCUITED TO NEW CHIPOTLE PANEL 'A'. VERIFY EXACT QUANTITY IN FIELD. SEE PANEL A SCHEDULE FOR SUGGESTED CIRCUITS. PER PREVIOUS TENANT DRAWINGS THERE ARE (6) 30A-1P BREAKERS FOR SITE LIGHTING. EXTEND WIRING FROM OLD PANEL LOCATION TO NEW PANEL 'A', THROUGH NEW LIGHTING CONTROL PANEL EXTERIOR RELAYS.


NOTE:

SOME OF THE ELEMENTS SHOWN BELOW ARE EXISTING TO REMAIN, AND WILL JUST REQUIRE EXTENSION INSIDE THE BUILDING TO THE NEW CHIPOTLE PANEL. CONTRACTOR TO VERIFY IN FIELD.


TAG	DESCRIPTION	RESPONSIBILITY: DEVICE OR CONDUIT	RESPONSIBILITY: CONNECTION OR CONDUCTORS
1	VEHICLE DETECTOR LOOP - 6'x4' WITH 4 TURNS (EMX PR-46-XX). VERIFY LENGTH OF LEAD-IN WIRE PRIOR TO ORDERING TO ALLOW WIRE TO REACH VEHICLE DETECTOR WITHOUT SPLICING. SEE SITE PLAN FOR LOCATIONS.	GC	GC
2	1" CONDUIT FROM VEHICLE DETECTOR LOOP LOCATION TO LOW VOLTAGE J-BOX.	GC	GC
3	1" CONDUIT FROM ANNOUNCE SIGN LOCATION TO LINE VOLTAGE J-BOX. SEE SITE PLAN FOR LOCATION.	GC	GC
4	1" CONDUIT FROM CLEARANCE BAR LOCATION TO LINE VOLTAGE J-BOX. SEE SITE PLAN FOR LOCATION.	GC	N/A
5	1" CONDUIT FROM SITE DIRECTIONAL SIGNAGE AND/OR MONUMENT SIGN LOCATION(S) TO LINE VOLTAGE J-BOX. SEE SITE PLAN FOR LOCATIONS AND NUMBER OF ROUGH-IN LOCATIONS.	GC	GC
6	1" CONDUIT FROM SITE LIGHTING FIXTURE(S) TO LINE VOLTAGE J-BOX. SITE LIGHTING FIXTURES CAN BE DAISY-CHAINED.	GC	GC
7	LINE VOLTAGE J-BOX - MINIMUM 6"X6"X4" J-BOX ON INTERIOR WALL OF BUILDING AT 11'-0" AFF. SEE SITE PLAN FOR LOCATION.	GC	GC
8	LOW VOLTAGE J-BOX - MINIMUM 6"X6"X4" J-BOX ON INTERIOR WALL OF BUILDING AT 11'-0" AFF. SEE SITE PLAN FOR LOCATION.	GC	GC
9	1" SPARE CONDUIT FROM LOW VOLTAGE J-BOX TO LANDSCAPING AREA. SEAL CONDUIT FOR FUTURE USE.	GC	GC
10	1" SPARE CONDUIT FROM LINE VOLTAGE J-BOX TO LANDSCAPING AREA. SEAL CONDUIT FOR FUTURE USE.	GC	GC

GENERAL NOTES

A. WORK AND MATERIALS SHALL BE COMPLIANT WITH THE NEC AND REQUIREMENTS OF THE AHJ.
B. CONDUCTORS AND CONNECTIONS BELOW GRADE, EVEN WHERE WITHIN CONDUITS OR ENCLOSURES, SHALL BE SUITABLE FOR WET LOCATIONS.
C. PROVIDE PULL STRING IN EMPTY CONDUITS.
D. SEAL ENDS OF CONDUITS STUBBED UP ABOVE GRADE TO PROTECT FROM THE ELEMENTS.

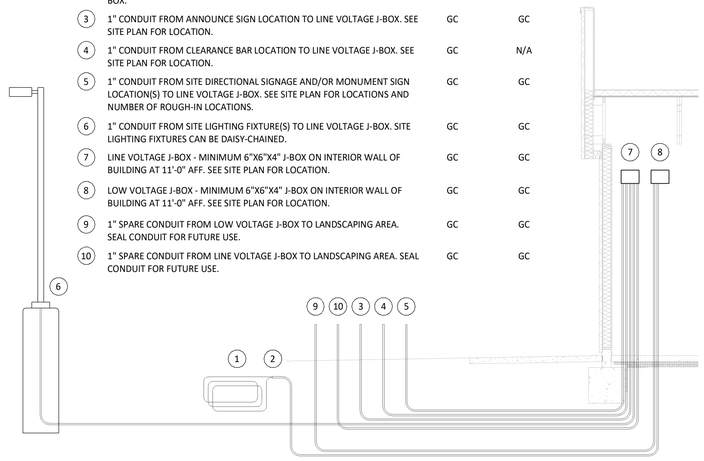

4 SITE CONDUIT DETAIL
NOT TO SCALE

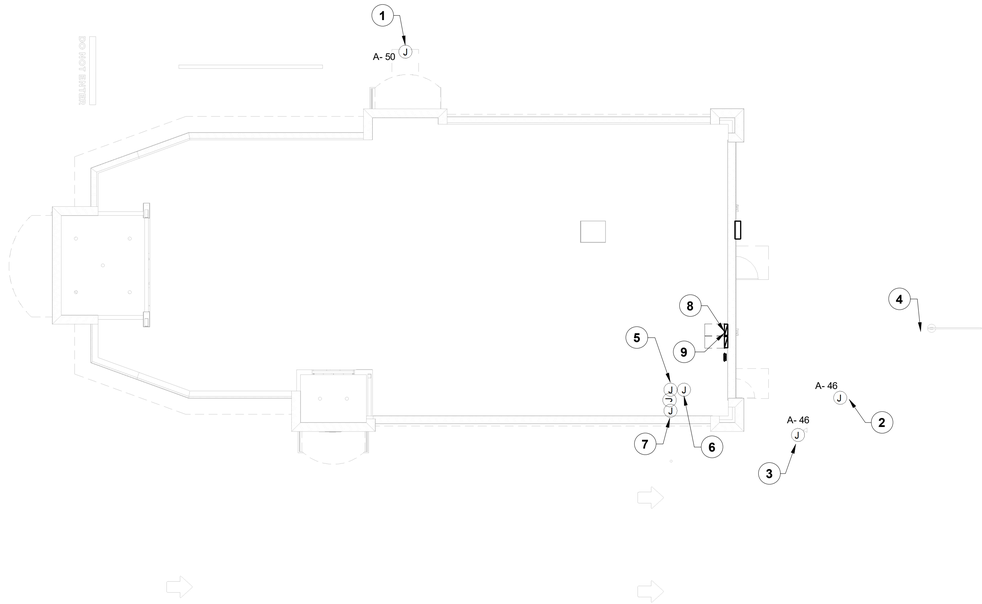

1 SITE POWER PLAN
3/32" = 1'-0"

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
SITE POWER PLAN

SHEET NUMBER:
E-102


2024-DB#2/P#1-2

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
1	SHOW ROOM WINDOW RECEPTACLE. COORDINATE EXACT RECEPTACLE MOUNTING HEIGHT IN THE FIELD. LOCATION SHALL BE IN THE DRYWALL IMMEDIATELY ABOVE THE MAIN STORE-FRONT WINDOW AS SHOWN ON THE DINING ROOM ELECTRICAL ELEVATIONS ON SHEET E-700.
2	ICE MACHINE ELECTRICAL TIE-IN. COORDINATE EXACT LOCATION WITH EQUIPMENT INSTALLER PRIOR TO ROUGH-IN. PROVIDE L5-20P FLANGED INLET WIRED TO THE REMOTE CONDENSER. PROVIDE 48" CORDS, ONE WITH 5-20P END AND ONE WITH L5-20R END, FROM ICE MAKER TO RECEPTACLE AND FLANGED INLET.
3	CONNECT RECEPTACLES SERVING EQUIPMENT BELOW THE KITCHEN HOOD TO THE CIRCUITS SHOWN THROUGH THE CONTACTOR INTEGRAL TO THE HOOD CONTROL PANEL. INTEGRAL CONTACTOR SHALL BE INTERLOCKED TO HOOD FIRE PROTECTION SYSTEM SO THAT RECEPTACLES ARE DE-ENERGIZED UPON ACTIVATION OF HOOD FIRE PROTECTION SYSTEM.
4	JUNCTION BOX FOR EXTERIOR SIGN LIGHTING, COORDINATE EXACT LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER AND THE SIGN INSTALLER PRIOR TO ROUGH-IN. CONNECT TO CIRCUIT SHOWN THROUGH THE EXTERIOR LIGHTING CONTACTOR PANEL AS SHOWN IN DETAIL 1/E-101.
5	PROVIDE 4" OCTAGONAL JUNCTION BOX WITH SCREW THREADS SET AT THE 2 & 8 O'CLOCK POSITIONS FOR THE KITCHEN EXHAUST SUPPRESSION SYSTEM PULL STATION. PROVIDE A 1/2" CONDUIT FROM THE J-BOX TO 6" ABOVE THE CEILING AND TERMINATE WITH A CONDUIT BUSHING. COORDINATE EXACT LOCATION WITH THE KITCHEN EXHAUST SUPPRESSION SYSTEM INSTALLER AND THE FIRE MARSHAL PRIOR TO ROUGH-IN.
6	HOOD CONTROL PANEL AND KITCHEN EXHAUST SUPPRESSION SYSTEM CABINET SHALL BE LOCATED WITHIN THE INTEGRAL HOOD UTILITY CABINET, PROVIDE FINAL ELECTRICAL CONNECTIONS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS NECESSARY FOR A COMPLETE AND OPERATIONAL SYSTEM.
7	PROVIDE AN EMPTY SINGLE GANG J-BOX FOR VOLUME CONTROLS. INSTALL 16/2 SPEAKER WIRE FURNISHED BY THE MSS FROM THE J-BOX TO THE AMPLIFIER IN THE OFFICE WITH 3'-0" OF SLACK AT EACH END.
8	COORDINATE DATA/POWER RECEPTACLE MOUNTING REQUIREMENTS WITH THE CASE WORK INSTALLER PRIOR TO ROUGH-IN.
9	PROVIDE ROUGH-IN FOR LAUNCHPORT AS NOTED. LAUNCHPORT WILL BE FURNISHED AND INSTALLED BY CHIPOTLE WITH THE WALLSTATION AT 62" AFF. PROVIDE A 4" X 2-1/8" DEEP OCTAGON J-BOX WITH 1-1/2" EXTENSION RING AT 62" AFF FOR THE WALLSTATION INSTALLATION WITH A 1" CONDUIT WITH PULL STRING FROM THE J-BOX TO ABOVE THE OFFICE CEILING.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
10	PROVIDE (2) EMPTY 2" CONDUIT WITH PULL STRING FROM EXISTING TELEPHONE SERVICE ENTRANCE TO THE SPACE ABOVE OFFICE CEILING. TERMINATE WITH CONDUIT BUSHING
11	AFTER THE DML, POS, AND OFFICE EQUIPMENT IS INSTALLED PROVIDE CHILDPROOF RECEPTACLE COVERS ON UNUSED IG RECEPTACLES AT THE DML, POS, AND OFFICE.
12	INSTALL THE BYPASS DISTRIBUTION PANEL (BDP) FURNISHED BY THE TENANT. INSTALL PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS AND DETAILS 1 AND 2/E-710.
13	ROUGH-INS TO SERVE LINE AND POS EQUIPMENT ARE UNDERGROUND. COORDINATE ROUGH-IN REQUIREMENTS AND LOCATIONS WITH EQUIPMENT MANUFACTURER PRIOR TO ROUGH-IN.
14	ICE MAKER RECEPTACLES SHALL BE CONCEALED BEHIND THE ICE MAKER. COORDINATE LOCATION WITH ACTUAL WIDTH OF ICE MAKER.
15	PROVIDE VERTICAL METAL DIE CAST WEATHERPROOF WHILE IN USE OUTLET COVER ON RECEPTACLES AT COOK LINE. COVER SHALL BE INTERMATIC WP1010MXD FOR SINGLE GANG BOXES AND WP1030MXD FOR DOUBLE GANG BOXES. NO SUBSTITUTIONS SHALL BE ACCEPTED.
16	LABEL BATTERY-PROTECTED RECEPTACLES "BATTERY-PROTECTED RECEPTACLES IN USE. DISCONNECT AT PANEL BDP"
17	LABEL MAIN DISCONNECT SWITCH AND PANEL A "WARNING: BATTERY-PROTECTED RECEPTACLES IN USE. DISCONNECT AT PANEL BDP."
18	PROVIDE A NEMA 5-20P FLANGED INLET (LEVITON MODEL #15378-C) AND SINGLE NEMA 5-20R RECEPTACLE IN OFFICE AT 102"AFF FOR CONNECTION TO A CENTRAL UPS SYSTEM. CONNECT THE FLANGED INLET AND THE SINGLE RECEPTACLE TO THE TERMINAL BLOCK IN THE BDP PER THE MANUFACTURER'S INSTRUCTIONS. PROVIDE FINAL CONNECTION FROM FLANGED INLET TO THE OUTPUT OF THE UPS USING A 2'-LONG 20A EXTENSION CORD. PLUG THE UPS INTO THE SINGLE RECEPTACLE.
19	INSTALL 16/2 SPEAKER WIRE FURNISHED BY MSS. INSTALL SPEAKER WIRE BETWEEN SPEAKERS IN THE DINING ROOM AS SHOWN TO THE VOLUME CONTROL IN THE KITCHEN WITH 3 FEET OF SLACK AT EACH END. SEE ARCHITECTURAL PLANS FOR SPEAKER LOCATIONS. ADJUST EACH SPEAKER 70V TAP SETTING TO BE 15 WATTS.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
20	PROVIDE POWER CONNECTIONS TO ISLAND PREP TABLE PER DETAIL 3/E-710. PROVIDE GFCI DUPLEX RECEPTACLES IN TWO (2) J-BOXES INTEGRAL TO PREP TABLE FOR HOT HOLDING CABINET AND GENERAL RECEPTACLE.
21	PROVIDE GFCI RECEPTACLE AND J-BOX AND INSTALL CO2 ALARM FURNISHED BY CO2 ALARM VENDOR AS SHOWN IN DETAIL 3/E-700.
22	PROVIDE J-BOX AND INSTALL C02 ALARM REMOTE DISPLAY UNIT FURNISHED BY CO2 ALARM VENDOR AS SHOWN IN DETAILS 3/E-700 AND 8/E-700.
23	INSTALL WALK-IN COOLER EXTERNAL READOUT THERMOMETER REMOTE PROBE ON WALL OPPOSITE DOOR AS SHOWN. ROUTE TEMPERATURE PROBE WIRE ABOVE WALK-IN COOLER CEILING PANELS, SEAL PENETRATIONS THROUGH THE CEILING PANELS, AND SECURE VERTICAL PROBE WIRE TIGHT TO WALLS. NO EXCESS PROBE WIRE SHALL BE WITHIN THE WALK-IN COOLER.
24	PROVIDE RECEPTACLE FOR RESTROOM HAND SINK FAUCET AS SHOWN IN DETAIL 4/P-200.
25	PROVIDE 4" SQUARE J-BOX ON EXTERIOR WALL FOR MOUNTING OF EXTERIOR CAMERA. SEE ARCHITECTURAL ELEVATION FOR EXACT HEIGHT AND LOCATION. PROVIDE 3/4" CONDUIT WITH PULLSTRING FROM J-BOX TO ABOVE LAY-IN CEILING AREA IN KITCHEN. J-BOX SHALL NOT BE SURFACE MOUNTED. BASE OF CAMERA SHALL BE MOUNTED FLUSH TO EXTERIOR WALL FINISH.
26	PROVIDE 1" CONDUITS FROM LOW-VOLTAGE J-BOXES AT POS COUNTER CONCEALED WITHIN THE SERVE LINE WIRING CHASE TO THE WALL, THEN CONCEALED WITHIN THE WALL AND ABOVE THE CEILING TO ABOVE THE OFFICE CEILING.
27	INSTALL VEHICLE DETECTOR SYSTEM FURNISHED BY TLS SURFACE-MOUNTED ON WALL IN ACCESSIBLE LOCATION ABOVE CEILING AND CONNECT TO STROBE/CHIME AND DETECTOR LOOP PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. MAKE FINAL ADJUSTMENTS TO LOOP SENSITIVITY PER THE MANUFACTURER'S INSTRUCTIONS. ONCE ALL COMPONENTS ARE INSTALLED AND OPERATIONAL THE CHIME/STROBE LIGHT SHOULD STAY ILLUMINATED AND THERE SHOULD BE A SINGLE CHIME WHEN A VEHICLE DRIVES OVER OR STOPS ON LOOP.
28	SEAL INTERIOR AND EXTERIOR OF CONDUITS THAT PASS THROUGH THE WALK-IN COOLER ENVELOPE PER THE NEC.
29	PROVIDE ISLAND PREP TABLE FOOD WARMER RECEPTACLE WITH GROUND PIN TOWARDS THE BOTTOM OF THE RECEPTACLE.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
30	PROVIDE (2) 10"X10"X4" JUNCTION BOXES (J-BOX #1/J-BOX #2) ON THE WALL ABOVE PANELBOARDS 6" BELOW THE LAY-IN CEILING AND MOUNTED ADJACENT TO EACH. PROVIDE CONDUITS AND WIRING SHOWN IN DETAIL 8/E710. TEMS SHALL PROVIDE GRIDPOINT 3 PHASE METER AND TRANSFORMER WITHIN J-BOX #1 AND GRIDPOINT IOM/HUB WITHIN J-BOX #2. SEE GRIDPOINT INSTALLATION SHEET FOR DETAILS.
31	PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION. PROVIDE CONDUITS AND WIRING AS SHOWN IN DETAIL 8/E710.
32	INSTALL WIRED DOOR BUZZER AT 96" AFF. SEE ARCHITECTURAL DOOR EQUIPMENT FOR EQUIPMENT INFORMATION. CONNECT TO CIRCUIT SHOWN THROUGH THE TRANSFORMER FURNISHED WITH THE DOOR BUZZER. PROVIDE WIRING TO A BUTTON ADJACENT TO THE SERVICE DOOR AND CONNECT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
33	CONNECT BATHROOM SANITIZER TO CIRCUIT SHOWN SO THAT IT IS ENERGIZED AT ALL TIMES.
34	PROVIDE POWER AND LOW VOLTAGE CONNECTIONS TO DISH SANITIZING MACHINE AS SHOWN PER DETAIL 7/E-710. CONNECT THE DETERGENT DISPENSER TO THE DISH MACHINE USING THE INCLUDED WIRING HARNESS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
35	PROVIDE RECEPTACLE FOR 1-DOOR REFRIGERATOR WITH GROUND PIN TOWARDS THE BOTTOM OF THE RECEPTACLE.
36	PROVIDE CORD AND NEMA 5-20P PLUG FROM UTENSIL COUNTER ICE MAKER, THROUGH UTENSIL COUNTER, TO ICE MAKER RECEPTACLE.
37	LABEL UTENSIL COUNTER RECEPTACLES "TRACTOR BEVERAGE", "ICE MAKER/IMSB", AND "SODA FOUNTAIN".
38	LABEL RECEPTACLE "UV INSECT TRAP".
39	PROVIDE POWER CONNECTIONS TO ISLAND PREP TABLE PER DETAIL 3/E710. PROVIDE GFCI DUPLEX RECEPTACLE IN THE J-BOX INTEGRAL TO PREP TABLE FOR UNDERCOUNTER REFRIGERATOR. PROVIDE FINAL CONNECTION TO CARVING STATION HEATER.
40	IF NEUTRAL CONDUCTOR IS NOT NEEDED FOR SERVE LINE HOT FOOD SERVER TERMINATE NEUTRAL IN JUNCTION BOX.
41	PROVIDE SINGLE-GANG J-BOX FOR DATA JACK AS SHOWN FOR KRONOS TIME CLOCK.
42	INSTALL CARBON MONOXIDE DETECTOR/ALARM AT 48"AFF. CO DETECTOR SHALL BE SYSTEM SENSOR #CO1224T INSTALLED AS A STAND-ALONE SYSTEM.
43	PROVIDE A RECESSED J-BOX AT 48" AFF FOR THE INSTALLATION OF THE SECURITY SYSTEM KEYPAD WITH A 3/4" CONDUIT TO ABOVE THE DROP TILE CEILING IN THE OFFICE AREA. TERMINATE CONDUIT WITH A CONDUIT BUSHING

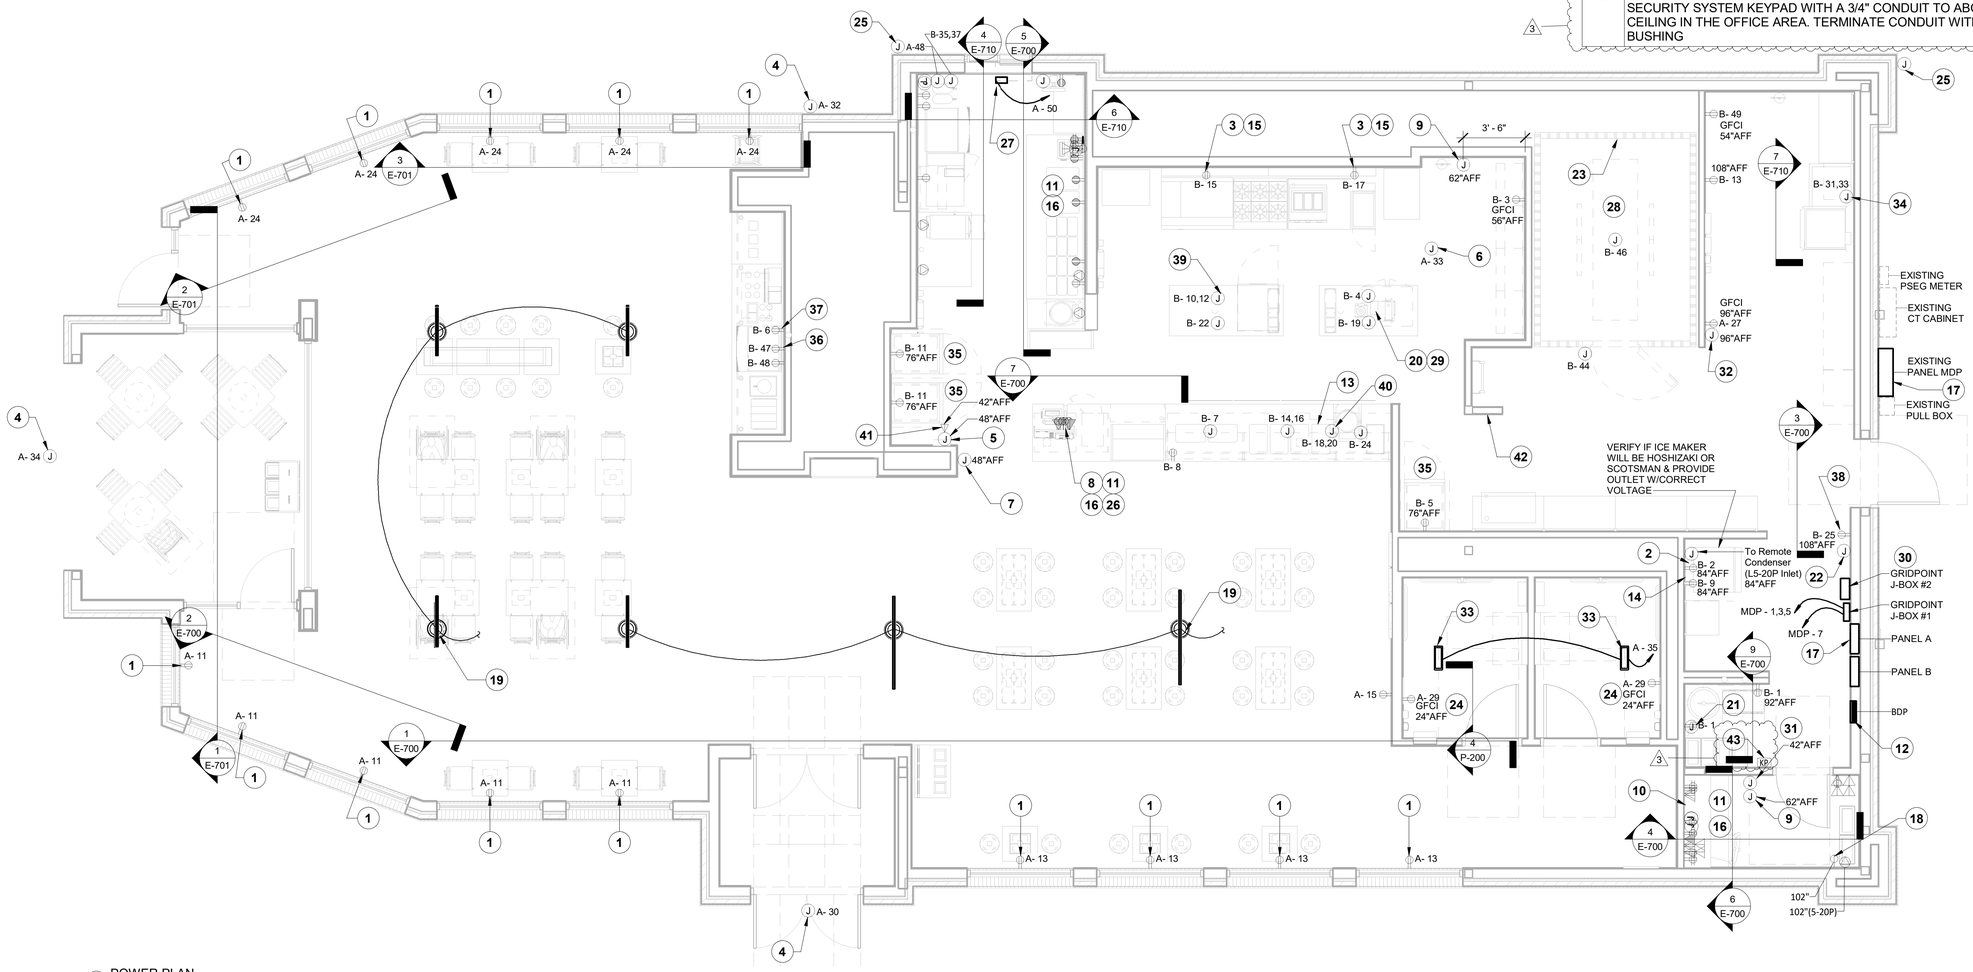

1 POWER PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077


PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
POWER PLAN

SHEET NUMBER:
E-110

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
1	UNIT SHALL HAVE AN INTEGRAL NON-FUSED DISCONNECT SWITCH.
2	ROOFTOP UNIT SHALL HAVE INTEGRAL UNIT MOUNTED GFCI RECEPTACLE.
3	PROVIDE POWER TO AIR CURTAIN OVER DOOR, AND WIRING FOR CONTROLS. CONCEAL DISCONNECT(S) ON SIDE OF AIR CURTAIN. COORDINATE WITH CHIPOTLE CONSTRUCTION MANAGER FOR EXACT LOCATION.
4	PROVIDE POWER TO RESTROOM EXHAUST FAN WITH LOCAL DISCONNECT SWITCH. VERIFY LOCATION IN FIELD. CONNECT EXHAUST FAN TO CIRCUIT SHOWN THROUGH THE LIGHTING CONTROL PANEL (LCP) IN THE OFFICE.
5	PROVIDE A TWO-CONDUCTOR LOW VOLTAGE WIRE IN 3/4" C. AND (4) #12, #12 N., #12 G. IN 1" C. FROM MAU-1 TO THE HOOD CONTROL PANEL PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
6	PROVIDE ONE PHASE, ONE NEUTRAL, AND ONE GROUND CONDUCTOR FROM THE ICE MAKER TO THE REMOTE CONDENSER.
7	PROVIDE A SUITABLE LENGTH OF LIQUID-TIGHT CONDUIT TO THE EXHAUST FAN EF-1 TO ALLOW THE EXHAUST FAN TO HINGE COMPLETELY OPEN WHEN THE VIROGUARD SYSTEM IS INSTALLED.
8	INSTALL TRANSFORMER FURNISHED BY TUV WITH THE REME HALO AIR PURIFIER IN THE JUNCTION BOX ON THE EXTERIOR OF THE RTU PER DETAIL 5/M700. CONNECT LINE SIDE OF THE TRANSFORMER TO THE RTU SERVICE RECEPTACLE CIRCUIT SO THAT THE REME HALO RUNS CONTINUOUSLY. CONNECT THE LOW VOLTAGE SIDE OF THE TRANSFORMER TO THE REME HALO USING THE INCLUDED BARREL PLUG.
9	PROVIDE 3" CONDUIT (EMT, IMC, OR RMC) THROUGH ROOF. TERMINATE WITH WEATHERHEAD 12" ABOVE ROOF FOR FUTURE CELL BOOSTER.

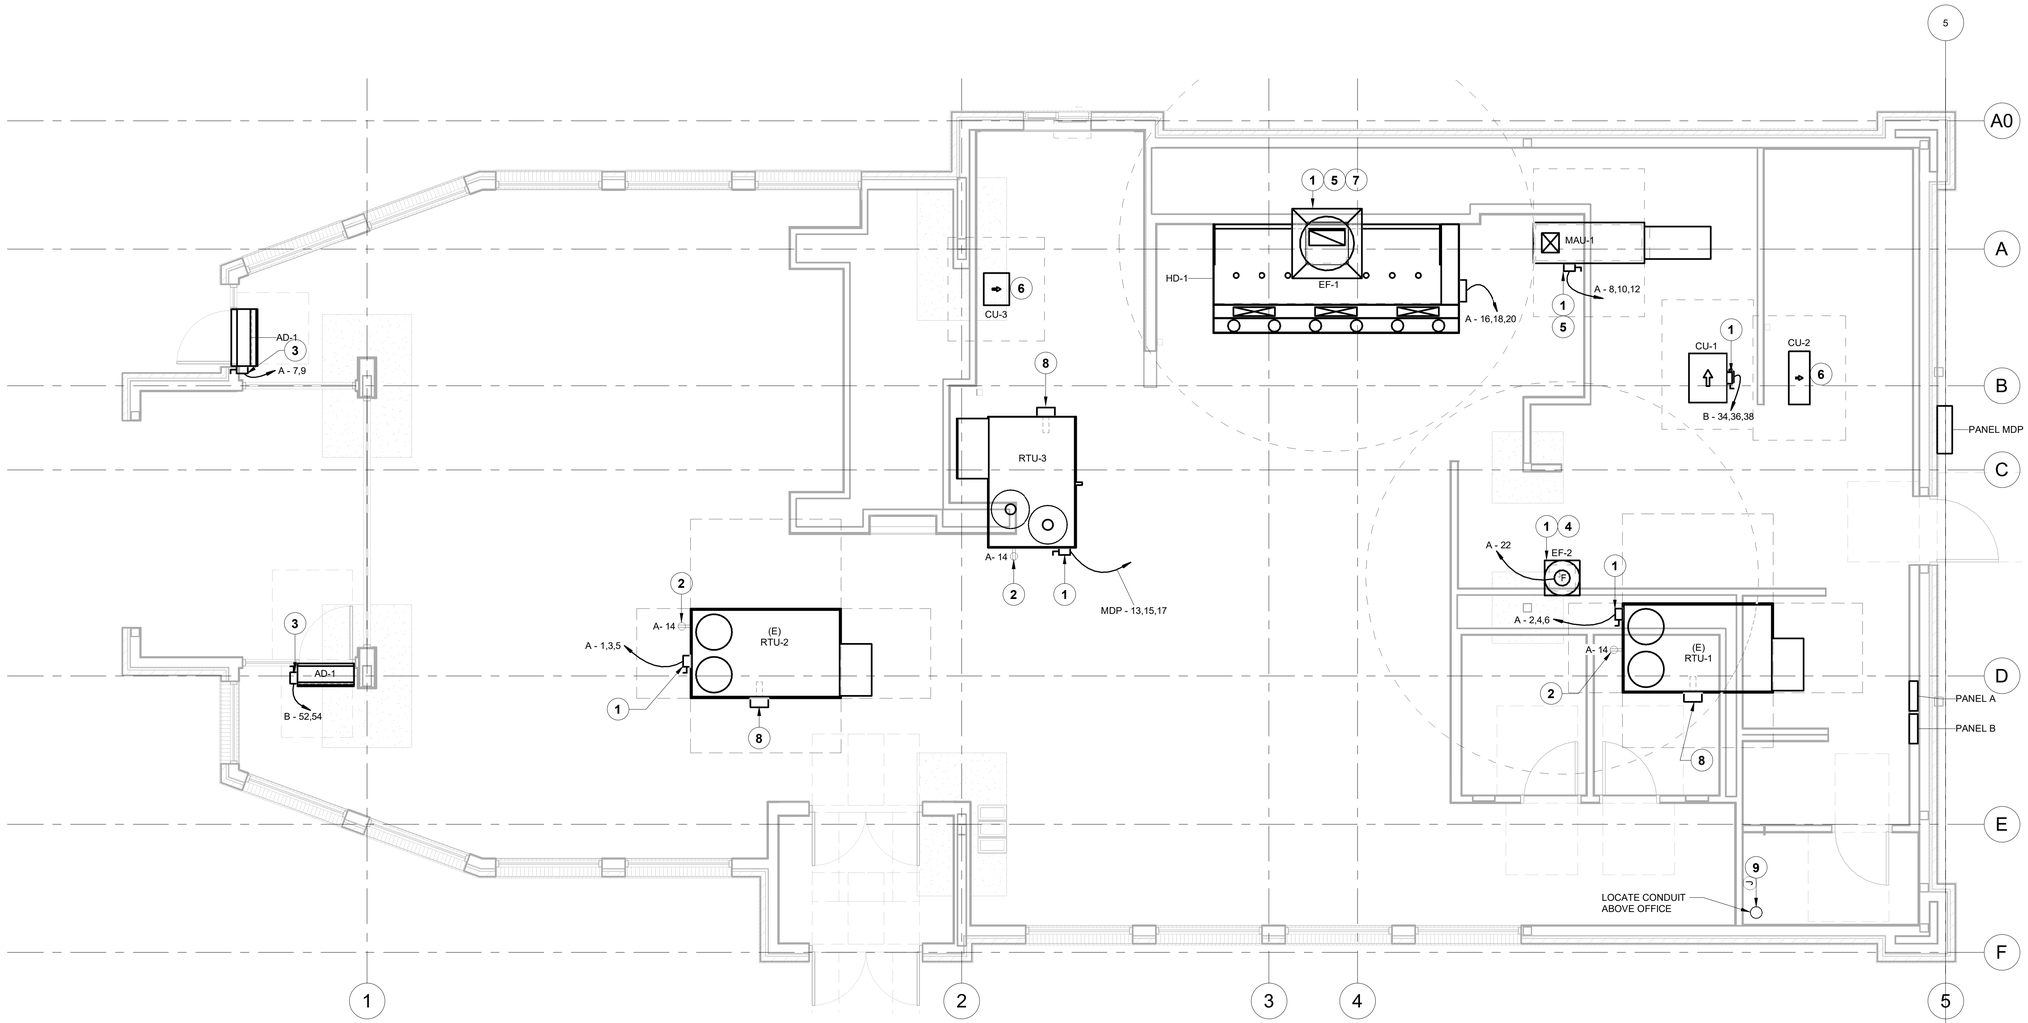

1 HVAC POWER PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY:AJS

PROJECT NUMBER:
21008

SHEET TITLE:

HVAC POWER PLAN

SHEET NUMBER:

E-120

Branch Panel: A

Location: KITCHEN 108
Supply From: MDP
Mounting: Recessed
Enclosure: Type 1

Volts: 120/208 Wye
Phases: 3
Wires: 4

A.I.C. Rating: 65,000 Series Rated
Mains Type:
Mains Rating: 225 A MLO
MCB Rating: ~~225 A~~

CKT	Circuit Description	Trip	Poles	A		B		C		Poles	Trip	Circuit Description	CKT
1	EXISTING RTU-2 (3#6, #10G, 1-1/4"C)	50 A	3	5044 VA	5524 VA					3	60 A	EXISTING RTU-1 (3#6, #10G, 1-1/4"C)	2
3	--	--	--			5044 VA	5524 VA			--	--	--	4
5	--	--	--					5044 VA	5524 VA	--	--	--	6
7	AD-1 (2#8, #10G, 1"C) (HACR)	40 A	2	2974 VA	468 VA					3	15 A	Hood Makup Air Fan (MAU-1) (HACR) (3#12, #112G, 3/4"C)	8
9	--	--	--			2974 VA	468 VA			--	--	--	10
11	Show Window Receptacles Receptaculo	20 A	1					900 VA	468 VA	--	--	--	12
13	Show Window Receptacles Receptaculo	20 A	1	720 VA	540 VA					1	20 A	RTU Receptacles	14
15	General Receptacle - Dining	20 A	1			180 VA	1249 VA			3	20 A	Hood Exhaust Fan (EF-1) (HACR) (3#12, #12G, 3/4"C)	16
17	Panel BDP	20 A	1					1980 VA	1249 VA	--	--	--	18
19	Exterior Irrigation/Shed (reconnect from demo panel)	20 A	1	1500 VA	1249 VA					--	--	--	20
21	Receptacles - POS General Receptaculo	20 A	1			720 VA	334 VA			1	20 A	Restroom Exhaust EF-2 (HACR)	22
23	Security/Audio Sistema de la Seguridad	20 A	1					360 VA	900 VA	1	20 A	Show Window Receptacles Receptaculo	24
25	Spare	20 A	1	0 VA	1188 VA					1	20 A	Lighting - Front of Kitchen Illuminacion - Cocina de en frente	26
27	Receptacle Office GFCI Receptaculo	20 A	1			900 VA	698 VA			1	20 A	Lighting - Dining Room Illuminacion - Comedor	28
29	Receptacle Restrooms Receptaculo	20 A	1					360 VA	1200 VA	1	20 A	Signage - Front Entrance Illuminacion para letreros	30
31	Receptacle - DML GFCI Receptaculo	20 A	1	720 VA	1200 VA					1	20 A	Signage - D/T Side Illuminacion para letreros	32
33	Hood Lights and Controls Luces	20 A	1			500 VA	1200 VA			1	20 A	Signage - Patio Illuminacion para letreros	34
35	Bathroom Sanitizer Sanitizante de bano	20 A	1					22 VA	1500 VA	1	30 A	Exterior Site Lighting (reconnect from demo panel)	36
37	Exterior Site Lighting (reconnect from demo panel)	30 A	1	1500 VA	59 VA					1	20 A	Lighting - Exterior Lighting Illuminacion - Exterior	38
39	Exterior Site Lighting (reconnect from demo panel)	30 A	1			1500 VA	1500 VA			1	30 A	Exterior Site Lighting (reconnect from demo panel)	40
41	Exterior Site Lighting (reconnect from demo panel)	30 A	1					1500 VA	1500 VA	1	30 A	Exterior Site Lighting (reconnect from demo panel)	42
43	Spare	20 A	1	0 VA	48 VA					1	20 A	Lighting Control Panel	44
45	Spare	20 A	1			0 VA	400 VA			1	20 A	Directional Sign	46
47	Spare	20 A	1					0 VA	200 VA	1	20 A	Pick-Up Window	48
49	Spare	20 A	1	0 VA	330 VA					1	20 A	Vehicle Detector	50
51	Spare	20 A	1			0 VA	0 VA			1	20 A	Spare	52
53	Spare	20 A	1					0 VA	0 VA	1	20 A	Spare	54
			Total Load:	23064 VA		23191 VA		22707 VA					
			Total Amps:	193 A		194 A		189 A					

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals	
Other	334 VA	100.00%	334 VA		
Power	42803 VA	100.00%	42803 VA	**Total Conn. Load:**	68962 VA
Non-Continuous	3780 VA	100.00%	3780 VA	**Total Est. Demand:**	64031 VA
Kitchen Equip	15393 VA	65.00%	10005 VA	**Total Conn. Current:**	191 A
E	22 VA	100.00%	22 VA	**Total Est. Demand Current:**	178 A
B	14 VA	125.00%	17 VA		
G	2030 VA	100.00%	2030 VA		

Panel Name: BDP
Mounting: Recessed
Enclosure: Type 1

Voltage: 120
Phases: 1
Wires: 2

Mains: Lugs
Amperage: 20

CKT NO.	CIRCUIT DESCRIPTION	TRIP	POLES	LOAD
1	POS	15A	1	0.2kVA
2	DML POS	15A	1	0.2kVA
3	DML ORDERING SYSTEM	15A	1	0.5kVA
4	OFFICE - SECURITY SYSTEM	15A	1	0.2kVA
5	OFFICE - COMPUTER	15A	1	0.4kVA
6	OFFICE - DVR/ISP	15A	1	0.4kVA
			Total Load:	1.1kVA
			Total Amps:	9A

Branch Panel: B

Location: KITCHEN 108
Supply From: MDP
Mounting: Recessed
Enclosure: Type 1

Volts: 120/208 Wye
Phases: 3
Wires: 4

A.I.C. Rating: 65,000 Series Rated
Mains Type:
Mains Rating: 225 A MLO
MCB Rating: ~~11 A~~

CKT	Circuit Description	Trip	Poles	A		B		C		Poles	Trip	Circuit Description	CKT
1	Carbonator / CO2 Alarm #6 GFCI Sistema de carbonatacion y alarma de CO2	20 A	1	1308 VA	1440 VA					1	20 A	Ice Maker Sanitizer GFCI Desinfectante de la maquina para hacer hielo	2
3	Food Prep Table Receptaculo	20 A	1			356 VA	180 VA			1	20 A	Food Prep Table (Island) GFCI Mesa para la preparacion de alimentos (isla)	4
5	Upright Beverage Cooler GFCI (HACR) Refrigerador vertical	20 A	1					575 VA	1128 VA	1	20 A	Soda System Dispenser GFCI Dispensador para el sistema de refrescos	6
7	Cold Top (Serve Line) #1 GFCI Refrigerador	20 A	1	1440 VA	1056 VA					1	20 A	Ready to Drink Refrigerator GFCI	8
9	Ice Maker (BOH) GFCI Maquina para haoerhielo	20 A	1			1840 VA	1080 VA			2	20 A	Carving Station #11 GFCI (2#10,#10G,3/4"C) Estacion para cortar carnes	10
11	Upright Beverage Cooler GFCI (HACR) Refrigerador vertical	20 A	1					1150 VA	1080 VA	--	--	--	12
13	Water Heater Controls GFCI Calentador de agua a gas	20 A	1	180 VA	2080 VA					2	30 A	Hot Food Server (ServeLine) GFCI (2#10,#10 N, #10G,3/4"C) Servidor Caliente del Alimento	14
15	Gas Grill #13 GFCI Plancha de gas	20 A	1			180 VA	2080 VA			--	--	--	16
17	Gas Fryer #16 GFCI Freidora de gas	20 A	1					80 VA	1350 VA	2	20 A	Tortilla Press (Serve Line) #2 GFCI Calentador de tortillas (2#10,#10G,3/4"C)	18
19	Food Warmer (Rice Table) #26 GFCI Calentador de alimentos (mesa para el arroz)	20 A	1	180 VA	1350 VA					--	--	--	20
21	Tortilla Press (DML) GFCI (2#10,#10G,3/4"C) Calentador de tortillas	20 A	2			250 VA	300 VA			1	20 A	Refrigerator (Cook Line) #12 GFCI Refrigerador (Linea Para Cocinar)	22
23	--	--	--					250 VA	840 VA	1	20 A	Future Equipment GFCI Equipo futuro	24
25	UV Insect Light Trap GFCI	20 A	1	180 VA	2100 VA					2	30 A	Hot Food Server (DML) GFCI (2#10,#10G,3/4"C) Servidor de alimentos calientes	26
27	Spare	20 A	1			0 VA	2100 VA			--	--	--	28
29	Undercounter Cooler (Pick-Up Window) GFCI	20 A	1					200 VA	1200 VA	1	20 A	Foodwarmer (DML) GFCI Calentador de alimentos (linea de fax)	30
31	Dish Machine (2#10,#10G,3/4"C) Lavavajillas	30 A	2	2600 VA	1200 VA					1	20 A	Cold Top (DML) #39 GFCI Tabla fria (linea de fax)	32
33	--	--	--			2600 VA	781 VA			3	15 A	Walk-in Condensing Unit (CU-1)(3#10,#10G,3/4"C) (HACR)	34
35	PUW Air Curtain (2#10,#10G,3/4"C) (HACR)	25 A	2					2100 VA	781 VA	--	--	--	36
37	--	--	--	2100 VA	781 VA					--	--	--	38
39	Soda Machine (Pick-Up Window) GFCI	20 A	1			1150 VA	3000 VA			2	30 A	Quesadilla Maker GFCI (2#10,#10G,3/4"C)	40
41	Quesadilla Maker GFCI (2#10,#10G,3/4"C)	30 A	2					3000 VA	3000 VA	--	--	--	42
43	--	--	--	3000 VA	200 VA					1	20 A	Walk-in Cooler - Door Section	44
45	Ice Maker - Pick Up Window GFCI	20 A	1			1500 VA	200 VA			1	20 A	Walk-in Cooler - Evaporator	46
47	Ice Maker - Utensil Counter GFCI Maquina para hacer hielo	20 A	1					1380 VA	1020 VA	1	20 A	Bubbler GFCI	48
49	Water Softener	20 A	1	180 VA	0 VA					1	20 A	Spare	50
51	Spare	20 A	1			0 VA	2974 VA			2	40 A	AD-1 (2#8, #10G, 1"C) (HACR)	52
53	Spare	20 A	1					0 VA	2974 VA	--	--	--	54
			Total Load:	21375 VA		20571 VA		22108 VA					
			Total Amps:	179 A		171 A		185 A					

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals	
Power	25145 VA	100.00%	25145 VA		
Non-Continuous	19626 VA	100.00%	19626 VA	**Total Conn. Load:**	64054 VA
F	1500 VA	65.00%	975 VA	**Total Est. Demand:**	59279 VA
D	4200 VA	100.00%	4200 VA	**Total Conn. Current:**	178 A
Kitchen Equip	10088 VA	65.00%	6557 VA	**Total Est. Demand Current:**	165 A

Branch Panel: MDP (Existing To Remain)

Location: Exterior Wall
Supply From: Existing To Remain
Mounting: Recessed
Enclosure: Type 1

Volts: 120/208 Wye
Phases: 3
Wires: 4
NEMA 3R

A.I.C. Rating: EXISTING TO REMAIN
Mains Type:
Mains Rating: 800 A MLO
6 DISCONNECT RULE

Notes:

CKT	Circuit Description	Trip	Poles	A		B		C		Poles	Trip	Circuit Description	CKT
1	NEW GRIDPOINT 3 PHASE METER (4-#12,#12G,3/4"C)	20 A	3	0 VA	23064 VA					3	225 A	NEW PANEL A	2
3	--	--	--			0 VA	23191 VA			--	--	--	4
5	--	--	--					0 VA	22707 VA	--	--	--	6
7	NEW GRIDPOINT TRANSFORMER	20 A	1	180 VA	21375 VA					3	225 A	NEW PANEL B	8
9	BLANKED OFF	--	1			--	20571 VA			--	--	--	10
11	BLANKED OFF	--	1					--	22108 VA	--	--	--	12
13	NEW RTU-3 (3#4, #10G, 1-1/4"C) (HACR)	50 A	3	5044 VA	0 VA					3	60 A	TVSS (4#6, #10G, 1"C)	14
15	--	--	--			5044 VA	0 VA			--	--	--	16
17	--	--	--					5044 VA	0 VA	--	--	--	18
			Total Load:	49663 VA		48806 VA		49859 VA					
			Total Amps:	415 A		407 A		417 A					

Legend:

Load Classification	Connected Load	Demand Factor	Estimated Demand	Panel Totals	
Other	334 VA	100.00%	334 VA		
Power	83080 VA	100.00%	83080 VA	**Total Conn. Load:**	148328 VA
Non-Continuous	23406 VA	100.00%	23406 VA	**Total Est. Demand:**	138622 VA
F	1500 VA	65.00%	975 VA	**Total Conn. Current:**	412 A
D	4200 VA	100.00%	4200 VA	**Total Est. Demand Current:**	385 A
Kitchen Equip	25481 VA	65.00%	16563 VA		
E	22 VA	100.00%	22 VA		
B	14 VA	125.00%	17 VA		
G	2210 VA	100.00%	2210 VA		

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
PANEL SCHEDULES


SHEET NUMBER:
E-600

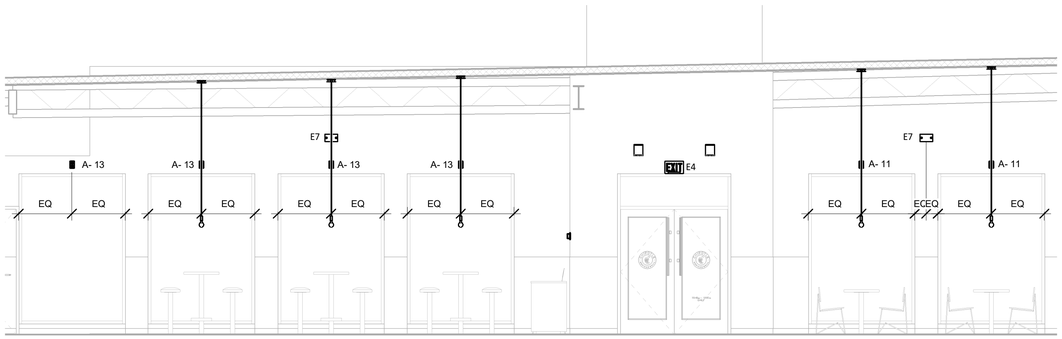


1 DINING ROOM ELECTRICAL ELEVATION
1/4" = 1'-0"

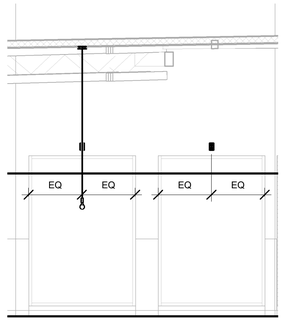


2 DINING ROOM ELECTRICAL ELEVATION 2
1/4" = 1'-0"

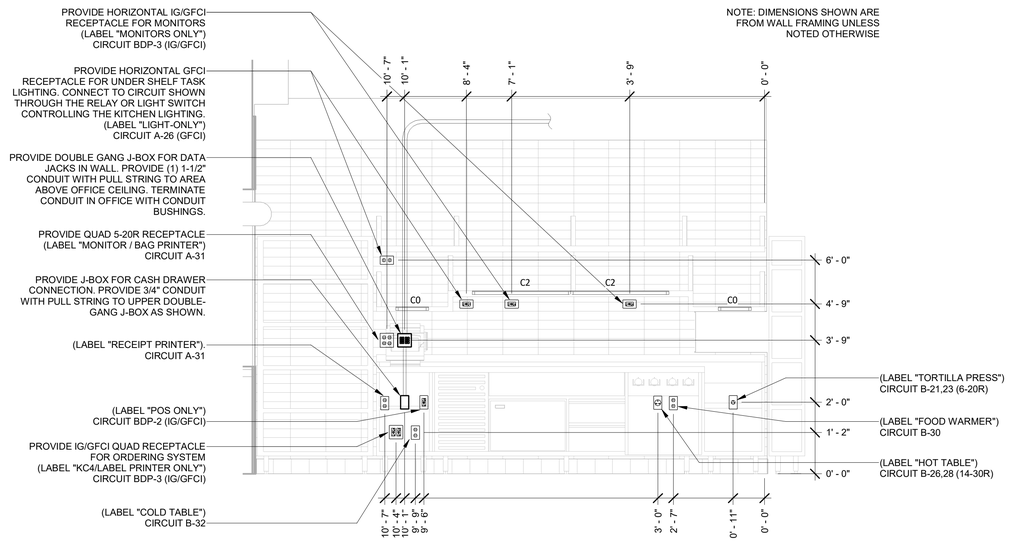

5 DML ELEVATION
1/2" = 1'-0"

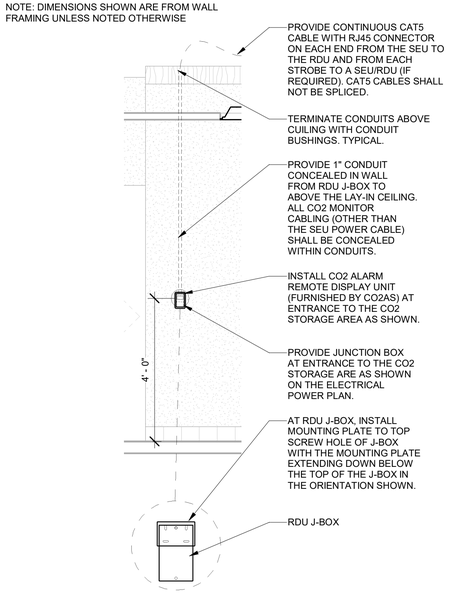


3 CO2 REMOTE DISPLAY DETAIL
1/2" = 1'-0"

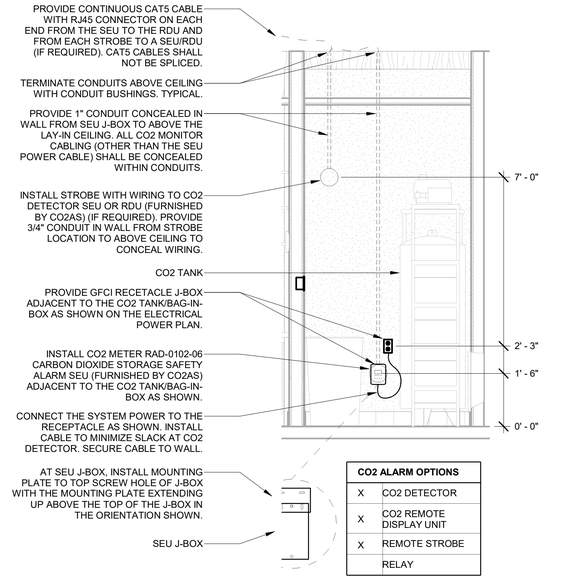


CO2 ALARM OPTIONS	
X	CO2 DETECTOR
X	CO2 REMOTE DISPLAY UNIT
X	REMOTE STROBE
	RELAY


9 CO2 AREA ALARM DETAIL
1/2" = 1'-0"

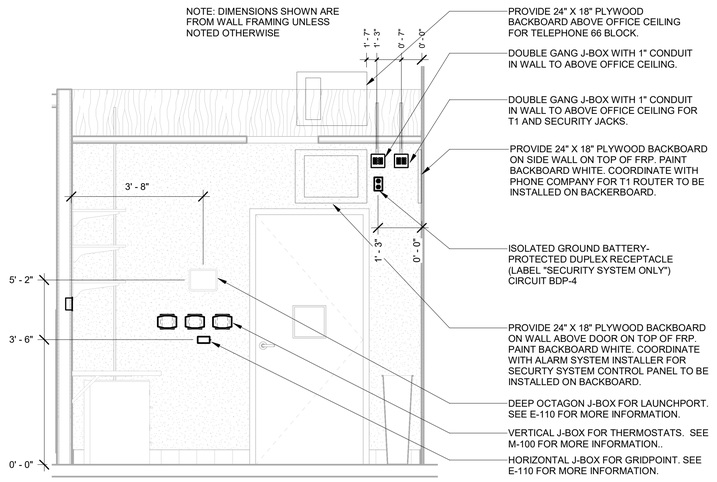

4 OFFICE DOOR ELEVATION
1/2" = 1'-0"

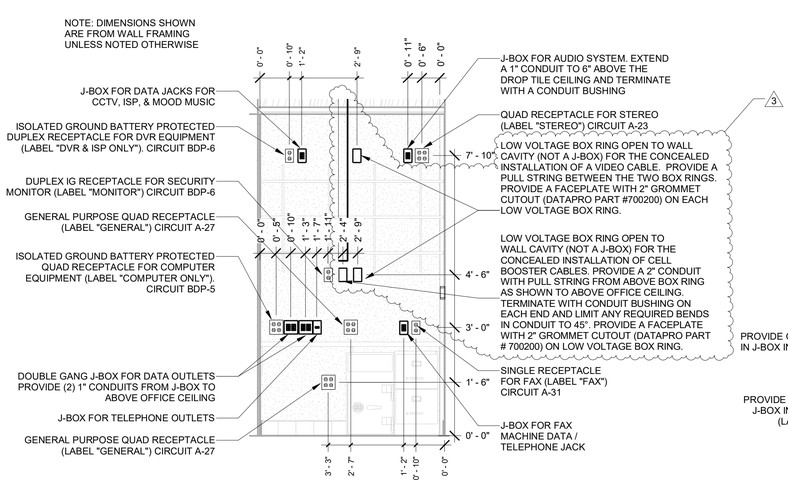

6 OFFICE DESK ELEVATION
1/2" = 1'-0"

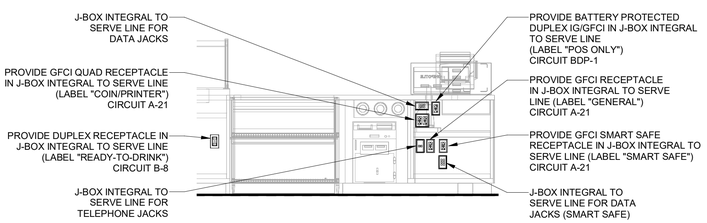

7 POS COUNTER ELEVATION
1/2" = 1'-0"

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
ELECTRICAL INTERIOR ELEVATIONS


SHEET NUMBER:
E-700

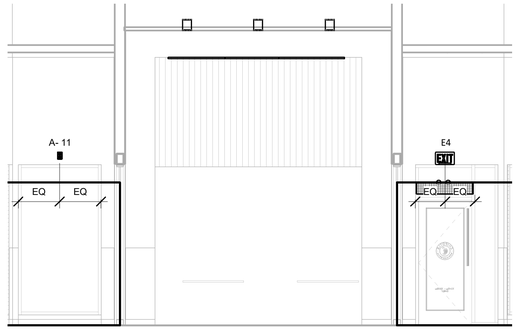

1 DINING ROOM ELECTRICAL ELEVATION 3
1/4" = 1'-0"

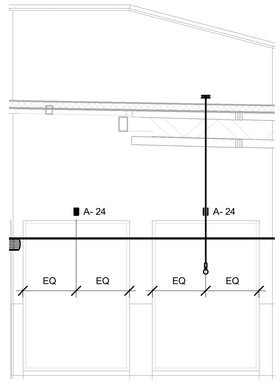

2 DINING ROOM ELECTRICAL ELEVATION 4
1/4" = 1'-0"

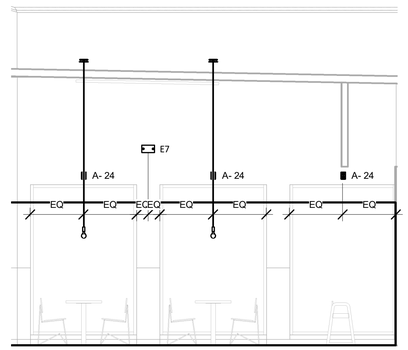

3 DINING ROOM ELECTRICAL ELEVATION 5
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:

ELECTRICAL INTERIOR ELEVATIONS

SHEET NUMBER:

E-701

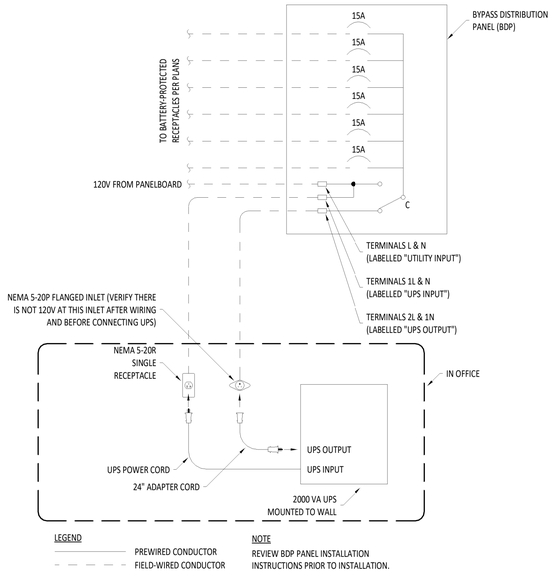


1 BYPASS DISTRIBUTION PANEL WIRING DIAGRAM
NOT TO SCALE


INSTALL SURFACE MOUNTED TVSS UNIT (CURRENT TECHNOLOGY MODEL CG60-120/208-3GY) FURNISHED BY OWNER. FEED THROUGH 60A 3PH CIRCUIT BREAKER. LOCATE DIRECTLY ABOVE PANELBOARD 12" BELOW CEILING. CONDUCTORS SHALL NOT HAVE SHARP BENDS. INSTALL TVSS UNIT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.

INSTALL PANELS A & B FURNISHED BY TPS & INSTALL PANEL BDP AS SHOWN. CIRCUIT BREAKERS IN PANELS A & B SHALL HAVE A SERIES COMBINATION RATING OF AT LEAST 65,000 AIC WHEN USED IN SERIES WITH PANEL MDP. PROVIDE THE FOLLOWING MARKING ON THE PANELBOARDS:

"CAUTION - SERIES COMBINATION SYSTEM RATED 65,000 AMPERES. IDENTIFIED REPLACEMENT COMPONENTS REQUIRED."

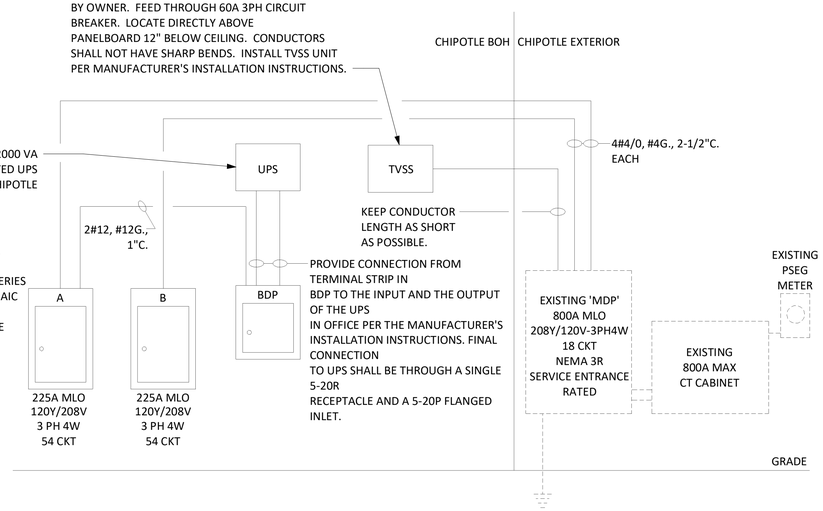


2 MAIN DISTRIBUTION DIAGRAM
NOT TO SCALE

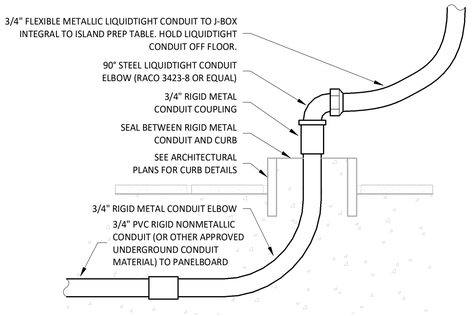


3 PEDESTAL OUTLET DETAIL
NOT TO SCALE


NOTE: DIMENSIONS SHOWN ARE FROM WALL FRAMING UNLESS NOTED OTHERWISE

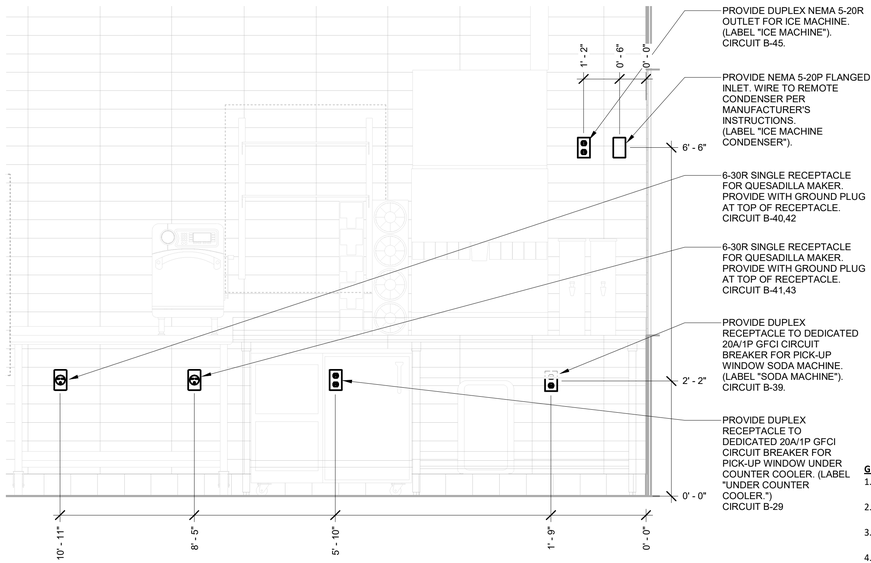

4 COLD SML ELECTRICAL ELEVATION
3/4" = 1'-0"

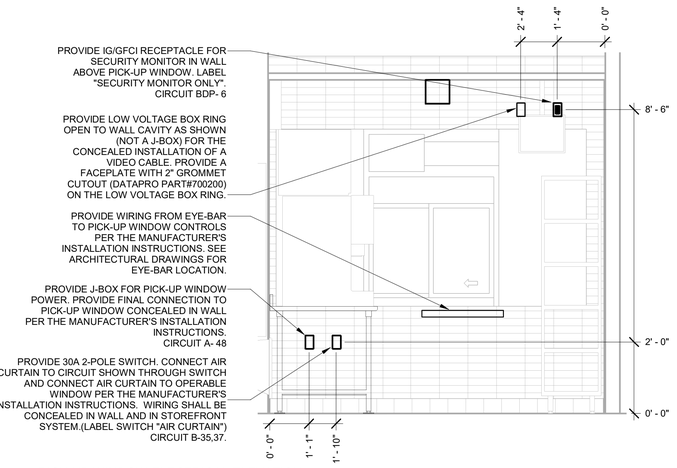

6 PICK-UP WINDOW ELECTRICAL ELEVATION
1/2" = 1'-0"

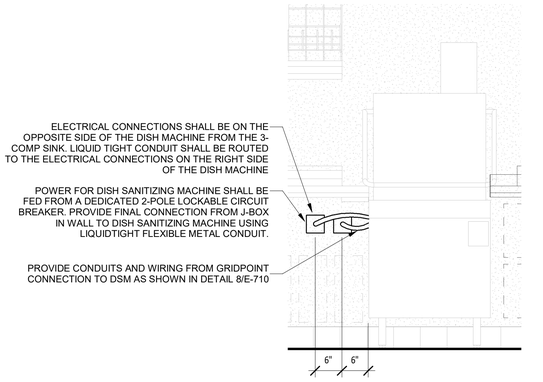


7 DISH SANITIZING MACHINE ELECTRICAL DETAIL
3/4" = 1'-0"

GRIDPOINT DIAGRAM NOTES

1. INSTALL GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR RTU-1 AND RTU-2. PROVIDE THERMOSTAT WIRING FROM EACH THERMOSTAT TO THE CORRESPONDING ROOFTOP UNIT.
2. PROVIDE CAT5E CABLE FROM RTU-1 THERMOSTAT TO J-BOX #2 ABOVE ELECTRICAL PANELS (LEAVE 16" OF CABLE COILED UP INSIDE OF J-BOX #2 AND 16" BEHIND WALL OF THERMOSTAT FOR FINAL CONNECTION TO THE EMS SYSTEM BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTATS".
3. PROVIDE CAT5E CABLE(S) BETWEEN THERMOSTATS (LEAVE 16" OF CABLE BEHIND WALL OF EACH THERMOSTAT FOR FINAL CONNECTION BY THE TEMS) AND LABEL BOTH ENDS OF CABLE "TSTAT JUMPER". SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
4. INSTALL GRIDPOINT ZONE SENSOR MODULES FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM ZSM TO CORRESPONDING THERMOSTAT T1 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
5. INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS AS SHOWN ON HVAC FLOOR PLAN. PROVIDE 18G-24G SHIELDED TWISTED PAIR FROM SUPPLY PROBE TO CORRESPONDING THERMOSTAT T2 TERMINALS. SEE GRIDPOINT INSTALLATION INSTRUCTIONS FOR TERMINATION INSTRUCTIONS.
6. PROVIDE 3/4" LIQUIDTIGHT CONDUIT FROM DISH SANITIZING MACHINE TO LOW-VOLTAGE JUNCTION BOX OR TRIM RING FLUSH MOUNTED TO WALL. PROVIDE CONTINUOUS (NOT SPLICED) CAT5E CABLE FROM DISH SANITIZING MACHINE TO OFFICE (ABOVE LAY-IN CEILING) WITH 54" SLACK WITHIN THE DISH MACHINE AND 10' SLACK ABOVE THE LAY-IN CEILING. PROVIDE RJ-12 PLUG ON CABLE AT DISH MACHINE END WITH BLUE WIRE CONNECTED TO PIN 3 AND BLUE/WHITE WIRE CONNECTED TO PIN 4. LABEL CABLE ON BOTH ENDS WITH "DISHWASHER".
7. PROVIDE CAT5 CABLE FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "RS-485 COMMS" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
8. PROVIDE CABLE (18-24AWG SHIELDED TWISTED PAIR) FROM J-BOX #2 TO OFFICE ABOVE LAY-IN CEILING AND LABEL "EMS POWER" ON BOTH ENDS OF THE CABLE. LEAVE 10' OF SLACK CABLE ABOVE OFFICE CEILING AND 16" OF SLACK CABLE INSIDE OF J-BOX #2.
9. PROVIDE SURFACE MOUNT 10" X 10" X 4" NEMA 1 ENCLOSURES ABOVE PANELBOARDS AND 6" BELOW CEILING.
10. PROVIDE 3/4" CONDUIT WITH INSULATING BUSHING ON END CONCEALED IN WALL FROM J-BOX #2 TO 6" ABOVE LAY-IN CEILING.
11. PROVIDE 3/4" CONDUIT(S) FROM J-BOX #1 TO J-BOX #2.
12. PROVIDE EMPTY 1" CONDUIT(S) FROM PANELBOARD(S) TO J-BOX #1 FOR FUTURE CT WIRING BY TEMS.
13. FIRST PANELBOARD FED FROM ELECTRICAL SERVICE. PROVIDE WITH (1) 20A/3-POLE CIRCUIT BREAKER (FOR GRIDPOINT 3 PHASE METER). IF PANELBOARD HAS 120V CIRCUITS AVAILABLE THEN ALSO PROVIDE (1) 20/1-POLE CIRCUIT BREAKER (FOR GRIDPOINT TRANSFORMER).
14. IF SPACE HAS MULTIPLE ELECTRICAL SERVICES THEN PROVIDE A "J-BOX #1" AND ASSOCIATED BREAKERS, CONDUITS, AND CONDUCTORS ON THE FIRST PANELBOARD FED FROM EACH ELECTRICAL SERVICE.
15. FOR EACH ELECTRICAL SERVICE PROVIDE (1) SET OF [(4) #12, #12 G.] FROM 3-POLE GRIDPOINT CIRCUIT BREAKER AND, IF THE PANELBOARD HAS 120V CIRCUITS AVAILABLE, (1) SET OF [(2) #12, #12 G.] FROM 1-POLE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX #1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
16. IF THE PANELBOARD DOES NOT HAVE 120V CIRCUITS AVAILABLE PROVIDE A 1-POLE 120V 20A CIRCUIT BREAKER IN A PANEL WITH A 120V CIRCUIT AVAILABLE. PROVIDE (1) SET OF [(2) #12, #12 G.] FROM THE GRIDPOINT CIRCUIT BREAKER IN 3/4" CONDUIT CONCEALED IN WALL TO J-BOX #1. TERMINATE IN J-BOX #1 WITH 16" SLACK FOR FINAL CONNECTION BY TEMS.
17. GRIDPOINT CONTROLLER PROVIDED BY TEMS
18. PROVIDE HORIZONTAL SINGLE-GANG J-BOX BELOW FUTURE GRIDPOINT CONTROLLER LOCATION AS SHOWN. PROVIDE 3/4" CONDUIT WITH PULL STRING AND INSULATING BUSHING FROM J-BOX TO 6" ABOVE OFFICE LAY-IN CEILING.

NOTE:
ARRANGEMENT SHOWN IS DIAGRAMMATIC - SEE PLANS FOR ACTUAL DEVICE LOCATIONS.

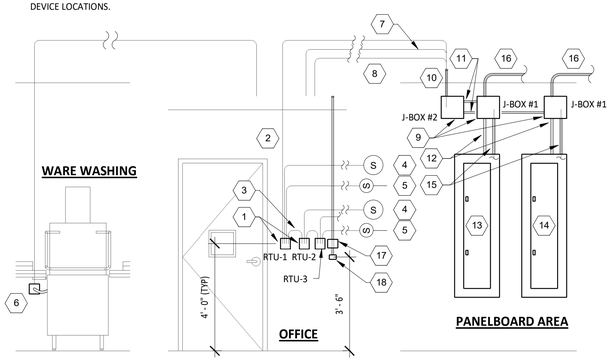

8 ELEC-GRIDPOINT WIRING DIAGRAM
NOT TO SCALE

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
ELECTRICAL DETAILS

SHEET NUMBER:
E-710

COM*check* Software Version COMcheckWeb

Interior Lighting Compliance Certificate

Project Information

Energy Code: 90.1 (2019) Standard
Project Title: 21008 ChipotLANE Hamilton NJ
Project Type: Alteration

Construction Site:
555 Marketplace Blvd
Hamilton, New Jersey 08609

Owner/Agent:

Designer/Contractor:
Anthony Scalamandre
Polaris Consulting Engineers
214 W. Main Stree
Moorestown, New Jersey 08057
856-778-5400

Allowed Interior Lighting Power

A Area Category	B Floor Area (ft2)	C Allowed Watts / ft2	D Allowed Watts
1-Entire Space (Dining: Cafeteria/Fast Food)	3765	0.76	2861
		Total Allowed Watts =	2861

Proposed Interior Lighting Power

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
Entire Space (Dining: Cafeteria/Fast Food, 3765 sq.ft.)				
LED: A1: 2x2: Other:	1	8	30	240
LED: B1: 6" Recessed: Other:	1	7	17	119
LED: B2: 6" Recessed: Other:	1	40	17	680
LED: B3: 6" Recessed: Other:	1	4	12	48
LED: C0: 1' Linear: Other:	1	2	5	10
LED: C2: 3' Linear: Other:	1	2	12	24
LED: C3: 4' Linear: Other:	1	11	15	165
LED: C4: 5' Linear: Other:	1	5	18	90
LED: H1: Hood Lights: Other:	1	8	15	120
LED: J4: Kitchen Pendant: Other:	1	2	9	18
LED: P5: Pendant: Other:	1	15	5	75
LED: P6: Decorative Pendant: Other:	1	3	30	90
LED: W1: Walk-in Cooler Lights: Other:	1	4	29	116
Track Lighting: TCL-0.5: 6' Track Section: Wattage based on current limiting device capacity	0	0	60	60
Track Lighting: TCL-0.5: 6' Track Section: Wattage based on current limiting device capacity	0	0	60	60
Track Lighting: TCL-1.0: 18' Track Section: Wattage based on current limiting device capacity	0	0	120	120
			Total Proposed Watts =	2035

Interior Lighting PASSES

Interior Lighting Compliance Statement

Compliance Statement: The proposed interior lighting alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed interior lighting systems have been designed to meet the 90.1 (2019) Standard requirements in COM*check* Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Name - Title Signature Date

COM*check* Software Version COMcheckWeb

Exterior Lighting Compliance Certificate

Project Information

Energy Code: 90.1 (2019) Standard
Project Title: 21008 ChipotLANE Hamilton NJ
Project Type: Alteration
Exterior Lighting Zone 2 (Neighborhood business district (LZ2))

Construction Site:
555 Marketplace Blvd
Hamilton, New Jersey 08609

Owner/Agent:

Designer/Contractor:
Anthony Scalamandre
Polaris Consulting Engineers
214 W. Main Stree
Moorestown, New Jersey 08057
856-778-5400

Allowed Exterior Lighting Power

A Area/Surface Category	B Quantity	C Allowed Watts /	D Tradable Wattage	E Allowed Watts (B X C)
Main Entry (Entry canopy)	90 ft2	0.25	Yes	22
Drive Up Window (Drive-up windows/doors)	1 windows	200	No	200
Secondary Entry (Illuminated length of facade wall or surface)	3 ft	2.5	No	8
			Total Tradable Watts (a) =	22
			Total Allowed Watts =	230
			Total Allowed Supplemental Watts (b) =	400

(a) Wattage tradeoffs are only allowed between tradable areas/surfaces.
(b) A supplemental allowance equal to 400 watts may be applied toward compliance of both non-tradable and tradable areas/surfaces.

Proposed Exterior Lighting Power

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixture	D Fixture Watt.	E (C X D)
Main Entry (Entry canopy, 90 ft2): Tradable Wattage				
LED: X9: 10' Linear Strip: Other:	1	1	45	45
Drive Up Window (Drive-up windows/doors, 1 windows or doors): Non-tradable Wattage				
LED: X9: 10' Linear Strip: Other:	1	1	45	45
Secondary Entry (Illuminated length of facade wall or surface, 3 ft): Non-tradable Wattage				
LED: X9: 3' Linear Strip: Other:	1	1	14	14
			Total Tradable Proposed Watts =	45

Exterior Lighting PASSES

Exterior Lighting Compliance Statement

Compliance Statement: The proposed exterior lighting alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed exterior lighting systems have been designed to meet the 90.1 (2019) Standard requirements in COM*check* Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Name - Title Signature Date

COM*check* Software Version COMcheckWeb

Mechanical Compliance Certificate

Project Information

Energy Code: 90.1 (2019) Standard
Project Title: 21008 ChipotLANE Hamilton NJ
Location: Trenton, New Jersey
Climate Zone: 4a
Project Type: Alteration

Construction Site:
555 Marketplace Blvd
Hamilton, New Jersey 08609

Owner/Agent:

Designer/Contractor:
Anthony Scalamandre
Polaris Consulting Engineers
214 W. Main Stree
Moorestown, New Jersey 08057
856-778-5400

Mechanical Systems List

Quantity System Type & Description

1 MAU-1
Heating: 1 each - Central Furnace, Gas, Capacity = 90 kBtu/h
Proposed Efficiency = 92.00% Et, Required Efficiency: 80.00 % Et (or 80% AFUE)

SYSTEM COMPLIANCE REQUIREMENT UNKNOWN
Alteration details have not been specified

1 RTU-3
Heating: 1 each - Central Furnace, Gas, Capacity = 224 kBtu/h
Proposed Efficiency = 81.00% Et, Required Efficiency: 80.00 % Et (or 80% AFUE)
Cooling: 1 each - Single Package DX Unit, Capacity = 125 kBtuh, Air-Cooled Condenser, Air Economizer
Proposed Efficiency = 11.00 EER, Required Efficiency = 11.00 EER
Proposed Part Load Efficiency = 14.60 IEER, Required Part Load Efficiency = 14.60 IEER

SYSTEM COMPLIANCE REQUIREMENT UNKNOWN
Alteration details have not been specified

Mechanical Compliance Statement

Compliance Statement: The proposed mechanical alteration project represented in this document is consistent with the building plans, specifications, and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 90.1 (2019) Standard requirements in COM*check* Version COMcheckWeb and to comply with any applicable mandatory requirements listed in the Inspection Checklist.

Name - Title Signature Date

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:

ENERGY COMPLIANCE FORMS

SHEET NUMBER:

EN-100

2024-DB#2/P#1-2

HVAC ABBREVIATIONS

ACC	AIR COOLED CONDENSING UNIT (HVAC)
AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
AHU	AIR HANDLING UNIT
CD	CEILING DIFFUSER
CU	CONDENSING UNIT (COOLER)
EF	EXHAUST FAN
ER	EXHAUST REGISTER
(E)/EXT'G	EXISTING
HD	HOOD
MAU	MAKEUP AIR UNIT
OBD	OPPOSED BLADE DAMPER
RG	RETURN GRILL
RTU	ROOFTOP UNIT
SR	SUPPLY REGISTER
VSC	VARIABLE SPEED CONTROL

SUPPLIER/VENDOR ABBREVIATIONS

CO2AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
LL	LANDLORD
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST & BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SANITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

HVAC SYMBOLS

- CEILING DIFFUSER
- CEILING-MOUNTED RETURN REGISTER
- CEILING-MOUNTED EXHAUST REGISTER
- SUPPLY REGISTER
- RETURN REGISTER
- FLEXIBLE DUCT
- MITERED CORNER WITH TURNING VANES
- DUCTWORK INTERNAL FREE DIMENSIONS (WIDTH x HEIGHT)
- RECTANGULAR TO ROUND DUCT TRANSITION
- DUCT-MOUNTED SMOKE DETECTOR
- M — MOTOR-OPERATED DAMPER
- MANUAL VOLUME DAMPER
- GREASE DUCT CLEANOUT
- MITERED CORNER WITHOUT TURNING VANES
- T — GRIDPOINT THERMOSTAT
- S — GRIDPOINT ZONE SENSOR MODULE
- S — GRIDPOINT SUPPLY PROBE
- # — PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
- CONNECT TO EXISTING
- XXX-# — EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET M-600 FOR EQUIPMENT INFORMATION
- A/V — AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET
- M — MOTORIZED DAMPER
- FD/AD — FIRE DAMPER W/ ACCESS DOOR
- CD-1 / 12" ROUND / 550 CFM — GRILL, REGISTER, OR DIFFUSER TAG / NECK SIZE / AIRFLOW

HVAC GENERAL NOTES

A. GENERAL NOTES APPLY TO HVAC SHEETS.

B. WORK SHALL COMPLY WITH STATE AND LOCAL CODE REQUIREMENTS AS APPROVED AND AMENDED BY THE AUTHORITY HAVING JURISDICTION, INCLUDING APPLICABLE SECTIONS OF NFPA, THE MECHANICAL CODE, AND ANY INTERIM AMENDMENTS AT THE TIME OF THE PROPOSAL. PURCHASE PERMITS ASSOCIATED WITH THE WORK. OBTAIN INSPECTIONS REQUIRED BY CODE. SEE SHEET G-001 FOR THE PREVAILING CODES.

C. CONTRACTOR AND SUBCONTRACTORS SHALL REVIEW A COMPLETE SET OF THE CONSTRUCTION DOCUMENTS.

D. COORDINATE WORK WITH THE WORK OF OTHER TRADES, EQUIPMENT FURNISHED BY OTHERS, REQUIREMENTS OF THE OWNER, AND OF THE EXISTING CONDITIONS AT THE PROJECT SITE.

E. DRAWINGS FOR THE MECHANICAL WORK ARE DIAGRAMMATIC, SHOWING THE GENERAL LOCATION, TYPE, LAYOUT, AND EQUIPMENT REQUIRED. THE DRAWING SHALL NOT BE SCALED FOR EXACT MEASUREMENTS. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS. REFER TO MANUFACTURER'S STANDARD INSTALLATION DRAWINGS FOR EQUIPMENT CONNECTIONS AND INSTALLATION REQUIREMENTS. PROVIDE DUCTWORK, CONNECTIONS, OFFSETS, ACCESSORIES, AND MATERIALS NECESSARY FOR A COMPLETE SYSTEM.

F. DUCT DIMENSIONS ON PLANS INDICATE DIMENSIONS OF INTERNAL FREE AREA.

G. PERFORATED CEILING DIFFUSERS SHALL BE 4-WAY UNLESS NOTED OTHERWISE.

H. COORDINATE ROOF WORK WITH THE OWNER'S CONSTRUCTION MANAGER PRIOR TO CONSTRUCTION.

I. UNLESS NOTED OTHERWISE, RECTANGULAR DUCT ELBOWS GREATER THAN 45° SHALL BE MITERED ELBOWS WITH DOUBLE-THICKNESS TURNING VANES AND RECTANGULAR DUCT ELBOWS 45° OR LESS SHALL BE RADIUSED ELBOWS WITH AN INSIDE RADIUS OF AT LEAST 1/2 THE WIDTH OF THE DUCT.

J. REPLACE AIR FILTERS WITH NEW, CLEAN, MERV 7 AIR FILTERS AT TURNOVER.

K. THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.

L. PROVIDE LABELING CALLED FOR IN THE HVAC PLANS USING ENGRAVED PHENOLIC PLATES.

M. PROVIDE P3000 12 GA. UNISTRUT WITH PG FINISH FOR DUCT SUPPORTS AND OTHER UNISTRUT IN AREAS EXPOSED TO VIEW. SLOTTED UNITRUT AND OTHER UNISTRUT WITH HOLES IS NOT ACCETABLE.

MATERIAL SCHEDULE

CATEGORY	APPLICATION	ALLOWABLE MATERIAL
DUCT	EXPOSED SUPPLY	RECT. LINED OR ROUND AS SHOWN, NO EXPOSED DUCT SEALING MASTIC
	EXPOSED RETURN	RECTANGULAR, NO EXPOSED DUCT SEALING MASTIC
	EXPOSED GEN. EXHAUST	RECTANGULAR, NO EXPOSED DUCT SEALING MASTIC
	CONCEALED, SUPPLY	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, RETURN	RECT. OR ROUND AS SHOWN, LINED OR INSULATED
	CONCEALED, GEN. EXHAUST	RECT. OR ROUND AS SHOWN
	CONCEALED, TYPE I HOOD EXHAUST	RECTANGULAR 16 GA. BLACK IRON W/ WRAP OR UL 1978 FACTORY-MANUFACTURED DUCT W/ WRAP (SUBMIT SHOP DRAWINGS FOR FACTORY-MANUFACTURED DUCT PRIOR TO ORDERING FOR APPROVAL)

HVAC SPECIFICATIONS

SECTION 15732 - PACKAGED ROOFTOP AIR-CONDITIONING UNITS

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data and Shop Drawings.
B. Comply with ASHRAE 15.
C. EER: Equal to or greater than prescribed by ASHRAE 90.1 - 2019
D. Warranties: Submit a written warranty, signed by the manufacturer, agreeing to the repair or replacement of components that fail within 5 years of Substantial Completion.

PART 2 - PRODUCTS

2.1 PACKAGED UNITS, 5 TO 20 TONS

A. Factory assembled and tested, consisting of compressors, condensers, evaporator coils, condenser and evaporator fans, refrigeration and temperature controls, filters, and dampers.
1. Refer to Rooftop Heating/Cooling Unit Schedule on drawing M600 for capacities, and manufacturers.
2. Evaporator Fans: Belt or direct driven, forward curved centrifugal.
3. Exhaust/Relief Fans: Direct drive, forward curved centrifugal or propeller.
4. Condenser Fans: Direct drive propeller.
5. Refrigerant Coils: Aluminum fins and copper coil.
6. Compressors: Serviceable hermetic or fully hermetic, with safety controls, hot gas bypass, and timed off controls.
7. Heat Exchangers: Gas fired, with gas controls, electronic ignition, high limit cutout, and forced draft proving switch.
8. Economizer controls (Comparative Enthalpy, 100% capacity).
9. Low ambient controls.
10. Smoke Detectors: Photoelectric - In supply and/or return as called for on teh schedule on M-600.
11. Operating Controls: Two stage heating and two stage cooling on units 8-1/2 tons and over.
12. Roof curb.
13. Control Wiring from T-stat to rooftop unit: Shall be 18ga / 7 conductor, rated for plenum applications.
14. Control Wiring from T-stat to remote sensor: Shall be a separate 18ga / 2 conductor shielded, rated for plenum applications.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install units level and plumb and firmly anchored.
B. Connect gas piping to burner with pipe same size as gas train inlet, and provide union with sufficient clearance for burner removal and service.
C. Connect to supply and return hydronic piping with shutoff valve and union or flange at each connection.
D. Install ducts to termination in roof mounting frames. Terminate return air duct through roof structure.
E. Connect units to wiring systems and to ground.

END OF SECTION 15732

SECTION 15810 - DUCTS AND ACCESSORIES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: Product Data for fire and smoke dampers.
B. Comply with NFPA 90A for systems serving spaces more than 25,000 cu. ft. in volume or building Types II, IV, and V construction more than 3 stories in height.
C. Comply with NFPA 90B for systems serving spaces in 1 or 2 family dwellings or serving spaces less than 25,000 cu. ft.
D. Comply with NFPA 96, "Ventilation Control and Fire Protection of Commercial Cooking Operations," Chapter 3, "Duct System," for range hood ducts, except single family residential usage, unless otherwise indicated.
E. Comply with UL 181 and UL 181A for ducts and closures.
F. Testing, Adjusting, and Balancing Agency Qualifications: AABC certified.

PART 2 - PRODUCTS

2.1 DUCTS

A. Spiral Duct: Spiral Lock Seam, without insulation, G90 galvanized finish, ASTM A-653/924
1. Basis of Design Manufacturers: Lindab SPIROsafe, alternates to the basis of design must be submitted for review.
2. Fittings: Factory produced standing seam construction with internal sealing. Fittings with a major axis of 36" or smaller shall be 20 gauge. Fittings with a major axis of 37"-48" shall be 18 gauge.
B. Galvanized Steel Sheet: Forming steel, ASTM A 653/653M, G90 coating designation.
C. Duct Liner: ASTM C 1071, Type II, with an airstream surface coated with a temperature resistant coating. Thickness: 1-1/2 inch. R-value : 6.3.
1. Adhesive: ASTM C 916, Type I.
2. Mechanical Fasteners: Galvanized steel pin, length as required to penetrate liner plus a 1/8 inch projection maximum into the airstream.
D. Joint and Seam Tape: Comply with UL 181A.
E. Joint and Seam Sealant: Comply with UL 181A.
F. Rectangular Metal Duct Fabrication: Comply with SMACNA's "HVAC Duct Construction Standard" for metal thickness, reinforcing types and intervals, tie rod applications, and joint types and intervals.

2.2 ACCESSORIES

A. Volume-Control Dampers: Factory fabricated volume control dampers, complete with required hardware and accessories. Single blade and multiple opposed blade, standard leakage rating, and suitable for horizontal or vertical applications.
B. Fire Dampers: Factory-fabricated fire dampers, complete with required hardware and accessories. UL labeled according to UL 555, "Fire Dampers".
C. Flexible Connectors: Flame retardant or noncombustible fabrics, coatings, and adhesives complying with UL 181, Class 1.
D. Flexible Ducts: Factory fabricated, insulated, round duct, with an outer jacket enclosing 2 inch thick, glass fiber insulation, R-value: 6.0, around a continuous inner liner.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Duct System Pressure Class: Construct and install each duct system with 2 inch positive and negative duct pressure classifications.
B. Conceal ducts from view in finished and occupied spaces. Except where noted as exposed.
C. Avoid passing through electrical equipment spaces and enclosures.
D. Support and connect metal ducts according to SMACNA's "HVAC Duct Construction Standard".
E. Install duct accessories according to applicable portions of details of construction as shown in SMACNA standards.
F. Install liner on all supply and return duct.
G. Install volume control dampers in lined duct with methods to avoid damage to liner and to avoid erosion of duct liner.
H. Install fire and smoke dampers according to manufacturer's UL approved written instructions.
I. Install fusible links in fire dampers.
J. Provide saddle taps at tees for exposed ductwork.

3.2 TESTING, ADJUSTING, AND BALANCING

A. The owner will supply an independent balance agent to to balance and adjust the HVAC installation. The balance agent will be responsible for any pulley or belt changes required.
B. The general contactor is to have trained staffed available during the balancing to correct issues noted by the balance agent.
C. The balance agent is to balance airflow within distribution systems, including submains, branches, and terminals to indicated quantities +/- 10%. The hood exhaust system shall be balanced to a tolerance of -0+10% and the make-up air system to a tolerance of -10+0%.
D. The balance agent is to supply a copy of the balance report to the owner, engineer and general contractor for review.

END OF SECTION 15810

SECTION 15855 - DIFFUSERS, REGISTERS, AND GRILLES

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Submittals: None.

PART 2 - PRODUCTS

2.1 OUTLETS AND INLETS

A. Diffusers:
1. Refer to Grills, Registers, and Diffusers Schedule for equipment schedule
2. Manufacturer: As scheduled (NO SUBSTITUTIONS)
3. Material: As scheduled.
4. Finish: As scheduled.
5. Mounting: As scheduled.
B. Wall and Ceiling Registers:
1. Refer to Grills, Registers, and Diffusers Schedule for equipment schedule
2. Manufacturer: As scheduled (NO SUBSTITUTIONS)
3. Material: As scheduled.
4. Finish: As Scheduled.
5. Mounting: Countersunk screw.
C. Wall and Ceiling Grilles:
6. Refer to Grills, Registers, and Diffusers Schedule for equipment schedule
7. Manufacturer: As scheduled (NO SUBSTITUTIONS)
8. Material: As scheduled.
9. Finish: As Scheduled.
10. Mounting: Countersunk screw or lay in depending location.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Coordinate location and installation with duct installation and installation of other ceiling and wall mounted items.
B. Locate ceiling diffusers, registers, and grilles, as indicated on general construction "reflected ceiling plans." Unless otherwise indicated, locate units in center of acoustical ceiling panels.

END OF SECTION 15855

SECTION 15900 - HVAC INSTRUMENTATION AND CONTROLS

PART 1 - GENERAL

1.1 SECTION REQUIREMENTS

A. Summary: Electric/electronic control sequences for HVAC systems and equipment.
B. Submittals: Shop Drawings detailing operating control sequences of each item of HVAC equipment and system and Product Data for controllers, sensors, operators, control panels, thermostats, humidistats, actuators, control valves and dampers.
C. System Description: Control systems consists of sensors, indicators, actuators, final control elements, interface equipment, and other apparatus, accessories, required to operate mechanical systems according to sequences of operation indicated and specified.
D. Operation Sequence:
1. Unoccupied Cycle: During unoccupied hours, as set by the Energy Management System, the outside air and return dampers for the HVAC unit close, and the thermostat set point resets to 65° F (user adjustable). Upon a call for heating, the HVAC unit energizes.
2. Occupied Cycle: During occupied hours, as set by the Energy Management System, the outside air and return dampers open to a minimum set point. The furnace and exhaust fans run continuously. Upon a call for heating, the furnace heating energizes. Upon a call for cooling, the condensing unit energizes.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install control wiring concealed, except in mechanical rooms, and according to requirements specified in Division 16 Sections.

END OF SECTION 15900

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ 08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:

MECHANICAL SPECIFICATIONS, SYMBOLS, & GENERAL INFORMATION


SHEET NUMBER:

M-010

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
1	SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING MOUNTED EQUIPMENT LOCATION. TYPICAL.
2	PAINT DUCTWORK VISIBLE THROUGH DINING ROOM SUPPLY REGISTERS BLACK. TYPICAL.
3	36/14 DUCT UP FOR TRANSITION TO RTU-3 RETURN CONNECTION IN ROOF CURB. RTU-3 SHALL HAVE AN INTEGRAL SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. INTERLOCK SMOKE DETECTOR TO RTU-3 OPERATION.
4	24/18 DUCT UP FOR TRANSITION TO (E) RTU-1 RETURN CONNECTION IN ROOF CURB. REPAIR & REFURBISH (E) DUCT SMOKE DETECTOR, OR PROVIDE (N) SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. VERIFY (E) CONDITIONS IN FIELD. INTERLOCK SMOKE DETECTOR TO (E) RTU-1 OPERATION.
5	24/24 DUCT UP FOR TRANSITION TO (E) RTU-2 RETURN CONNECTION IN ROOF CURB. REPAIR & REFURBISH (E) DUCT SMOKE DETECTOR, OR PROVIDE (N) SMOKE DETECTOR MOUNTED IN THE RETURN AIR STREAM. VERIFY (E) CONDITIONS IN FIELD. INTERLOCK SMOKE DETECTOR TO (E) RTU-2 OPERATION.
6	26/16 DUCT UP FROM BUILDING SUPPLY THROUGH ROOF. TRANSITION TO (E) RTU-1 SUPPLY CONNECTION IN ROOF CURB.
7	24/16 DUCT UP FROM BUILDING SUPPLY THROUGH ROOF. TRANSITION TO (E) RTU-2 SUPPLY CONNECTION IN ROOF CURB.
8	14/14 DUCT UP THROUGH ROOF. TRANSITION TO MAU-1 SUPPLY CONNECTION IN ROOF CURB.
9	16/16 DUCT UP FROM HOOD THROUGH ROOF TO EF-1 COMPLIANT WITH NFPA 96. PROVIDE RADIUSED ELBOWS WITH AN INSIDE RADIUS OF 0.5W AT ELBOWS IN GREASE DUCT.
10	8/6 DUCT UP THROUGH ROOF TO EF-2. SEE DETAIL 6/M-701.
11	28/6 DUCT DOWN TO MAKEUP AIR PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL FOR 3.
12	8" DIA. DUCT DOWN TO AC PSP DUCT CONNECTION. TRANSITION TO SUPPLY PLENUM OPENING SIZE. TYPICAL. CAP UNUSED DUCT CONNECTIONS.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
13	INSTALL SINGLE-GANG VERTICAL J-BOX FOR GRIDPOINT THERMOSTATS FURNISHED BY TEMS FOR (E) RTU-1, (E) RTU-3 AND RTU-3 AT THIS LOCATION AT 48" AFF. COORDINATE WITH ELECTRICAL SWITCHING IN THIS AREA. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710. LABEL THERMOSTAT WITH CORRESPONDING UNIT.
14 (3)	INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR (E) RTU-1 AT THIS LOCATION AT 72" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710. LABEL SENSOR WITH CORRESPONDING UNIT.
15	INSTALL GRIDPOINT ZONE SENSOR MODULE FURNISHED BY TEMS FOR (E) RTU-2 & RTU-3 AT THIS LOCATION AT 66" AFF DIRECTLY TO WALL (NO JUNCTION BOX). COORDINATE LOCATION WITH EQUIPMENT. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710. LABEL SENSOR WITH CORRESPONDING UNIT.
16	INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR (E) RTU-1 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
17	INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR (E) RTU-2 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
18 (3)	INSTALL REMOTE TEMPERATURE SENSOR FOR HOOD HD-1 AT THIS LOCATION AT 72" AFF. COORDINATE LOCATION WITH EQUIPMENT. PROVIDE (2) #18 G. THERMISTOR CABLE FROM TEMPERATURE SENSOR TO HOOD CONTROL PANEL. LABEL SENSOR "HD-1".

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
19	INSTALL KITCHEN HOOD, HD-1. SUPPORT HOOD PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL HOOD ACCORDING TO THE REQUIREMENTS OF ITS LISTING, IN COMPLIANCE WITH NFPA 96, THE BUILDING CODE, AND AUTHORITIES HAVING JURISDICTION. HOOD SHALL HAVE AN INTEGRAL DUCT COLLAR TEMPERATURE SENSOR TO AUTOMATICALLY ENERGIZE THE EXHAUST AND MAKEUP AIR FANS IF COOKING TEMPERATURES ARE DETECTED. EXHAUST DUCT SYSTEM TO BE WELDED OR FACTORY-MANUFACTURED WATER AND AIR TIGHT. INSTALL CLEANOUTS PER CODE AND AS SHOWN. INSTALL HOOD PER DETAILS 4/M-700, AND 2,3 AND 9/M-701. CHIPOTLE WILL PROVIDE AN INDEPENDENT TESTING AGENCY FOR TESTING THE INTEGRITY OF THE GREASE DUCT SYSTEM.
20	PROVIDE SUPPLY DIFFUSER CONNECTION TO SUPPLY SYSTEM PER DETAIL 6/M-700. TYPICAL.
21	PROVIDE AUDIO/VISUAL REMOTE SMOKE DETECTOR ANNUNCIATOR WITH REMOTE KEY OPERATED RESET. WIRE A UNIT BACK TO EACH SMOKE DETECTOR. MOUNT UNIT 60" AFF. LABEL ANNUNCIATOR WITH CORRESPONDING UNIT. TYPICAL.
22	ADJUST SUPPLY REGISTERS SO THAT SUPPLY AIR HITS WALL ON OPPOSITE SIDE OF ROOM AT APPROXIMATELY 7' AFF WITH NO DRAFTS FELT IN THE DINING ROOM.
23	OFFSET DUCT AS REQUIRED TO HEIGHT OF SR-2.
24	26/16 DUCT UP FROM BUILDING SUPPLY THROUGH ROOF. TRANSITION TO RTU-3 SUPPLY CONNECTION IN ROOF CURB.
25	INSTALL GRIDPOINT SUPPLY PROBE FURNISHED BY TEMS FOR RTU-3 IN THE SUPPLY DUCTWORK UPSTREAM FROM THE FIRST BRANCH CONNECTION. PROVIDE WIRING AS SHOWN IN DETAIL 8/E710.
26	DIFFUSERS FACING WINDOWS / EXTERIOR OF DINING TO BE MOUNTED ON DUCT 45 DEG FROM BOTTOM OF DUCT FOR THROW DOWN TOWARDS WINDOWS. TYPICAL.

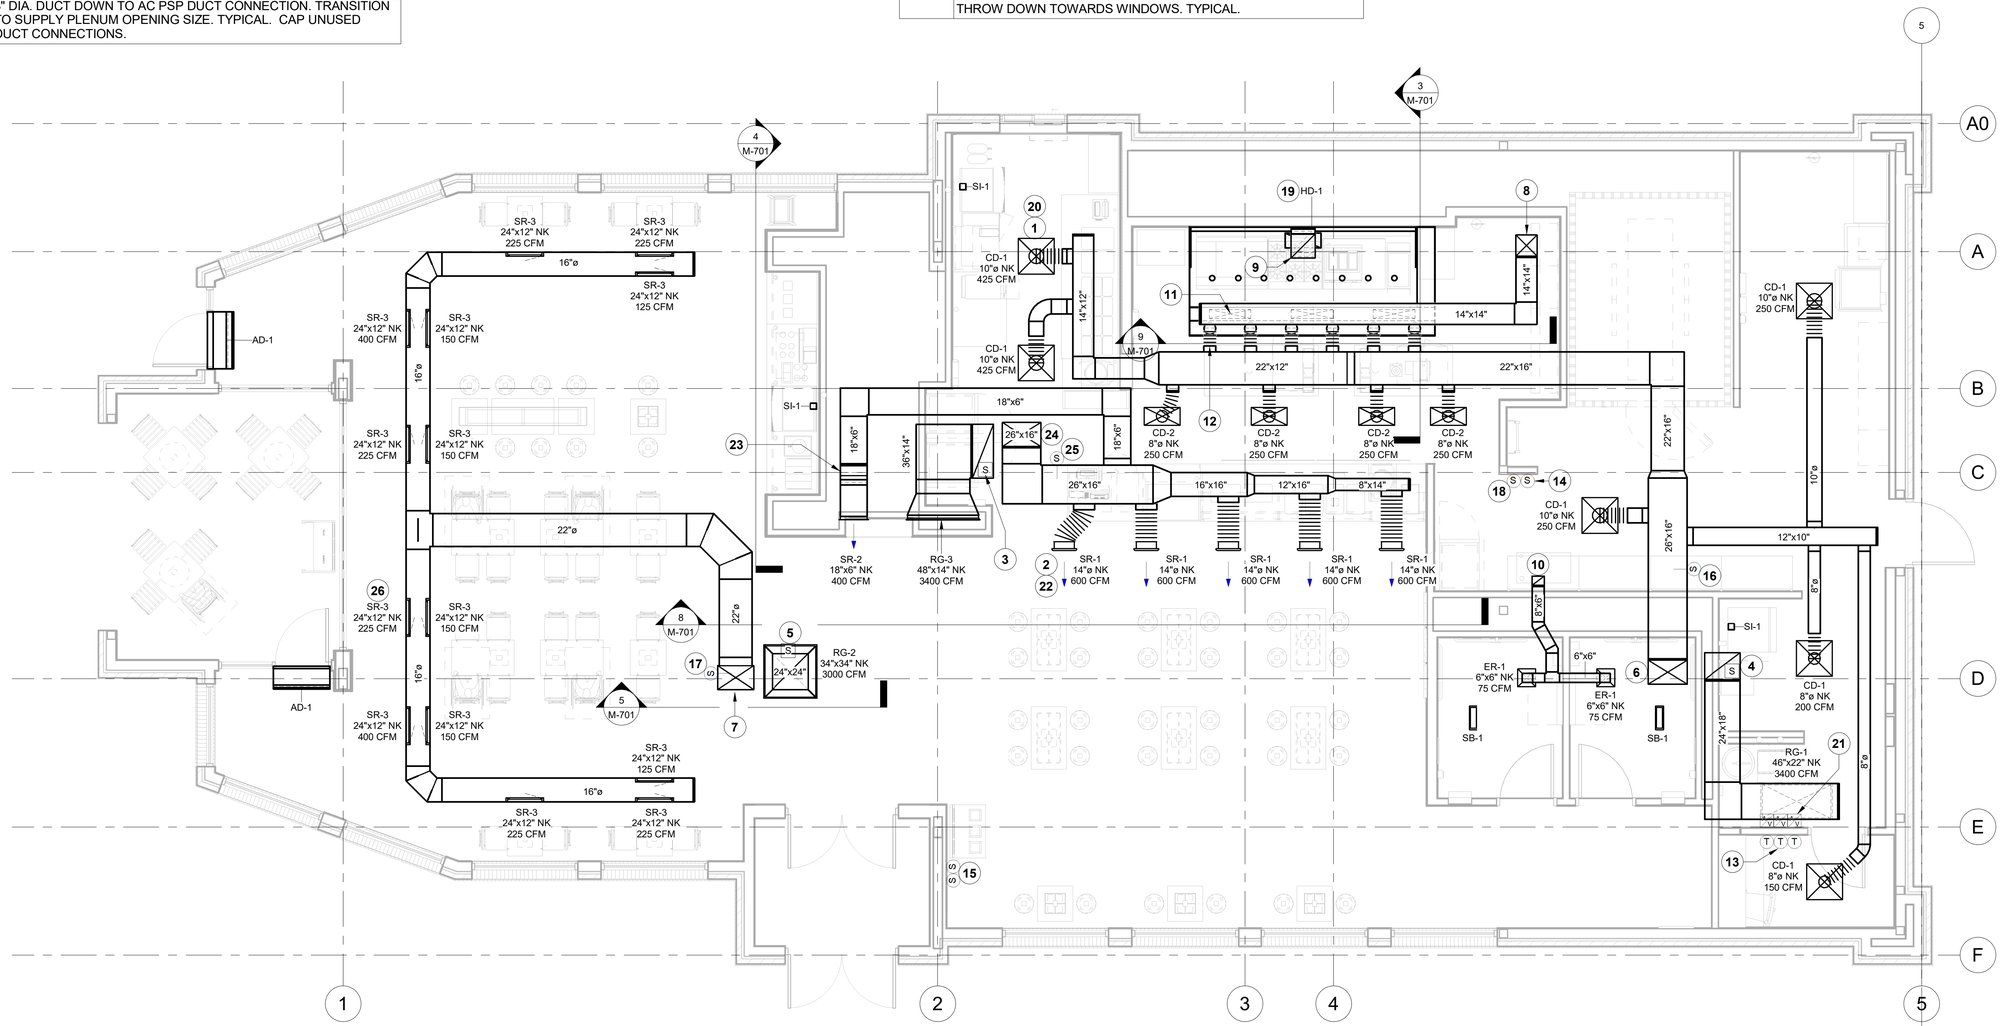

1 HVAC PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008


SHEET TITLE:
HVAC PLAN

SHEET NUMBER:
M-100

	KEYNOTES FOR THIS SHEET 1 , 2 ETC.
1	INSTALL REMOTE CONDENSING UNIT FOR WALK-IN COOLER ON ROOF AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS, AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. SEAL PIPING PENETRATIONS THROUGH ROOF. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3'-0" OF THE CONDENSING UNIT. CUT 2-1/2" HOLE IN WALK-IN COOLER ROOF FOR REFRIGERANT LINE SET AND SEAL PER THE COOLER MANUFACTURER'S INSTALLATION INSTRUCTIONS AFTER LINE SET IS INSTALLED.

	KEYNOTES FOR THIS SHEET 1 , 2 ETC.
2	INSTALL REMOTE CONDENSER FOR ICE MACHINE ON ROOF. INSTALL REFRIGERANT LINE SET, THERMOSTATIC EXPANSION VALVE, SOLENOID VALVE, TEMPERATURE CONTROL, SIGHT GLASS, FILTER DRIER, PRESSURE CONTROL, LOW AMBIENT CONTROLS AND WEATHERPROOF HOUSING. TRAP AND SLOPE REFRIGERANT LINES PER MANUFACTURER'S RECOMMENDATIONS. SEAL PIPING PENETRATIONS THROUGH ROOF. INSTALLATION SHALL COMPLY WITH ASHRAE/ANSI STANDARD 15. INSTALL THE REFRIGERANT LINE SET UNDER THE ROOF DECK TO WITHIN 3'-0" OF THE REMOTE CONDENSER. IF REFRIGERANT PIPING TO ICE MACHINE IS EXPOSED TO PUBLIC VIEW, CONCEAL WITHIN A STAINLESS STEEL SHROUD AS SHOWN IN THE ARCHITECTURAL DRAWINGS.
3	INSTALL ROOFTOP EQUIPMENT PER MANUFACTURER'S INSTALLATION INSTRUCTIONS AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
4	INSTALL EXHAUST FAN EF-1 PER DETAIL 8/M-700 AND AS DETAILED IN THE ARCHITECTURAL AND STRUCTURAL DRAWINGS. INSTALL GREASE VIROGUARD SYSTEM FURNISHED BY CHIPOTLE ON EXHAUST FAN EF-1.
5	INSTALL REME HALO AIR PURIFIER FURNISHED BY TUV IN RTU PER DETAIL 5/M-700. SEE ELECTRICAL DRAWINGS FOR POWER CONNECTION INFORMATION. INSTALL UV WARNING STICKERS ON FACE OF ENCLOSURE PER DETAIL AND ON ANY RTU ACCESS DOOR(S) THROUGH WHICH THE REME HALO WOULD BE VISIBLE IF OPENED.

	KEYNOTES FOR THIS SHEET 1 , 2 ETC.
6	MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER FLUE TERMINATION AND OUTSIDE AIR INTAKES. MAINTAIN 10' CLEARANCE BETWEEN WATER HEATER COMBUSTION AIR INTAKE AND EXHAUST FAN EF-1 DISCHARGE. SEE PLUMBING DRAWINGS FOR MORE INFORMATION ON WATER HEATER FLUE AND COMBUSTION AIR TERMINATIONS.
7	10'-0" MIN. CLEARANCE FROM OUTER EDGE OF EXHAUST FAN TO FRESH AIR INTAKES. TYPICAL.
8	PROVIDE (N) RTU IN LOCATION OF (E) TO BE REMOVED RTU. VERIFY (E) CURB DIMENSIONS & NOTIFY CARRIER TO DETERMINE IF CURB ADAPTOR IS REQUIRED. VERIFY (E) RTU LOCATION & ASSOCIATED ROOF OPENING(S) IN FIELD.
9	CONFIRM LOCATION OF REME HALO AIR PURIFIER INSTALLATION WITH LENNOX PRIOR TO ROUGH-IN, AS NOTED IN DETAIL 5/M-700,
10	(E) RTU TO REMAIN. REPAIR & REFURBISH AS NECESSARY TO ENSURE PROPER WORKING ORDER. VERIFY (E) RTU LOCATION & ASSOCIATED ROOF OPENING(S) IN FIELD.

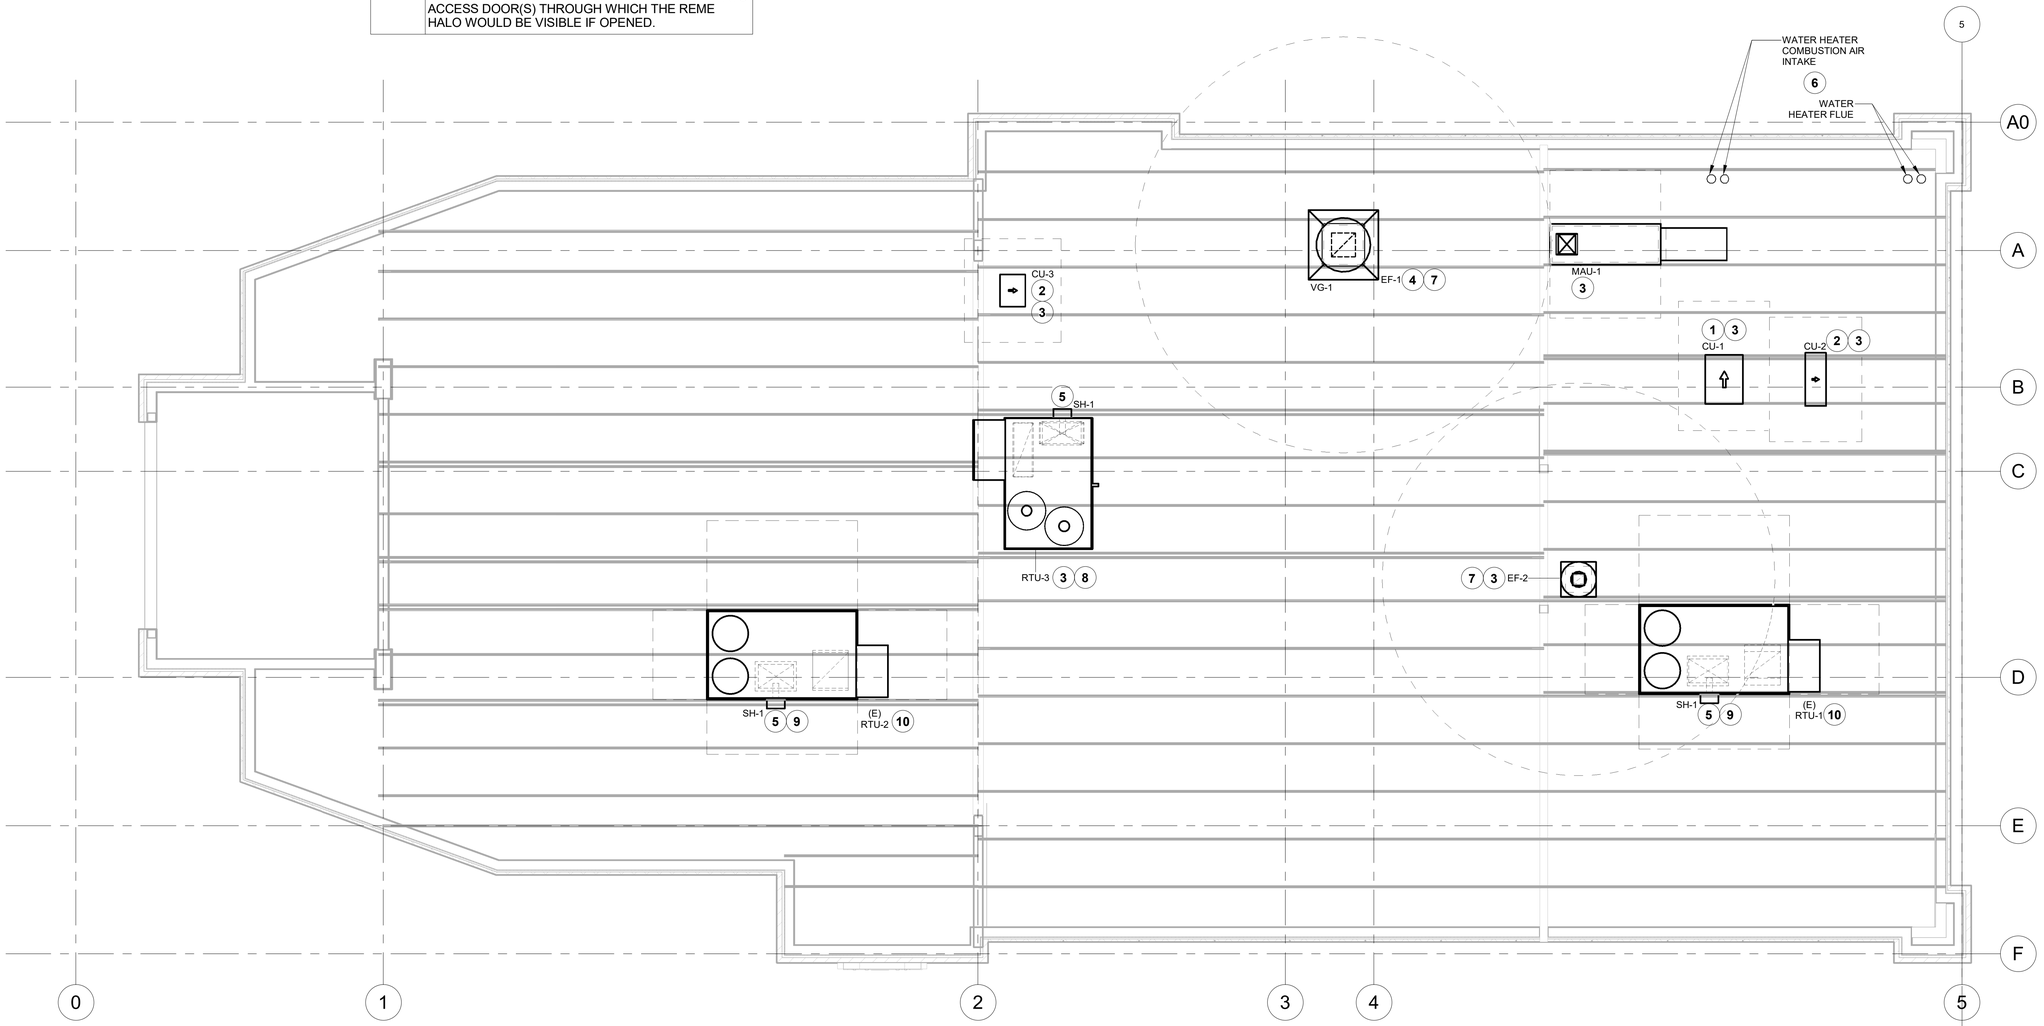

1 HVAC ROOF PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
HVAC ROOF PLAN

SHEET NUMBER:
M-101

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

FOR QUESTIONS, CALL THE
Highwoods Group
REGION 40
PHONE: (919) 875 - 0420
EMAIL: reg40@captiveaire.com

PATENT NUMBERS

AC-PSP (UNITED STATES) - US PATENT 7963830 B2.
AC-PSP WALL (CANADA) - CA PATENT 2820509.
AC-PSP ISLAND (CANADA) - CA PATENT 2520330.

HOOD INFORMATION - JOB#6017478

HOOD NO	TAG	MODEL	MANUFACTURER	LENGTH	MAX COOKING TEMP	TYPE	APPLIANCE DUTY	DESIGN CFM/FT	TOTAL EXH CFM	EXHAUST PLENUM RISER(S) WIDTH	LENG	HEIGHT	DIA	CFM	VEL	SP	MUA CFM	AC CFM	HOOD CONSTRUCTION	HOOD CONFIG END TO END	ROW
1		5424 ND-2-ACPSP-F	CAPTIVEAIRE	12' 9"	600 DEG	I	HEAVY	200	2550	10"	24"	4"		2550	1530	-0.966"	1300	696	430 SS WHERE EXPOSED	ALONE	ALONE

HOOD INFORMATION


HOOD NO	TAG	FILTER(S) TYPE	QTY	HEIGHT	LENGTH	EFFICIENCY @ 7 MICRONS	LIGHT(S) QTY	TYPE	WIRE GUARD	UTILITY CABINET(S) LOCATION	SIZE	FIRE SYSTEM TYPE	FIRE SYSTEM SIZE	ELECTRICAL MODEL #	SWITCHES QUANTITY	FIRE SYSTEM PIPING	HOOD HANGING WEIGHT
1		CAPTRATE SOLO FILTER	9	16"	16"	85% SEE FILTER SPEC	8	L55 SERIES E26	NO	RIGHT	12"x54"x24"	TANK FS	4.0/4.0	SC-311110MA	1 LIGHT 1 FAN	YES	1192 LBS

HOOD OPTIONS

HOOD NO	TAG	OPTION
1		FIELD WRAPPER 10.00" HIGH FRONT, LEFT, RIGHT.
		INSULATION FOR BACK OF HOOD.
		RISER SENSOR INSTALL 6IN PLEN.
		RIGHT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 80" HIGH INSULATED 430 SS.
		LEFT VERTICAL END PANEL 27" TOP WIDTH, 21" BOTTOM WIDTH, 80" HIGH INSULATED 430 SS.
		FULL DIMENSION HANGING BRACKET - FRONT.

PERFORATED SUPPLY PLENUM(S)


HOOD NO	TAG	POS	LENGTH	WIDTH	HEIGHT	TYPE	RISER(S) WIDTH	LENG	DIA	CFM	SP
1		Front	165"	19"	6"	MUA	6"	28"		432	0.127"
						MUA	6"	28"		432	0.127"
						MUA	6"	28"		432	0.127"
						AC			8"	116	0.043"
						AC			8"	116	0.043"
						AC			8"	116	0.043"
						AC			8"	116	0.043"
						AC			8"	116	0.043"
						AC			8"	116	0.043"

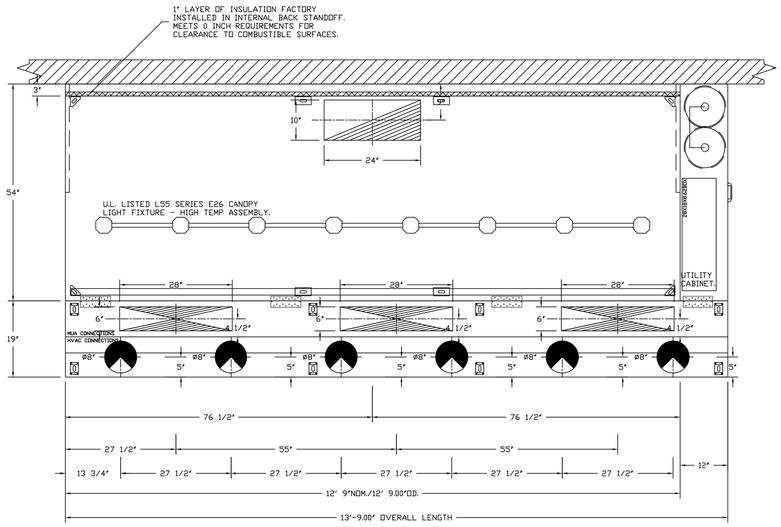

PLAN VIEW - HOOD #1
12' 9.00" LONG 5424ND-2-ACPSP-F
NOTE: ADDITIONAL HANGING ANGLES PROVIDED FOR HOODS 12' AND LONGER.

ACPSP SHIPS LOOSE FOR FIELD INSTALLATION

HOOD CORNER HANGING ANGLE (HARDWARE BY INSTALLER)



ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION BENEATH HOOD HANGING ANGLES AND ABOVE CEILING ANCHORS. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

SPECIFICATION: CAPTRATE® GREASE-STOP® SOLO FILTER

THE CAPTRATE GREASE-STOP SOLO FILTER IS A SINGLE-STAGE FILTER FEATURING A UNIQUE S-BAFFLE DESIGN IN CONJUNCTION WITH A SLOTTED REAR BAFFLE DESIGN, TO DELIVER EXCEPTIONAL FILTRATION EFFICIENCY.


FILTER IS STAINLESS STEEL CONSTRUCTION, AND SIZED TO FIT INTO STANDARD 2-INCH DEEP HOOD CHANNEL(S).

UNITS SHALL INCLUDE STAINLESS STEEL HANDLES AND A FASTENING DEVICE TO SECURE THE TWO COMPONENTS WHEN ASSEMBLED.


GREASE EXTRACTION EFFICIENCY PERFORMANCE SHALL REMOVE AT LEAST 75% OF GREASE PARTICLES FIVE MICRONS IN SIZE, AND 85% GREASE PARTICLES SEVEN MICRONS IN SIZE AND LARGER, WITH A CORRESPONDING PRESSURE DROP NOT TO EXCEED 1.0 INCHES OF WATER GAUGE.

THE CAPTRATE GREASE-STOP SOLO WAS TESTED TO ASTM STANDARD ASTM F2519-05. MANUFACTURER APPROVED FOR USE IN SOLID FUEL APPLICATIONS AS A SPARK ARRESTER.

EFFICIENCY VS. PARTICLE DIAMETER




PRESSURE DROP VS. FLOW RATE



CAPTRATE FILTERS ARE BUILT IN COMPLIANCE WITH.
NFPA #96.
NSF STANDARD #2.
UL STANDARD #1046.
INT. MECH. CODE (IMC).
ULC-S649.


FULL LENGTH HANGING ANGLE (HARDWARE BY INSTALLER)

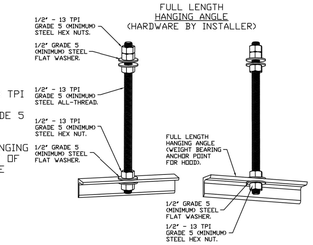

ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION ABOVE CEILING ANCHORS. SINGLE HEX NUT BENEATH HANGING ANGLE IS ACCEPTABLE FOR FULL LENGTH HANGING ANGLES. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

SUPPLY PLENUM HANGING ANGLE (HARDWARE BY INSTALLER)



ASSEMBLY INSTRUCTIONS

HANGING ANGLE MUST BE SUPPORTED WITH 1/2" - 13 TPI GRADE 5 (MINIMUM) ALL-THREAD. SANDWICH HANGING ANGLES AND CEILING ANCHOR POINTS WITH 1/2" GRADE 5 (MINIMUM) STEEL FLAT WASHERS AND 1/2" - 13 TPI GRADE 5 (MINIMUM) HEX NUTS AS SHOWN. MUST USE DOUBLED HEX NUT CONFIGURATION ABOVE CEILING ANCHORS. SINGLE HEX NUT BENEATH HANGING ANGLE IS ACCEPTABLE FOR PSP HANGING ANGLES. MAINTAIN 1/4" OF EXPOSED THREADS BENEATH BOTTOM HEX NUT. TORQUE ALL HEX NUTS TO 57 FT-LBS.

REVISIONS

	DESCRIPTION	DATE:
1		
2		
3		
4		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023
DWG.#: 6017478
DRAWN BY: JMB-40
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 1

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER: 21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-401

2024-DB#2/P#1-2

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

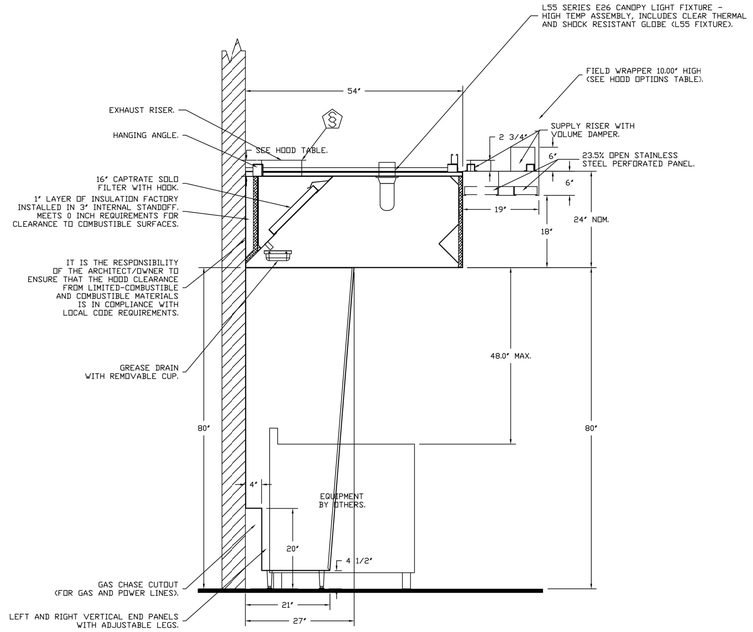

SECTION VIEW - MODEL 5424ND-2-ACPSP-F
HOOD - #1

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE

Highwoods Group

4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com

www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 2

Consultant:

Polaris Consulting Engineers, PC

214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:

CAPTIVEAIRE DRAWINGS

SHEET NUMBER:

M-402

2024-DB#2/P#1-2

HOOD SHOP DRAWING PRODUCED BY
MANUFACTURER - FOR REFERENCE ONLY

FIRE SYSTEM INFORMATION – JOB#6017478

FIRE SYSTEM NO	TAG	TYPE	SIZE	MAX FP	DESIGN FP	INSTALLATION	
						SYSTEM	LOCATION ON HOOD
1		TANK FS	4.0/4.0	40	32	FIRE CABINET RIGHT	RIGHT, HOOD :

GAS VALVE(S)

FIRE SYSTEM NO	TAG	TYPE	SIZE	SUPPLIED BY
1		SC ELECTRICAL	2.000	CAPTIVEAIRE SYSTEMS

FIRE SYSTEM PARTS LIST KEY

FIRE SYSTEM NO	TAG	KEY NUMBER - PART DESCRIPTION	QTY BY FACTORY	QTY BY DIST
1		0 - 0 - TANK FIRE SUPPRESSION POST-DISCHARGE PROCEDURE UTILITY CABINET LABEL SHEET.	1	0
		0 - 0 - TANK FIRE SUPPRESSION MAINTENANCE GUIDE UTILITY CABINET LABEL SHEET.	1	0
		0 - 0 - 12-F28021-32144-QT-360 DUCT FIRE THERMOSTAT WITH 12 FOOT WIRE LEADS. NO, CLOSE ON TEMP RISE AT 360°F.	1	0
		0 - 0 - 32-00002 QUIK SEAL - 1/2" (UL).	1	0
		0 - 0 - 4429K153 1/2" MALE NPT TO 1/2" FEMALE NPT ELBOW, BRASS.	2	0
		0 - 0 - 4429K422 1/2" X 1/4" BRASS REDUCING BUSHING.	1	0
		0 - 0 - 79525 1/2" 90 PRO-PRESS ELBOW WITH 1/2" NPT FEMALE CONNECTION, VIEGA.	1	0
		0 - 0 - 79580 1/2" X 1/2" PRO-PRESS TEE X 1/2" NPT FEMALE CONNECTION, VIEGA.	2	0
		0 - 0 - 87-120042-001 SECONDARY ACTUATOR VALVE (SVA) - SINGLE ACTUATOR, REQUIRES PRIMARY RELEASE ACTUATOR, TANK FIRE SUPPRESSION.	1	0
		0 - 0 - 87-120045-001 HOSE, SECONDARY ACTUATOR HOSE, 7.5" BRAIDED STAINLESS STEEL, TANK FIRE SUPPRESSION.	1	0
		0 - 0 - 87-300001-001 TANK - PRESSURIZED TANK USED FOR TANK FIRE SUPPRESSION.	2	0
		0 - 0 - 87-300030-001 PRIMARY ACTUATOR KIT (PAK) - ACTUATOR AND RELEASE SOLENOID ASSEMBLY, ONE NEEDED PER FIRE SYSTEM, SUPERVISED, TANK FIRE SUPPRESSION.	1	0
		0 - 0 - 87-300152-001 HARDWARE, SVA BOLTS, TANK FIRE SUPPRESSION.	8	0
		0 - 0 - 9055455PC PRO PRESS 1/2 PRESS X PRESS 90 ELBOW LD.	7	0
		0 - 0 - 9097200PC PRO PRESS PC611 1/2 PRESS TEE LD.	7	0
		0 - 0 - 98694A115 HARDWARE, DATANKLOCK LOCKING BRACKET SQUARE NUTS 5/16" ZINC, TANK FIRE SUPPRESSION.	4	0
		0 - 0 - A0034332 JUNCTION BOX FOR MANUAL PULL STATION. 1.5" DEEP BACK BOX, RED COLOR.	1	0
		0 - 0 - A31484 1/4" NPT SCHRADER VALVE AND CAP, JB INDUSTRIES. 1/4" FLARE X 1/4" MPT HALF UNION. USED ON TANK SERVICE PORT.	1	0
		0 - 0 - BI145 3/8" BLACK IRON 90 ELL.	3	0
		0 - 0 - DATANKLOCK DISCHARGE ADAPTER TANK LOCKING PLATE FOR FIRE SYSTEM TANK INSTALLATION IN UTILITY CABINETS, TANK FIRE SUPPRESSION.	2	0
		0 - 0 - TANK STRAP TANK STRAP - USED FOR TANK FIRE SUPPRESSION.	6	0
		0 - 0 - TFS-UCTANKBRACKET TANK BRACKET FOR FIRE SYSTEM TANK INSTALLATION IN UTILITY CABINETS, TANK FIRE SUPPRESSION.	2	0
		0 - 0 - WK-283952-000 DISCHARGE ADAPTER, TANK FIRE SUPPRESSION.	2	0
		16 - 16 - 79210 1/2" X 3/8" NPT MALE ADAPTER, VIEGA.	8	0
		16 - 16 - DL-F NOZZLE - TANK PROTECTION APPLIANCE COVERAGE NOZZLE (INCLUDES METAL BLOW OFF CAP, LANYARD, USED WITH CHROME-PLATED PIPE).	8	0
		26 - 26 - QSA-3/8 QUIK SEAL - 3/8" (UL).	8	0
		34 - 34 - A0034331 24VDC SINGLE ACTION MANUAL ACTUATION DEVICE (PUSH/PULL STATION) WITH PROTECTIVE COVER, ONE (1) NORMALLY OPEN CONTACT. RED COLOR.	1	0

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE

Highwoods Group

4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com

www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064

TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 3

Consultant:

Polaris Consulting Engineers, PC

214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:


CAPTIVEAIRE
DRAWINGS

SHEET NUMBER:

M-403

2024-DB#2/P#1-2

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

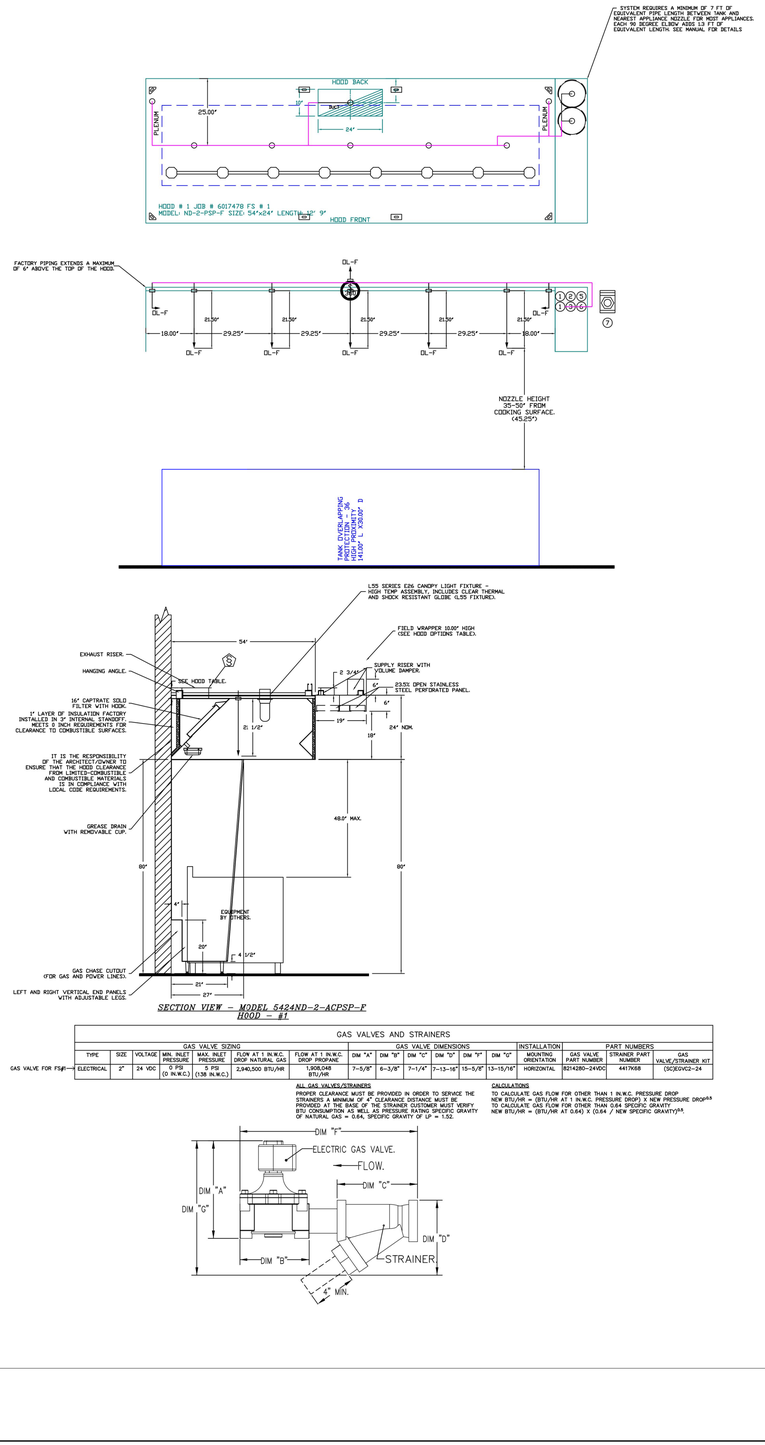

SECTION VIEW - MODEL 5424ND-2-ACPSP-F HOOD - #1

NOTES
- FIELD PIPE DROPS AS SHOWN
  PIPING, ELBOWS, TEES, AND NOZZLES SUPPLIED BY CAS.
- FIELD INSTALLED DROP: FACTORY WILL PROVIDE QTY 2 60IN LONG PIECES OF CHROME PLATED PIPING SHIPPED LOOSE TO BE FIELD-INSTALLED.
- SHIP LOOSE DROP: FACTORY WILL PROVIDE THE EXACT CHROME PIPE LENGTH NEEDED SHIPPED LOOSE TO BE FIELD-INSTALLED.
- RELOCATE NOZZLES IF FLOW PATTERN IS BLOCKED BY SHELVING, SALAMANDERS, ETC.
- OVERLAPPING COVERAGE SHALL NOT BE USED ON ANY APPLIANCE WITH AN OBSTRUCTION.
- IF APPLICABLE, EXTENDED PRE-PIPED DROPS ARE SHIPPED LOOSE.
- FACTORY PIPING EXTENDS A MAXIMUM OF 6" ABOVE THE TOP OF THE HOOD.

- APPLIANCE DIMENSIONS LISTED REPRESENT THE COOKING SURFACE SIZE, NOT THE OVERALL APPLIANCE SIZE.

- THIS FIRE SYSTEM COMPLIES WITH U.L. 300 REQUIREMENTS.

- DL-F NOZZLE PART NUMBER REPLACES 3070-3/8H-10-SS

JOB #: 601747B.
JOB NAME: CHIPOTLE HAMILTON NJ #4064.

SYSTEM SIZE: TANK-SP-2 DESIGN FP: 32. MAXIMUM FP: 40.
HOOD # 1 12' 9.00" LONG x 54" WIDE x 24" HIGH.
RISER # 1 SIZE: 10" x 24".
HOOD # 1 METAL BLOW-OFF CAPS INCLUDED.

- HEAVY-DUTY APPLIANCES (RATED 600°F) WILL REQUIRE AN ADDITIONAL DOWNSTREAM FIRESTAT IN THE EVENT THAT THE DUCTWORK CONTAINS ANY HORIZONTAL RUNS OVER 25 FT IN LENGTH.
- MEDIUM TO LIGHT-DUTY APPLIANCES (RATED 450°F) WILL NOT REQUIRE ANY ADDITIONAL DOWNSTREAM DETECTION.

LEGEND - FIRE CABINET TANK SYSTEM

1 4 GALLON TANK.
2 PRIMARY ACTUATOR RELEASE.
3 SECONDARY ACTUATOR RELEASE.
4 PRESSURE SUPERVISION SWITCH.
5 PRIMARY HOSE ASSEMBLY.
6 SECONDARY HOSE ASSEMBLY.
7 REMOTE MANUAL ACTUATION DEVICE.

INCLUDES: FIELD INSTALLATION AND HOOKUP DURING NORMAL BUSINESS HOURS BY CERTIFIED INSTALLERS ONLY IN THE LOCATION NOTED ABOVE. TWO SITE VISITS ONLY (ONE VISIT TO SET PULL STATION & SYSTEM HOOKUP AND ONE VISIT FOR ONE TEST; ADDITIONAL VISITS WILL RESULT IN ADDITIONAL CHARGES). ONE MECHANICAL OR ELECTRICAL GAS VALVE PER SYSTEM AT A MAXIMUM SIZE OF 2", PERMIT, AND SYSTEM TEST.
EXCLUDES: UNION LABOR & PREVAILING WAGE (LABOR & WAGES WILL BE ADDED IF APPLICABLE). GAS VALVE INSTALLATION, ELECTRICAL HOOKUP AND CONNECTIONS, HANGING OF FIRE CABINET, SHUNT TRIP, HANDHELD EXTINGUISHER(S), ON-SITE RE-PIPING DUE TO EQUIPMENT LAYOUT CHANGES.

GAS VALVE FOR FS#1

GAS VALVES AND STRAINERS														
GAS VALVE SIZING						GAS VALVE DIMENSIONS						INSTALLATION	PART NUMBERS	
TYPE	SIZE	VOLTAGE	MIN. INLET PRESSURE	MAX. INLET PRESSURE	FLOW AT 1 IN.W.C. DROP NATURAL GAS	FLOW AT 1 IN.W.C. DROP PROPANE	DIM "A"	DIM "B"	DIM "C"	DIM "D"	DIM "F"	DIM "G"	MOUNTING ORIENTATION	GAS VALVE PART NUMBER	STRAINER PART NUMBER	GAS VALVE/STRAINER KIT
ELECTRICAL	2"	24 VDC	0 PSI (0 IN.W.C.)	5 PSI (138 IN.W.C.)	2,940,500 BTU/HR	1,908,048 BTU/HR	7-5/8"	6-3/8"	7-1/4"	7-13-16"	15-5/8"	13-15/16"	HORIZONTAL	8214280-24VDC	4417068	(SC)ECVC2-24

ALL GAS VALVES/STRAINERS
PROPER CLEARANCE MUST BE PROVIDED IN ORDER TO SERVICE THE GAS VALVE AND STRAINER. THE GAS VALVE AND STRAINER PROVIDED AT THE BASE OF THE STRAINER CUSTOMER MUST VERIFY BTU CONSUMPTION AS WELL AS PRESSURE RATING SPECIFIC GRAVITY OF NATURAL GAS = 0.64, SPECIFIC GRAVITY OF LP = 1.52.

CALCULATIONS
TO CALCULATE GAS FLOW FOR OTHER THAN 1 IN.W.C. PRESSURE DROP NEW BTU/HR = (BTU/HR AT 0.64) X (0.64 / NEW SPECIFIC GRAVITY)^0.5. TO ADJUST GAS FLOW FOR OTHER THAN 0.64 SPECIFIC GRAVITY NEW BTU/HR = (BTU/HR AT 0.64) X (0.64 / NEW SPECIFIC GRAVITY)^0.5.

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: regt40@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023
DWG.#: 6017478
DRAWN BY: JMB-40
SCALE: 1/2" = 1'-0"
MASTER DRAWING
SHEET NO. 4

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER: 21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-404

2024-DB#2/P#1-2

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

EXHAUST FAN INFORMATION – JOB#6017478

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	MANUFACTURER	CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	DISCHARGE VELOCITY	WEIGHT (LBS)	SONES
1	EF-1	1	DU180HFA	CAPTIVEAIRE	2550	1.450	1221	ODP,PREMIUM	2.000	1.2790	3	208	8.3	589 FPM	183	16.7
2	EF-2	1	DR12HFA	CAPTIVEAIRE	150	0.600	1282	TEAO-ECM	0.250	0.0930	1	115	2.9		50	6.1

MUA FAN INFORMATION – JOB#6017478

FAN UNIT NO	TAG	QTY	FAN UNIT MODEL #	BLOWER	HOUSING	MIN CFM	DESIGN CFM	ESP	RPM	MOTOR ENCL	HP	BHP	PHASE	VOLT	FLA	MCA	MOCP	WEIGHT (LBS)	SONES
3	MAU-1	1	A1-D.250-15D	15MF-1-MOD	A1-D.250	1000	1300	0.500	1546	ODP,PREMIUM	1.000	0.5670	3	208	3.1	3.9A	15A	495	12.1

GAS FIRED MAKE-UP AIR UNIT(S)

FAN UNIT NO	TAG	INPUT BTUs	OUTPUT BTUs	TEMP RISE	REQUIRED INPUT GAS PRESSURE	GAS TYPE	BURNER EFFICIENCY(%)
3	MAU-1	90289	83066	60°F	7 IN. W.C. – 14 IN. W.C.	NATURAL	92

FAN OPTIONS

FAN UNIT NO	TAG	QTY	DESCRIPTION
1	EF-1	1	GREASE BOX
		1	2 YEAR PARTS WARRANTY
2	EF-2	1	I 12-BDD DAMPER
		1	ECM WIRING PACKAGE - MANUAL OR 0-10VDC REFERENCE SPEED CONTROL -RTC- (TELCO MOTOR), CCW ROTATION
		1	2 YEAR PARTS WARRANTY
3	MAU-1	1	SIZE 1 TEMPERED COMMERCIAL DOWN DISCHARGE FOR DIRECT DRIVE AHUS
		1	INLET PRESSURE GAUGE, 0-35"
		1	MANIFOLD PRESSURE GAUGE, -5 TO 15" WC
		1	SHIP LOOSE GAS STRAINER 3/4"
		1	MOTORIZED BACKDRAFT DAMPER FOR A1-D HOUSING - MEETS AMCA CLASS 1A RATING
		1	SEPARATE 120V WIRING PACKAGE (REQUIRED AND USED ONLY FOR DCV OR PREWIRE WITH VFD) - THREE PHASE ONLY
		1	2 YEAR PARTS WARRANTY


FAN ACCESSORIES

FAN UNIT NO	TAG	EXHAUST			SUPPLY			
		GREASE CUP	GRAVITY DAMPER	WALL MOUNT	SIDE DISCHARGE	GRAVITY DAMPER	MOTORIZED DAMPER	WALL MOUNT
1	EF-1	YES						
2	EF-2		YES					
3	MAU-1						YES	

CURB ASSEMBLIES

NO	ON FAN	TAG	WEIGHT	ITEM	SIZE
1	# 1	EF-1	37 LBS	CURB	26.500"W X 26.500"L X 20.000"H VENTED.
2	# 2	EF-2	31 LBS	CURB	17.500"W X 17.500"L X 26.000"H.
3	# 3	MAU-1	65 LBS	CURB	21.000"W X 71.000"L X 20.000"H INSULATED.

HMI SCHEDULE				
UNIT NUMBER	HMI #	HMI LOCATION	TEMP AVERAGING	MODBUS ADDRESS
FAN #3	HMI #1 - UNIT HMI #1	MOUNTED IN UNIT	NOT AVERAGED	55
FAN #3	HMI #1 - SPACE HMI #0	MOUNTED IN UNIT	NOT AVERAGED	55

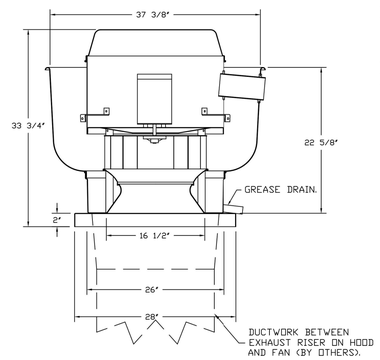

FAN #1 DU180HFA - EXHAUST FAN (EF-1)

FEATURES:


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- RESTAURANT MODEL.
- UL705 AND UL762 AND ULC-S645
- VARIABLE SPEED CONTROL.
- INTERNAL WIRING.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).
- HIGH HEAT OPERATION 300°F (149°C).
- GREASE CLASSIFICATION TESTING.
- NEMA 3R SAFETY DISCONNECT SWITCH.


NORMAL TEMPERATURE TEST
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING AIR AT 300°F (149°C) UNTIL ALL FAN PARTS HAVE REACHED THERMAL EQUILIBRIUM, AND WITHOUT ANY DETERIORATING EFFECTS TO THE FAN WHICH WOULD CAUSE UNSAFE OPERATION.

ABNORMAL FLARE-UP TEST
EXHAUST FAN MUST OPERATE CONTINUOUSLY WHILE EXHAUSTING BURNING GREASE VAPORS AT 600°F (316°C) FOR A PERIOD OF 15 MINUTES WITHOUT THE FAN BECOMING DAMAGED TO ANY EXTENT THAT COULD CAUSE AN UNSAFE CONDITION.

OPTIONS

- GREASE BOX.
- 2 YEAR PARTS WARRANTY.

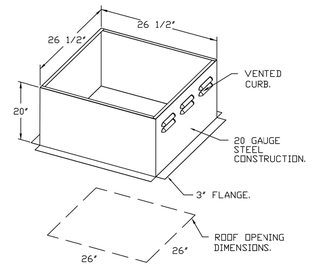



TOP VIEW

REVISIONS

	DESCRIPTION	DATE:
1		
2		
3		
4		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: mg40@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 5

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-405

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

FAN #2 DR12HFA - EXHAUST FAN (EF-2)

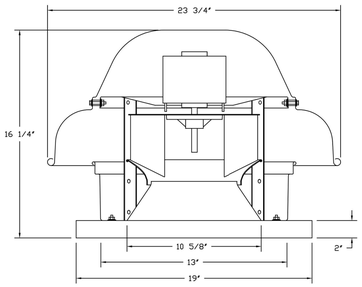


FEATURES:


- DIRECT DRIVE CONSTRUCTION (NO BELTS/PULLEYS).
- ROOF MOUNTED FANS.
- UL705.
- SAFETY DISCONNECT.
- STANDARD BIRD SCREEN.
- SPEED CONTROL.
- THERMAL OVERLOAD PROTECTION (SINGLE PHASE).


OPTIONS

- 1 12-BDD DAMPER.
- ECM WIRING PACKAGE - MANUAL OR 0-10VDC REFERENCE SPEED CONTROL -RTC- (TELCO MOTOR), CCW ROTATION.
- 2 YEAR PARTS WARRANTY.

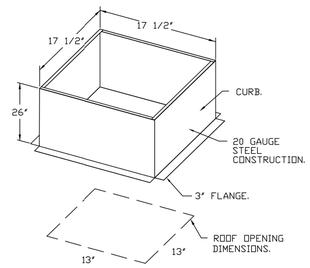

BACKDRAFT DAMPER INSTALLATION



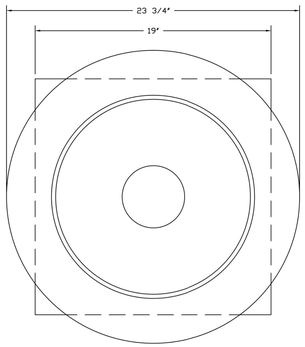

TOP VIEW

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE

Highwoods Group

4641 Paragon Park Rd., Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com

www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 6

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC

214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:

CAPTIVEAIRE DRAWINGS

SHEET NUMBER:

M-406


HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY


FAN #2 A1-D250-15D - HEATER (MAU-1)
1. DIRECT GAS FIRED HEATED MAKE UP AIR UNIT WITH 15" MIXED FLOW DIRECT DRIVE FAN.
2. INTAKE HOOD WITH EZ FILTERS.
3. DOWN DISCHARGE - AIR FLOW RIGHT -> LEFT.
4. DOWN DISCHARGE CONSTRUCTION FOR SIZE 1 DIRECT DRIVE AHUS.
5. GAS PRESSURE GAUGE, 0-25", 2.5" DIAMETER, 1/4" THREAD SIZE.
6. GAS PRESSURE GAUGE, -5 TO +15 INCHES WC, 2.5" DIAMETER, 1/4" THREAD SIZE.
7. SHIP LOOSE GAS STRAINER. TO BE INSTALLED UPSTREAM OF UNIT CONNECTION. 3/4" CONNECTION.
8. MOTORIZED BACK DRAFT DAMPER 16" X 18" FOR SIZE 1 STANDARD & MODULAR HEATER UNITS W/EXTENDED SHAFT, STANDARD GALVANIZED CONSTRUCTION, 3/4" REAR FLANGE, LOW LEAKAGE, TF8120S ACTUATOR INCLUDED.
9. SEPARATE 120VAC WIRING PACKAGE FOR MAKE-UP AIR UNITS. OPTION MUST BE SELECTED WHEN MOUNTING VFD IN PREWIRE PANEL OR WITH DCV PACKAGE. PROVIDES SEPARATE 120VAC INPUT TO SUPPLY FAN. THIS 120V SIGNAL MUST BE RUN BY ELECTRICIAN FROM DCV TO MUA SWITCH.
10. HINGED DOUBLE WALL INSULATED DOOR ASSEMBLY (BURNER/BLOWER SECTION).
11. 2 YEAR PARTS WARRANTY.

*NOTE: SUPPLY DUCT MUST BE INSTALLED TO MEET SMACNA STANDARDS. A MINIMUM STRAIGHT DUCT LENGTH MUST BE MAINTAINED DOWNSTREAM OF UNIT DISCHARGE AS OUTLINED IN AMCA PUBLICATION 201. WHEN USING RECTANGULAR DUCTWORK, ELBOWS MUST BE RADIUS THROAT, RADIUS BACK WITH TURNING VANES. FLEXIBLE DUCTWORK AND SQUARE THROAT/SQUARE BACK ELBOWS SHOULD NOT BE USED. ANY TRANSITION AND/OR TURNS IN THE DUCTWORK WILL CAUSE SYSTEM EFFECT. SYSTEM EFFECT WILL DRASTICALLY INCREASE STATIC PRESSURE AND REDUCE AIRFLOW. DO NOT RELY ON UNIT TO SUPPORT DUCT IN ANY WAY. FAILURE TO PROPERLY SIZE DUCTWORK MAY CAUSE SYSTEM EFFECTS AND REDUCE PERFORMANCE OF THE EQUIPMENT.
SUGGESTED STRAIGHT DUCT SIZE IS 14" x 14".

SUPPLY SIDE HEATER INFORMATION:

WINTER TEMPERATURE = 15°F. TEMP. RISE = 60°F.
BTUs CALCULATED OFF ACTUAL AIR DENSITY.
OUTPUT BTUs AT ALTITUDE OF 0.0 FT. = 83331.
INPUT BTUs AT ALTITUDE OF 0.0 FT. = 90577.
OUTPUT BTUs AT ALTITUDE OF 88 FT. = 83066.
INPUT BTUs AT ALTITUDE OF 88 FT. = 90289.

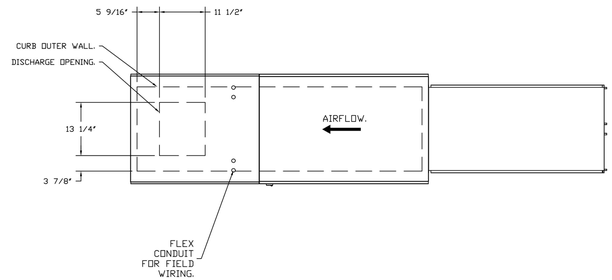




DIRECT FIRED (DF) PROFILE PLATE ASSEMBLY

DIRECT FIRED PROFILE PLATE SPECIFICATIONS:
DESCRIPTION:
DIRECT FIRED BURNERS SHALL HAVE PATENTED (US PATENT NO: US6629523B2), SELF-ADJUSTING PROFILE PLATES DESIGNED TO ENSURE PROPER AIR VELOCITY AND PRESSURE DROP ACROSS THE BURNER. PROFILE PLATES SHALL ALLOW BURNERS TO ACHIEVE CLEAN COMBUSTION BY LIMITING BY-PRODUCT LEVELS TO A MAXIMUM OF 9PPM OF CARBON MONOXIDE (CO), AND 0.5PPM OF NITROGEN DIOXIDE (NO2)DIRECT FIRED UNITS SHALL BE CONFIGURED WITH THE BLOWER MOUNTED DOWNSTREAM OF THE BURNER. THIS ARRANGEMENT WILL ENSURE A CONSISTENT AIRFLOW, REGARDLESS OF INLET AIR TEMPERATURE.


APPLICATION:
SPRING-LOADED BURNER PROFILE PLATES ARE ENGINEERED TO AUTOMATICALLY REACT TO THE MOMENTUM OF A FRESH AIR STREAM, WITHOUT THE NEED FOR ANY MOTORS OR ACTUATORS TO MECHANICALLY ADJUST THEM. WITH THIS FEATURE, ALL DF UNITS ARE DESIGNED FOR DEMAND CONTROL VENTILATION (DCV) REQUIREMENTS.

CERTIFICATIONS:
ALL PROFILE PLATE ASSEMBLIES SHALL BE INCLUDED IN THE DF UNIT'S ETL LISTING AND COMPLY WITH COMBINED SAFETY STANDARDS ANSI Z83.4 AND CSA 3.7 (NON-RECIRCULATING DF HEATERS) AND ANSI Z83.18 (RECIRCULATING DF HEATERS).


GENERAL CONSTRUCTION:
-PROFILE PLATES SHALL BE FORMED FROM G90 GALVANIZED STEEL.
-PROFILE PLATES SHALL VARY IN SIZE PER UNIT.
-PROFILE PLATES SHALL BE MOUNTED ALONG THE SAME PLANE AS THE DISCHARGE OF THE BURNER.
-DESIGN SHALL INCORPORATE PROPERLY TORQUED, PERMANENTLY MOUNTED SPRING HINGES.
-SPRING HINGES SHALL BE MADE FROM PLATED STEEL.

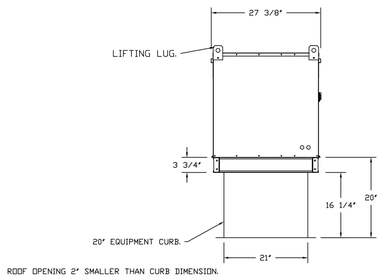

ROOF OPENING 2" SMALLER THAN CURB DIMENSION.

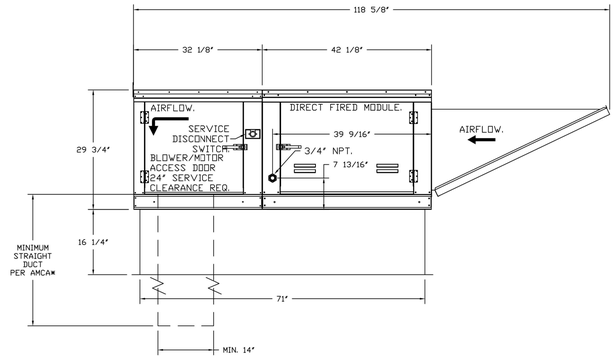

OPTIONS:
- FULL BOTTOM CORNERS.

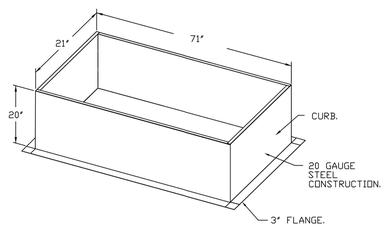

2024-DB#2/P#1-2

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC. 27616 PHONE: (919) 875 - 0420 FAX: 8198750577 EMAIL: rep40@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023
DWG.#: 6017478
DRAWN BY: JMB-40
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 7

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077


PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER: 21008


SHEET TITLE:
CAPTIVEAIRE DRAWINGS


SHEET NUMBER:
M-407

HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

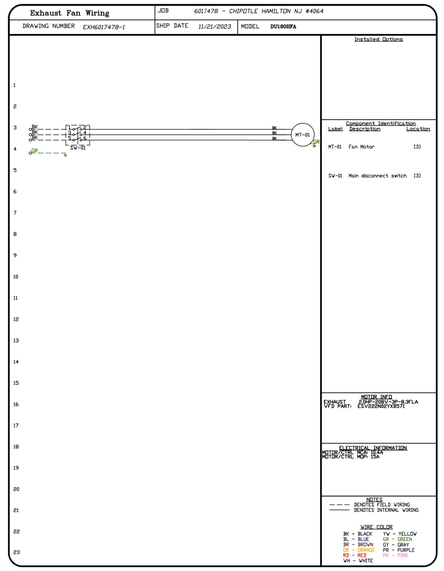

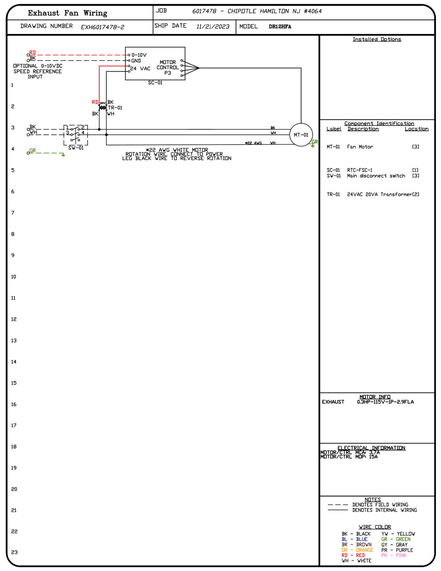

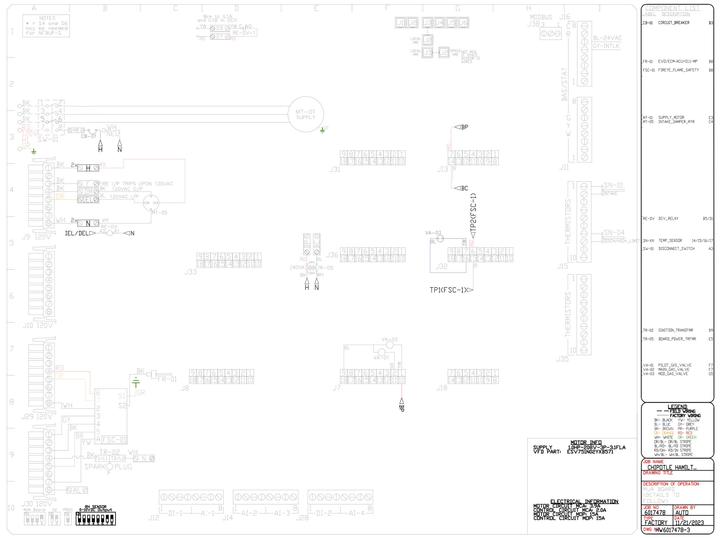

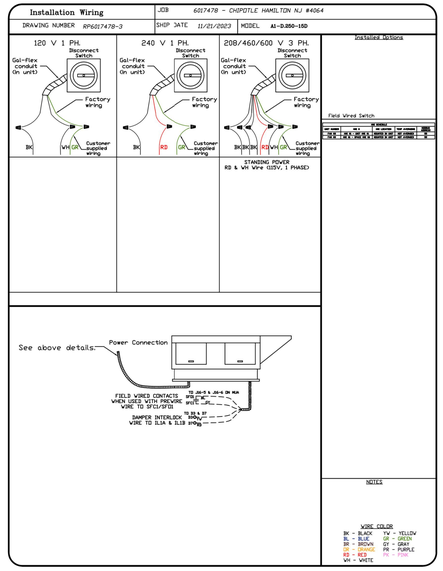

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: regi40@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 8

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-408


HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY

ELECTRICAL PACKAGE – JOB#6017478

NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED					
				LOCATION	QUANTITY		FAN TAG	TYPE	Φ	HP	VOLT	FLA
1		SC-311110MA	UTILITY CABINET RIGHT	UTILITY CABINET RIGHT	1 LIGHT	SMART CONTROLS THERMOSTATIC CONTROL W/ RELAY ON/OFF WITH SUPPLY	EF-1	EXHAUST	3	2.000	208	8.3
				HOOD # 1	1 FAN		MAU-1	SUPPLY	3	1.000	208	3.1


JOB NO 6017478 | MODEL NUMBER SC-311110MA | JOB NAME CHIPOTLE HAMILTON NJ #4064 | DRAWN BY | DATE 11/21/2023 | SCHEMATIC TYPE INSTALL | DWG NO ECP #1-1

DESCRIPTION OF DESCRIPTION:
3 Phase w/ control for 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Facial On/Off thermostatically Controlled. Room temperature sensor shipped loose for field installation. INVERTER DUTY 3 PHASE MOTOR REQUIRED FOR USE WITH VFD.

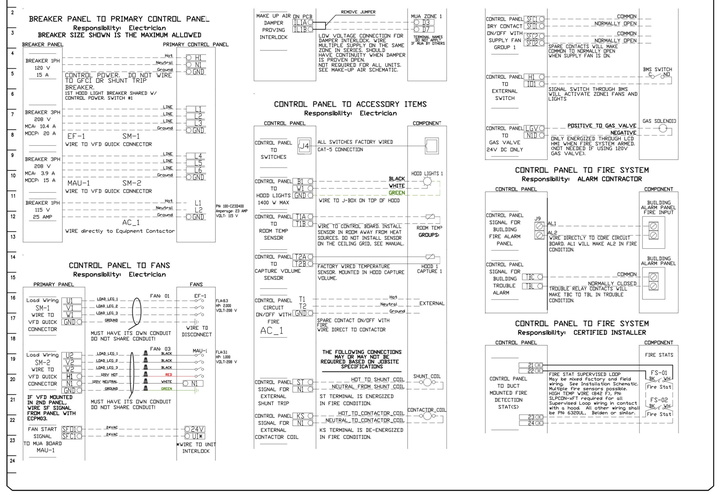

JOB NO 6017478 | MODEL NUMBER SC-311110MA | JOB NAME CHIPOTLE HAMILTON NJ #4064 | DRAWN BY | DATE 11/21/2023 | SCHEMATIC TYPE INSTALL | DWG NO ECP #1-2

DESCRIPTION OF DESCRIPTION:
3 Phase w/ control for 1 Exhaust Fan, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Relay On/Off with Supply Fan, Facial On/Off thermostatically Controlled. Room temperature sensor shipped loose for field installation. INVERTER DUTY 3 PHASE MOTOR REQUIRED FOR USE WITH VFD.

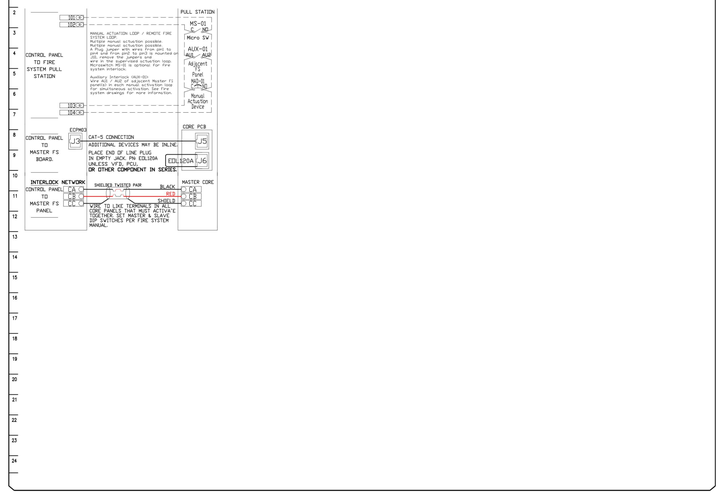

JOB NO 6017478 | MODEL NUMBER SC-311110MA | JOB NAME CHIPOTLE HAMILTON NJ #4064 | DRAWN BY | DATE 11/21/2023 | SCHEMATIC TYPE INSTALL | DWG NO ECP #1-3

DESCRIPTION OF DESCRIPTION:
Fire System #1 TANK FS - 40/40.

TANK PROTECTION ELECTRICAL DETAIL


02/10/2021 Rev. 2

ELECTRICIAN
1. WIRE MAIN CONTROL PANEL PER INCLUDED SCHEMATIC
2. WIRE MAU-1 PER INCLUDED SCHEMATIC
3. COMPLETE FINAL HOOKUP OF SYSTEM
4. WIRE GAS APPLIANCE KILL SWITCH, IF EQUIPPED (OPTIONAL)
5. WIRE GAS VALVE

FS-1: MASTER

ELECTRICAL CONTRACTOR REQUIREMENT

ITEM	CONNECTION IN PANEL	CONNECTION IN DEVICE	VOLTAGE	AMPERAGE	COMMENTS
SHUNT TRIP BREAKER (OPTIONAL)	ST & N1	BREAKER COIL (A1 & A2)	120 VAC	< 4 AMPS	ST TO A1 ON SHUNT BREAKER COIL, AND NEUTRAL TO A2 ON SHUNT TRIP BREAKER COIL
CONTROL PANEL POWER	H1 & N1 + GROUND	CIRCUIT BREAKER	120 VAC	15 AMPS	CONTROL PANEL POWER MUST NOT BE RUN THROUGH SHUNT TRIP BREAKER
UDS APPLIANCE KILL SWITCH (OPTIONAL)	KTS & N	KTS & N1	120 VAC	< 4 AMPS	KILL SWITCH TERMINALS MUST BE IN SERIES WITH OTHER KILL SWITCHES
REMOTE 120VAC ANSUL AUTOMAN (OPTIONAL)	AUI, AUE	SOLENOID	120 VAC	< 6 AMPS	120V TO AUI, AUE TO ANSUL ELECTRIC AUTOMAN, ANSUL SOLENOID TO NEUTRAL
GAS VALVE	LGV & N2 (IF 24 VDC) GAS & N1 (IF 120 VAC)	RED/RED/GREEN	24 VDC OR 120 VAC	< 10 AMPS	IF 24 VDC – 2 WIRES & GROUND 22G TO RED, 22G TO BLK, AND GREEN TO GROUND IF 120 VAC – 2 WIRES & GROUND 22G TO RED, N1 TO RED, AND GREEN TO GROUND

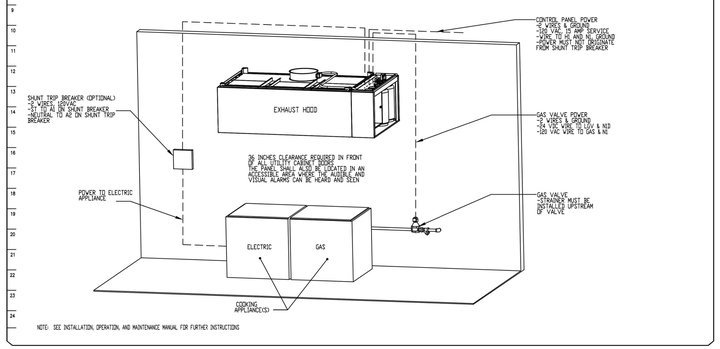

NOTE: SEE INSTALLATION, OPERATION, AND MAINTENANCE MANUAL FOR FURTHER INSTRUCTIONS

JOB NO 6017478 | MODEL NUMBER SC-311110MA | JOB NAME CHIPOTLE HAMILTON NJ #4064 | DRAWN BY | DATE 11/21/2023 | SCHEMATIC TYPE INSTALL | DWG NO ECP #E-4

DESCRIPTION OF DESCRIPTION:
Fire System #1 TANK FS - 40/40.

TANK PROTECTION LOW-VOLTAGE DETAIL


02/10/2021 Rev. 2

ALARM CONTRACTOR:
1. WIRE MANUAL ACTUATION DEVICE(S), REMOTE FIRESTAT(S), CORE INTERLOCK(S), FIRE SENSOR(S) AND FIRE ALARM CONTACTS
2. WIRE GAS VALVE
3. VERIFY FINAL FIRE SYSTEM TEST

FS-1: MASTER

ALARM CONTRACTOR REQUIREMENT

ITEM	CONNECTION IN PANEL	CONNECTION IN DEVICE	VOLTAGE	AMPERAGE	COMMENTS
MANUAL ACTUATION DEVICE(S)	101 AND 104 102 AND 103	1 & 2	24 VDC	< 10 AMPS	WIRE MANUAL ACTUATION DEVICE TERMINAL 1 BETWEEN CORE PANEL TERMINALS 102 AND 103 WIRE MANUAL ACTUATION DEVICE TERMINAL 2 BETWEEN CORE PANEL TERMINALS 101 AND 104 JUMPER 2K OR 10-30A AND 10K OR 103 K 5W MANUAL ACTUATION DEVICE IS INSTALLED
MANUAL ACTUATION DEVICE COVER	N/A	N/A	N/A	N/A	MANUAL ACTUATION DEVICE COVER MUST BE INSTALLED IF SURFACE MOUNTED, USE COVER EXTENSION PIT-CSE088
REMOTE FIRESTAT SENSOR(S)	A1 AND 24 A2 AND 23	BLACK AND WHITE	24 VDC	< 10 AMPS	WIRE FIRE SENSOR WHITE WIRE(S) BETWEEN CORE PANEL TERMINALS 24 AND 23 WIRE FIRE SENSOR BLACK WIRE(S) BETWEEN CORE PANEL TERMINALS A1 AND A2 HIGH TEMP 190C(375 DEGREES F) WHITE WIRE(S) P/N 434473 (16 AWG) OR 434474 (14 AWG) OR TYP SEE FIRE SYSTEM DRAWINGS FOR ADDITIONAL FIRESTAT(S) IN SYSTEM, IF APPLICABLE
FIRE ALARM CONTACT	ALI, ALE	VARIES	50V MAX (AC/DC)	UP TO 1 AMP	FIRE ALARM RELAY CONTACTS FOR SENDING FIRE ALARM LOCATED IN THE CORE ELECTRICAL CONTROL PANEL
CORE INTERLOCK(S)	ILA, ILB, ILC	ILA, ILB, ILC	RS-485 COMMUNICATIONS SIGNAL		CORE INTERLOCK (1) ILA, (2) ILB, (3) ILC TO CORE SYSTEM (2) ILB CORE SYSTEM (1) ILA, (3) ILC, SYSTEM (2) ILB, USE BELDEN 8895AE OR SIMILAR WIRE
TROUBLE CONTACT	TBC, TBL, TDK	VARIES	MAX 120 VAC	UP TO 6 AMPS	WIRE TO TBL & TBC NORMALLY OPEN CONTACT, CLOSES IN TROUBLE CONDITION
CORE COMMUNICATIONS CABLE	RJ-45 Jack	INTERNET CONNECTION	SIGNAL	<10 AMPS	TYPICAL CONNECTION CAT5 CABLE TO LOCAL AREA NETWORK VIA ETHERNET SWITCH OR WIRELESS ROUTER WITH VALID INTERNET CONNECTION

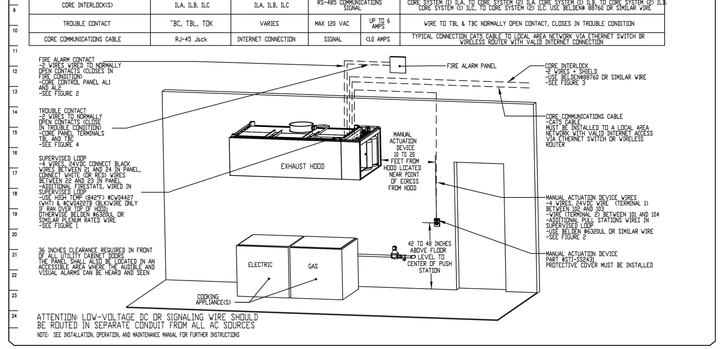

ATTENTION: LOW-VOLTAGE DC OR SIGNALING WIRE SHOULD BE ROUTED IN SEPARATE CONDUIT FROM ALL AC SOURCES

NOTE: SEE INSTALLATION, OPERATION, AND MAINTENANCE MANUAL FOR FURTHER INSTRUCTIONS

2024-DB#2/P#1-2

REVISIONS

	DESCRIPTION	DATE:
△		
△		
△		
△		

CAPTIVEAIRE
Highwoods Group
4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: regal@captiveaire.com
www.captiveaire.com

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

DATE: 11/21/2023

DWG.#: 6017478

DRAWN BY: JMB-40

SCALE: 3/4" = 1'-0"

MASTER DRAWING

SHEET NO. 9

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-409


HOOD SHOP DRAWING PRODUCED BY MANUFACTURER - FOR REFERENCE ONLY


JOB NO 6017478 | MODEL NUMBER SC-311110MA | DRAWN BY | SCHEMATIC TYPE INSTALL | DESCRIPTION OF OPERATION: Fire System #1 TANK FS - 48/48.
JOB NAME CHIPOTLE HAMILTON NJ #4064 | DATE 11/21/2023 | CHG NO ECP #1-5

TANK PROTECTION LOW-VOLTAGE FIGURES

02/10/2021 Rev. 17


FS-1: MASTER

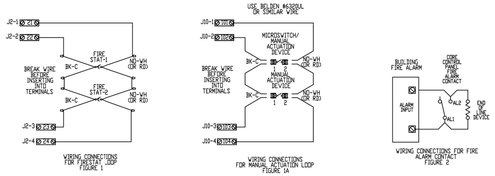


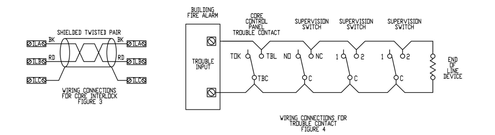


NOTE: SEE INSTALLATION, OPERATION, AND MAINTENANCE MANUAL FOR FURTHER INSTRUCTIONS

ATTENTION: LOW-VOLTAGE DC OR SIGNALING WIRE SHOULD BE ROUTED IN SEPARATE CONDUIT FROM ALL AC SOURCES

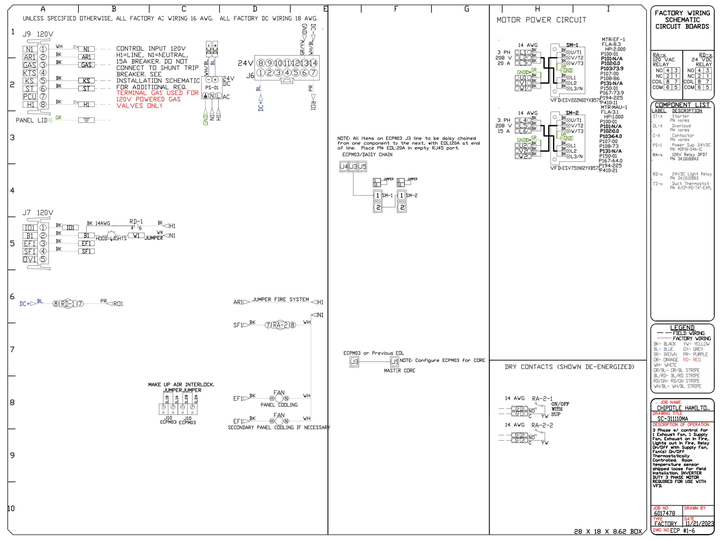

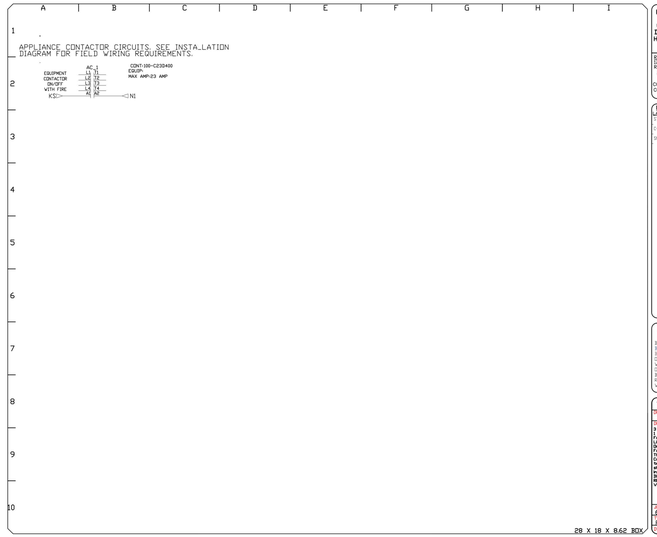

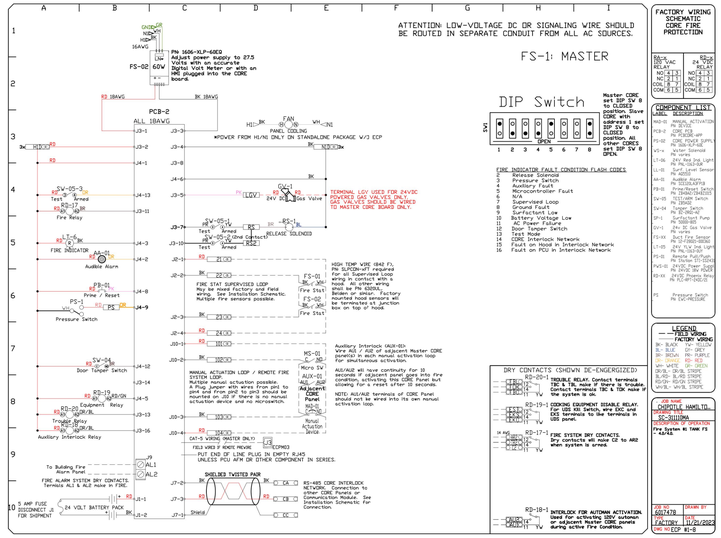

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REVISIONS

	DESCRIPTION	DATE
1		
2		
3		
4		

CAPTIVEAIRE
4641 Paragon Park Rd., Raleigh, NC, 27616 PHONE: (919) 875 - 0420 FAX: 9198750577 EMAIL: reg40@captiveaire.com
Highwoods Group
www.captiveaire.com

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

CHIPOTLE HAMILTON NJ #4064
TRENTON, NJ, 08691

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
CAPTIVEAIRE DRAWINGS

SHEET NUMBER:
M-410

DATE: 11/21/2023
DWG.#: 6017478
DRAWN BY: JMB-40
SCALE: 3/4" = 1'-0"
MASTER DRAWING
SHEET NO. 10

EXHAUST FAN SCHEDULE

Tag	Manufacturer	Model	Type	Drive	CFM	E.S.P.	Motor					Sone	Weight	Furnished	Installed	Comments
						IN. W.C.	H.P.	Volts	PH.	Hz.	RPM	Level	lbs.	By	By	
EF-1	Captive-Aire	DU180HFA	Roof	Direct	2550	1.45	2	208	3	60	1221	16.7	183	HS	GC	See Captive-Aire drawings for options & accessories.
EF-2	Captive-Aire	DR12HFA	Roof	Direct	150	0.6	.25	115	1	60	1282	6.10	50	HS	GC	See Captive-Aire drawings for options & accessories.

OUTDOOR AIR COOLED CONDENSING UNIT SCHEDULE

Unit ID	Nominal Cooling Capacity (Tons)	Manuf.	Model	Description	Refrig. Type	Refrig. Charge	Unit Electrical Data					Unit Installed Weight lbs.	Furnished By	Installed By	Comments
							Voltage	Phase	Hz.	FLA	MOCP				
CU-1	-	Manitowoc (Harford)	PC98MZOP-3	Walk-in Cooler Remote CU	R-404A	-	208	3	60	6.5	15	200	WCS	GC	Furnished with walk-in cooler
CU-2	-	HOSHIZAKI	URC-9FZ	Ice Maker Remote CU	R-404A	11 lbs. 7.4 oz.	120	1	60	-	-	100	KES	GC	Furnished with ice maker
CU-3	-	HOSHIZAKI	URC-5FZ	PUW Ice Maker Remote CU	R-404A	11 lbs. 7.4 oz.	120	1	60	-	-	100	KES	GC	Furnished with ice maker

3

AIR DOOR SCHEDULE

ID	Manufacturer	Model	Airflow			Electrical			Furnished By	Installed By	Remarks
			Max FPM	Avg FPM	CFM	KW	V/P/H	FLA			
AD-1	Berner	ALC081036E	3600	2116	1036	5.6	208/1/60	28.6	GC	GC	(2) total units

MAKE-UP AIR UNIT SCHEDULE

Unit ID	Manuf.	Model	Orientation	Fan Performance				RPM	Heating Performance					Unit Electrical Data					Unit Installed Weight lbs.	Furnished By	Installed By	Comments
				Design Supply (CFM)	Min Supply CFM	Total E.S.P. in. w.c.	Motor Nominal HP		Type	Input MBH	Output MBH	Temperature Rise °F D.B.	Efficiency AFUE %	Voltage	Phase	Hz.	MCA	MOCP				
MAU-1	Captive-Aire	A1-D.250-15D	Downflow	1300	1000	0.50	1	1546	Nat.Gas	90.2	83.1	60.0	92	208	3	60	3.9	15	495	HS	GC	See Captive-Aire drawings for options & accessories.

VENTILATION SCHEDULE

Space Served		Calculation of Minimum Outside Air (OA) Per IMC 2021										OA CFM		Ventilation	Comments
Name	Area (SQ.FT.)	Classification	Based on Occupancy					Based on CFM / SQ.FT.		Based on Exhaust				Required	Provided	System	
			Persons Per 1000 SQ.FT.	Estimated Max. Occupant Load	Design Occupant Load	CFM Per Person	Total OA CFM	CFM Per SQ.FT.	Total OA CFM	Fixture Quantity	CFM Per Fixture	CFM Per SQ.FT.	Total Exhaust CFM				
101-Dining	1675	Food and beverage service: Cafeteria, fast food	100	168	69	7.5	517.5	0.18	302					819	1125	RTU-2&RTU-3	See Note 1
102-Utensil	92	Public spaces, Corridors and utilities						0.06	6					6	8	RTU-2	
103-Passage	109	Public spaces, Corridors and utilities						0.06	7					7	9	RTU-2	
105-Ordering	124	Food and beverage service: Cafeteria, fast food	100	12	12	7.5	93	0.18	22					115	158	RTU-2	See Note 1
111-Unisex1	62	Public spaces: Toilet rooms - public							0	1	70		70	0	0	EF-2	
112-Unisex2	62	Public spaces: Toilet rooms - public							0	1	70		70	0	0	EF-2	
Totals:	2124				81									946	1300	RTU-2&RTU-3	See Note 2
104-POS	198	Food and beverage service: Cafeteria, fast food	100	20	2	7.5	15	0.18	36					51	130	RTU-1	See Note 1
106-Serving	64	Food and beverage service: Cafeteria, fast food	100	6	4	7.5	30	0.18	12					42	106	RTU-1	See Note 1
107-Cooking	273	Food and beverage service: Kitchens (cooking)	20	5	2	7.5	15	0.12	33			0.7	191	48	122	EF-1	
108-Kitchen	488	Food and beverage service: Cafeteria, fast food	100	49	4	7.5	30	0.18	88					118	302	RTU-1	See Note 1
109-Office	50	Offices: Office spaces	5	0	1	5	5	0.06	3					8	20	RTU-1	
Totals:	1073				13									266	680	RTU-1	

Notes:

1. Classification of "Food and beverage service, Cafeteria, fast food" results in an estimated quantity of people on a square footage basis that is unrealistic with regard to the actual use of the space. The calculated number of people has been noted in the above calculation, but an alternative, reasonably conservative actual maximum occupancy (which is supported by the Owner's historical data) is utilized in the calculation for the Total Outside Air CFM required for the respective Zones. The code-mandated value of 7.5 cfm/person for "Food and beverage service, Cafeteria, fast food" is used in the calculation.

ROOFTOP UNIT SCHEDULE

Unit ID	Nominal Cooling Capacity Tons	Manuf.	Model	Area Served	Orientation	Fan Performance				Cooling Capacity					Heating Performance				Unit Electrical Data					Unit Installed Weight lbs.	Furnished By	Installed By	Accessories, Features & Options												Comments
						Air Balance		Motor	Total	Net Capacity		Efficiency	EAT (Deg. F)		Cond.	Type	Input	Output	Efficiency	Voltage	Phase	Hz.	MCA	MOCP				1	2	3	4	5	6	7	8	9	10	11	12	
						Supply CFM	Outdoor CFM*	BHp	E.S.P. in. w.c.	Total MBH	Sensible MBH	(S)EER	DB	WB	EAT (Def. F)		MBH	MBH	AFUE %																					
(E)RTU-1	8.5	Lennox	LGH102	Kitchen	Downflow	3400	340	-	0.8	-	-	-	-	-	-	Nat.Gas	240	192	80	208	3	60	44.0	50	-	–	GC	X	X	X	X	X	X	X	X	X	X	X	Existing to Remain
(E)RTU-2	7.5	Lennox	LGH092	Dining	Downflow	3000	600	-	0.8	-	-	-	-	-	-	Nat.Gas	240	192	80	208	3	60	42.0	50	-	–	GC	X	X	X	X	X	X	X	X	X	X	X	Existing to Remain
RTU-3	8.5	Carrier	48FCEM09	Dining	Downflow	3400	680	1.9	0.8	96.4	73.5	11.2	80.0	67.0	95.0	Nat.Gas	180	148	82	208	3	60	42.0	50	1108	HES	GC	X	X	X	X	X	X	X	X	X	X	X	X	

*Re-balance OA CFM for (E) RTU-1 & (E) RTU-2 as shown

Notes that apply to all units:

1. Static pressure indicated above is the external static pressure which excludes any pressure drops within the unit.
2. Unit shall be complete with side outlet drain and access doors. Outside air dampers shall be equipped with blade and jamb seals.
3. Contractor to ensure that outdoor air intakes are a minimum of 10'-0" away from any exhaust fan discharge, plumbing vent or other contaminant source.
4. Maximum air velocity through cooling coil shall not exceed 500 feet per min.
5. Provide 4 sided factory roof curb suitable for seismic conditions of project location.
6. Perform testing and balancing and submit reports to the engineer in accordance with specification.
7. Refer to roof framing plan for exact location of rooftop units.
8. Mechanical subcontractor shall affix unit designation decal on unit.
9. Unit to operate at 7 in. w.g. natural gas pressure. See Manufacturer's specifications for final connection size to unit.
10. Provide alternate bid to supply all rooftop units with coastal package (coated coils, painted rails, etc.) when site is located within 5 miles of the coast.

Accessories, Features & Options:

1. MERV-8 filters.
2. Roof curb - 14" high.
3. M.O.D.
4. Hail guard.
5. Unit mounted convenience receptacle.
6. R.A. smoke detector w/ remote keyed annunciator/reset.
7. Comp. enthalpy econ.
8. Barometric relief.
9. Toolless hinged access panels.
10. Unit shall be charged with refrigerant type R-410A
11. Disconnect.
12. STD / MED static motor

GRILLES, REGISTERS, AND DIFFUSERS SCHEDULE

Tag	Description	Face Size / Neck Size	Material	Finish	Mounting	Furnished By	Installed By	Manufacturer	Model	Notes
CD-1	Perforated ceiling diffuser	Face: 24"x24" Neck: Varies	Aluminum	White	Lay-in ceiling	GC	GC	Nailor	4320A Type L	Provide with integral OBD
CD-2	Perforated ceiling diffuser	Face: 24"x12" Neck: Varies	Aluminum	White	Lay-in ceiling	GC	GC	Nailor	4320A Type L	Provide with integral OBP Remove 4-way deflectors
ER-1	Perforated ceiling exhaust	Face: 12"x12" Neck: Varies	Aluminum	White	Surface mount	GC	GC	Nailor	4330R Type S	Provide with integral OBD
RG-1	Perforated ceiling return	Face: 48"x24" Neck: Varies	Aluminum	White	Lay-in ceiling	GC	GC	Nailor	4330R Type L	
RG-2	Perforated ceiling return	Face: 48"x24" Neck: Varies	Aluminum	White	Surface mount	GC	GC	Nailor	4330R Type S	
RG-3	0 deg. Fixed blade return grille	Face: Varies Neck: Varies	Aluminum	White	Wall	GC	GC	Nailor	51FH	
SR-1	Adjustable turbo nozzle	Neck: Varies	Aluminum	White	Wall	GC	GC	Air Concepts	ANR-14	Provide with concealed mounting and integral OBD
SR-2	Double-deflection supply register	Neck: Varies	Aluminum	White	Wall	GC	GC	Nailor	51DH	Provide with integral OBD
SR-3	Curved double-deflection supply register	Neck: Varies	Aluminum	Mill	Duct	GC	GC	Nailor	51DHC	Provide with integral OBD

VIROGUARD SCHEDULE

TAG	QUANTITY	DESCRIPTION	DUCT CONNECTION SIZE	FAN	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN MANUFACTURER
VG-1	1	VIROGUARD HOOD EXHAUST FAN ROOFTOP CONTAINMENT SYSYTEM	16"x16"	Captive-Aire DU180HFA	TDC	GC	ENVIROMATIC

SANITIZING EQUIPMENT SCHEDULE

TAG	COUNT	DESCRIPTION	FURNISHED BY	INSTALLED BY	BASIS FOR DESIGN MANUFACTURER	BASIS FOR DESIGN MODEL	REMARKS
SB-1	2	BATHROOM AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	BRU ASSEMBLY	SEE ELECTRICAL SHEETS FOR CONNECTION INFORMATION
SH-1	3	HVAC AIR PURIFICATION UNIT	TUV	GC	RGF ENVIRONMENTAL GROUP	REME-HALO	SEE DETAIL 6/M700 FOR INSTALLATION INFORMATION
SI-1	3	ICE MACHINE TREATMENT SYSTEM	TUV	GC	RGF ENVIRONMENTAL GROUP	IMS-B-GA	SEE PLUMBING DRAWINGS FOR INSTALLATION INFORMATION

AIR BALANCE CALCULATIONS

System	Supply Air CFM	Return Air CFM	Outdoor Air CFM	Exhaust Air CFM	Pressure CFM
RTU-1	3400	3060	340		340
RTU-2	3000	2400	600		600
RTU-3	3400	2720	680		680
MAU-1	1300	0	1300		1300
EF-1				2550	-2550
EF-2				150	-150
Total	11100	8180	2920	2700	220

CONTROL FUNCTIONS

A. THE MAIN COOKING EXHAUST FAN AND MAKE-UP AIR UNIT SHALL BE INTERLOCKED TO OPERATE TOGETHER. THIS CONTROL CIRCUIT IS ACTIVATED BY A SWITCH AND INCLUDES A FIRE PROTECTION OVERRIDE.

B. THE TEMPERATURE IN EACH ZONE IS CONTROLLED BY SPACE TEMPERATURE SENSORS CONNECTED TO THE THERMOSTATS LOCATED IN THE OFFICE. ALL ZONES SHALL OPERATE WITH CONTINUOUS FAN OPERATION DURING OCCUPIED TIMES AND INTERMITTENLY AS NEEDED TO MAINTAIN SET POINTS DURING UNOCCUPIED TIMES. OUTSIDE AIR DAMPERS SHALL BE OPEN CONTINUOUSLY WHEN EITHER IN OCCUPIED MODE OR WHEN HOOD SYSTEM IS ON AND SHALL BE CLOSED DURING UNOCCUPIED PERIODS.

C. THE THERMOSTATS SHALL DETERMINE OCCUPIED/UNOCCUPIED STATUS BASED ON THE SCHEDULE IN THE ENERGY MANAGEMENT SYSTEM.

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
HVAC SCHEDULES

SHEET NUMBER:
M-600

FIRE RATED ENCLOSURE - GREASE DUCTS


1. THERMAL CERAMICS FIREMASTER FASTWRAP XL IS TESTED TO ASTM E2336 AND UL LISTED PER HNKT.G18 TO PROVIDE ZERO CLEARANCE TO COMBUSTIBLES AND TO PROVIDE A 1- OR 2- HOUR ENCLOSURE. THROUGH PENETRATIONS FIRESTOP SYSTEMS ARE TESTED IN ACCORDANCE WITH ASTM E 814 (UL 1479). ICC CODE EVALUATION PER REPORT UL ER 14229-01.
2. COMPLIANT TO THE FOLLOWING CODES:
   - NFPA 96
   - INTERNATIONAL MECHANICAL CODES
   - UNIFORM MECHANICAL CODE
   - CALIFORNIA MECHANICAL CODE
3. INSULATION APPLIED IN TWO LAYERS WITH TIGHT COMPRESSION JOINT ON BOTH LAYERS AT ALL JOINTS.
4. MINIMUM 16 GAUGE CARBON STEEL (OR 18 GAGE STAINLESS STEEL) RECTANGULAR OR ROUND GREASE EXHAUST DUCT
5. INSTALL UL LISTED AND LIQUID TIGHT THERMAL CERAMICS FASTDOOR XL ACCESS DOORS, OR ALTERNATE DOOR UL LISTED PER UL1978, AT ALL CHANGES IN DIRECTION AND AT MINIMUM EVERY 12 FT ON HORIZONTAL RUNS.
6. SUPPORT HANGER SYSTEMS DO NOT NEED TO BE WRAPPED PROVIDED THE HANGER RODS ARE MINIMUM OF 3/8 IN. DIAMETER AND SUPPORTS ARE MINIMUM 2 X 2 X 1/8 IN. STEEL ANGLE OR SMACNA EQUIVALENT SUPPORT SYSTEM.
7. THERMAL CERAMICS DUCT WRAP SHALL BE INSTALLED DIRECTLY ONTO THE DUCT AND APPLIED FROM THE HOOD CONNECTION TO THE CONNECTION TO THE FAN.
8. THERMAL CERAMICS DUCT ENCLOSURE SYSTEM SHALL BE INSTALLED IN STRICT ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS AND UL LISTINGS.

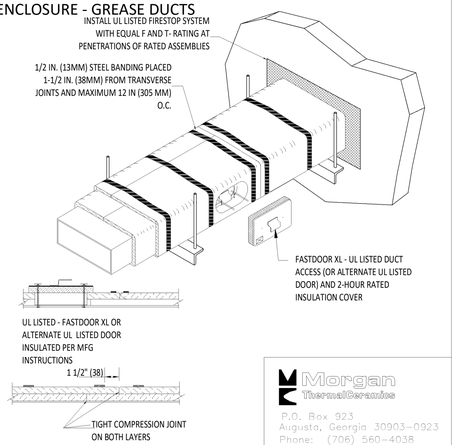


Morgan Thermal Ceramics
P.O. Box 923
Augusta, Georgia 30903-0923
Phone: (706) 560-4038

1 FIREMASTER DUCT WRAP - UL HNKT-G18
NOT TO SCALE

RECTANGULAR DUCT HANGER SCHEDULE (MINIMUM SIZES)								
HALF DUCT PERIMETER RANGE	PAIR AT 10' SPACING		PAIR AT 8' SPACING		PAIR AT 5' SPACING		PAIR AT 4' SPACING	
	STRAP	WIRE/ROD	STRAP	WIRE/ROD	STRAP	WIRE/ROD	STRAP	WIRE/ROD
P/2<30'	1"X22 GA.	10 GA. (0.135")	1"X22 GA.	10 GA. (0.135")	1"X22 GA.	12 GA. (0.106")	1"X22 GA.	12 GA. (0.106")
P/2<72"	1"X18 GA.	3/8"	1"X20 GA.	1/4"	1"X22 GA.	1/4"	1"X22 GA.	1/4"
P/2<96"	1"X16 GA.	3/8"	1"X18 GA.	3/8"	1"X20 GA.	3/8"	1"X22 GA.	1/4"
P/2<120"	1-1/2"X16 GA.	1/2"	1"X16 GA.	3/8"	1"X18 GA.	3/8"	1"X20 GA.	1/4"
P/2<168"	1-1/2"X16 GA.	1/2"	1"X16 GA.	1/2"	1"X16 GA.	3/8"	1"X18 GA.	3/8"
P/2<192"	-	1/2"	1-1/2"X16 GA.	1/2"	1"X16 GA.	3/8"	1"X16 GA.	3/8"

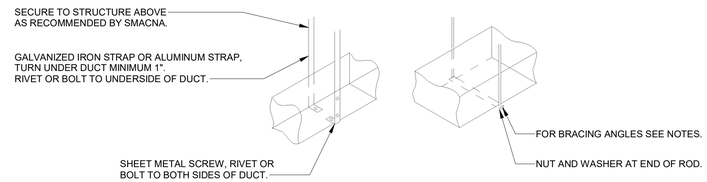


3 HVAC - DUCT HANGER DETAILS
NOT TO SCALE

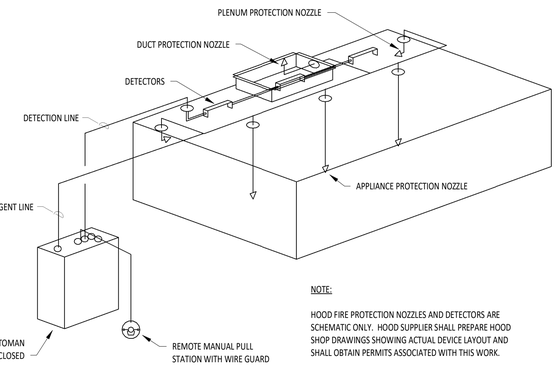

NOTE:

HOOD FIRE PROTECTION NOZZLES AND DETECTORS ARE SCHEMATIC ONLY. HOOD SUPPLIER SHALL PREPARE HOOD SHOP DRAWINGS SHOWING ACTUAL DEVICE LAYOUT AND SHALL OBTAIN PERMITS ASSOCIATED WITH THIS WORK.

4 HVAC - FIRE SUPPRESSION SYSTEM SCHEMATIC
NOT TO SCALE

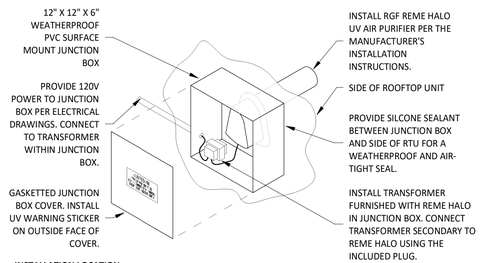

INSTALLATION LOCATION

INSTALL AIR PURIFIER WITH JUNCTION BOX ON OUTSIDE FACE OF ROOFTOP UNIT AND WITH UV LAMP TUBE EXTENDING INTO THE INTERIOR OF THE ROOFTOP UNIT. FIELD VERIFY EXACT LOCATION TO AVOID DAMAGING, TOUCHING, OR INTERFERING WITH ANY RTU INTERIOR COMPONENTS. INSTALLATION LOCATION SHALL BE AS FOLLOWS:


TRANE: INSTALL INTO THE SUPPLY AIR STREAM THROUGH THE REMOVABLE PANEL COVERING THE HORIZONTAL DISCHARGE SUPPLY AIR OPENING.

YORK: INSTALL INTO THE SUPPLY AIR PLENUM FROM THE BACK SIDE OF THE UNIT JUST ABOVE THE HEAT EXCHANGER.

CARRIER: INSTALL DOWNSTREAM FROM THE EVAPORATOR, AWAY FROM THE HEAT EXCHANGER, AT TOP OF UNIT ABOVE REMOVABLE PANEL COVERING THE HORIZONTAL DISCHARGE SUPPLY OPENING.


(E) LENNOX UNITS: INSTALL ON LONG SIDE OF UNIT WITH REMOVABLE PANEL COVERING THE HORIZONTAL SUPPLY & RETURN DISCHARGE OPENINGS. CONFIRM WITH LENNOX IF SHOULD BE INSTALLED DIRECTLY IN SUPPLY PANEL, OR ABOVE PANEL.

5 UV AIR PURIFIER INSTALLATION
NOT TO SCALE

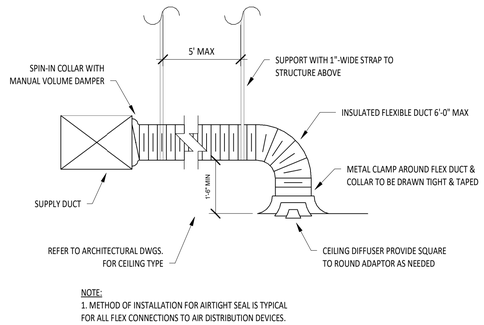


NOTE:
1. METHOD OF INSTALLATION FOR AIRTIGHT SEAL IS TYPICAL FOR ALL FLEX CONNECTIONS TO AIR DISTRIBUTION DEVICES.

6 HVAC - DIFFUSER CONNECTION
NOT TO SCALE

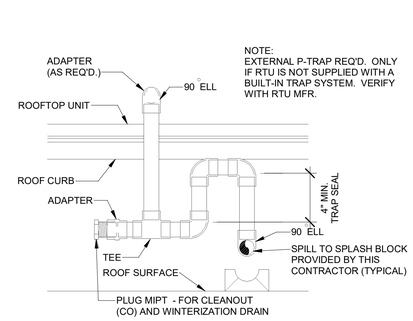


NOTE:
EXTERNAL P-TRAP REQ'D. ONLY IF RTU IS NOT SUPPLIED WITH A BUILT-IN TRAP SYSTEM. VERIFY WITH RTU MFR.

7 HVAC - CONDENSATE PIPING FROM RTU
NOT TO SCALE

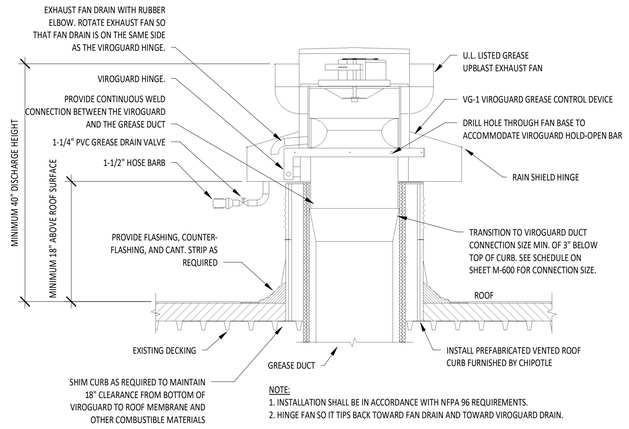


NOTE:
1. INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA 96 REQUIREMENTS.
2. HINGE FAN SO IT TIPS BACK TOWARD FAN DRAIN AND TOWARD VIROGUARD DRAIN.

8 GREASE EXHAUST FAN
NOT TO SCALE

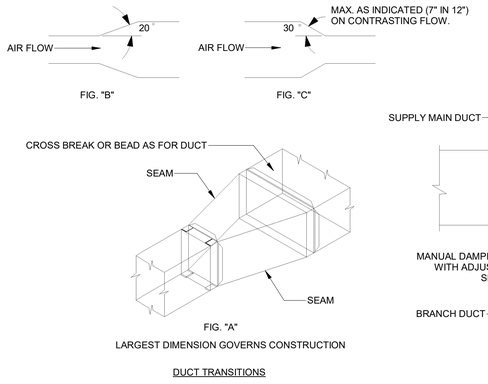

NOTE:
1. DUCT TRANSITIONS TYPICAL AFTER EACH TAKE-OFF(S) WHERE CHANGE IN DUCT SIZE IS INDICATED.

9 HVAC - DUCT TRANSITION DETAILS
NOT TO SCALE

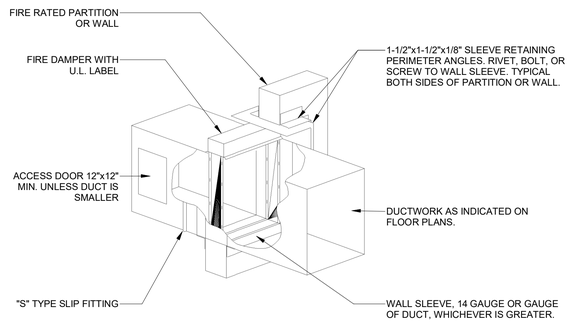

NOTES:
1. FIRE DAMPER INSTALLATION FOR VERTICAL AIRFLOW SHALL BE SIMILAR WITH S.S. NEGATOR SPRINGS FOR CLOSURE.

10 HVAC - FIRE DAMPER DETAIL
NOT TO SCALE

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077


PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
HVAC DETAILS


SHEET NUMBER:
M-700

2024-DB#2/P#1-2

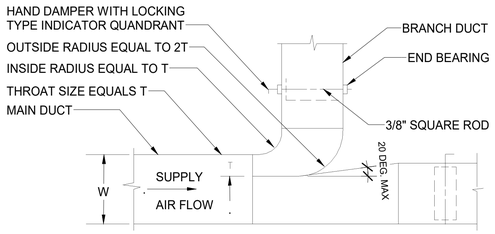


NOTES:
1. FURNISH THIS TYPE CONNECTION FOR BRANCHES WITH MORE THAN 200 CFM.
2. MUST BE USED WHEN W IS GREATER THAN, OR EQUAL TO 36".
3. MINIMUM T = 4".


1 HVAC - RECTANGULAR DUCT BRANCH
NOT TO SCALE

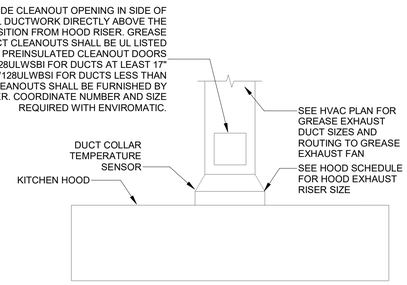


2 HVAC - GREASE EXHAUST DUCT AT HOOD
NOT TO SCALE

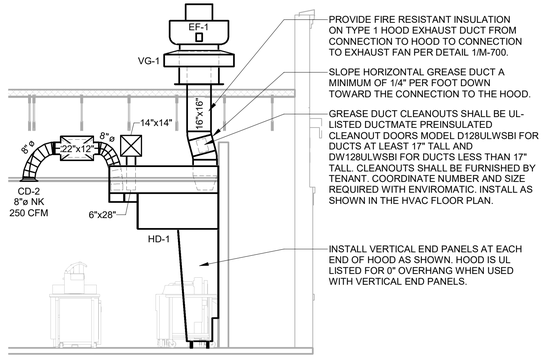


3 HVAC - HOOD DUCTWORK SECTION 'A'
1/4" = 1'-0"

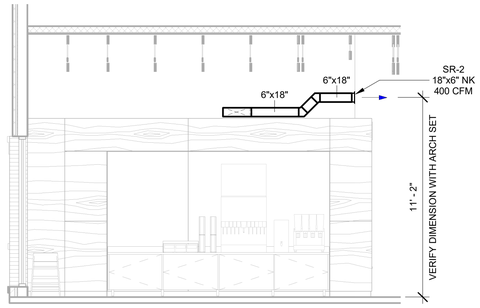


4 HVAC - UTENSIL COUNTER DUCTWORK SECTION 'A'
1/4" = 1'-0"

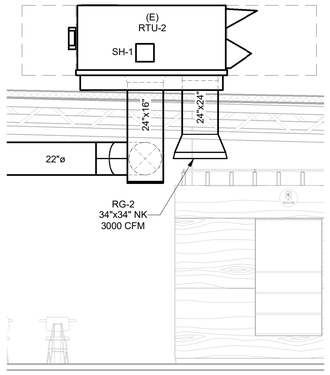

5 HVAC - (E) RTU-2A DUCTWORK SECTION
1/4" = 1'-0"

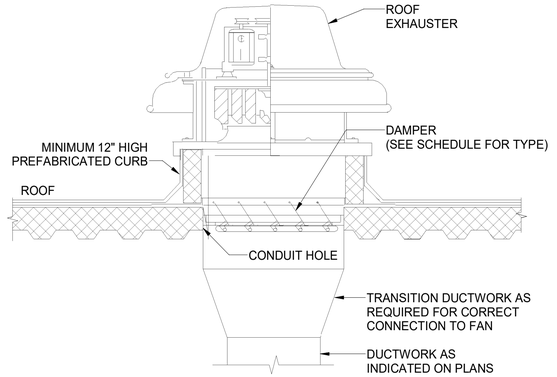


6 HVAC - ROOF MOUNTED EXHAUST FAN
NOT TO SCALE

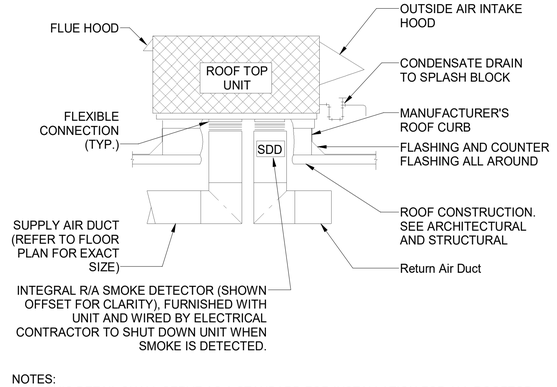


NOTES:
1. THIS DETAIL SHALL SERVE AS A STANDARD FOR INSTALLATION FOR ALL ROOFTOP UNITS. REFER TO FLOOR PLANS FOR EXACT REQUIREMENTS FOR EACH UNIT.
2. ALL ROOF PENETRATIONS ARE BASED ON MANUFACTURERS EQUIPMENT S/A TO R/A OPENING SIZE UNLESS NOTED OTHERWISE. EXTEND FULL SIZE DUCT DOWN TO ABOVE CEILING AND TRANSITION AS SHOWN ON PLANS.

7 HVAC - ROOFTOP UNIT MOUNTING DETAIL
NOT TO SCALE

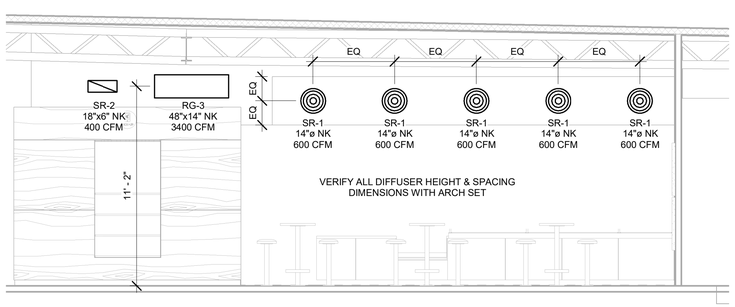

8 HVAC - DINING ROOM DUCTWORK SECTION 'A'
1/4" = 1'-0"

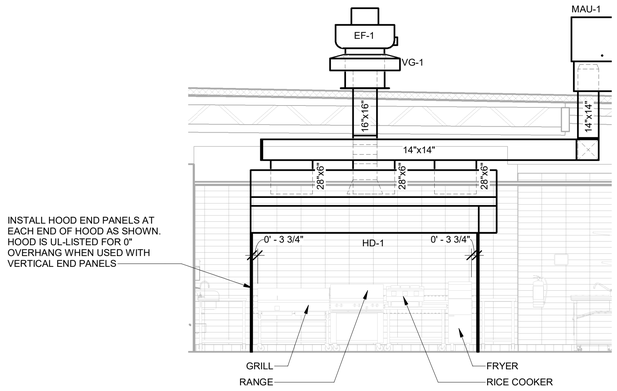

9 HVAC - HOOD ELEVATION
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
HVAC DETAILS

SHEET NUMBER:
M-701

GENERAL NOTES:

A. THE EXISTING CONDITIONS ARE BASED ON "AS-BUILT" DRAWINGS AND/OR LIMITED FIELD VERIFICATIONS. THE CONTRACTOR SHALL ADJUST TO ACTUAL FIELD CONDITIONS AT NO ADDITIONAL EXPENSE TO THE PROJECT. NO ADDITIONAL COMPENSATION WILL BE PROVIDED FOR ANY EXTRAS DUE TO THE CONTRACTOR'S FAILURE TO VISIT THE PROJECT SITE AND/OR PREDETERMINATION OF EXISTING CONDITIONS PRIOR TO SUBMITTING THE BID. ANY DISCREPANCIES SHALL BE IMMEDIATELY REPORTED TO THE ARCHITECT/ENGINEER FOR RESOLUTION.

B. THE CONTRACTOR SHALL FAMILIARIZE HIMSELF WITH THE INCIDENTAL DEMOLITION WORK PRIOR TO BIDDING AND COMMENCEMENT OF WORK. THE CONTRACTOR IS RESPONSIBLE FOR DEMOLITION OF ALL EXISTING EQUIPMENT AS REQUIRED FOR THE INSTALLATION/CONSTRUCTION OF NEW WORK.

C. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH ALL APPLICABLE HEALTH, GOVERNMENTAL AND LOCAL CODE REQUIREMENTS. SEE SHEET G-001 FOR THE PREVAILING CODES.

D. PROVIDE ACCESS PANELS AS REQUIRED TO ALLOW ACCESS TO VALVES, EQUIPMENT, ETC. LOCATED ABOVE INACCESSIBLE CEILINGS AND WALL CAVITIES. COORDINATE LOCATIONS WITH ARCHITECT.

E. COORDINATE ALL SLAB PENETRATIONS WITH ARCHITECT AND GENERAL CONTRACTOR PRIOR TO CONSTRUCTION. MAINTAIN A MINIMUM OF 2" CLEARANCE FROM THE EDGE OF THE SLAB OPENING TO ANY STRUCTURAL MEMBERS AND PIPES.

F. PIPE SIZES INDICATED ON THE PLANS ARE MINIMUM. THE CONTRACTOR SHALL PROVIDE PIPE SIZES EQUAL TO OR GREATER THAN THE SPECIFIED SIZES. THE CONTRACTOR MAY INCREASE PIPE SIZES AS REQUIRED AT NO ADDITIONAL EXPENSE TO THE PROJECT.

G. REFER TO THE PLUMBING FIXTURE SCHEDULE FOR INDIVIDUAL PLUMBING FIXTURE CONNECTION SIZE REQUIREMENTS.

H. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO DISPOSE OF ALL EQUIPMENT NOT REUSED AS PART OF THE NEW WORK. THE OWNER SHALL HAVE FIRST SALVAGE RIGHTS ON ALL MATERIALS AND EQUIPMENT.

I. THE EQUIPMENT LOCATIONS INDICATED ON THIS DRAWING ARE FOR BIDDING PURPOSES ONLY. THE CONTRACTOR SHALL VERIFY THE FINAL INTENDED LOCATION OF ALL FLOOR MOUNTED EQUIPMENT WITH THE OWNER PRIOR TO ROUGH-IN.

J. THE TERM "FURNISH" MEANS SUPPLY AND DELIVER TO THE PROJECT SITE, READY FOR UNLOADING, UNPACKING, ASSEMBLY, INSTALLATION, AND SIMILAR OPERATIONS. THE TERM "INSTALL" DESCRIBES THE OPERATIONS AT THE PROJECT SITE INCLUDING THE ACTUAL UNLOADING, UNPACKING, ASSEMBLY, ERECTING, PLACING, ANCHORING, APPLYING, WORKING TO DIMENSION, FINISHING, CURING, PROTECTING, CLEANING, AND SIMILAR OPERATIONS. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL, COMPLETE AND READY FOR THE INTENDED USE.

PLUMBING SPECIFICATIONS

SECTION 15055 - COMMON PIPING REQUIREMENTS
PART 1 - GENERAL
A. SECTION REQUIREMENTS
1. Comply with the requirements of the Building Code and the local authority having jurisdiction.
PART 2 - PRODUCTS
2.1 SUPPORTING DEVICES
A. Hanger and Pipe Attachments: Factory fabricated with galvanized coatings; nonmetallic coated for hangers in direct contact with copper tubing.
B. Building Attachments: Powder actuated type, drive pin attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
C. Mechanical Anchor Fasteners: Insert-type attachments with pullout and shear capacities appropriate for supported loads and building materials; UL listing and FM approval for fire protection systems.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install piping free of sags and bends.
B. Install fittings for changes in direction and branch connections.
C. Install sleeves for pipes passing through concrete and masonry walls, gypsum board partitions, and concrete floor and roof slabs.
D. Exterior Wall, Pipe Penetrations: Mechanical sleeve seals installed in steel or cast iron pipes for wall sleeves.
E. Fire Barrier Penetrations: Seal pipe penetrations with through-penetration firestop systems.
F. Install unions adjacent to each valve and at final connection to each piece of equipment.
G. Install dielectric unions and flanges to connect piping materials of dissimilar metals in gas piping.
H. Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals in water piping.
I. Provide full ring escutcheons at plumbing penetrations through walls or ceilings. Tightly seal escutcheons to the adjacent surface.
3.2 HANGERS AND SUPPORTS
A. Install building attachments within concrete or to structural steel. Install additional attachments at concentrated loads, including valves, flanges, guides, strainers, expansion joints, and at changes in direction of piping.
B. Install powder actuated drive pin fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
C. Install mechanical anchor fasteners in concrete after concrete is cured. Do not use in lightweight concrete or in slabs less than 4 inches thick.
D. Support fire protection system piping independent of other piping.
E. Load Distribution: Install hangers and supports so piping live and dead loading and stresses from movement will not be transmitted to connected equipment.
END OF SECTION 15055

SECTION 15080 - MECHANICAL INSULATION
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Quality Assurance: Labeled with maximum flame-spread rating of 25 and maximum smoke developed rating of 50 according to ASTM E 84.
PART 2 - PRODUCTS
2.1 PIPE INSULATION
A. Preformed Glass Fiber Pipe Insulation: ASTM C 547, Class 1, with factory applied, all purpose, vapor retarder jacket.
B. Polyolefin Pipe Insulation: Unicellular polyethylene, preformed pipe insulation. Comply with ASTM C 534, Type I, except for density.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install vapor barriers on insulated pipes with surface operating temperatures below 60 deg F.
B. Insulate fittings, valves, and specialties.
C. Seal vapor barrier penetrations for hangers, supports, anchors, and other projections.
D. Coat glass fiber pipe insulation ends with vapor barrier coating.
E. Roof Penetrations: Apply insulation for interior applications to a point even with the top of the roof flashing.
F. Exterior Wall Penetrations: For penetrations of below grade exterior walls, terminate insulation flush with mechanical sleeve seal.
G. Interior Walls and Partitions Penetrations: Apply insulation continuously through walls and partitions, except fire rated walls and partitions.
H. Fire Rated Walls and Partitions Penetrations: Terminate insulation at penetrations through fire rated walls and partitions. Seal around penetration with through penetration firestop systems.
I. Floor Penetrations: Terminate insulation at the underside of the floor assembly and at the floor support at top of floor. Seal around penetration with through penetration firestop systems.
J. Glass Fiber Insulation Installation: Bond insulation to pipe with adhesive. Seal seams and joints with vapor barrier compound.
K. Interior Piping System Applications: Insulate the following piping systems:
1. Domestic hot and cold water.
2. Exposed sanitary drains of fixtures for the disabled.
3. Refrigerant piping.
L. Do not apply insulation to the following systems, materials, and equipment:
1. Flexible connectors.
2. Fire protection piping systems.
3. Sanitary drainage and vent piping.
4. Chrome plated pipes and fittings, except for plumbing fixtures for the disabled.
5. Piping specialties, including air chambers, unions, strainers, check valves, plug valves, and flow regulators.
M. Pipe Insulation Thickness Application Schedule: Insulate piping with the following materials and thicknesses:
1. Domestic Hot and Cold Water: 1/2-inch preformed glass fiber pipe insulation.
2. Sanitary Drains: 1/2-inch polyolefin pipe insulation.
END OF SECTION 15080

SECTION 15110 - VALVES
PART 1 - GENERAL (Not Applicable)
PART 2 - PRODUCTS
2.1 GENERAL DUTY VALVES
A. End Connections: Threads shall comply with ANSI B1.20.1. Flanges shall comply with ANSI B16.1 for cast iron valves and ANSI B16.24 for bronze valves. Solder-joint connections shall comply with ANSI B16.18.
B. Ball Valves: Rated for 150 psig saturated steam pressure, 400 psig WOG pressure; 2 piece construction; with bronze body, standard (or regular) port, chrome plated brass ball, replaceable "Teflon" or "TFE" seats and seals, blowout proof stem, and vinyl covered steel handle.
C. Plug Valves: Rated at 150 psig WOG; bronze body, with straightaway pattern, square head, and threaded ends.
D. Swing Check Valves: Class 125, cast bronze body and cap; with horizontal swing, Y-pattern, and bronze disc.
E. Valves for Copper Tube: Solder ends, except provide threaded ends for heating hot water and low pressure steam service.
F. Valves for Steel Pipe: Threaded ends.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Use gate and ball valves for shutoff duty and ball for throttling duty.
B. Locate valves for easy access and provide separate support where necessary.
C. Install valves for each fixture and item of equipment.
D. Install valves in horizontal piping with stem at or above center of pipe.
E. Install valves in a position to allow full stem movement.
F. Install check valves for proper direction of flow in horizontal position with hinge pin level.
END OF SECTION 15110

SECTION 15140 - DOMESTIC WATER PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Performance Requirements: Unless otherwise indicated minimum pressure requirements for water piping are as follows:
1. Service Entrance Piping: 100 psig.
2. Domestic Water Piping: 80 psig.
B. Comply with NSF 61 "Drinking Water System Components -- Health Effects."

PART 2 - PRODUCTS
2.1 PIPES AND TUBES
A. Hard Copper Tube: ASTM B 88, Types L and M, water tube, drawn temper.

2.2 FITTINGS
A. Wrought Copper, Solder Joint Pressure Fittings: ASME B 16.22.
B. Cast Copper Alloy, Solder Joint Pressure Fittings: ASME B 16.18.
C. Bronze Flanges: ASME B 16.24, Classes 150 and 300.
D. Copper Unions: ASME B 16.18, cast copper alloy body, hexagonal stock, with ball and socket joint, metal to metal seating surfaces, and solder joint, threaded, or solder joint and threaded ends. Threads complying with ASME B 1.20.1.

2.3 JOINING MATERIALS
A. Solder Filler Metal: ASTM B 32, lead free.
B. Brazing Filler Metals: AWS A5.8, alloys to suit system requirements.

PART 3 - EXECUTION
3.1 VALVE APPLICATIONS
A. Install gate valves close to main on each branch and riser serving two or more plumbing fixtures or equipment connections and where indicated.
B. Install gate or ball valves on inlet to each plumbing equipment item, on each supply to each plumbing fixture not having stops on supplies, and elsewhere as indicated.
C. Install drain valve at base of each riser, at low points of horizontal runs, and where required to drain water distribution piping system.
D. Install swing check valve on discharge side of each pump and elsewhere as indicated.
E. Install ball valves in each hot water circulating loop and discharge side of each pump.
3.2 PIPING INSTALLATIONS
A. Install hangers and supports at intervals indicated in the applicable plumbing code and as recommended by pipe manufacturer.
B. Support vertical piping at each floor.
3.3 INSPECTING AND CLEANING
A. Inspect and test piping systems following procedures of authorities having jurisdiction.
B. Clean and disinfect water distribution piping following procedures of authorities having jurisdiction.
END OF SECTION 15140

SECTION 15150 - SANITARY WASTE AND VENT PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Minimum Pressure Requirement for Soil, Waste and Vent: 10 feet head.
B. Comply with NCF 14 "Plastic Piping Components and Related Materials".
PART 2 - PRODUCTS
2.1 PIPES AND TUBES
A. PVC Plastic, DWV Pipe: ASTM D 2665, Schedule 40, plain ends.
2.2 FITTINGS
A. PVC Plastic, DWV Pipe Fittings: ASTM D 2665, made to ASTM D 3311; socket type; drain, waste, and vent pipe patterns.
PART 3 - EXECUTION
3.1 PIPING INSTALLATION
A. Install cleanout and extension to grade at connection of building sanitary drain and building sanitary sewer.
B. Locate drainage piping runouts as close as possible to bottom of floor slab supporting fixtures or drains.
3.2 INSPECTION
A. Inspect and test piping systems following procedures of authorities having jurisdiction.
END OF SECTION 15150

SECTION 15198 - NATURAL GAS PIPING
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Quality Assurance: Comply with NFPA 54 and the Plumbing Code.
PART 2 - PRODUCTS
2.1 PIPE, TUBE, AND SPECIALTIES
A. Steel Pipe: ASTM A 53, Type S (Seamless), Grade B, Schedule 40, plain ends.
B. Malleable Iron Threaded Fittings: ASME B16.3, Class 150.
C. Manual Valves: Comply with standards listed or, if appropriate, to ANSI Z21.15.
D. Gas Stops: AGA certified, bronze-body, plug type with bronze plug, for 2-psig
E. or less natural gas. Include AGA stamp, flat or square head or lever handle, and threaded ends complying with ASME B1.20.1.
F. Gas Valves: 150-psig WOG, cast-iron or bronze body, bronze plug, straightaway pattern, square head, tapered-plug type.
G. Gas Pressure Regulators: ANSI Z21.18, single stage, steel jacketed, corrosion resistant pressure regulators. Include atmospheric vent, elevation compensator. Regulator pressure ratings, inlet and outlet pressures, and flow volume in cubic feet per hour of natural gas at specific gravity are as indicated.
1. Line Gas Pressure Regulators: Inlet pressure rating not less than system pressure.
H. Flexible Connectors: ANSI Z21.24, copper alloy.
I. Strainers: Bronze body, Y-pattern, full size of connecting piping. Include stainless-steel screens with 3/64 inch perforations and a pressure rating of 125-psig- minimum, WOG working pressure.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Close equipment shutoff valves before turning off gas to premises or section of piping. Perform leakage test as specified to determine that all equipment is turned off in affected piping section.
B. Install shutoff valve, downstream from gas meter, outside building at gas service entrance.
C. Install gas stops for shutoff to appliances with NPS 2" or smaller low pressure gas supply.
D. Drips and Sediment Traps: Install drips at points where condensate may collect. Include outlets of gas meters. Locate where readily accessible to permit cleaning and emptying. Do not install where condensate would be subject to freezing.
E. Install gas piping at uniform slope of 0.1 percent upward toward risers.
F. Use eccentric reducer fittings to make reductions in pipe sizes. Install fittings with level side down.
G. Connect branch piping from top or side of horizontal piping.
H. Install strainers on supply side of each control valve, gas pressure regulator, solenoid valve, and elsewhere as indicated.
I. Install valves in accessible locations, protected from damage. Tag valves with metal tag indicating piping supplied. Attach tag to valve with metal chain.
J. Install gas valve upstream from each gas pressure regulator. Where two gas-pressure regulators are installed in series, valve is not required at second regulator.
K. Connect gas piping to equipment and appliances with shutoff valves and unions. nstall gas valve upstream from and within 72 inches of each appliance using gas. Install union or flanged connection downstream from valve.
L. Inspect, test, and purge piping according to NFPA 54, Part 4, "Gas Piping Inspection, Testing, and Purging", and requirements of authorities having jurisdiction.
END OF SECTION 15198

SECTION 15410 - PLUMBING FIXTURES
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: None.
B. Comply with requirements of Public Law 102-486, "Energy Policy Act", regarding water flow rate and water consumption of plumbing fixtures.
C. Comply with applicable standards below:
1. Enameled, Cast Iron Fixtures: ASME A112.19.1M.
2. National Sanitation Foundation Construction: NFS2.
3. Porcelain Enameled Fixtures: ASME A112.19.4M.
4. Slip Resistant Bathing Surfaces: ASTM F 462.
5. Stainless Steel Fixtures: ASME A112.19.3M.
6. Vitreous China Fixtures: ASME A112.19.2M.
PART 2 - PRODUCTS
2.1 Refer to the fixture schedule on drawing P200
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install fitting insulation kits on fixtures for the disabled.
B. Install fixtures with flanges and gasket seals.
C. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for the disabled to reach.
D. Fasten wall hanging plumbing fixtures securely to supports attached to building substrate when supports are specified, and to building wall construction where no support is indicated.
E. Fasten floor mounted fixtures to substrate. With fixtures having holes for securing fixture to wall construction, fasten to reinforcement built into walls.
F. Fasten wall mounted fittings to reinforcement built into walls.
G. Fasten counter mounted plumbing fixtures to casework.
H. Secure supplies to supports or substrate within pipe space behind fixture.
I. Set shower receptors and mop basins in leveling bed of cement grout.
J. Install individual supply inlets, supply stops, supply risers, and tubular brass traps with cleanouts at fixture.
K. Install water supply stop valves in accessible locations.
L. Install traps on fixture outlets. Omit traps on fixtures having integral traps. Omit traps on indirect wastes, unless otherwise indicated.
M. Install escutcheons at wall, floor, and ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep pattern escutcheons where required to conceal protruding pipe fittings.
N. Seal joints between fixtures and walls, floors, and counters using sanitary type, one part, mildew resistant, silicone sealant. Match sealant color to fixture color.
O. Install piping connections between plumbing fixtures and piping systems and plumbing equipment. Install insulation on supplies and drains of fixtures for the disabled.
P. Ground equipment. Tighten electrical connectors and terminals according to UL 486A and UL 486B.
END OF SECTION 15410

SECTION 15425 - PLUMBING SPECIALTIES
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Minimum Working Pressure Rating for Products:
1. Water Distribution Piping: 80 psig.
B. Submittals: Product Data.
PART 2 - PRODUCTS
2.1 Refer to fixture schedule on drawing P200.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install backflow preventers at each water-supply connection to mechanical equipment and where required by authorities having jurisdiction.
B. Install hose bibbs with integral or field-installed vacuum breaker.
C. Install floor drains at low points of surface areas and where indicated. Set tops of drains flush with finished floor.
1. Trap drains connected to sanitary building drain.
2. Install drain flashing collar or flange so no leakage occurs between drain and adjoining flooring. Maintain integrity of waterproof membranes.
END OF SECTION 15425

SECTION 15554 FLUES AND VENTS
PART 1 - GENERAL
1.1 SECTION REQUIREMENTS
A. Submittals: Product Data.
PART 2 - PRODUCTS
2.1 GAS VENTS
A. Vent/air intake for high efficiency domestic water heater. Size per manufacturer's recommendation.
B. Accessories: Tees, elbows, increasers, draft hood connectors, metal cap with bird barrier, adjustable roof flashing, storm collar, support assembly, thimbles, firestopping spacers, and fasteners; fabricated of similar materials and designs as vent pipe straight sections.
PART 3 - EXECUTION
3.1 INSTALLATION
A. Install vents according to stipulated minimum clearances from combustibles.
B. Seal between sections of positive pressure vents using only sealants recommended by manufacturer.
C. Support vents at intervals to support the weight of the vent and all accessories, without exceeding loading of appliances.
END OF SECTION 15554

PLUMBING ABBREVIATIONS

AFF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
(E)/EXT'G	EXISTING
FCO	FLOOR CLEANOUT
FD	FLOOR DRAIN
FS	FLOOR SINK
GCO	GRADE CLEANOUT

SUPPLIER/VENDOR ABBREVIATIONS

CO2AS	TENANT'S CO2 ALARM SUPPLIER
GC	GENERAL CONTRACTOR
HES	TENANT'S HVAC EQUIPMENT SUPPLIER
HS	TENANT'S HOOD SUPPLIER
KES	TENANT'S KITCHEN EQUIPMENT SUPPLIER
SPS	TENANT'S SODA POP SUPPLIER
TAB	TENANT'S TEST & BALANCE VENDOR
TCC	TENANT'S CABLING CONTRACTOR
TDC	TENANT'S DUCT CLEANER
TEMS	TENANT'S ENERGY MANAGEMENT SYSTEM SUPPLIER
TLS	TENANT'S LIGHT/LAMP SUPPLIER
TMB	TENANT'S MENU BOARD SUPPLIER
TMS	TENANT'S MILLWORK SUPPLIER
TP	TENANT'S PHONE SUPPLIER
TRS	TENANT'S RAILING SUPPLIER
TSV	TENANT'S SIGN VENDOR
TUV	TENANT'S UV SANITIZER SUPPLIER
WCS	TENANT'S WALK-IN COOLER SUPPLIER
WHS	TENANT'S WATER HEATER SUPPLIER

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ 08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
PLUMBING SPECIFICATIONS

SHEET NUMBER:
P-010

GENERAL NOTES:

A. ALL PUBLIC USE LAVATORY FAUCETS SHALL HAVE AN AUTOMATIC SAFETY WATER MIXING DEVICE IN ACCORDANCE WITH ANSI//ASSE 1016 OR 1017.

B. ALL HANDICAPPED ACCESSIBLE WATER CLOSETS SHALL HAVE THE FLUSHING HANDLE ON THE WIDE SIDE OF THE HANDICAPPED ACCESSIBLE STALL AS REQUIRED BY LOCAL BARRIER FREE CODE REQUIREMENTS.

C. PROVIDE STOP VALVES AT FIXTURES. IN ADDITION, PROVIDE SHUT OFF VALVES FOR ISOLATION OF FIXTURE GROUPS

D. INSULATE THE HOT AND COLD WATER AND CONDENSATE DRAINAGE PER THE SPECIFICATIONS AND DETAIL 2/P-400.

E. PROVIDE GAS SHUT-OFF VALVES AT EACH PIECE OF EQUIPMENT. PROVIDE ACCESSIBLE DIRT LEG AT THE BOTTOM OF VERTICAL SECTIONS OF GAS PIPE AND AT THE CONNECTION TO EACH PIECE OF EQUIPMENT.

F. CONCEAL PIPING UNLESS NOTED OTHERWISE. WATER SUPPLY PIPES SHALL BE INSTALLED LEVEL. PIPING IN EXTERIOR WALLS SHALL BE INSTALLED ON WARM SIDE OF INSULATION.

G. WHERE THE WATER OR GAS SUPPLY LINE SIZE SHOWN IN THE PLUMBING DRAWINGS DIFFERS FROM THE FIXTURE OR EQUIPMENT CONNECTION SIZE, PROVIDE LINE SIZE PIPE SHOWN TO WITHIN 6" OF THE FIXTURE OR EQUIPMENT BEFORE TRANSITIONING TO THE CONNECTION SIZE.

H. ALL WATER PIPING SHALL BE COPPER. NO PVC ALLOWED.

I. PERFORM FLOW TEST ON THE INCOMING WATER PRESSURE ON THE DOMESTIC WATER SYSTEM AT POSSESSION. IF WATER PRESSURE IS OVER 80 PSI THEN COORDINATE WITH CHIPOTLE CONSTRUCTION MANAGER TO PROVIDE A PRESSURE REGULATOR (WATTS LFUSB-Z3 OR EQUAL). PROVIDE RESULTS OF FLOW TEST TO THE ENGINEER FOR CONFIRMATION OF ADEQUATE CAPACITY.

J. PROVIDE TRAP PRIMERS FOR FLOOR DRAINS.

K. INSTALL SHUTOFF AND ISOLATION VALVES SHOWN TO BE ABOVE CEILINGS IN ACCESSIBLE LOCATIONS WITHIN 12" OF LAY-IN CEILINGS.

MATERIAL SCHEDULE

CATEGORY	APPLICATION	ALLOWABLE MATERIAL
WATER SUPPLY PIPE	ABOVE GRADE	TYPE L COPPER TUBE
NATURAL GAS PIPE	CONCEALED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS
	EXPOSED	SCH. 40 STEEL PIPE, MALLEABLE IRON THREADED FITTINGS, PAINTED

KEYNOTES FOR THIS SHEET 1 , 2 ETC.


1	CONNECT TO EXISTING 2" DOMESTIC WATER SERVICE IN THIS LOCATION.
2	PROVIDE 1/2" FILTERED WATER TO THE BAG-IN-BOX SODA CARBONATOR AT 102" AFF. SODA CARBONATOR SHALL HAVE AN INTEGRAL ASSE 1022-RATED CARBONATED BEVERAGE BACKFLOW PREVENTION DEVICE.
3	PROVIDE WATER HEATERS DWH-1 & DWH-2 PER DETAIL 5/P-200. OFFSET FLUE VENTS TO BE 10'0" MINIMUM FROM ANY AIR INTAKES.
4	PROVIDE WATER FILTERS MOUNTED TO WALL PER DETAIL 1/P-401. PROVIDE 1/2" SUPPLY PIPES FROM FILTERS TO ICE MAKER AND SODA CARBONATOR AS SHOWN.
5	PROVIDE 1/2" FILTERED WATER TO ICE MAKER AT 56" AFF. PROVIDE 6'-0" LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE WATER CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
6	PROVIDE DOMESTIC WATER ROUGH-INS FOR THE MOP BASIN FAUCET AT 36" AFF. PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 64" AFF DIRECTLY ABOVE THE MOP BASIN FAUCET. SEE ARCHITECTURAL ELEVATION FOR DETAIL.
7	CONNECT TO THE EXISTING GAS SERVICE IN THIS AREA. COORDINATE WITH GAS COMPANY FOR REPLACEMENT OF GAS METER, IF REQUIRED BY NEW LOADS.
8	PROVIDE GAS CONNECTION TO THE COOKING EQUIPMENT PER DETAIL 3/P-400.
9	SUPPORT THE GAS PIPE ON THE ROOF PER DETAIL 3/P-401. WOOD BLOCKING IS NOT AN ACCEPTABLE METHOD OF SUPPORTING THE GAS PIPE.
10	PROVIDE ACCESSIBLE LINE-SIZED GAS VALVE, DIRT LEG, AND UNION AT GAS CONNECTION TO THE EQUIPMENT.
11	REFER TO ARCHITECTURAL DRAWINGS FOR PAINTING OF EXPOSED INTERIOR AND EXTERIOR GAS PIPE.
12	PROVIDE DOMESTIC WATER ROUGH-INS FOR THE CHEMICAL DISPENSER FAUCET (HB-1) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
13	PROVIDE DOMESTIC WATER ROUGH-INS FOR THE VICTORY WASH DISPENSER FAUCET (HB-2) AT 52" AFF. SEE ARCHITECTURAL ELEVATION FOR ADDITIONAL INFORMATION.
14	PROVIDE ROUGH-INS TO RESTROOM HAND SINKS AS SHOWN IN DETAIL 4/P-200.
15	PROVIDE KITCHEN EQUIPMENT GAS SHUTOFF 6" BELOW THE CEILING PER DETAIL 5/P-400.
16	CONNECT CHEMICAL DISPENSER TO HB-1. CHEMICAL DISPENSER HAS AN INTEGRAL AIR GAP AS IS SHOWN IN DETAIL 11/P-400.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.

17	PROVIDE ASSE 1016/1070 POINT-OF-USE THERMOSTATIC MIXING VALVE, WATTS LFUSG-B, ON WATER SUPPLY TO KITCHEN HAND SINKS. PROVIDE ANGLE STOP BELOW SINK, FASTEN MIXING VALVE TO WALL, AND MAKE FINAL CONNECTION FROM ANGLE STOPS TO MIXING VALVE AND FROM MIXING VALVE TO FAUCET USING BRAIDED STAINLESS STEEL HOSE. ADJUST MIXING VALVE FOR A DISCHARGE TEMPERATURE OF APPROXIMATELY 110° F.
18	PROVIDE ACCESSIBLE VALVE IN WATER SUPPLY TO FIXTURE AS SHOWN.
19	PROVIDE GAS CONNECTION TO THE RICE COOKER PER DETAIL 2/P-401.
20	PROVIDE GAS ROUGH-IN TO FRYER BEHIND RICE COOKER TABLE SO THAT VALVES AND DIRT LEG ARE ACCESSIBLE ONCE FRYER IS SECURED INTO PLACE.
21	PROVIDE 1/2" FILTERED WATER ROUGH-IN TO THE ICE MAKER AT 24"AFF. PROVIDE 6' LONG STAINLESS STEEL FLEXIBLE BRAIDED WASHING MACHINE CONNECTOR WITH MINIMUM 0.43" ID (BRASSCRAFT SL12-72WA F OR EQUAL) FOR FINAL CONNECTION TO ICE MAKER.
22	INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV PER CHIPOTLE'S INSTALLATION INSTRUCTIONS.
23	PROVIDE 3/4" DOMESTIC HOT AND COLD WATER ROUGH-INS FOR THE PREP SINK (SK-2) FAUCET AT 24" AFF TO ALLOW FOR THE VICTORY WASH CHEMICAL DOCK TO BE INSTALLED DIRECTLY BELOW THE PREP SINK BASIN. MAKE FINAL CONNECTION TO THE PREP SINK FAUCET USING 3/4" BRAIDED STAINLESS STEEL WATER HEATER CONNECTOR HOSE.
24	PROVIDE 3/4" HOT WATER TO THE DISH MACHINE, MAKING FINAL CONNECTION USING CONNECTION HOSE FURNISHED WITH DISH MACHINE. PROVIDE WATER HAMMER ARRESTOR ON HOT WATER LINE. PROVIDE AN ACCESSIBLE SHUTOFF VALVE BELOW THE DISH MACHINE AND INSTALL THE STRAINER FURNISHED WITH THE DISH MACHINE IN AN ACCESSIBLE LOCATION AT THE CONNECTION TO THE UNIT.
25	PROVIDE ROOF HYDRANT RH-1 WITH BOTTOM OF NOZZLE INSTALLED 24" ABOVE THE BOTTOM OF ROOF DECK. SUPPORT ROOF HYDRANT PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
26	PROVIDE FILTERED DOMESTIC WATER ROUGH-IN FOR THE SPEED FILL POT FILLER FAUCET (PF-1) AT 40"AFF. SEE ARCHITECTURAL ELEVATION FOR DETAIL.
27	INSTALL RGF IMSB ICE MAKER SANITIZER FURNISHED BY TUV BELOW UTENSIL COUNTER PER CHIPOTLE'S INSTALLATION INSTRUCTIONS. LOCATE IMSB BELOW UTENSIL COUNTER IN A LOCATION THAT DOES NOT INTERFERE WITH THE ROLLING RACK BELOW THE UTENSIL COUNTER.
28	PROVIDE ACCESSIBLE TRAP PRIMER ABOVE LAY-IN CEILING AS SHOWN. INSTALL PER MANUFACTURER'S INSTALLATION INSTRUCTIONS WITH A SERVICE VALVE AT THE TRAP PRIMER INLET. PROVIDE 1/2" DISTRIBUTION PIPE(S) TO FLOOR DRAIN TRAP PRIMER CONNECTION(S) AS SHOWN. HORIZONTAL DISTRIBUTION PIPING SHALL HAVE CONTINUOUS SLOPE TO THE FLOOR DRAIN(S).
29	WATER SOFTENER ASSEMBLY TO SERVE HOT WATER HEATERS ONLY. PIPE INCOMING WATER THROUGH SOFTENER PRIOR TO CONNECTION OF WATER HEATERS.

PLUMBING SYMBOLS

- ELBOW UP
- ELBOW DOWN
- DOMESTIC COLD WATER
- DOMESTIC FILTERED COLD WATER
- DOMESTIC SOFTENED COLD WATER
- DOMESTIC HOT WATER (110 DEGREES)
- DOMESTIC HOT WATER RECIRC.
- GAS
- GAS (ON ROOF)
- PLAN NOTE: SEE PLAN NOTES LISTED ON THE SAME SHEET FOR NOTE MEANING
- CONNECT TO EXISTING
- REDUCED PRESSURE ZONE BACKFLOW PREVENTER
- WATER METER
- GAS METER
- EQUIPMENT TAG: SEE EQUIPMENT SCHEDULE ON SHEET P200 FOR EQUIPMENT INFORMATION
- VALVE
- SOLENOID-OPERATED VALVE
- WALL HYDRANT/ROOF HYDRANT
- CHECK VALVE
- CIRCUIT-SETTER BALANCE VALVE RATED FOR POTABLE WATER
- FLOOR DRAIN
- FLOOR SINK
- CLEANOUT

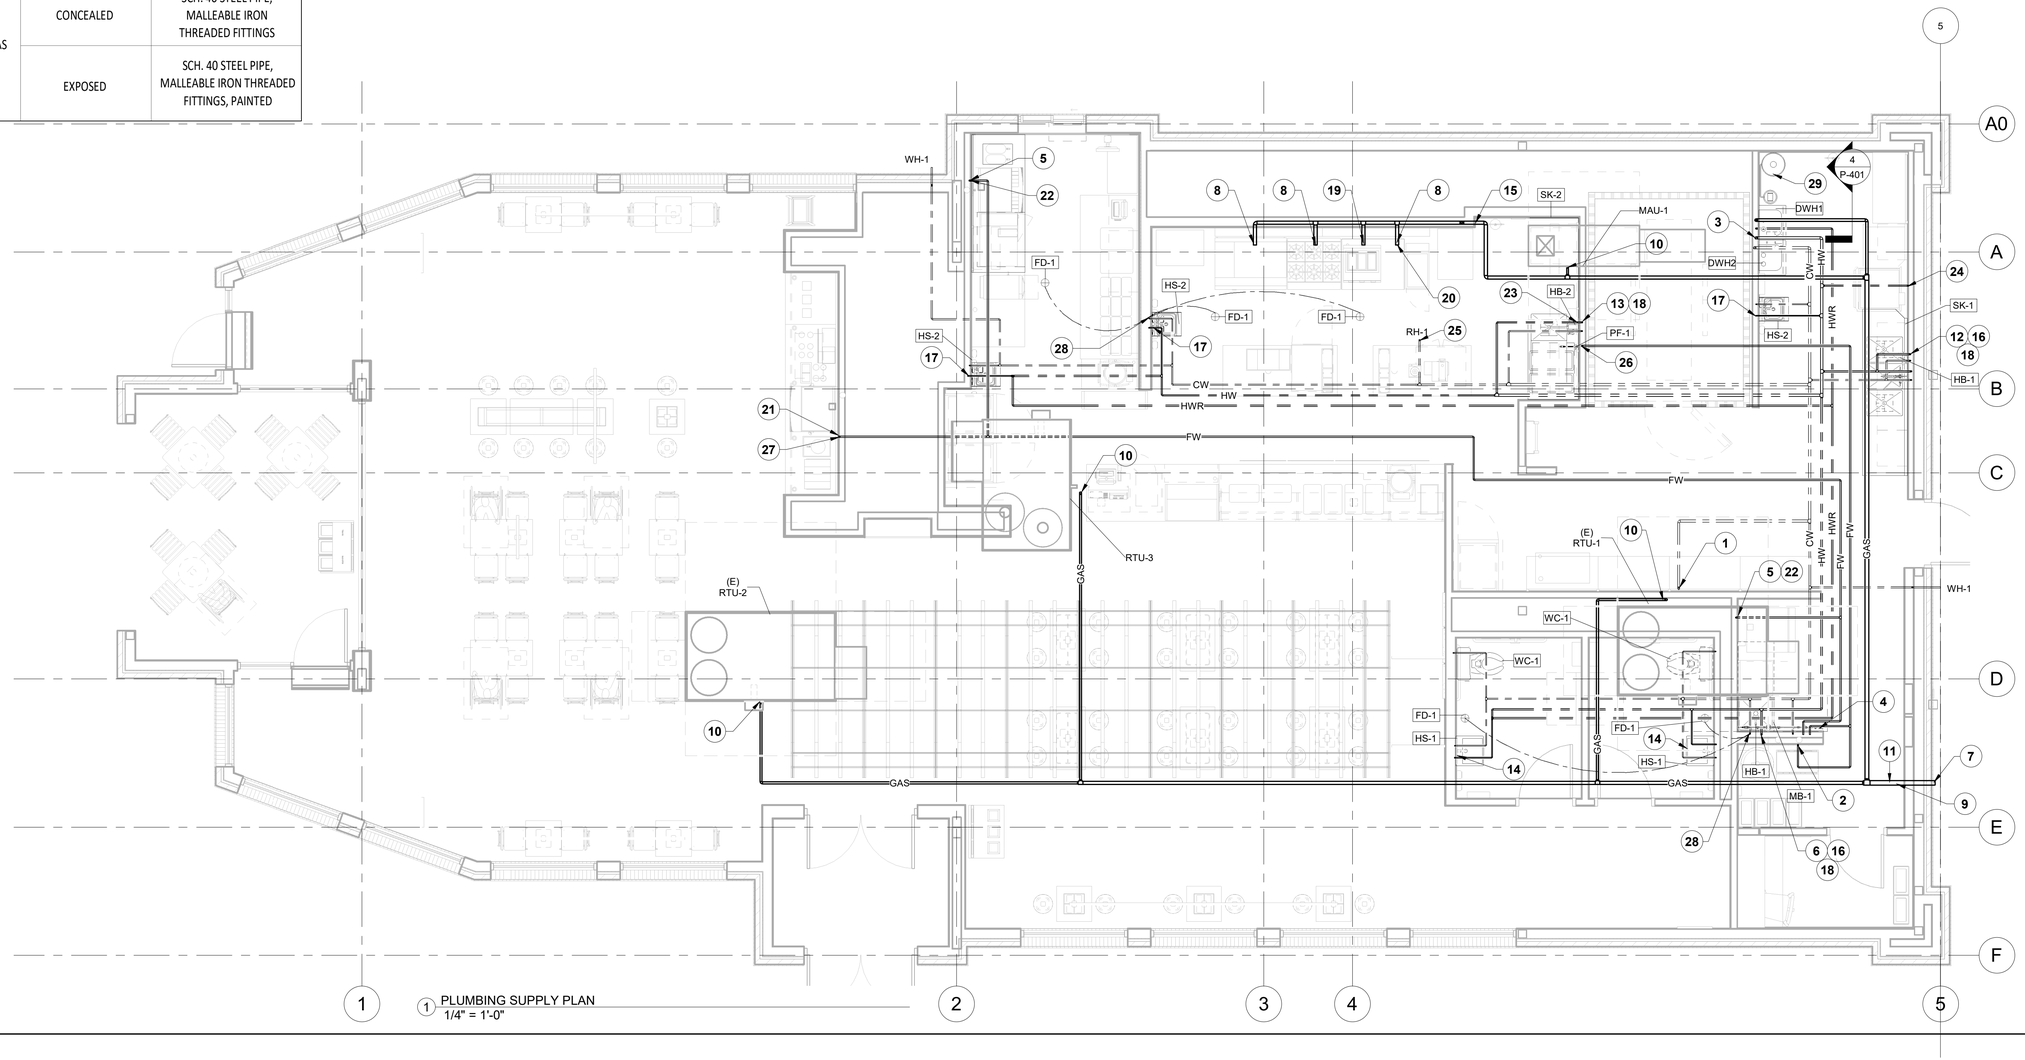

1 PLUMBING SUPPLY PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ 08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
PLUMBING SUPPLY PLAN

SHEET NUMBER:
P-100

GENERAL NOTES:

A. ALL SANITARY LINES AND PLUMBING FIXTURES ON THE PROJECT SHALL HAVE AN APPROVED MEANS OF SEWAGE BACKFLOW PREVENTION. FIXTURE SPECIFIC BACKFLOW PREVENTION INCLUDING AIR GAPS AND VACUUM BREAKERS ARE AN ACCEPTABLE MEANS OF BACKFLOW PREVENTION.

B. THE CONTRACTOR SHALL OBTAIN A COPY OF THE LANDLORD'S TENANT CRITERIA MANUAL PRIOR TO BIDDING. THE TENANT CRITERIA MANUAL REQUIREMENTS SHALL BE INCLUDED IN THE CONTRACTOR CONTRACT. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COMPLYING WITH THE LANDLORD REQUIREMENTS AT NO ADDITIONAL EXPENSE TO THE PROJECT.

C. PROVIDE TEMPORARY COVERS, CAPS, OR PLUGS ON SANITARY SEWER SYSTEM THROUGHOUT THE DURATION OF CONSTRUCTION. RAG WADS, DUCT TAPE, OR OTHER SIMILAR METHODS OF TEMPORARY COVERS SHALL NOT BE UTILIZED. UPON COMPLETION OF CONSTRUCTION, COMPLETELY REMOVE ANY AND ALL OBSTRUCTIONS INSIDE THE ENTIRE SYSTEM BY SNAKING, RODING, OR JETTING THE SYSTEM IMMEDIATELY PRIOR TO PROJECT TURNOVER TO THE OWNER.

D. ALL BELOW GRADE SANITARY LINES SHALL BE A MINIMUM OF 2" OR IN ACCORDANCE WITH LOCAL CODE REQUIREMENTS.

E. SANITARY TEE FITTINGS SHALL NOT BE INSTALLED IN DRAIN, WASTE, AND VENT (DWV) SYSTEMS.

F. INSTALL SANITARY PIPING 2" OR SMALLER AT A SLOPE OF 1/4" PER FOOT AND SANITARY PIPING LARGER THAN 2" AT A SLOPE OF 1/8" PER FOOT.

G. ALL HANDICAPPED ACCESSIBLE WATER CLOSETS SHALL HAVE THE FLUSHING HANDLE ON THE WIDE SIDE OF THE HANDICAPPED ACCESSIBLE STALL AS REQUIRED BY LOCAL BARRIER FREE REQUIREMENTS.

H. THE PLUMBING CONTRACTOR SHALL PROVIDE HEAT TRACING TAPE AND INSULATION AS REQUIRED FOR ALL PIPING INSTALLED WITHIN WALK-IN FREEZERS TO PREVENT PIPING FROM FREEZING. THE HEAT TRACING SHALL BE THERMON 10-FLX-1 OR EQUAL. COORDINATE THE INSTALLATION OF THE HEAT TRACING WITH THE ELECTRICAL CONTRACTOR PRIOR TO INSTALLATION.

I. PRIOR TO TURNOVER, PERFORM A VIDEO INSPECTION OF THE SANITARY AND GREASE LINES FROM THE MAIN LINES WITHIN THE TENANT SPACE TO THE MAIN SEWER TO VERIFY THAT THE SANITARY WASTE SYSTEM IS CONNECTED, CLEAN, AND FREE OF SAGS, BELLIES, BREAKS, AND DEBRIS. DELIVER A REPORT AND COPY OF THE VIDEO TO THE TENANT'S CONSTRUCTION MANAGER PRIOR TO TURNOVER.


J. PRIOR TO CONNECTION TO ANY EXISTING SEWER SYSTEM PERFORM A DIE TEST TO VERIFY THE TYPE OF SYSTEM AND THE DIRECTION OF FLOW. REPORT ANY DEVIATION FROM THE CONSTRUCTION DOCUMENTS TO THE TENANT'S CONSTRUCTION MANAGER.

K. PROVIDE TRAP PRIMERS FOR FLOOR DRAINS.


KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
1	PROVIDE 3/4" CONDENSATE DRAIN FROM THE WALK-IN COOLER EVAPORATOR TO THE FLOOR SINK BELOW THE WATER HEATERS AS SHOWN. SLOPE CONDENSATE DRAIN A MINIMUM OF 1" PER FOOT. HOLD EXPOSED CONDENSATE DRAIN IN WALK-IN COOLER AS HIGH AS POSSIBLE. CONCEAL DRAIN PIPING WITHIN FRAMED WALLS AS SHOWN. DISCHARGE THROUGH AN AIR GAP. MAKE FINAL CONNECTION TO EVAPORATOR INSIDE WALK-IN COOLER USING A UNION. CONDENSATE DRAIN SHOULD PENETRATE WALL BEHIND PREP SINK AT 8" AFF AND BE SECURED TO FLOOR UNDER SINK.
2	PROVIDE DRAIN CONNECTIONS TO THE THREE COMPARTMENT SINK PER DETAIL 4/P-400.
3	COORDINATE ROUTING OF SODA BUNDLES WITH COCA-COLA TECHNICIAN FROM BAG-IN-BOX AREA TO EACH SODA FOUNTAIN. OTHER THAN WITHIN THE WALLS DOWN TO THE DRYER BOX THE SODA BUNDLE SHALL BE ROUTED OVERHEAD WITHOUT CONDUIT. COORDINATE SUPPORT AND ROUTING OF THE SODA LINE BUNDLES WITH COCA-COLA TECHNICIAN DURING ROUGH IN AND PROVIDE NECESSARY SUPPORTS. SEE ARCHITECTURAL DRAWINGS FOR SODA BUNDLE TERMINATION LOCATION AND PROVIDE TERMINATION PER DETAIL THIS SHEET.
4	PROVIDE PVC DRAIN PIPES FROM THE ICE MACHINE TO THE FLOOR SINK PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A CODE-APPROVED AIR GAP AT THE DISCHARGE TO THE FLOOR SINK. SECURE DRAIN PIPES TO THE BOTTOM OF THE ICE MAKER.
5	PROVIDE DRAIN LINES FROM THE FOOD PREP SINK TO THE FLOOR SINK. PROVIDE AN AIR GAP AT THE DISCHARGE TO THE FLOOR SINK.
6	CONNECT TO EXISTING OR PROVIDE NEW 4" VENT THROUGH THE ROOF. SEE DETAIL 1/P-400.
7	CONNECT TO EXISTING GREASE WASTE LINE TO EXTERIOR GREASE INTERCEPTOR.
8	CONNECT TO EXISTING 4" SANITARY SEWER PROVIDED BY LANDLORD.

KEYNOTES FOR THIS SHEET 1 , 2 ETC.	
9	PROVIDE 3/4" VALVED DRAIN FROM HOT FOOD TABLE TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP.
10	PROVIDE INSULATED COPPER DRAIN LINES FROM THE TEA TRAY DRAIN AND THE SODA MACHINE DRAIN TO THE FLOOR SINK. DRAIN THROUGH AN AIR GAP. HOLD TEA TRAY DRAIN AS HIGH AS POSSIBLE AND SECURE TO STRUCTURE BELOW THE UTENSIL COUNTER.
11	TRIM TRENCH DRAIN ENDS PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS PRIOR TO INSTALLATION SO THAT GRATE FITS WITHOUT GAPS. INSTALL TRENCH DRAIN WITH SLIGHT POSITIVE SLOPE TOWARD THE DRAIN CONNECTION TO AVOID STANDING WATER IN TRENCH DRAIN.
12	DO NOT PROVIDE WALL CLEANOUTS ON TILE OR PUBLICLY-VISIBLE WALLS. IF A WALL CLEANOUT IS REQUIRED ON THESE SURFACES COORDINATE THE EXACT LOCATION WITH CHIPOTLE'S CONSTRUCTION MANAGER.
13	PROVIDE INDIRECT WASTE AND CONDENSATE DRAINS FROM FIXTURES OTHER THAN KITCHEN SINKS CONCEALED IN THE WALL AS SHOWN IN DETAIL 6/P-400.
14	PROVIDE DRAIN FROM WATER FILTER BFP TO MOP SINK, CONCEALED IN WALL AS SHOWN IN DETAIL 6/P-400.
15	PROVIDE TRENCH DRAIN PER DETAIL 8/P-400.
16	INSTALL DRAIN HOSE FURNISHED WITH DISH MACHINE FROM DISH MACHINE OUTLET TO FLOOR SINK. HOLD DRAIN HOSE TIGHT TO WALL AND SECURE TO 3-COMP SINK DRAIN TO MAINTAIN AN AIR GAP AT THE FLOOR SINK.
17	PROVIDE DRAIN FROM WATER SOFTENER ASSEMBLY TO ADJACENT FLOOR SINK.
18	SEE DETAIL 5/P-401 FOR DRAINS FROM TEA TRAY, ICE MAKER, AND SODA MACHINE TO FUNNEL DRAIN.

MATERIAL SCHEDULE		
CATEGORY	APPLICATION	ALLOWABLE MATERIAL
SANITARY WASTE AND VENT PIPE	ABOVE GROUND, CONCEALED	PVC PLASTIC DWV PIPE AND FITTINGS
	ABOVE GROUND PREP SINK AND WARE WASHING SINK DRAINS	PVC PLASTIC DWV PIPE AND FITTINGS
	ABOVE GROUND HAND SINK DRAINS	BRASS WITH CHROME FINISH
	BELOW GROUND	PVC PLASTIC DWV PIPE AND FITTINGS



3 SODA TERMINATION DETAIL
NOT TO SCALE

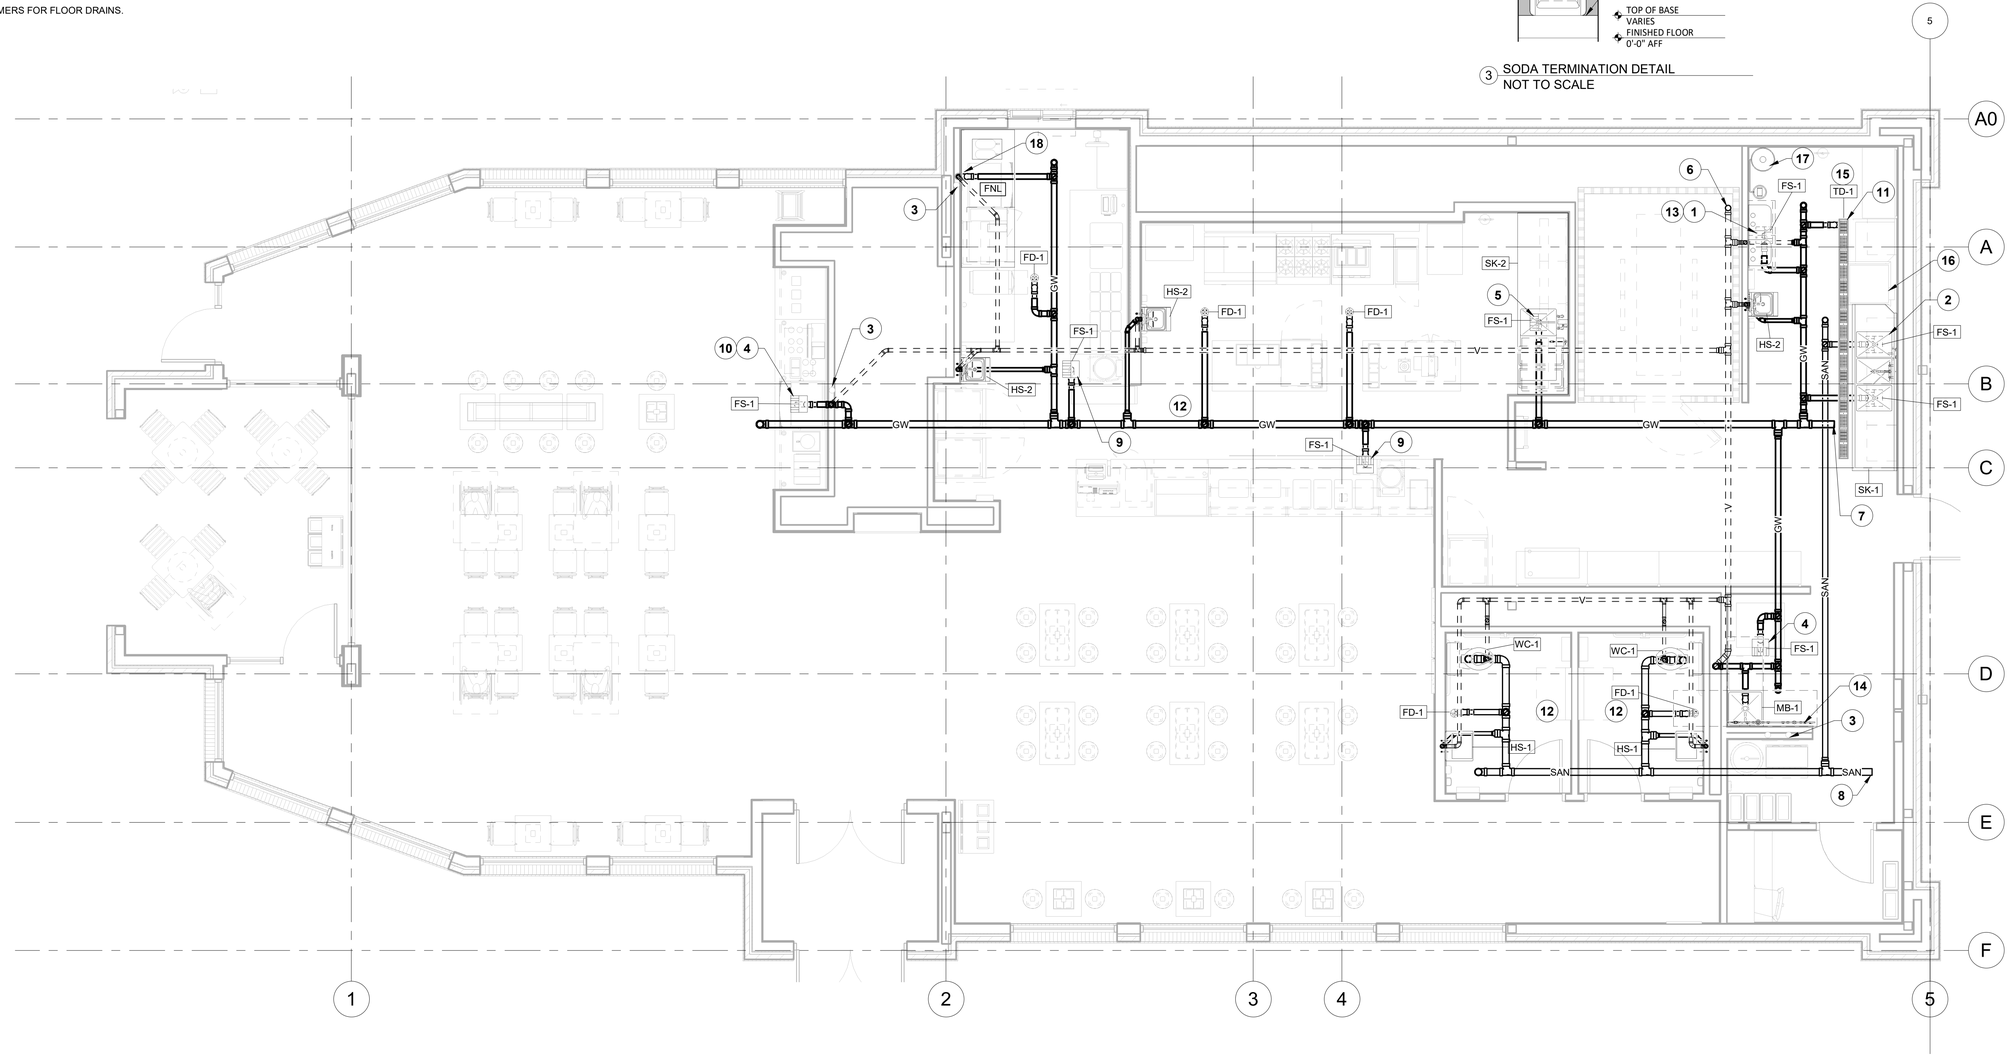

1 PLUMBING WASTE & VENT PLAN
1/4" = 1'-0"

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:
PLUMBING WASTE AND VENT PLAN

SHEET NUMBER:
P-102

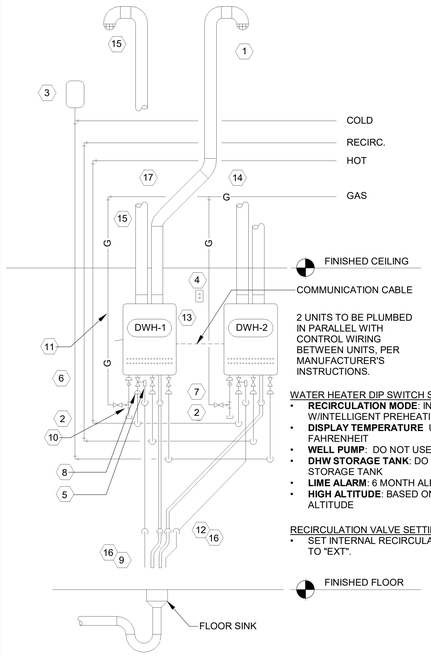

WATER HEATER INSTALLATION NOTES

A. CLEAN INLET STRAINERS AFTER CONSTRUCTION HAS BEEN COMPLETED AND PRIOR TO TURNOVER OF THE BUILDING TO THE OWNER.
B. INSTALL PIPING WITH AS FEW ELBOWS AS POSSIBLE.
C. MAINTAIN REQUIRED CLEARANCES TO COMBUSTIBLE MATERIALS.
D. SEE ARCHITECTURAL ELEVATIONS FOR EXACT MOUNTING HEIGHT.
E. ADJUST WATER HEATER TO A SETPOINT OF 120° F.

WATER HEATER DIP SWITCH SETTINGS

- **RECIRCULATION MODE**: INTERNAL W/INTELLIGENT PREHEATING.
- **DISPLAY TEMPERATURE** UNIT: FAHRENHEIT
- **WELL PUMP**: DO NOT USE WELL PUMP
- **DHW STORAGE TANK**: DO NOT USE STORAGE TANK
- **LIME ALARM**: 6 MONTH ALERT
- **HIGH ALTITUDE**: BASED ON PROJECT ALTITUDE


RECIRCULATION VALVE SETTING

- SET INTERNAL RECIRCULATION VALVE TO "EXT".

WATER HEATER DETAIL NOTES (TYPICAL EACH UNIT)

1. PROVIDE TWO 90° ELBOWS AND A SCREEN FOR THE FLUE TERMINATION THROUGH THE ROOF PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
2. ROUGH IN COLD, HOT, AND RECIRC WATER PIPES AT 64" AND GAS AT 61" BELOW THE FINISHED CEILING.
3. PROVIDE EXPANSION TANK ET-1 SHOWN. SUPPORT TANK FROM WALL OR STRUCTURE ABOVE.
4. PROVIDE WATER HEATER RECEPTACLE WITHIN 12" OF THE FINISHED CEILING, FASTEN CORD TIGHT TO THE WALL.
5. PROVIDE PRESSURE RELIEF VALVE. PIPE PRESSURE RELIEF VALVE TO FLOOR DRAIN OR MOP BASIN.
6. CONCEAL WATER PIPING WITHIN THE WALL AS SHOWN. INSULATE CONCEALED WATER PIPING. DO NOT PROVIDE INSULATION ON EXPOSED WATER PIPING AT WATER HEATERS.
7. INSTALL "PLUMB EASY VALVE SET" EXPOSED AT THE COLD AND HOT WATER CONNECTIONS TO THE WATER HEATER AS SHOWN.
8. IF THE PIPE SIZES AS SHOWN ON THE PLUMBING PLANS ARE LARGER THAN THE WATER HEATER CONNECTION SIZES, PROVIDE REDUCERS WITHIN 6" OF THE WATER HEATER.
9. PIPE PRESSURE RELIEF VALVE DISCHARGE AND FLUE CONDENSATE DRAIN TO THE FLOOR DRAIN OR MOP BASIN. DRAIN THROUGH AN AIR GAP.
10. PROVIDE AN EXPOSED DRIP LEG AND LINE-SIZED GAS VALVE ON THE GAS SERVICE TO THE WATER HEATER.
11. CONCEAL GAS PIPING IN THE WALL AS SHOWN.
12. PROVIDE 1/2" PVC FROM THE FLUE CONDENSATE CONNECTION TO THE POINT OF DISCHARGE. DRAIN THROUGH AN AIR GAP.
13. INSTALL THE TANKLESS WATER HEATER WITH THE TOP OF THE WATER HEATER BETWEEN 9" AND 12" OF THE FINISHED CEILING.
14. PROVIDE A 3" Ø PVC PIPE FROM THE TANKLESS WATER HEATER TO THE POINT OF DISCHARGE. SLOPE HORIZONTAL SECTION OF THE FLUE 1/4" PER FOOT TOWARDS THE DRAIN TEE.
15. PROVIDE A SCREENED AIR INTAKE WITH TWO 90° ELBOWS ABOVE THE ROOF LINE PER THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
16. CONCEAL DRAIN LINES IN WALL PER DETAIL 6/P-400.
17. OFFSET FLUE VENT AS REQUIRED TO MAINTAIN 10'-0" BETWEEN FLUE TERMINATION AND ANY OUTDOOR AIR INTAKES.
18. IF WATER HEATERS ARE INSTALLED WITH A COMMON VENT SYSTEM THEN PROVIDE THE NAVIEN COMMON VENT COLLAR KIT WITH BACK-DRAFT DAMPER PER THE MANUFACTURER'S INSTALLATION MANUAL.

5 WATER HEATER HOOK-UP
NOT TO SCALE

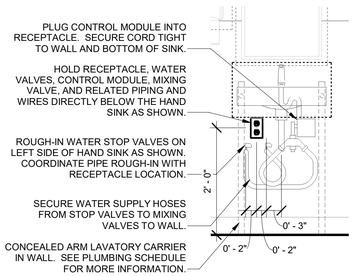

4 RESTROOM HAND SINK DETAIL
NOT TO SCALE

PLUMBING FIXTURE / EQUIPMENT SCHEDULE

TAG	FIXTURE	MANUFACTURER	MODEL NUMBER	DESCRIPTION	CONNECTION SIZES			FIXTURE UNITS (EACH)		
					HW	CW	WASTE	CW	HW	SAN
WC-1	WATER CLOSET	KOHLER	K-3519 W/ SEAT K-4666-C	WHITE HIGHLINE 1.1 GPF, 17-1/8"-HIGH, ADA ACCESSIBLE, PRESSURE ASSIST WATER CLOSET WITH OPEN-FRONT SEAT. INSTALL TRIP LEVER ON THE TANK TO THE OPEN SIDE OF THE STALL (ADD RA TO THE MODEL # FOR RIGHT HAND TRIP LEVER).	--	1/2"	3"	10	--	6
HS-1A	RESTROOM HAND SINK	AMERICAN STANDARD	9024.001EC	ADA-ACCESSIBLE, WALL-MOUNTED PORCELAIN LAVATORY. INSTALL PLUG-IN AUTOMATIC FAUCET WITH 0.5 GPM AERATOR AND THERMOSTATIC MIXING VALVE FURNISHED BY TES. PROVIDE ZURN Z1231 (Z1231-D FOR BACK TO BACK APPLICATIONS) CONCEALED ARM CARRIER IN WALL. PROVIDE TRUEBRO 103 E-Z PIPE INSULATION, PROVIDE OFFSET GRID DRAIN. APPROVED ALTERNATE: KOHLER K-2084	1/2"	1/2"	1 1/4"	1.5	1.5	1
HS-1B	RESTROOM HAND SINK FAUCET	FURNISHED BY KES	--	PLUG-IN AUTOMATIC FAUCET WITH 0.5 GPM AERATOR AND THERMOSTATIC MIXING VALVE. ADJUST FAUCET CONTROLS FOR 10 SECOND SHUTOFF DELAY AND 30 SECOND TIME-OUT DELAY.	1/2"	1/2"	0"	1.5	1.5	0
HS-2	KITCHEN HAND SINK	FURNISHED BY KES	--	STAINLESS STEEL SINK WITH WALL MOUNTING BRACKET, T&S BACKSPLASH MOUNTED FAUCET WITH SWIVEL GOOSENECK.	1/2"	1/2"	1 1/2"	3.0	3.0	2
MB-1	MOP BASIN	FIAT	MSB2424	PROVIDE 24" X 24" X 10" MOLDED STONE MOP BASIN. INSTALL MOP BASIN IN A BED OF GROUT SO THERE ARE NO VOIDS BETWEEN THE MOP BASIN AND THE SLAB.	--	--	3"	--	--	5
MB-1A	MOP BASIN FAUCET	KES	--	INSTALL SERVICE SINK FAUCET WITH BUILT IN STOPS, LEVER HANDLES, AND WALL BRACE FURNISHED BY KES.	1/2"	1/2"	--	2.25	2.25	0
FD-1	FLOOR DRAIN	SIOUX CHIEF	842-2-PNR	ADJUSTABLE FLOOR DRAIN WITH DECK FLANGE, ROUND POLISHED METAL RING AND STRAINER TRAP PRIMER CONNECTION	--	--	SEE PLANS	--	--	5
FS-1	FLOOR SINK	SIOUX CHIEF	861-3PU2	HEAVY DUTY PVC FLOOR SINK WITH ALUMINUM DOME BOTTOM STRAINER AND OPEN HALF PVC GRATE	--	--	SEE PLANS	--	--	5
SK-1	THREE COMPARTMENT SINK	FURNISHED BY KES	--	THREE-COMPARTMENT WARE-WASHING SINK FURNISHED WITH (1) PRE-RINSE UNIT WITH ADD ON FAUCET.	1/2"	1/2"	TO FS	1.5	1.5	--
SK-2	PREP SINK	FURNISHED BY KES	--	STAINLESS STEEL CHEF'S TABLE WITH INTEGRAL PREP SINK. FAUCET T&S MODEL #B-0293 WITH B-0199-01 AERATOR AT 2.2 GPM.	3/4"	3/4"	TO FS	1.5	1.5	--
ET-1	EXPANSION TANK	AMTROL	ST-5	2 GALLON CAPACITY	--	1/2"	--	--	--	--
P-1	RECIRCULATING PUMP	TACO	003-BC4-PNP	DOMESTIC HOT WATER CARTRIDGE-TYPE CIRCULATOR WITH INTEGRAL TIMER. PROVIDE WITH AQUASTAT 115 VOLTS, 1 PH, 60 HZ, 1 GPM SET AT 100°F.	1/2"	--	--	--	--	--
HB-1	HOSE BIBB	FURNISHED BY KES	--	COMMERCIAL QUALITY HOT & COLD MIXING WALL HYDRANT WITH AN INTEGRAL VACUUM BREAKER. SUPPLY ARMS SHALL HAVE INTEGRAL SHUT-OFF STOP AND CHECK VALVE.	3/4"	3/4"	--	1.87	1.87	--
HB-2	HOSE BIBB	FURNISHED BY KES	--	SILL FAUCET WITH 1/2"NPT FEMALE INLET AND 3/4" GARDEN HOSE THREADED OUTLET		1/2"	--	1.5	1.5	--
WCO	WALL CLEANOUT	ZURN	Z1446	WALL CLEANOUT, DURA-COATED CAST IRON BODY, GAS AND WATERTIGHT ABS TAPERED THREAD PLUG, ROUND, SMOOTH STAINLESS STEEL ACCESS COVER WITH SECURING SCREW. MOUTING HEIGHT SET AT 24" A.F.F.	--	--	--	--	--	--
FCO	FLOOR CLEANOUT	SIOUX CHIEF	852-3PNR (3") 852-4PNR (4")	ON-GRADE ADJUSTABLE CLEANOUT WITH INTERNAL THREADED CLEANOUT PLUG AND ROUND NICKEL-BRONZE RING AND COVER (OR APPROVED EQUAL WITH INTERNAL THREADED CLEANOUT PLUG)	--	--	--	--	--	
WH1	FREEZE PROOF WALL HYDRANT	WOODFORD	MODEL 65	AUTOMATIC DRAINING, FREEZELESS WALL HYDRANT WITH ANTI-SIPHON VACUUM BREAKER.		3/4"				
RH1	FREEZE PROOF ROOF HYDRANT	HOEPTNER	2131R	AUTOMATIC DRAINING, FREEZELESS HYDRANT WITH ANTI-SIPHON VACUUM BREAKER. HOEPTNER PRODUCTS 408-847-7615.		3/4"				
BFP-1	REDUCED PRESSURE BACKFLOW PREVENTER	CONBRACO	4ALF-203-T2F	LEAD FREE REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER WITH AUTOMATIC DIFFERENTIAL RELIEF VALVE	--	1/2"	--	--	--	--
FNL	FUNNEL DRAIN	J.R. SMITH	3823T	FUNNEL DRAIN WITH CAST BRONZE BODY AND THREADED OUTLET			2"			
TP-1	TRAP PRIMER	PRECISION PLUMBING PRODUCTS	P1-500 W/ DU-U	TRAP PRIMER WITH INTEGRAL VACUUM BREAKER AND DISTRIBUTION UNIT. CAP UNUSED DISTRIBUTION UNIT OUTLETS.	--	1/2"	--	--	--	--
GI	GREASE INTERCEPTOR	EXISTING		EXISTING 1,000 GALLON EXTERIOR INTERCEPTOR TO BE SERVICED AND REUSED.			4"			
TD-1	TRENCH DRAIN	ZURN	Z886 8601 8602	6" x 160" HDPE TRENCH DRAIN (SLOPED FROM 3.50" TO 4.70") WITH (2) CLOSED END CAPS, (1) 4" NO-HUB BOTTOM OUTLET, AND CLASS-A HEEL-PROOF POLYETHYLENE GRATES. SEE DETAIL 8/P400 FOR REDUCTION TO 2" DRAIN CONNECTION.	--	--	2"	--	--	2
PF-1	POT FILLER	FURNISHED BY KES	--	WALL-MOUNTED POT FILLER WITH SELF CLOSING FILLER VALVE AND 3/8" NPT FEMAILE INLET	--	1/2"	--	1.5	--	--

GAS WATER HEATER SCHEDULE - INSTANTANEOUS

MARK	DESCRIPTION	MANUFACTURER AND MODEL NO.	INPUT MBH	DELIVERY	NOTES
DWH-1 & 2	DIRECT VENT GAS FIRED INSTANTANEOUS WATER HEATER	NAVIEN NPE-240A2	199	5.6 GPM @ 65° RISE	PROVIDE WITH LEAD FREE "PLUMB EASY VALVE SET". GC SHALL PURCHASE WATER HEATER DIRECTLY THROUGH A NAVIEN AUTHORIZED DISTRIBUTOR (1-800-519-8794 OR WWW.NAVIEN.COM TO LOCATE AUTHORIZED DISTRIBUTOR).

VALVE SCHEDULE

TYPE	MANUFACTURER	THREADED/FLANGED PIPING		SOLDERED/BRAZED PIPING
		2" AND SMALLER	2-1/2" AND LARGER	3" AND SMALLER
BALL	JENKINS	901A	---	902A
	MILWAUKEE	BA100	---	BA150
	STOCKHAM	S-216-BR1-R-T	---	S-216-BR1-R-S
CHECK	JENKINS	4092	624-C	4093
	MILWAUKEE	509	F2974	1509
	STOCKHAM	B-319	G-931	B-309
AUTOMATIC BALANCING	HAYS	43-45-2510-0.50-P/T	N.A.	N.A.

NOTES:
1. VALVES MATERIAL (BODIES, DISC, GASKETS, LININGS, PACKINGS, ETC.) SHALL BE APPROVED FOR THE SERVICE IN WHICH THEY ARE INSTALLED.
2. VALVES SHALL BE LINE SIZE UNLESS OTHERWISE INDICATED.
3. VALVES SHALL BE EQUIPPED WITH ACCESSORIES AS REQUIRED.

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
PLUMBING FIXTURE SCHEDULE


SHEET NUMBER:
P-200

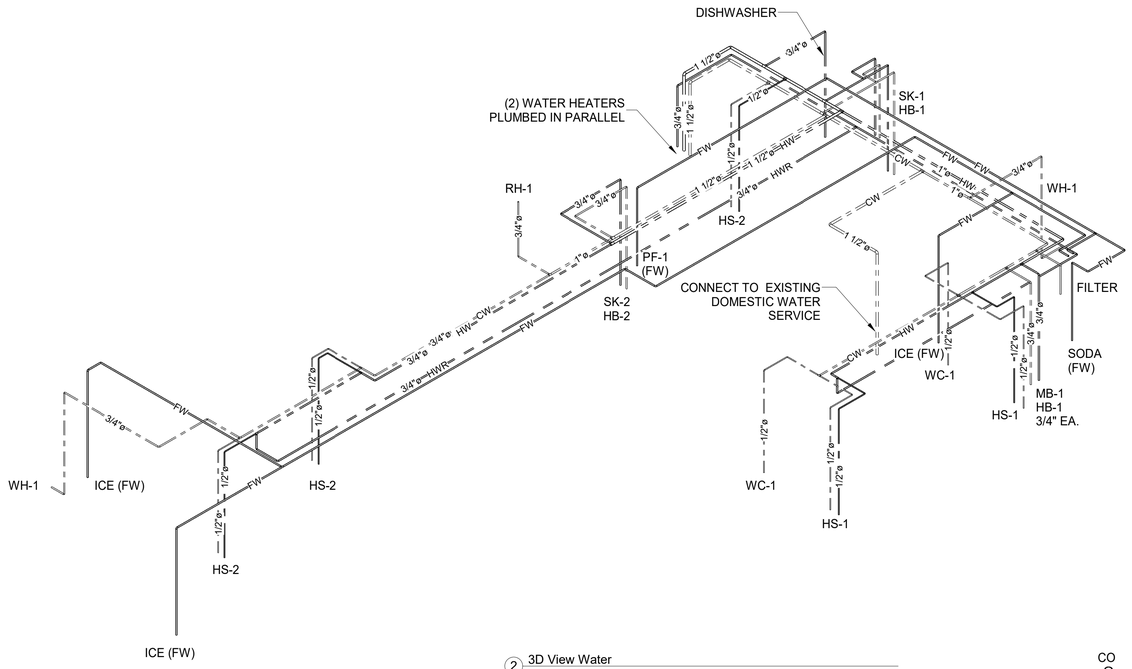

2 3D View Water

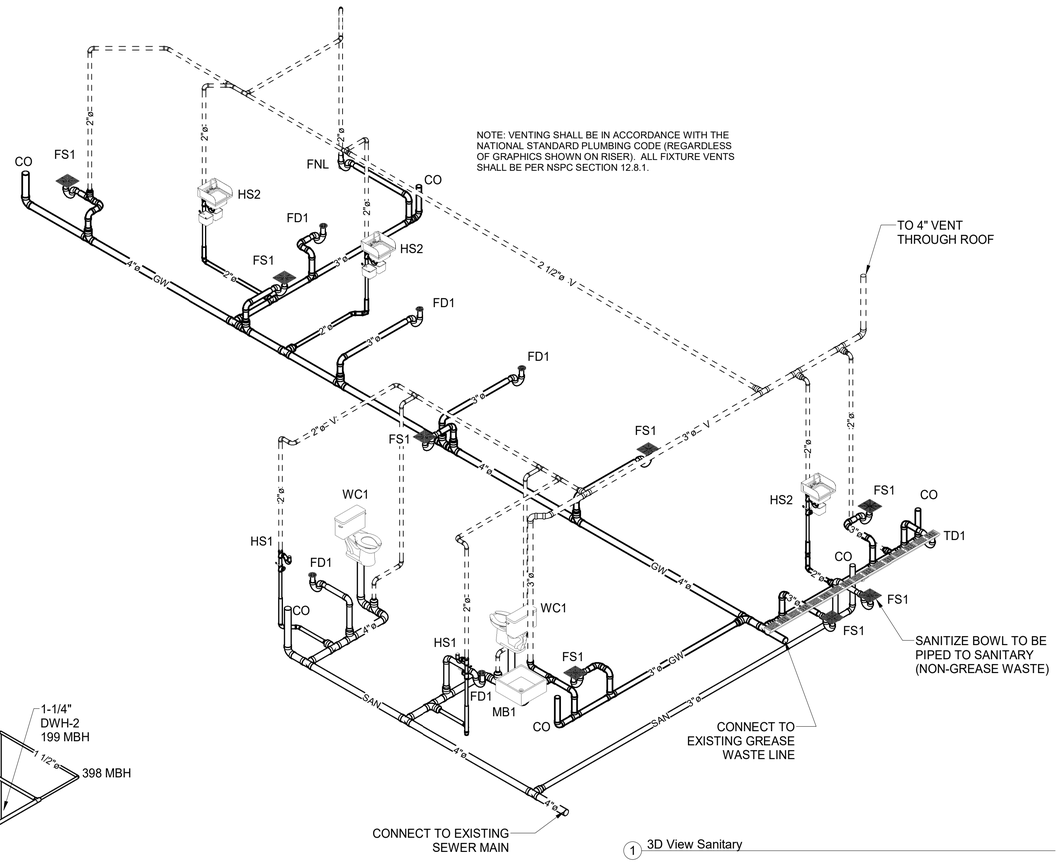

1 3D View Sanitary

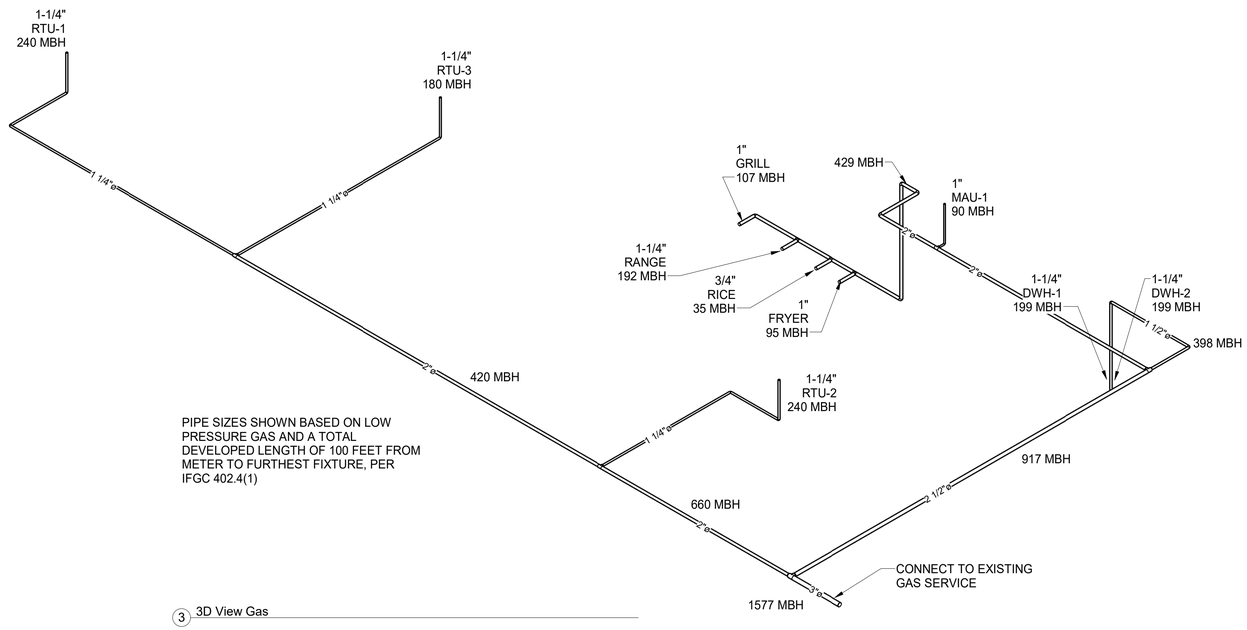

3 3D View Gas

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
1	02.02.2024	REVISION 1
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008


SHEET TITLE:
RISER DIAGRAMS

SHEET NUMBER:
P-300

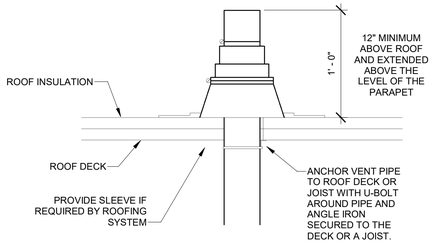


REFER TO PLANS FOR VTR PIPE SIZES AND LOCATIONS. LOCATE VTR MINIMUM TEN FEET HORIZONTALY OR THREE FEET VERTICALLY ABOVE ANY BUILDING OPENING OR FRESH AIR INTAKE, AND ONE FOOT FROM ANY VERTICAL SURFACE. PROVIDE 1" FIBERGLASS INSULATION WITH ALL-SERVICE JACKET ON VENT PIPE INSIDE BUILDING WITHIN SIX FEET OF VENT THRU ROOF LOCATION. FLASHING AND COUNTER FLASHING ARE TO BE COMPATIBLE WITH THE ROOFING SYSTEM.

1 VENT THROUGH ROOF
NOT TO SCALE

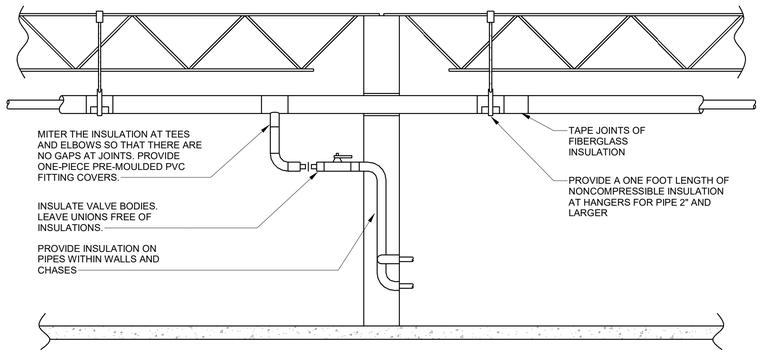


PROVIDE INSULATION ON INTERIOR COLD AND HOT WATER PIPING, CONDENSATE DRAIN PIPE, AND STORM PIPE. REFER TO SPECIFICATIONS FOR FURTHER INFORMATION REGARDING INSULATION. INSTALL ALL ITEMS PER SPECIFICATIONS AND MANUFACTURER'S INSTRUCTIONS. MAINTAIN VAPOR BARRIER ON COLD WATER AND CONDENSATE PIPING BY MEANS OF SEALANT AND TAPE. FLAME SPREAD AND SMOKE-DEVELOPED INDEXES SHALL NOT EXCEED 25/50. SEAL EXPOSED ENDS OF FIBERGLASS INSULATION WITH ADHESIVE MASTIC. UNLESS NOTED OTHERWISE PROVIDE PREFORMED GLASS FIBER PIPE INSULATION WITH PRE-MOLDED PVC JACKETS, SLEEVES, AND FITTING COVERS ON EXPOSED WATER PIPE SO THAT EXPOSED WATER PIPE IS COVERED ENTIRELY WITH PVC INSULATION COVERS.

2 PIPE INSULATION DETAIL
NOT TO SCALE

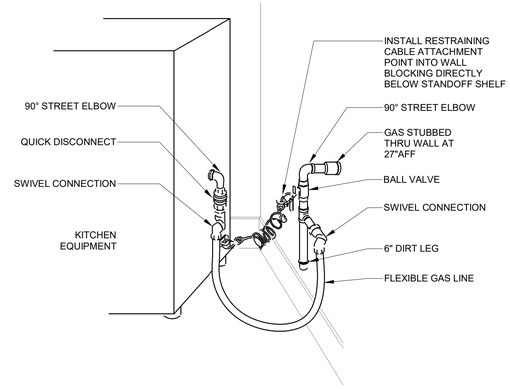


ARRANGEMENT SHOWN IS SCHEMATIC. ADJUST TO SUIT ACTUAL CONDITIONS. MAKE FINAL CONNECTION TO EQUIPMENT AS RECOMMENDED BY MANUFACTURER. PROVIDE WELDED FITTINGS/JOINTS IN ANY CONCEALED, UNSLEEVED LOCATION.

3 KITCHEN GAS EQUIPMENT DETAIL
NOT TO SCALE

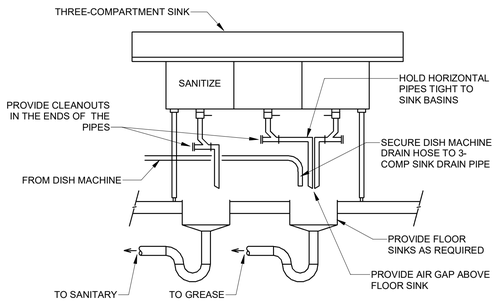


4 WARE-WASHING SINK DETAIL
NOT TO SCALE

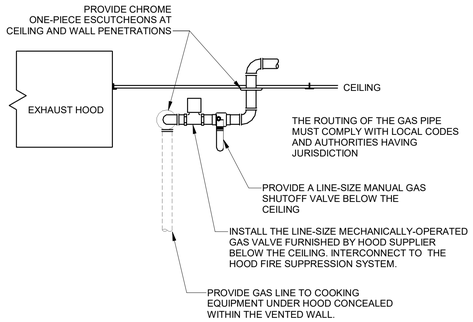


SEQUENCE OF OPERATIONS
NORMAL MODE:
DURING NORMAL OPERATION THE GAS SHUT-OFF VALVE SHALL BE OPEN.
EMERGENCY MODE:
UPON ACTUATION OF THE HOOD FIRE SUPPRESSION SYSTEM THE GAS SHUT-OFF VALVE SHALL CLOSE.

5 KITCHEN GAS SHUTOFF DETAIL
NOT TO SCALE

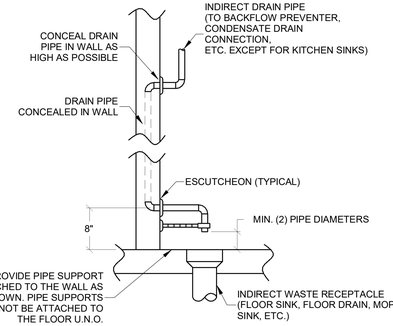


6 INDIRECT WASTE PIPING DETAIL
NOT TO SCALE

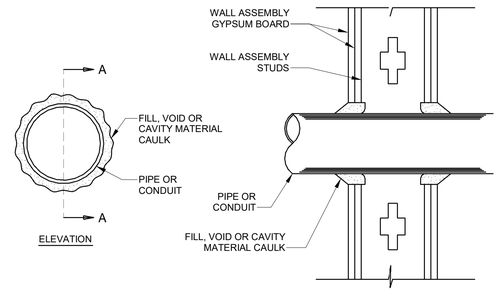


SECTION A-A

NOTE:
DETAIL FOR THROUGH PENETRATION OF A GYPSUM WALL WITH A FIRE RATING OF1, 2, 3, OR 4 HOURS BY METAL PIPE OR CONDUIT WITH SIZES OF 12" OR LESS FOR STEEL PIPE, 12" OR LESS FOR CAST IRON SOIL PIPE, 12" OR LESS FOR DUCTILE IRON PRESSURE PIPE, 6" OR LESS FOR STEEL CONDUIT, 4" OR LESS FOR STEEL ELECTRICAL METALLIC TUBING, 6" OR LESS FOR COPPER TUBING AND 1" OR LESS FOR FLEXIBLE STEEL CONDUIT.

7 THROUGH PENETRATION DETAIL W-L-1001
NOT TO SCALE

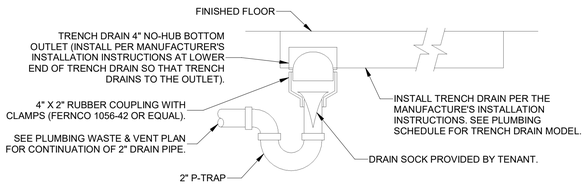


8 TRENCH DRAIN DETAIL
NOT TO SCALE

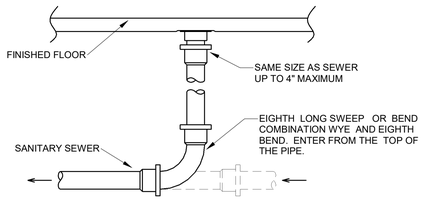

PROVIDE FLOOR CLEANOUTS WHERE SHOWN ON PLANS. LOCATE CLEANOUTS WHERE THERE IS 18" CLEAR AROUND. PROVIDE ROUND SECURED ADJUSTABLE TOP WITH "CO" ON COVER THAT IS SUITABLE FOR THE FLOOR FINISH (CARPET MARKER, RECESSED FOR TILE, SCORIATED FOR UNFINISHED FLOORS).

9 FLOOR CLEANOUT DETAIL
NOT TO SCALE

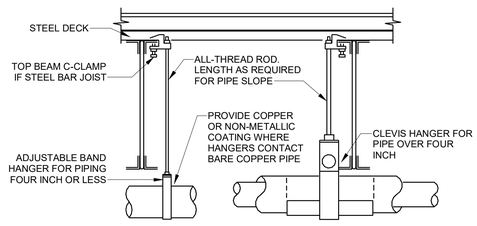


DO NOT HANG PIPE LARGER THAN 3" FROM BOTTOM OF JOISTS.

PROVIDE GALVANIZED STEEL SADDLE FOR ALL INSULATED PIPE LARGER THAN 3/4". VERIFY INSULATION THICKNESS WHEN SIZING HANGERS.

PROVIDE UPPER ATTACHMENT AS REQUIRED FOR CASES NOT SHOWN HERE. DO NOT INSTALL HANGER INSIDE INSULATION OR OTHERWISE PENETRATE VAPOR BARRIER. DO NOT HANG ONE PIPE FROM ANOTHER EXCEPT IN CHASES. TRAPEZE HANGERS MAY BE USED FOR MULTIPLE PARALLEL PIPES. HANGER SPACING FOR PIPE SIZE: COPPER: 4"=12' 3"=11' 2-1/2"=10' 2"=9' 1-1/2"=8' 1-1/4"=7' 1"=6' 3/4"=6' 1/2"=5'. CAST IRON: 10' AND ONE NEAR ALL JOINTS. STEEL: 4"=14' 3"=12' 2-1/2"=11' 2"=10' 1-1/2"=9' 1"=7' 3/4"=6' 1/2"=5'. LOCATE HANGERS AS CLOSE AS POSSIBLE TO TURNS AND TEES OF PIPE. PROVIDE SUPPLEMENTARY STEEL STRUTS BETWEEN JOISTS IF REQUIRED.LOCATE HANGERS TO TAKE LOAD OFF OF EQUIPMENT CONNECTIONS. ANCHOR WATER PIPE AGAINST SWAYING DUE TO CHANGES IN WATER VELOCITY. PROVIDE SEISMIC BRACING IF/AS REQUIRED BY LOCAL AUTHORITIES. CHAINS OR PERFORATED STRAP IRON OR STEEL IS NOT ACCEPTABLE. REFER TO CODES FOR FURTHER INFORMATION.

10 PIPE INSULATION/HANGER DETAIL
NOT TO SCALE



11 CHEMICAL DISPENSER DETAIL
NOT TO SCALE

2024-DB#2/P#1-2

Consultant:
Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP,NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL


Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS


PROJECT NUMBER:
21008

SHEET TITLE:
PLUMBING DETAILS


SHEET NUMBER:
P-400

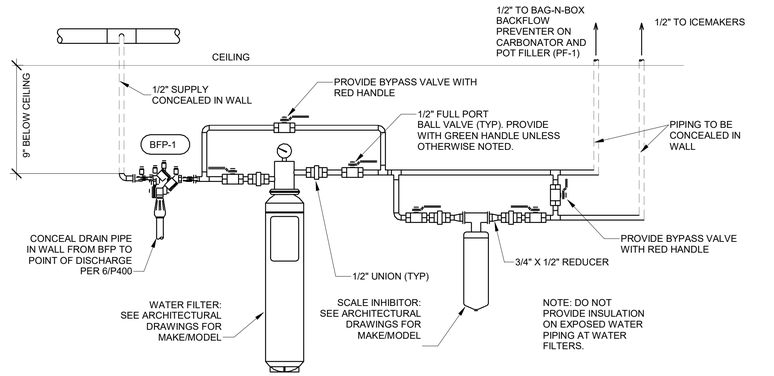

1 WATER FILTRATION
NOT TO SCALE

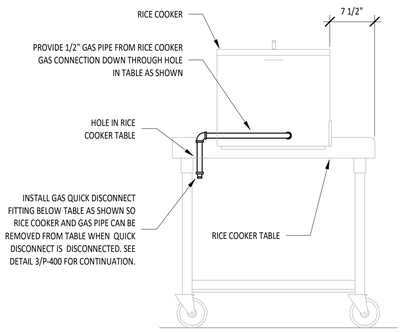


2 RICE COOKER GAS CONNECTION DETAIL
NOT TO SCALE

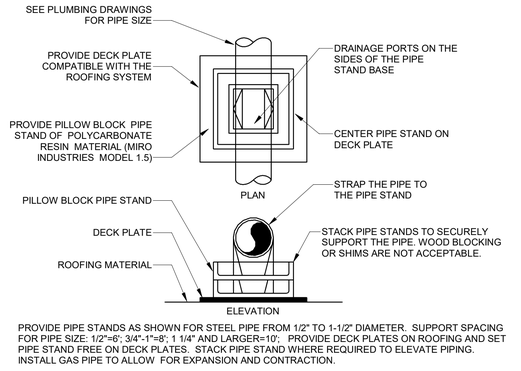

PROVIDE PIPE STANDS AS SHOWN FOR STEEL PIPE FROM 1/2" TO 1-1/2" DIAMETER. SUPPORT SPACING FOR PIPE SIZE: 1/2"=6', 3/4"-1"=8'; 1 1/4" AND LARGER=10'. PROVIDE DECK PLATES ON ROOFING AND SET PIPE STAND FREE ON DECK PLATES. STACK PIPE STAND WHERE REQUIRED TO ELEVATE PIPING. INSTALL GAS PIPE TO ALLOW FOR EXPANSION AND CONTRACTION.

3 ROOFTOP PIPING SUPPORT
NOT TO SCALE

4 WATER SOFTENER DETAIL
3/4" = 1'-0"

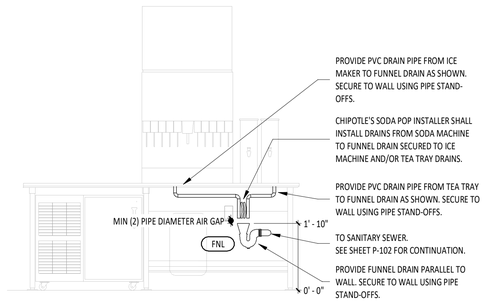

5 PUW FUNNEL DRAIN DETAIL
NOT TO SCALE

2024-DB#2/P#1-2

Consultant:

Polaris Consulting Engineers, PC
214 W. Main Street, Suite 208
Moorestown, NJ 08057
(856) 778-5400

COPYRIGHT 2023
THIS DRAWING IS AN INSTRUMENT OF SERVICE AND AS SUCH REMAINS THE PROPERTY OF CHIPOTLE MEXICAN GRILL, INC.. PERMISSION FOR USE OF THIS DOCUMENT IS LIMITED AND CAN BE EXTENDED ONLY BY WRITTEN AGREEMENT WITH CHIPOTLE MEXICAN GRILL, INC..

CHIPOTLE MEXICAN GRILL, INC.
PO BOX 182566
COLUMBUS, OH 43218-2566
TELEPHONE: (614) 318-2400
INTERNET: WWW.CHIPOTLE.COM

STORE NO.: 4064
555 MARKETPLACE BLVD
HAMILTON TOWNSHIP, NJ
08609

REV.	DATE	DESCRIPTION
	07.14.2023	PERMIT SET
2	02.16.2024	BID SET
3	03.25.2024	CONSTRUCTION SET

PROFESSIONAL SEAL

Michael L. Wilson, P.E.
NJ License #30077

PROFESSIONAL IN CHARGE: Michael L. Wilson, P.E.
DRAWN BY: PCE
CHECKED BY: AJS

PROJECT NUMBER:
21008

SHEET TITLE:

PLUMBING DETAILS

SHEET NUMBER:

P-401