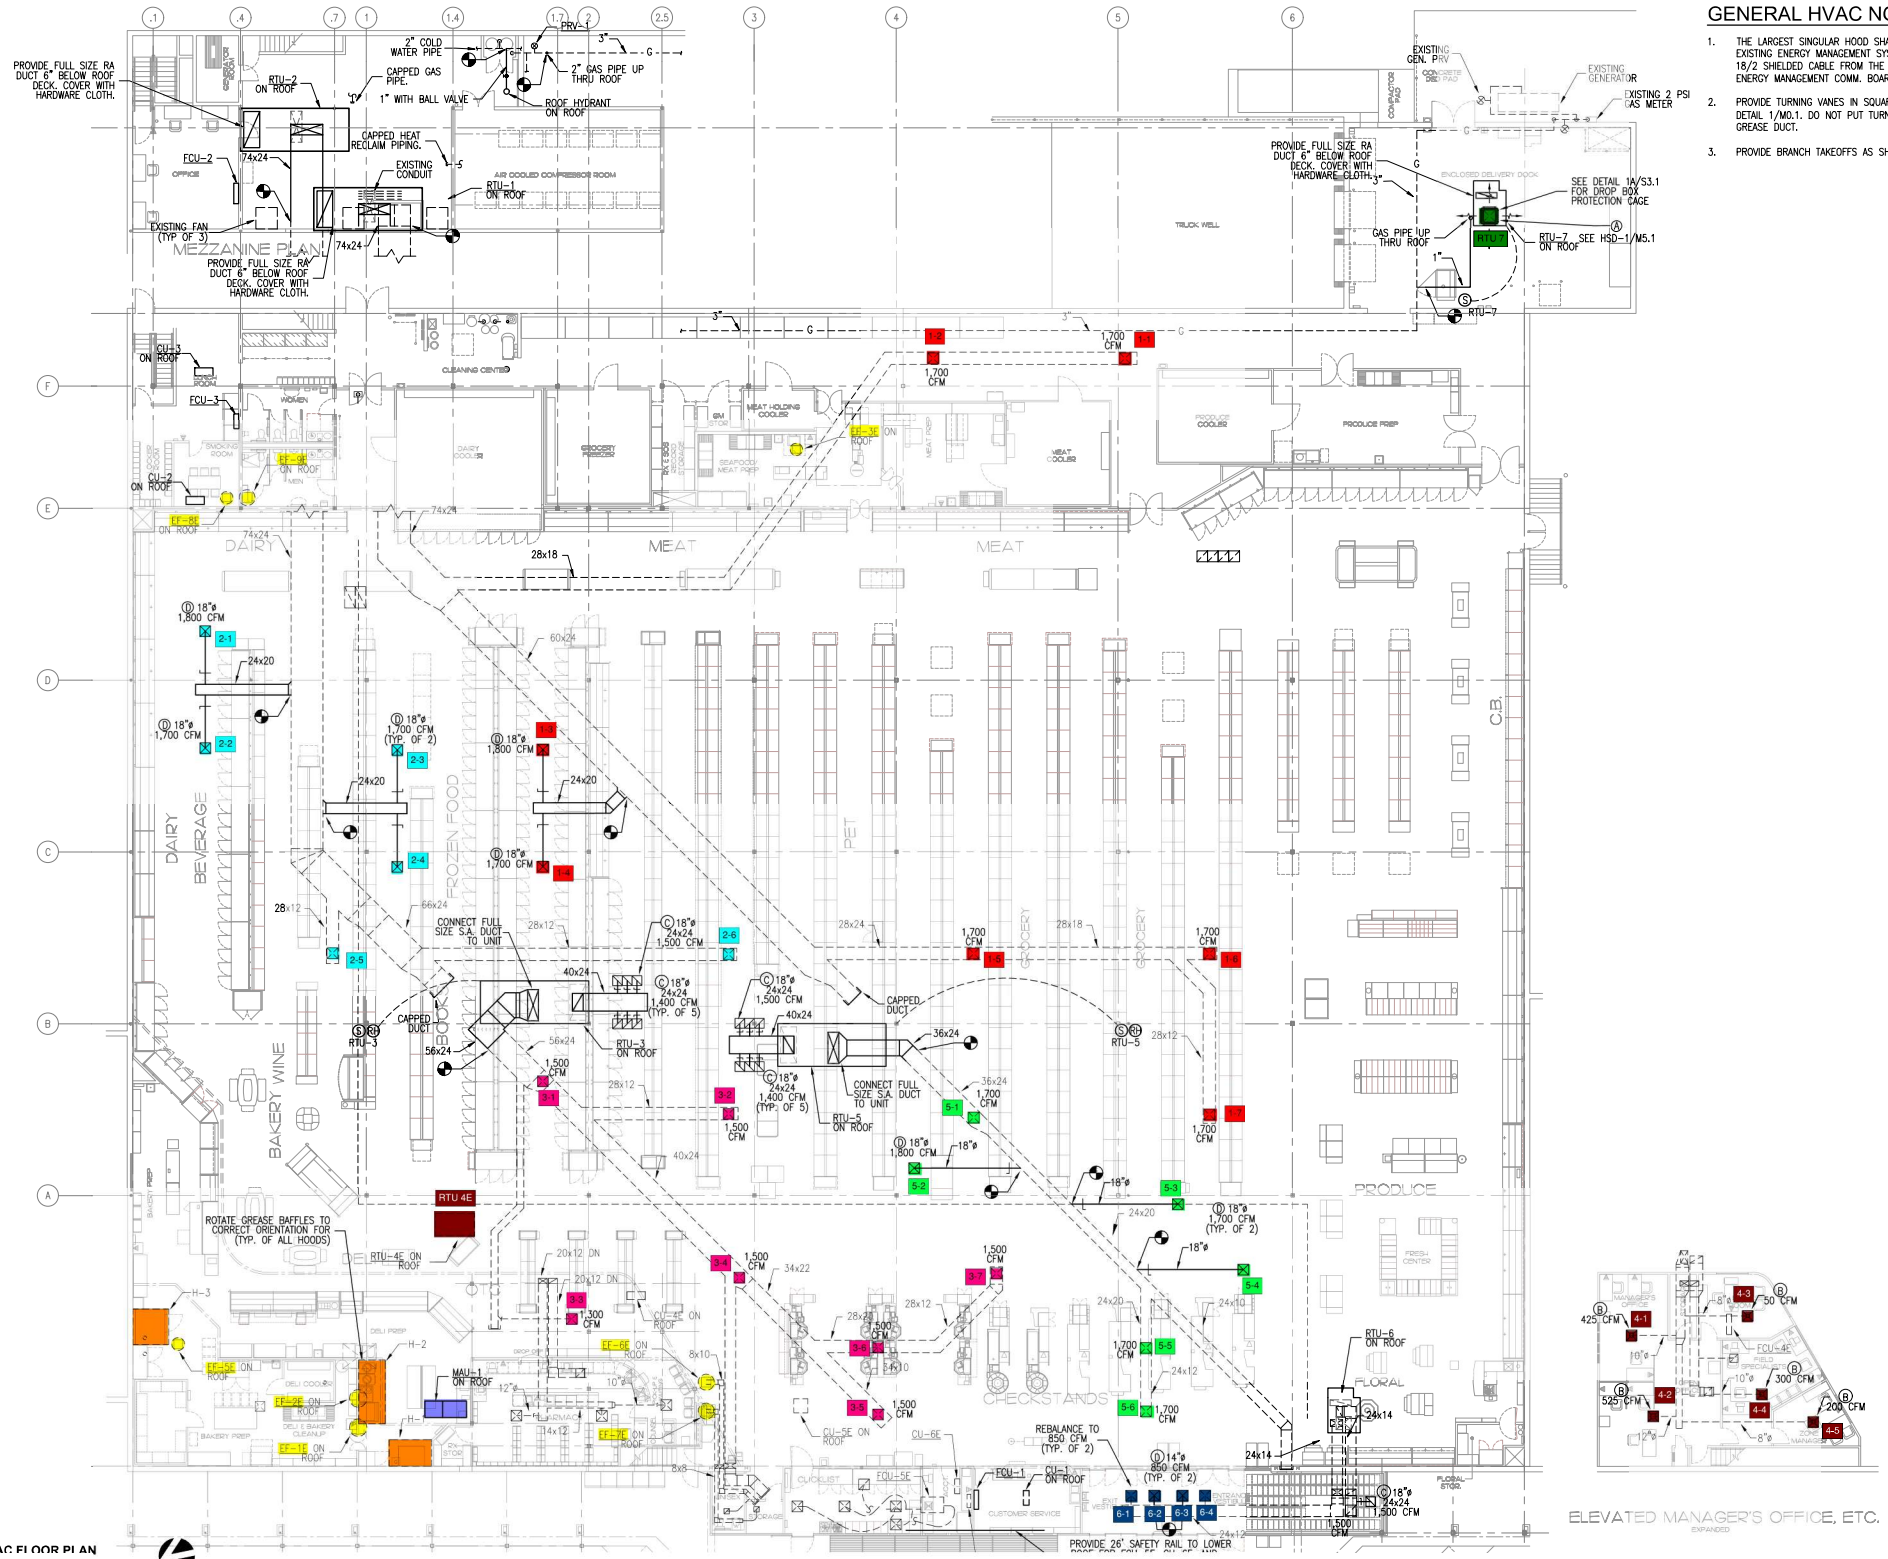

GENERAL HVAC NOTES

1. THE LARGEST SINGULAR HOOD SHALL BE CONNECTED TO THE EXISTING ENERGY MANAGEMENT SYSTEM. PROVIDE BELDEN 18/2 SHIELDED CABLE FROM THE HOOD TO THE CLOSEST ENERGY MANAGEMENT COMM. BOARD.
2. PROVIDE TURNING VANES IN SQUARE ELBOWS AS SHOWN IN DETAIL 1/M0.1. DO NOT PUT TURNING VANES IN EXHAUST GREASE DUCT.
3. PROVIDE BRANCH TAKEOFFS AS SHOWN IN DETAIL 2/M0.1.