


MECHANICAL FLOOR PLAN

1/4" = 1'-0"

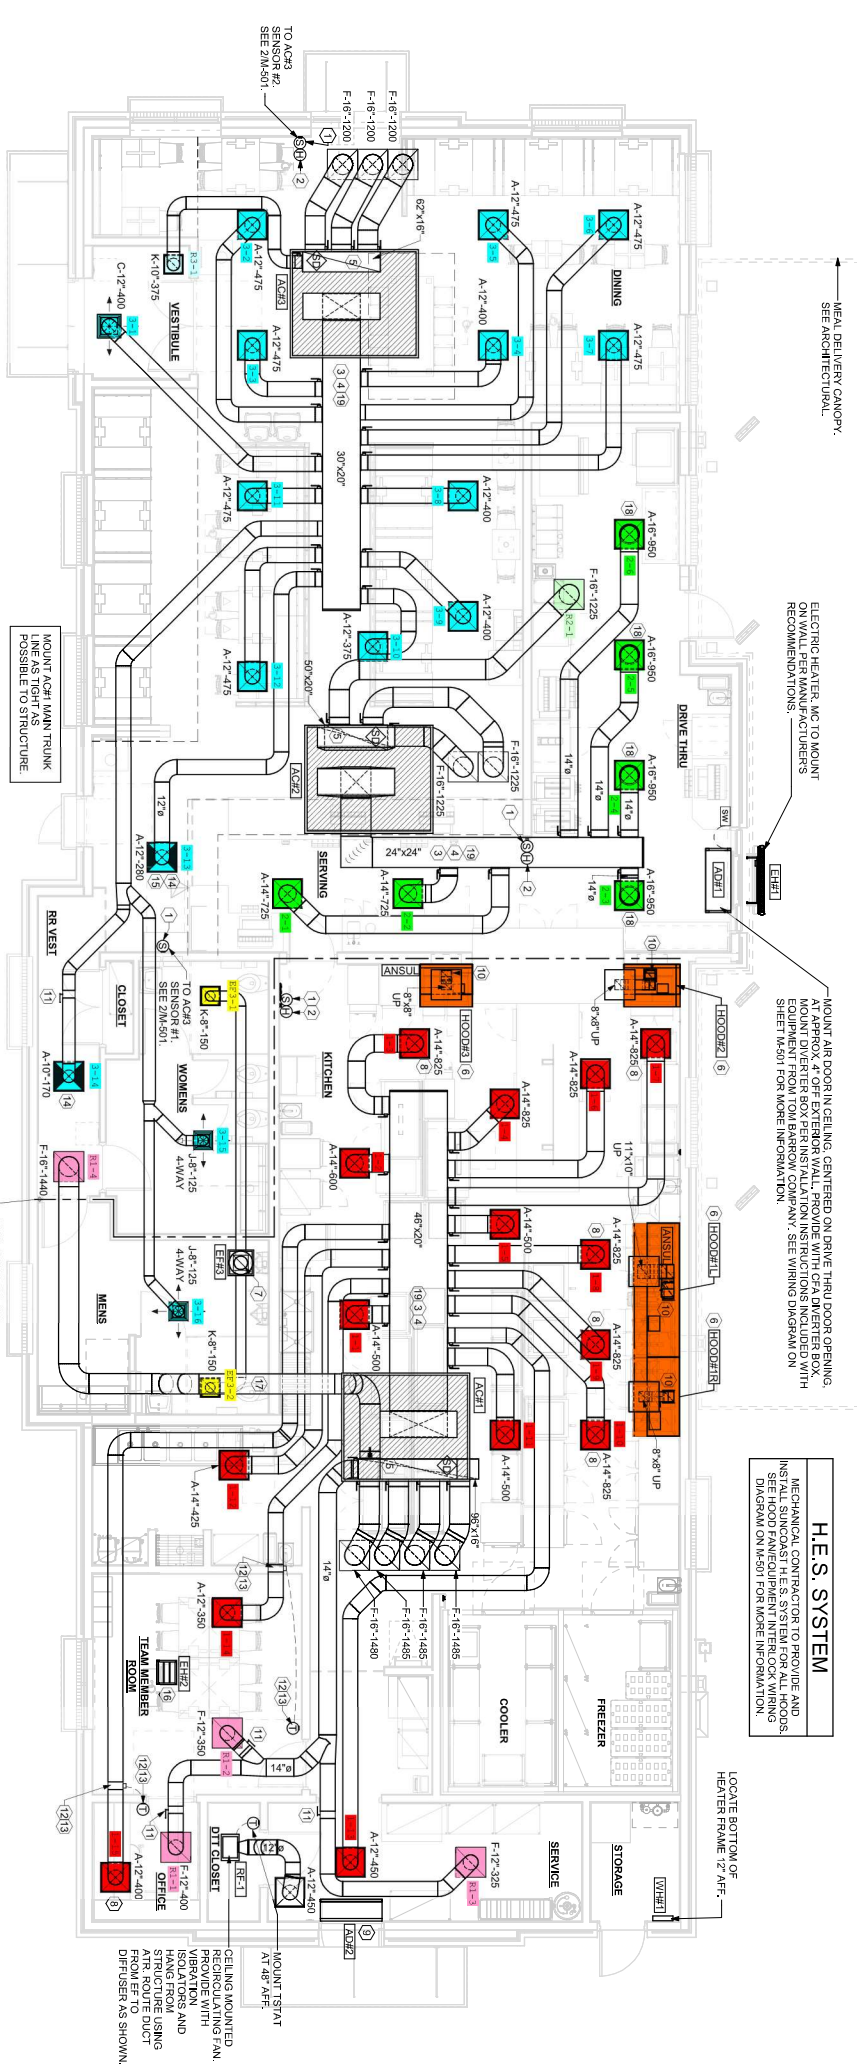

MEAL DELIVERY CANOPY.
SEE ARCHITECTURAL.

ELECTRIC HEATERS, NO TO MOUNT
ON WALL PER MANUFACTURERS
RECOMMENDATIONS. SEE

MOUNT AIR DOOR IN CEILING, CENTERED ON DRIVE THRU DOOR OPENING.
MOUNT DIFFUSER BOX PER INSTALLATION INSTRUCTIONS INCLUDED WITH
SHEET M-501 FOR MORE INFORMATION. SEE WIRING DIAGRAM ON

H.E.S. SYSTEM
MECHANICAL CONTRACTOR TO PROVIDE AND
INSTALL ALL EQUIPMENT AND WIRING.
SEE HOOD FAN/EQUIPMENT INTERLOCK WIRING
DIAGRAM ON M-501 FOR MORE INFORMATION.

LOCATE BOTTOM OF
HEATER FROM 12" AFF.

MOUNT FAN MAIN TRUNK
LINE AS TIGHT AS
POSSIBLE TO STRUCTURE.

SEAL PENETRATIONS IN SMOKE
ARCH PLANS FOR CONSTRUCTION.

CEILING MOUNTED
RECYCLING FAN.
PROVIDE WITH
INSULATORS AND
HANG FROM USING
STRUCTURE USING
FROM EFF TO 18" AFF
DIFFUSER AS SHOWN.

MOUNT TYPICAL
AT 48" AFF.