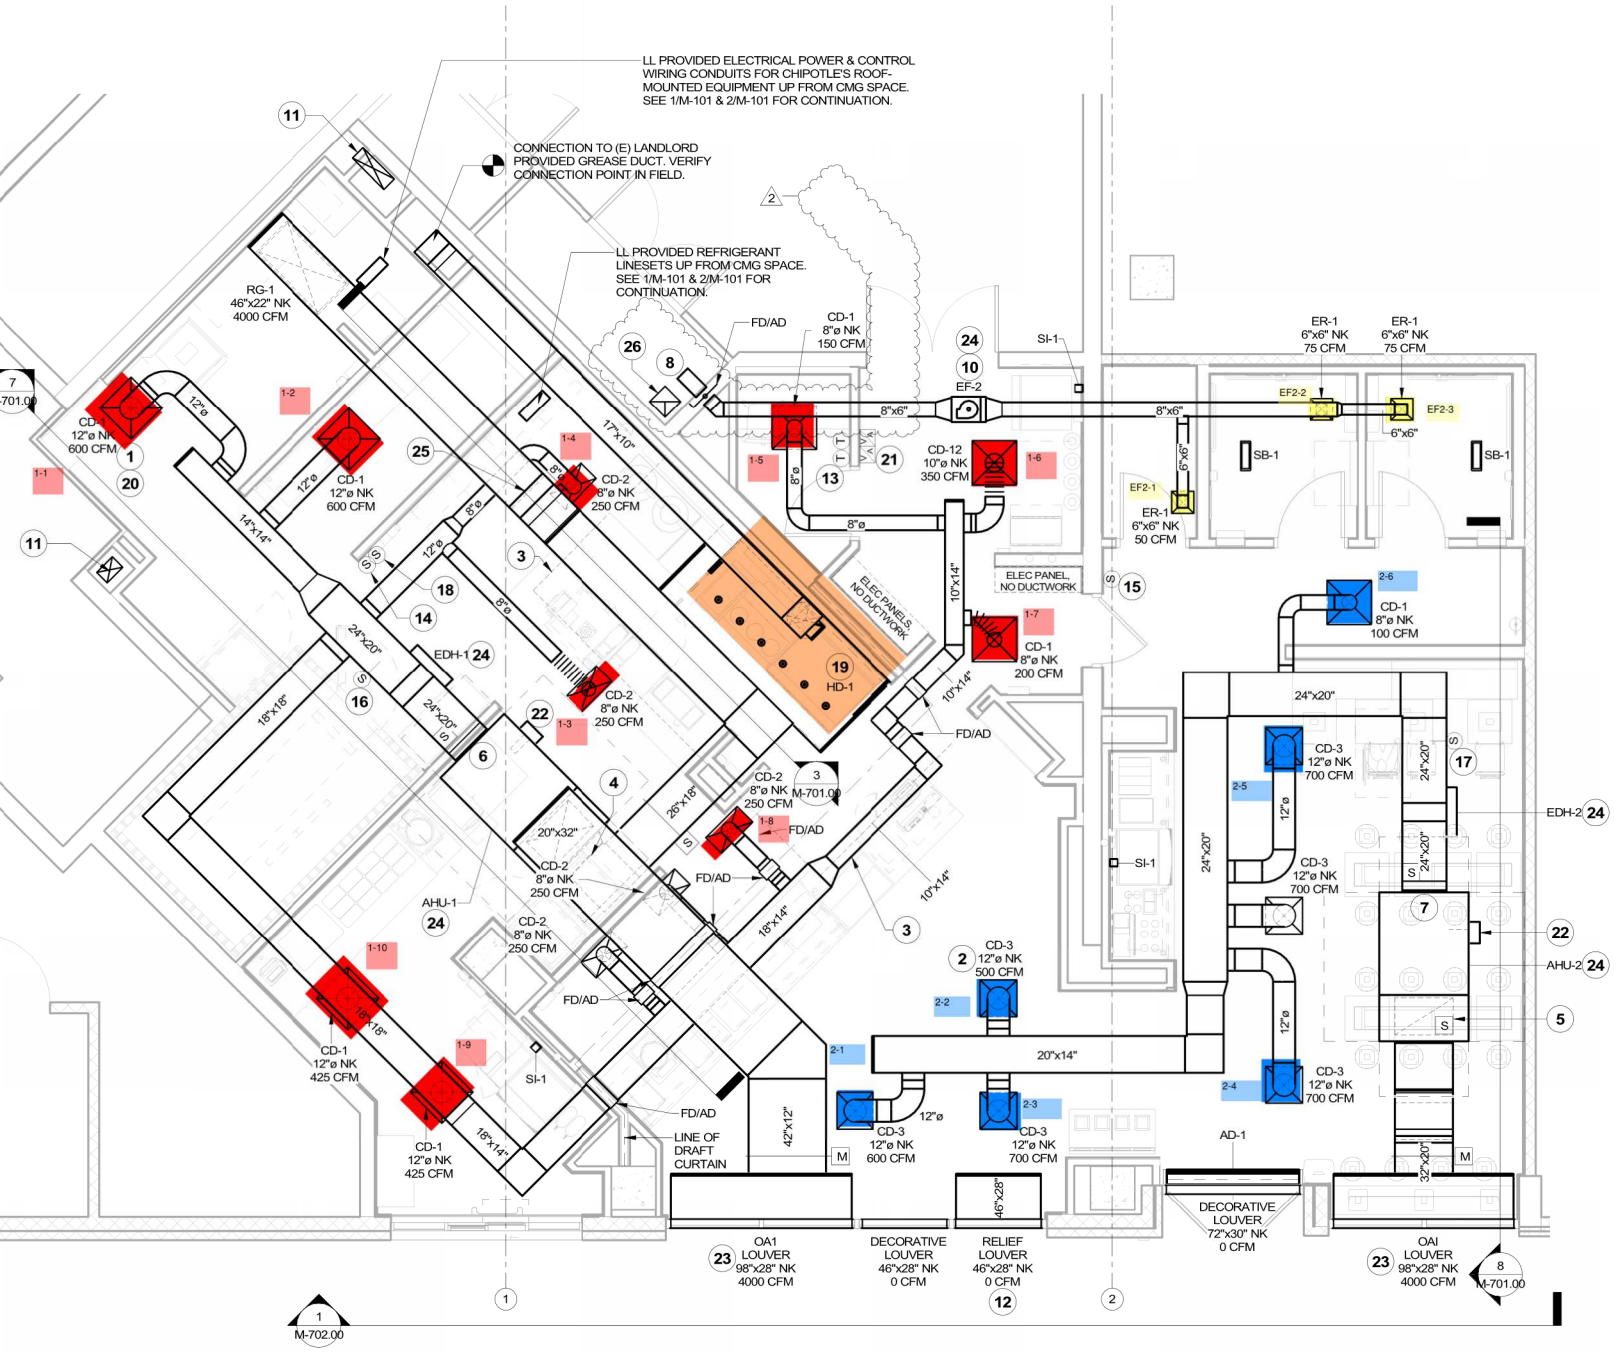
LL PROVIDED ELECTRICAL POWER & CONTROL WIRING CONDUITS FOR CHIPOTLE'S ROOF-MOUNTED EQUIPMENT UP FROM CMG SPACE. SEE 1/M-101 & 2/M-101 FOR CONTINUATION.
CONNECTION TO (E) LANDLORD PROVIDED GREASE DUCT. VERIFY CONNECTION POINT IN FIELD.
LL PROVIDED REFRIGERANT LINESETS UP FROM CMG SPACE. SEE 1/M-101 & 2/M-101 FOR CONTINUATION.
RG-1 46"x22" NK 4000 CFM
CD-1 12"ø NK 600 CFM
CD-1 12"ø NK 600 CFM
CD-2 8"ø NK 250 CFM
CD-1 8"ø NK 150 CFM
FD/AD
EF-2
CD-12 10"ø NK 350 CFM
SI-1
ER-1 6"x6" NK 75 CFM
ER-1 6"x6" NK 75 CFM
EF2-2
EF2-3
EF2-1
ER-1 6"x6" NK 50 CFM
SB-1
SB-1
ELEC PANEL, NO DUCTWORK
ELEC PANELS NO DUCTWORK
HD-1
CD-1 8"ø NK 200 CFM
CD-1 8"ø NK 100 CFM
CD-2 8"ø NK 250 CFM
CD-2 8"ø NK 250 CFM
CD-2 8"ø NK 250 CFM
CD-2 8"ø NK 250 CFM
EDH-1
AHU-1
CD-1 12"ø NK 425 CFM
CD-1 12"ø NK 425 CFM
LINE OF DRAFT CURTAIN
CD-3 12"ø NK 500 CFM
CD-3 12"ø NK 600 CFM
CD-3 12"ø NK 700 CFM
CD-3 12"ø NK 700 CFM
CD-3 12"ø NK 700 CFM
CD-3 12"ø NK 700 CFM
EDH-2
AHU-2
AD-1
DECORATIVE LOUVER 72"x30" NK 0 CFM
OA1 LOUVER 98"x28" NK 4000 CFM
DECORATIVE LOUVER 46"x28" NK 0 CFM
RELIEF LOUVER 46"x28" NK 0 CFM
OAI LOUVER 98"x28" NK 4000 CFM
M-701.00
M-702.00

PLAN