MORE THAN REQUIRED. TOTAL OUTSIDE AIR FOR BOTH ZONES IS EXCEEDED.

(16) PROVIDE INDEPENDENT ON/OFF SWITCH FO
BASIN.
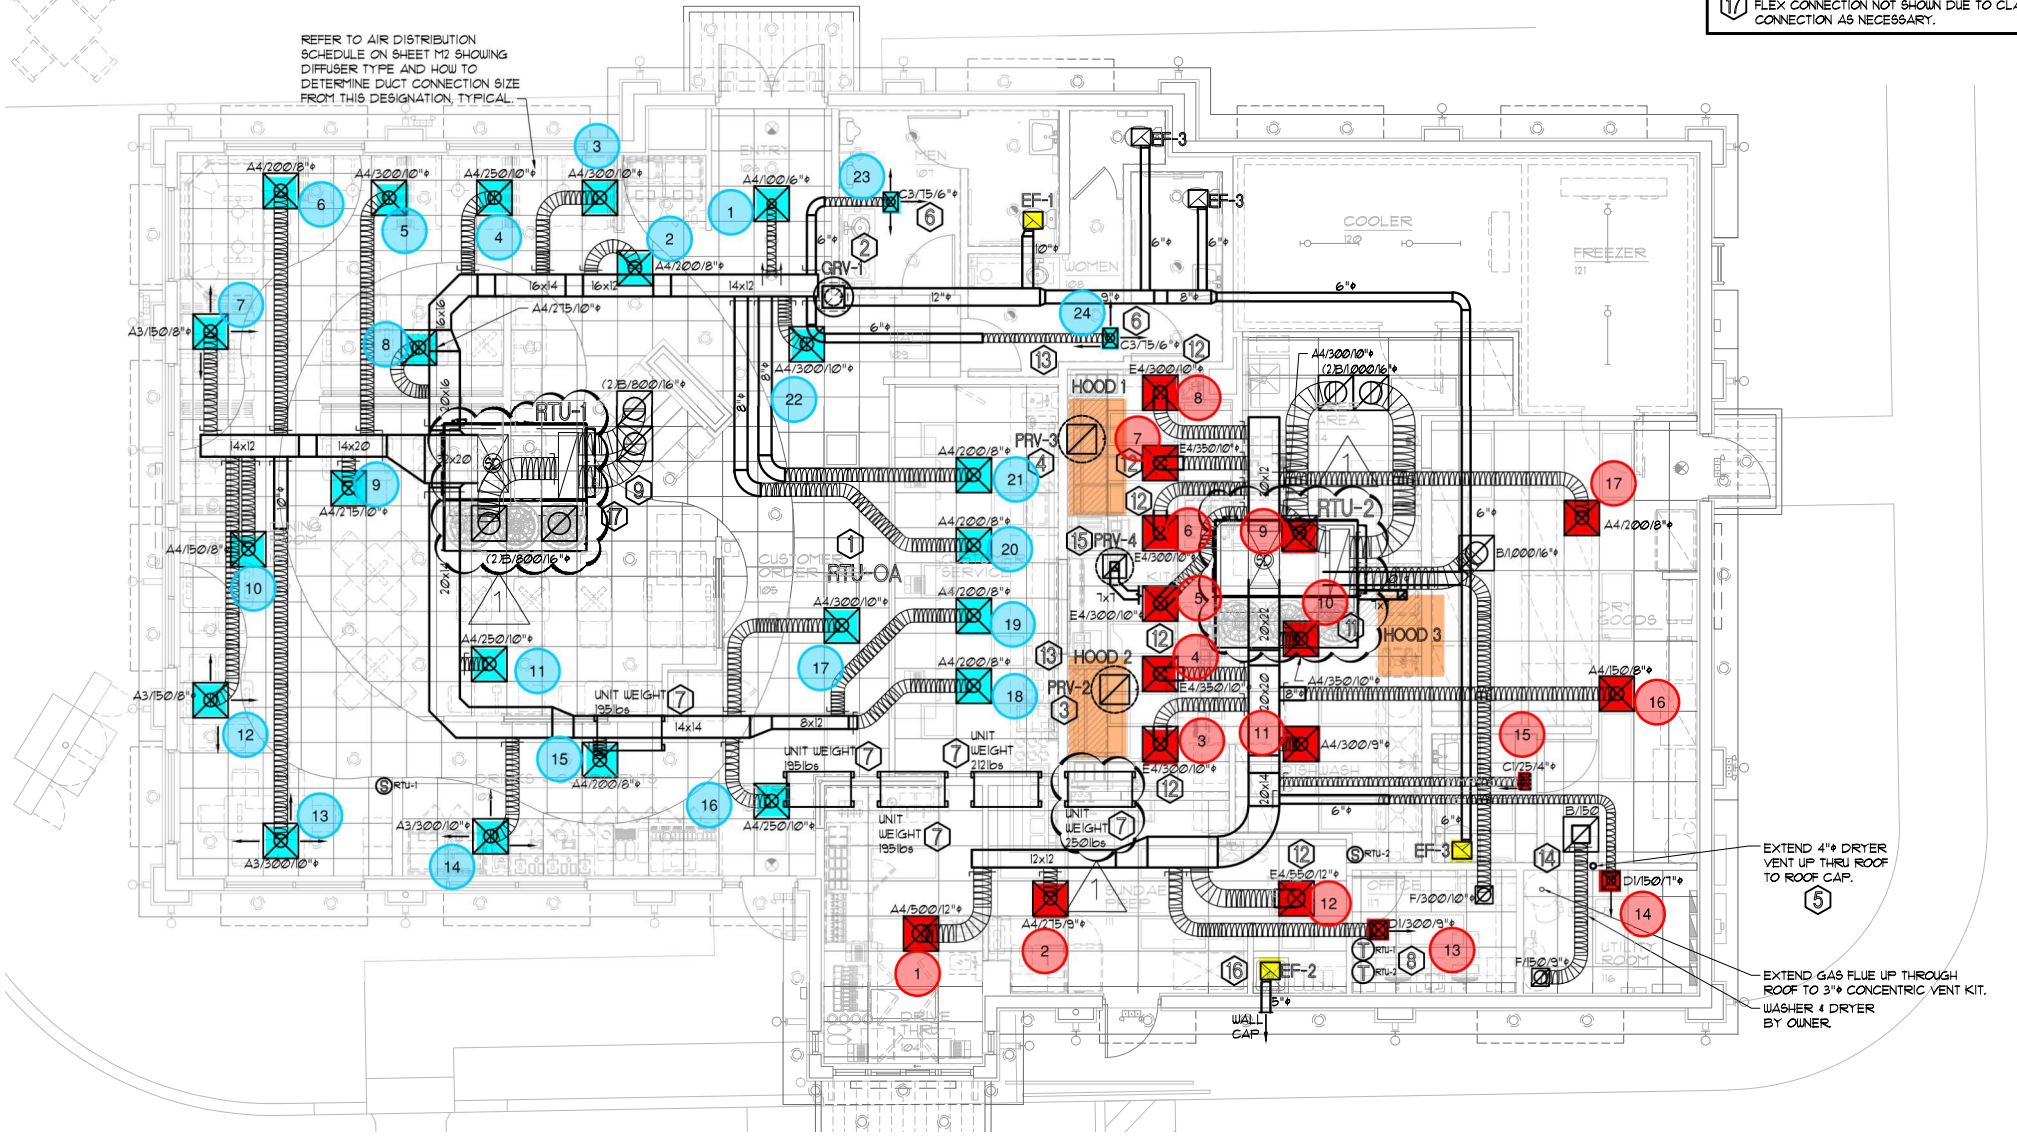
(17) FLEX CONNECTION NOT SHOWN DUE TO CLA
CONNECTION AS NECESSARY.