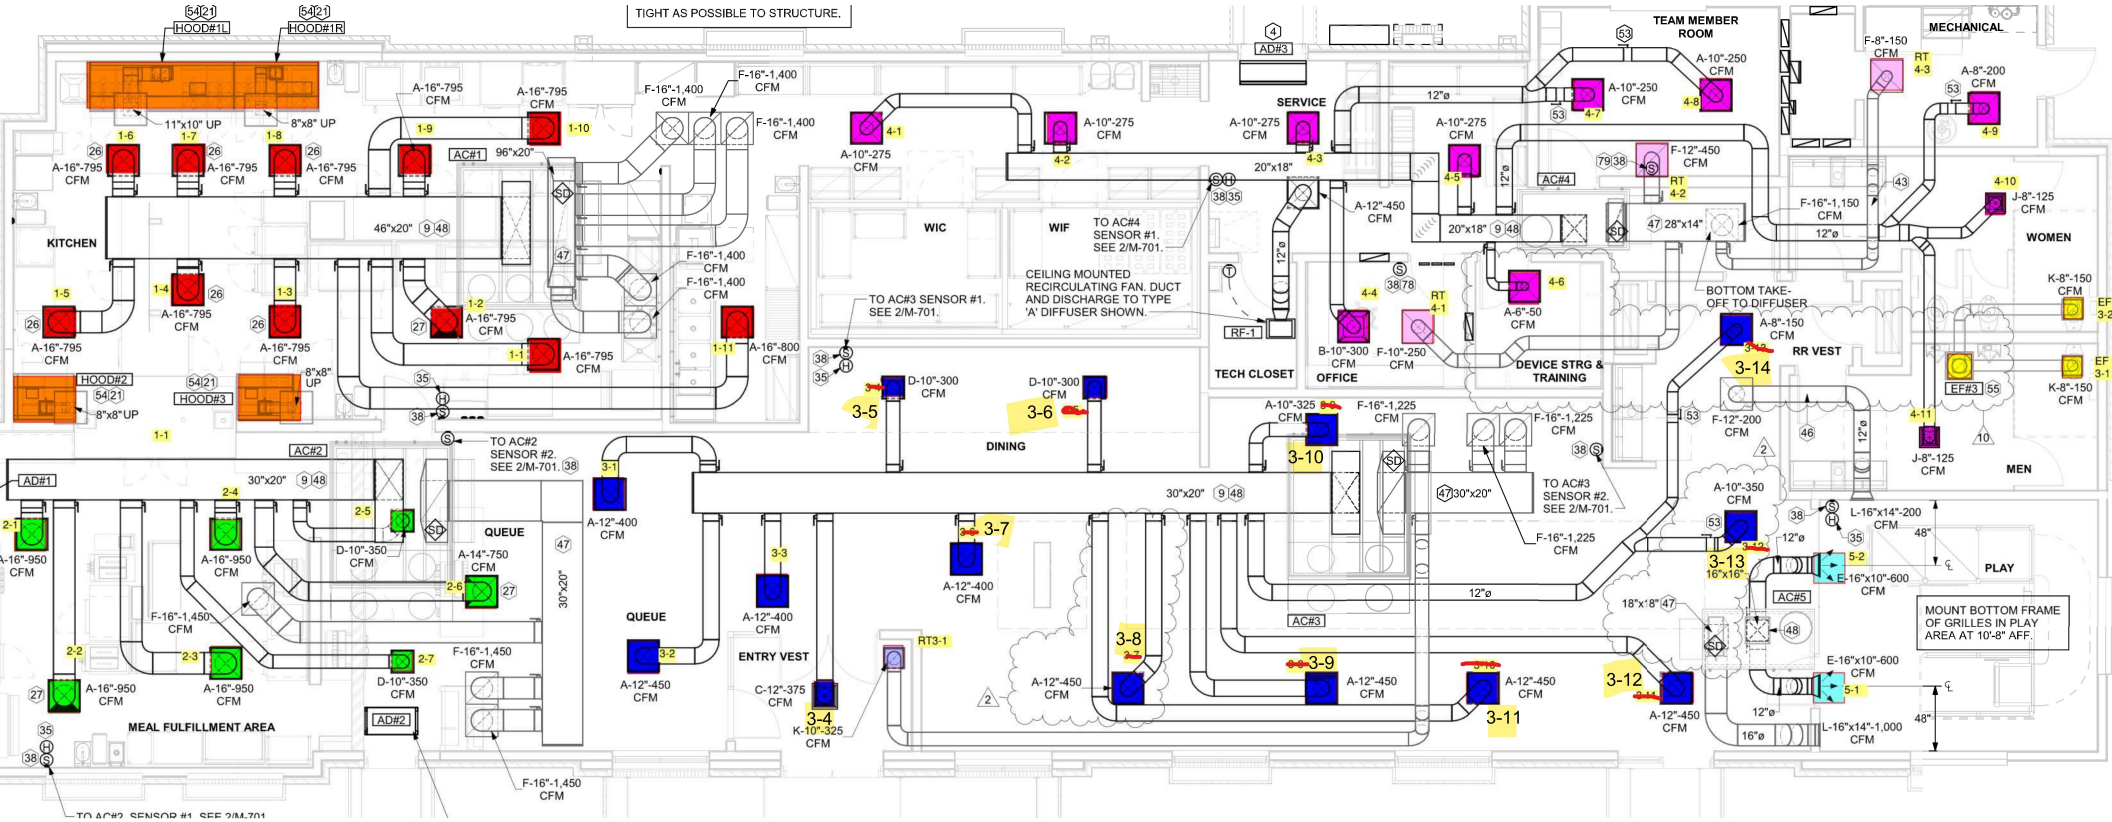
TIGHT AS POSSIBLE TO STRUCTURE.
HOOD#1L
HOOD#1R
HOOD#2
HOOD#3
11"x10" UP
8"x8" UP
KITCHEN
AC#1
AC#2
AC#3
AC#4
AC#5
AD#1
AD#2
AD#3
WIC
WIF
SERVICE
TECH CLOSET
OFFICE
DEVICE STRG & TRAINING
TEAM MEMBER ROOM
MECHANICAL
WOMEN
MEN
RR VEST
PLAY
DINING
QUEUE
ENTRY VEST
MEAL FULFILLMENT AREA
TO AC#4 SENSOR #1. SEE 2/M-701.
CEILING MOUNTED RECIRCULATING FAN. DUCT AND DISCHARGE TO TYPE 'A' DIFFUSER SHOWN.
TO AC#3 SENSOR #1. SEE 2/M-701.
TO AC#2 SENSOR #2. SEE 2/M-701.
TO AC#3 SENSOR #2. SEE 2/M-701.
BOTTOM TAKE-OFF TO DIFFUSER
MOUNT BOTTOM FRAME OF GRILLES IN PLAY AREA AT 10'-8" AFF.
3-4
3-5
3-6
3-7
3-8
3-9
3-10
3-11
3-12
3-13
3-14