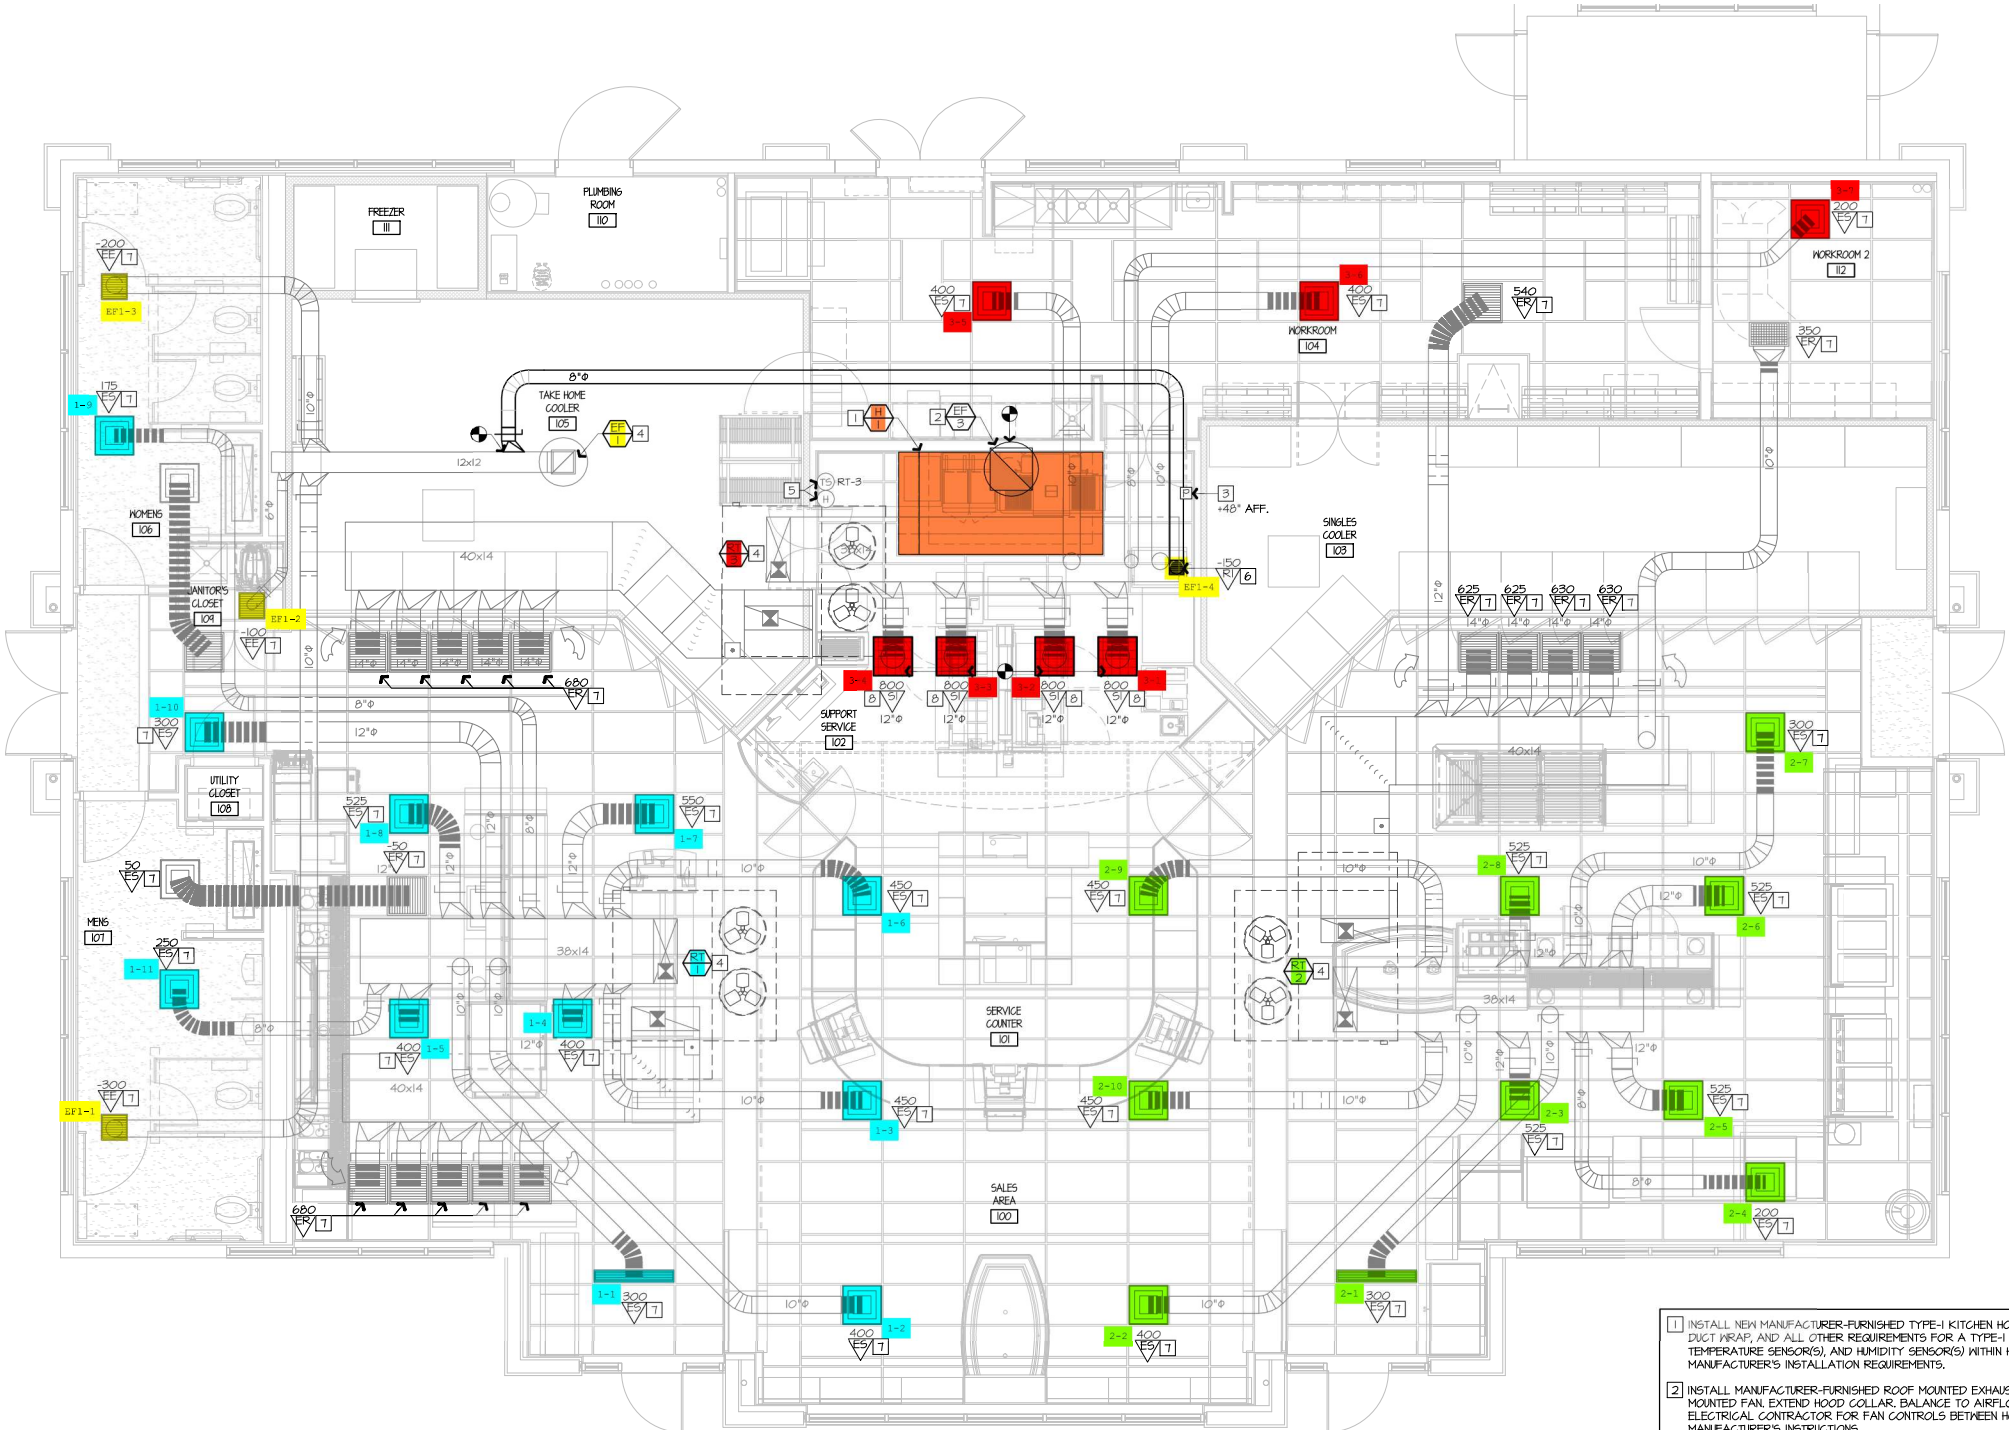

1 INSTALL NEW MANUFACTURER-FURNISHED TYPE-I KITCHEN HO
DUCT WRAP, AND ALL OTHER REQUIREMENTS FOR A TYPE-I
TEMPERATURE SENSOR(S), AND HUMIDITY SENSOR(S) WITHIN
MANUFACTURER'S INSTALLATION REQUIREMENTS.

2 INSTALL MANUFACTURER-FURNISHED ROOF MOUNTED EXHAUS
MOUNTED FAN. EXTEND HOOD COLLAR. BALANCE TO AIRFLO
ELECTRICAL CONTRACTOR FOR FAN CONTROLS BETWEEN H
MANUFACTURER'S INSTRUCTIONS