


NORTH RR

OPERATIONS RM

ROUGH-IN. ENSURE ALL CLEARANCE REQUIREMENTS FOR THE UNIT ARE MAINTAINED THROUGH CONSTRUCTION. KITCHEN EQUIPMENT SUPPLIER SHALL PROVIDE LINESET, SPECIALTIES AND MAKE ALL FINAL CONNECTIONS BETWEEN THE CONDENSING UNIT AND EVAPORATOR COIL
11 ROUTE DUCTWORK TIGHT UNDER STRUCTURE.

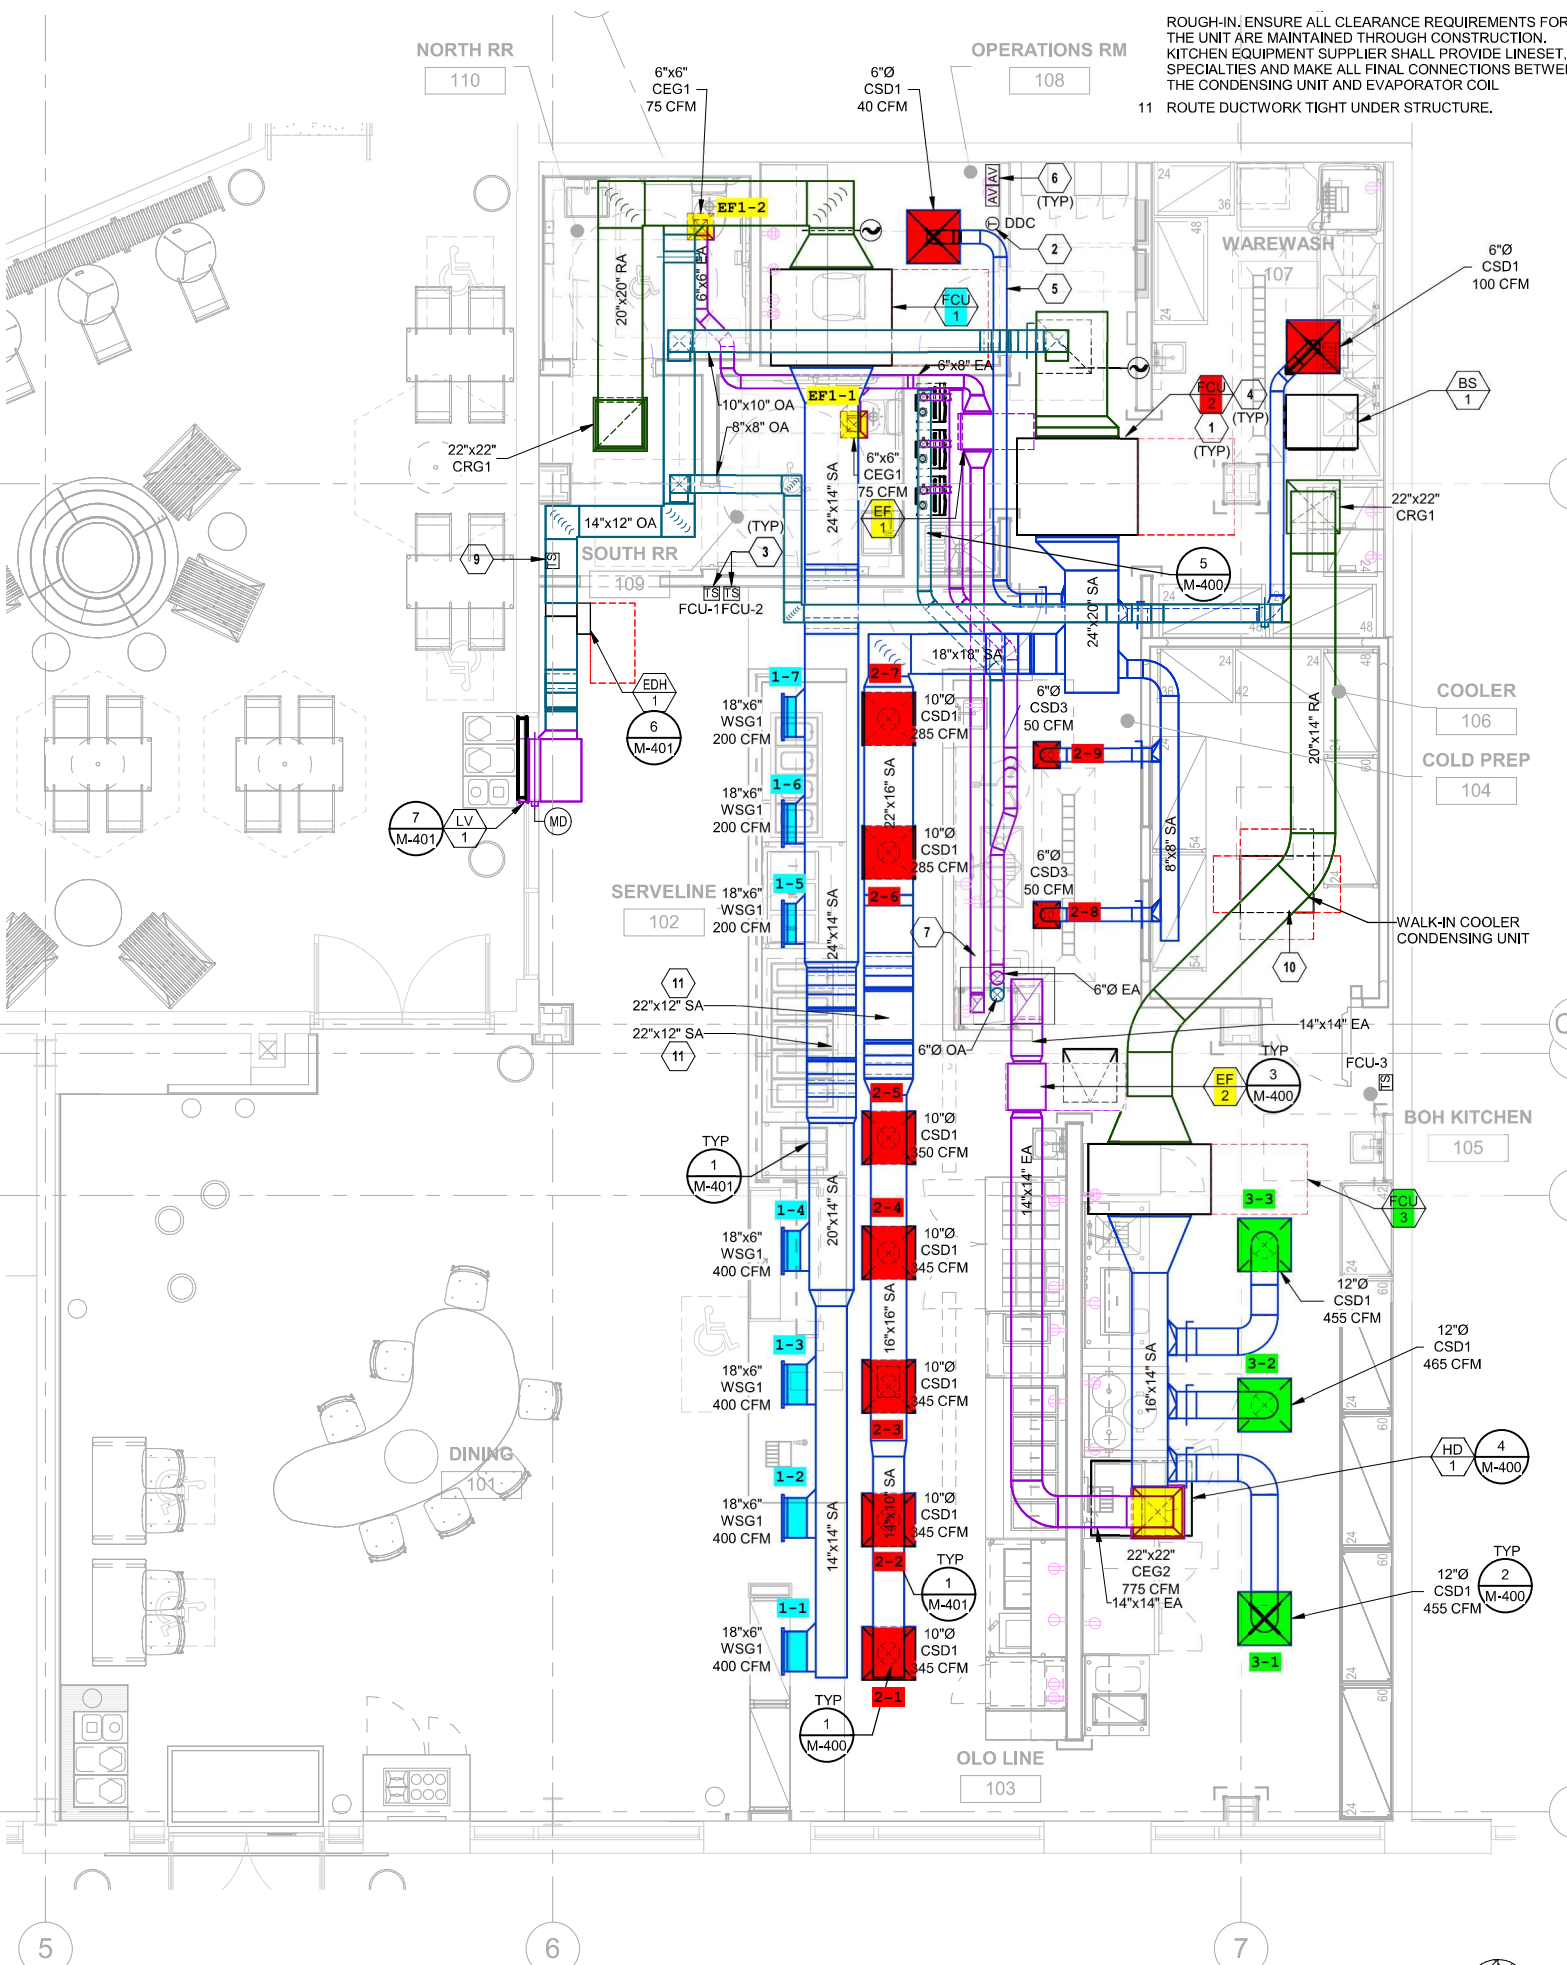

1 HVAC FLOOR PLAN
1/4" = 1'-0"

