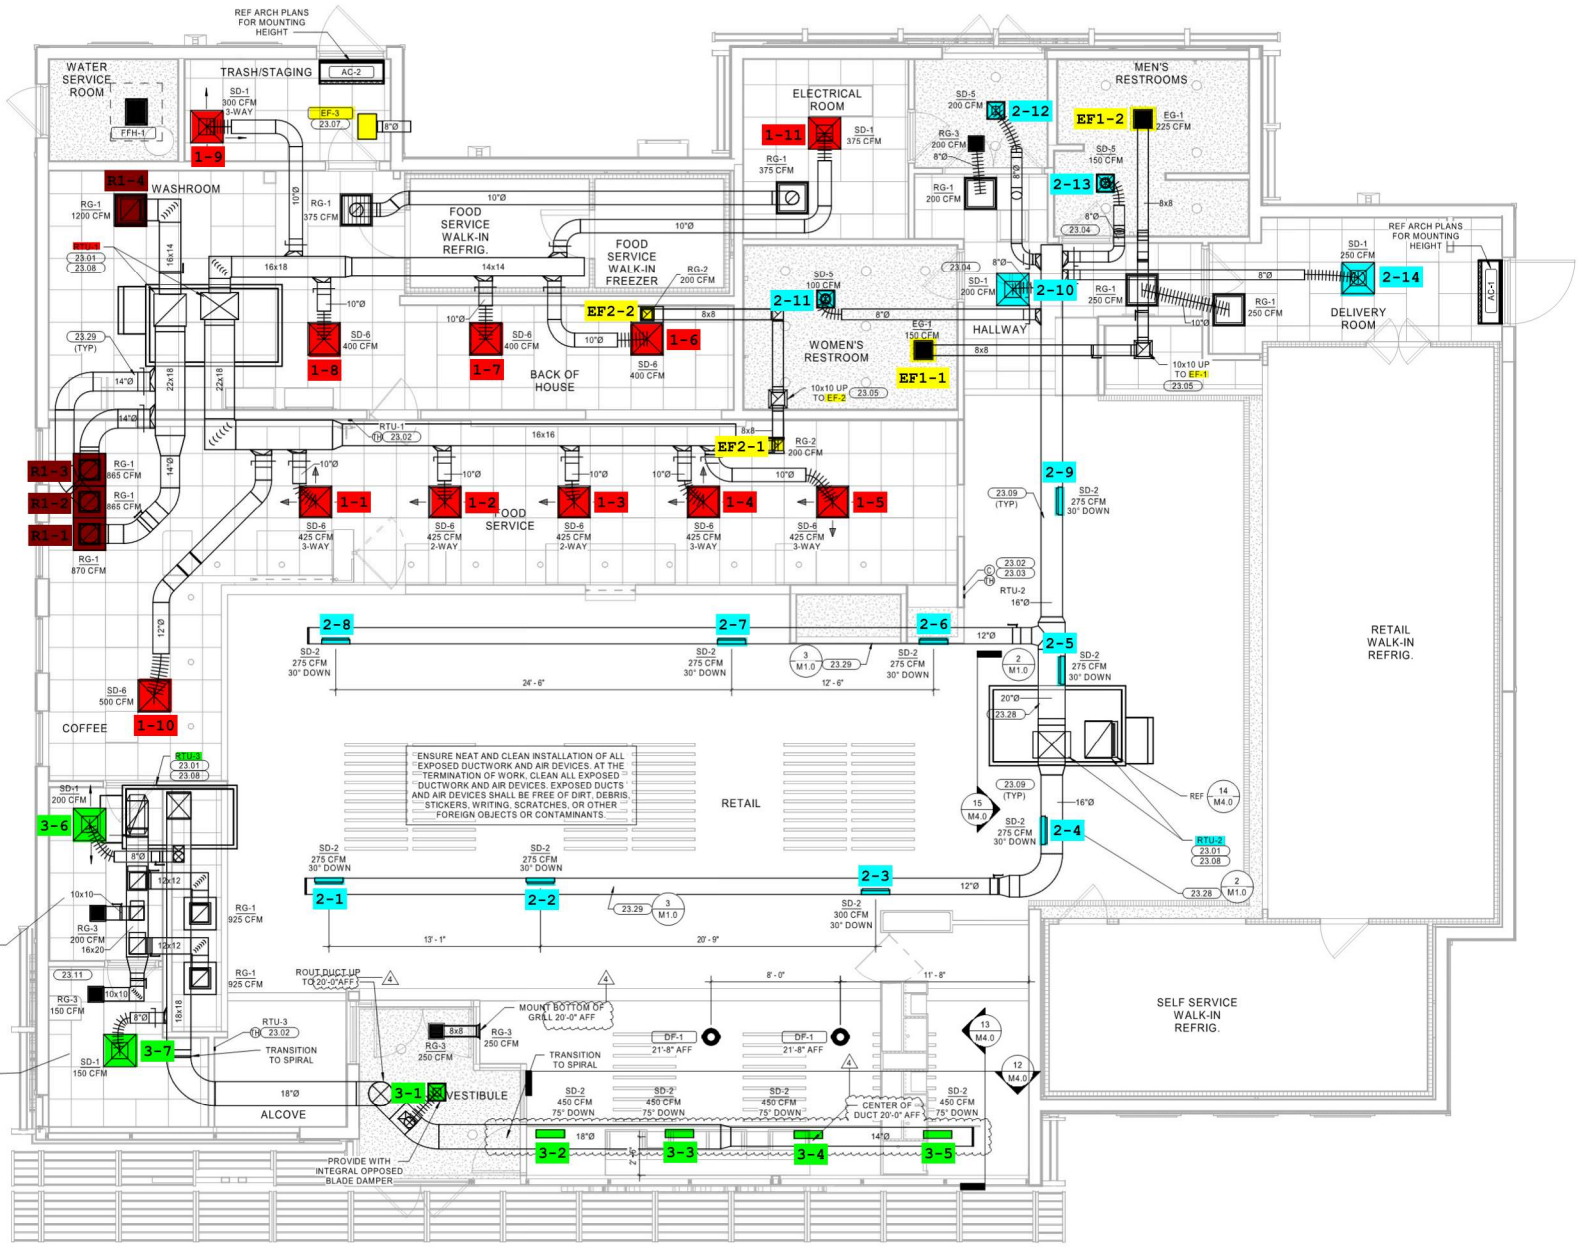
REF ARCH PLANS FOR MOUNTING HEIGHT
WATER SERVICE ROOM
FFH-1
TRASH/STAGING
AC-2
SD-1 300 CFM 3-WAY
EF-3 23.07
1-9
R1-4
WASHROOM
RG-1 1200 CFM
RTU-4 23.01 23.08
23.29 (TYP)
FOOD SERVICE WALK-IN REFRIG.
FOOD SERVICE WALK-IN FREEZER
RG-2 200 CFM
EF2-2
1-6
1-7
1-8
SD-6 400 CFM
BACK OF HOUSE
ELECTRICAL ROOM
1-11
SD-1 375 CFM
RG-1 375 CFM
MEN'S RESTROOMS
EF1-2
EG-1 225 CFM
SD-5 200 CFM
2-12
RG-3 200 CFM
SD-5 150 CFM
2-13
RG-1 200 CFM
2-11
SD-5 100 CFM
WOMEN'S RESTROOM
EG-1 150 CFM
EF1-1
10x10 UP TO EF-2
HALLWAY
SD-1 200 CFM
2-10
RG-1 250 CFM
10x10 UP TO EF-1
23.05
DELIVERY ROOM
SD-1 250 CFM
2-14
AC-1
EF2-1
RG-2 200 CFM
RTU-1 23.02
R1-3
R1-2
R1-1
RG-1 865 CFM
RG-1 870 CFM
1-1
1-2
1-3
1-4
1-5
SD-6 425 CFM 3-WAY
SD-6 425 CFM 2-WAY
FOOD SERVICE
2-9
23.09 (TYP)
SD-2 275 CFM 30" DOWN
23.02 23.03
RTU-2 16"Ø
2-8
2-7
2-6
2-5
2-4
2-3
2-1
2-2
24' - 6"
12' - 6"
13' - 1"
20' - 9"
SD-6 500 CFM
COFFEE
1-10
ENSURE NEAT AND CLEAN INSTALLATION OF ALL EXPOSED DUCTWORK AND AIR DEVICES. AT THE TERMINATION OF WORK, CLEAN ALL EXPOSED DUCTWORK AND AIR DEVICES. EXPOSED DUCTS AND AIR DEVICES SHALL BE FREE OF DIRT, DEBRIS, STICKERS, WRITING, SCRATCHES, OR OTHER FOREIGN OBJECTS OR CONTAMINANTS.
RETAIL
RETAIL WALK-IN REFRIG.
SELF SERVICE WALK-IN REFRIG.
3-6
RG-1 925 CFM
RG-3 200 CFM 16x20
RG-3 150 CFM
SD-1 150 CFM
3-7
RTU-3 23.02
TRANSITION TO SPIRAL
ROUT DUCT UP TO 20'-0" AFF
MOUNT BOTTOM OF GRILL 20'-0" AFF
RG-3 250 CFM
DF-1 21'-8" AFF
3-1
VESTIBULE
ALCOVE
SD-2 450 CFM 75° DOWN
CENTER OF DUCT 20'-0" AFF
3-2
3-3
3-4
3-5
PROVIDE WITH INTEGRAL OPPOSED BLADE DAMPER