


SEAL PENETRATIONS IN DRAFTSTOPPING CURTAIN AIR-TIGHT. REFER TO ARCH DRAWINGS FOR LOCATION AND CONSTRUCTION OF DRAFTSTOPPING CURTAIN.

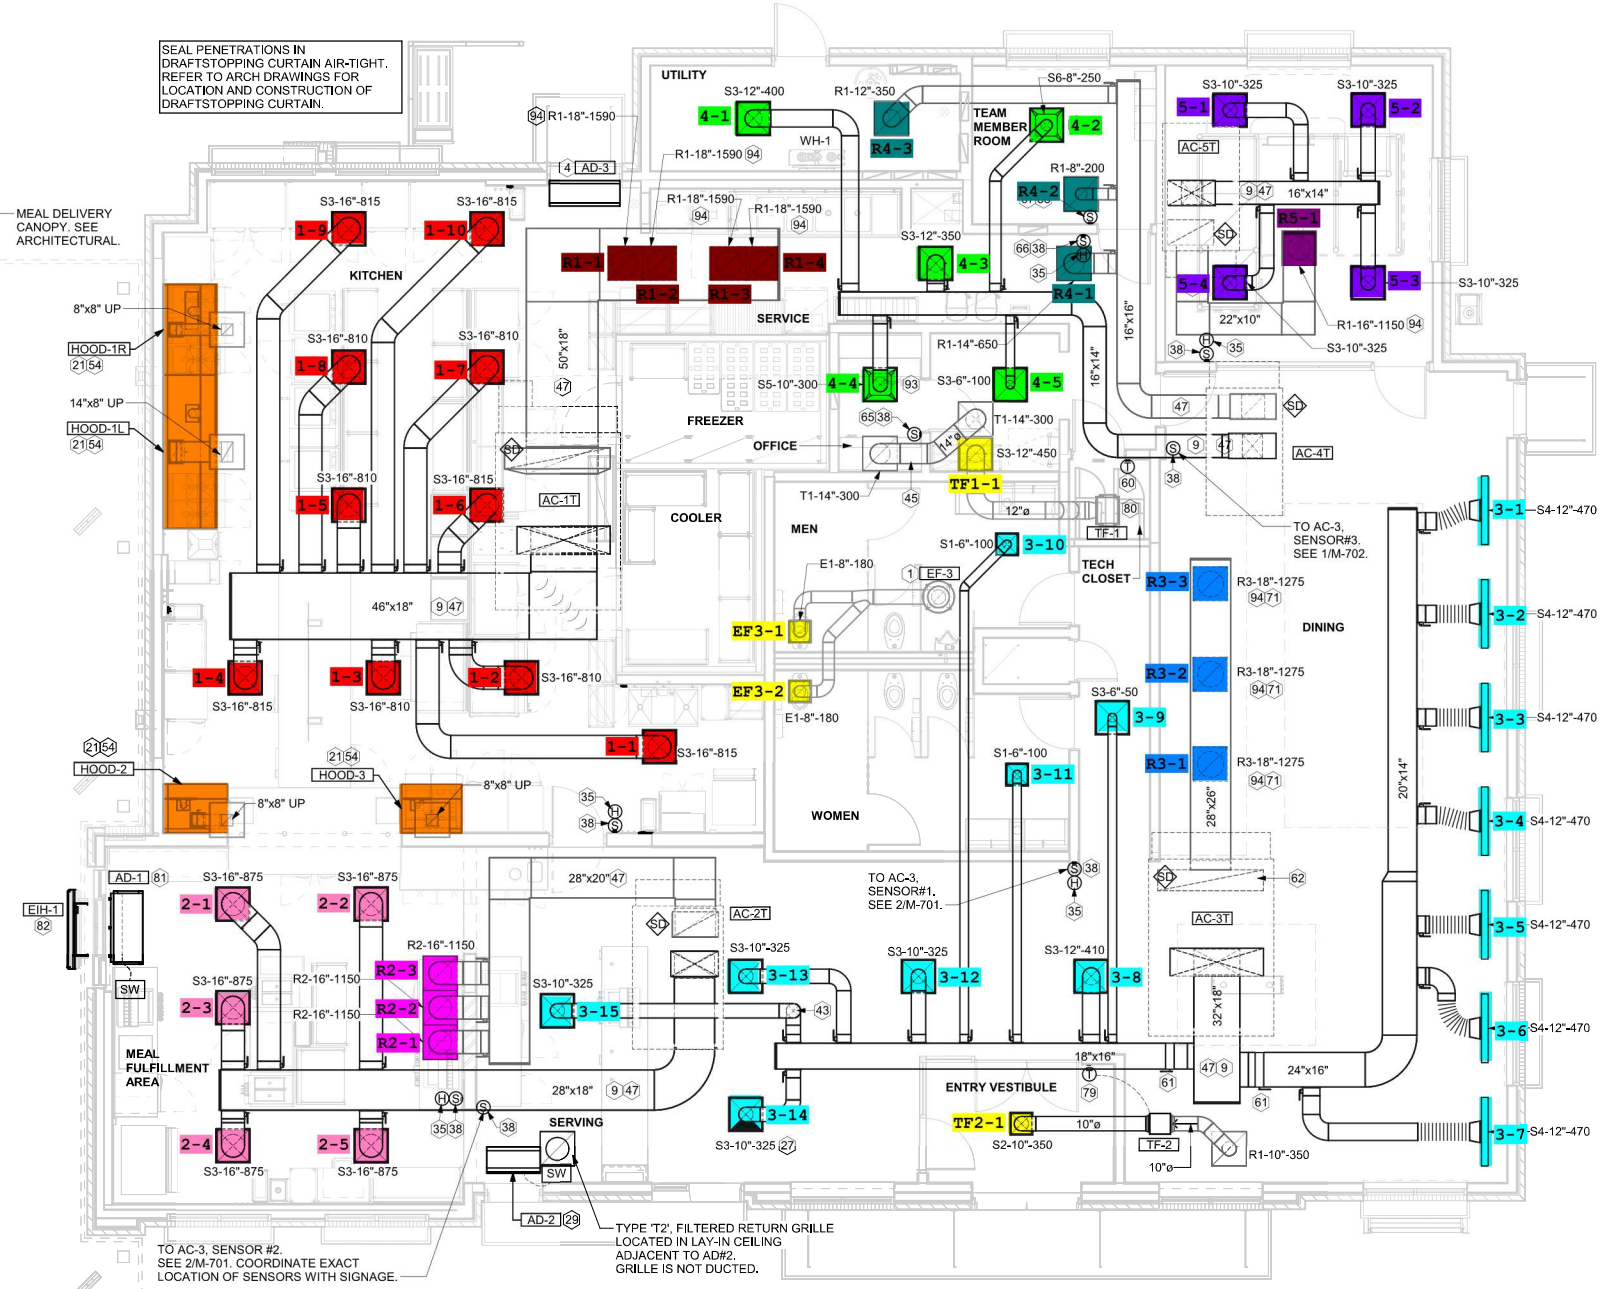

TO AC-3, SENSOR #2. SEE 2/M-701. COORDINATE EXACT LOCATION OF SENSORS WITH SIGNAGE.

TYPE T2: FILTERED RETURN GRILLE LOCATED IN LAY-IN CEILING ADJACENT TO AD#2. GRILLE IS NOT DUCTED.

1 EQUIPMENT AND DUCTWORK PLAN
1/4" = 1'-0"