ERANT LINE SET AND SEAL
LINE SET IS INSTALLED.

THE ARCHITECTURAL AND
EXPANSION VALVE, SOLENOID
CONTROL, LOW AMBIENT
NT LINES PER
OUGH ROOF. INSTALLATION
NT LINE SET UNDER THE ROOF
TO ICE MAKER IS EXPOSED TO
THE ARCHITECTURAL

RUCTIONS AND AS DETAILED IN

RCHITECTURAL AND
D BY CHIPOTLE ON EXHAUST

1/M700. TYPICAL.
EMOTE KEY OPERATED RESET.
CAL.
/M700. SEE ELECTRICAL
STICKERS ON FACE OF
CH THE REME HALO WOULD
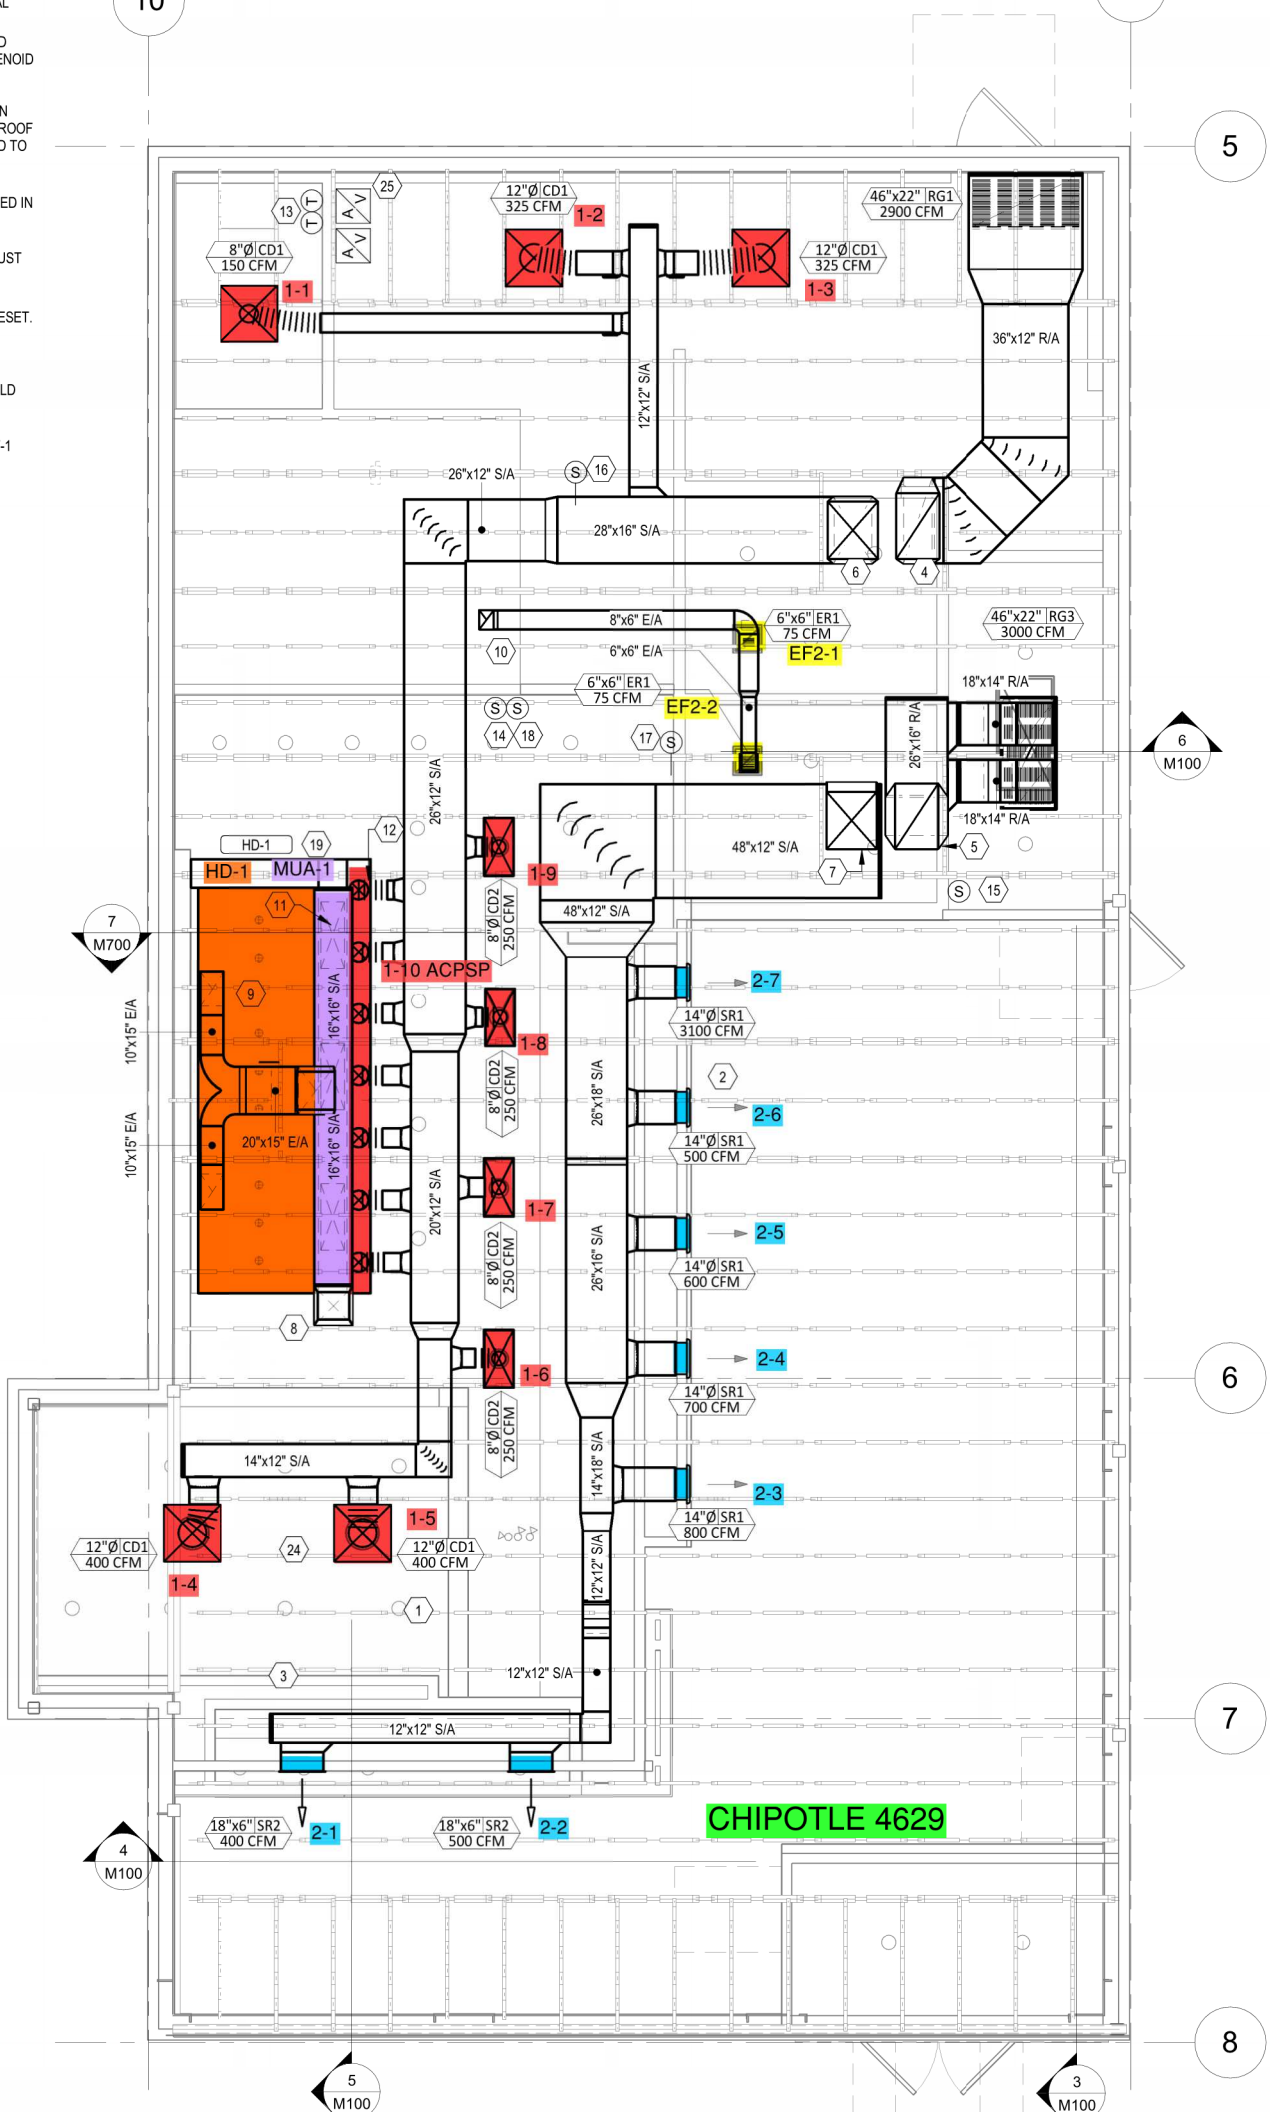
ND OUTSIDE AIR INTAKES.
AKE AND EXHAUST FAN EF-1
R HEATER FLUE AND