



HATCHED AREA DENOTES PRODUCTION SUITE BY OTHERS (UNLESS NOTED OTHERWISE) - SEE SEPARATE PERMIT

1 HVAC LEVEL 3  
SCALE: 1/8" = 1'-0"

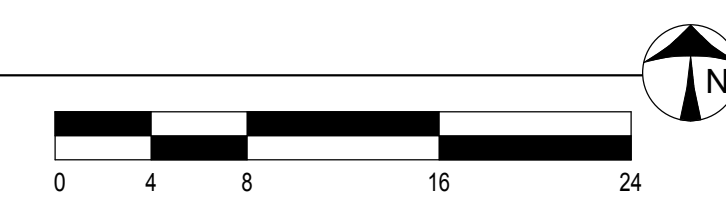

2 TYPICAL TRANSFER AIR DUCT  
SCALE: 1/4" = 1'-0"

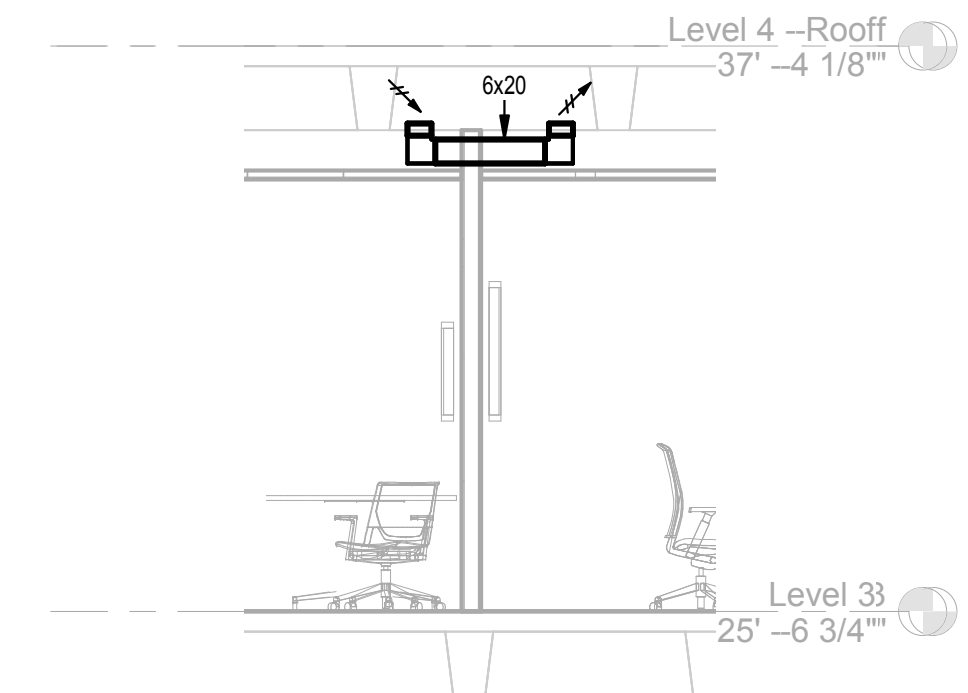

**GENERAL NOTES**

A. HATCHED DUCTWORK SHALL BE DOUBLE WALL INSULATED. REFER TO DUCT CONSTRUCTION SCHEDULE.

**NOTES**

1. PROVIDE NEW RETURN AIR OPENING IN LOCATION SHOWN. REFER TO DETAIL ON SHEET H002.
2. PROVIDE CABLE-ACTUATED REMOTE BALANCING DAMPER IN SUPPLY REGISTER RUNOUT DUCT. REMOTE BALANCING DAMPER SHALL BE YOUNG REGULATOR 830ACC OR APPROVED EQUAL.
3. TRANSITION DUCT WITHIN SHAFT AS REQUIRED FOR CONNECTION TO NEW AIR DEVICE.
4. AIR DEVICE LOCATED IN FACE OF NEW SOFFIT. COORDINATE EXACT LOCATION WITH ARCHITECTURAL DRAWINGS.
5. PROVIDE NEW MANUAL BALANCING DAMPER IN EXISTING RETURN AIR DUCT.



10 S Patterson Blvd  
Dayton, OH 45402  
T 937.224.4474  
thinkchamplin.com  
THINK CREATE REALIZE



1400 W Dorothy Lane, Dayton, OH 45409  
T 937.224.0861  
2202 S Patterson Blvd, Dayton OH 45409  
T 937.298.4631

FAC 23-04  
eLEARNING, CTL,  
INNOVATIONS LAB,  
PRODUCTION STUDIO




444 W 3rd St,  
Dayton, OH 45402  
Building 4  
SCC PROJECT #: FAC 23-04

**ISSUANCES**

No.	Description	Date
1	60% CD SET	01/16/2023
2	75% CD SET	01/30/2023
3	90% CD SET	02/13/2023
4	98% CD SET	03/20/2023
5	CONSTRUCTION DOCS	04/07/2023

Drawn By  
Author  
Checked By  
Checker  
Client No.  
659  
Project No.  
8064

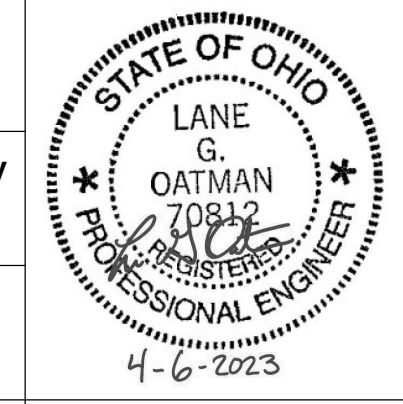

THIRD FLOOR NEW WORK

H101