

**Report By:**

National TAB  
1329 E. KEMPER ROAD  
SUITE 4210  
CINCINNATI, OH 45246



**Report: Issue Data**  
**Function: Test, Adjust, & Balance**  
**Date: 12/04/2025**  
**Completed By: National TAB**

**PROJECT**  
**CW 8950 - Mr Cooper (Coppell, TX)**

8950 Cypress Waters Blvd.

Coppell, TX 75019

**Client**

Pacific Builders  
7950 Legacy Dr.  
Suite 150  
Plano, TX 75024

# National TAB

Project: CW 8950 - Mr Cooper (Coppell, TX)

## Table Of Contents

Section	Page #
Issue Data	3

## Issue List

- FPB-E3.20 Control Issue
- FPB-E3.21 Control Issue
- FPBE3.1 Showing "NR" on Controls
- FPBE3.14 FAN NOT OPERATIONAL
- FPBE3.2 Showing "NR" on Controls
- FPBE3.23 Showing "NR" on Controls
- FPBE3.4 Showing "NR" on Controls
- FPBE3.5 Thermostat not Mounted
- FPBE3.6 Showing "NR" on Controls




## CW 8950 - Mr Cooper (Coppell, TX)

### Project Issue Information

**Issue Name :** FPB-E3.20 Control Issue  
**Description :** FPB-E3.20(FPB3-46 on controls graphics) does not pull up the right box when opened on control graphics. Box is labeled as FPB3-46 on control graphics, however it opens box FPB3-47. The only way to access the correct box is to go through the RTU matrix page.  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** InfoOnly                                      **Asset Tag :**  
**Originated Date :** 12/02/2025 - Bayley Morvant - National TAB

#### Project Issue File Details

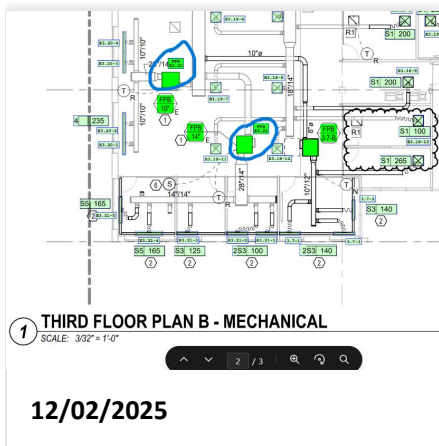



## CW 8950 - Mr Cooper (Coppell, TX)

### Project Issue Information

**Issue Name :** FPB-E3.21 Control Issue  
**Description :** FPB-E3.21(FPB3-45 on controls graphics) does not pull up the right box when opened on control graphics. Box is labeled as FPB3-45 on control graphics, however it opens box FPB2-18. The only way to access the correct box is to go through the RTU matrix page.


**Created By :** National TAB      **Assigned To :** National TAB - Stephan Gabbert

**Status :** Open

**Priority :** InfoOnly      **Asset Tag :**

**Originated Date :** 12/02/2025 - Bayley Morvant - National TAB

#### Project Issue File Details

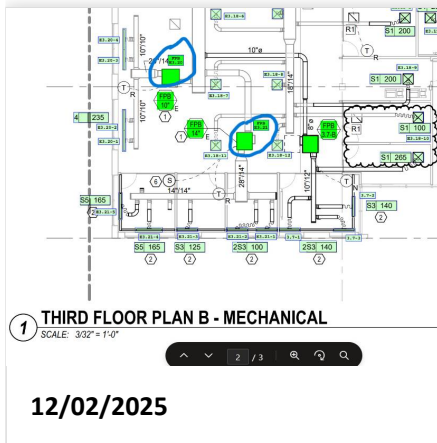




**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.1 Showing "NR" on Controls  
**Description :** FPBE3.1 is showing "NR" on controls. Unit is not operational. (Box labeled as FPB3-32 on controls)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent                                      **Asset Tag :**  
**Originated Date :** 12/04/2025 - Bayley Morvant - National TAB

Project Issue File Details

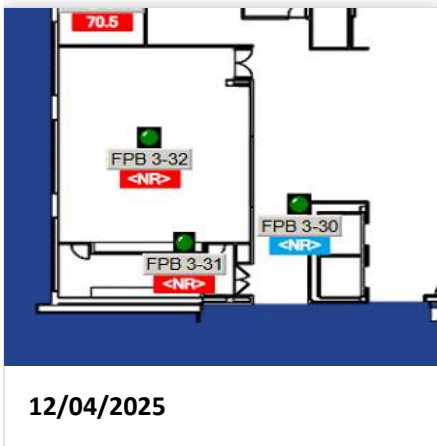




**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.14 FAN NOT OPERATIONAL  
**Description :** EXISTING BOX FPBE3.14 FAN IS NOT OPERATIONAL. UNABLE TO BALANCE FAN TO DESIGN CFM. (BOX IS LABELED AS FPB3-48 ON CONTROLS GRAPHICS)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent                                      **Asset Tag :**  
**Originated Date :** 12/02/2025 - Bayley Morvant - National TAB

**Project Issue File Details**

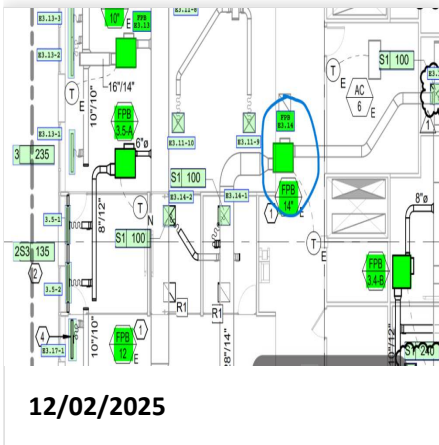




**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.2 Showing "NR" on Controls  
**Description :** FPBE3.2 is showing "NR" on controls. Box is not operational. (Box labeled as FPB3-31 on controls)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent                                      **Asset Tag :**  
**Originated Date :** 12/04/2025 - Bayley Morvant - National TAB

Project Issue File Details

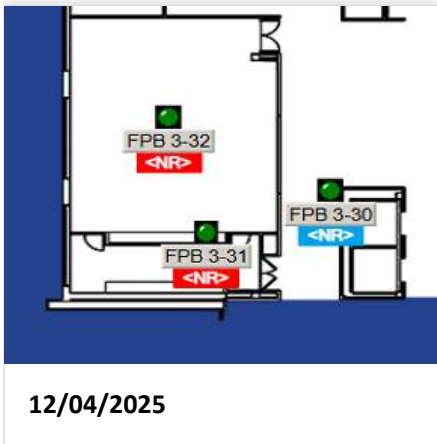




**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.23 Showing "NR" on Controls  
**Description :** FPBE3.23 is showing "NR" on controls. Unable to control box to calibrate and balance. (Controls name for thie box is FPB3-43)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** **Urgent**                                      **Asset Tag :**  
**Originated Date :** 12/03/2025 - Bayley Morvant - National TAB

Project Issue File Details

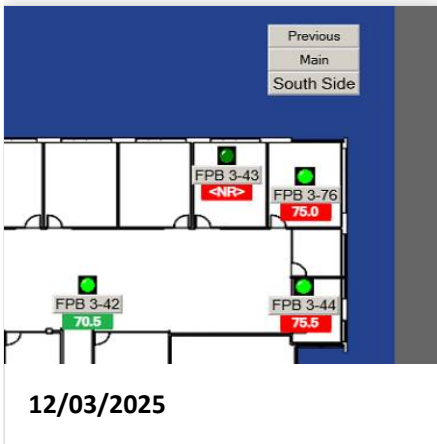




**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.4 Showing "NR" on Controls  
**Description :** FPBE3.4 is showing "NR" on controls and is not operational. (Box labeled as FPB3-34 on controls graphics)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent                                      **Asset Tag :**  
**Originated Date :** 12/04/2025 - Bayley Morvant - National TAB

Project Issue File Details

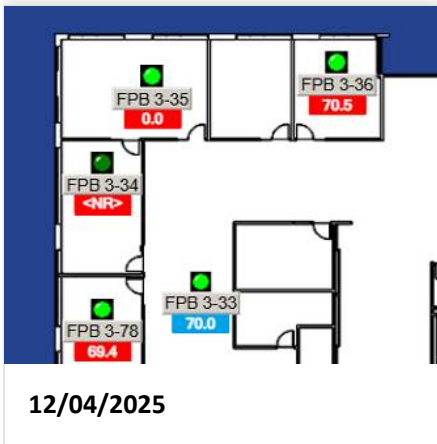




### CW 8950 - Mr Cooper (Coppell, TX)

#### Project Issue Information

**Issue Name :** FPBE3.5 Thermostat not Mounted  
**Description :** FPBE3.5 thermostat not mounted during time of testing. Unit was able to be calibrated and balanced, however, due to the thermostat not being hooked up heat and fan operation were unable to be checked and balanced. Once thermostat is mounted and hooked up heat and fan can be checked and balanced. (Box is labeled as FPB3-35 on controls)  
**Created By :** National TAB **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent **Asset Tag :**  
**Originated Date :** 12/04/2025 - Bayley Morvant - National TAB


#### Project Issue File Details

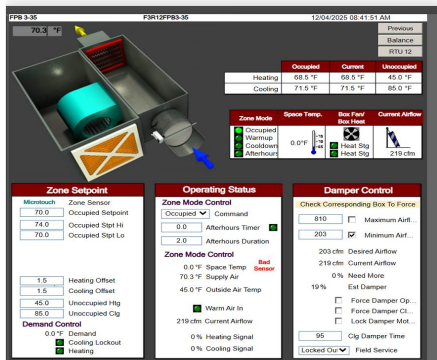

12/04/2025



12/04/2025

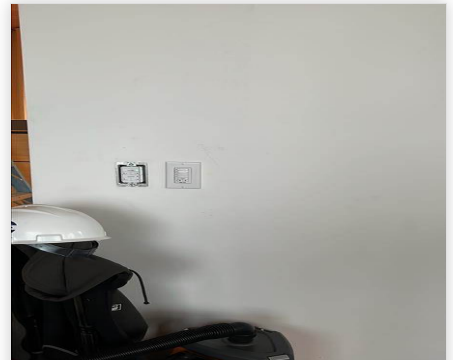

12/04/2025



**CW 8950 - Mr Cooper (Coppell, TX)**

**Project Issue Information**

**Issue Name :** FPBE3.6 Showing "NR" on Controls  
**Description :** FPBE3.6 is showing "NR" on controls. Box is not operational. (Box labeled as FPB3-30 on controls)  
**Created By :** National TAB                      **Assigned To :** National TAB - Stephan Gabbert  
**Status :** Open  
**Priority :** Urgent                                      **Asset Tag :**  
**Originated Date :** 12/04/2025 - Bayley Morvant - National TAB

Project Issue File Details

