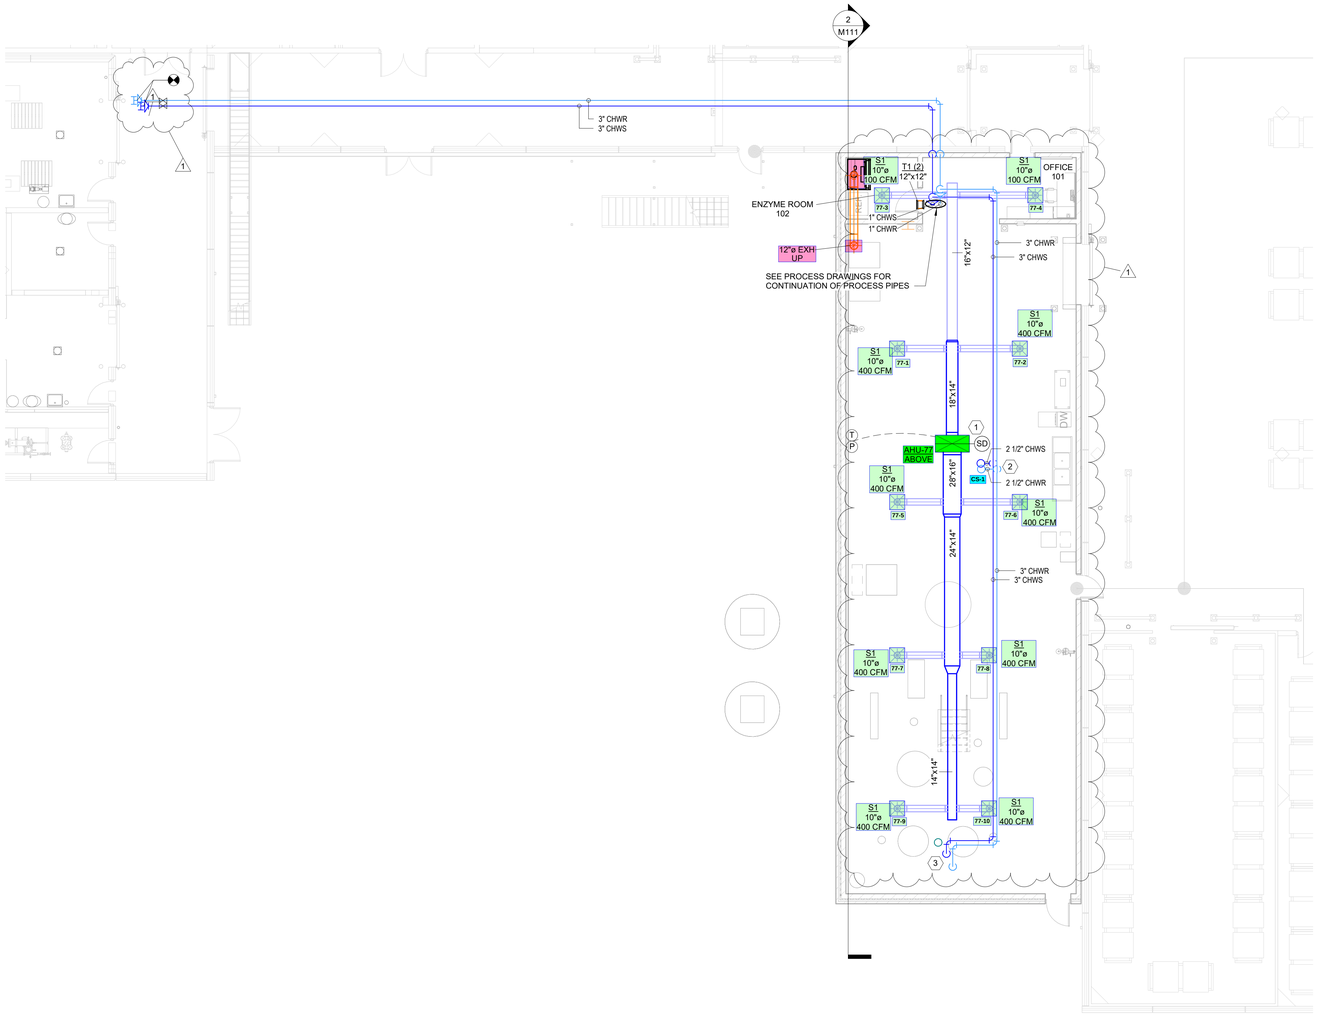

1 Level 1 - HVAC LEVEL 1
1/8" = 1'-0"

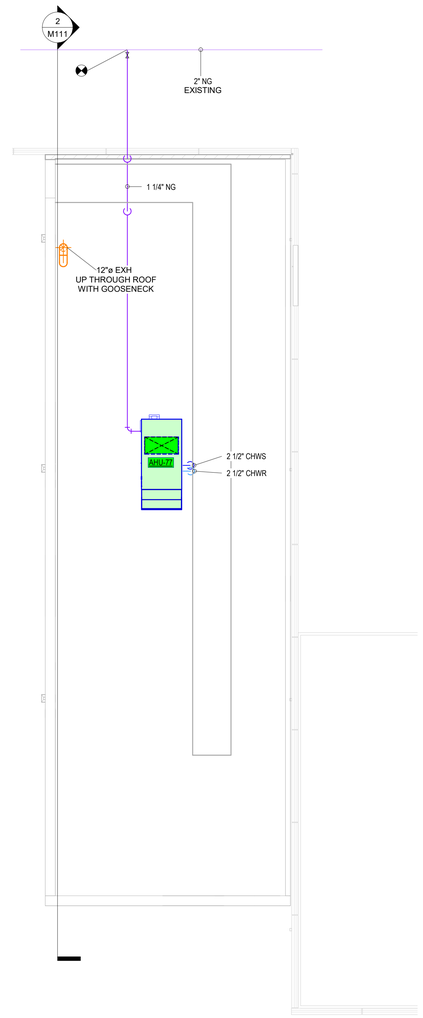

3 Roof - HVAC
1/8" = 1'-0"

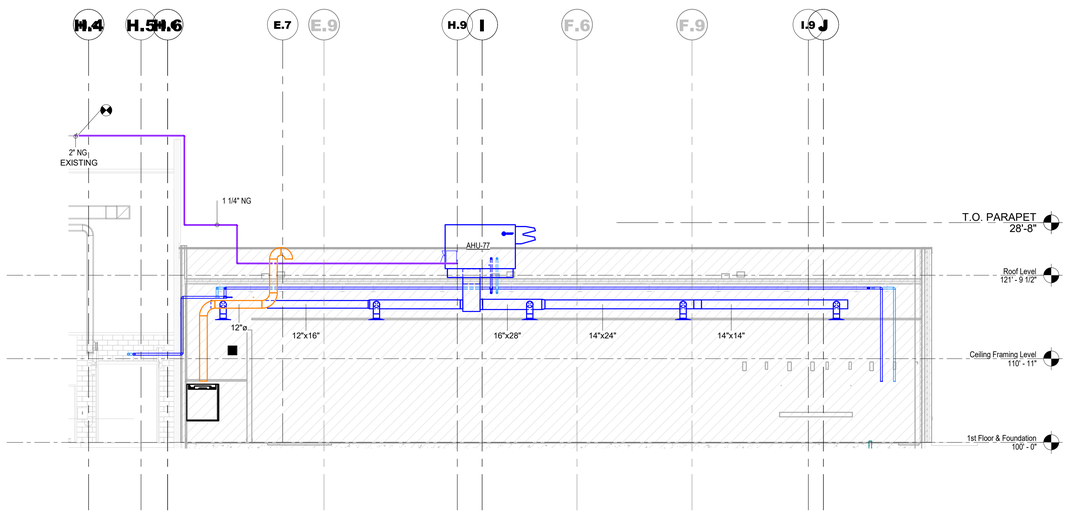

2 Section 1
1/8" = 1'-0"

PLAN NOTES

1. DUCT MOUNTED SMOKE DETECTOR. SUPPLIED AND WIRED BY OTHERS, MOUNTED BY CINFAB. CONNECT TO BUILDING FIRE ALARM SYSTEM.
2. REFER TO DETAIL 1 ON SHEET M000 FOR COIL CONNECTION.
3. DROP PIPE DOWN TO CONNECT TO PROCESS HEAT EXCHANGER.

GROTE ENTERPRISES, LLC
Thomas J. DYER Company
CINFAB
SHEET METAL FABRICATION AND INSTALLATION
5340 LESTER ROAD
CINCINNATI, OH 45213
PH (513) 321-8100

PROPERTY OF GROTE ENTERPRISES - IMPORTANT - THIS DRAWING PRINT IS LOANED FOR MUTUAL ASSISTANCE AND AS SUCH IS SUBJECT TO RECALL AT ANY TIME. INFORMATION CONTAINED HEREON IS NOT TO BE DISCLOSED OR REPRODUCED IN ANY FORM FOR THE BENEFIT OF PARTIES OTHER THAN NECESSARY SUBCONTRACTORS AND SUPLIERS WITHOUT WRITTEN CONSENT OF GROTE ENTERPRISES.

REV #	DATE	DESCRIPTION OF REVISION	BY	APP
0	02/20/24	PERMIT	JMT	
1	06/19/24	ENGINEERING CHANGES	JMT	

PROJECT
MANE SAVORY
1093 Mane Way
Lebanon, OH 45036

SHEET TITLE
HVAC PLAN

DRAWN BY	JMT
JOB #	---
FULL SHEET SIZE	30"X42"

M111

0 4' 8' 16'
0 1' 2' 4' 8'