


1 Level 1 - HVAC LEVEL 1  
1/8" = 1'-0"

3 Roof - HVAC  
1/8" = 1'-0"

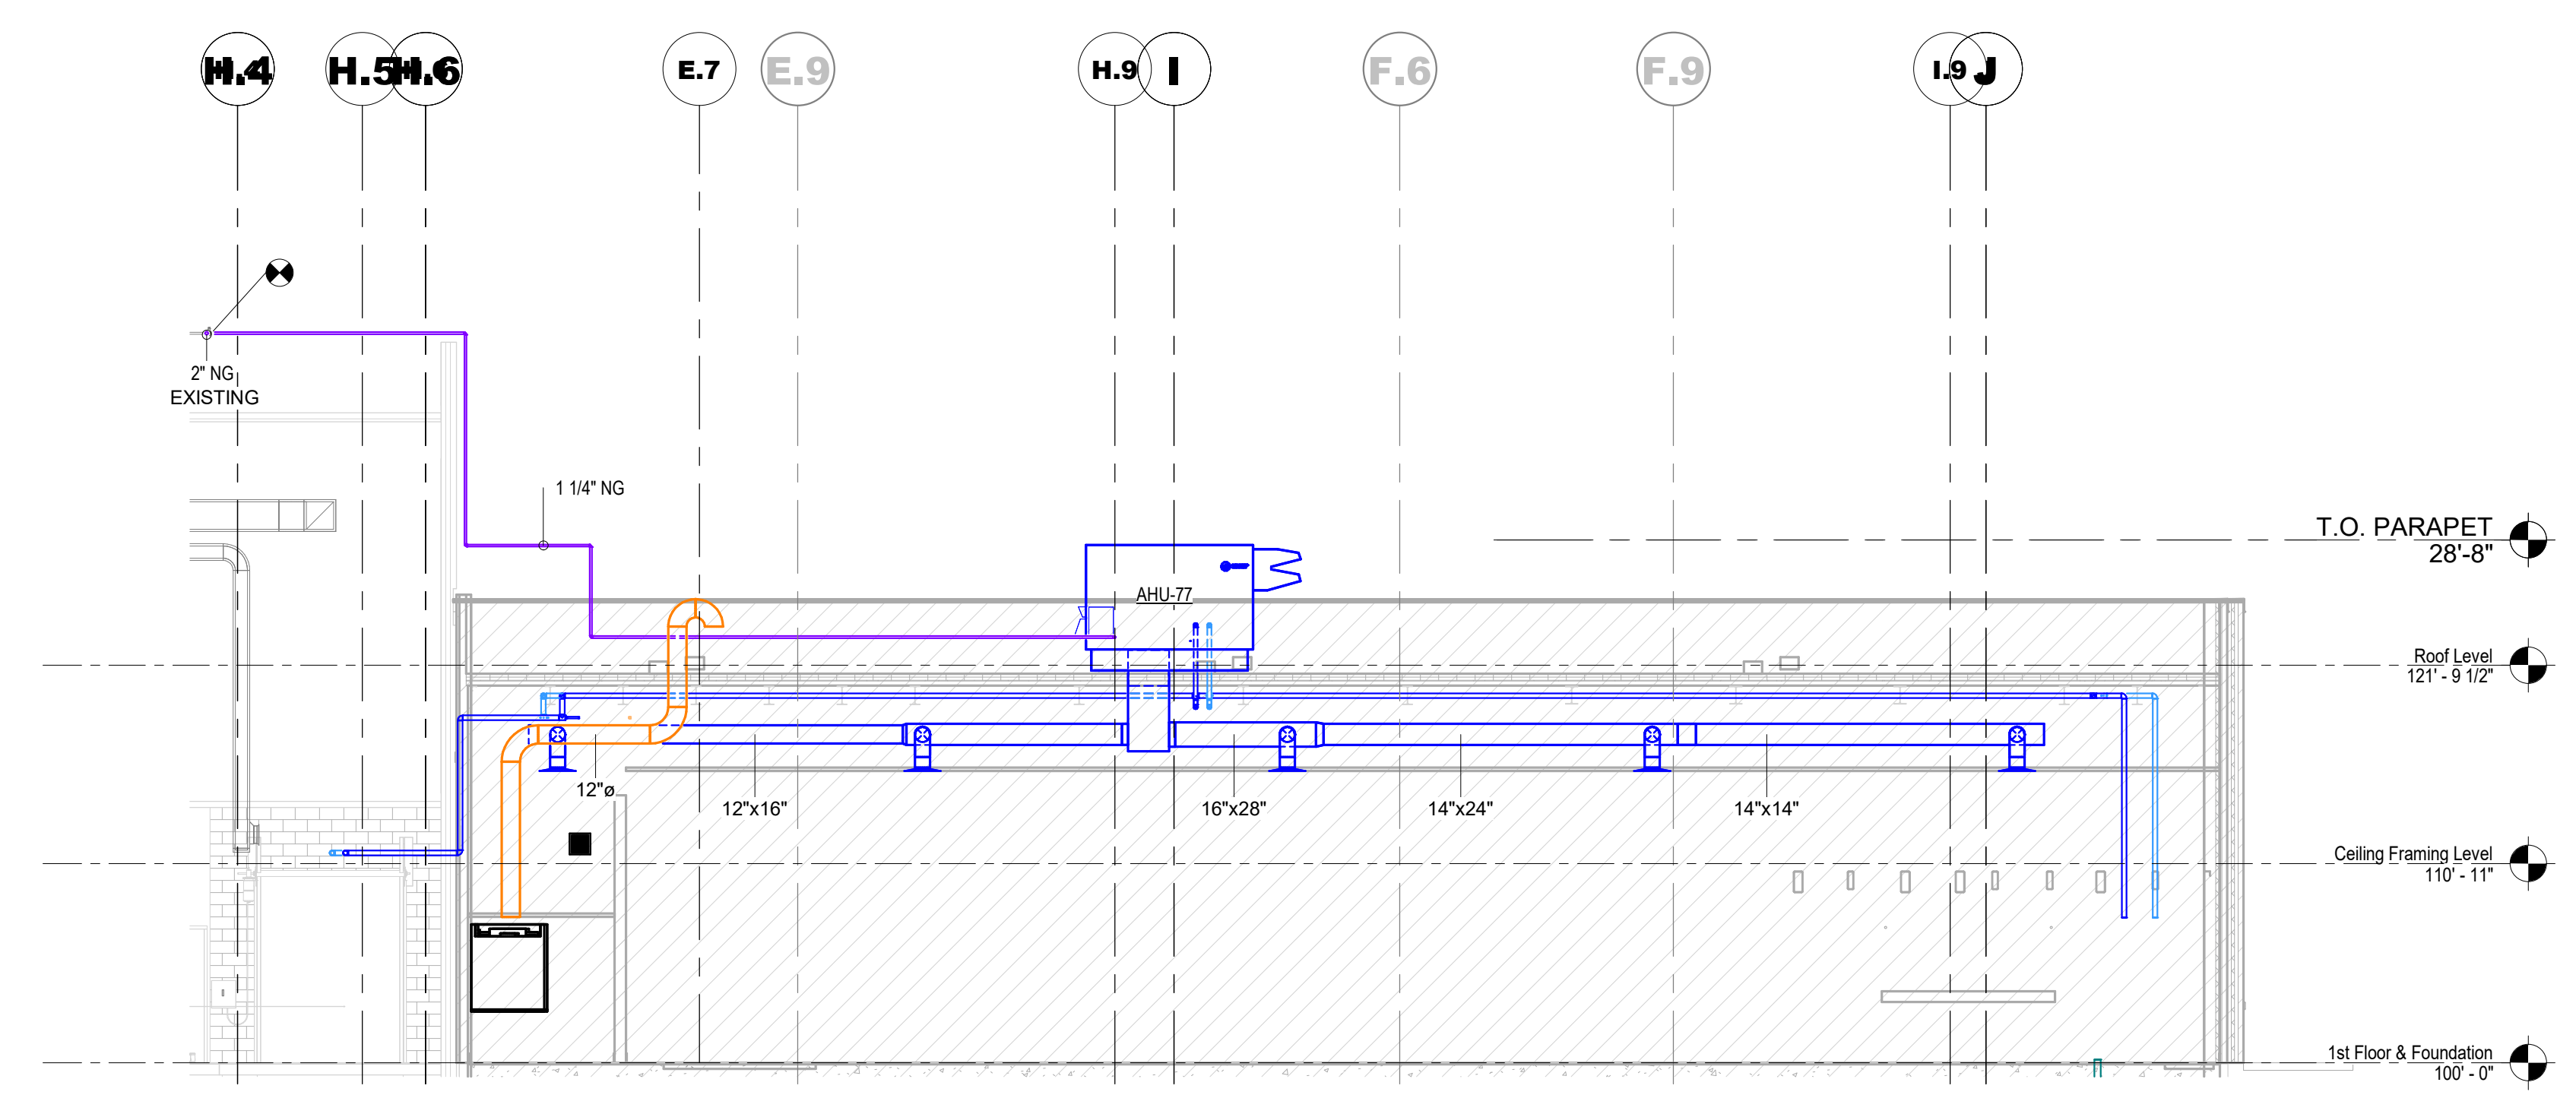

2 Section 1  
1/8" = 1'-0"

PLAN NOTES

- DUCT MOUNTED SMOKE DETECTOR, SUPPLIED AND WIRED BY OTHERS, MOUNTED BY CINFAB. CONNECT TO BUILDING FIRE ALARM SYSTEM.
- REFER TO DETAIL 1 ON SHEET M000 FOR COIL CONNECTION.
- DROP PIPE DOWN TO CONNECT TO PROCESS HEAT EXCHANGER.

PROPERTY OF GROTE ENTERPRISES -  
IMPORTANT - THIS DRAWING PRINT IS  
LOANED FOR MUTUAL ASSISTANCE AND AS  
SUCH IS SUBJECT TO RECALL AT ANY TIME.  
INFORMATION CONTAINED HEREON IS NOT  
TO BE DISCLOSED OR REPRODUCED IN ANY  
FORM FOR THE BENEFIT OF PARTIES OTHER  
THAN NECESSARY SUBCONTRACTORS AND  
SUPPLIERS WITHOUT WRITTEN CONSENT OF  
GROTE ENTERPRISES.

REV #	DATE	DESCRIPTION OF REVISION
0	02/29/24	PERMIT
1	06/19/24	ENGINEERING CHANGES