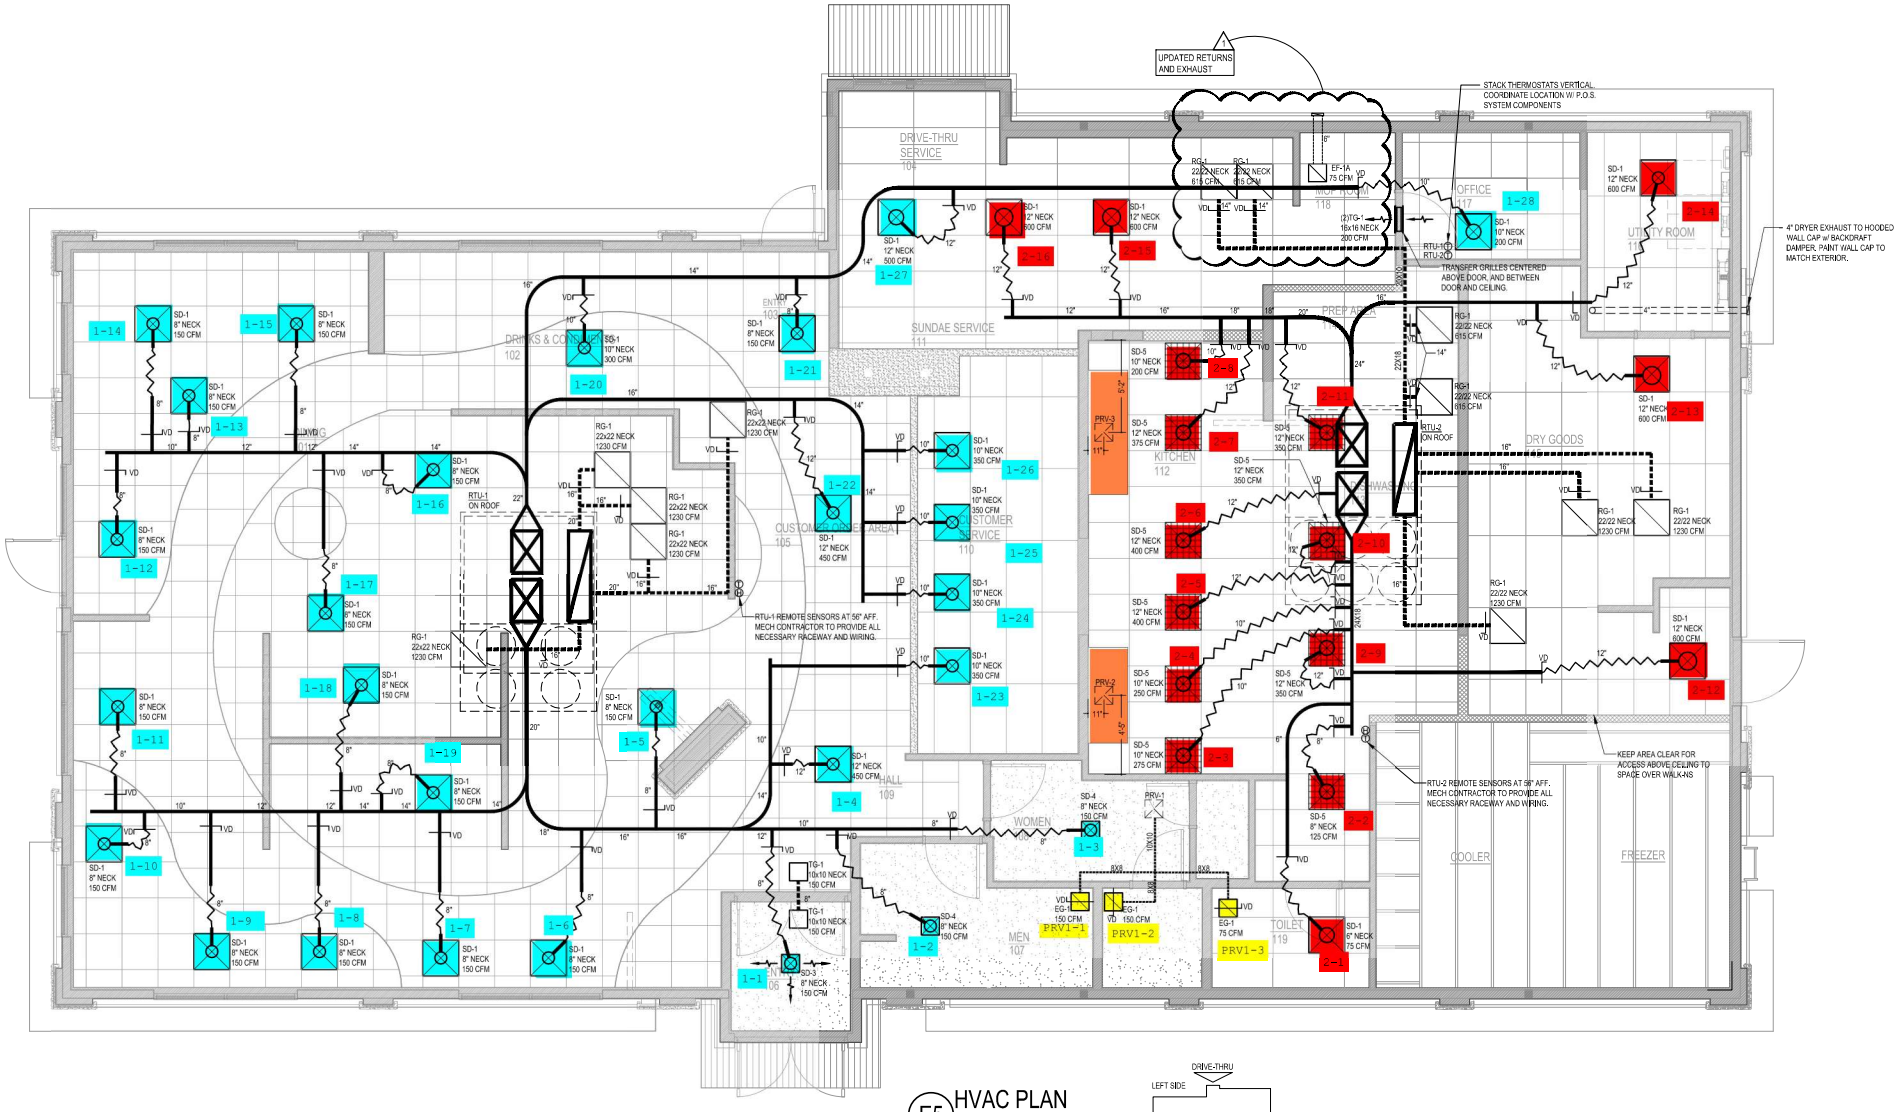
UPDATED RETURNS AND EXHAUST
STACK THERMOSTATS VERTICAL. COORDINATE LOCATION W/ P.O.S. SYSTEM COMPONENTS
4" DRYER EXHAUST TO HOODED WALL CAP w/ BACKDRAFT DAMPER. PAINT WALL CAP TO MATCH EXTERIOR.
TRANSFER GRILLES CENTERED ABOVE DOOR, AND BETWEEN DOOR AND CEILING.
RTU-1 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
RTU-2 REMOTE SENSORS AT 56" AFF. MECH CONTRACTOR TO PROVIDE ALL NECESSARY RACEWAY AND WIRING.
KEEP AREA CLEAR FOR ACCESS ABOVE CEILING TO SPACE OVER WALK-INS
DRIVE-THRU SERVICE
SUNDAE SERVICE
DRINKS & CONDIMENTS
CUSTOMER SERVICE
KITCHEN
PREP AREA
DRY GOODS
OFFICE
UTILITY ROOM
COOLER
FREEZER
WOMEN
MEN
TOILET
RTU-1 ON ROOF
RTU-2 ON ROOF
PRV1-1
PRV1-2
PRV1-3
HVAC PLAN
DRIVE-THRU
LEFT SIDE