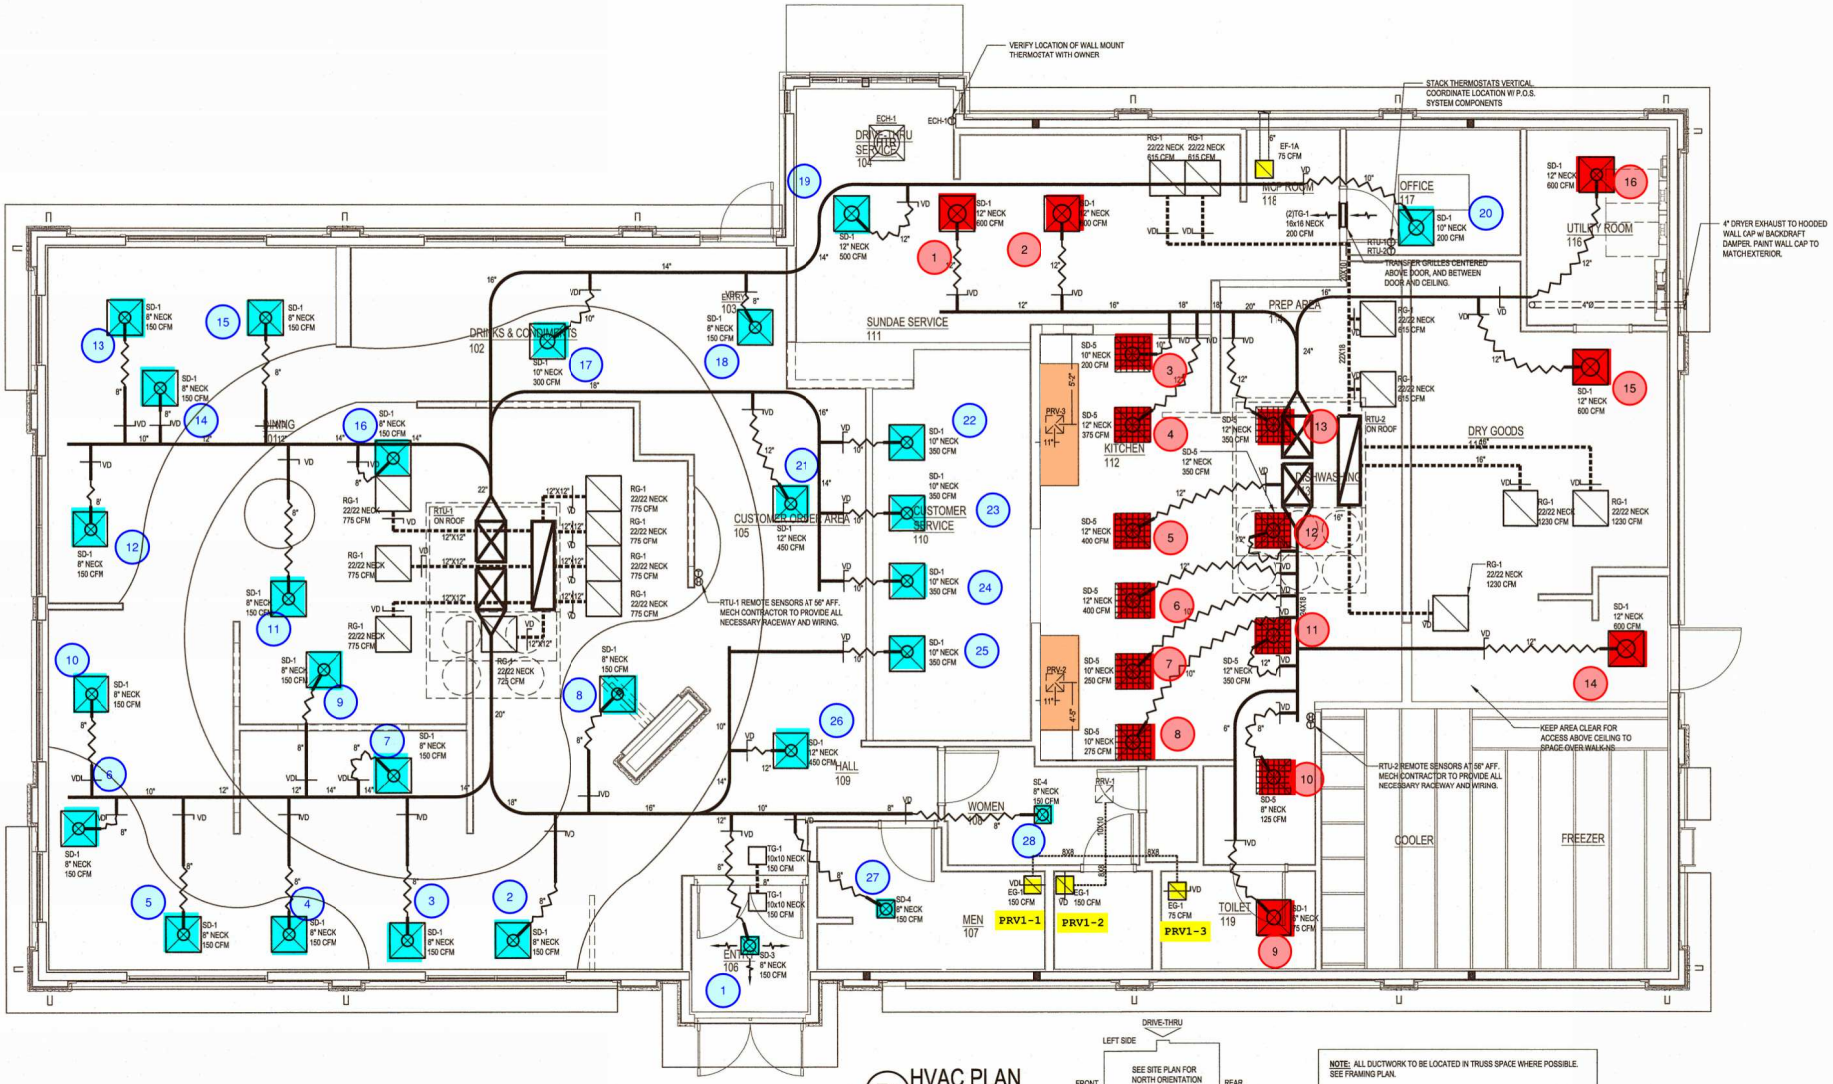

E5 HVAC PLAN

SCALE : 1/4" = 1'-0"

NOTE: ALL DUCTWORK TO BE LOCATED IN TRUSS SPACE WHERE POSSIBLE. SEE FRAMING PLAN.

HVAC SETPOINTS RECOMMENDED BY CORPORATE OPERATIONAL GUIDELINES:

1. DINING: HEATING 70 DEGF, COOLING 72 DEGF
2. KITCHEN: HEATING 68 DEGF, COOLING 74 DEGF

LOWELL J. LARSON E-17499 STATE OF NEBRASKA

2-2-23