



MECHANICAL SYMBOLS ABBREVIATIONS

(SOME SYMBOLS MAY NOT BE USED ON THE DRAWINGS)


%	PERCENT
ABS	ABSOLUTE
ACC	AIR-COOLED CHILLER
ACU	AIR CONDITIONING UNIT
AD	ACCESS DOOR
AF	AIR FOIL
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
ALT	ALTITUDE
AMB	AMBIENT
AMCA	AIR MOVEMENT AND CONTROL ASSOCIATION
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APPROX	APPROXIMATE
ARI	AIR-CONDITIONING AND REFRIGERATION INSTITUTE
ASHRAE	AMERICAN SOCIETY OF HEATING, REFRIGERATION, AND AIR-CONDITIONING ENGINEERS
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS
ASTM	AMERICAN SOCIETY OF TESTING MATERIALS
AVG	AVERAGE
B	BOILER
BD	BACKDRAFT DAMPER
BG	BELOW GRADE
BEMCS	BUILDING ENERGY MANAGEMENT AND CONTROL SYSTEM
BHP	BRAKE HORSEPOWER
BI	BACKWARD INCLINED
BOD	BOTTOM OF DUCT
BOP	BOTTOM OF PIPE
BTU	BRITISH THERMAL UNIT
BTUH	BTU PER HOUR
CD	COLD DECK
CF	CUBIC FEET
CFM	CUBIC FEET PER MINUTE
CHET	CHILLED WATER EXPANSION TANK
CMPR	COMPRESSOR
COND	CONDENSER
CRAC	COMPUTER ROOM AIR CONDITIONER
CT	COOLING TOWER
CHWR	CHILLED WATER RETURN
CHWS	CHILLED WATER SUPPLY
CU IN	CUBIC INCH
dB	DECIBEL
DB	DRY BULB
DCP	DISTRIBUTED CONTROL PANEL
DEG	DEGREE
DIA	DIAMETER
DWG	DRAWING
DX	DIRECT-EXPANSION
EAT	ENTERING AIR TEMPERATURE
EDH	ELECTRIC DUCT HEATER
EF	EXHAUST FAN
EFF	EFFICIENCY
EL	ELEVATION
ENT	ENTERING
ESP	EXTERNAL STATIC PRESSURE
EXP	EXPANSION
F	FAHRENHEIT
FA	FACE AREA
FCU	FAN COIL UNIT
FD	FIRE DAMPER
FH	FUME HOOD
FLEX	FLEXIBLE
FFM	FEET PER MINUTE
FPS	FEET PER SECOND
FRP	FIBERGLASS REINFORCED PIPE
FS	FLOW SWITCH
FSD	COMBINATION FIRE-SMOKE DAMPER
FT	FEET OR FOOT
FTU	FAN TERMINAL UNIT
GA	GAUGE OR GAGE
GAL	GALLONS
GALV	GALVANIZED
GPD	GALLONS PER DAY
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
GR	GRAINS
H	ENTHALPY
HD	HEAD
HD	HOT DECK
HG	HEAT GAIN OR MERCURY
HGT	HEIGHT
HP	HORSEPOWER
HPS	HIGH PRESSURE STEAM
HR	HOUR
HTHW	HIGH TEMPERATURE HEATING WATER
HVAC	HEATING/VENTILATING/AIR-CONDITIONING
HVU	HEATING AND VENTILATING UNIT
HWR	HEATING HOT WATER RETURN
HWS	HEATING HOT WATER SUPPLY
HZ	FREQUENCY
ID	INSIDE DIAMETER
IPS	INTERNATIONAL PIPE STANDARD
ip	IRON PIPE SIZE
K	THERMAL CONDUCTIVITY
KH	KITCHEN HOOD
KW	KILOWATT

LAT	LEAVING AIR TEMPERATURE
LBS	POUNDS
LF	LINEAR FEET
LG	LENGTH
LPS	LOW PRESSURE STEAM
LTHW	LOW TEMPERATURE HOT WATER
LWT	LEAVING WATER TEMPERATURE
MCA	MINIMUM CIRCUIT AMPACITY
MOCP	MAXIMUM OVERCURRENT PROTECTION
MAX	MAXIMUM
MBH	BTU PER HOUR (THOUSAND)
MIN	MINIMUM
N.C.	NORMALLY CLOSED
N.O.	NORMALLY OPEN
N/A	NOT APPLICABLE
NC	NOISE CRITERIA
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
OA	OUTSIDE AIR
OBD	OPOSED BLADE DAMPER
OD	OUTSIDE DIAMETER
PD	PUMPED DISCHARGE
PBD	PARALLEL BLADE DAMPER
PH	PHASE (ELECTRICAL)
PPM	PARTS PER MILLION
PRESS	PRESSURE
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PSIA	PSI ABSOLUTE
PSIG	PSI GAGE
R	RANKINE
R-22	REFRIGERANT (NUMBER INDICATES TYPE)
RA	RETURN AIR
RAF	RELIEF AIR FAN
RECIRC	RECIRCULATE
RH	RELATIVE HUMIDITY
RHC	REHEAT COIL
RPM	REVOLUTIONS PER MINUTE
SA	SUPPLY AIR
SC	SHADING COEFFICIENT
SCFM	CUBIC FEET PER MINUTE-STANDARD CONDITIONS
SD	SMOKE DAMPER
SEC	SECOND
SF	SQUARE FEET
SG	SPECIFIC GRAVITY
SHG	SENSIBLE HEAT GAIN
SHR	SENSIBLE HEAT RATIO
SP	STATIC PRESSURE
SPEC	SPECIFICATION
SQ	SQUARE
SSD	SUB-SOIL DRAINAGE
STD	STANDARD
SUCT	SUCTION
t	TIME
T	TEMPERATURE SENSOR
TD	TEMPERATURE DIFFERENCE
TEMP	TEMPERATURE
TOC	TOP OF CONCRETE
TOD	TOP OF DUCT
TONS	TONS OF REFRIGERATION
TOP	TOP OF PIPE
TOS	TOP OF STEEL
TSP	TOTAL STATIC PRESSURE
T-STAT	THERMOSTAT
TU	TERMINAL UNIT
TYP	TYPICAL
U	HEAT TRANSFER COEFFICIENT
UH	UNIT HEATER
UF	UNDER FLOOR
V	VOLT
VA	VOLT AMPERE
VAC	VACUUM
VAV	VARIABLE AIR VOLUME
VD	VOLUME DAMPER
VENT	VENTILATION
VERT	VERTICAL
VFD	VARIABLE FREQUENCY DRIVE
VOL	VOLUME
VP	VELOCITY PRESSURE
W	HUMIDITY RATIO OR WATT
W.C.	WATER COLUMN
W.G.	WATER GAUGE
WB	WET BULB
WT	WEIGHT
YR	YEAR


SHEET SYMBOLS

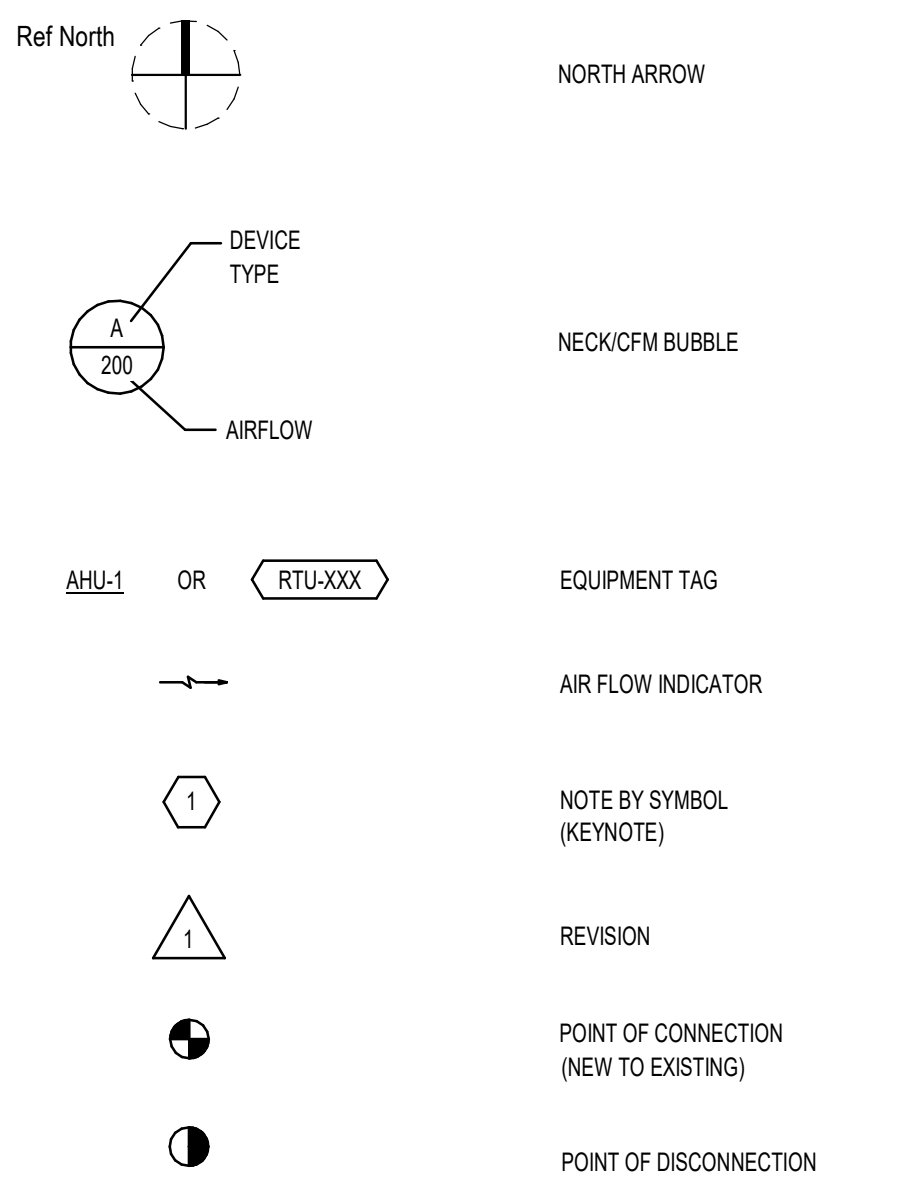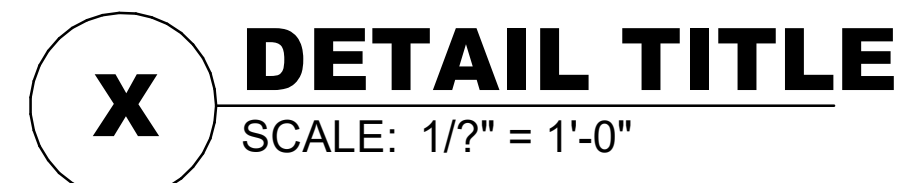


MECHANICAL EQUIPMENT

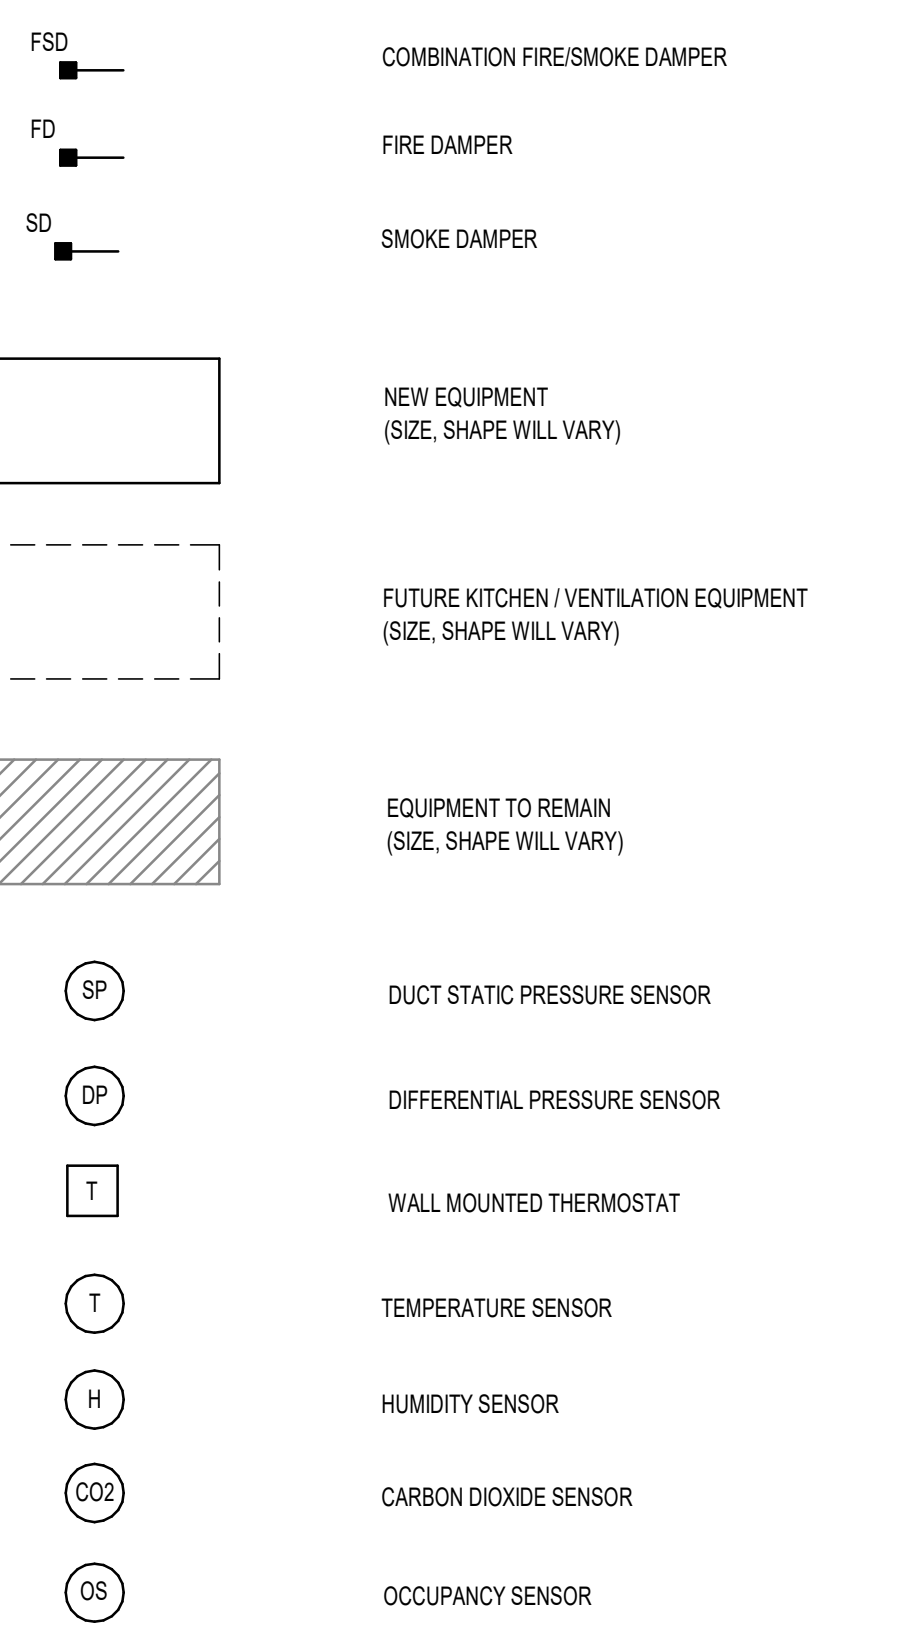


DUCTWORK

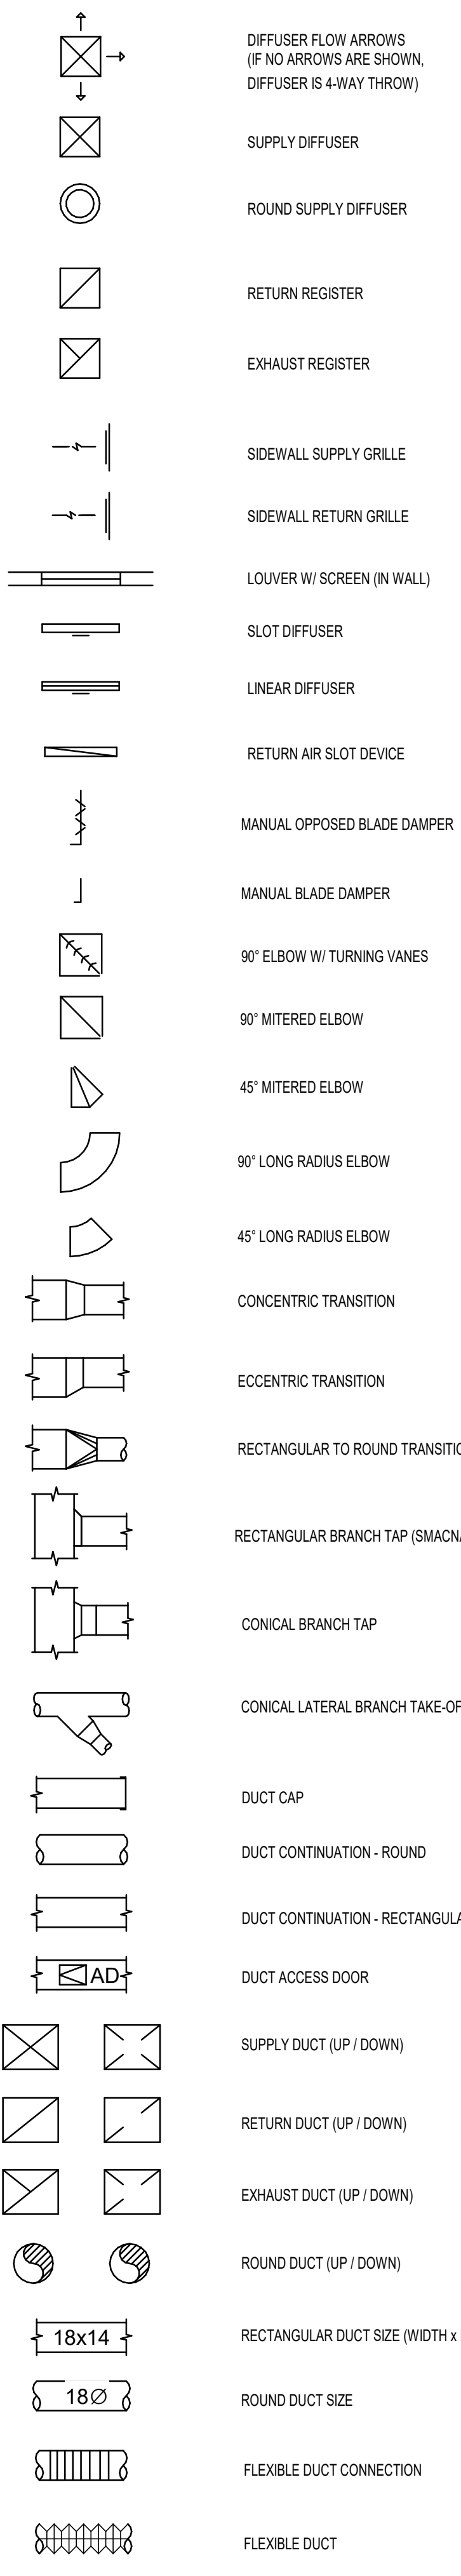

DUCTWORK

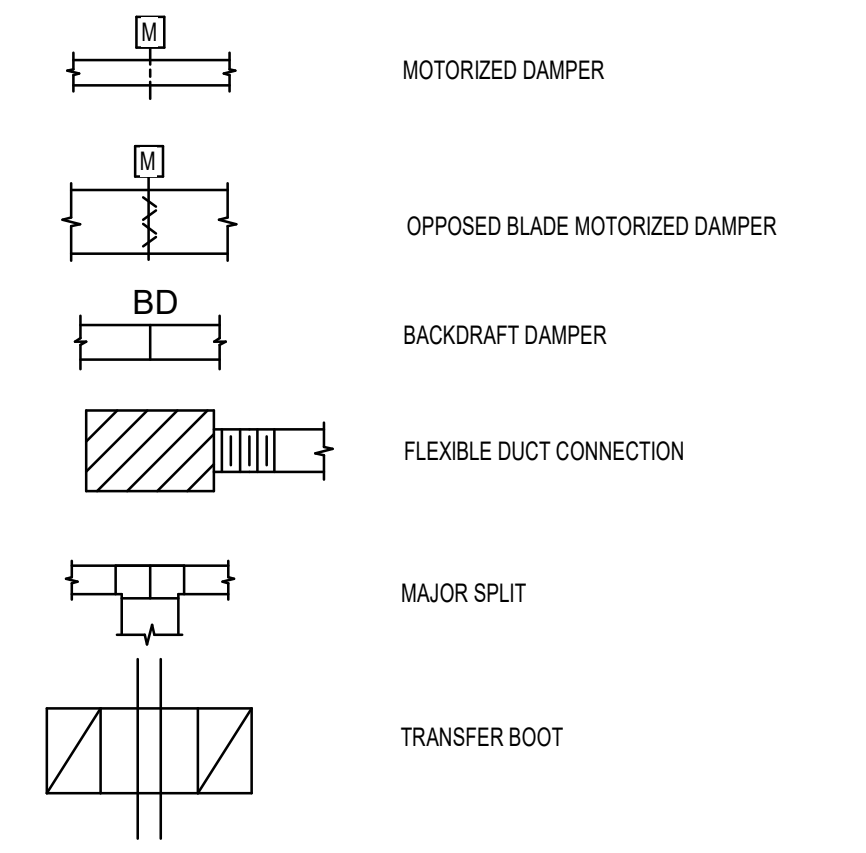

PIPING SYMBOLS

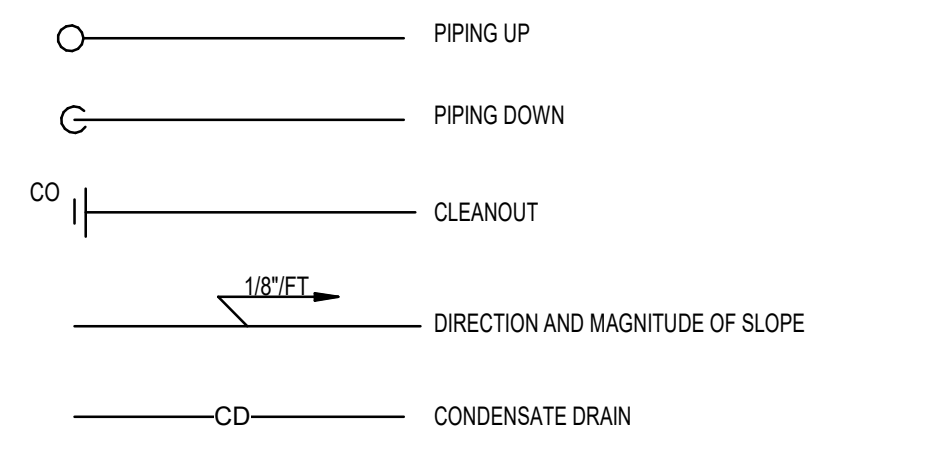

HVAC DESIGN CRITERIA

ASHRAE FUNDAMENTALS - 2021:	SUMMER COOLING DESIGN (0.4%):
WEATHER STATION - ROCK HILL, SC	94.7 °F DRY BULB
ELEVATION: 669'	77.9 °F WET BULB
WINTER HEATING DESIGN (99.6%):	
20.3 °F DRY BULB	

GENERAL NOTES

- PERFORM WORK IN ACCORDANCE WITH THE LATEST EDITIONS, REVISIONS, AMENDMENTS OR SUPPLEMENTS OF APPLICABLE STATUTES, ORDINANCES, CODES OR REGULATIONS OF FEDERAL, STATE AND LOCAL AUTHORITIES HAVING JURISDICTION IN EFFECT ON THE DATE BIDS ARE RECEIVED.
- PROVIDE ALL SYSTEMS AS COMPLETE WITH ALL REQUIRED ACCESSORIES FOR CODE COMPLIANCE.
- REFER TO SPECIFICATIONS FOR MATERIALS AND METHODS FOR CONSTRUCTION.
- DUCTWORK SIZES SHOWN ARE FREE AIR STREAM DIMENSIONS.
- INSTALL DUCTWORK AND PIPING TO PROVIDE THE MAXIMUM POSSIBLE CLEAR HEIGHT UNDERNEATH. (BETWEEN STRUCTURE OR CEILING AND TOP OF DUCT).
- WHERE APPROVAL CODES HAVE BEEN ESTABLISHED BY OSHA, UNDERWRITER'S LABORATORY, AMERICAN CODES, ANSI, ASME, ASA, ASHRAE, ASTM, ARI, NEL, NFPA, SMACNA, OR THE STATE FIRE INSURANCE REGULATORY BODY, FOLLOW THESE STANDARDS WHETHER OR NOT INDICATED ON THE DRAWINGS AND SPECIFICATIONS.
- PROVIDE THE ENTIRE SYSTEM AND ITS COMPONENT ITEMS OF EQUIPMENT IN OPERATING CONDITION FREE OF OBJECTIONABLE VIBRATION OR NOISE.
- COORDINATE WORK SO THAT INTERFERENCES BETWEEN PIPING, DUCTWORK, EQUIPMENT, PLUMBING WORK, ELECTRICAL WORK, AND BUILDING STRUCTURE WILL BE AVOIDED.
- FURNISH ACCESS DOORS FOR INSTALLATION IN WALLS AND CEILINGS WHERE ACCESS IS REQUIRED TO CONCEALED MECHANICAL EQUIPMENT, VALVES, DAMPERS, CONTROLS AND OTHER DEVICES.
- COORDINATE THE EXACT LOCATION OF DRAIN AND MECHANICAL EQUIPMENT LOCATIONS WITH MECHANICAL, ARCHITECTURAL, AND STRUCTURAL DRAWINGS PRIOR TO INSTALLATION.
- RECTANGULAR ELBOWS SHALL BE LONG-RADIUS ELBOWS UNLESS OTHERWISE SHOWN OR NOTED. SUPPLY AIR STANDARD NON-RADIUS 90° ELBOWS SHALL HAVE TURNING VANES.

PREPARED FOR:

WHATABURGER

BL Companies
Architecture
Engineering
Environmental
Land Surveying
Companies

3420 Torrington Way, Ste 210
Charlotte, NC 28227
(704) 565-7070
(203) 630-2615 Fax

© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version
09.30.2024 2024 Q3 PT22M Prototype Release

Date	Description
------	-------------



Seal / Signature

Project Name
WHATABURGER ROCK HILL, SC

Date: 12.20.2024

Project Number
2400234

Description
GENERAL NOTES, SYMBOLS AND ABBREVIATIONS

Scale
NOT TO SCALE

M0.1

REFRIGERATION CALCULATIONS PER SCMC 2021, TABLE 1103.1:			
AREA SERVED	KITCHEN / STORAGE	FREEZER 108	COOLER 109
OCCUPANCY CLASSIFICATION	COMMERCIAL	COMMERCIAL	COMMERCIAL
REFRIGERANT TYPE	404A	448A	448A
REFRIGERANT CLASSIFICATION	A1	A1	A1
PIPING MATERIAL	COPPER TUBE	COPPER TUBE	COPPER TUBE
SYSTEM CLASSIFICATION	DIRECT SYSTEM, HIGH PROBABILITY	DIRECT SYSTEM, HIGH PROBABILITY	DIRECT SYSTEM, HIGH PROBABILITY
MAX REFRIG. QTY (LBS./1000 CU. FT.)	31	24	24
SPACE VOLUME (CU. FT.)	12348	698	698
MAX. SYSTEM REFRIG. (LBS.)	398.3	16.75	16.75
PROPOSED SYSTEM REFRIG. (LBS.)	43.5 (14.5/UNIT)	14.3	11.6


- NOTES:
- PROPOSED REFRIGERANT VOLUME IS BASED ON A MAXIMUM LINE LENGTH OF 50 FEET. FINAL SIZING OF REFRIGERANT LINES AND DETERMINATION OF REFRIGERANT VOLUME IS THE RESPONSIBILITY OF THE EQUIPMENT SUPPLIER. INSTALLED REFRIGERANT CHARGE SHALL COMPLY WITH SCMC AND ASHRAE 34 REQUIREMENTS AND SHALL NOT EXCEED THE MAXIMUM AMOUNT SPECIFIED IN THE TABLE ABOVE. REFRIGERANT PIPING SYSTEMS SHALL BE PRESSURE TESTED FOR STRENGTH AND LEAK TESTED FOR TIGHTNESS IN ACCORDANCE WITH SCMC SECTION 1110. EQUIPMENT SUPPLIER AND MECHANICAL CONTRACTOR SHALL COMPLY WITH THESE REQUIREMENTS AND SHALL ADVISE ENGINEER AND GC IF UNABLE TO COMPLY.

MECHANICAL KEY NOTES

- 34"x16" SUPPLY DUCT AND 46"x14" RETURN DUCT UP TO RTU-1. PROVIDE DUCT TRANSITIONS TO MATCH UNIT CONNECTION SIZE.
- 30"x12" SUPPLY DUCT AND 44"x14" RETURN DUCT UP TO RTU-2. PROVIDE DUCT TRANSITIONS TO MATCH UNIT CONNECTION SIZE.
- DUCT MOUNTED SUPPLY AIR SMOKE DETECTOR. FURNISHED BY RTU MANUFACTURER. INSTALLED IN DUCT BY MC, AND WIRED BY FA CONTRACTOR.
- CONNECT KITCHEN EXHAUST HOOD ABOVE GRILL UP TO KEF-1 WITH 16" DIA. PRE-FABRICATED UL 1978 LISTED AND LABELED GREASE DUCT (DURAVENT DIS1 OR EQUAL). PROVIDE TRANSITION ABOVE CEILING TO MATCH HOOD CONNECTION SIZE. CONNECT TO HOOD VIA MANUFACTURER'S UL METHOD FOR GREASE AND SMOKE TIGHT JOINT. INSTALL ACCORDING TO MANUFACTURER'S DIRECTIONS FOR NFPA 96 COMPLIANCE.
- 16" GREASE EXHAUST DUCT UP TO KEF-1 ON ROOF. RE: A2/M5.1
- 10"x10" EXHAUST DUCT UP TO EF-1 ON ROOF. RE: A1/M5.1
- CONNECT KITCHEN EXHAUST HOOD ABOVE FRYER UP TO KEF-2 WITH 12" DIA. PRE-FABRICATED UL 1978 LISTED AND LABELED GREASE DUCT (DURAVENT DIS1 OR EQUAL). PROVIDE TRANSITION ABOVE CEILING TO MATCH HOOD CONNECTION SIZE. CONNECT TO HOOD VIA MANUFACTURER'S UL METHOD FOR GREASE AND SMOKE TIGHT JOINT. INSTALL ACCORDING TO MANUFACTURER'S DIRECTIONS FOR NFPA 96 COMPLIANCE.
- 12" GREASE EXHAUST DUCT UP TO KEF-2 ON ROOF. RE: A2/M5.1
- 1" CONDENSATE DOWN TO FLOOR. TERMINATE CONDENSATE AT FLOOR DRAIN WITH 1" AIR GAP.
- FULLY INSULATED 1" COPPER CONDENSATE PIPE UP THROUGH ROOF. RE: C4/M5.1. CONDENSATE TO START HORIZONTAL RUN AS CLOSE TO STRUCTURE INSIDE BUILDING AS POSSIBLE.
- THE PILOT RDM SYSTEM CONTROLLER PANEL SHALL BE MOUNTED AND INSTALLED FLUSH IN THE MANAGER'S OFFICE AT 5' AFF TO CENTER. COORDINATE FINAL LOCATION OF PANEL WITH OWNER AND GC.
- TEMPERATURE AND HUMIDITY SENSORS "T" AND "H" TO BE CEILING MOUNTED AND TIED INTO THE BUILDING CONTROL SYSTEM.
- LISTED GREASE DUCT ACCESS DOOR ASSEMBLY (DIS1-0ADL26 OR EQUAL). INSTALL ON SIDE OF DUCT.
- KITCHEN FREEZER EVAPORATOR UNIT. FURNISHED BY OWNER. INSTALLED BY MC IN COORDINATION WITH GC.
- KITCHEN COOLER EVAPORATOR UNIT. FURNISHED BY OWNER. INSTALLED BY MC IN COORDINATION WITH GC.
- KITCHEN ICEMAKER EVAPORATOR UNIT. FURNISHED BY OWNER. INSTALLED BY MC IN COORDINATION WITH GC.
- MECHANICAL CONTRACTOR TO PROVIDE EQUIPMENT SUPPORTS, REFRIGERANT LINES, AND COMPLETE EQUIPMENT INSTALLATION. COORDINATE EXACT LOCATION OF EQUIPMENT ON-SITE AND ROUTE REFRIGERANT PIPING THROUGH ROOF PENETRATION. COORDINATE PIPING AND UNIT INSTALLATION REQUIREMENTS AND STARTUP WITH KITCHEN EQUIPMENT MANUFACTURER AND GC.
- REMOTE ANSUL SYSTEM MOUNTED ON WALL. CONFIRM FINAL LOCATION OF STATION WITH OWNER, ARCHITECT, AND OTHER TRADES. REFER TO DETAILS AND SPECIFICATIONS.

MECHANICAL GENERAL NOTES

- REFER TO M0.1 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
- SMOKE DETECTORS SHALL BE PROVIDED AND INSTALLED BY THE RTU MANUFACTURER IN THE SUPPLY AND RETURN SIDES OF RTU. COORDINATE INSTALLATION AND CONNECTION OF SMOKE DETECTORS WITH FA CONTRACTOR, EC, AND GC. REFERENCE M6.1 FOR RTU SCHEDULE. ACTIVATION OF SMOKE DETECTORS SHALL SHUT DOWN RTU AND ACTIVATE THE AUDIBLE AND VISUAL SIGNAL PROVIDED.
- PROVIDE NECESSARY ACCESS AND CLEARANCES AROUND ALL EQUIPMENT ACCORDING TO MANUFACTURER'S RECOMMENDATION.
- MAINTAIN A MINIMUM DISTANCE OF 10'-0" BETWEEN ALL ROOF MOUNTED EQUIPMENT AND EDGE OF ROOF WITH THE EXCEPTION OF EQUIPMENT LOCATED BEHIND AN ARCHITECTURAL GUARD (MINIMUM 42" HIGH) OR PROVIDED WITH AN APPROVED FALL ARREST ANCHORAGE CONNECTOR DEVICE.
- MAINTAIN A MINIMUM DISTANCE OF 10'-0" BETWEEN MECHANICAL AIR INTAKES AND ALL MECHANICAL EXHAUSTS OR PLUMBING VENTS.
- AN APPROVED AGENCY SHALL BE HIRED BY THE OWNER AS PART OF THIS PROJECT TO PROVIDE A COMMISSIONING PLAN THAT INCLUDES THE FOLLOWING ITEMS:
 - A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING EACH PHASE OF COMMISSIONING, INCLUDING THE PERSONNEL INTENDED TO ACCOMPLISH EACH OF THE ACTIVITIES.
 - A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED AND A DESCRIPTION OF THE TESTS TO BE PERFORMED.
 - FUNCTIONS TO BE TESTED INCLUDING, BUT NOT LIMITED TO, CALIBRATIONS AND ECONOMIZER CONTROLS.
 - CONDITIONS UNDER WHICH THE TEST WILL BE PERFORMED. TESTING SHALL AFFIRM WINTER AND SUMMER DESIGN CONDITIONS AND FULL OUTSIDE AIR CONDITIONS.
 - MEASURABLE CRITERIA FOR PERFORMANCE.
- KITCHEN HOODS, ANSUL FIRE SUPPRESSION SYSTEM AND HOOD CONTROLS SHALL BE OWNER-FURNISHED AND CONTRACTOR-INSTALLED. COORDINATE WITH GC.
- FINAL LOCATION OF ALL TEMPERATURE AND HUMIDITY SENSORS TO BE COORDINATED IN FIELD. LOCATE SENSORS SUCH THAT THEY ARE ACCESSIBLE, PROTECTED, AND IN AN AREA OF UNOBSTRUCTED AIR CIRCULATION.
- ALL TESTS AND BALANCES TO BE PERFORMED BY A THIRD PARTY - NOT BY MEP SUBCONTRACTOR.
- PRIOR TO BEGINNING WORK, COORDINATE COMPLETE INSTALLATION OF ALL ROOFTOP EQUIPMENT AND ACCESSORIES WITH GC AND OTHER TRADES.
- VERIFY RTUS ARE LEVEL AND CONDENSATE IS DRAINING PROPERLY.

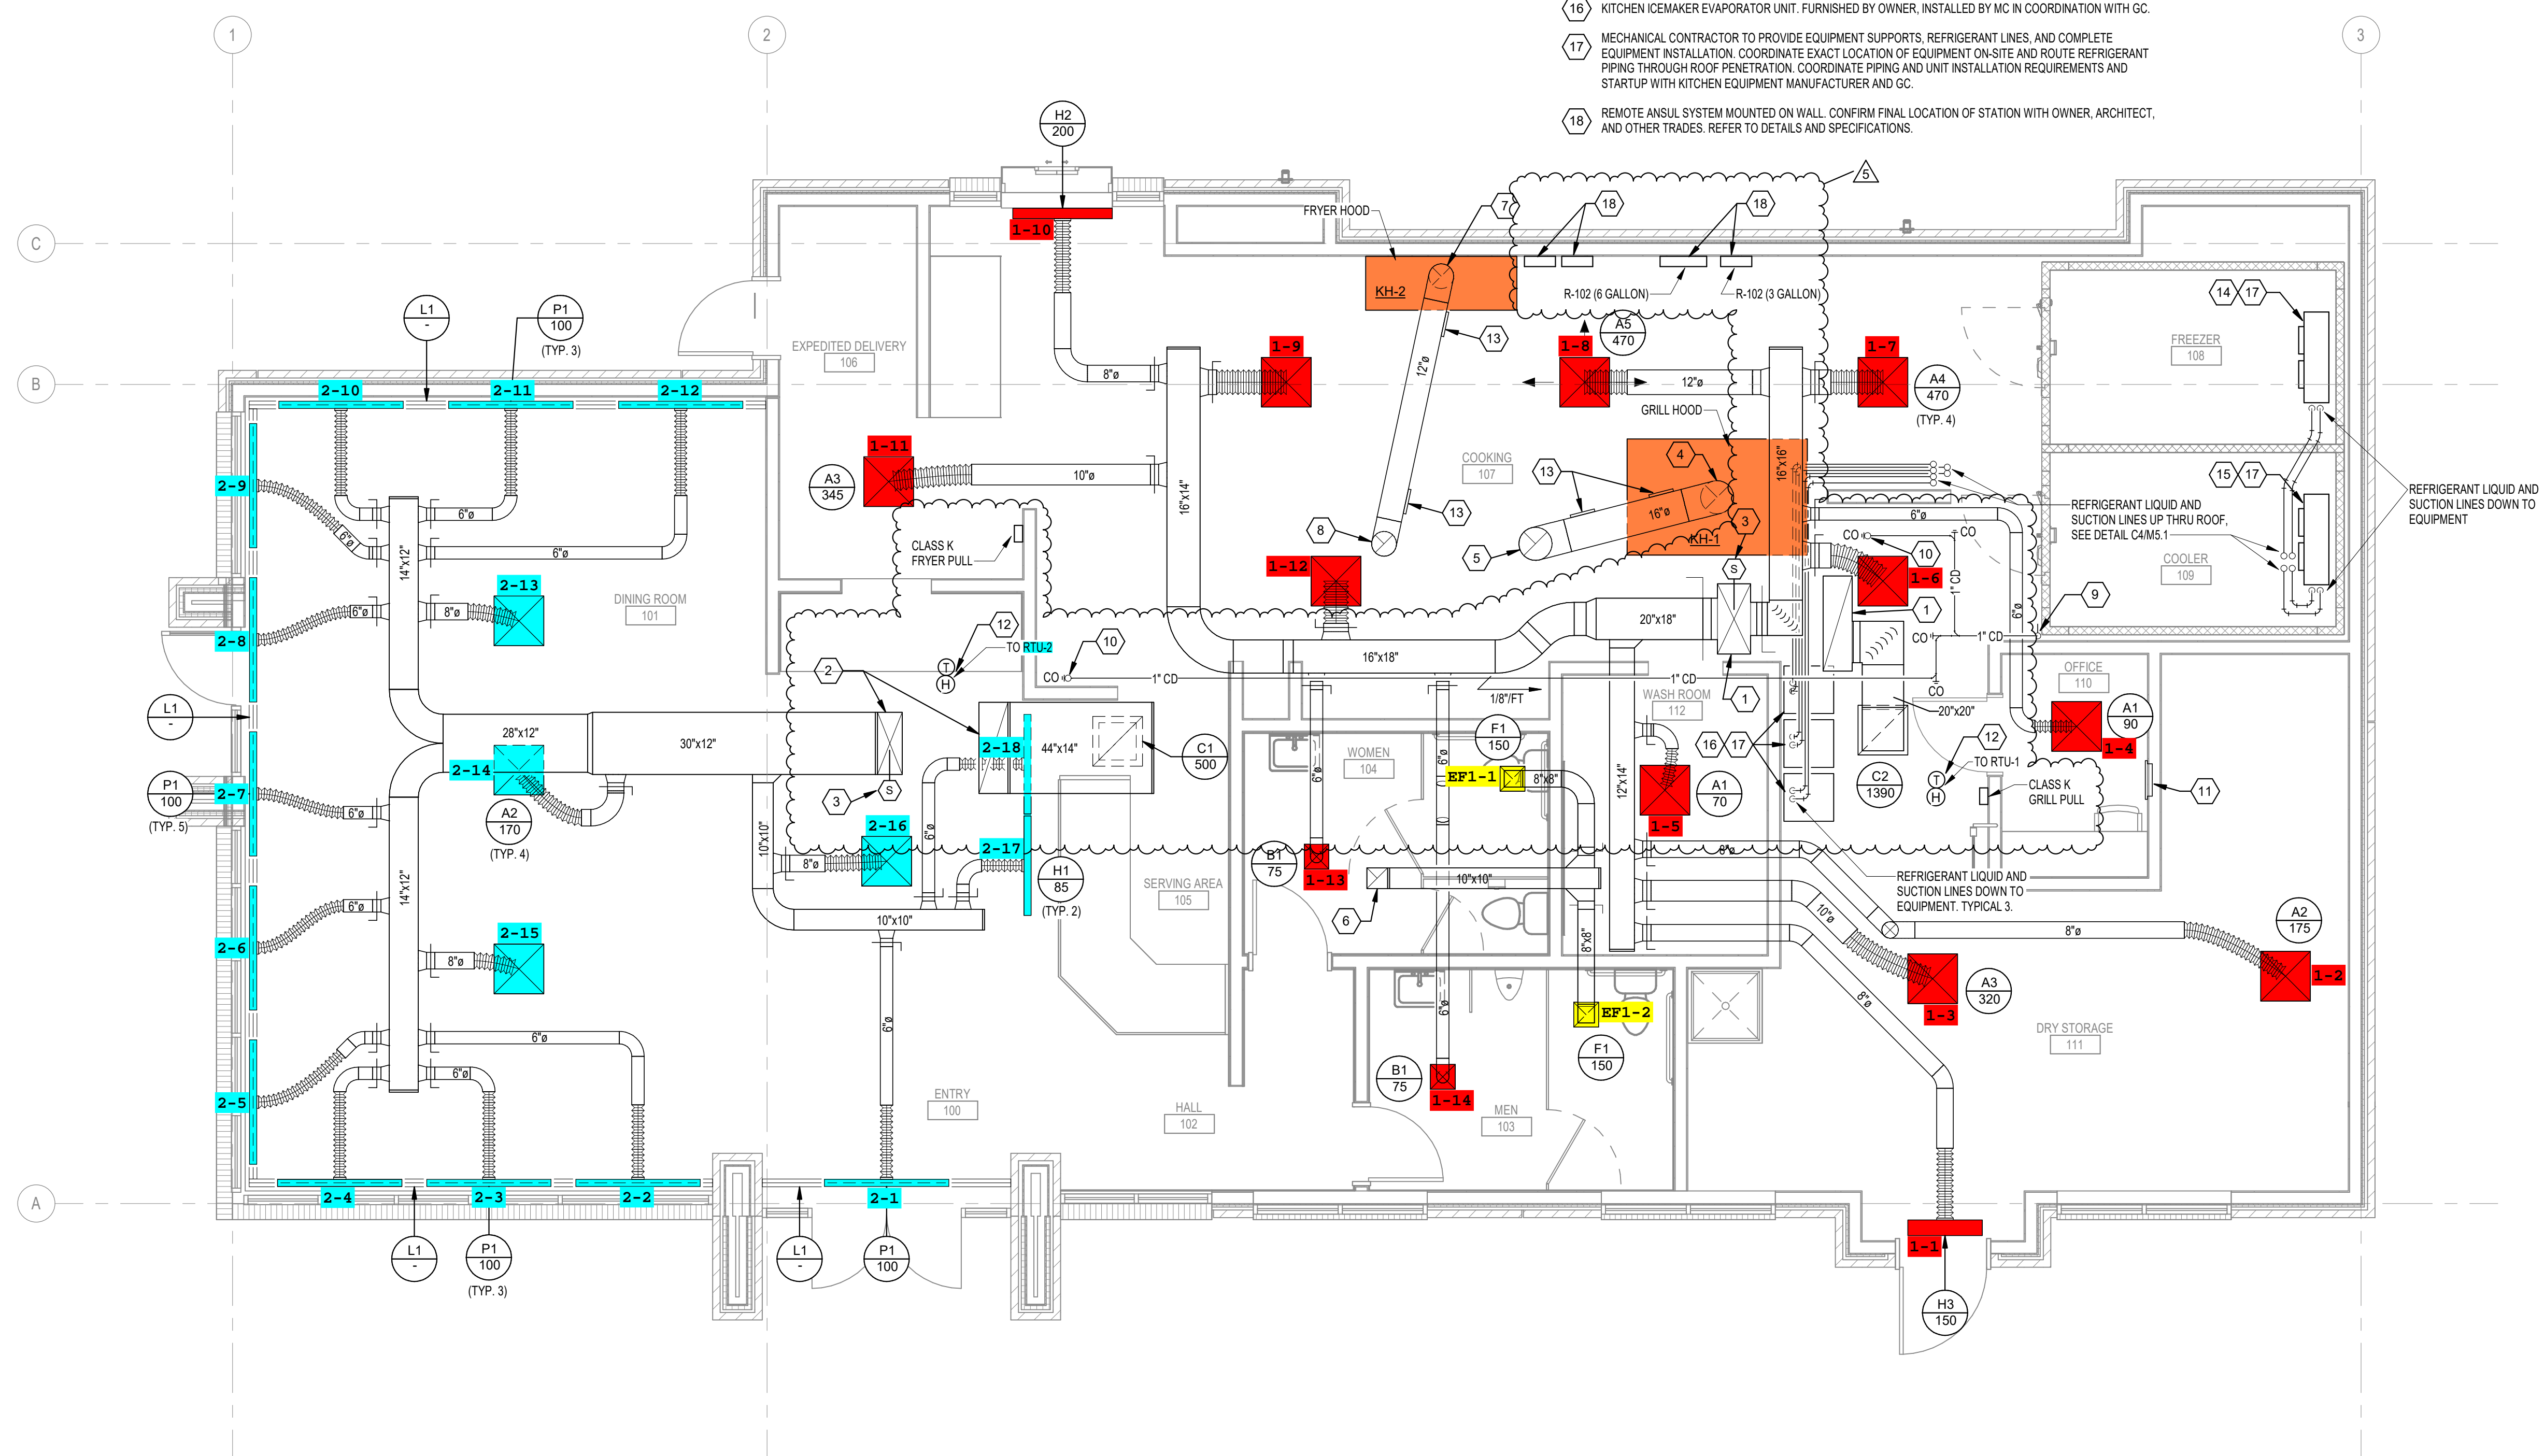

PREPARED FOR:




3420 Torrington Way, Ste 210
 Charlotte, NC 28227
 (704) 565-7070
 (203) 630-2615 Fax

© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version

09.30.2024 2024 Q3 PT22M Prototype Release

Date	Description
03/31/2025	PERMIT COMMENTS
06/06/2025	PERMIT COMMENTS
09/12/2025	MECHANICAL EQUIPMENT UPDATE

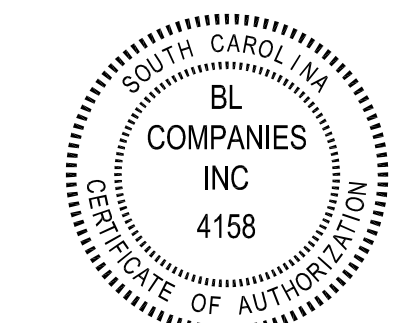

Seal / Signature

Project Name
 WHATABURGER ROCK HILL, SC

Date: 12.20.2024

Project Number

2400234

Description

MECHANICAL FLOOR PLAN

Scale

As indicated

Ref North

M1.1


9/12/2025 2:47:18 PM C:\Users\JAnderson\Documents\2400234_03_PT22M_MECH_IR22_panieronQ4NC.rvt

MECHANICAL KEY NOTES

- 1 ROOFTOP HVAC UNIT MOUNTED ON PRE-FABRICATED CURB, RE: C3M5.1
- 2 CENTRIFUGAL UPBLAST GREASE HOOD EXHAUST FAN MOUNTED ON MANUFACTURER PROVIDED ROOF CURB, RE: A2M5.1
- 3 CENTRIFUGAL DOWNBLAST EXHAUST FAN MOUNTED ON MANUFACTURER PROVIDED ROOF CURB, RE: A1M5.1
- 4 REQUIRED UNIT CLEARANCE PER BOB MANUFACTURER. COORDINATE EXACT CLEARANCE REQUIREMENTS WITH INSTALLED EQUIPMENT.
- 5 KITCHEN FREEZER CONDENSING UNIT MOUNTED ON ROOFTOP, FURNISHED BY OWNER, INSTALLED BY MC IN COORDINATION WITH GC. PROVIDE R404A REFRIGERANT, 3/8" LIQUID LINE AND 7/8" SUCTION LINE BETWEEN INDOOR AND OUTDOOR UNIT PER EQUIPMENT MFR.
- 6 KITCHEN COOLER CONDENSING UNIT MOUNTED ON ROOFTOP, FURNISHED BY OWNER, INSTALLED BY MC IN COORDINATION WITH GC. PROVIDE R404A REFRIGERANT, 3/8" LIQUID LINE AND 5/8" SUCTION LINE BETWEEN INDOOR AND OUTDOOR UNIT PER EQUIPMENT MFR.
- 7 KITCHEN ICEMAKER CONDENSING UNIT MOUNTED ON ROOFTOP, FURNISHED BY OWNER, INSTALLED BY MC IN COORDINATION WITH GC. PROVIDE R404A REFRIGERANT, 3/8" LIQUID LINE AND 7/8" SUCTION LINE BETWEEN INDOOR AND OUTDOOR UNIT PER EQUIPMENT MFR.
- 8 MECHANICAL CONTRACTOR TO PROVIDE EQUIPMENT SUPPORTS, REFRIGERANT LINES, AND COMPLETE EQUIPMENT INSTALLATION. COORDINATE EXACT LOCATION OF EQUIPMENT ON-SITE AND ROUTE REFRIGERANT PIPING THROUGH ROOF PENETRATION. COORDINATE PIPING AND UNIT INSTALLATION REQUIREMENTS AND STARTUP WITH KITCHEN EQUIPMENT MANUFACTURER AND GC.
- 9 REFRIGERATION PIPING ROOF PENETRATION, RE: C4M5.1
- 10 ROUTE CONDENSATE LINE DOWN THROUGH ROOF, RE: M1M1.1 FOR CONTINUATION AND RE: C4M5.1 FOR DETAIL.

MECHANICAL GENERAL NOTES

- A. REFER TO M0.1 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
- B. SMOKE DETECTORS SHALL BE PROVIDED AND INSTALLED BY THE RTU MANUFACTURER IN THE SUPPLY AND RETURN SIDES OF RTU. COORDINATE INSTALLATION AND CONNECTION OF SMOKE DETECTORS WITH FA CONTRACTOR, GC, AND GC. REFERENCE M6.1 FOR RTU SCHEDULE. ACTIVATION OF SMOKE DETECTORS SHALL SHUT DOWN RTU AND ACTIVATE THE AUDIBLE AND VISUAL SIGNAL PROVIDED.
- C. PROVIDE NECESSARY ACCESS AND CLEARANCES AROUND ALL EQUIPMENT ACCORDING TO MANUFACTURER'S RECOMMENDATION.
- D. MAINTAIN A MINIMUM DISTANCE OF 10'-0" BETWEEN ALL ROOF MOUNTED EQUIPMENT AND EDGE OF ROOF WITH THE EXCEPTION OF EQUIPMENT LOCATED BEHIND AN ARCHITECTURAL GUARD (MINIMUM 42" HIGH) OR PROVIDED WITH AN APPROVED FALL ARREST ANCHORAGE CONNECTOR DEVICE.
- E. MAINTAIN A MINIMUM DISTANCE OF 10'-0" BETWEEN MECHANICAL AIR INTAKES AND ALL MECHANICAL EXHAUSTS OR PLUMBING VENTS.
- F. AN APPROVED AGENCY SHALL BE HIRED BY THE OWNER AS PART OF THIS PROJECT TO PROVIDE A COMMISSIONING PLAN THAT INCLUDES THE FOLLOWING ITEMS:
 - A NARRATIVE DESCRIPTION OF THE ACTIVITIES THAT WILL BE ACCOMPLISHED DURING EACH PHASE OF COMMISSIONING, INCLUDING THE PERSONNEL INTENDED TO ACCOMPLISH EACH OF THE ACTIVITIES.
 - A LISTING OF THE SPECIFIC EQUIPMENT, APPLIANCES OR SYSTEMS TO BE TESTED AND A DESCRIPTION OF THE TESTS TO BE PERFORMED.
 - FUNCTIONS TO BE TESTED INCLUDING, BUT NOT LIMITED TO, CALIBRATIONS AND ECONOMIZER CONTROLS.
 - CONDITIONS UNDER WHICH THE TEST WILL BE PERFORMED. TESTING SHALL AFFIRM WINTER AND SUMMER DESIGN CONDITIONS AND FULL OUTSIDE AIR CONDITIONS.
 - MEASURABLE CRITERIA FOR PERFORMANCE.
- G. KITCHEN HOODS, ANSUL FIRE SUPPRESSION SYSTEM AND HOOD CONTROLS SHALL BE OWNER-FURNISHED AND CONTRACTOR-INSTALLED. COORDINATE WITH GC.
- H. FINAL LOCATION OF ALL TEMPERATURE AND HUMIDITY SENSORS TO BE COORDINATED IN FIELD. LOCATE SENSORS SUCH THAT THEY ARE ACCESSIBLE, PROTECTED, AND IN AN AREA OF UNOBSTRUCTED AIR CIRCULATION.
- I. ALL TESTS AND BALANCES TO BE PERFORMED BY A THIRD PARTY - NOT BY MEP SUBCONTRACTOR.
- J. PRIOR TO BEGINNING WORK, COORDINATE COMPLETE INSTALLATION OF ALL ROOFTOP EQUIPMENT AND ACCESSORIES WITH GC AND OTHER TRADES.
- K. VERIFY RTU'S ARE LEVEL AND CONDENSATE IS DRAINING PROPERLY.

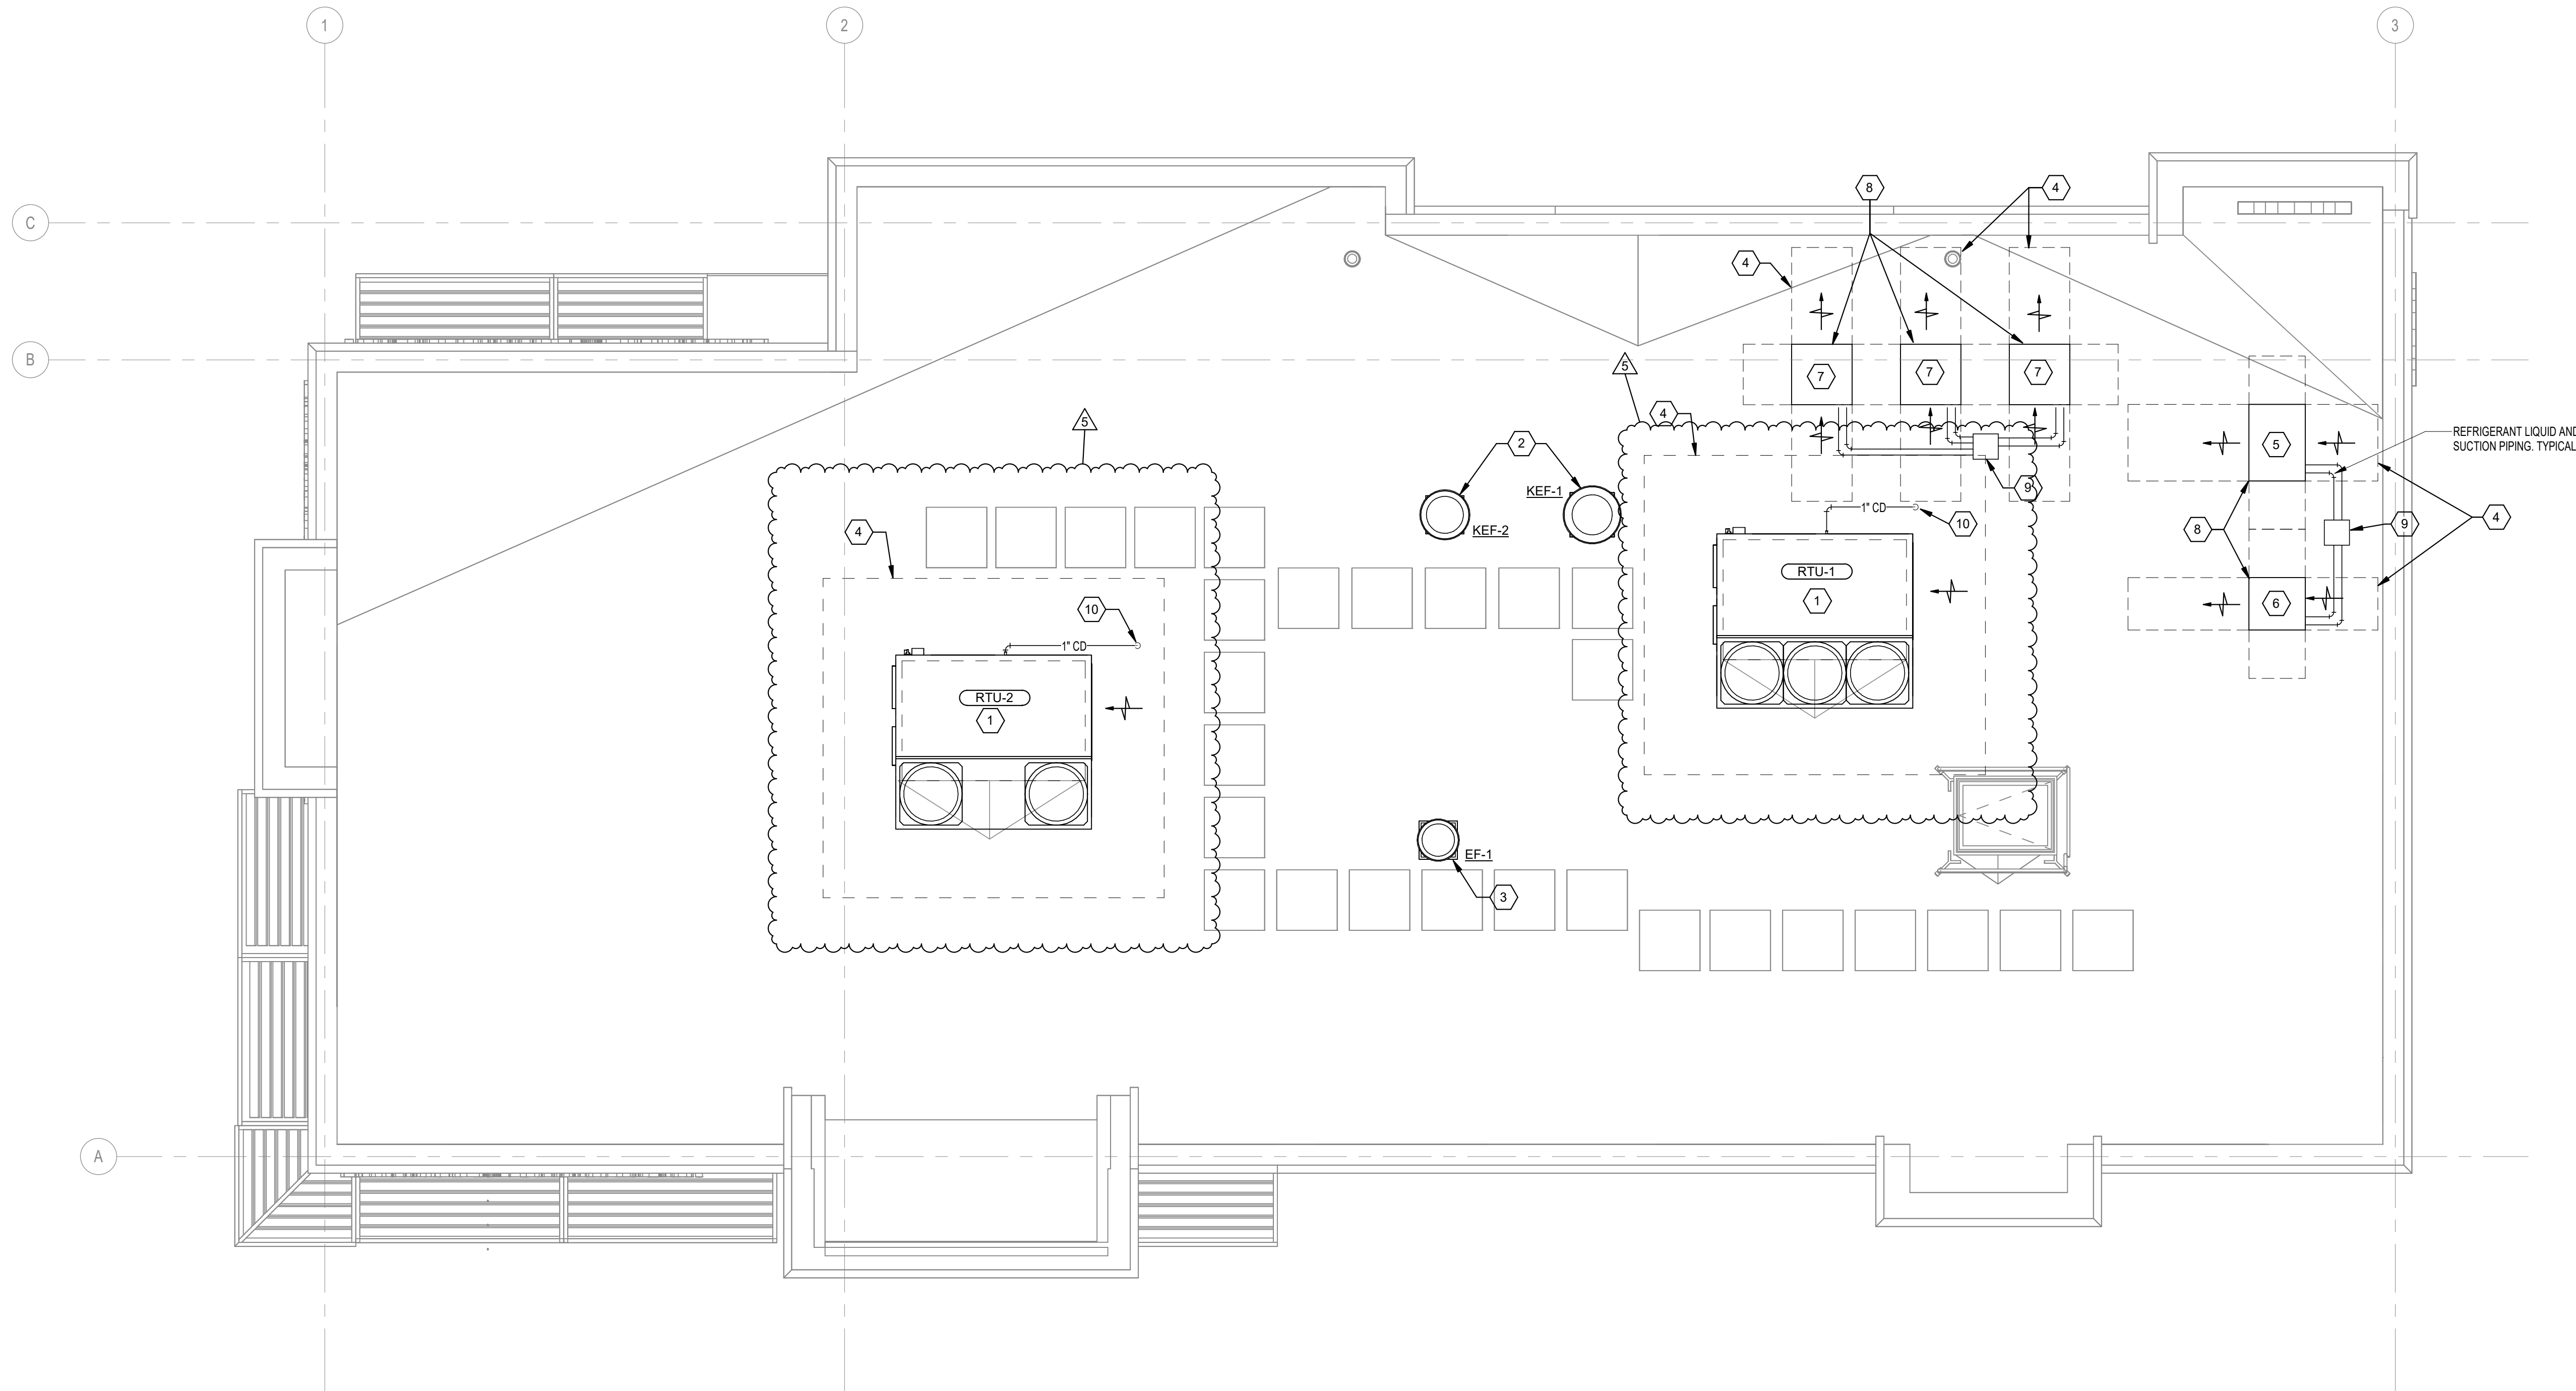

PREPARED FOR:



3420 Torrington Way, Ste 210
 Charlotte, NC 28227
 (704) 565-7070
 (203) 630-2615 Fax


© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version

09.30.2024 2024 Q3 PT22M Prototype Release

△ Date Description

- | △ Date | Description |
|--------------|-----------------------------|
| 1 03/31/2025 | PERMIT COMMENTS |
| 5 09/12/2025 | MECHANICAL EQUIPMENT UPDATE |

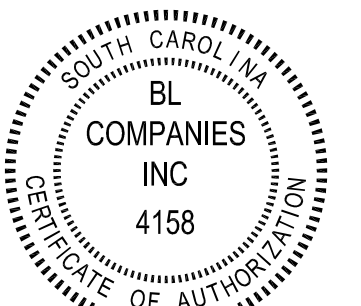

Seal / Signature

Project Name

WHATABURGER ROCK HILL, SC

Date: 12.20.2024

Project Number


2400234

Description

MECHANICAL ROOF PLAN

Scale


1/4" = 1'-0"




M2.1

M1 MECHANICAL ROOF PLAN
 1/4" = 1'-0"

TONS	DRAIN SIZE
UP TO 40	1"
UP TO 90	1-1/4"
UP TO 125	1-1/2"

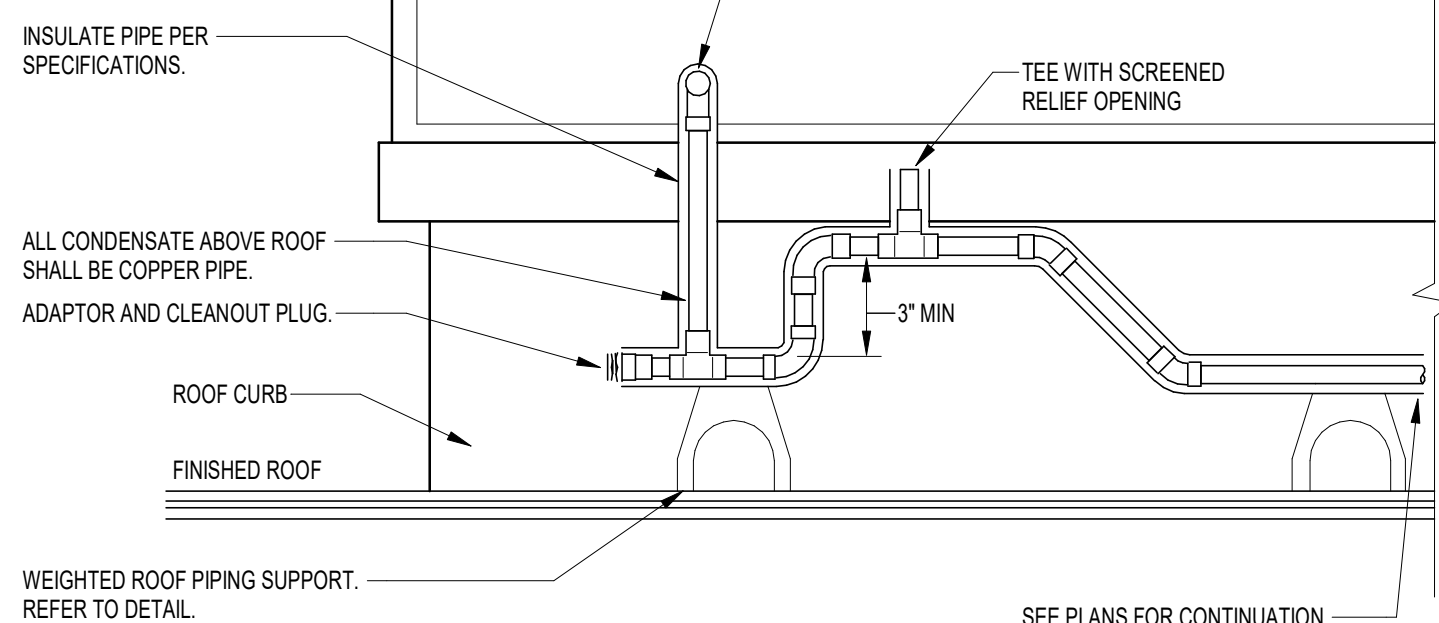


C1 RTU CONDENSATE DRAIN DETAIL
N.T.S.

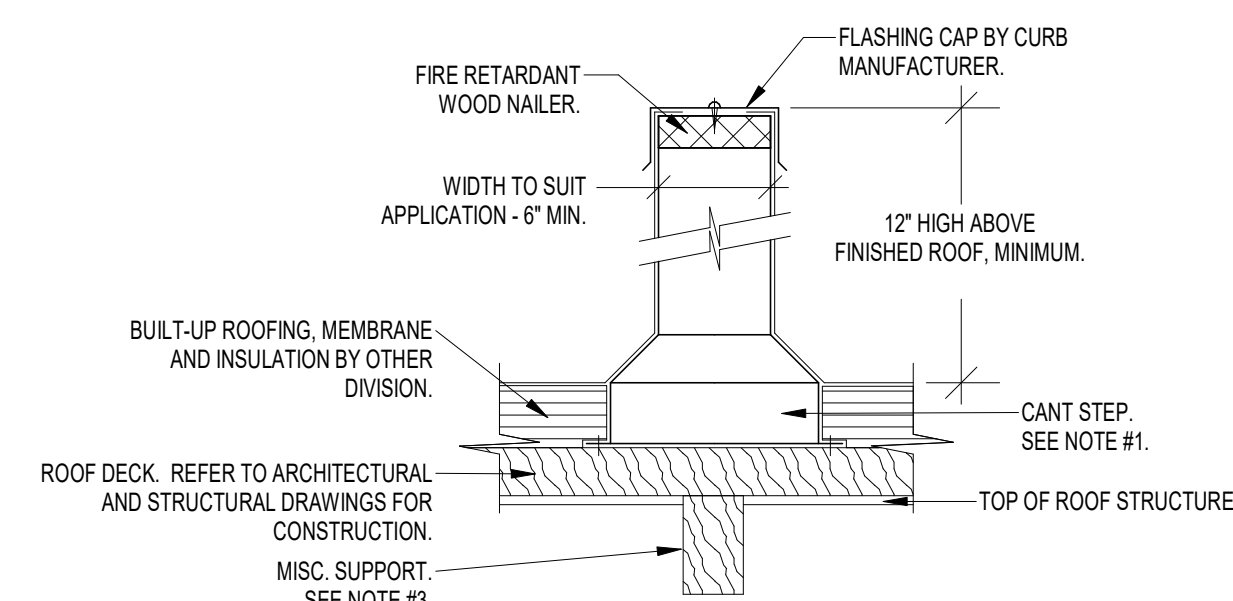

NOTES:

- THE RAISED CANT STEP HEIGHT SHALL BE COORDINATED WITH THICKNESS OF ROOF INSULATION ON ARCHITECTURAL DRAWINGS AND WITH THE ROOFING CONTRACTOR. SECURE RAIL TO THE ROOF DECK WITH LOAD RATED, RUST RESISTANT FASTENERS.
- THE RAIL SHALL BE DESIGNED AND FABRICATED TO THOROUGHLY SUPPORT ITS RESPECTIVE COMPONENT. AS A MINIMUM, RAILS SHALL BE FABRICATED OF 18 GAUGE GALVANIZED STEEL WITH BUILT-IN CANT. MONOLITHIC CONSTRUCTION WITH INTEGRAL BASE PLATE AND CONTINUOUS MITERED AND WELDED CORNER SEAMS, WITH FACTORY INSTALLED FIRE RETARDANT WOOD NAILER. EACH RAIL SHALL INCLUDE A MATCHING 18 GAUGE GALVANIZED STEEL COUNTERFLASHING CAP WITH INTEGRAL DRIP EDGE. ALL CORNERS MITERED AND WELDED, AND SCREWS FOR ATTACHMENT. EQUIPMENT CURBS OVER 3 FEET LONG SHALL INCORPORATE 1/4\"/>


C2 ROOFTOP CONDENSING UNIT SUPPORT RAILS
N.T.S.

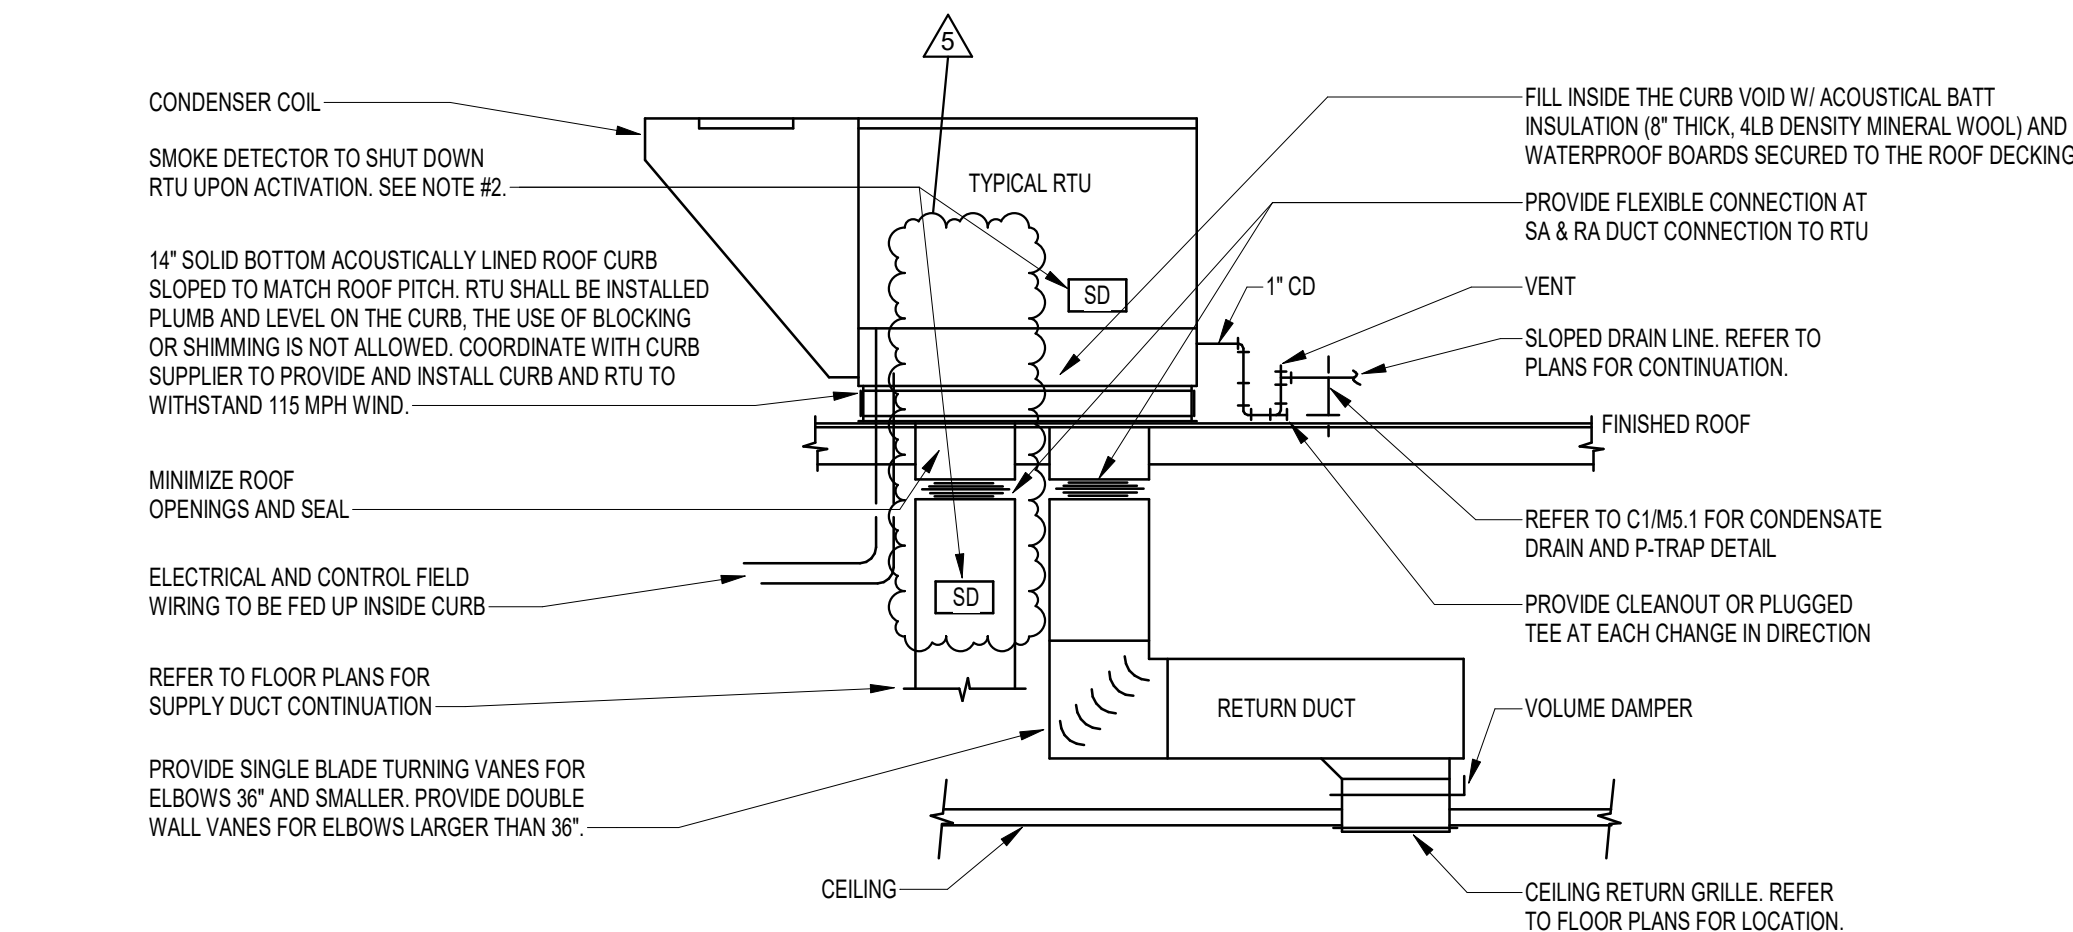

NOTES:


- DIMENSIONS OF CURB DIFFER FROM DIMENSIONS OF UNIT DUE TO THE SLOPED CONDENSER COIL.
- SMOKE DETECTORS SHALL BE PROVIDED AND INSTALLED BY THE RTU MANUFACTURER IN THE SUPPLY AND RETURN SIDES OF RTU. COORDINATE INSTALLATION AND CONNECTION OF SMOKE DETECTORS WITH FA CONTRACTOR, EC, AND GC. REFERENCE M6.1 FOR RTU SCHEDULE. ACTIVATION OF SMOKE DETECTORS SHALL SHUT DOWN RTU AND ACTIVATE THE AUDIBLE AND VISUAL SIGNAL PROVIDED.

C3 ROOFTOP HVAC UNIT DETAIL
N.T.S.

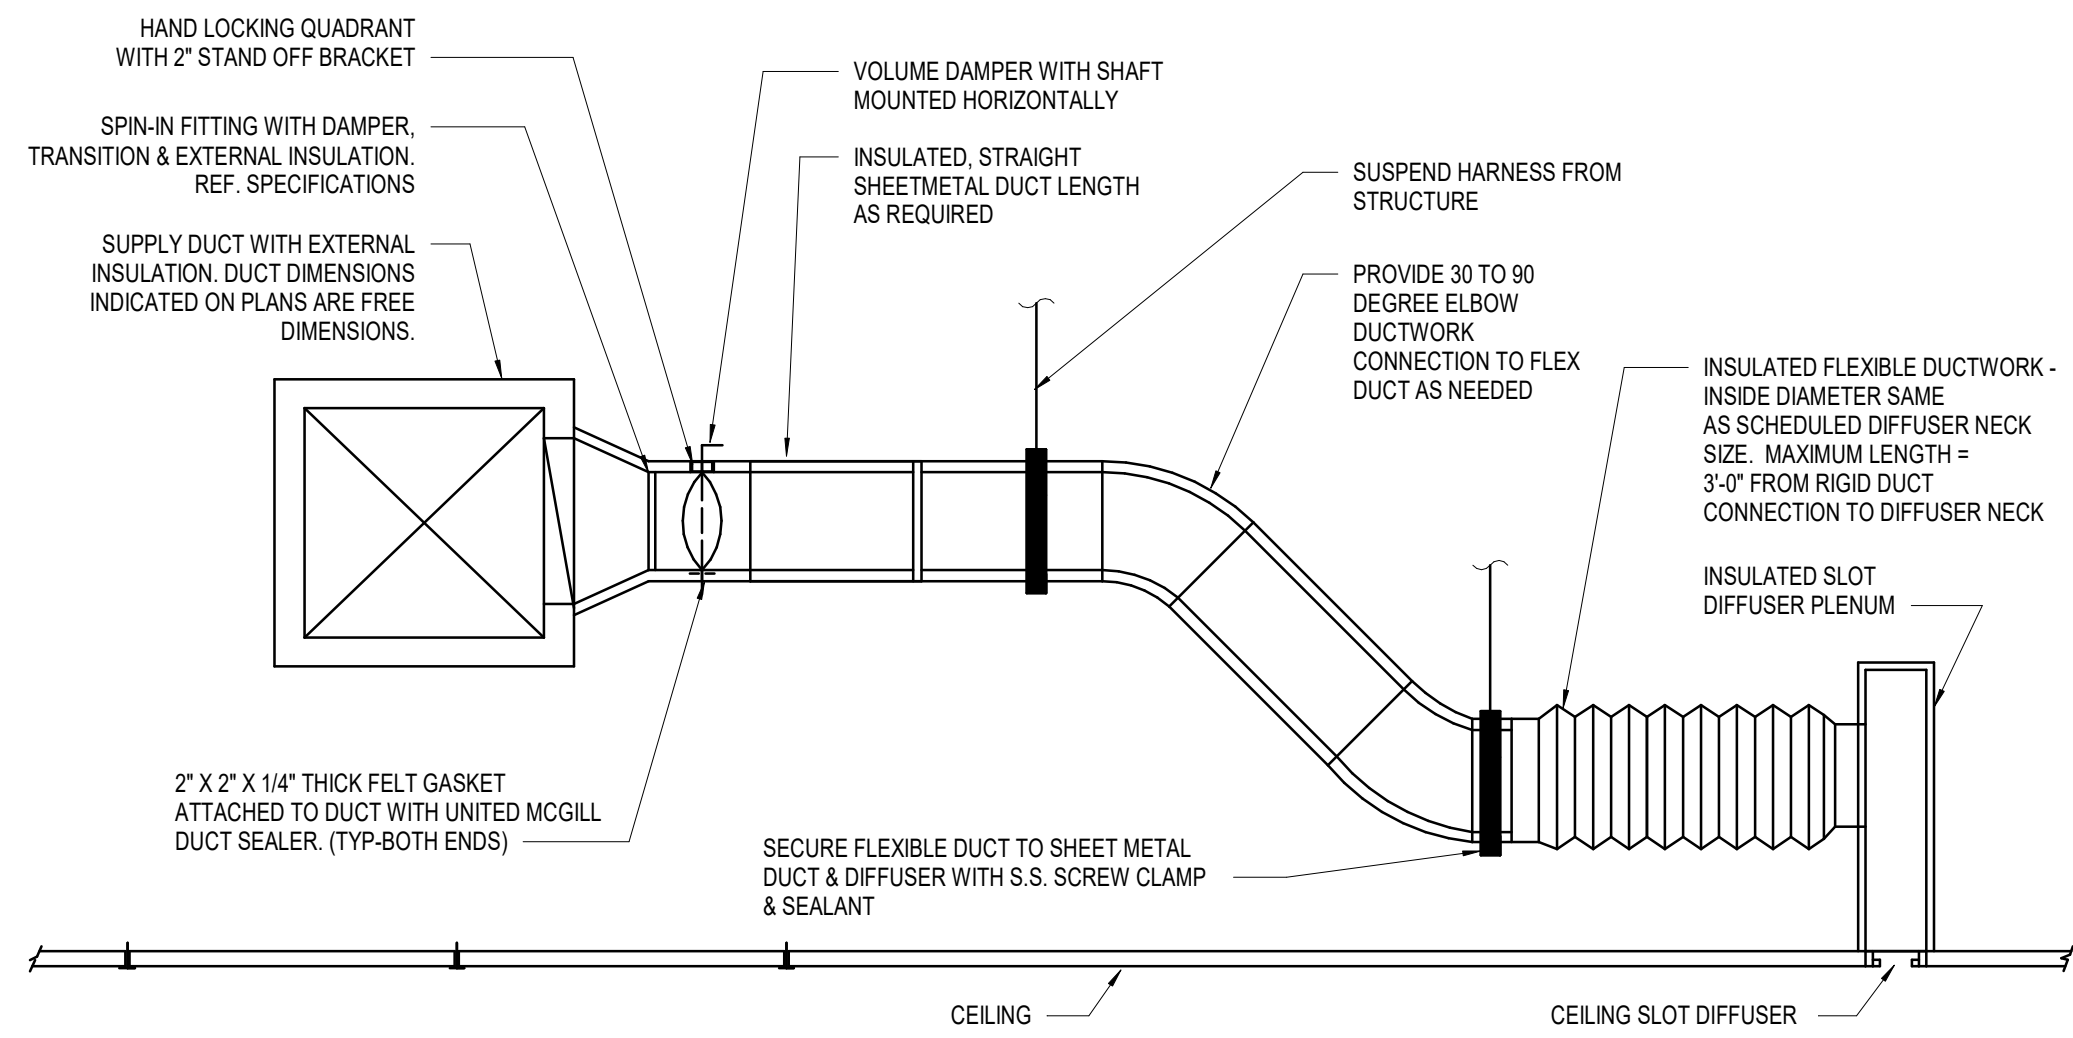


NOTE: INSTALL FLEXIBLE DUCTWORK SUPPORTS AT ALL ROUND NECK OUTLETS/INLETS UNLESS OTHERWISE NOTED ON DRAWINGS.


B1 PLENUM SLOT DIFFUSER DETAIL
N.T.S.

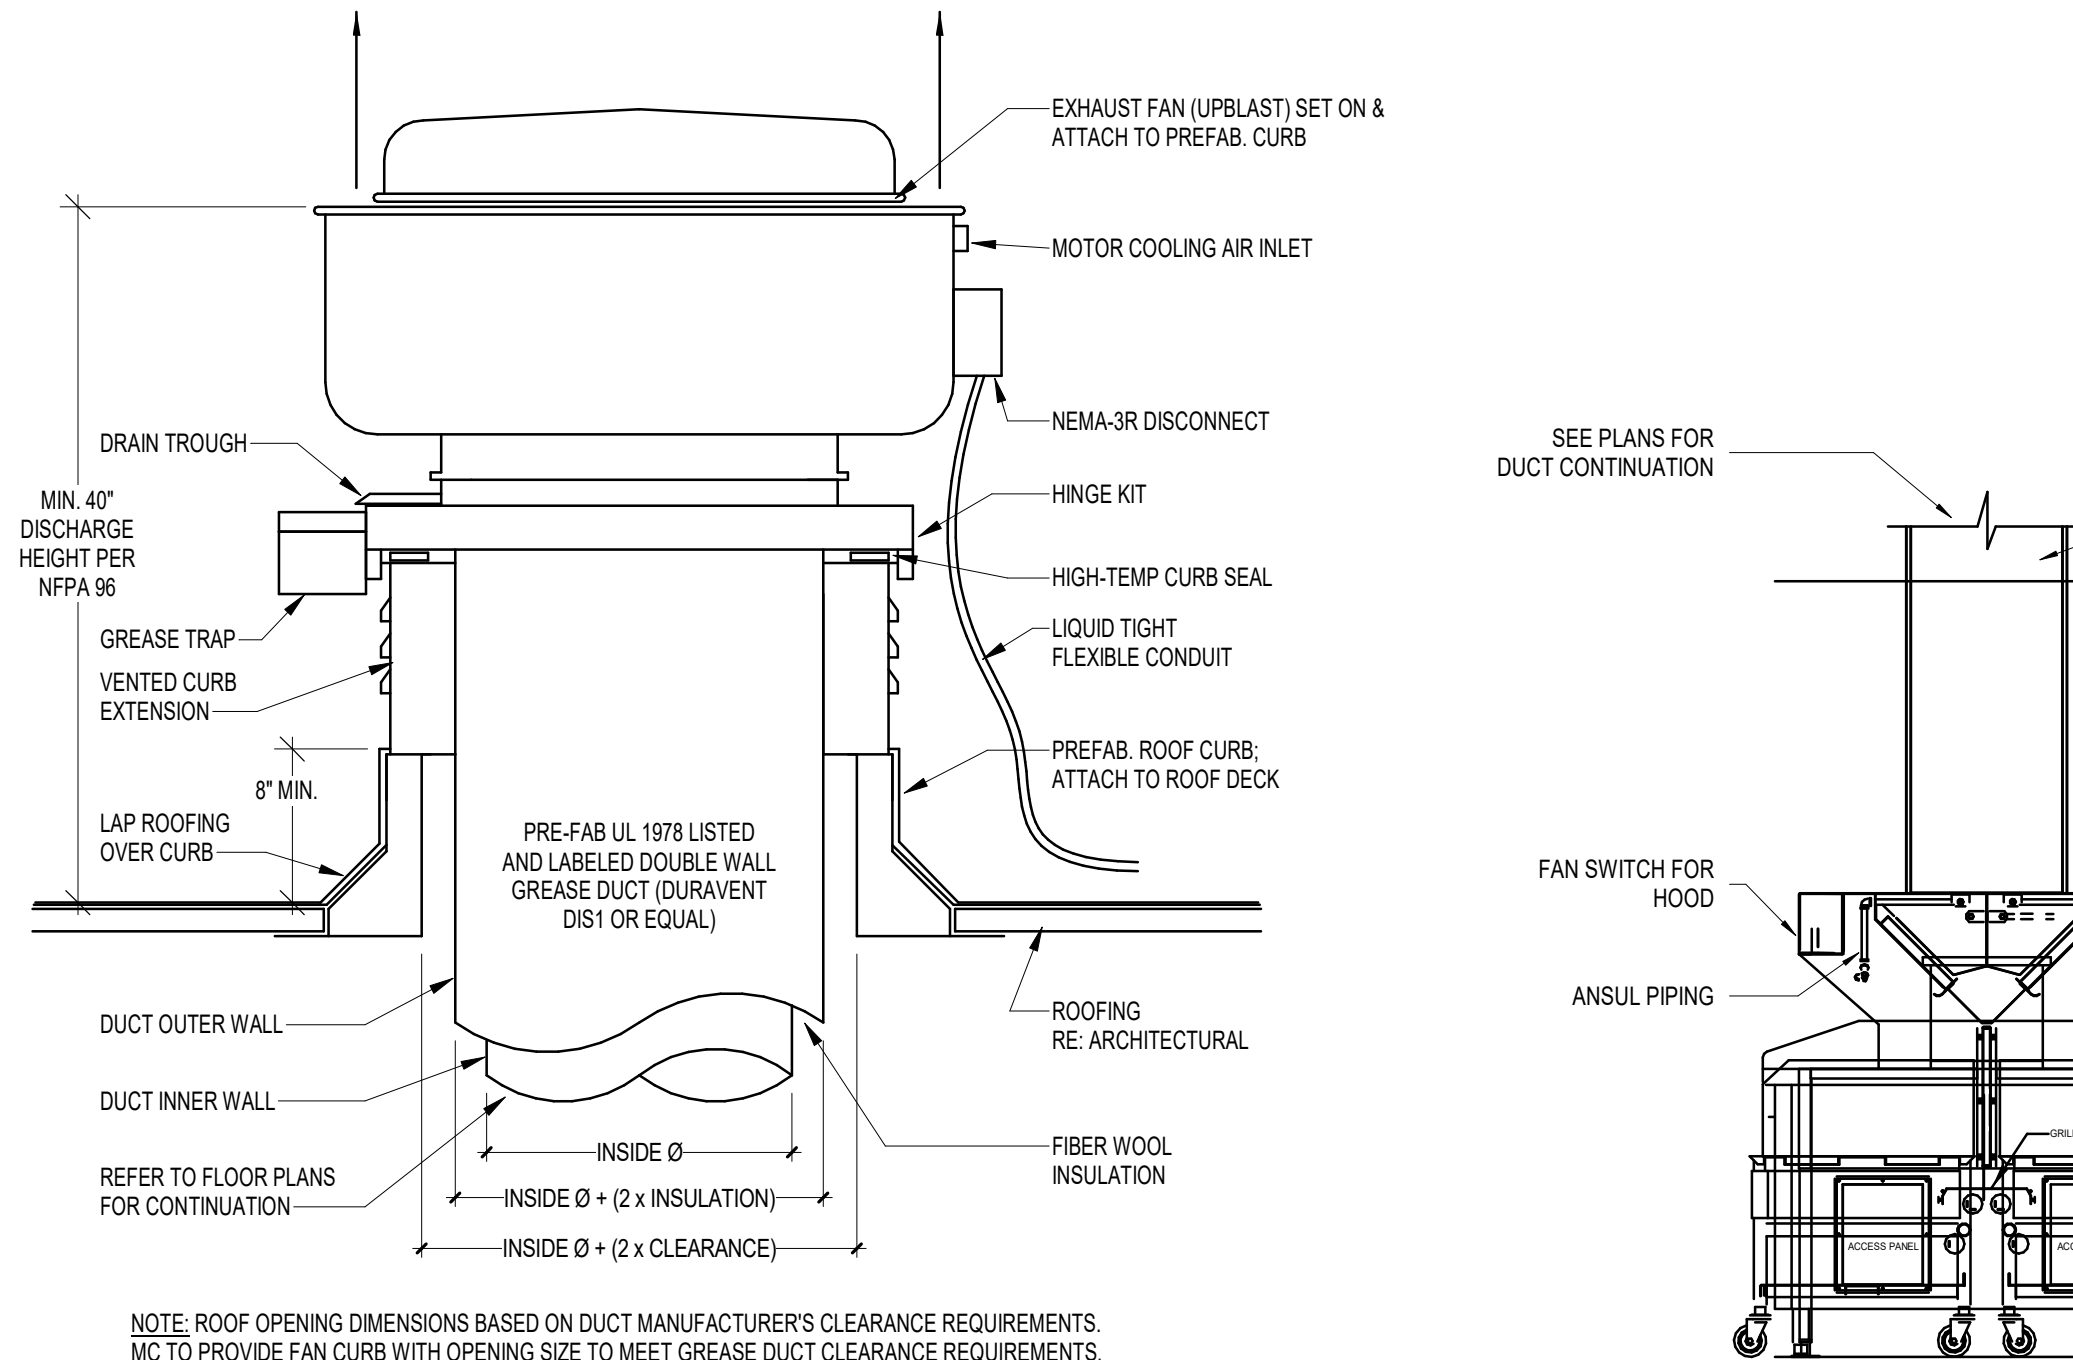


A2 ROOFTOP GREASE EXHAUST FAN DETAIL
N.T.S.

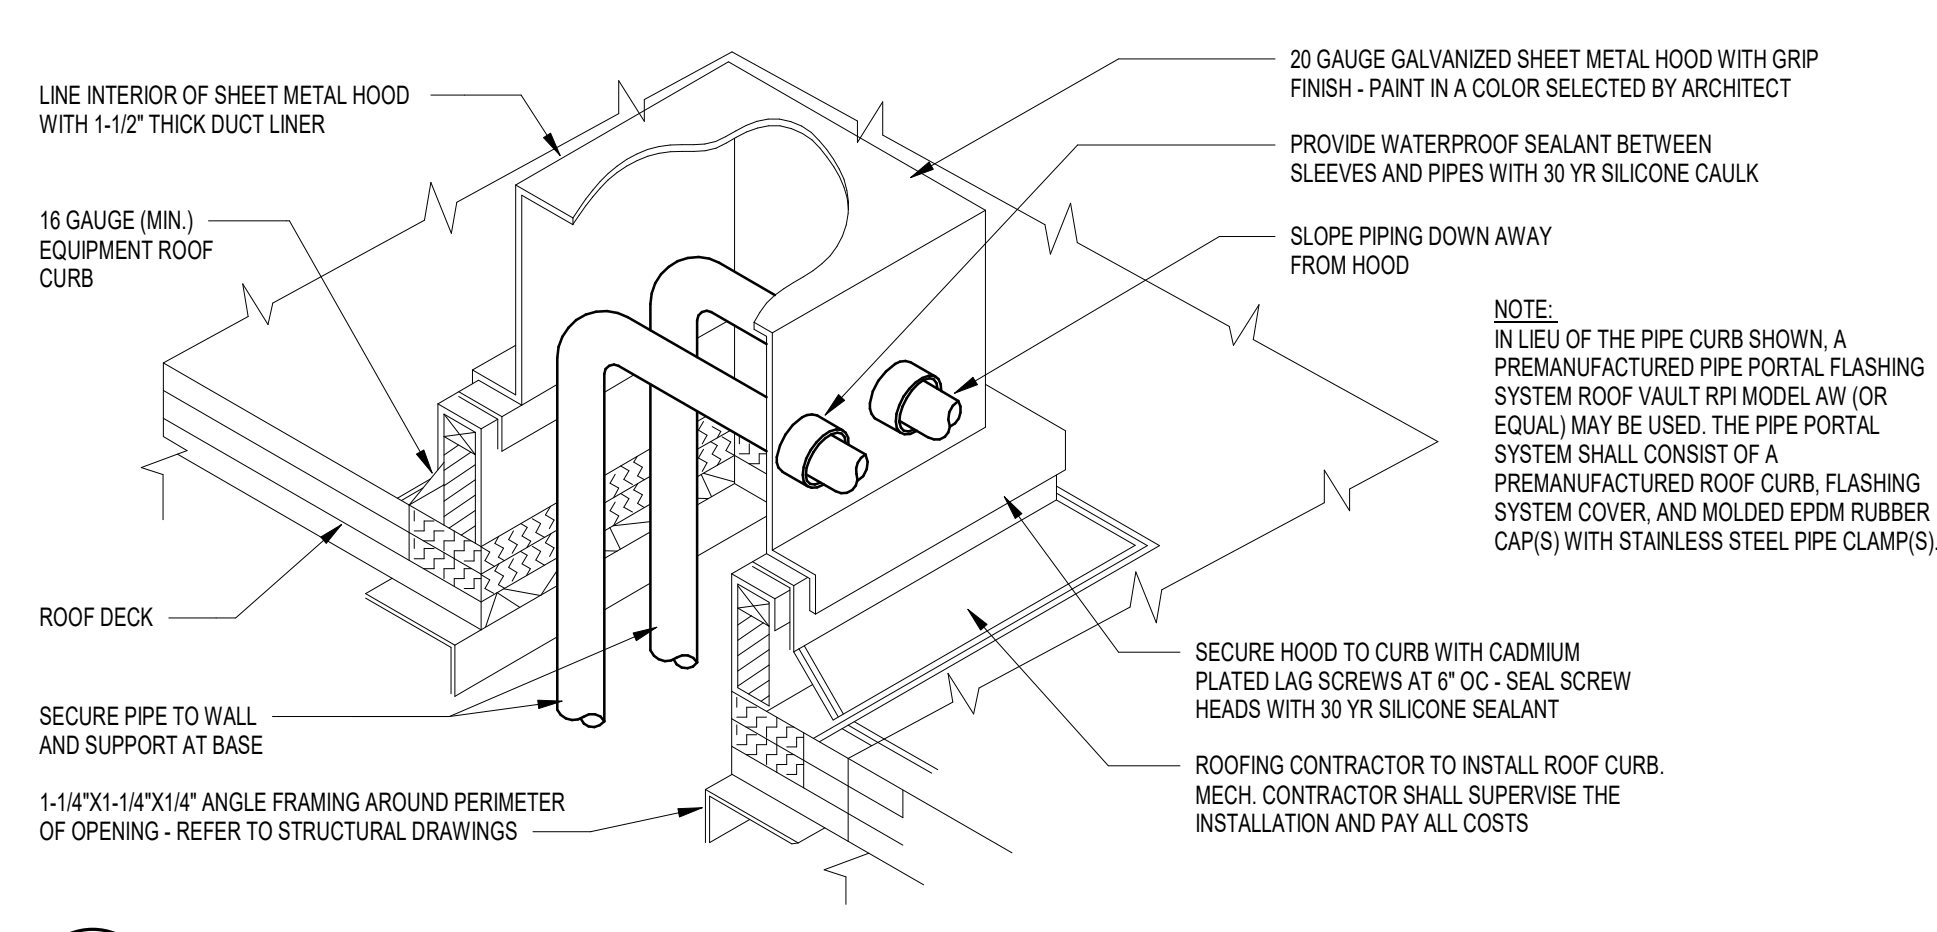


C4 PIPING THROUGH ROOF DETAIL
N.T.S.

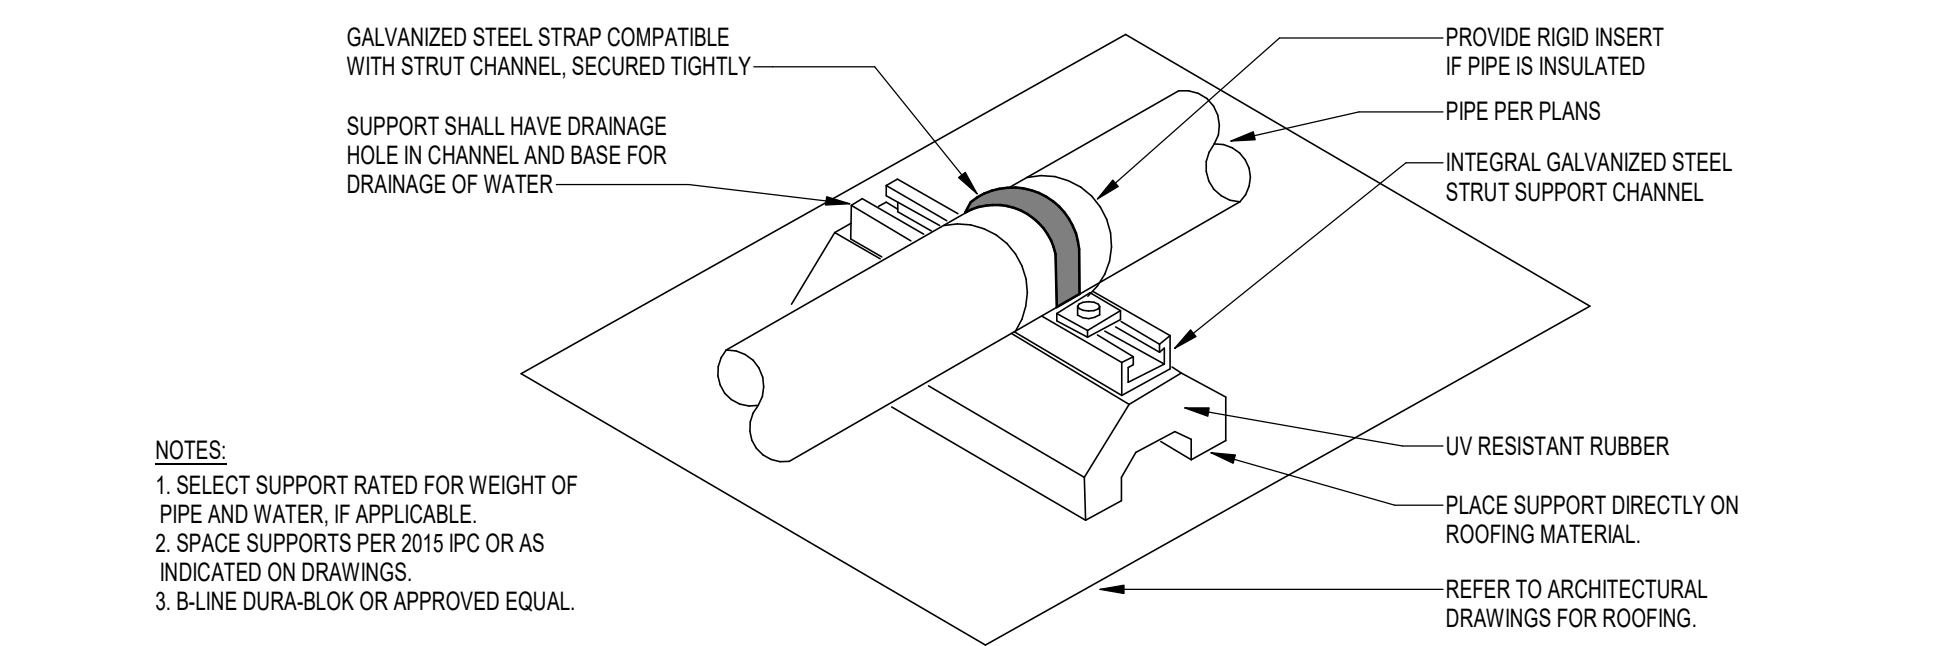


C5 ROOFTOP PIPE SUPPORT DETAIL
N.T.S.

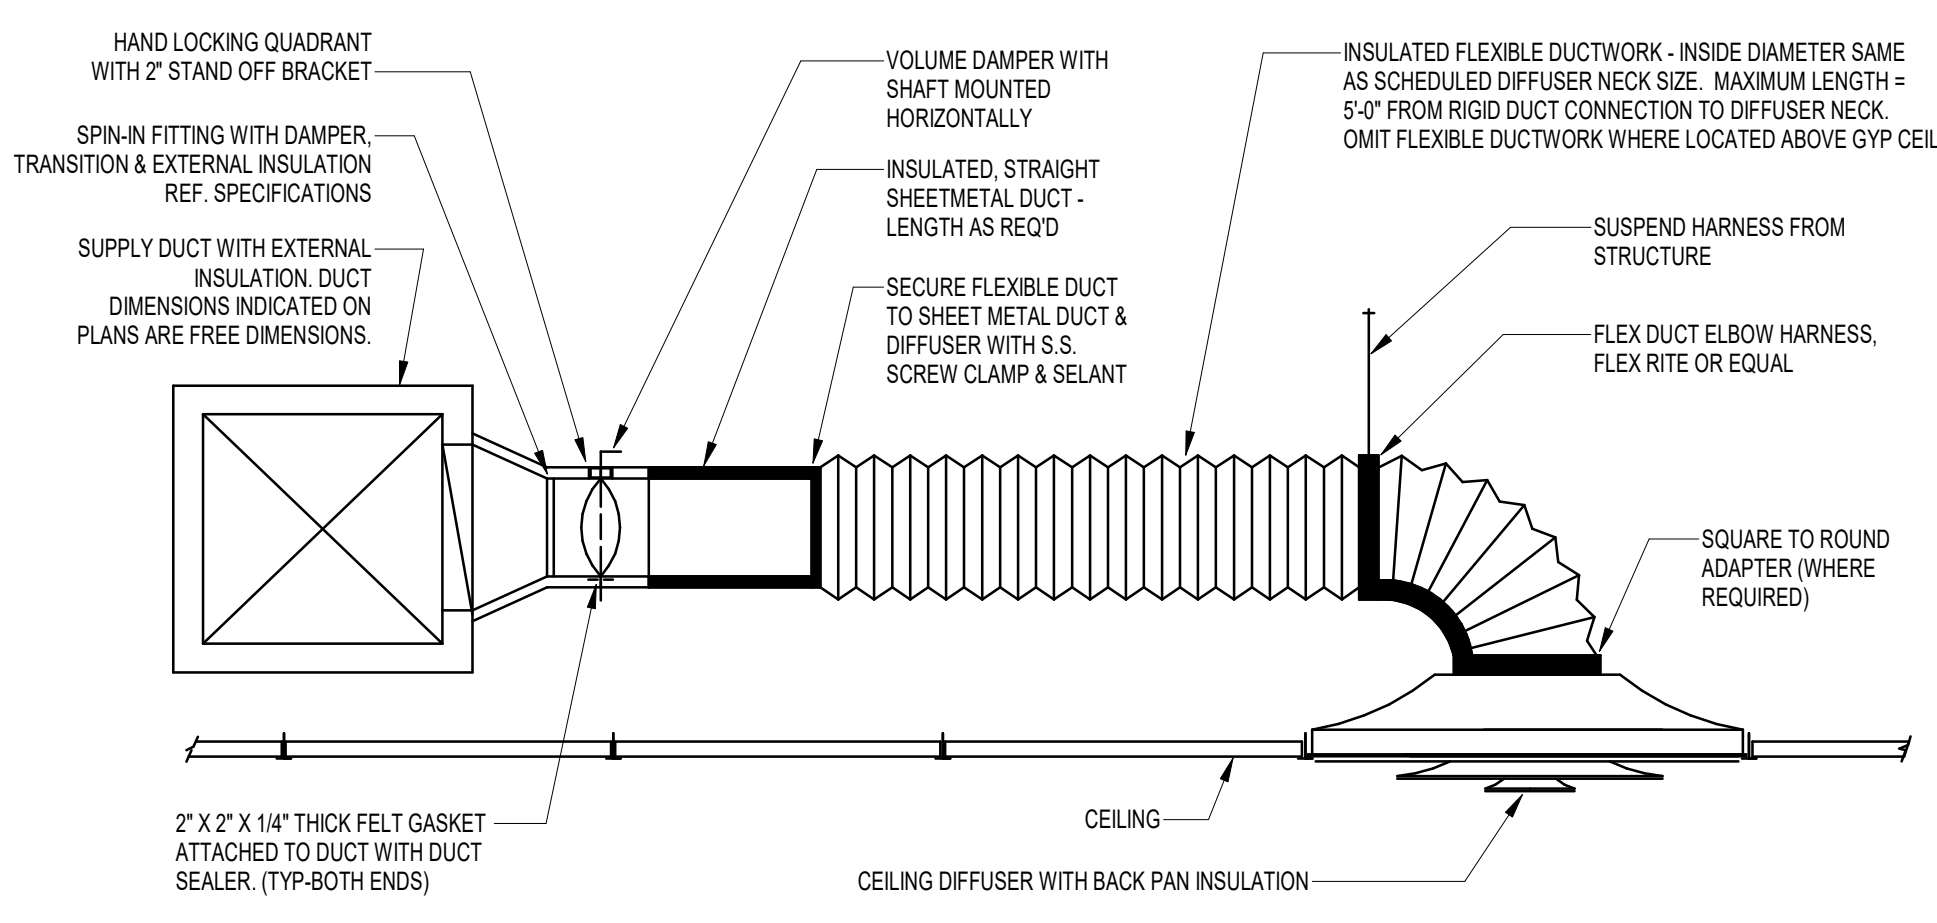

B2 DIFFUSER CONNECTION DETAIL
N.T.S.

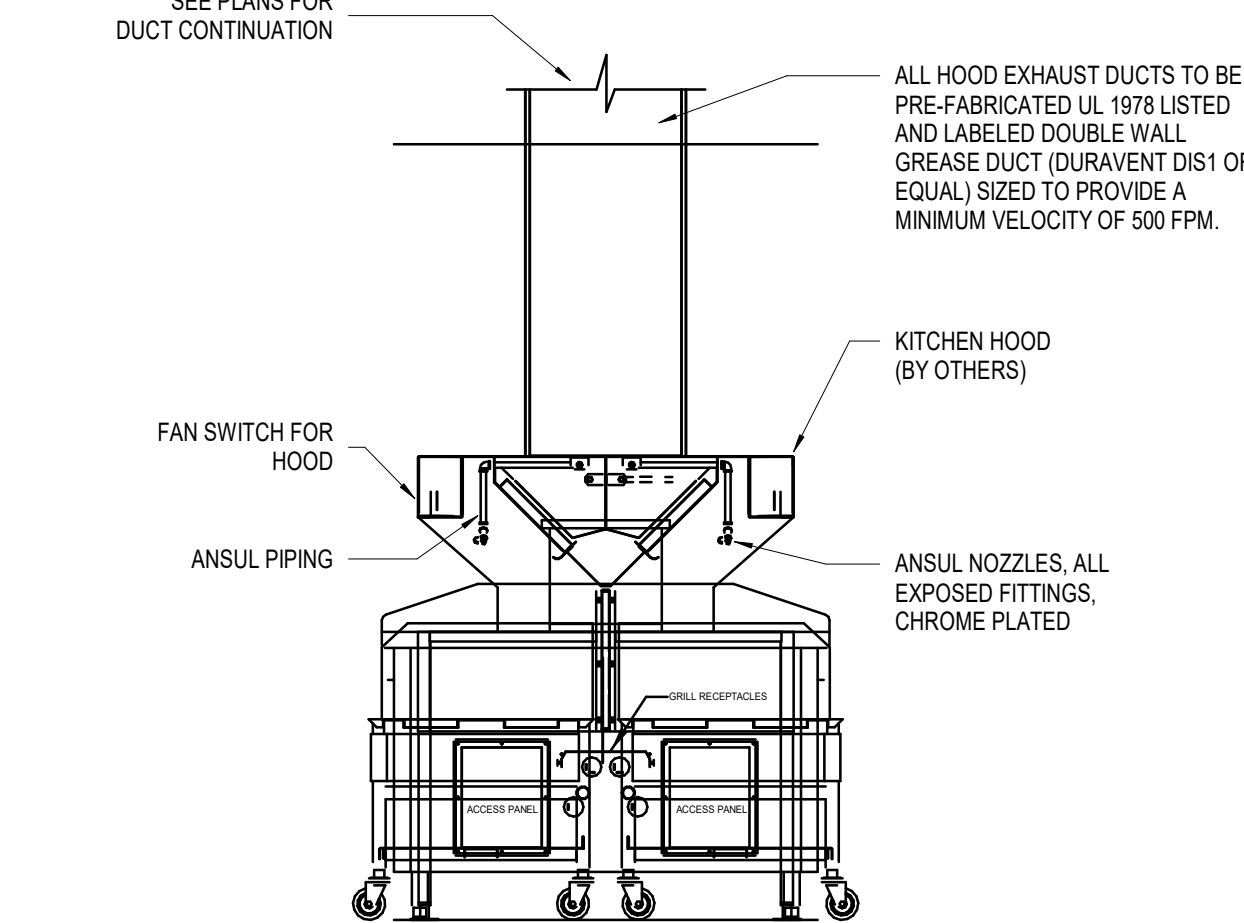

A3 LOW PROFILE HOOD DETAIL
N.T.S.

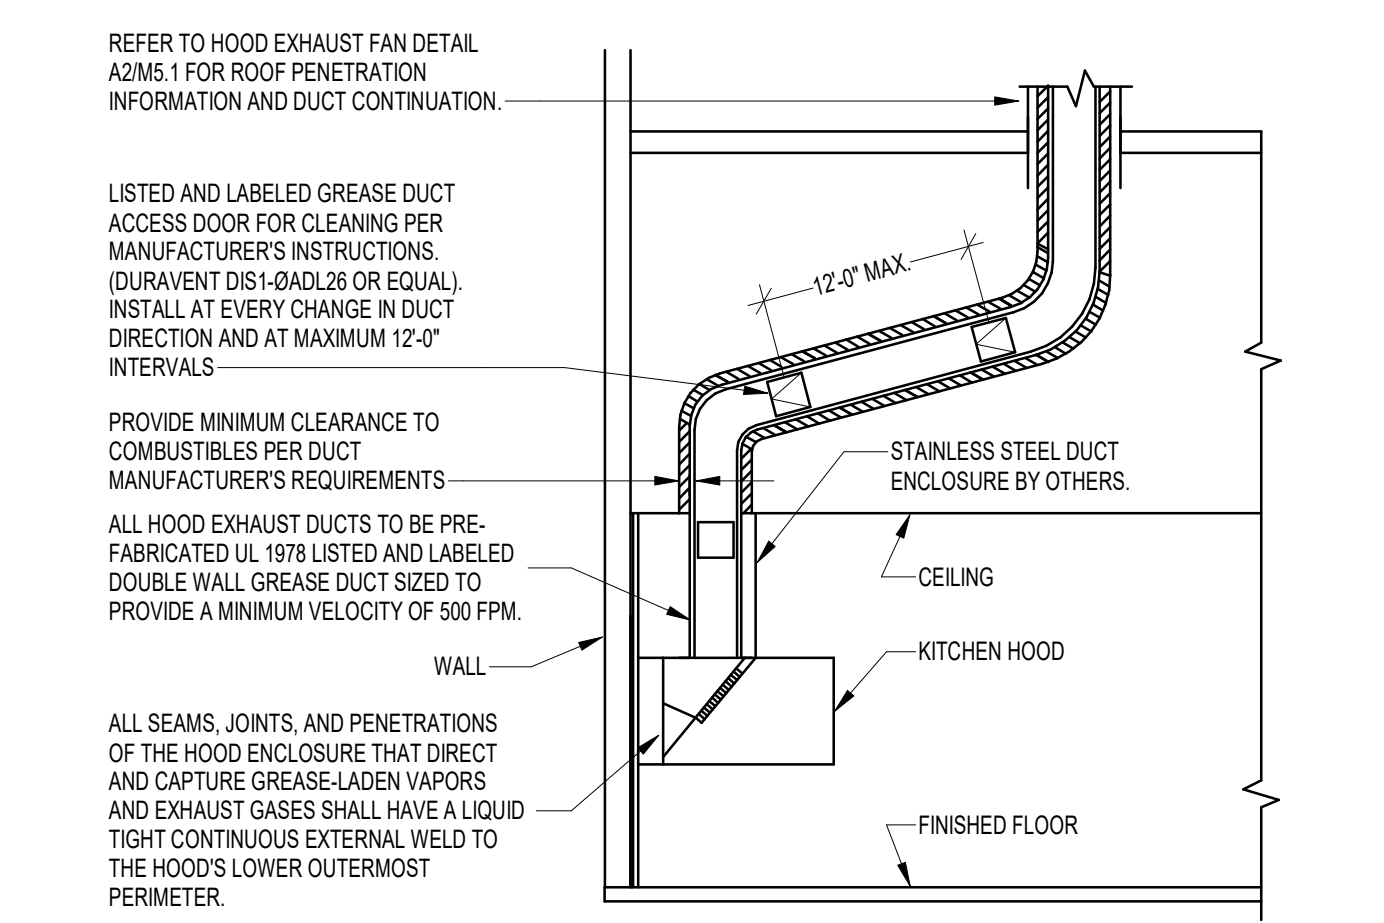

A4 HOOD EXHAUST DUCT DETAIL
N.T.S.

A1 ROOF MOUNTED EXHAUST FAN AND CURB DETAIL
N.T.S.



© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Date	Description
09/30/2024	2024 Q3 PT22M Prototype Release
09/12/2025	MECHANICAL EQUIPMENT UPDATE



Seal / Signature

Project Name	WHATABURGER ROCK HILL, SC
Date:	12.20.2024
Project Number	2400234
Description	MECHANICAL DETAILS

Scale
NOT TO SCALE

M5.1

ROOFTOP UNIT SCHEDULE

MARK	MANUFACTURER	MODEL	AREA SERVED	SUPPLY FAN					COOLING SECTION					HEATING SECTION					ELECTRICAL				FILTER TYPE	WEIGHT INCL. CURB (LBS)	NOTES							
				TOTAL SUPPLY CFM	OUTSIDE AIR CFM	RETURN AIR CFM	ESP (\"WG)	HP	TYPE	REFRIG. TYPE	AMBIENT (°F) DB/WB	TOTAL OUTPUT (MBH)	SENS. OUTPUT (MBH)	MAT (°F) DB/WB	LAT (°F) DB/WB	IEER / ISMRE2	HOT GAS REHEAT (MBH)	TYPE	AMBIENT (°F) DB/WB	INPUT (MBH)	OUTPUT (MBH)	STAGES				GAS PRESS. MIN / MAX (\" WC)	MAT (°F) DB/WB	LAT (°F) DB/WB	VOLTS	PH	MCA	MOP
RTU-1	CAPTIVEAIRE	CAS-HVAC3-1300-20-20T	KITCHEN	3850	2460	1390	1.0	5.0	DX	R-454B	94.777.9	256.1	136.5	87.472.8	50.150.1	18.2/7.9	88.7	NAT. GAS	20.3	273.5	221.5	6.1	7.0/14.0	37.1	87.1	208	3	96.7	110	2\" MERV 8	2808	ALL
RTU-2	CAPTIVEAIRE	CAS-HVAC3-1200-15-15T	DINING	2050	1560	500	1.0	2.0	DX	R-454B	94.777.9	196.3	86.5	89.874.5	49.349.1	18.8/8.3	48.1	NAT. GAS	20.3	192.0	155.5	6.1	7.0/14.0	31.5	96.5	208	3	66.3	70	2\" MERV 8	2604	ALL

NOTES:

- PROVIDE WITH PREMIUM EFFICIENCY MOTORS IN ACCORDANCE WITH NEMA MG-1. PROVIDE SUPPLY FAN VFD.
- PROVIDE WITH FACTORY INSTALLED RETURN AIR SMOKE DETECTOR AND FIELD INSTALLED SUPPLY AIR SMOKE DETECTOR TO SHUT DOWN UNIT UPON SMOKE DETECTION. COORDINATE CONNECTIONS TO FIRE ALARM SYSTEM WITH FA CONTRACTOR AND GC.
- PROVIDE WITH TERMINAL STRIP FOR FIELD INSTALLED CONTROLS.
- UNITS TO BE 2\" DOUBLE WALL R-13 CONSTRUCTION WITH 2500-HOUR SALT SPRAY RESISTANT PAINT.
- UNIT TO HAVE MODULATING HOT GAS REHEAT WITH SPACE DEWPOINT CONTROL. INTAKE AND DISCHARGE TEMPERATURE SENSORS SHALL BE FACTORY INSTALLED. PROVIDE FIRESTAT AND FREEZESTAT.
- PROVIDE FACTORY INSTALLED HAIL GUARDS.
- PROVIDE VARIABLE SPEED COMPRESSORS, ECM CONDENSING FANS, ELECTRONIC EXPANSION VALVE, HIGH/LOW REFRIGERATION PRESSURE MONITORING, AND REFRIGERANT LEAK DETECTOR.
- PROVIDE STAINLESS STEEL DRAIN PAN AND FACTORY MOUNTED AND WIRED CONDENSATE FLOW SWITCH.
- PROVIDE LOW LEAKAGE ECONOMIZER WITH DIFFERENTIAL ENTHALPY CONTROL, BAROMETRIC RELIEF DAMPER, AND FAULT DETECTION AND DIAGNOSTIC.
- PROVIDE STAINLESS STEEL GAS HEAT EXCHANGER WITH MODULATING CONTROL AND PRESSURE GAUGE.
- PROVIDE FACTORY NON-FUSED DISCONNECT SWITCH AND POWERED GFD CONVENIENCE RECEPTACLE. COORDINATE WITH EC.
- DOWN DISCHARGE AND DOWN RETURN. PROVIDE 14\" HIGH INSULATED, SOLID BOTTOM CURB FOR PITCHED ROOF. MECHANICAL CONTRACTOR TO FIELD CUT SUPPLY AND RETURN OPENINGS AS REQUIRED.
- PROVIDED CLOGGED FILTER SWITCH AND LOUVERED OUTDOOR AIR INTAKE WITH METAL MESH FILTERS.
- CAPTIVEAIRE UNITS PROVIDED BY WHATABURGER. FACTORY STARTUP IS INCLUDED. CONTACT BRADLEY CANNAN @ 210-647-7244 OR bradley.cannan@captivaire.com TO COORDINATE STARTUP.

HVAC KITCHEN HOOD SCHEDULE

MARK	MANUFACTURER	MODEL	DESCRIPTION	EXHAUST VENT DIAMETER	EXHAUST AIRFLOW (CFM)	TYPE
KH-1	H&K DALLAS INC.	CUSTOM	8\" DOUBLE SIDED GRILL HOOD	16\"	1994	TYPE I
KH-2	H&K DALLAS INC.	CUSTOM	10-BASKET FRYER HOOD	12\"	1216	TYPE I

NOTES:

- EQUIPMENT MANUFACTURER SHALL PROVIDE ALL HANGING MATERIALS FOR KITCHEN HOOD.

EXHAUST FAN SCHEDULE

MARK	MANUFACTURER	MODEL	TYPE	AIRFLOW (CFM)	TSP (\"WG)	RPM	BHP	HP	DRIVE TYPE	VOLTS	PH	WEIGHT (LBS.)	NOTES
EF-1	GREENHECK	G-080-VG	ROOF-MOUNTED CENTRIFUGAL DOWNBLAST	300	0.50	1680	0.07	0.10	DIRECT	120	1	44	1.2.3
KEF-1	GREENHECK	CLUE-140-VG	ROOF-MOUNTED CENTRIFUGAL UPBLAST	1994	1.00	1517	0.64	1.00	DIRECT	208	1	148	3.4.5.6
KEF-2	GREENHECK	CLUE-120-VG	ROOF-MOUNTED CENTRIFUGAL UPBLAST	1216	0.75	1415	0.25	0.50	DIRECT	208	1	115	3.4.5.6

NOTES:

- PROVIDE INSULATED 18\" HIGH ROOF CURB WITH DAMPER TRAY AND MOTORIZED DAMPER WITH END SWITCHES AND SPRING RETURN ACTUATOR.
- PROVIDE ALUMINUM BIRD SCREEN.
- PROVIDE WITH INTEGRAL DISCONNECT SWITCH NEMA-3R.
- PROVIDE GREASE BOX.
- PROVIDE INSULATED AND VENTED 24\" HIGH ROOF CURB AND HIGH TEMPERATURE CURB SEAL.
- PROVIDE HINGED ACCESS KIT.

FLEX DUCT SCHEDULE

CFM RANGE	SIZE (DIAMETER)
< 50	5
51 - 100	6
101 - 250	8
251 - 400	10
401 - 650	12
651 - 900	14
901 - 1300	16
1301 - 1800	18
1800 - 2300	20

NOTES:


- ALL FLEX DUCT SHALL BE SIZED IN ACCORDANCE WITH FLEX DUCT SCHEDULE. PROVIDE RIGID REDUCER AT NECK OF AIR DEVICE TO TRANSITION FROM FLEX DUCT SIZE TO DIFFUSER INLET CONNECTION SIZE. FLEX DUCT LENGTH NOT TO EXCEED 5 FT.

AIR DEVICE SCHEDULE

MARK	MANUFACTURER	MODEL	FACE SIZE (IN.)	NECK SIZE (IN.)	MAX NC	PATTERN	MOUNTING	SLOT LENGTH	SLOT WIDTH	SLOT QTY	SYSTEM CLASS	COMMENTS
A1	TITUS	TMS	24x24	6	30	4-WAY	LAY-IN	-	-	-	SUPPLY AIR	1
A2	TITUS	TMS	24x24	8	30	4-WAY	LAY-IN	-	-	-	SUPPLY AIR	1
A3	TITUS	TMS	24x24	10	30	4-WAY	LAY-IN	-	-	-	SUPPLY AIR	1
A4	TITUS	TMS	24x24	12	30	4-WAY	LAY-IN	-	-	-	SUPPLY AIR	1
A5	TITUS	TMS	24x24	12	30	3-WAY	LAY-IN	-	-	-	SUPPLY AIR	1
B1	TITUS	TMS	12x12	6	30	4-WAY	FLANGE	-	-	-	SUPPLY AIR	1.2
C1	TITUS	350FL1	22x22	18x18	30	-	FLANGE	-	-	-	RETURN AIR	2.5
C2	TITUS	350FL1	24x24	20x20	30	-	LAY-IN	-	-	-	RETURN AIR	5
F1	TITUS	50F	12x12	8x8	30	-	FLANGE	-	-	-	EXHAUST AIR	2
H1	TITUS	TBDI-30	48x1-34	6	30	2-WAY	FLANGE	48	3/4	1	SUPPLY AIR	3
H2	TITUS	TBDI-80	48x5	8	30	2-WAY	FLANGE	48	1-1/2	2	SUPPLY AIR	3
H3	TITUS	TBDI-80	36x7-12	8	30	2-WAY	FLANGE	36	1-1/2	3	SUPPLY AIR	3
L1	TITUS	FL-15-JT	SEE PLANS	-	30	1-WAY	FLANGE	CONTINUOUS	1-1/2	1	SUPPLY AIR	4
P1	TITUS	FBPI	60 X 3-1/2	6	30	-	FLANGE	60	-	-	SUPPLY AIR	3

NOTES:

- PROVIDE MOLDED INSULATION BLANKET (R-6).
- PROVIDE PLASTER FRAME FOR MOUNTING IN GYP. CEILING.
- PROVIDE INSULATED PLENUM.
- CONTINUOUS LINEAR SLOT DIFFUSER TO BE INSTALLED IN GYP. CEILING. PROVIDE INSULATED SUPPLY AIR PLENUMS AS SCHEDULED FOR A COMPLETE SYSTEM.
- PROVIDE 1\" MERV-5 FILTER.

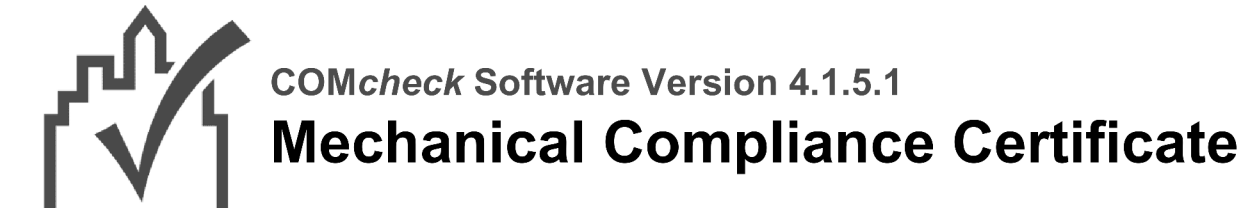

Section 1: Project Information

Energy Code: 2009 IECC
 Project Title: Whataburger
 Project Type: New Construction

Construction Site: 2265 Cross Pointe Dr, Rock Hill, SC 29730
 Owner/Agent: Whataburger
 Designer/Contractor: BL Companies, Inc., 355 Research Parkway, Meriden, CT 06450

Section 2: General Information

Building Location (for weather data): Rock Hill (York), South Carolina
 Climate Zone: 3a

Section 3: Mechanical Systems List

Quantity System Type & Description

1 RTU-1 (Single Zone): Heating: 1 each - Central Furnace, Gas, Capacity = 274 kBtu/h. Proposed Efficiency = 81.00% Ee, Required Efficiency: 80.00 % Ee. Cooling: 1 each - Single Package DX Unit, Capacity = 256 kBtu/h, Air-Cooled Condenser, Air Economizer. Proposed Efficiency = 12.20 EER, Required Efficiency: 9.80 EER + 9.5 IPLV. Fan System: FAN SYSTEM 1 | RTU-1 - Compliance (Motor nameplate HP method) : Passes. Fans: FAN 1 Supply, Constant Volume, 3850 CFM, 5.0 motor nameplate hp.

1 RTU-2 (Single Zone): Heating: 1 each - Central Furnace, Gas, Capacity = 192 kBtu/h. Proposed Efficiency = 81.00% Ee, Required Efficiency: 80.00 % Ee (or 78% AFUE). Cooling: 1 each - Single Package DX Unit, Capacity = 196 kBtu/h, Air-Cooled Condenser, Air Economizer. Proposed Efficiency = 13.10 EER, Required Efficiency: 10.80 EER. Fan System: FAN SYSTEM 2 | RTU-2 - Compliance (Motor nameplate HP method) : Passes. Fans: FAN 2 Supply, Constant Volume, 2050 CFM, 2.0 motor nameplate hp.

1 GWH-1: Gas Storage Water Heater, Capacity: 50 gallons, Input Rating: 100 kBtu/h w/ Circulation Pump. Proposed Efficiency: 96.00 % Et, Required Efficiency: 80.00 % Et.

Section 4: Requirements Checklist

- Requirements Specific To: RTU-1 :**
- Equipment minimum efficiency: Central Furnace (Gas): 80.00 % Ee
 - Equipment minimum efficiency: Single Package Unit: 9.80 EER + 9.5 IPLV
 - Integrated economizer is required for this location and system.
 - Cooling system provides a means to relieve excess outdoor air during economizer operation.
 - Hot gas bypass prohibited unless system has multiple steps of unloading or continuous capacity modulation
 - Hot gas bypass limited to 25% of total cooling capacity

- Requirements Specific To: RTU-2 :**
- Equipment minimum efficiency: Central Furnace (Gas): 80.00 % Ee (or 78% AFUE)
 - Equipment minimum efficiency: Single Package Unit: 10.80 EER
 - Integrated economizer is required for this location and system.
 - Cooling system provides a means to relieve excess outdoor air during economizer operation.
 - Hot gas bypass prohibited unless system has multiple steps of unloading or continuous capacity modulation
 - Hot gas bypass limited to 50% of total cooling capacity

- Requirements Specific To: GWH-1 :**
- Water heating equipment meets minimum efficiency requirements: Gas Storage Water Heater efficiency: 80.00 % Et (140 SL, kBtu/h)
 - All piping in circulating system insulated
 - Hot water storage temperature controls that allow setpoint of 90°F for non-dwelling units and 110°F for dwelling units.
 - Automatic time control of heat tapes and recirculating systems present
 - Controls will shut off operation of circulating pump between water heater/boiler and storage tanks within 5 minutes after end of heating cycle

Section 5: Compliance Statement

Compliance Statement: The proposed mechanical design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2009 IECC requirements in COMcheck Version 4.1.5.1 and to comply with the mandatory requirements in the Requirements Checklist.

Philip Anderson - Project Engineer
 Name - Title: Philip Anderson
 Signature: [Signature]
 Date: 08/27/2025

PREPARED FOR:



3420 Torrington Way, Ste 210
 Charlotte, NC 28227
 (704) 565-7070
 (203) 630-2615 Fax


© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version

09.30.2024 2024 Q3 PT22M Prototype Release

Date Description

5 09/12/2025 MECHANICAL EQUIPMENT UPDATE

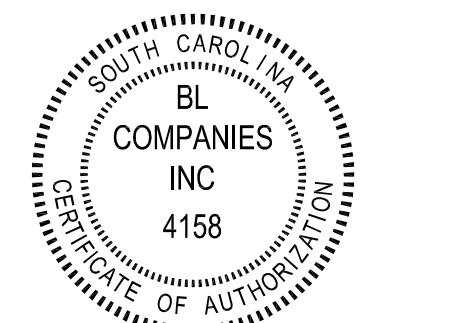

Seal / Signature

Project Name

WHATABURGER ROCK HILL, SC

Date: 12.20.2024

Project Number

2400234

Description

MECHANICAL SCHEDULES

Scale


NOT TO SCALE

M6.1

C:\Users\panderson\Documents\2400234_CS_PT22M_MECH_IR22_panderson\QC\QC.rvt 9/12/2025 2:47:21 PM

CONTROL SYMBOLS

AE	ANALYZER ELEMENT	CO	CARBON MONOXIDE SENSOR
DDC	DIRECT DIGITAL CONTROL	←	COMMUNICATION SIGNAL
BMS	BUILDING MANAGEMENT SYSTEM	HPS	HIGH STATIC PRESSURE SENSOR
RDC	ROOFTOP UNIT DDC CONTROLLER	DA	DAMPER ACTUATOR
FACP	FIRE ALARM CONTROL PANEL	CV	CONTROL VALVE
DPI	DIFFERENTIAL PRESSURE INDICATOR	DX	DX COOLING COIL
DPS	DIFFERENTIAL PRESSURE SWITCH	HC	NATURAL GAS HEATING COIL
DPT	DIFFERENTIAL PRESSURE TRANSMITTER	HGR	HOT GAS REHEAT
EDH	ELECTRIC DUCT HEATER	SF	SUPPLY AIR FAN
EF	EXHAUST FAN		
FE	FLOW ELEMENT		
FLTR	FILTER		
FS	FLOW SWITCH		
H	HUMIDISTAT		
HL	HIGH TEMPERATURE LIMIT SWITCH		
M	MOTOR		
PCV	PRESSURE CONTROL VALVE		
PT	PRESSURE TRANSMITTER		
SMK	SMOKE DETECTOR		
T	TEMPERATURE SENSOR		
TCV	TEMPERATURE CONTROL VALVE		
TSL	LOW LIMIT THERMOSTAT (FREEZE/STAT)		
TT	TEMPERATURE TRANSMITTER		
VFD	VARIABLE FREQUENCY DRIVE		
STARTER	MOTOR STARTER (PROVIDE CONTROL RELAY)		
CT	CURRENT TRANSDUCER		
OS	OCCUPANCY SENSOR		

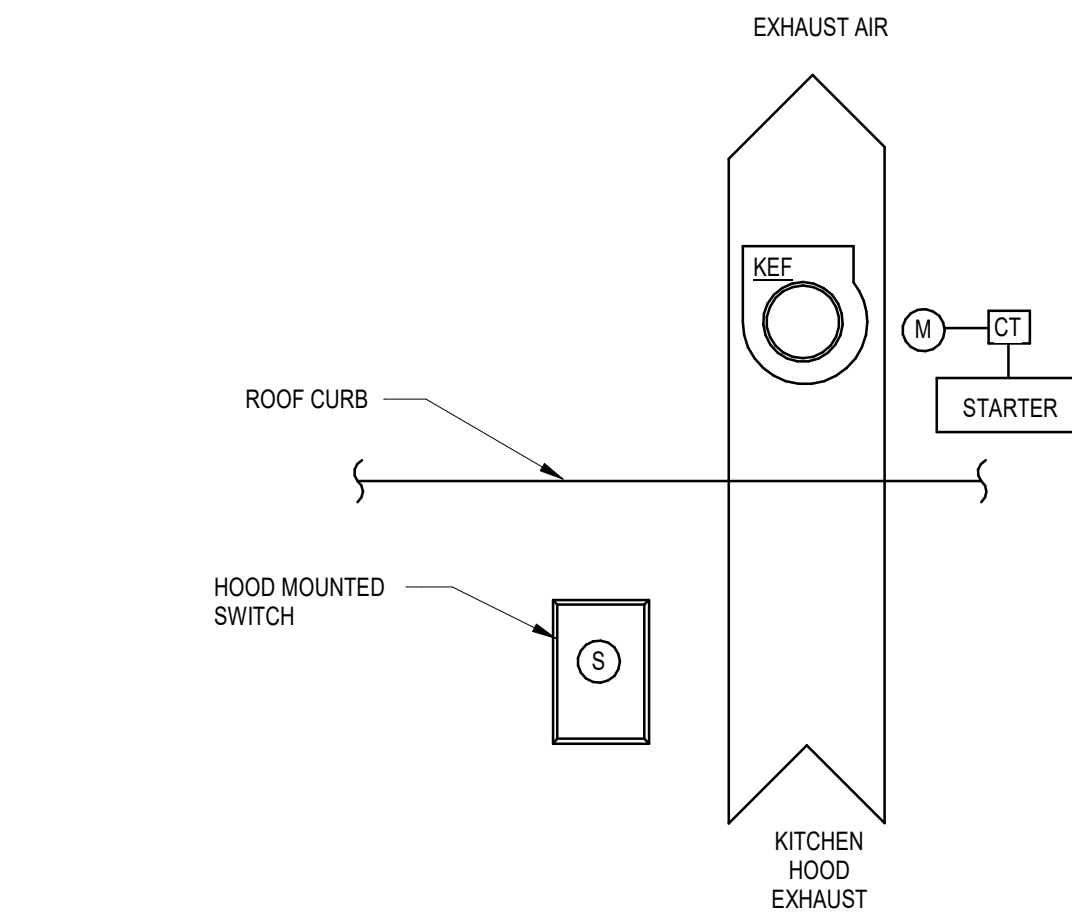


SEQUENCE OF OPERATION

OPERATING CONDITIONS - CONTINUOUS 24/7:
THE KITCHEN HOOD EXHAUST FAN SHALL RUN CONTINUOUSLY WHEN THE KITCHEN HOOD MOUNTED SWITCH IS ON.

INTEGRATED ANSUL FIRE SUPPRESSION SYSTEM:
UPON ACTIVATION OF THE INTEGRATED ANSUL FIRE SUPPRESSION SYSTEM DURING NORMAL KITCHEN OPERATION, THE KITCHEN HOOD EXHAUST FAN SHALL REMAIN ENERGIZED.

FIRE/SMOKE CONTROL:
UPON SENSING DUCT SMOKE, THE KITCHEN EXHAUST FAN SHALL BE CYCLED OFF. FAN STATUS SHALL BE REPORTED TO THE BAS.

B1 KITCHEN HOOD EXHAUST FAN CONTROL DIAGRAM
N.T.S.

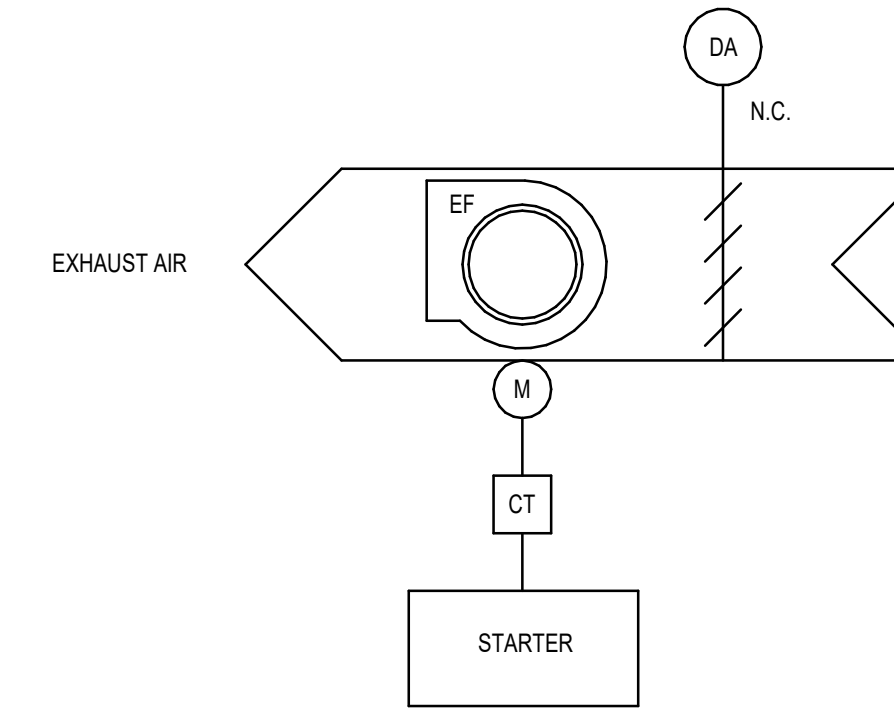


SEQUENCE OF OPERATION

OPERATING CONDITIONS:
THE GENERAL EXHAUST FAN SHALL BE INTERLOCKED WITH THE RESTROOM OCCUPANCY SENSORS. THE EXHAUST FAN SHUTOFF DAMPER SHALL BE INTERLOCKED WITH THE EXHAUST FAN TO OPEN WHEN THE FAN IS ENERGIZED AND CLOSE WHEN THE FAN IS DE-ENERGIZED.

ALARMS:
ALARMS SHALL BE PROVIDED AS FOLLOWS:
1. FAN FAILURE: FAN COMMANDED ON BUT STATUS IS OFF.
2. FAN IN HAND: FAN COMMANDED OFF BUT STATUS IS ON.
3. FAN BELT FAILURE: MOTOR AMPERAGE READS ZERO AS MEASURED BY CURRENT TRANSDUCER.

B2 GENERAL EXHAUST FAN CONTROL DIAGRAM
N.T.S.

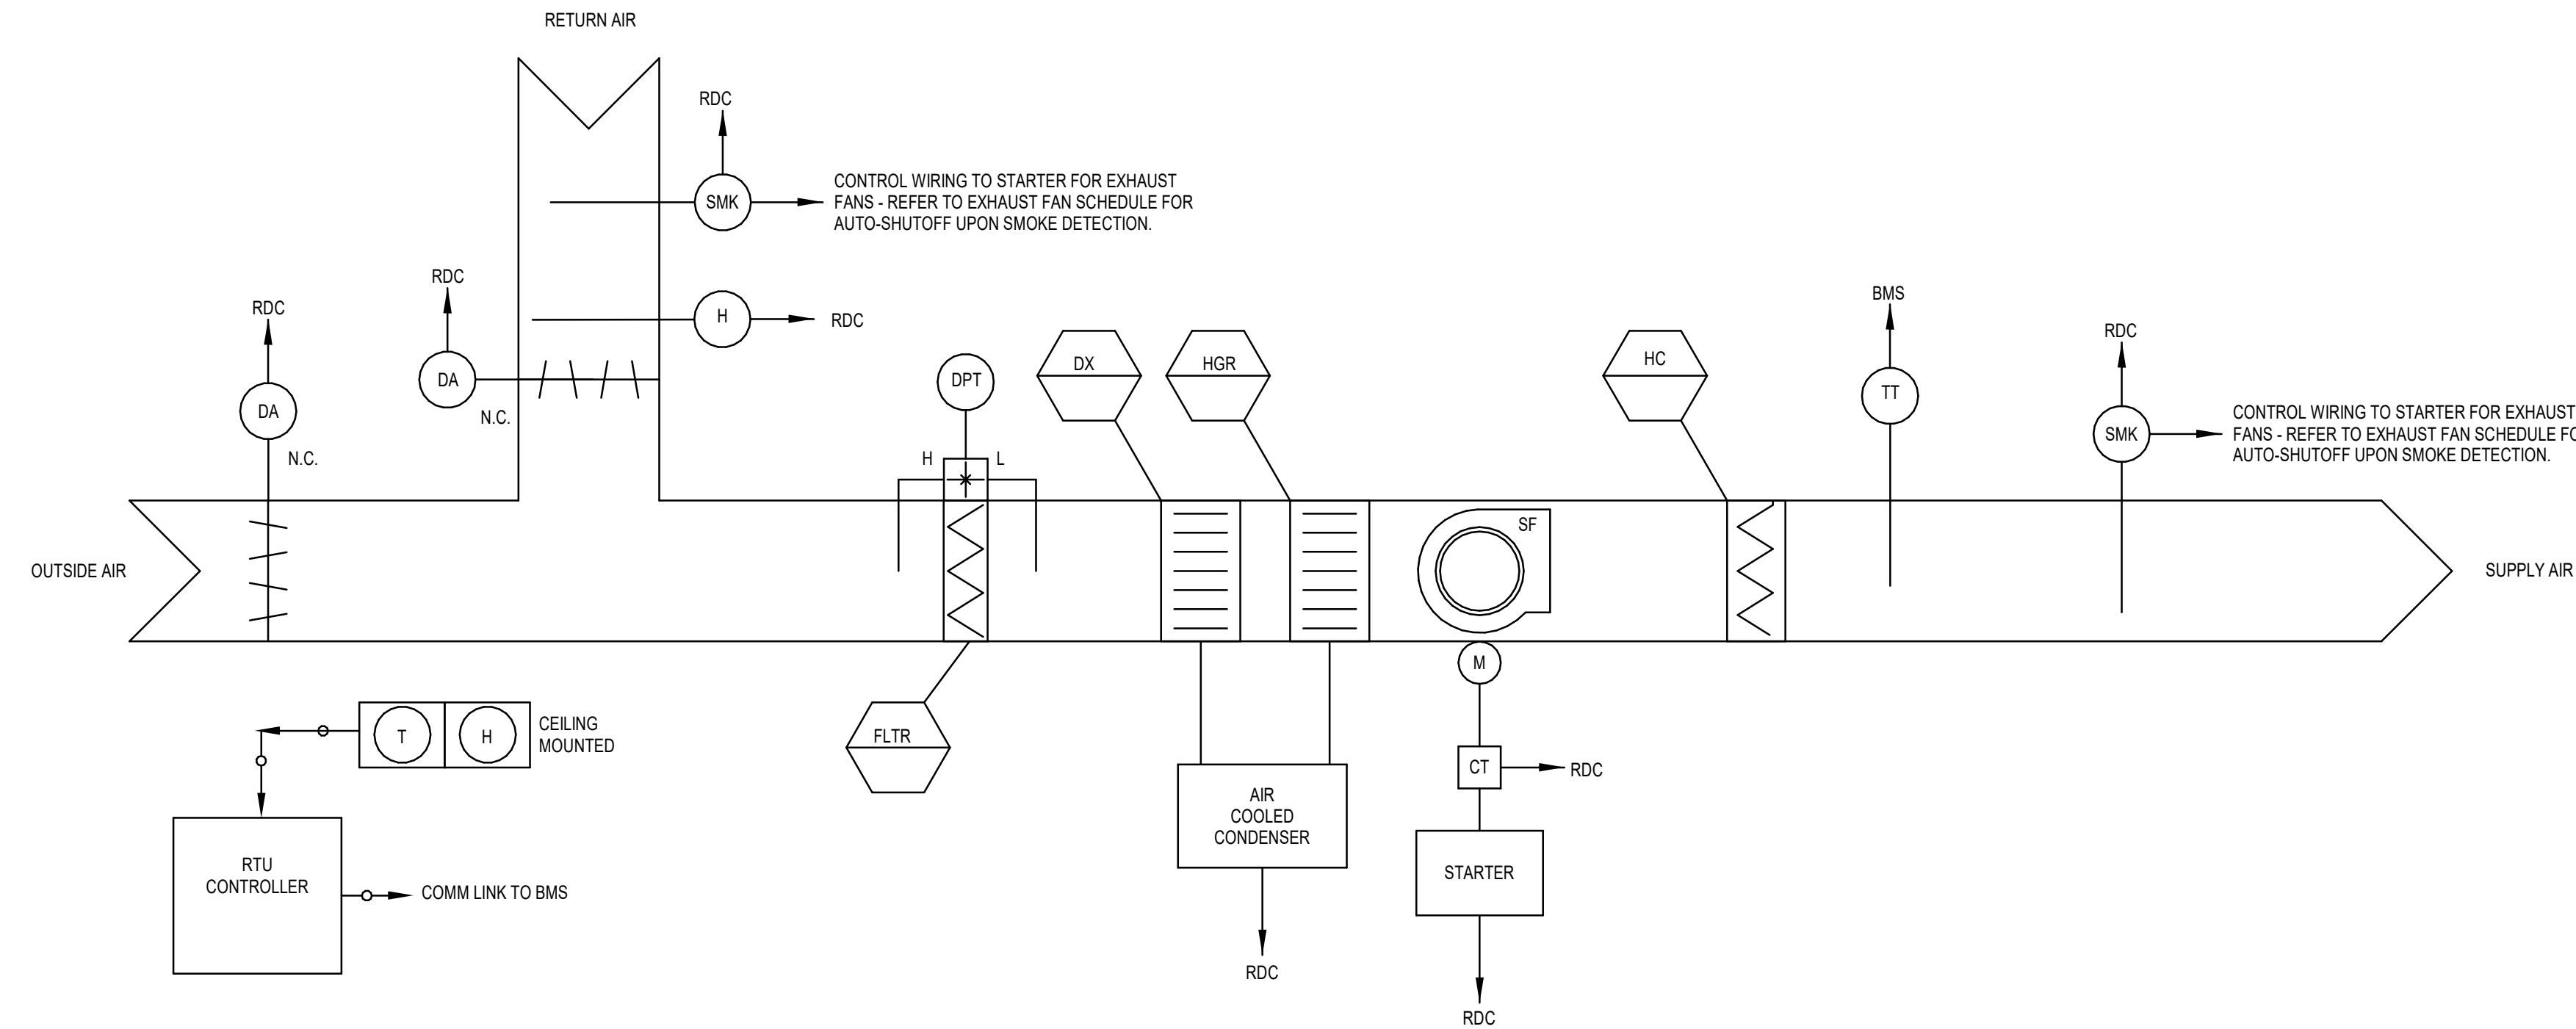

SEQUENCE OF OPERATION

OPERATING CONDITION - CONTINUOUS 24/7 (INTERLOCKED WITH KITCHEN EXHAUST)

THE PILOT RTU CONTROLLER (RDC) SHALL PERFORM ALL CONTROL, SAFETY AND INTERLOCKS AS DESCRIBED IN THE SEQUENCE OF OPERATION. THE BMS SHALL MONITOR THE RTU DDC CONTROLLER VIA BMS PROTOCOL COMMUNICATION AND/OR COMBINATION OF DISCRETE INPUT/OUTPUT POINTS. THE BMS SHALL OPERATE THE UNIT CONTINUOUS 24/7. WHEN THE UNIT IS DE-ENERGIZED BY THE BMS, THE FAN SHALL SHUT DOWN, THE OA DAMPER SHALL CLOSE. THE REFRIGERATION SYSTEM SHALL ALSO BE DE-ENERGIZED AND THE HEATING SYSTEM LOCKED OUT OF HEATING MODE.

THE BMS SHALL BE PROGRAMMED SO THAT THE HEATING AND COOLING SYSTEMS SHALL NEVER OPERATE SIMULTANEOUSLY.

TEMPERATURE CONTROL
OCCUPIED MODE - THE BMS WILL MAINTAIN THE FOLLOWING SPACE TEMPERATURE SETPOINTS:
• COOLING: 75°F, 55% RH (ADJUSTABLE)
• HEATING: 70°F (ADJUSTABLE)
SETBACK MODE - THE BMS WILL MAINTAIN THE FOLLOWING SPACE TEMPERATURE SETPOINTS:
• COOLING: 85°F (ADJUSTABLE) (ADJUST TO 80°F 1-HR PRIOR TO OCCUPANCY)
• HEATING: 60°F (ADJUSTABLE) (ADJUST TO 65°F 1-HR PRIOR TO OCCUPANCY)
THERE SHALL BE A DEADBAND OF +/- 5°F ON ALL TEMPERATURE CONTROL.

HUMIDITY CONTROL
IF THE RELATIVE HUMIDITY OF THE RETURN AIR EXCEEDS 80% (ADJUSTABLE) AND THERE IS NO CALL FOR COOLING IN THE SPACE, THE RDC SHALL ENABLE DEHUMIDIFICATION MODE OF THE RTU BASED ON ITS OWN INTERNAL CONTROLS UTILIZING HOT GAS REHEAT.

SEQUENCE OF OPERATION (CONTINUED)

ECONOMIZER OPERATION
BASED ON THE RTU INTERNAL DIFFERENTIAL ENTHALPY CONTROLS, THE RDC SHALL VARY THE OUTSIDE AIR DAMPER POSITION, BASED ON CALL FOR COOLING IN THE SPACE. THERE SHALL BE ONE FAN SPEED. THE RDC SHALL LOAD AND UNLOAD COMPRESSORS BASED ON THE UNIT INTERNAL CONTROLS TO CONDITION OR DEHUMIDIFY THE SPACE AS NEEDED.

UNIT SHUTDOWN
UNIT SHALL BE DE-ENERGIZED UPON DETECTION OF SMOKE IN UNIT OR BUILDING FIRE ALARM.

ALARMS
THE BMS SHALL MONITOR ALL SAFETIES ON THE REFRIGERATION SYSTEM AND THE HEATING SYSTEM THROUGH THE RDC COMMUNICATION PROTOCOL. ALL ABNORMAL CONDITIONS SHALL BE ALARMED AT THE BMS.

A. **FILTERS:**
THE RDC SHALL MONITOR THE STATIC PRESSURE DROP ACROSS THE FILTER BANK AND ALARM ON HIGH STATIC PRESSURE DROP. A DIFFERENTIAL PRESSURE SWITCH ACROSS THE FILTER SHALL INITIATE FILTER ALARM WHEN THE PRESSURE DROP ACROSS THE FILTER REACHES THE SETPOINT OF 1.0 INCHES W.C. (ADJUSTABLE).

B. **FIRE/SMOKE CONTROL:**
UPON ACTIVATION OF A DUCT SMOKE DETECTOR, THE BMS SHALL RECEIVE AN ALARM.

C. **GENERAL ALARM:**
ANY TROUBLE ALARM OR FAULT WITHIN THE UNIT ONBOARD CONTROLS WILL GENERATE A GENERAL ALARM TO THE BMS.

A1 PACKAGED ROOFTOP UNIT CONTROLS DIAGRAM
N.T.S.

PREPARED FOR:




3420 Torrington Way, Ste 210
Charlotte, NC 28227
(704) 565-7070
(203) 630-2615 Fax

© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version
09.30.2024 2024 Q3 PT22M Prototype Release

Date	Description
------	-------------

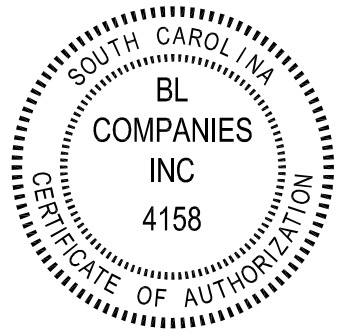

Seal / Signature

Project Name
WHATABURGER ROCK HILL, SC


Date: 12.20.2024

Project Number
2400234

Description
MECHANICAL CONTROLS

Scale
NOT TO SCALE

M7.1

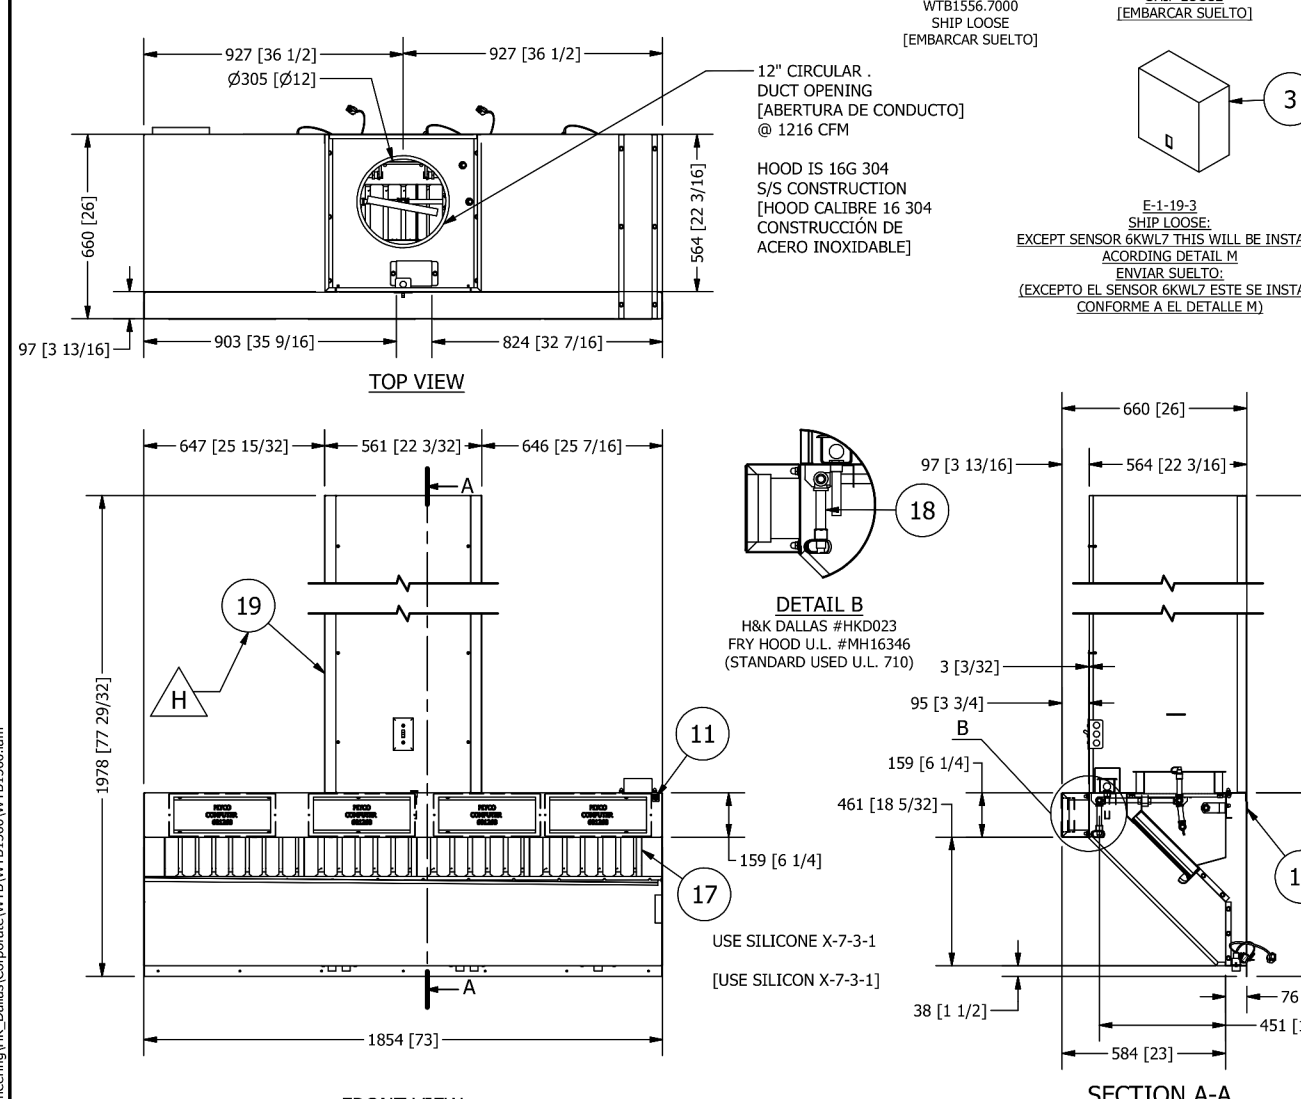

ITEM NO.	REV	PART NUMBER	REV	DESCRIPTION	MATERIAL
1	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
2	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
3	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
4	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
5	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
6	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
7	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
8	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
9	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
10	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
11	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
12	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
13	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
14	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
15	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
16	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
17	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
18	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC
19	1	WTB156.3000		FRY HOOD U.L. #PH10336	GENERIC

DATE	REVISION	DESCRIPTION	DATE	BY	CHECKED
6/16/2021	H	INITIAL DESIGN	2/15/2024	H	H
8/14/2024	R3	Label drawing was updated			
2/15/2024	JGH	Label drawing was updated			
8/21/2023	PHC	WTB156.3000 update			

DATE	REVISION	DESCRIPTION	DATE	BY	CHECKED
6/16/2021	H	INITIAL DESIGN	2/15/2024	H	H
8/14/2024	R3	Label drawing was updated			
2/15/2024	JGH	Label drawing was updated			
8/21/2023	PHC	WTB156.3000 update			

REVISION HISTORY

REVISION HISTORY

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000


WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

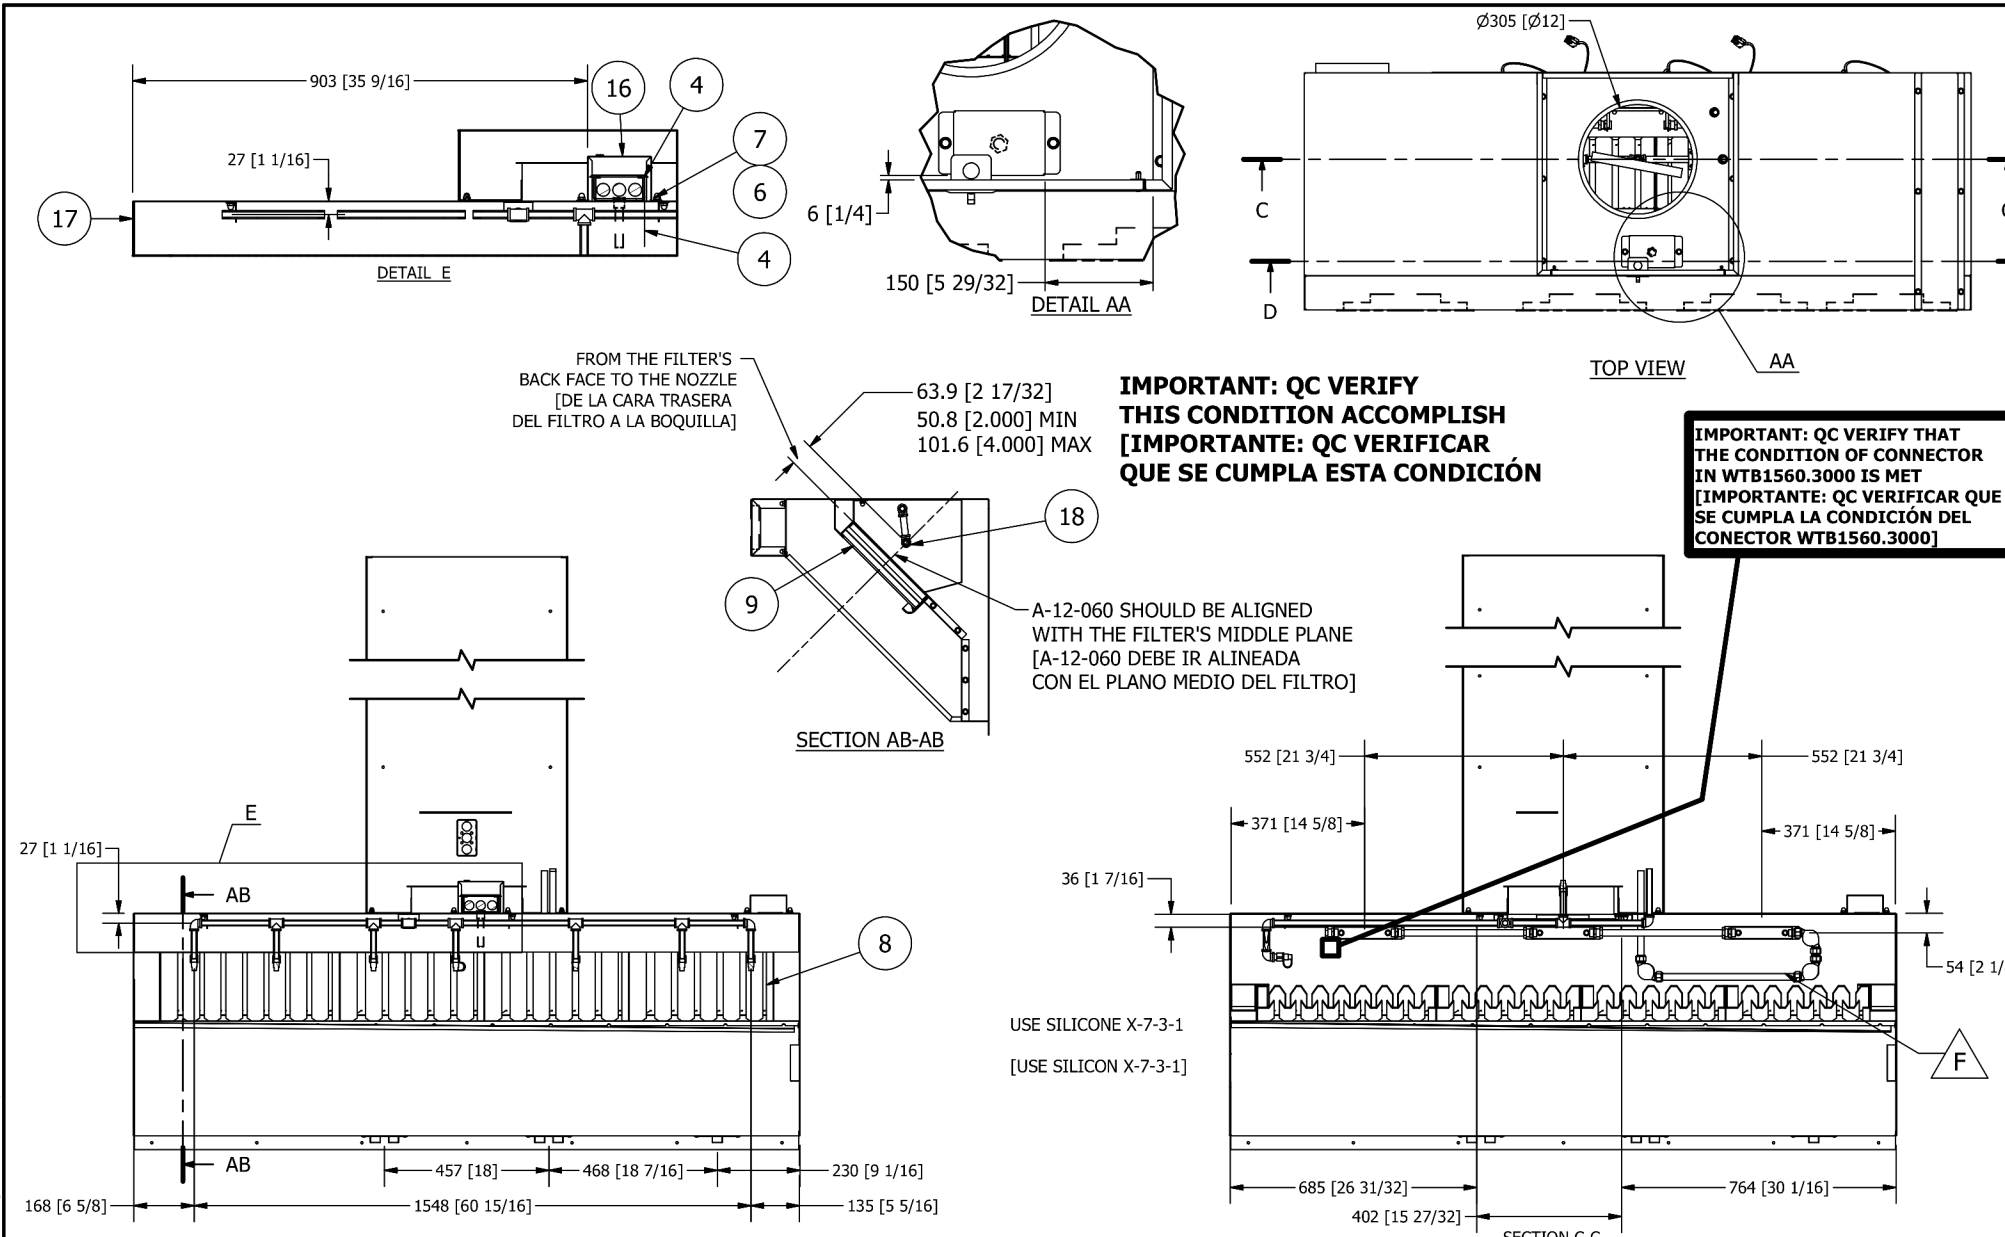

DATE	REVISION	DESCRIPTION	DATE	BY	CHECKED
6/16/2021	H	INITIAL DESIGN	2/15/2024	H	H
8/14/2024	R3	Label drawing was updated			
2/15/2024	JGH	Label drawing was updated			
8/21/2023	PHC	WTB156.3000 update			

REVISION HISTORY

REVISION HISTORY

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

WTB156.3000

H&K International
P.O. Box 180729 Dallas, Texas 75218, Telephone (214) 818-3500 FAX (214) 818-3582

July 20th, 2022

To Whom It May Concern,

H+K Hoods comply with IMC Section 506.5.4 and 507.2.6 for zero clearance to combustible and non-combustible walls.

Should you have any questions, please contact me.

Sincerely,

Bryann Tonn

Bryan Tonn
Director of Engineering, H+K International, Inc.
2200 Skyline Drive
Mesquite, TX 75149
(214) 818-3580
Bryan.tonn@hki.com










3420 Torrington Way, Ste 210
Charlotte, NC 28227
(704) 565-7070
(203) 630-2615 Fax

© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version
09.30.2024 2024 Q3 PT22M Prototype Release

Date	Description
09/12/2025	MECHANICAL EQUIPMENT UPDATE

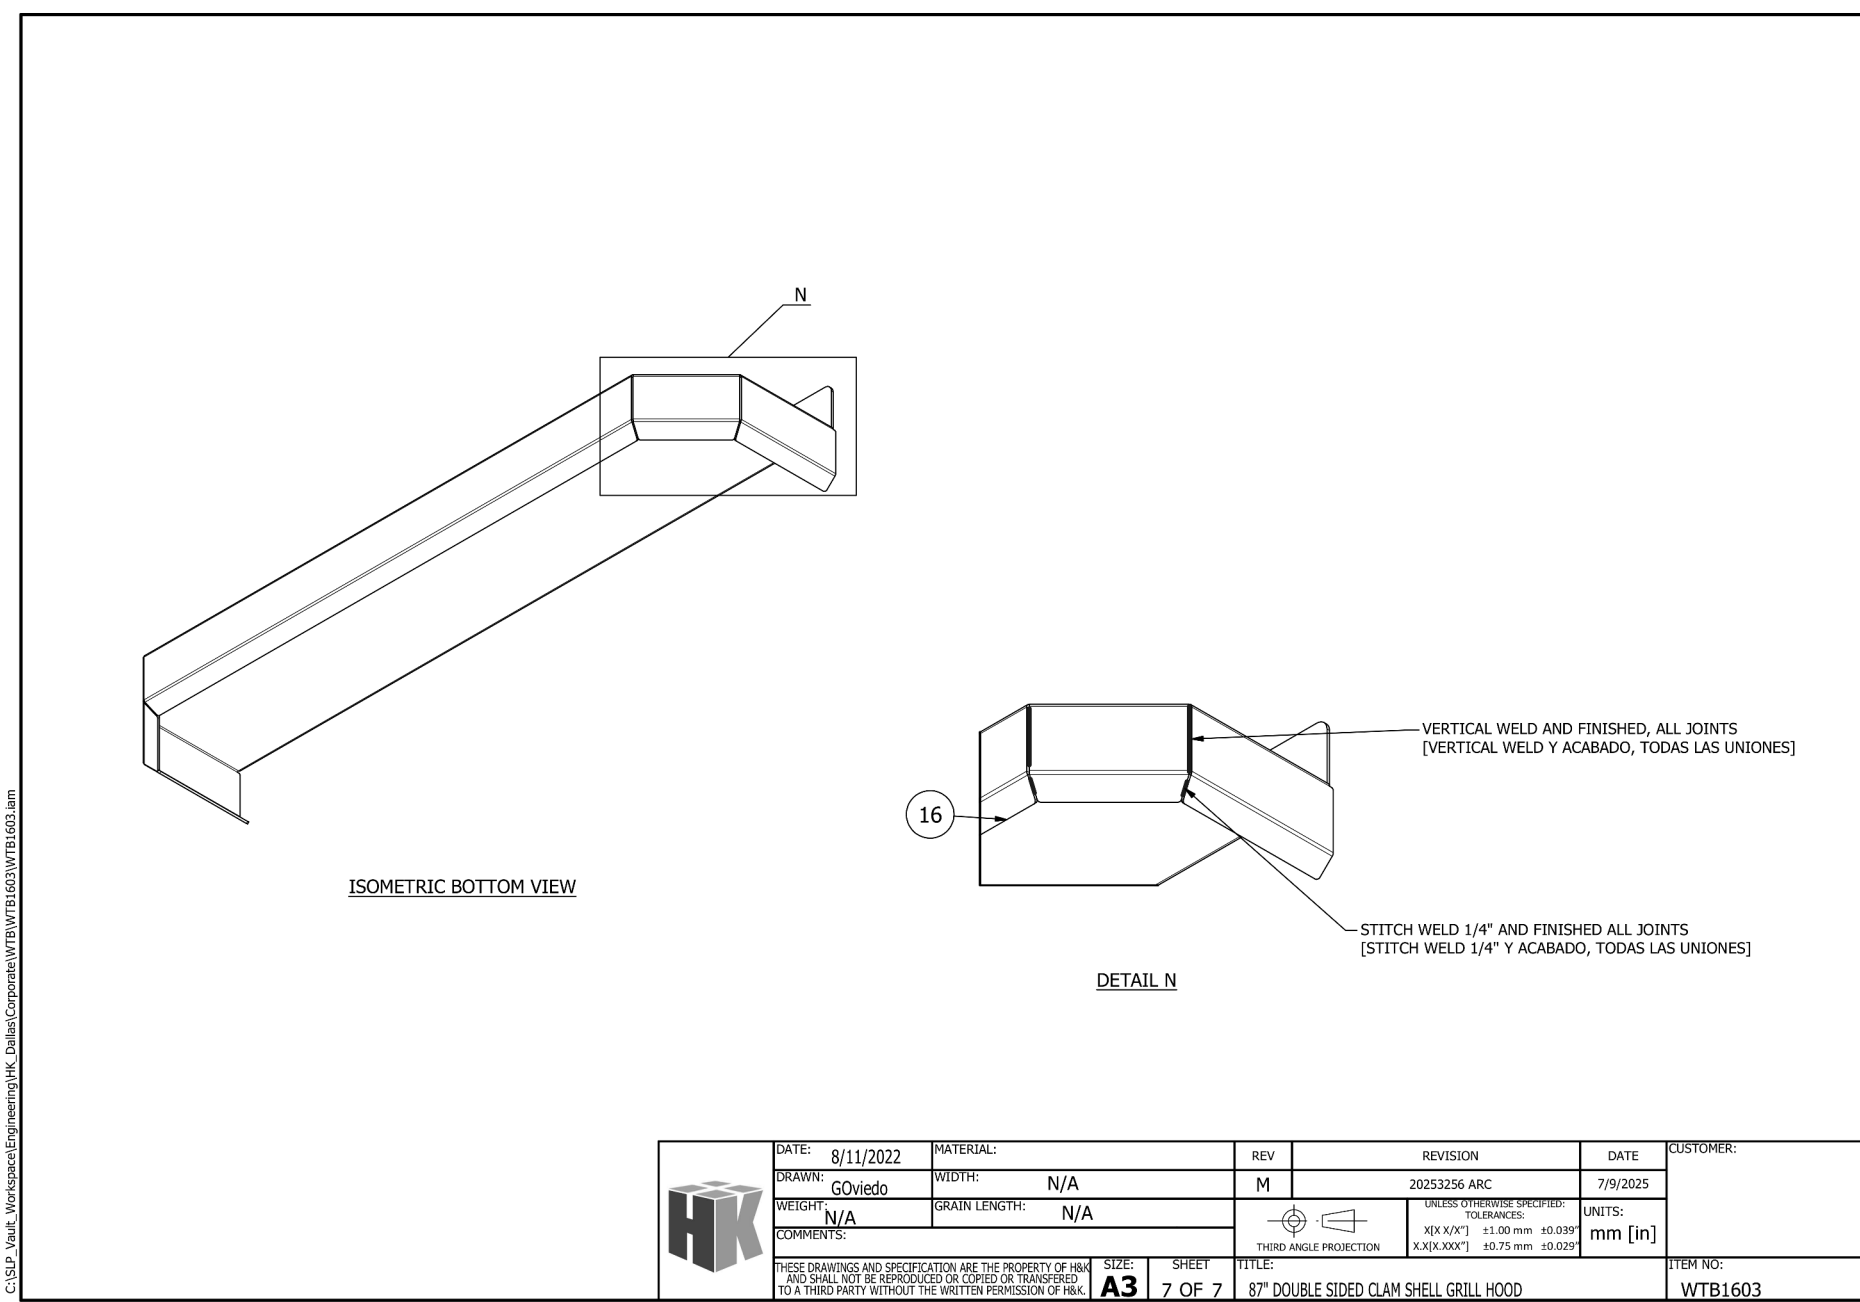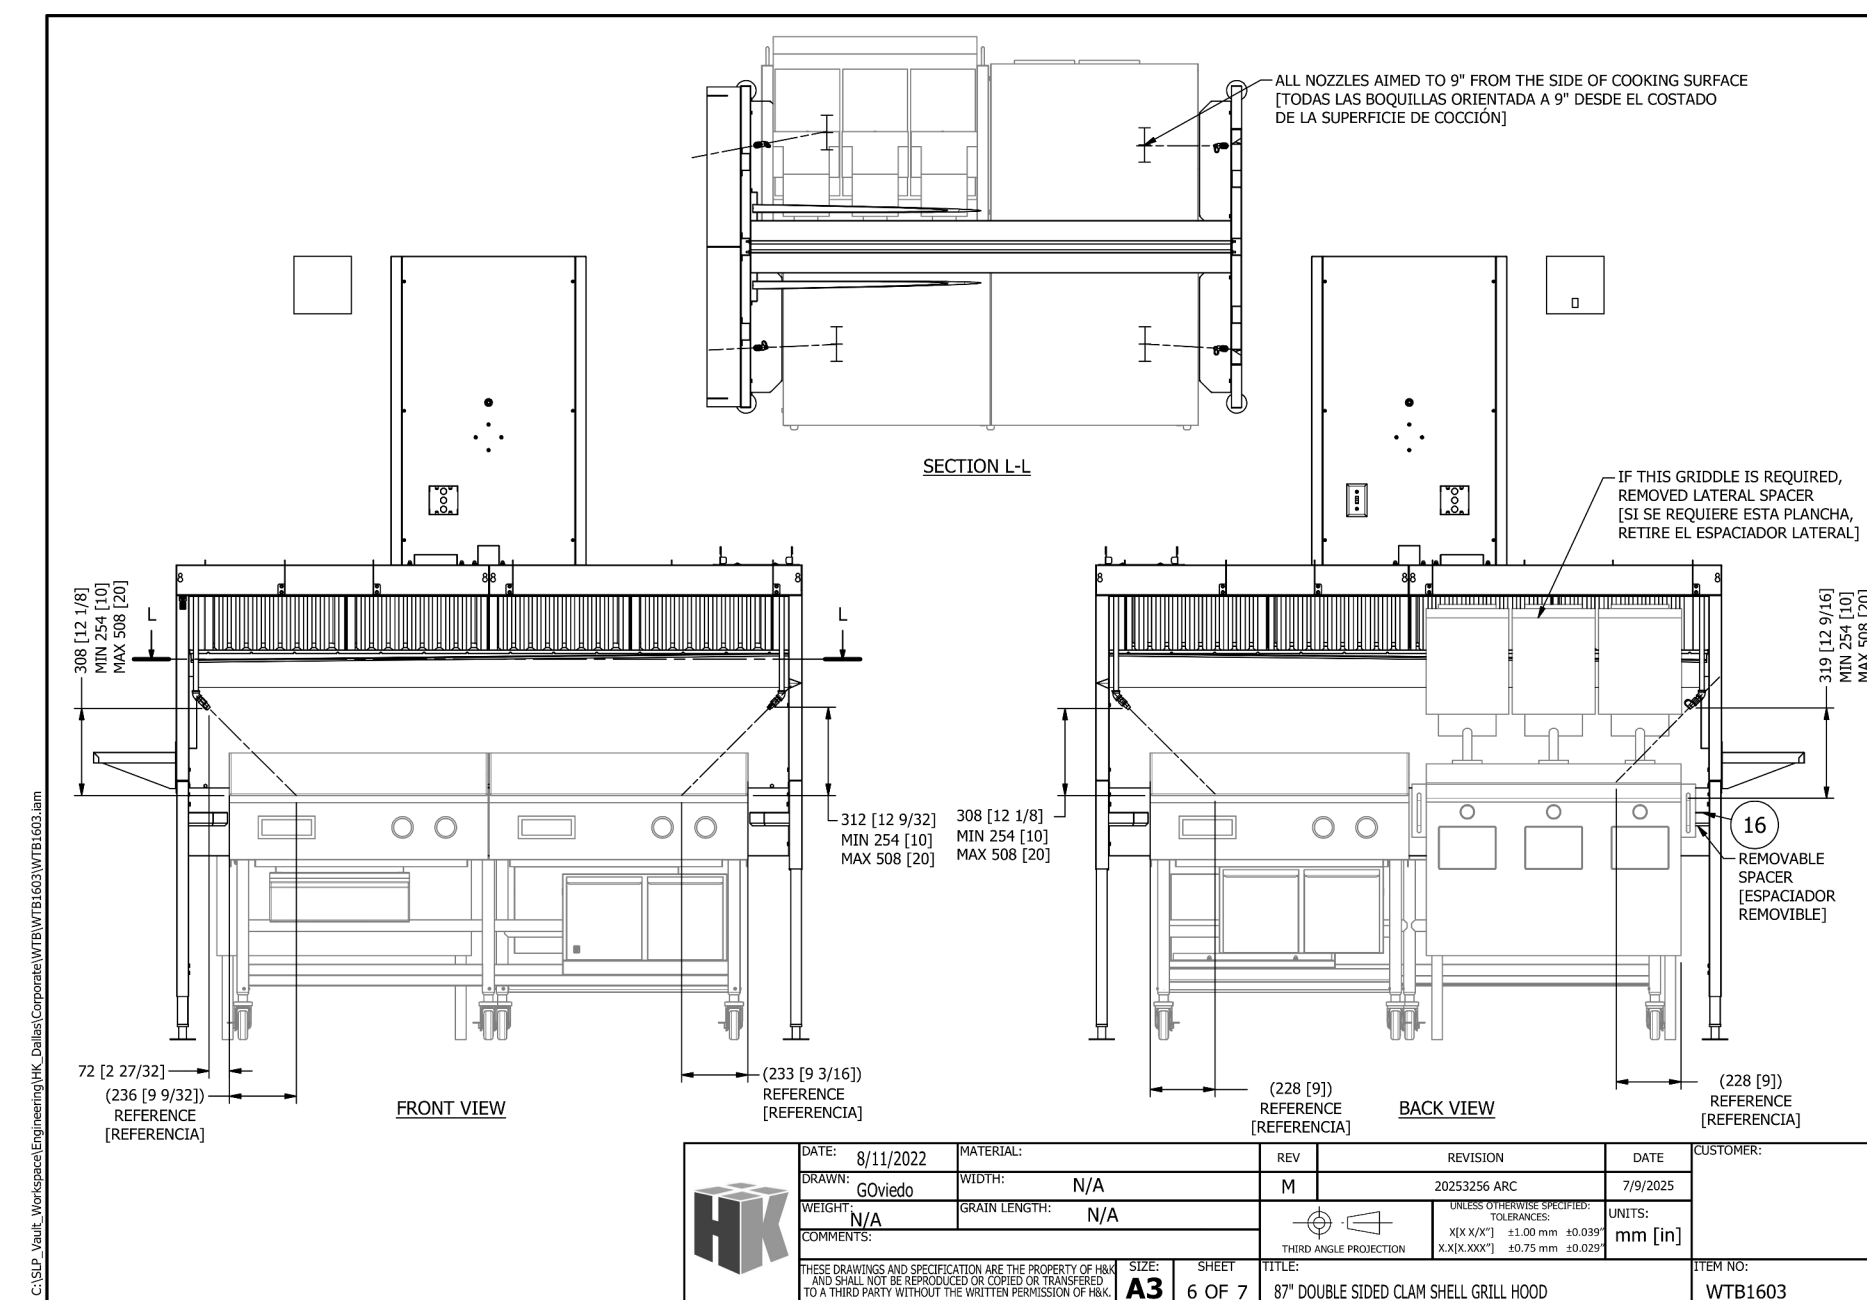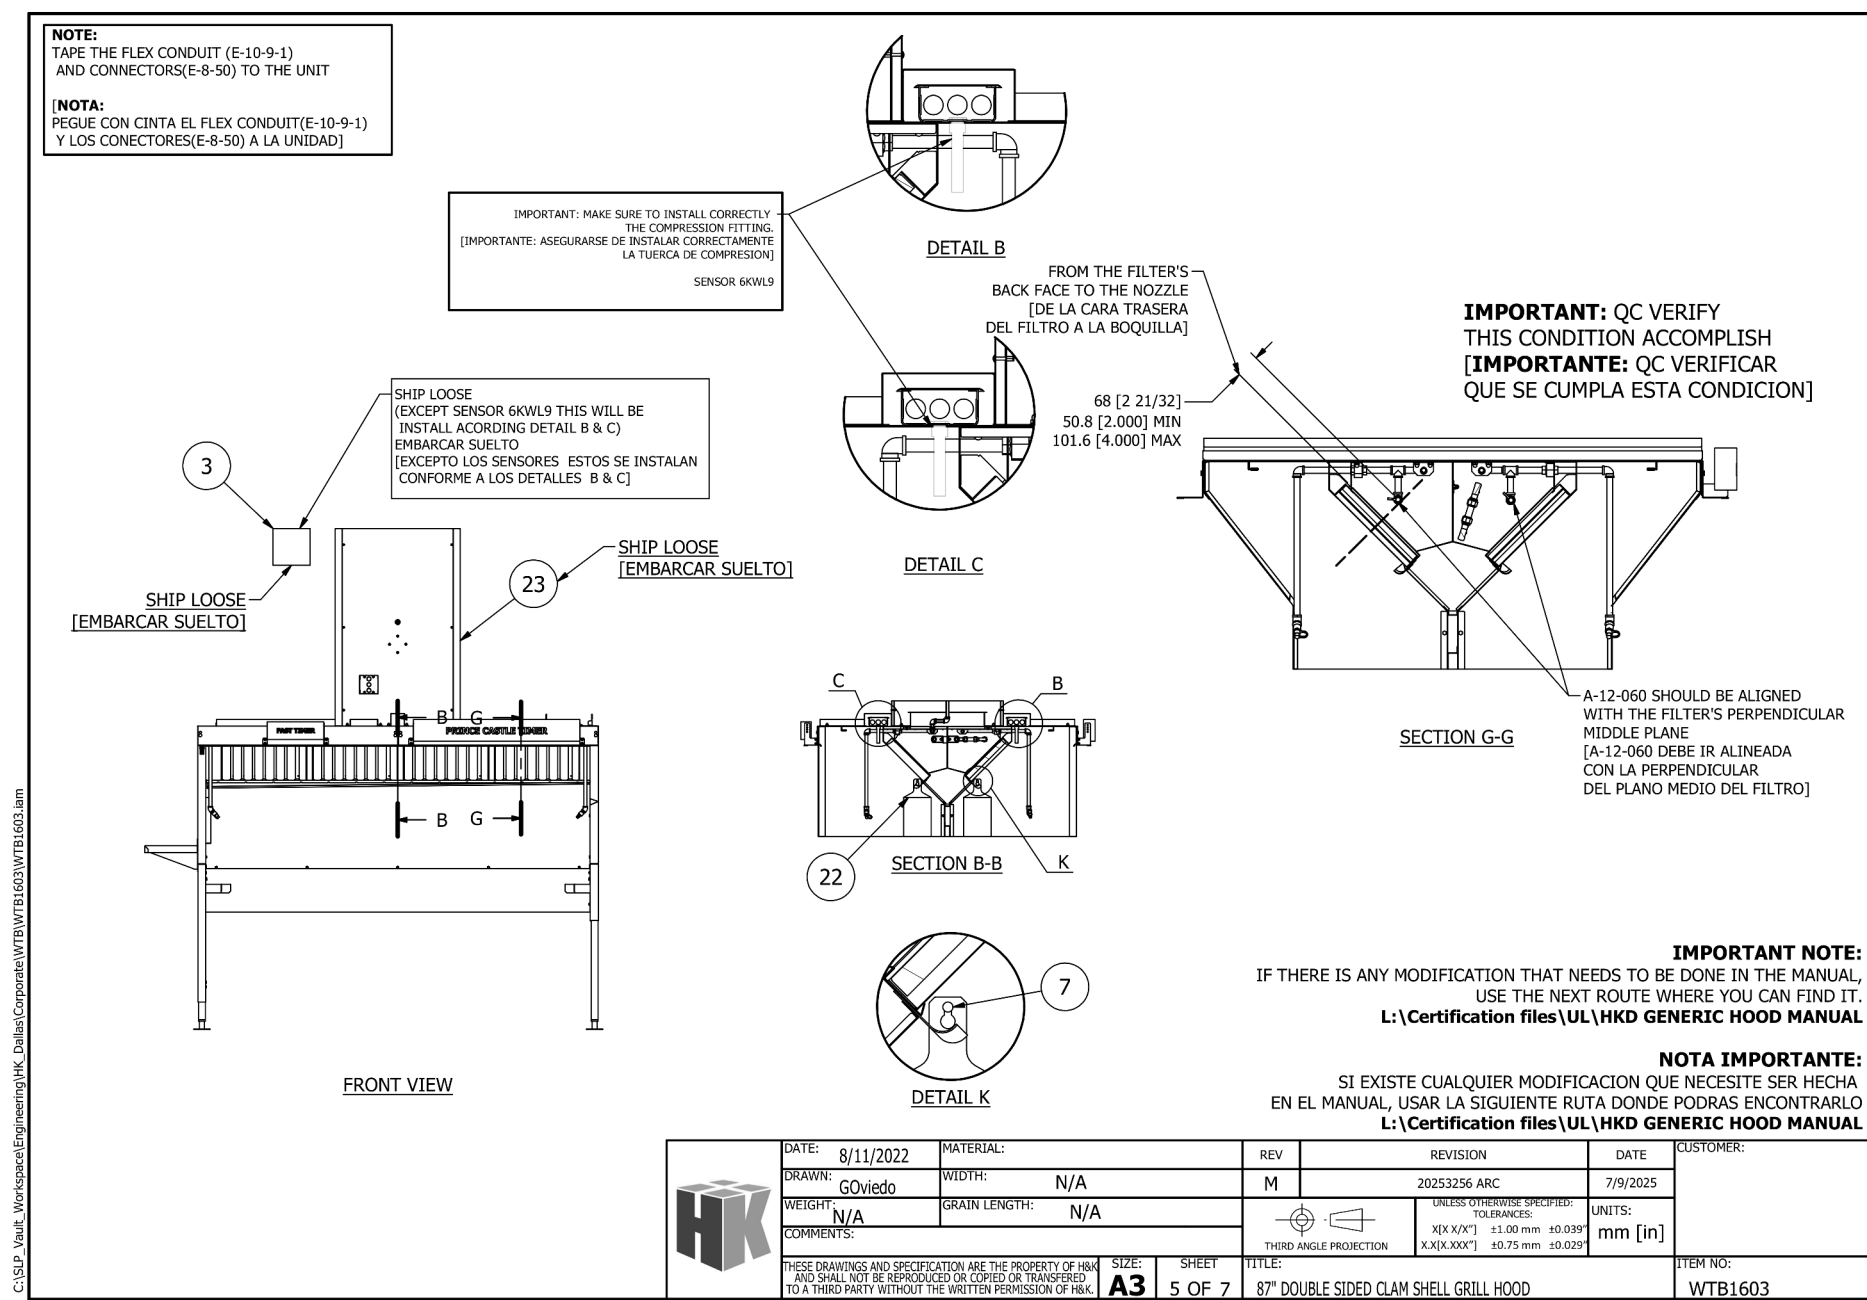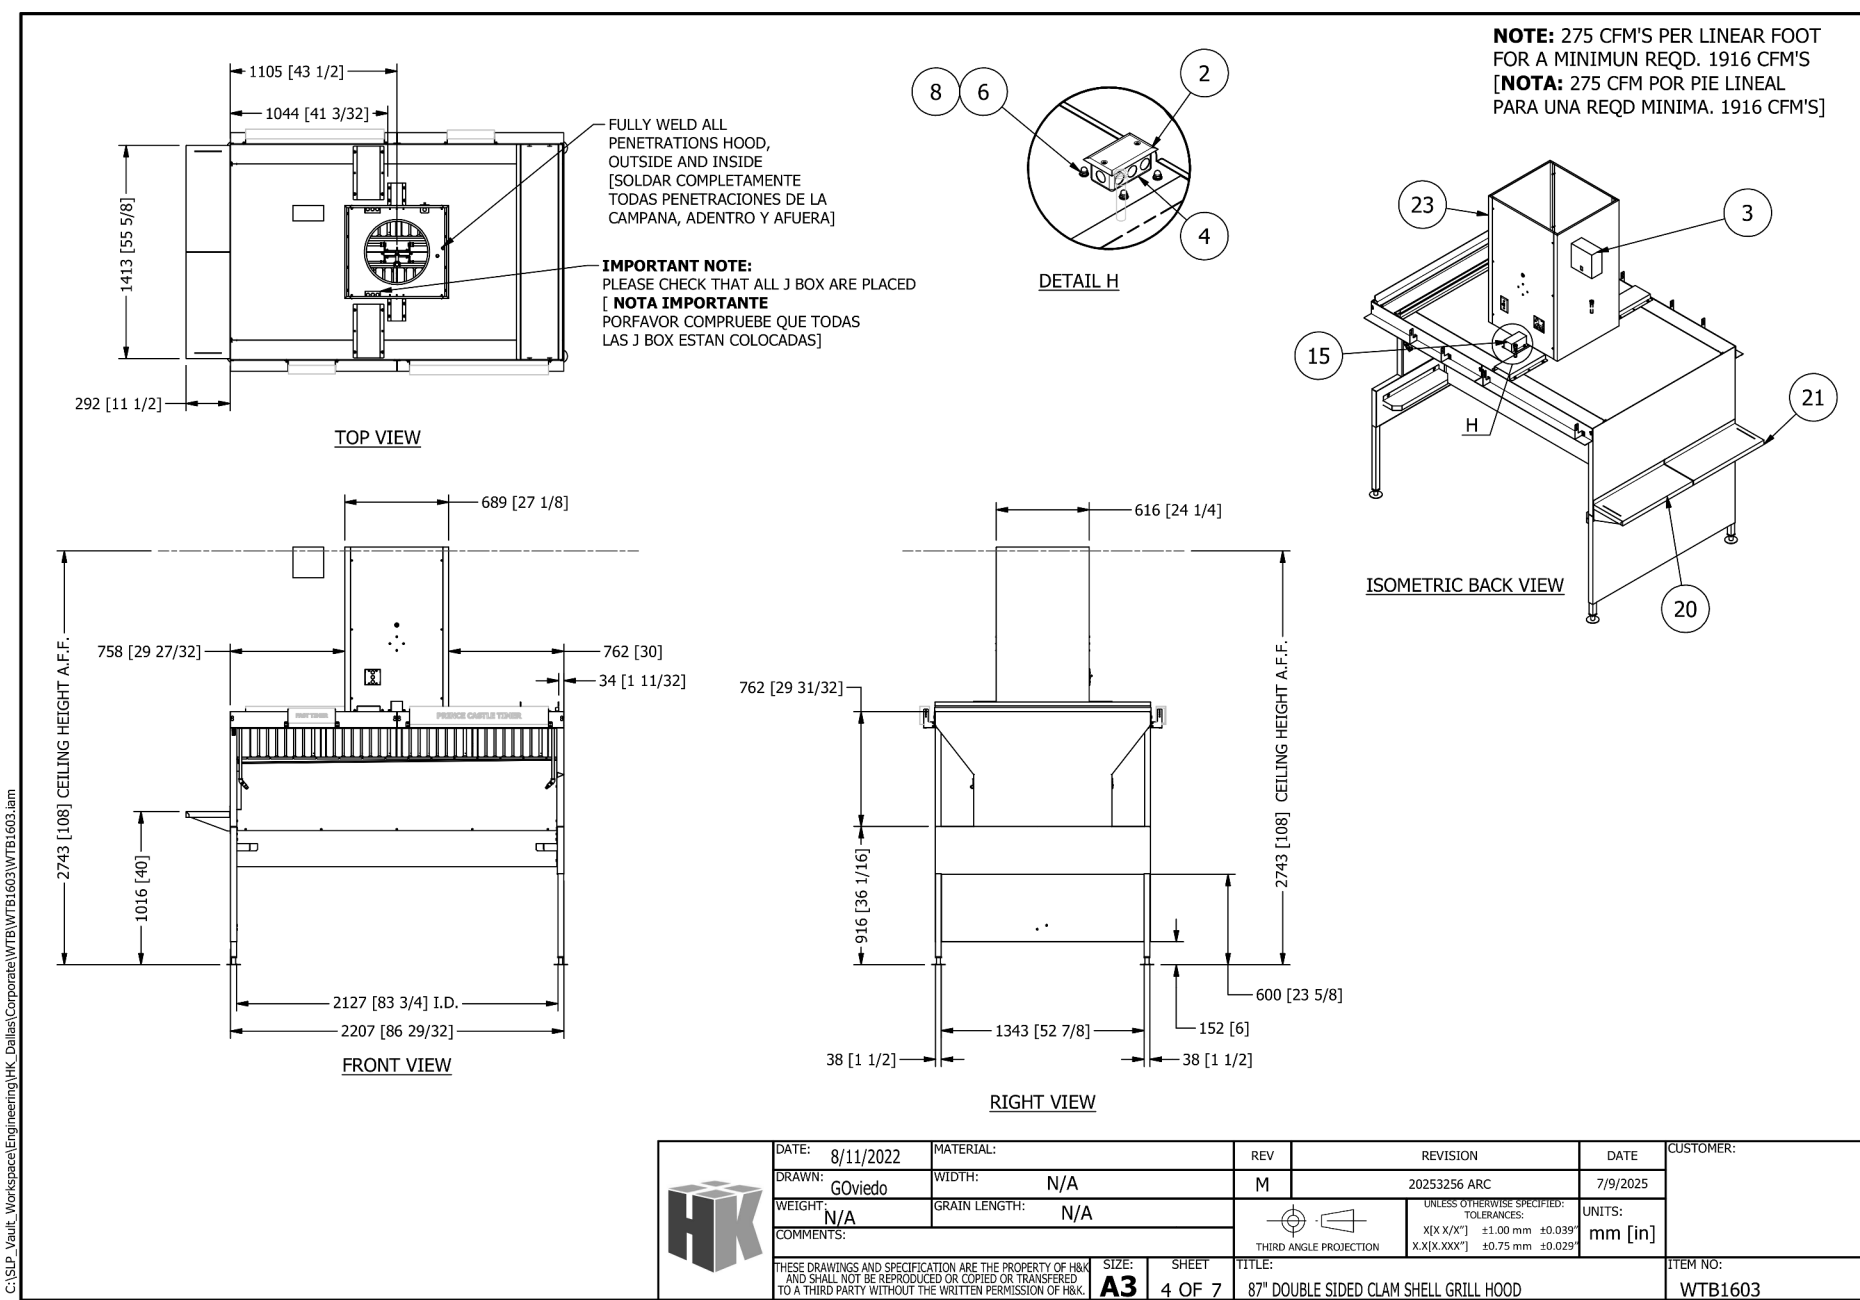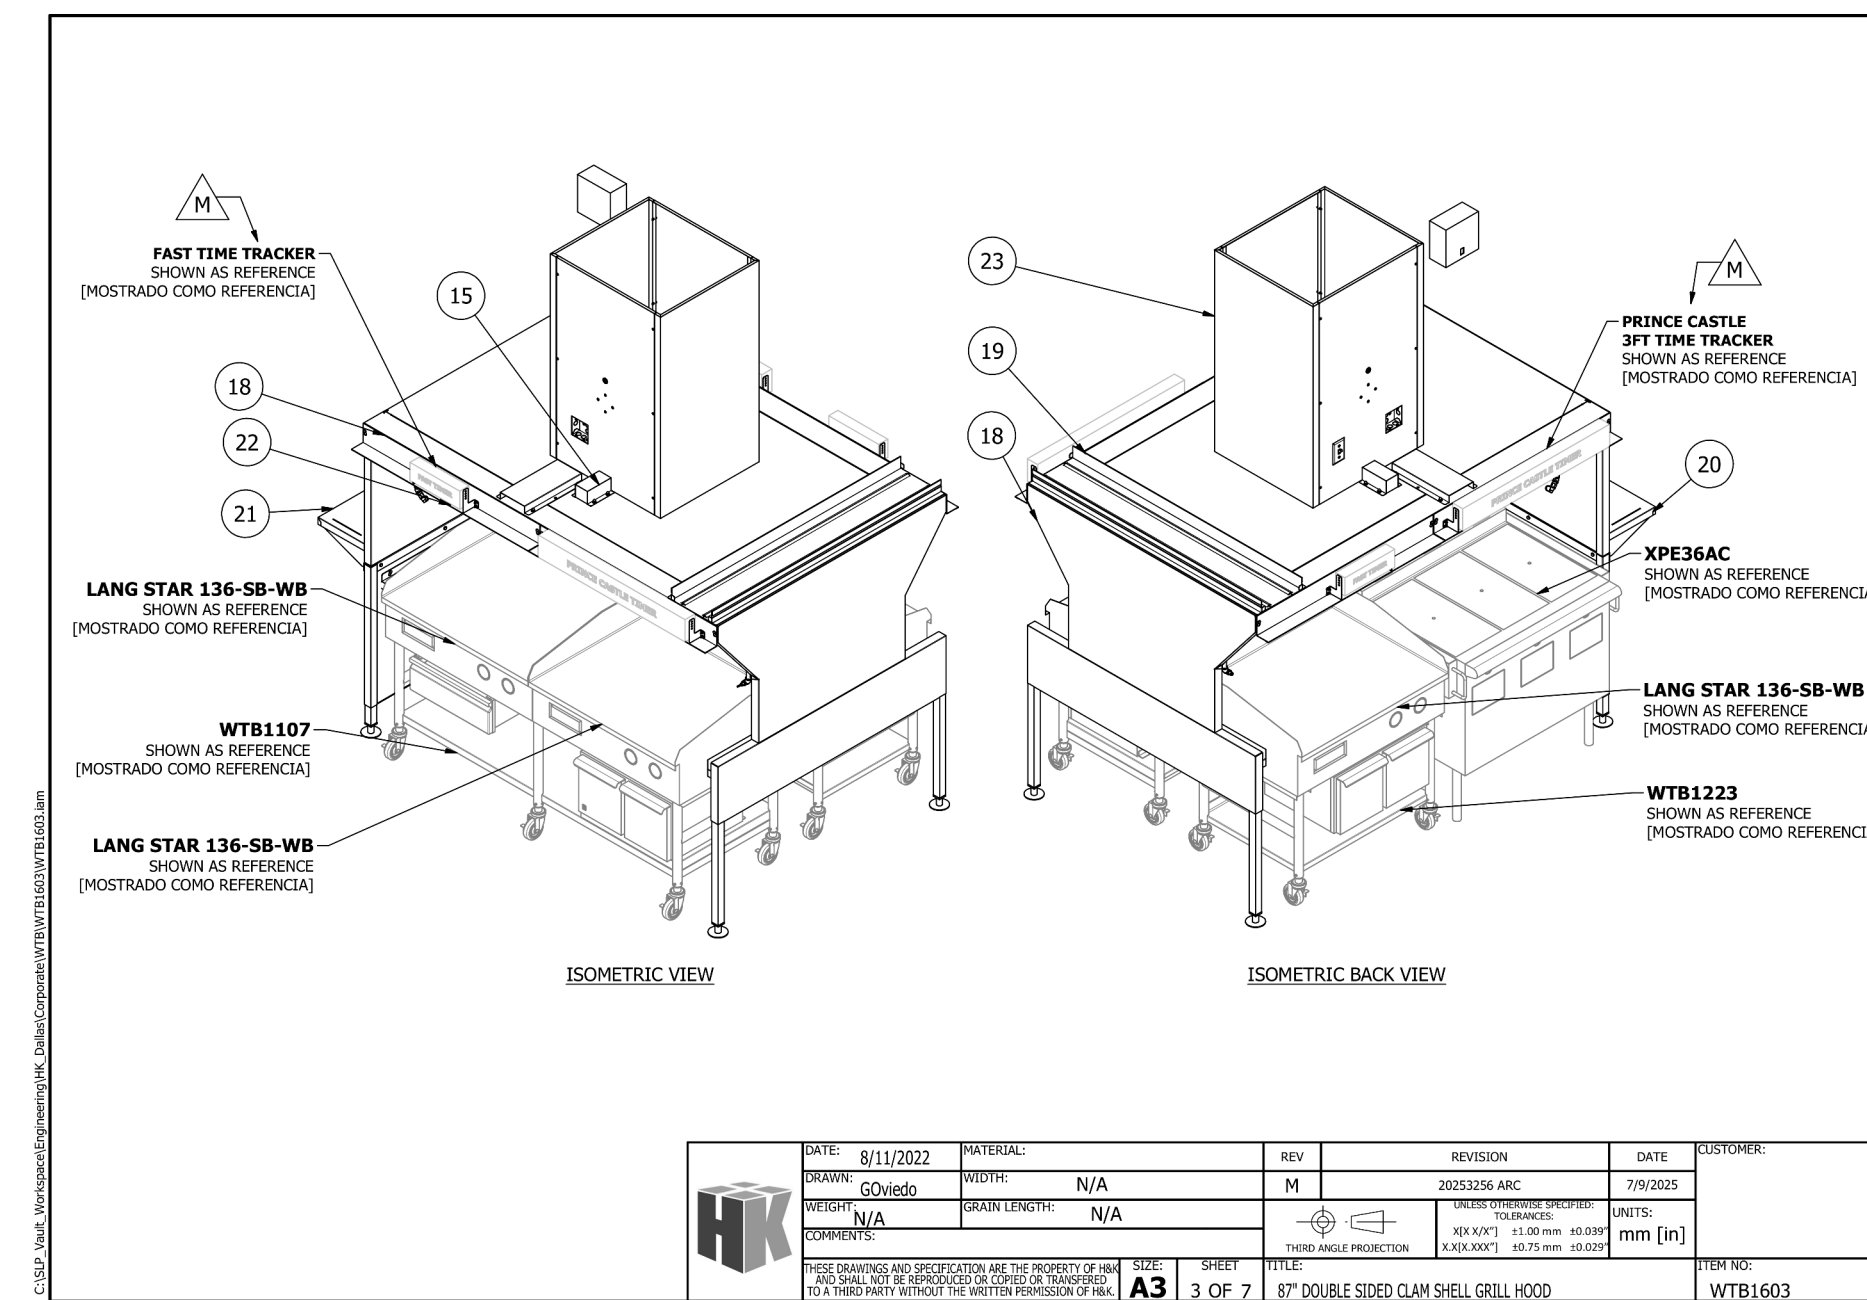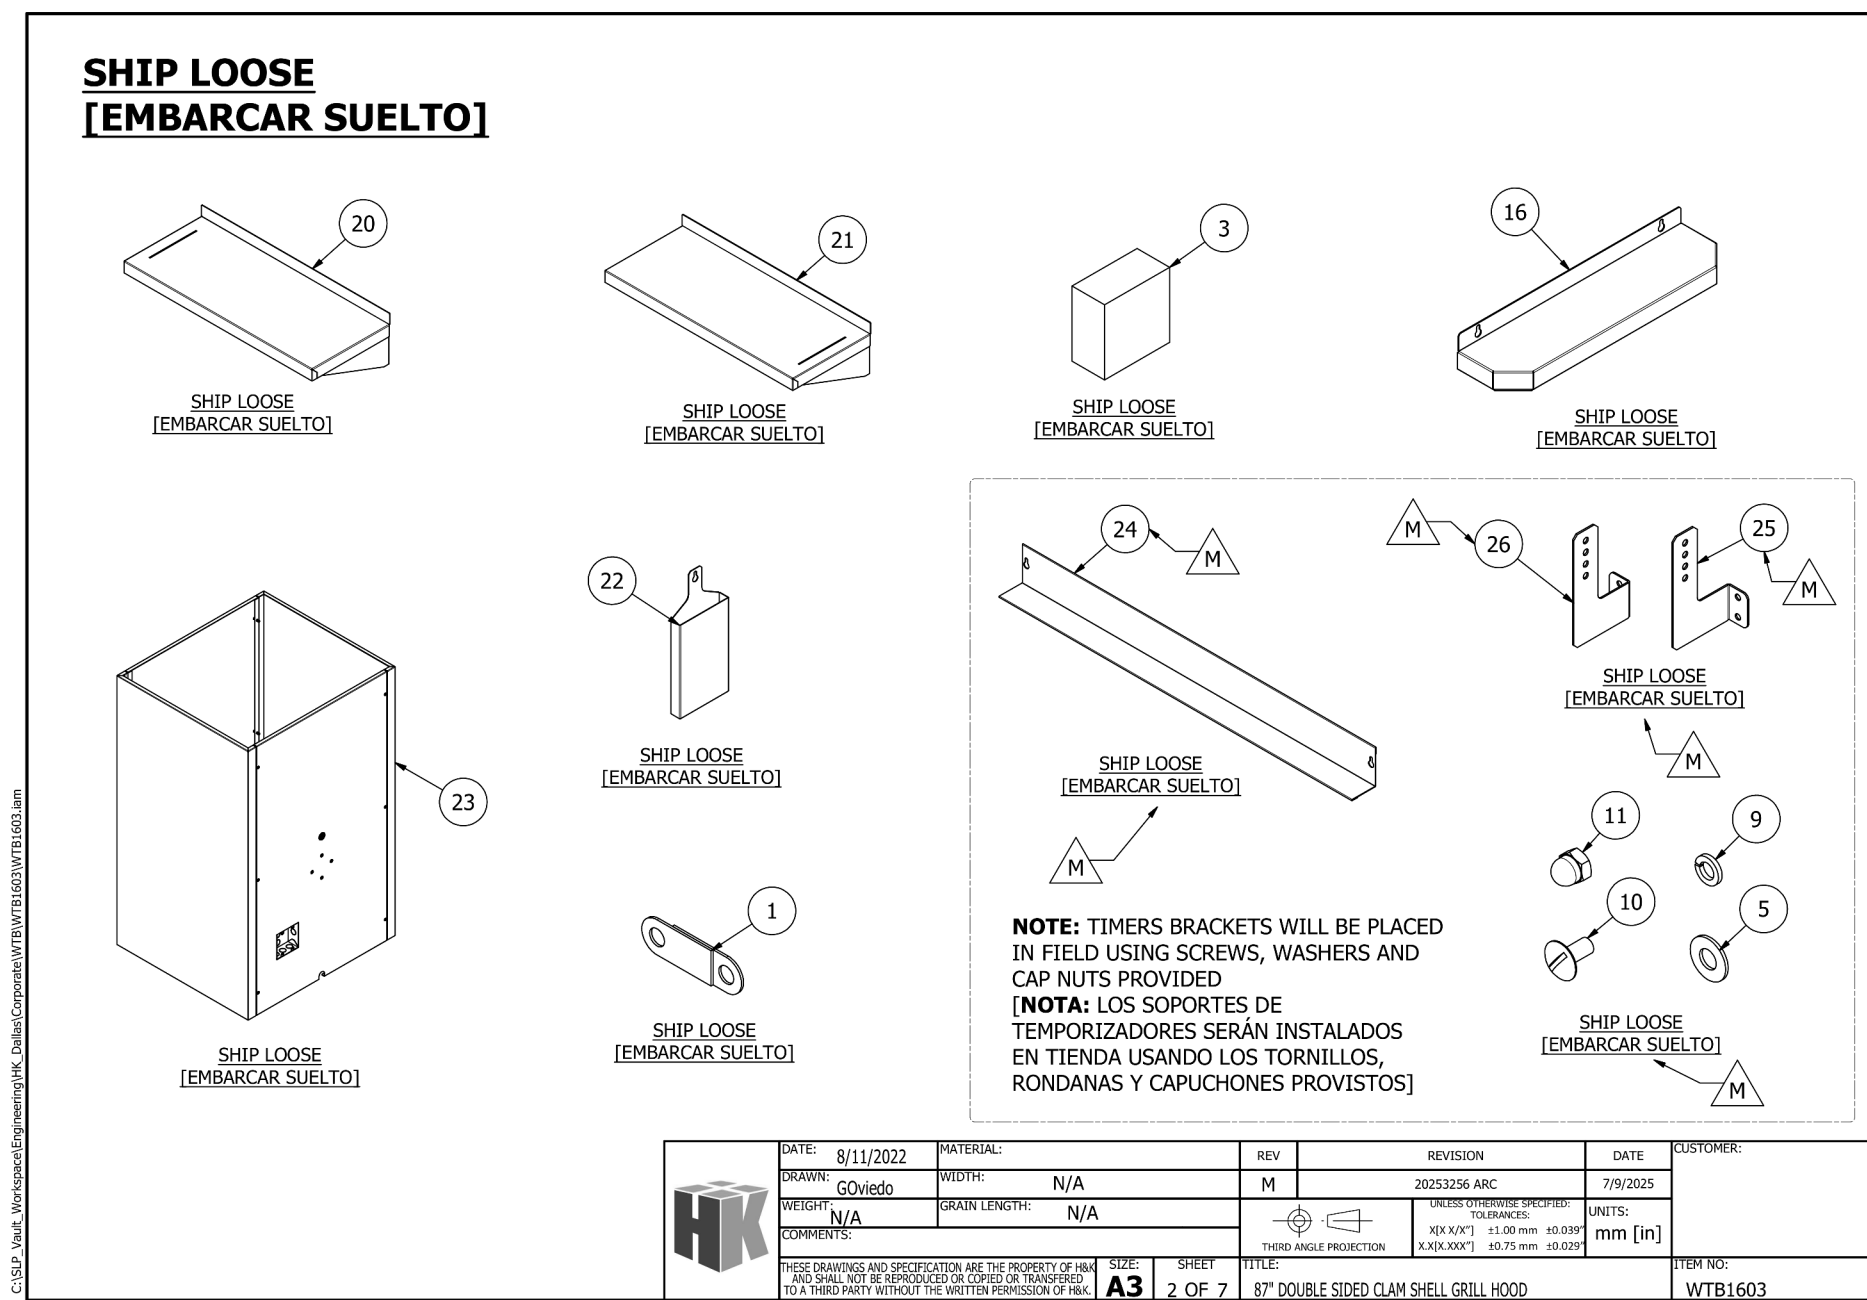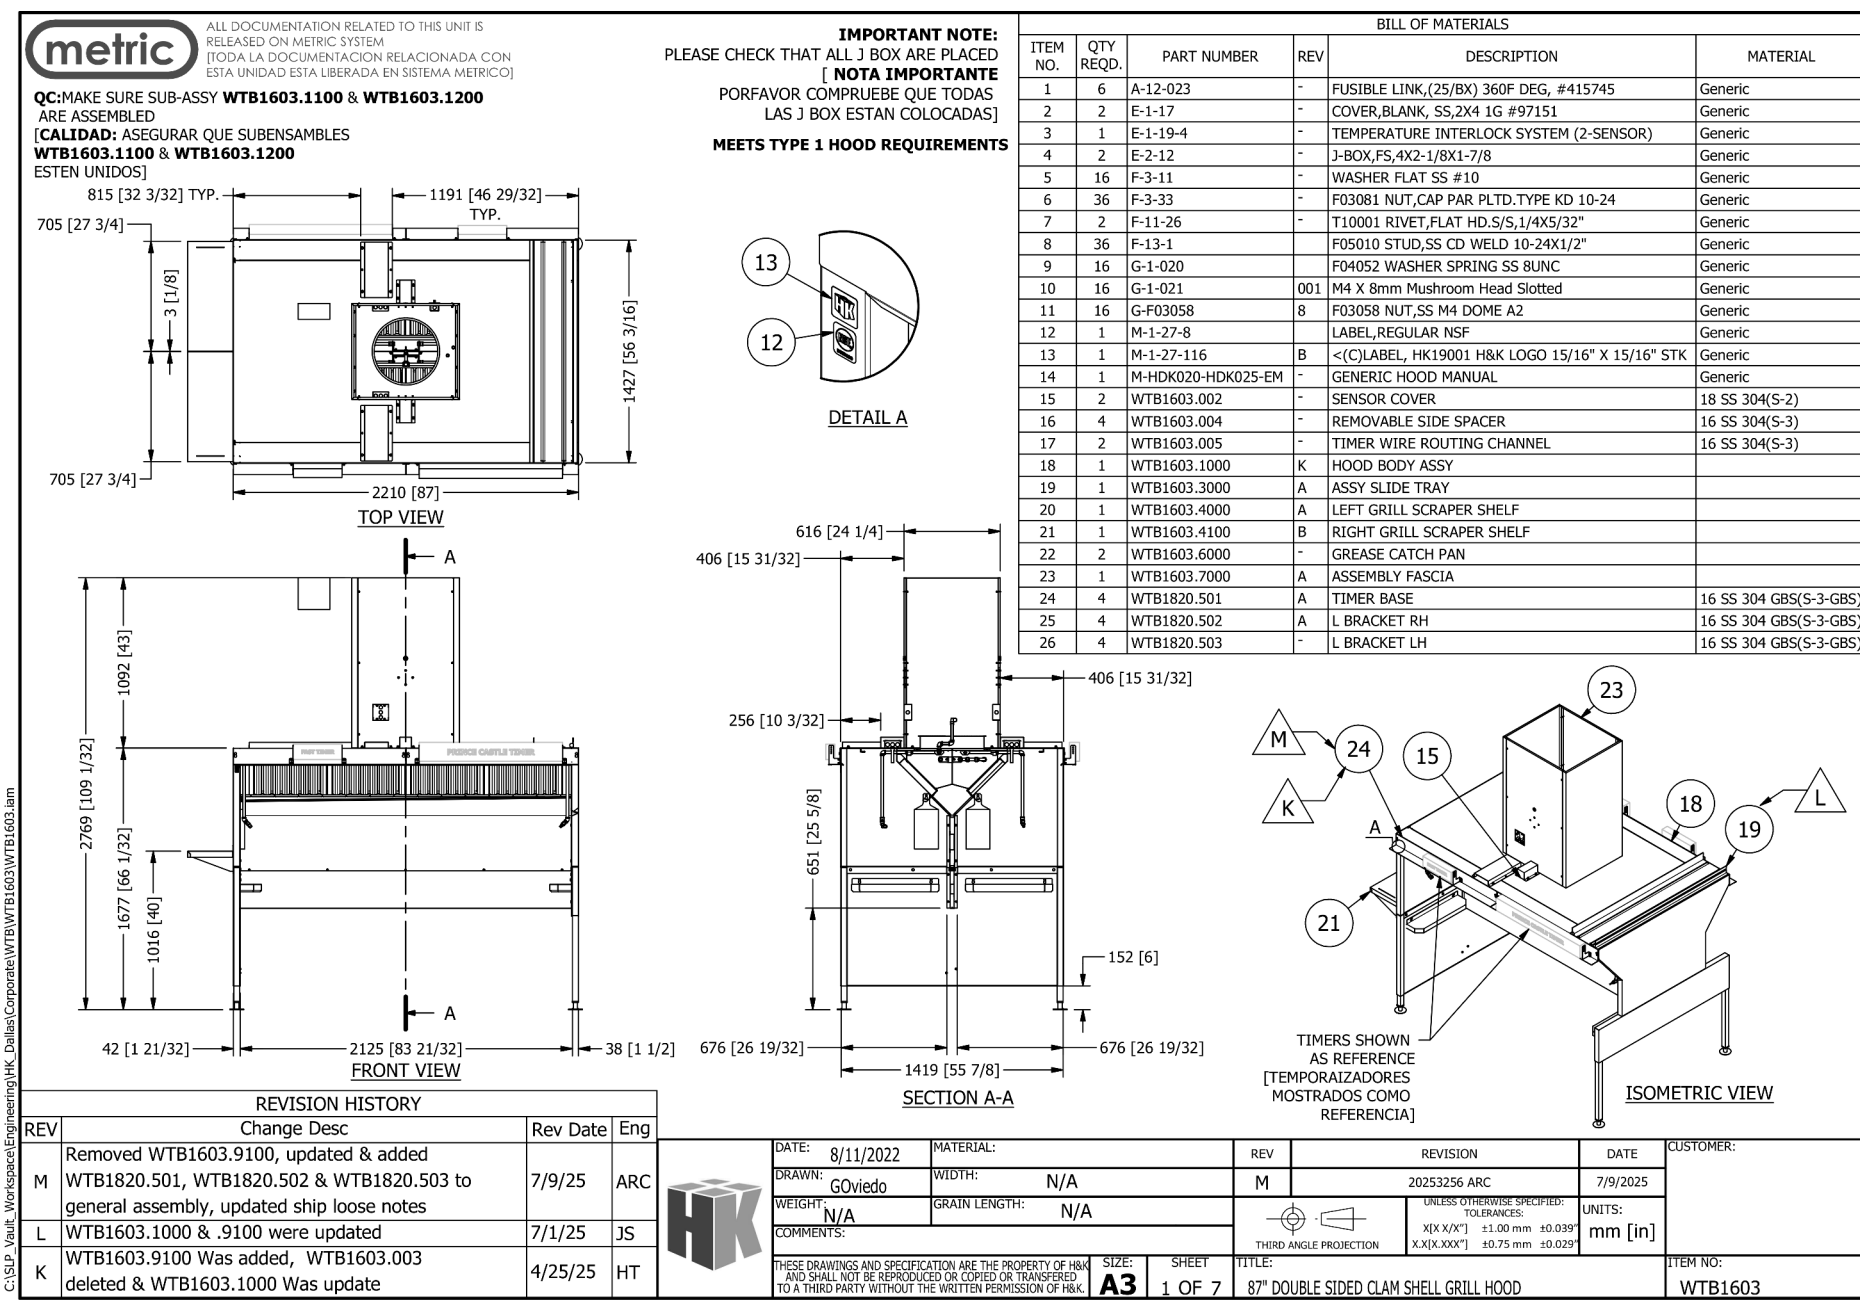

FOR REFERENCE ONLY
HOODS ARE TO BE PROVIDED BY OWNER. HOOD AND DUCT TO BE INSTALLED BY MECHANICAL CONTRACTOR. COMPLETE ANSUL SYSTEM TO BE PROVIDED BY CERTIFIED FIRE SUPPRESSION INSTALLER, REFER TO KITCHEN DRAWINGS FOR ADDITIONAL INFORMATION.

PREPARED FOR:

WHATABURGER


Architecture Engineering Environmental Land Surveying Companies

3420 Torrington Way, Ste 210
Charlotte, NC 28227
(704) 565-7070
(203) 630-2615 Fax

© 2024 BL COMPANIES, INC. THESE DRAWINGS SHALL NOT BE UTILIZED BY ANY PERSON, FIRM OR CORPORATION WITHOUT THE SPECIFIC WRITTEN PERMISSION OF BL COMPANIES.

Prototype Version
09.30.2024 2024 Q3 PT22M Prototype Release

Date Description
5 09/12/2025 MECHANICAL EQUIPMENT UPDATE

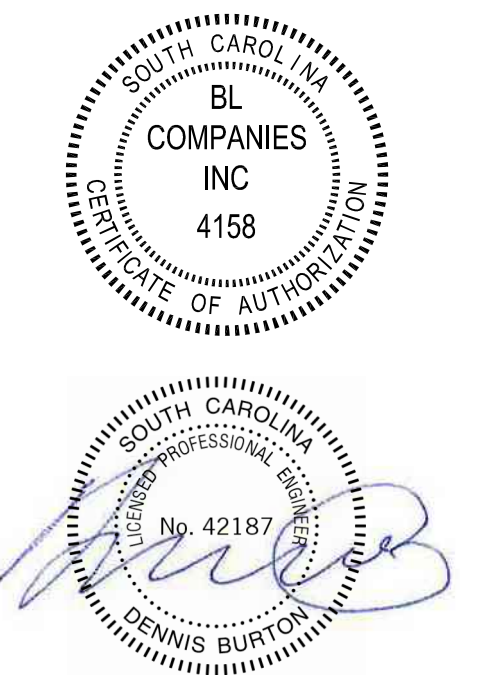

Seal / Signature

Project Name
WHATABURGER ROCK HILL, SC

Date: 12.20.2024

Project Number
2400234

Description
HOOD DRAWINGS

Scale
NOT TO SCALE

M8.2