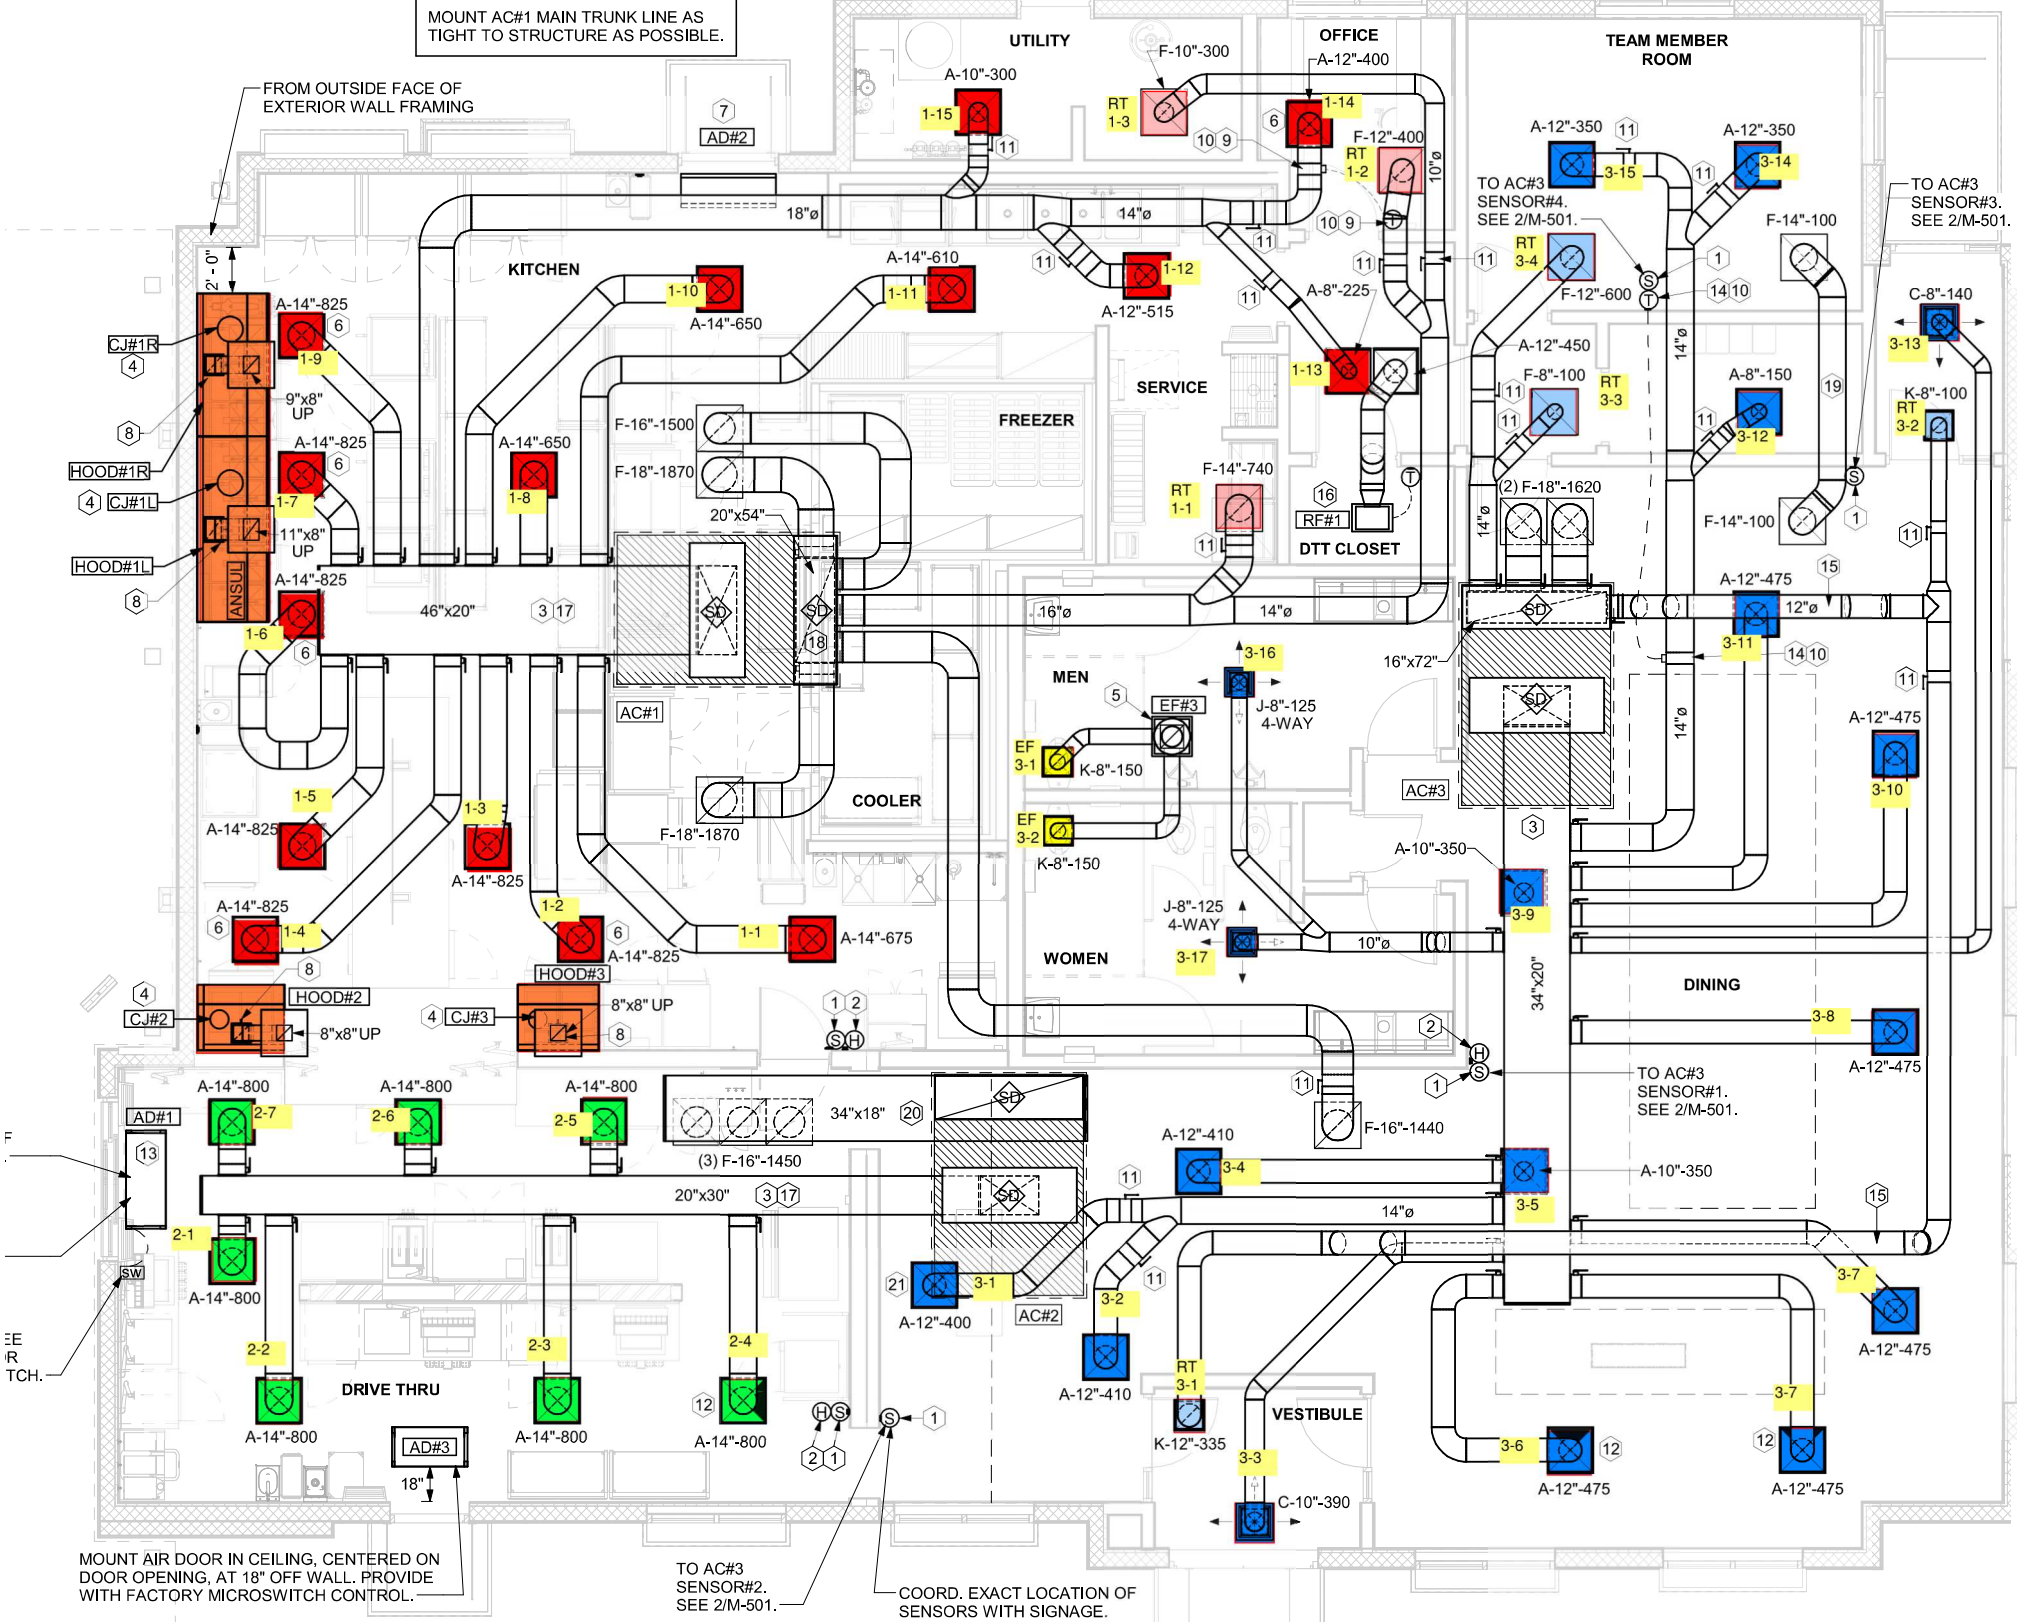
MOUNT AC#1 MAIN TRUNK LINE AS TIGHT TO STRUCTURE AS POSSIBLE.
FROM OUTSIDE FACE OF EXTERIOR WALL FRAMING
UTILITY
OFFICE
TEAM MEMBER ROOM
KITCHEN
SERVICE
FREEZER
DTT CLOSET
MEN
WOMEN
COOLER
DINING
DRIVE THRU
VESTIBULE
AD#1
AD#2
AD#3
AC#1
AC#2
AC#3
HOOD#1R
HOOD#1L
HOOD#2
HOOD#3
CJ#1R
CJ#1L
CJ#2
CJ#3
ANSUL
9"x8" UP
11"x8" UP
8"x8" UP
A-10"-300
F-10"-300
A-12"-400
F-12"-400
A-12"-350
F-14"-100
C-8"-140
K-8"-100
A-14"-825
A-14"-650
A-14"-610
A-12"-515
A-8"-225
A-12"-450
F-8"-100
A-8"-150
F-12"-600
F-14"-740
(2) F-18"-1620
A-12"-475
F-16"-1500
F-18"-1870
20"x54"
46"x20"
16"x72"
J-8"-125 4-WAY
K-8"-150
EF#3
A-10"-350
A-14"-675
34"x20"
34"x18"
(3) F-16"-1450
20"x30"
A-14"-800
A-12"-410
A-12"-400
F-16"-1440
K-12"-335
C-10"-390
RF#1
TO AC#3 SENSOR#4. SEE 2/M-501.
TO AC#3 SENSOR#3. SEE 2/M-501.
TO AC#3 SENSOR#1. SEE 2/M-501.
TO AC#3 SENSOR#2. SEE 2/M-501.
MOUNT AIR DOOR IN CEILING, CENTERED ON DOOR OPENING, AT 18" OFF WALL. PROVIDE WITH FACTORY MICROSWITCH CONTROL.
COORD. EXACT LOCATION OF SENSORS WITH SIGNAGE.