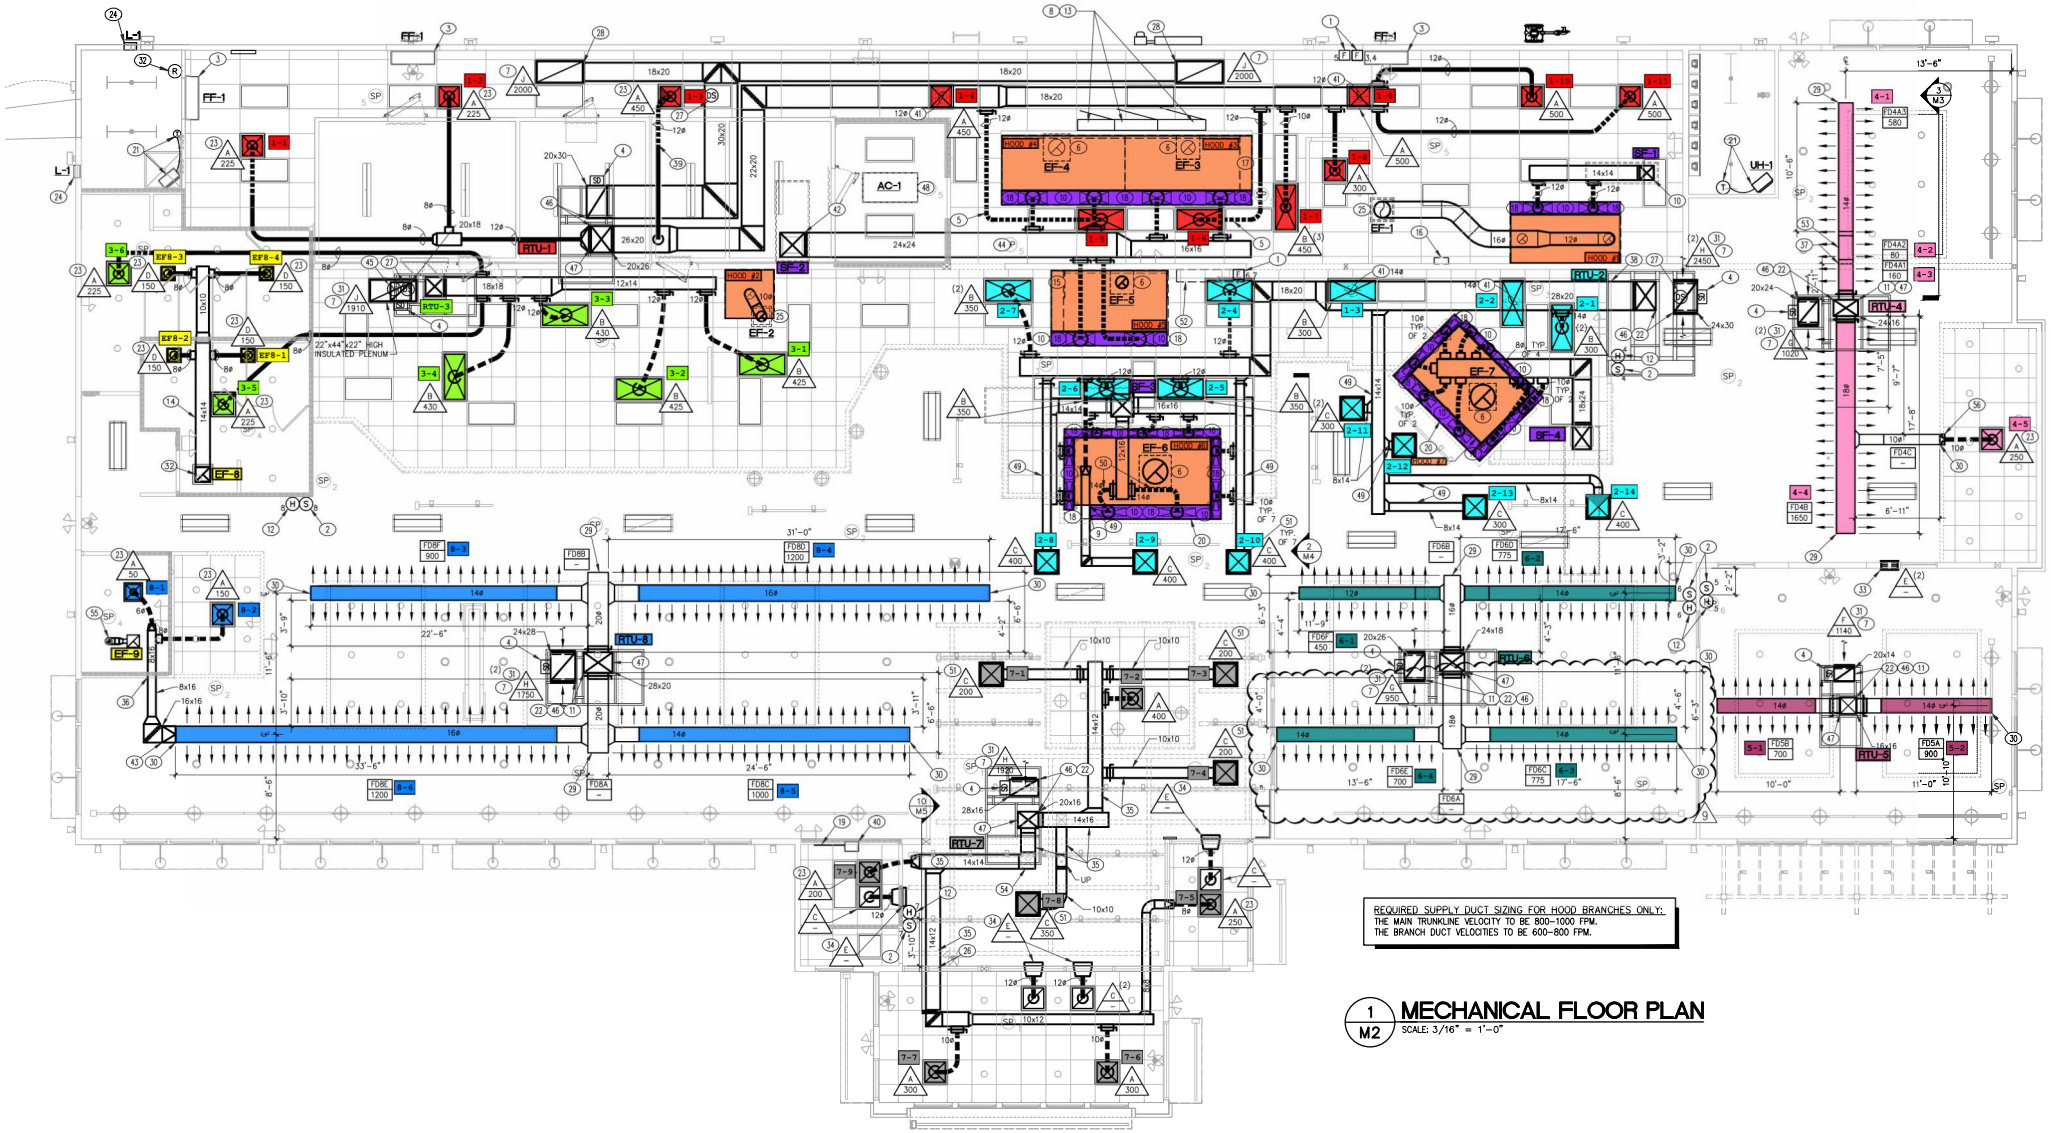

REQUIRED SUPPLY DUCT SIZING FOR HOOD BRANCHES ONLY:
THE MAIN TRUNKLINE VELOCITY TO BE 800-1000 FPM.
THE BRANCH DUCT VELOCITIES TO BE 600-800 FPM.

1 / M2 **MECHANICAL FLOOR PLAN**

SCALE: 3/16" = 1'-0"