

Report By:

National TAB
1329 E. KEMPER ROAD
SUITE 4210
CINCINNATI, OH 45246



Report: TAB Punchlist
Function: Test, Adjust, & Balance
Date: 01/06/2025
Completed By: National TAB

PROJECT

12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)

300 NJ-18 EAST

BRUNSWICK, NJ 08816

Client

CAVA
702 H ST NW
2nd floor

Washington, DC 20001

National TAB

Project: 12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)

Table Of Contents

Section	Page #
Remarks	3

Issue List

- Dining-BOH Transfer Grille
- KEF-1 Grease cup
- KEF-1 Lid latches
- Kitchen Transfer Grille



12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)

Project Issue Information

Issue Name : Dining-BOH Transfer Grille
Description : Transfer grille is not connected from dining corridor to the BOH storage room. Duct connection at the one grille is not well sealed.
Created By : National TAB **Assigned To :** National TAB - Tyler Youells
Status : Open
Priority : Low **Asset Tag :**
Originated Date : 01/06/2025 - Tyler Youells - National TAB


Project Issue File Details



01/06/2025



01/06/2025

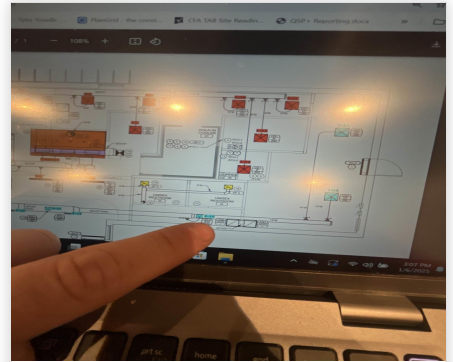

01/06/2025



12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)

Project Issue Information

Issue Name : KEF-1 Grease cup
Description : KEF-1 Grease cup is not yet installed. Grease will drip onto roof when cooking starts
Created By : National TAB **Assigned To :** National TAB - Tyler Youells
Status : Open
Priority : Low **Asset Tag :**
Originated Date : 01/06/2025 - Tyler Youells - National TAB


Project Issue File Details



01/06/2025

Project Issue Response Details

- **01/06/2025 National TAB - Tyler Youells**
 - PER Revision KEF-1 is supposed to have a Viroguard Grease trough installed and not a grease cup.

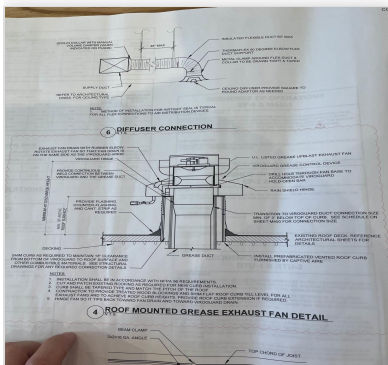

01/06/2025



12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)


Project Issue Information

Issue Name : KEF-1 Lid latches
Description : The kid on KEF-1 is missing two of the three latches.
Created By : National TAB **Assigned To :** National TAB - Tyler Youells
Status : Open
Priority : Low **Asset Tag :**
Originated Date : 01/06/2025 - Tyler Youells - National TAB

Project Issue File Details



01/06/2025

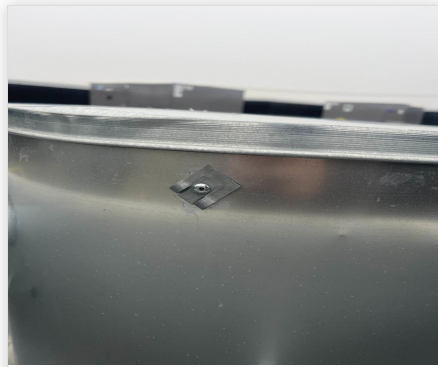

01/06/2025



01/06/2025




12-30-24 CAVA BRUNSWICK, NJ (MIDSTATE MALL)

Project Issue Information

Issue Name : Kitchen Transfer Grille
Description : Kitchen Transfer grille is not connected to the BOH side. Kitchen side is also not sealed to the grille.
Created By : National TAB **Assigned To :** National TAB - Tyler Youells
Status : Open
Priority : Low **Asset Tag :**
Originated Date : 01/06/2025 - Tyler Youells - National TAB


Project Issue File Details

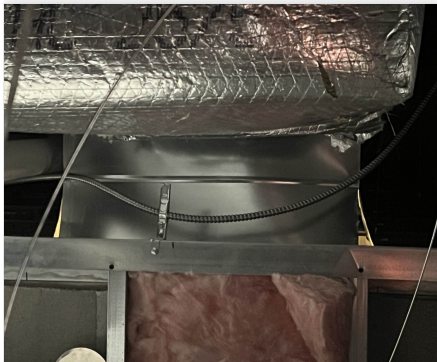

01/06/2025



01/06/2025

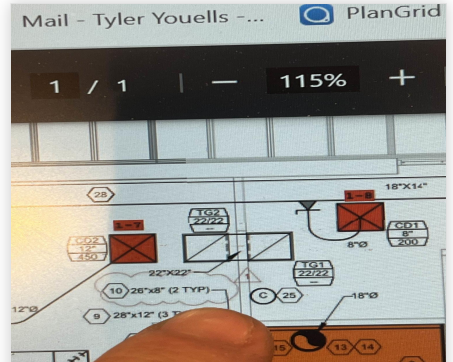

01/06/2025