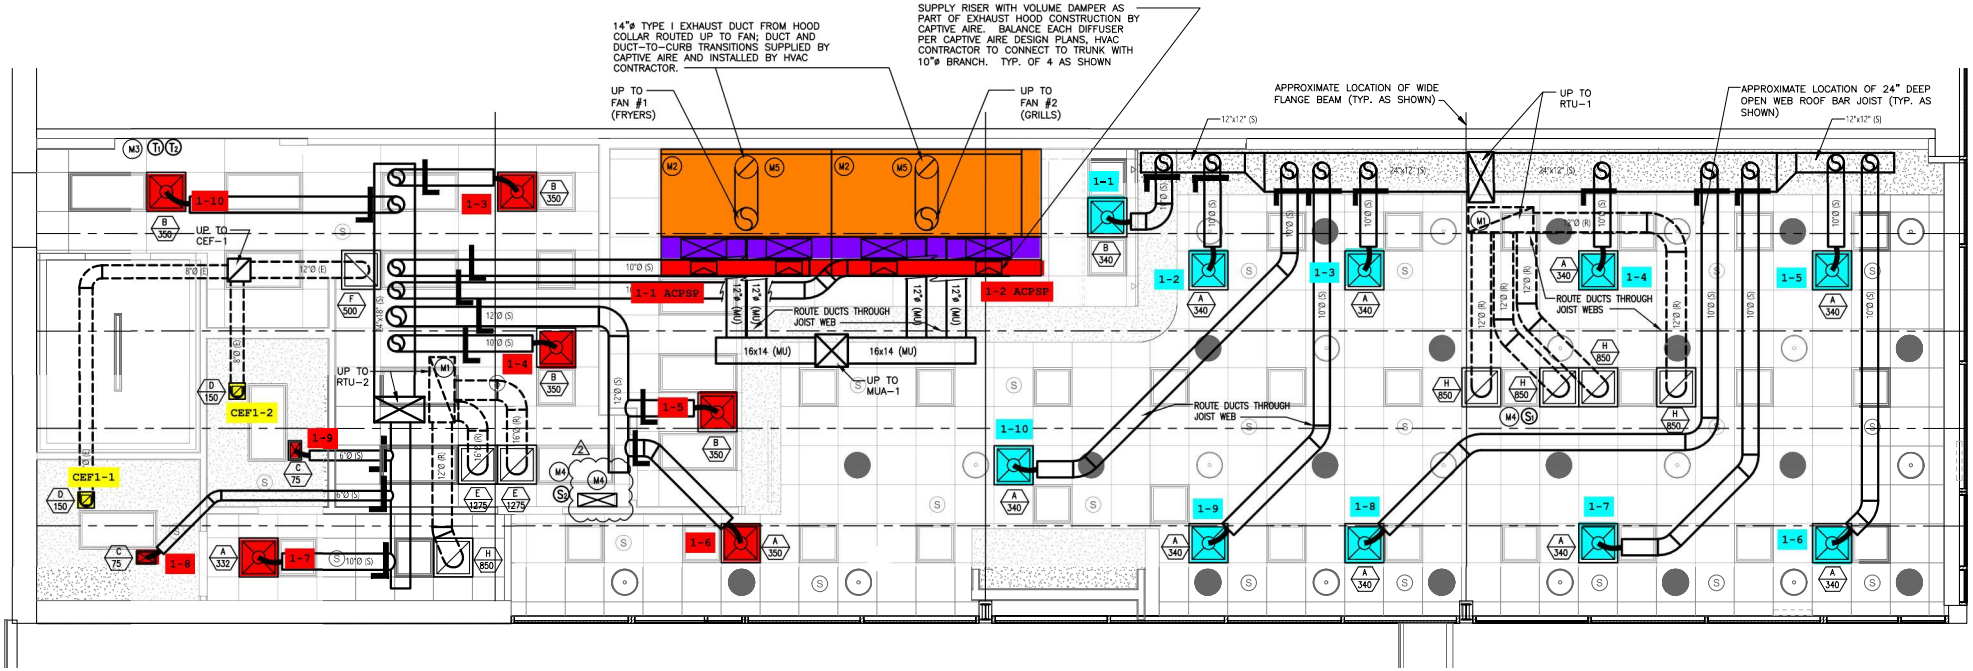
14"ø TYPE I EXHAUST DUCT FROM HOOD COLLAR ROUTED UP TO FAN; DUCT AND DUCT-TO-CURB TRANSITIONS SUPPLIED BY CAPTIVE AIRE AND INSTALLED BY HVAC CONTRACTOR.
SUPPLY RISER WITH VOLUME DAMPER AS PART OF EXHAUST HOOD CONSTRUCTION BY CAPTIVE AIRE. BALANCE EACH DIFFUSER PER CAPTIVE AIRE DESIGN PLANS. HVAC CONTRACTOR TO CONNECT TO TRUNK WITH 10"ø BRANCH. TYP. OF 4 AS SHOWN
UP TO FAN #1 (FRYERS)
UP TO FAN #2 (GRILLS)
APPROXIMATE LOCATION OF WIDE FLANGE BEAM (TYP. AS SHOWN)
UP TO RTU-1
APPROXIMATE LOCATION OF 24" DEEP OPEN WEB ROOF BAR JOIST (TYP. AS SHOWN)
UP TO CEF-1
UP TO RTU-2
CEF1-1
CEF1-2
1-1 ACPSP
1-2 ACPSP
ROUTE DUCTS THROUGH JOIST WEB
16x14 (MU)
UP TO MUA-1
ROUTE DUCTS THROUGH JOIST WEBS
1-1
1-2
1-3
1-4
1-5
1-6
1-7
1-8
1-9
1-10