


**2018 SCMC VENTILATION CALCULATIONS**

SECTION 403 311 - EQUIPMENT  
 R= 7.5 COMPRESSOR (TABLE 403.3)  
 F= 40 PEOPLE (85/175)  
 V=2700 CFM/AK

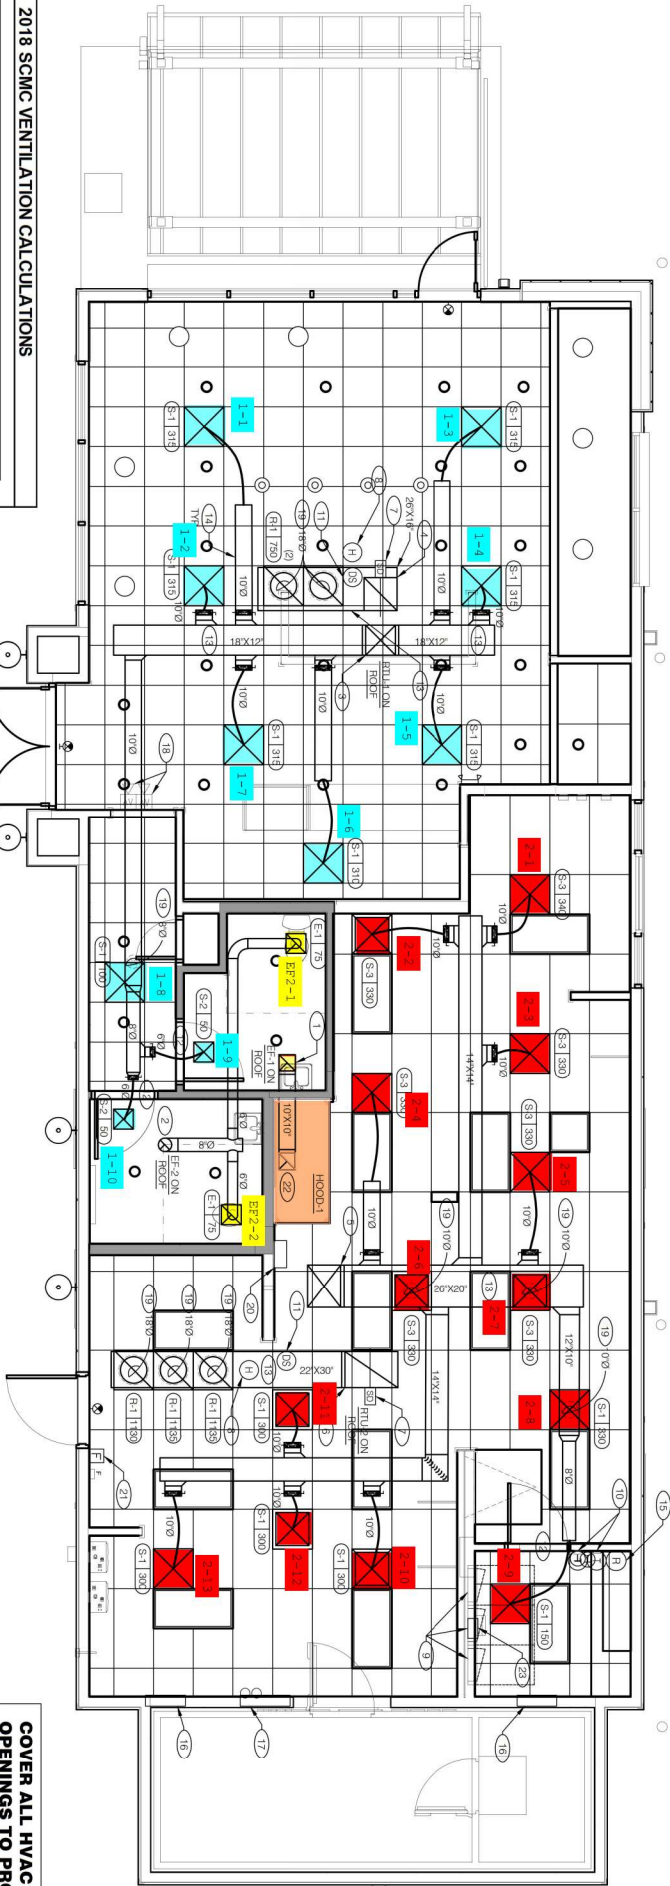

**COVER ALL HVAC DUCT SYSTEM OPENINGS TO PROTECT FROM CONSTRUCTION DUST AND DEBRIS UNTIL CONSTRUCTION IS COMPLETE**

DINNS AREA