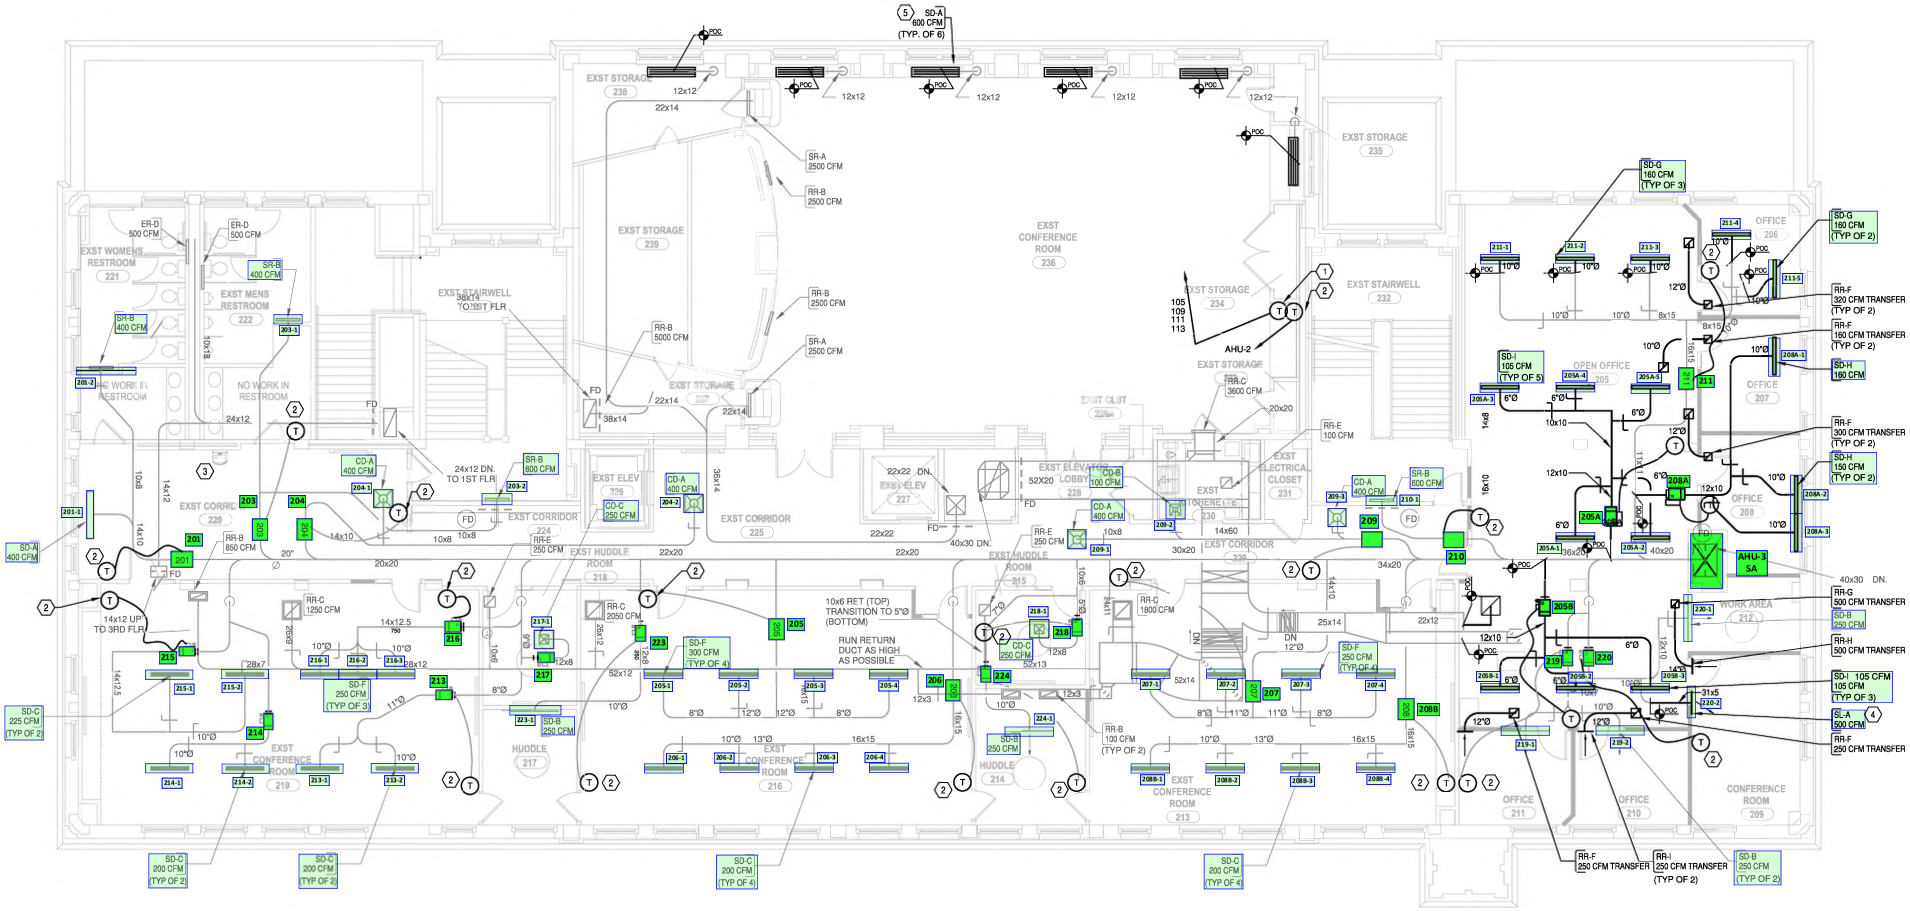
EXST STORAGE 238
EXST STORAGE 239
EXST CONFERENCE ROOM 236
EXST STORAGE 235
EXST STORAGE 234
EXST STAIRWELL 232
EXST WOMENS RESTROOM 221
EXST MENS RESTROOM 222
NO WORK IN RESTROOM
EXST STAIRWELL TO 1ST FLR
EXST STORAGE 237
EXST ELEV 226
EXST ELEV 227
EXST ELEVATOR LOBBY 228
EXST CLST 229A
EXST ELECTRICAL CLOSET 231
EXST TOILETTE 230
EXST CORRIDOR 220
EXST CORRIDOR 224
EXST CORRIDOR 225
EXST CORRIDOR 229
EXST HUDDLE ROOM 218
EXST HUDDLE ROOM 215
HUDDLE 217
HUDDLE 214
EXST CONFERENCE ROOM 219
EXST CONFERENCE ROOM 216
EXST CONFERENCE ROOM 213
OFFICE 206
OPEN OFFICE 205
OFFICE 207
OFFICE 208
WORK AREA 212
OFFICE 211
OFFICE 210
CONFERENCE ROOM 209
AHU-2
AHU-3 5A
SD-A 600 CFM (TYP. OF 6)
SR-A 2500 CFM
RR-B 2500 CFM
RR-B 5000 CFM
RR-C 3600 CFM
RR-E 100 CFM
ER-D 500 CFM
SR-B 400 CFM
CD-A 400 CFM
CD-B 100 CFM
CD-C 250 CFM
RR-B 850 CFM
RR-E 250 CFM
RR-C 1250 CFM
RR-C 2050 CFM
RR-C 1800 CFM
SD-A 400 CFM
SD-C 225 CFM (TYP OF 2)
SD-C 200 CFM (TYP OF 2)
SD-C 200 CFM (TYP OF 4)
SD-F 250 CFM (TYP OF 3)
SD-F 300 CFM (TYP OF 4)
SD-F 250 CFM (TYP OF 4)
SD-B 250 CFM
SD-B 100 CFM (TYP OF 2)
SD-G 160 CFM (TYP OF 3)
SD-G 160 CFM (TYP OF 2)
SD-I 105 CFM (TYP OF 5)
SD-H 160 CFM
SD-H 150 CFM (TYP OF 2)
SD-I 105 CFM 105 CFM (TYP OF 3)
SL-A 500 CFM
RR-F 320 CFM TRANSFER (TYP OF 2)
RR-F 160 CFM TRANSFER (TYP OF 2)
RR-F 300 CFM TRANSFER (TYP OF 2)
RR-G 500 CFM TRANSFER
RR-H 500 CFM TRANSFER
RR-F 250 CFM TRANSFER
RR-I 250 CFM TRANSFER (TYP OF 2)
14x12 UP TO 3RD FLR
24x12 DN. TO 1ST FLR
10x6 RET (TOP) TRANSITION TO 5"Ø (BOTTOM)
RUN RETURN DUCT AS HIGH AS POSSIible
40x30 DN.
22x22 DN.