

H.E.S. SYSTEM
 MECHANICAL CONTRACTOR TO PROVIDE AND INSTALL
 SMOKEST-LESS SYSTEM FOR ALL NEW HOODS. SEE
 HOOD FAN/EQUIPMENT INTERLOCK WIRING DIAGRAM
 ON SHEET M41 FOR MORE INFORMATION.


AS OBTAIN REMOVE WALL SWITCHES BY MECHANICAL. REFER
 TO ARCHITECT'S DRAWING FOR ALL CHANGES. PROVIDE
 TO ARCHITECT SCHEDULE AND CHAIN WIRING DIAGRAM
 FOR FUTURE INFORMATION. COORDINATE EXACT LOCATION
 FOR SWITCHES WITH KITCHEN EQUIPMENT AND PLANS.

NEW AIR OUTTAKE LOGS MOUNTED IN CEILING GRID
 ON TOP OF HOODS. PROVIDE TO ARCHITECT SCHEDULE
 WALL MECHANICAL CONTRACTOR SHALL ADJUST
 AIR DEFLECTORS TOWARD AIR DIVERTER BOX.

RE-BALANCE SUPPLY GRILLES
 TO 325 CFM SUPPLY EACH
 NEW ADW3

RE-BALANCE SUPPLY GRILLES
 TO 350 CFM
 SUPPLY EACH
 NEW ADW3

HOLD DUCT AT 40H AND
 AS HIGH AS POSSIBLE
 DUE TO LIMITED
 CEILING

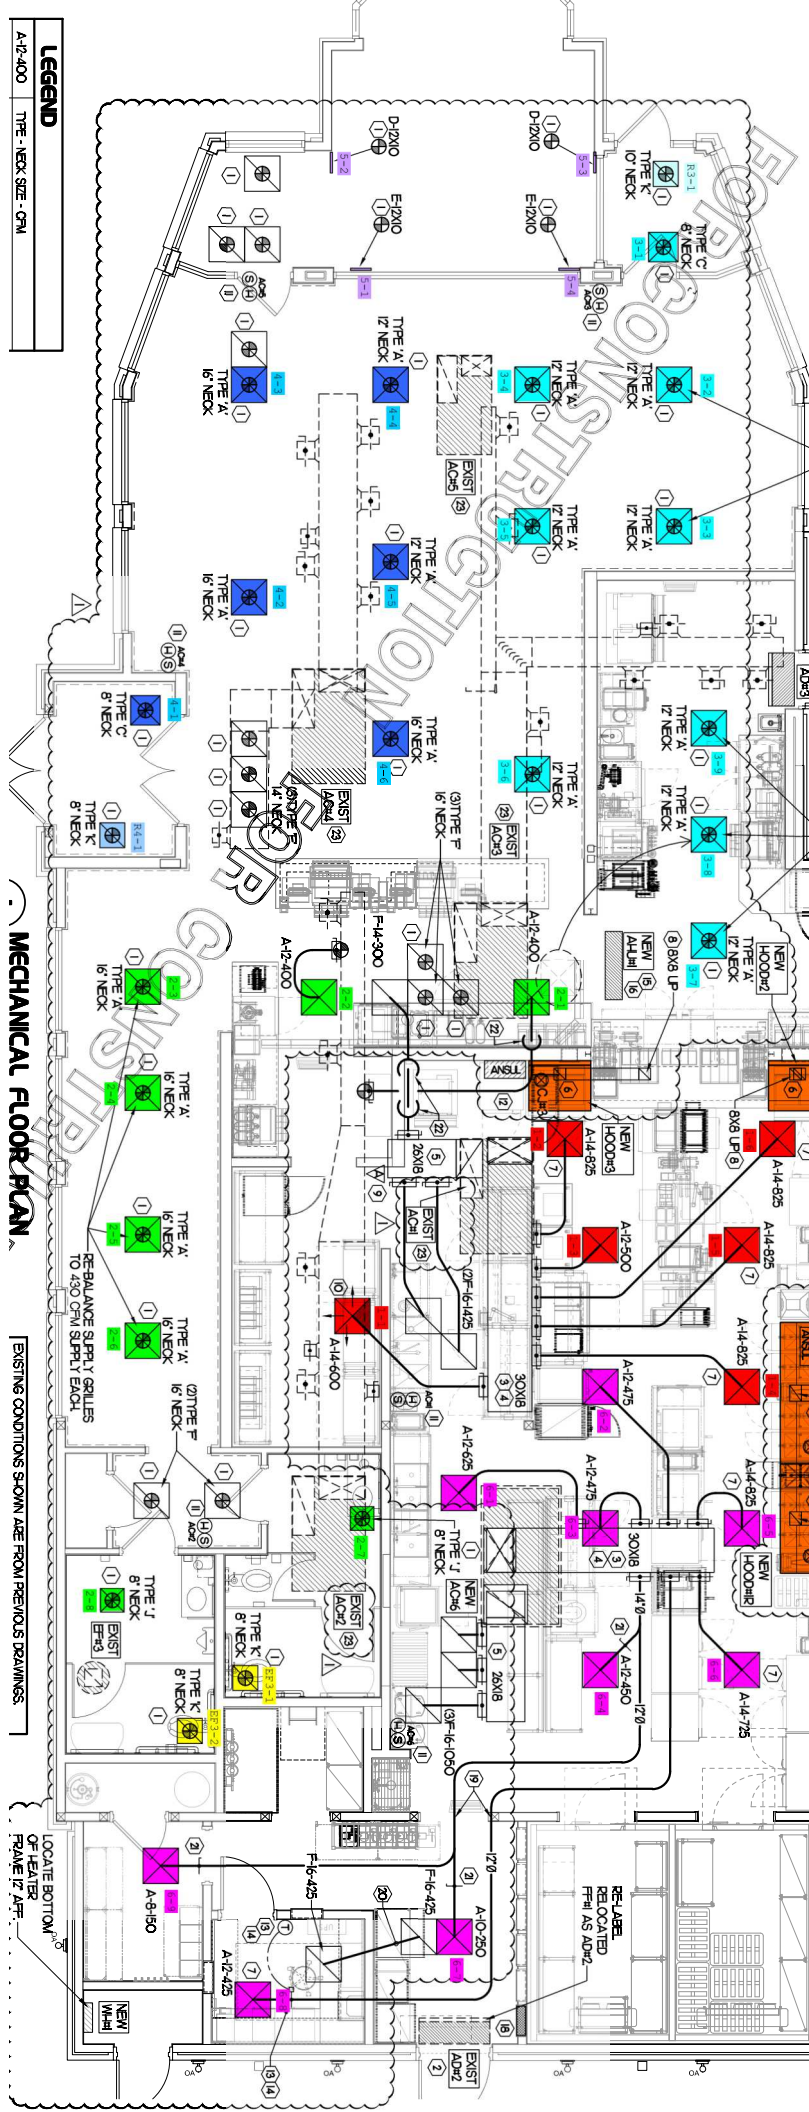

LEGEND
 A-12-400 TYPE - NECK SIZE - CFM

MECHANICAL FLOOR PLAN

EXISTING CONDITIONS SHOWN ARE FROM PREVIOUS DRAWINGS.

LOCATE BOTTOM OF HEATER FRAME IF APP.