


MECHANICAL FLOOR PLAN

1/2" = 1'-0"

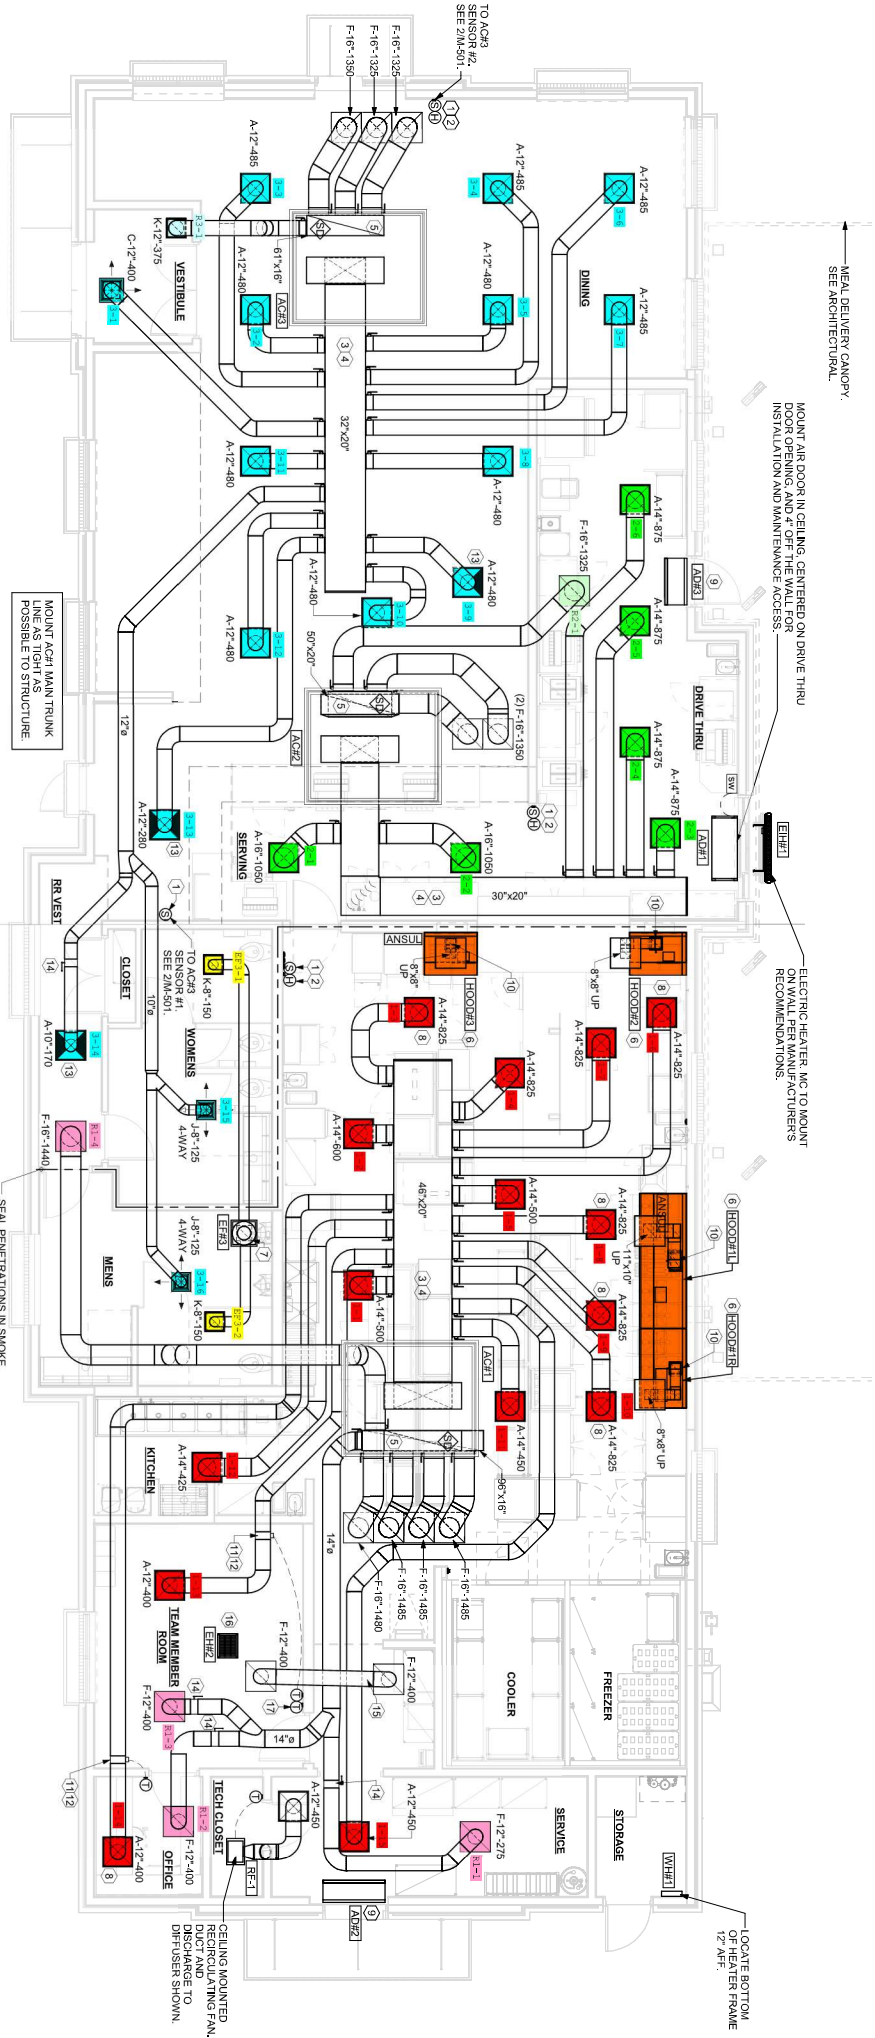

MEAL DELIVERY CANOPY,  
SEE ARCHITECTURAL.

Mount air coils in ceiling centered on drive thru  
doors opening and off the wall for  
installation and maintenance access.

ELECTRIC HEATER NOT TO MOUNT  
ON WALL PER MANUFACTURER'S  
RECOMMENDATIONS.

LOCATE BOTTOM  
OF HEATER FRAME  
12" MIN.

SEAL PENETRATIONS IN SPACE  
DRAFT CURTAIN AIR TIGHT. SEE  
ARCH PLANS FOR CONSTRUCTION.

Mount light main trunk  
line as tight as  
possible to structure.

CEILING MOUNTED  
DUCT AND  
DISCHARGE TO  
DIFFUSER SHOWN.