



Culvers
Hartford, WI



Thermostats



RTU-1




RTU-2
Cool line diffuser installation correct



PRV-2
HD-2 griddle



PRV-2

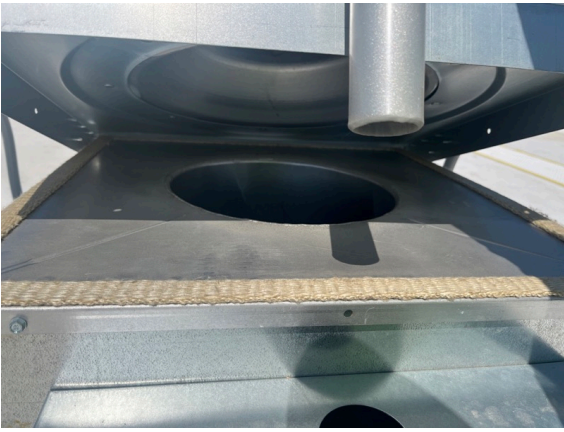

PRV-2
Grease duct




PRV-2



Captive Aire Hood HMI



HD-1
Griddle

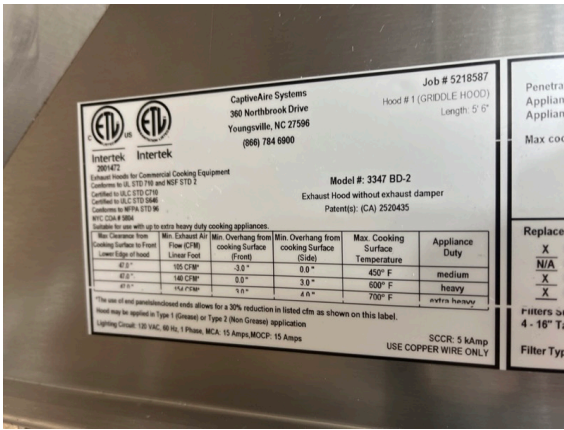

HD-1
Unit label



PRV-3
Fryer



PRV-3



PRV-3



PRV-3




HD-2



HD-2
Unit label



PRV-1
Restrooms

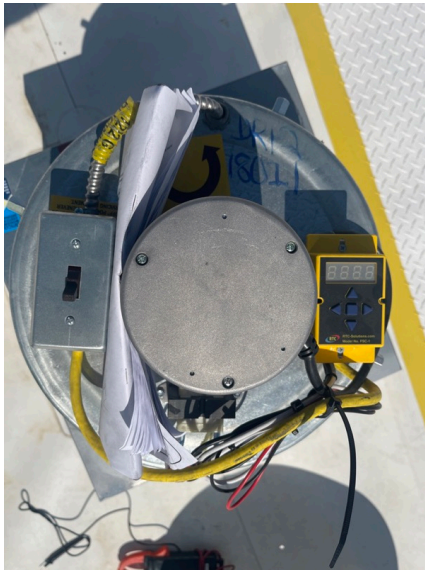

PRV-1



PRV-1
Backdraft damper installed and able
To move freely.



EF-1

EF-1

