

1 HVAC FLOOR PLAN
M1.0 1/4" = 1'-0"

KEY NOTES:

- 1 REMOVE SMOKE DETECTOR TEST STATIONS FOR RTU-1, 2, & 3. TEST STATIONS TO BE MOUNTED ON THE MANAGER'S OFFICE WALL. SECURITY CONTRACTOR SHALL WIRE RTU FACTORY MOUNTED SMOKE DETECTORS TO SECURITY/FIRE ALARM PANEL. MECHANICAL CONTRACTOR SHALL PROVIDE TEST STATION AND WIRING BETWEEN COMPONENTS AS WELL AS WIRING TO SHUT DOWN THE A/C FAN UPON ACTIVATION OF THE SMOKE DETECTOR. G.C. TO TEST THE SMOKE DETECTOR FUNCTIONS WITH THE WAVA PROJECT MANAGER.
- 2 WALL MOUNTED SENSOR(S) FOR EACH MECHANICAL UNIT PER ROOFTOP UNIT SCHEDULE ON SHEET M3.0. G.C. SHALL INSTALL AND WIRE TO UNIT. BAS CONTRACTOR SHALL CONNECT TO MECHANICAL UNIT ONLY.
- 3 COORDINATE EXACT LOCATION OF EXHAUST FAN PENETRATION WITH ARCHITECTURAL ROOF PLAN. INSTALL GALVANIZED DUCT WORK DOWN FROM FAN INTO CEILING/JOIST SPACE, AND CONNECT TO CEILING GRILLES.
- 4 REFER TO TYPICAL DUCT PLENUM DETAIL ON SHEET M3.0.
- 5 COORDINATE DUCT WITH STRUCTURE IN THIS LOCATION. COORDINATE TAKEOFF LOCATIONS WITH ANGLED WEB MEMBERS.
- 6 PROVIDE SURFACE MOUNT ADAPTER FRAME TO ALLOW ACCESS TO CEILING ABOVE THROUGH DIFFUSER OPENING. SEE AIR DEVICE SCHEDULE.
- 7 ROUTE DUCT UNDER STRUCTURAL MEMBERS AT THIS LOCATION.
- 8 DUCTWORK TO RUN WITHIN JOIST SPACING. MECHANICAL CONTRACTOR TO COORDINATE MECHANICAL WORK WITH ALL TRADES PRIOR TO INSTALLATION.
- 9 DUCT TAKEOFF WITH DAMPER FROM BOTTOM OF MAIN DUCT.
- 10 TRANSFER DUCT ASSEMBLY.
- 11 PROVIDE SEALED 20"x20" PLENUM BOX ASSEMBLY ABOVE TRANSFER GRILLES TO ALLOW FLEX TRANSFER DUCT CONNECTIONS.
- 12 GRILLE OPEN TO ABOVE CEILING.
- 13 INSTALL EXHAUST FAN ABOVE CEILING PER DETAIL SHEET M3.0. FAN SHALL BE WIRED TO EMERGENCY SHUTOFF SWITCH PROVIDED BY OTHERS. REFERENCE ARCHITECTURAL AND ELECTRICAL DRAWINGS.
- 14 MOUNT CENTER OF EXHAUST GRILLE AT 12" ABOVE FINISHED FLOOR. ROUTE DUCT SIZED AS SHOWN FROM GRILLE. UP IN WALL CAVITY TO ABOVE CEILING, THEN TO EXHAUST FAN AND OUT TO EXTERIOR WALL LOUVER. COORDINATE DUCT ROUTING WITH ALL OTHER TRADES.

SHEET GENERAL NOTE:

A. MECHANICAL CONTRACTOR SHALL ADJUST ALL LINEAR SLOT DIFFUSERS TO A GENERALLY VERTICAL FLOW. ADJUSTMENT SHALL BE MADE SO AS TO AVOID AIRFLOWS ON SENSORS, REFRIGERATION CASES, OR OPEN FOOD REFRIGERATION EQUIPMENT.

HVAC LEGEND

SYMBOL	DESCRIPTION
	NEW RECTANGULAR OR ROUND DUCT
	FLEXIBLE DUCT
	SUPPLY AIR DUCTWORK UP THROUGH PLAN
	RETURN AIR DUCTWORK UP THROUGH PLAN
	EXHAUST AIR DUCTWORK UP THROUGH PLAN
	90° ELBOW WITH TURNING VANES
	MANUAL AIR VOLUME CONTROL DAMPER
	4 WAY SUPPLY DIFFUSER
	3 WAY SUPPLY DIFFUSER
	2 WAY OPPOSED SUPPLY DIFFUSER
	2 WAY CORNER SUPPLY DIFFUSER
	RETURN AIR DEVICE
	EXHAUST AIR DEVICE
	AIR CURTAIN
	LINEAR SLOT DIFFUSER WITH PLENUM
	COMBINATION TEMPERATURE/HUMIDITY SENSOR
	TEMPERATURE SENSOR
	CO2 SENSOR
	TYPE MARK
	MECHANICAL EQUIPMENT TAG
	CONDENSATE PIPING
	ROOF MOUNTED EXHAUST FAN
	INLINE EXHAUST FAN
	PACKAGED ROOFTOP AIR CONDITIONER

2600 Maitland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
C-P.com

**CUHACI
PETERSON**

Copyright © All rights reserved. No part of this document may be reproduced without written permission from C & P a division of Federal copyright laws.

CLIENT NAME
WAWA
260 WEST BALTIMORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F88FF L v2021.3
STORE #5434
SR 18 & SR 100 (REID ST)
PALMATA, FL


DATE
06/15/2023

No.	Description	Date
1	MECHANICAL SET	06/05/2022
A	CHANGE	06/01/2023
B	PRE-BID SET	03/01/2023
C	PROT. UPDATE V21.3	03/27/2023
D	CONSTRUCTION SET	06/15/2023

PROJECT NO.
2203096
DATE
06-25-2023
DRAWN
PAK
CHECKED
JJD

M1.0

HVAC FLOOR PLAN

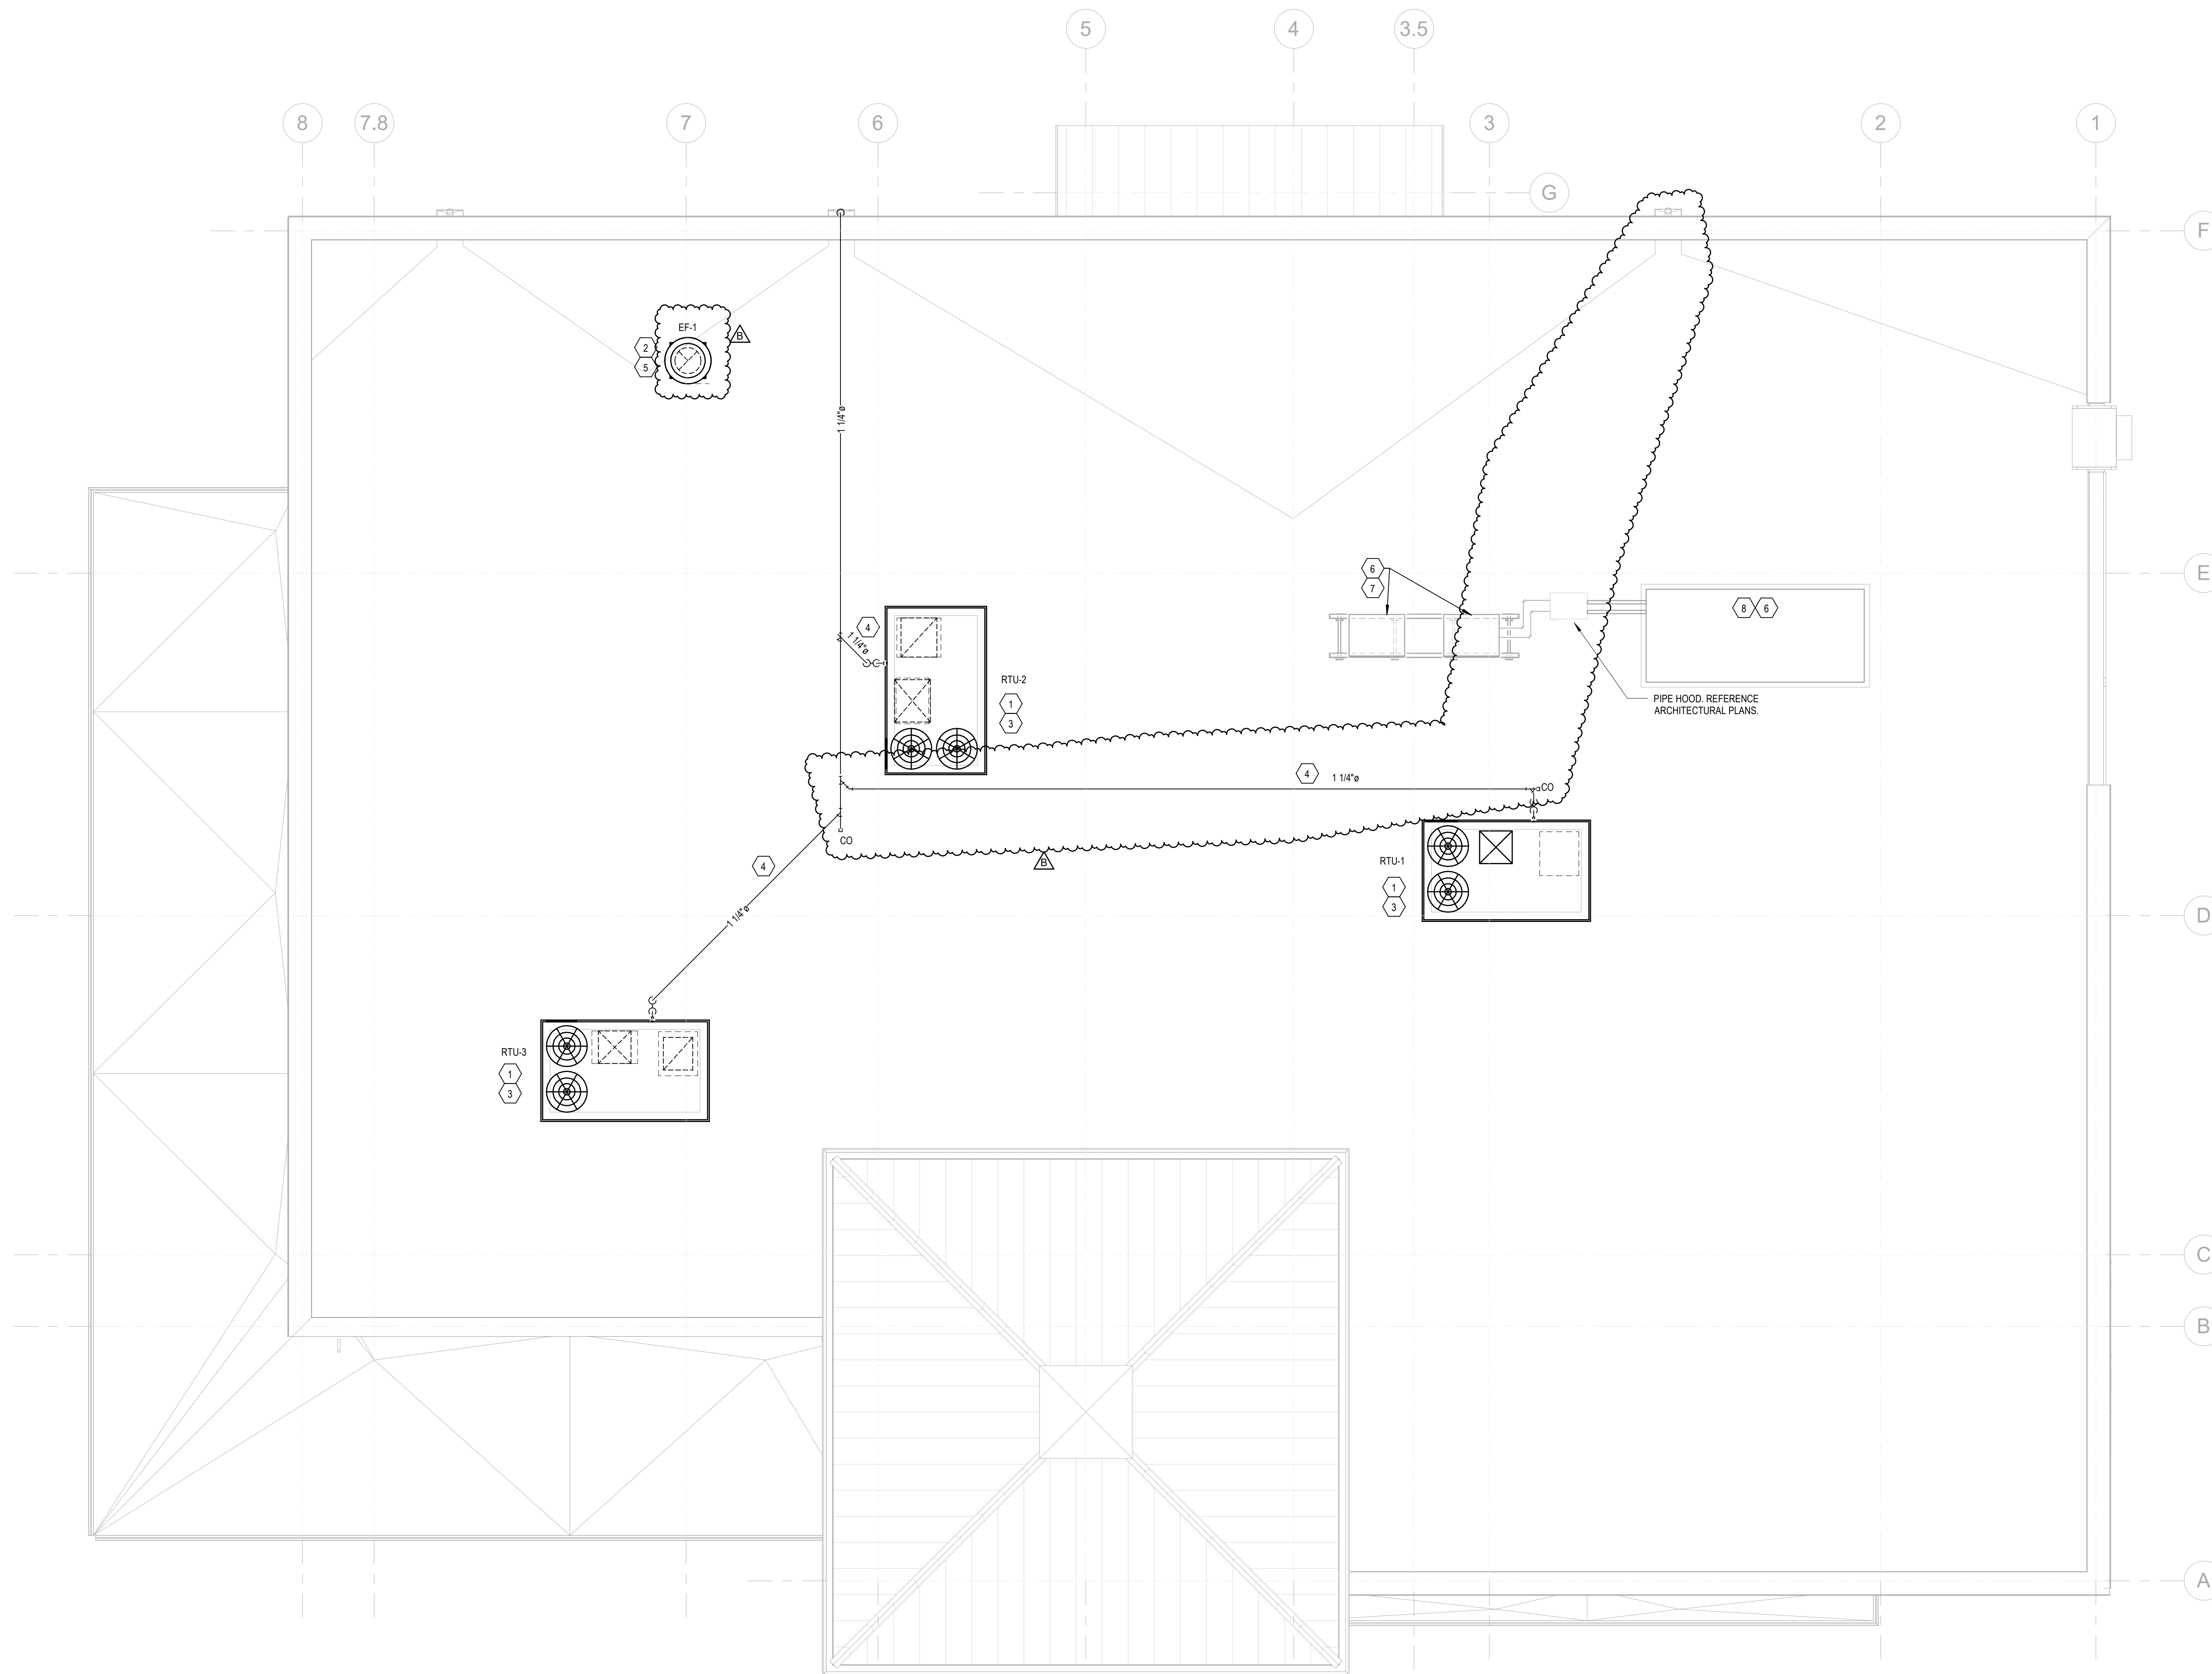

- KEY NOTES:**
- 1 FACTORY INSTALLED SMOKE DETECTOR IN MAIN SUPPLY AND RETURN OF EACH ROOFTOP UNIT.
 - 2 INSTALL ROOF MOUNTED EXHAUST FAN PER DETAIL ON SHEET M3.0. COORDINATE EXACT LOCATION OF FAN PENETRATION WITH ARCHITECTURAL ROOF PLAN. TRANSITION GALVANIZED DUCTWORK AS NECESSARY FROM FAN INTO CEILING/JOIST SPACE. SEE SHEET M1.0 FOR CONTINUATION.
 - 3 PROVIDE FLEXIBLE CONNECTIONS BETWEEN ALL DUCTWORK AND MECHANICAL UNITS.
 - 4 ROUTE SCH. 40 PVC CONDENSATE DRAIN PIPING ALONG ROOF. SUPPORT PIPING PER DETAIL ON SHEET M3.0.
 - 5 MAINTAIN A MINIMUM 10' CLEARANCE BETWEEN OUTSIDE AIR INTAKES AND EXHAUST TERMINATIONS ON ROOF.
 - 6 FOOD SERVICE REFRIGERATION EQUIPMENT PROVIDED BY OTHERS.
 - 7 FOOD SERVICE REFRIGERATION EQUIPMENT MOUNTED ON PRE-ENGINEERED RACK. REFER TO "CONDENSING UNIT ROOFING SUPPORT DETAIL" ON ARCHITECTURAL SHEETS FOR FLORIDA PRODUCT APPROVAL INFORMATION.
 - 8 FOR SPECIFIC WIND LOADING REQUIREMENTS NOT TO EXCEED CURBS, SEE STRUCTURAL DRAWINGS.

SHEET GENERAL NOTE:
 CONTRACTOR RESPONSIBLE FOR USING CURBS PLUS CLIPS ON ALL RTUS. CLIPS ARE DELIVERED TO SITE AS SEPARATE PACKAGE.

1 HVAC ROOF PLAN
 M2.0 1/4" = 1'-0"



COPYRIGHT © All rights reserved. Specifications, computer files, field data, notes and other documents are instruments of service prepared by Cuhaci & Peterson, C.A.P. All instruments of service remain the property of C.A.P. C.A.P. shall retain all copyright, patent, utility and other intellectual rights, including the copyright therein. Any use or reproduction of this document without written permission from C.A.P. is a violation of Federal copyright laws.

CLIENT NAME
WAWA
 260 WEST BALTIMORE PIKE
 WAWA, PENNSYLVANIA 19063

PROJECT NAME
WAWA F85FB L v2021.3
STORE #5434
 SR 19 & SR 100 (REID ST)
 PALMATA, FL

SHEET TITLE
HVAC ROOF PLAN

06/15/2023


No.	Description	Date
A	MECHANICAL UNIT CHANGE	08/25/2022
B	PRE-BID SET	03/01/2023
C	PROVIDE UPDATE V21.3	03/27/2023
D	CONSTRUCTION SET	06/15/2023

PROJECT NO.
 220396


DATE
 06-25-2022

DRAWN
 PAK


CHECKED
 JJD

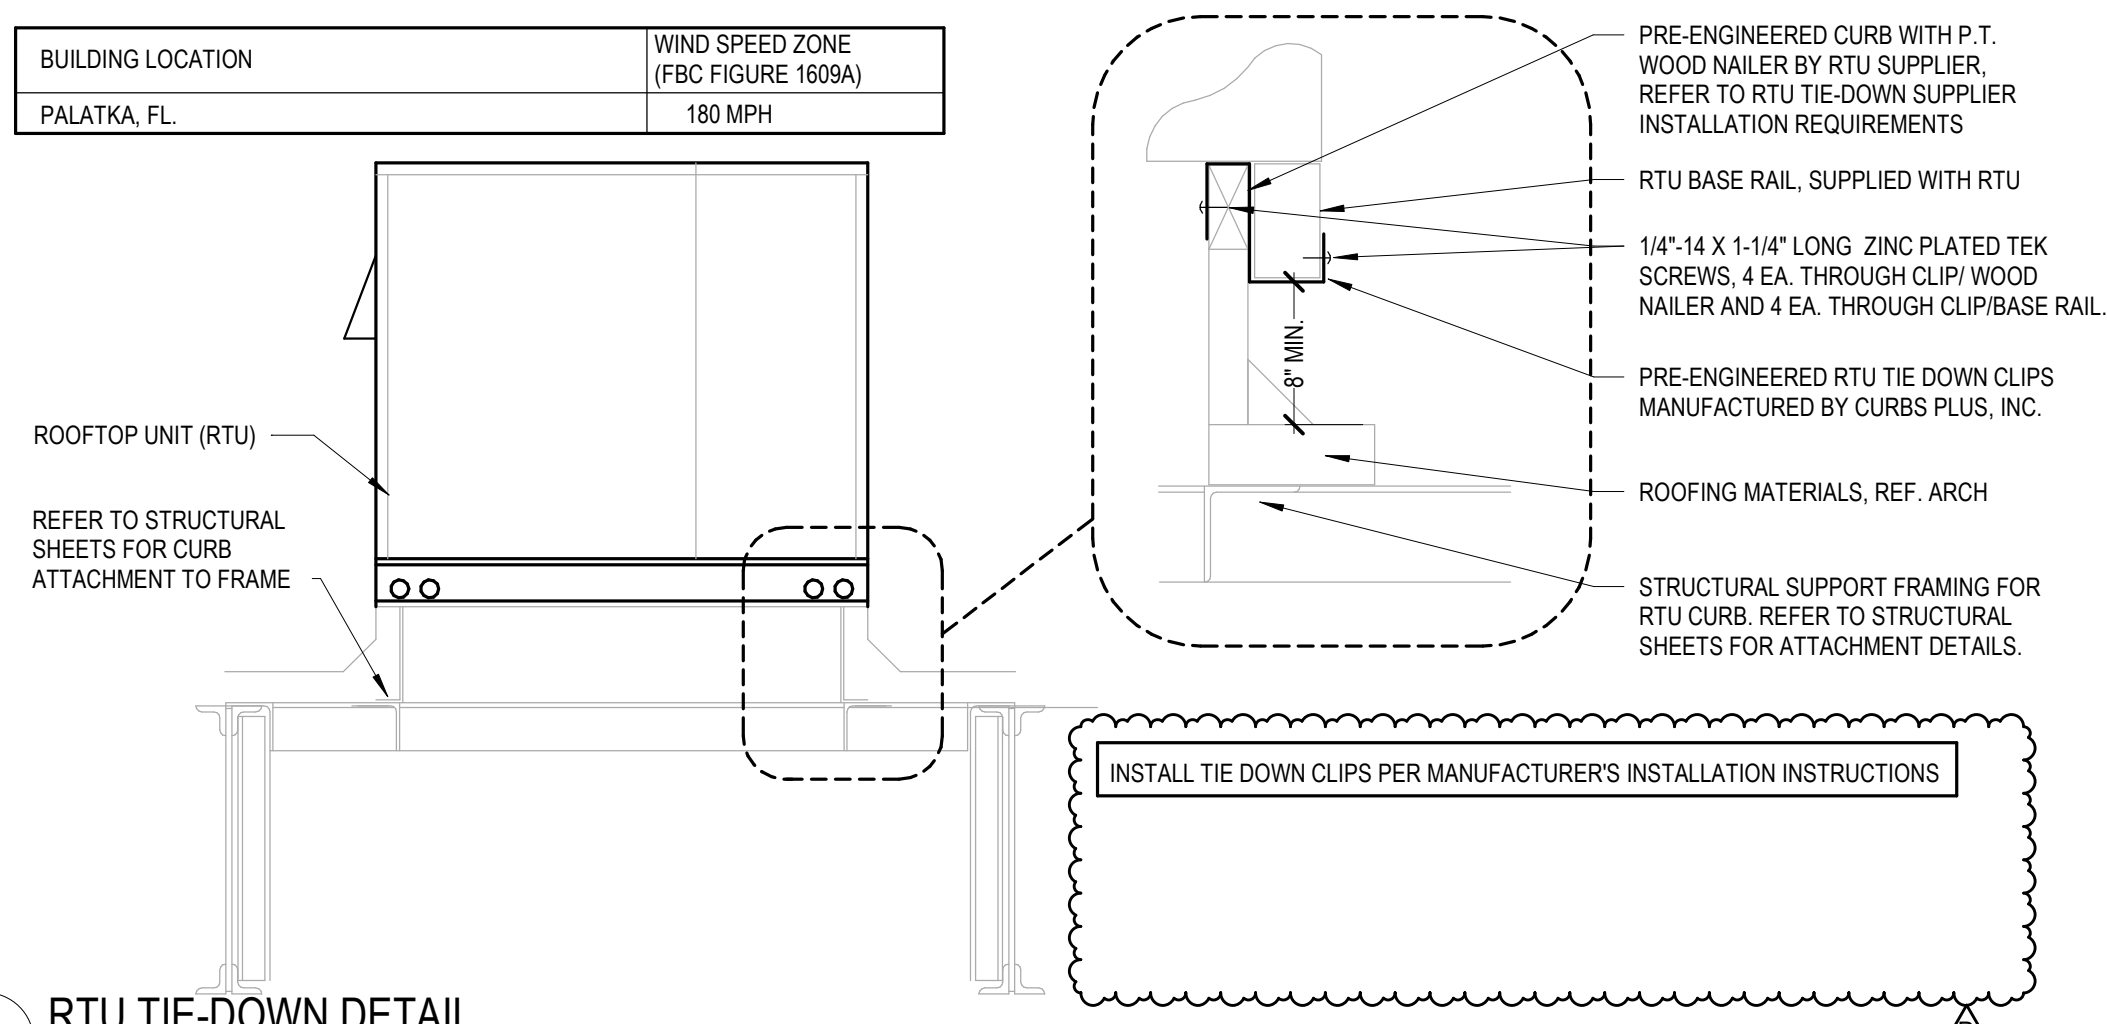


1 RTU TIE-DOWN DETAIL
M3.0 NOT TO SCALE

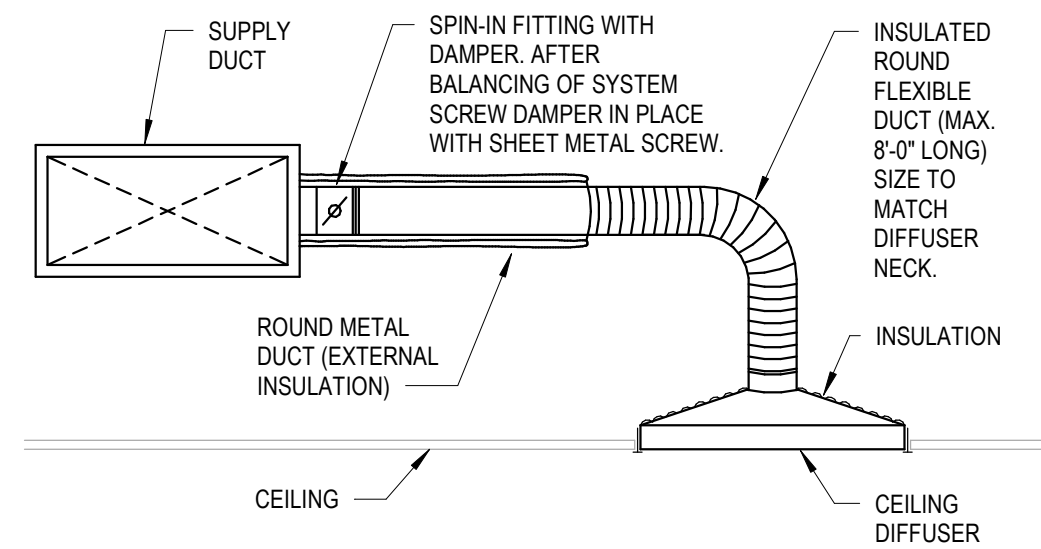


2 CEILING DIFFUSER RUNOUT DETAIL
M3.0 NOT TO SCALE

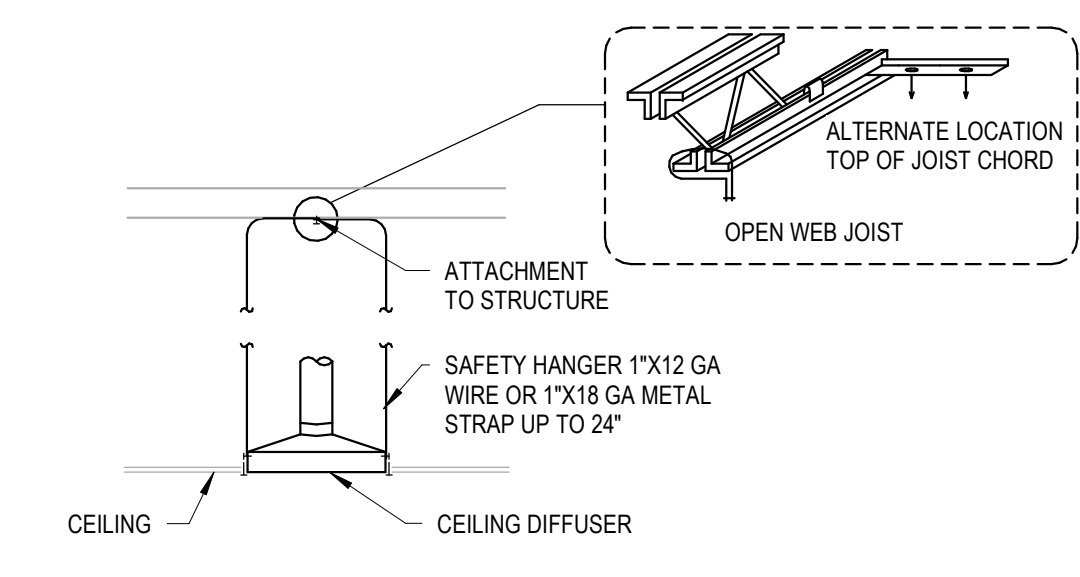


3 CEILING MOUNTED AIR DIFFUSER SUPPORT DETAIL
M3.0 NOT TO SCALE

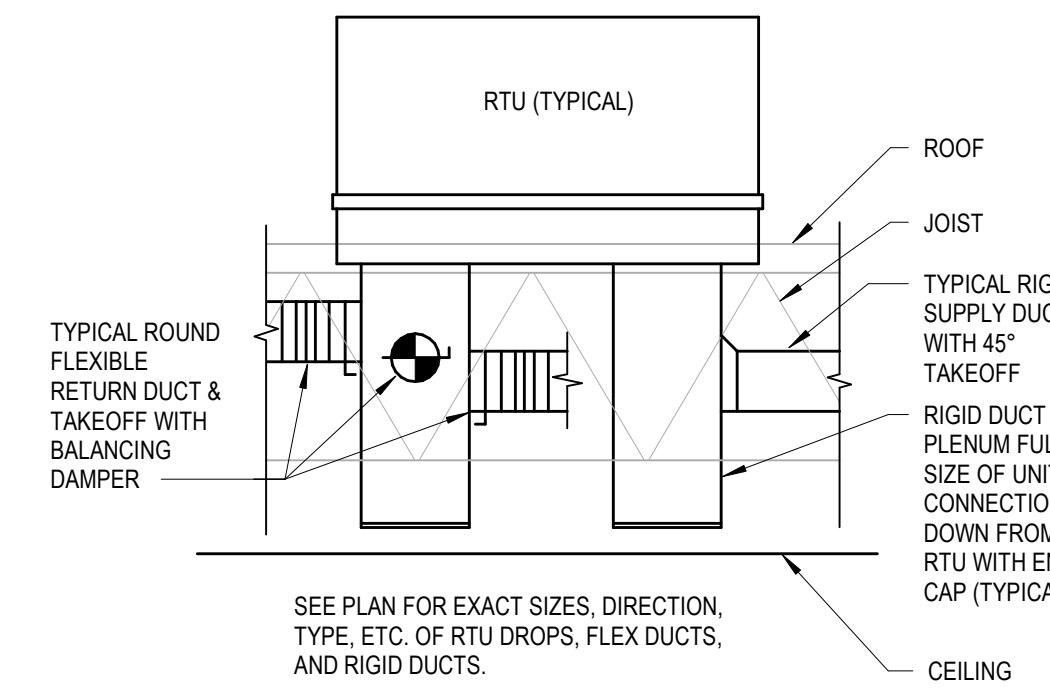


4 TYPICAL DUCT PLENUM DETAIL
M3.0 NOT TO SCALE

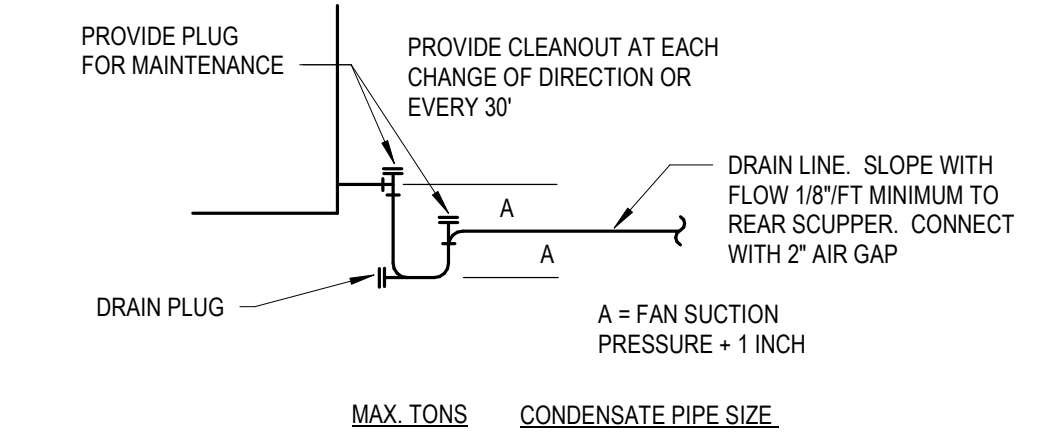


5 CONDENSATE DRAIN TRAP DETAIL
M3.0 NOT TO SCALE

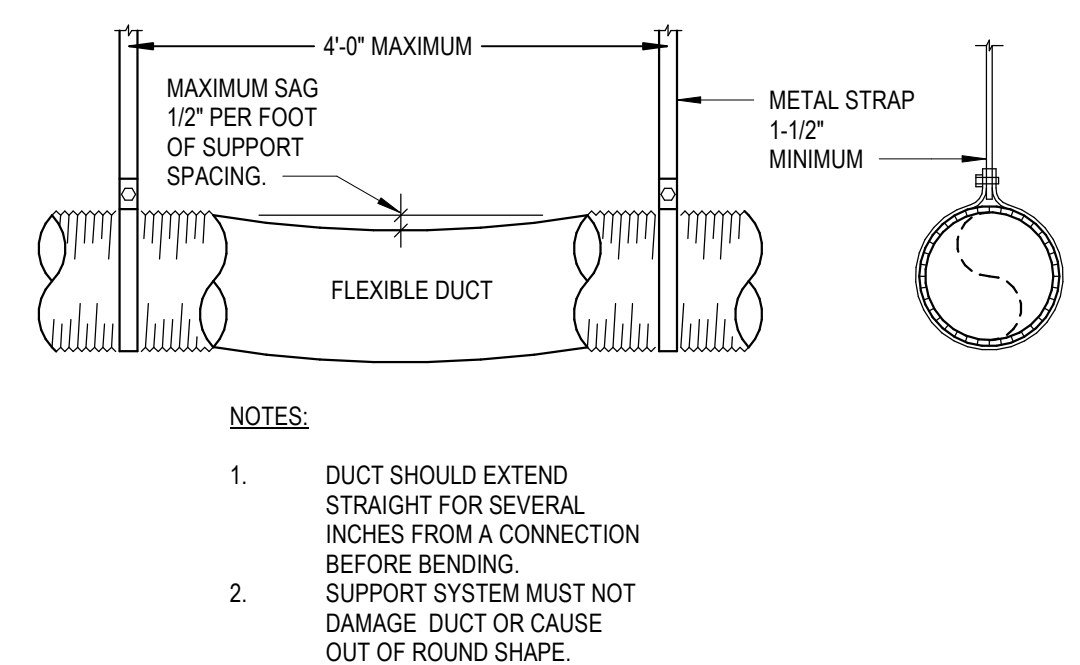


6 FLEX DUCT SUPPORT DETAIL
M3.0 NOT TO SCALE

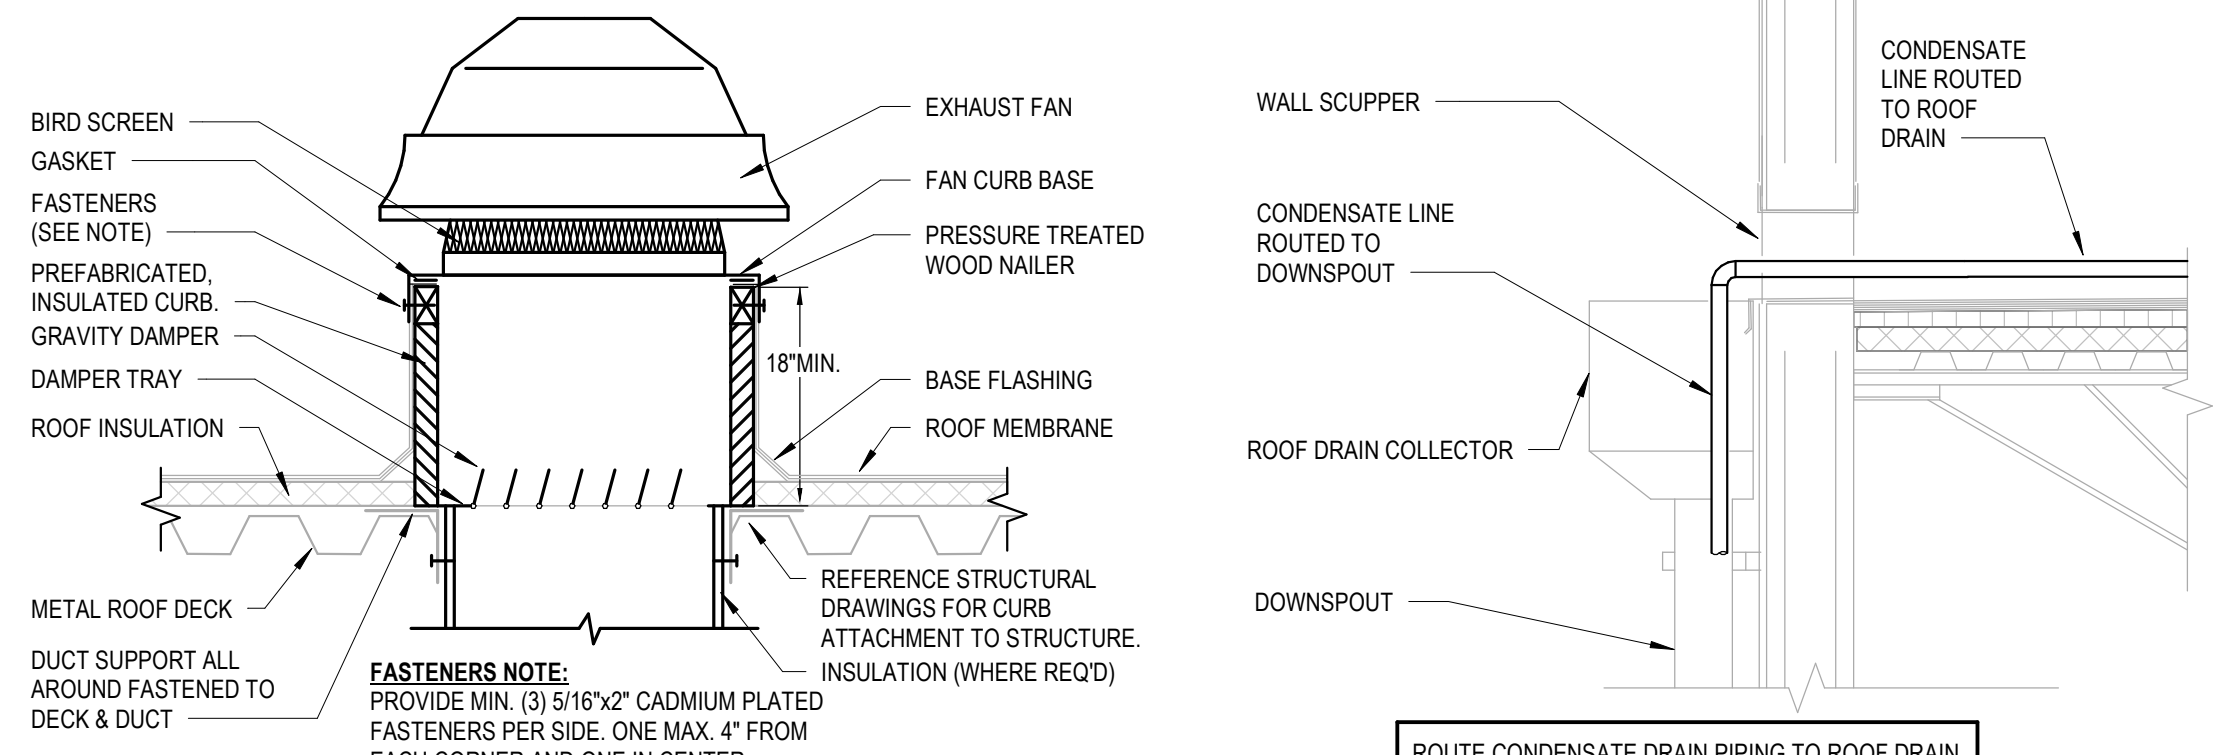


7 ROOF FAN MOUNTING DETAIL
M3.0 NOT TO SCALE

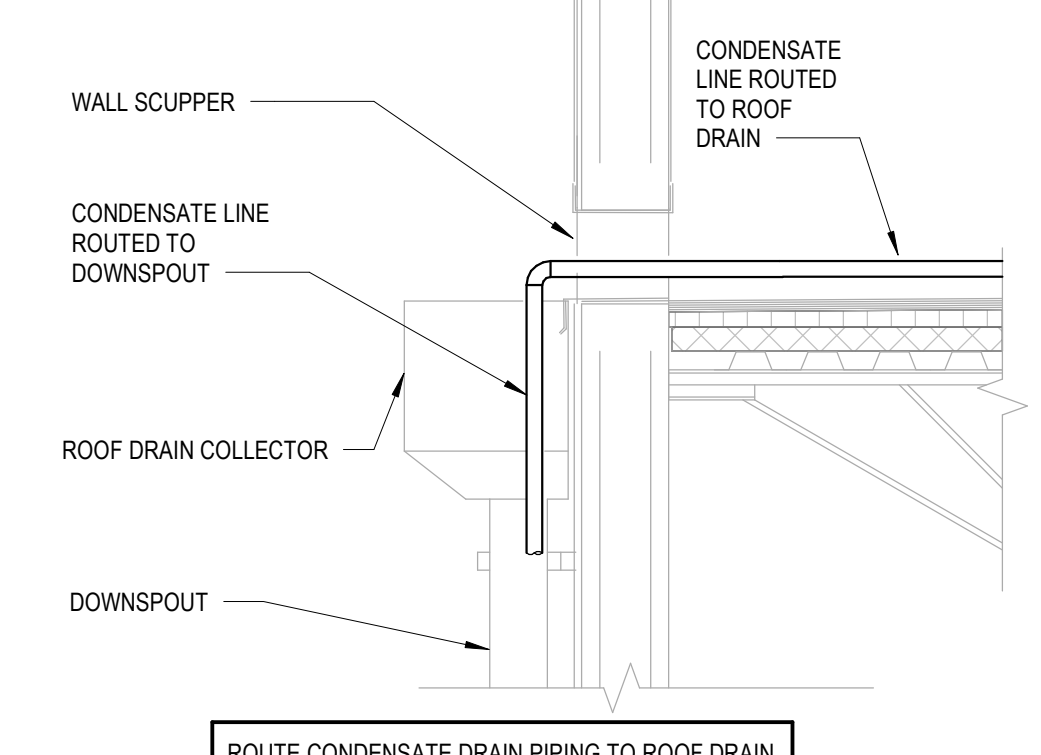


8 CONDENSATION TERMINATION DETAIL
M3.0 NOT TO SCALE

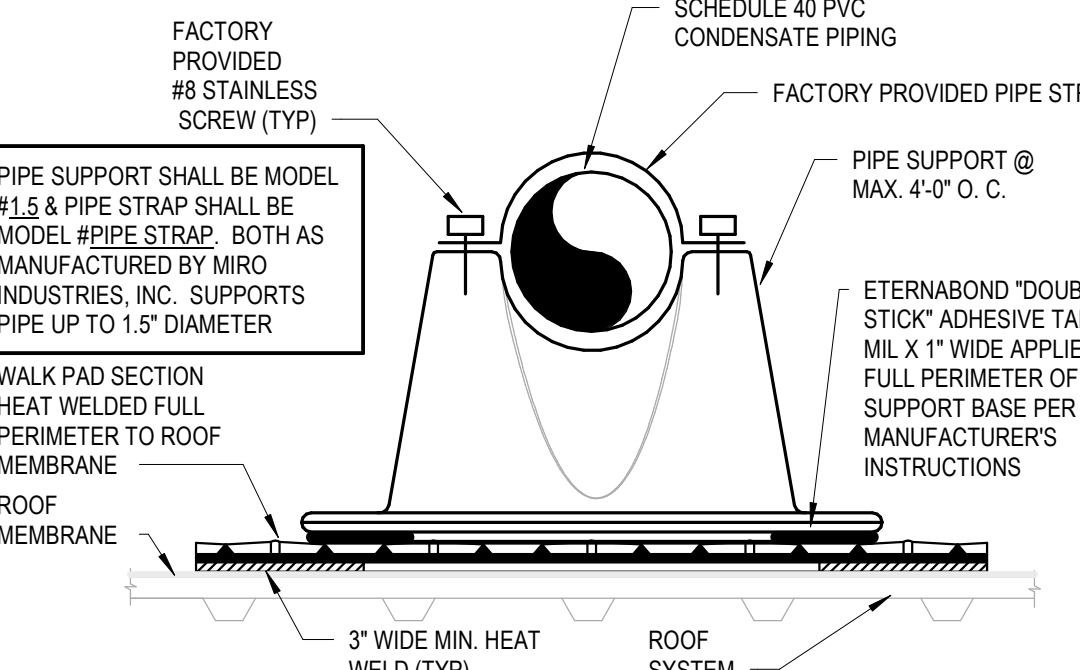

9 CONDENSATE PIPE ROOF SUPPORT DETAIL
M3.0 NOT TO SCALE

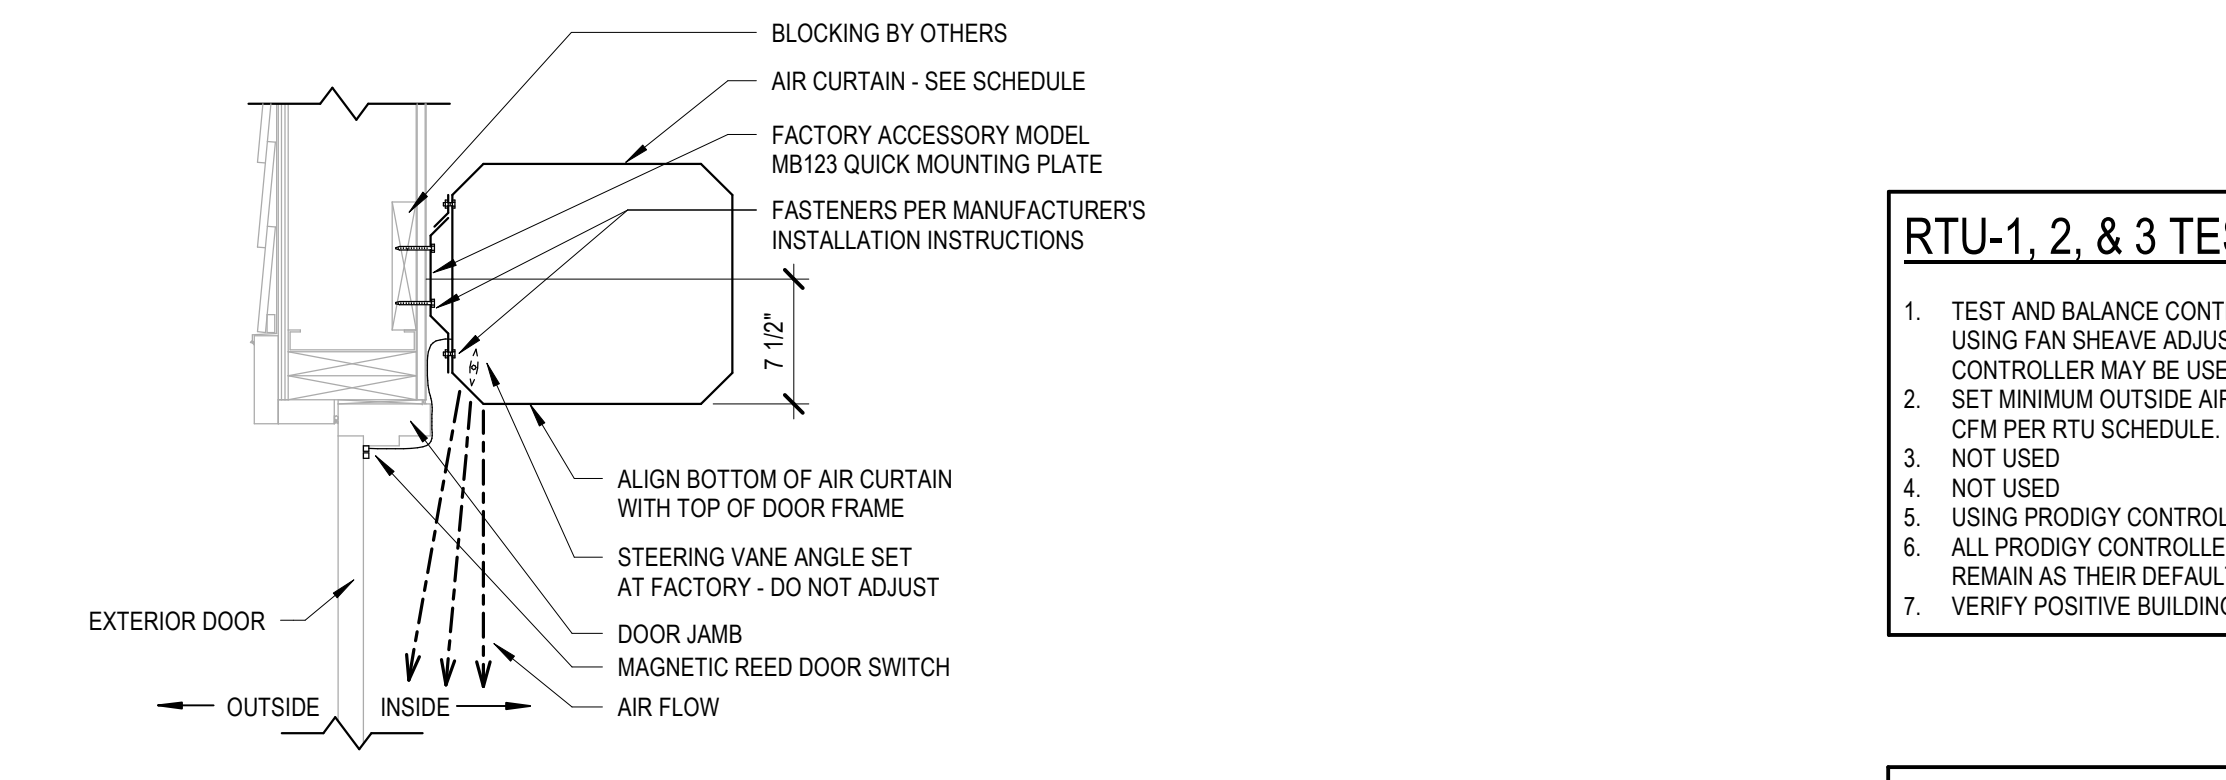

10 AIR CURTAIN INSTALLATION DETAIL
M3.0 NOT TO SCALE

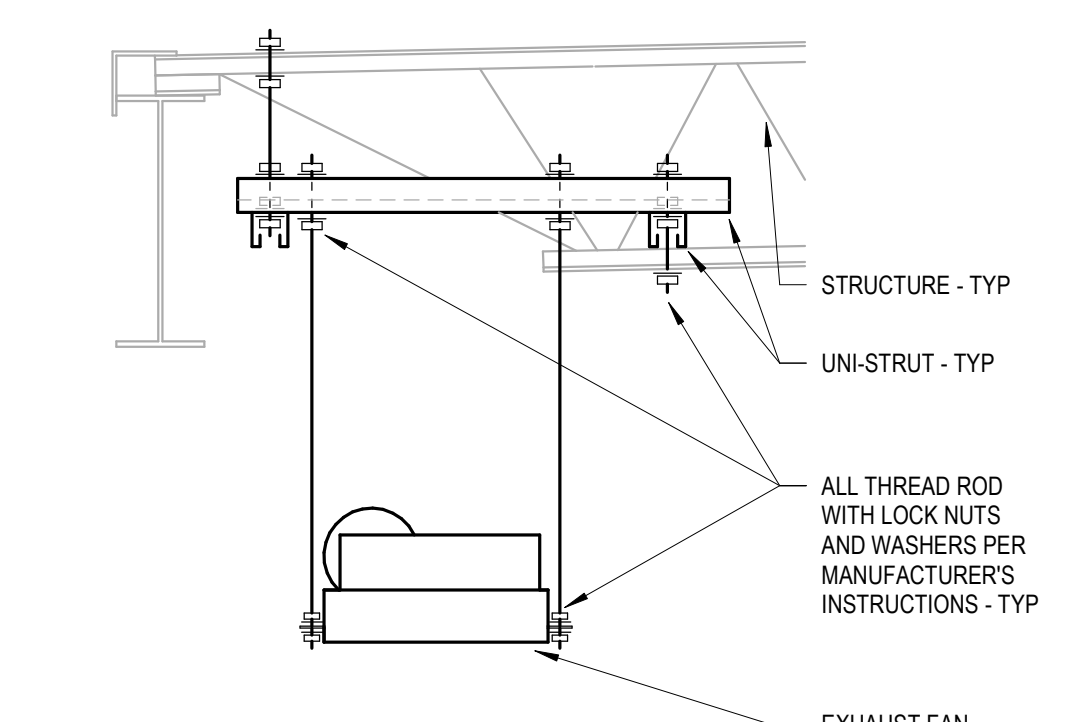

11 INLINE FAN MOUNTING DETAIL
M3.0 NOT TO SCALE

HVAC GENERAL NOTES

- ALL MECHANICAL WORK SHALL BE IN STRICT ACCORDANCE WITH THE JURISDICTION'S LATEST ACCEPTED VERSION OF THE FLORIDA BUILDING CODE - MECHANICAL, SMACNA, U.L. LOCAL CODES, MANUFACTURER'S RECOMMENDATIONS, AND ALL AUTHORITIES HAVING JURISDICTION.
- CONTRACTOR TO VISIT SITE AND VERIFY ALL CLEARANCES BEFORE FABRICATION OF DUCTWORK AND PROVIDE ADDITIONAL OFFSET AND/OR CHANGES IN DUCT SIZES TO MEET FIELD CONDITIONS AND COORDINATE WITH ELECTRICAL, PLUMBING AND FIRE PROTECTION SUBCONTRACTOR BEFORE ANY CONSTRUCTION WORK.
- SUPPLY AIR, RETURN AIR, OUTSIDE AIR AND EXHAUST AIR DUCTWORK SHALL BE SHEET METAL CONSTRUCTION. DUCT SHALL BE INSTALLED SECURELY SUPPORTED, HUNG OR SUSPENDED FROM THE STRUCTURE. JOINTS SHALL BE SEALED WITH 3" WIDE GLASS FABRIC TAPE AND FOSTER 3020 MASTIC OR EQUAL. DUCT CONSTRUCTION, SEALING AND INSTALLATION SHALL BE IN STRICT ACCORDANCE WITH THE JURISDICTION'S LATEST ACCEPTED VERSION OF THE FLORIDA BUILDING CODE - MECHANICAL, AND THE JURISDICTION'S LATEST CODE ACCEPTED SMACNA STANDARDS.
- OUTSIDE AIR INTAKES (ROOFTOP UNITS, GRAVITY ROOF VENTS, LOUVERS) SHALL MAINTAIN A MINIMUM OF 10'-0" FROM ANY EXHAUST OR SANITARY VENT.
- PROVIDE ALL MECHANICAL EQUIPMENT WITH MANUFACTURER'S RECOMMENDED SERVICE AREA CLEARANCES.
- ALL ROOFTOP UNITS SHALL BE CONSTRUCTED AND INSTALLED TO WITHSTAND LOCAL WIND LOAD DESIGN.
- SMOKE DETECTORS SHALL BE FURNISHED AND INSTALLED IN RTU BY THE UNIT MANUFACTURER. WIRED TO THE KEY SWITCH BY THE MECHANICAL CONTRACTOR, AND WIRED TO THE FIRE ALARM BY THE FIRE ALARM CONTRACTOR. SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72, NATIONAL FIRE ALARM CODE; NFPA 90A, STANDARD FOR INSTALLATION OF AIR-CONDITIONING AND VENTILATING SYSTEMS, THE JURISDICTION'S LATEST ACCEPTED VERSION OF THE FLORIDA BUILDING CODE - MECHANICAL, AND THE MANUFACTURER'S INSTALLATION INSTRUCTIONS. PROVIDE A VISIBLE LED/BLIND NOTIFICATION PANEL. MAKE SURE SENSORS ARE EQUAL COMPATIBLE WITH BUILDING FIRE ALARM SYSTEM.
- PLANS AND DIAGRAMS ARE SCHEMATIC ONLY AND SHOULD NOT BE SCALED.
- HVAC CONTRACTOR IS RESPONSIBLE FOR ANY ADDED ELECTRICAL COSTS WHICH MAY RESULT FROM SUBSTITUTED EQUIPMENT.
- PROVIDE EXTERNAL DUCT INSULATION FOR SUPPLY, RETURN AND OUTSIDE AIR DUCTWORK. DUCTWORK INSULATION SHALL BE FOIL FACED FIBERGLASS DUCT WRAP WITH A MINIMUM THERMAL RESISTANCE (R) OF 6.0. INSULATION SHALL HAVE VAPOR BARRIER. INSTALL PER MFR. REQUIREMENTS.
- COORDINATE CEILING MOUNTED DIFFUSERS, REGISTERS, AND GRILLES AND OTHER CEILING MOUNTED EQUIPMENT WITH LIGHTING FIXTURES.
- TURNING VANES SHALL BE PROVIDED IN ALL SUPPLY DUCT RECTANGULAR ELBOWS WITH ANGLES BETWEEN 15 DEGREES AND LESS THAN 90 DEGREES PER THE SMACNA HVAC DUCT CONSTRUCTION STANDARDS MANUAL.
- DUCT DIMENSIONS SHOWN ON DRAWINGS ARE CLEAR INSIDE DIMENSIONS. ALL DIMENSIONS ARE IN INCHES UNLESS OTHERWISE NOTED.
- DUCTWORK, DIFFUSERS, REGISTERS, GRILLES, AND OTHER ITEMS OF THE AIR HANDLING SYSTEM SHALL NOT BE SUPPORTED BY THE CEILING OR CEILING SUSPENSION SYSTEM.
- UNLESS OTHERWISE NOTED, INSTALL DUCTWORK AS HIGH AS POSSIBLE, TIGHT TO BOTTOM OF STRUCTURE. COORDINATE DUCT ELEVATION WITH STORM LEADERS, WATER PIPING, SANITARY DRAINS AND MAJOR ELECTRICAL CONDUITS.
- CONTRACTOR TO PROVIDE ALL SUPPLEMENTARY STEEL REQUIRED TO SUSPEND MECHANICAL EQUIPMENT & MATERIALS. INSTALLATION OF CEILING SHALL COMPLY WITH MANUFACTURER'S SPECIFICATIONS AND CLEARANCE REQUIREMENTS FOR SERVICING OF EQUIPMENT.
- VERIFY VOLTAGE WITH ELECTRICAL CONTRACTOR BEFORE ORDERING EQUIPMENT.
- PROVIDE A TRAP IN ALL CONDENSATE PIPING SERVING AIR HANDLING UNITS AND ROOFTOP UNITS. SLOPE CONDENSATE LINE 1/8" PER FOOT. CONDENSATE LINES SHALL BE PVC SCH. 40. ALL CONDENSATE DRAIN PIPING SHALL BE PROPERLY SUPPORTED. SEE "CONDENSATE DRAIN TRAP" DETAIL.
- GUARANTEE FOR ONE YEAR AFTER DATE OF ACCEPTANCE BY THE OWNER. ALL EQUIPMENT, MATERIALS AND WORKMANSHIP TO BE FREE FROM DEFECT.
- DO NOT CUT STRUCTURAL MEMBERS WITHOUT PRIOR WRITTEN APPROVAL OF THE STRUCTURAL ENGINEER.
- FLEXIBLE AND RIGID ROUND DUCT TAKE-OFFS FOR DIFFUSERS SHALL BE THE SAME SIZE AS DIFFUSER NECK. MAXIMUM FLEXIBLE DUCT LENGTH SHALL BE 8'-0". FLEXIBLE DUCT SHALL BE THERMAFLEX TYPE M-KC OR EQUAL. FLEXIBLE DUCT SHALL BE INSULATED FIBERGLASS, R-6, CLASS 1, UL181 LISTED AND COMPLY WITH NFPA 90A AND NFPA 90B.
- ALL WALL MOUNTED TEMPERATURE, HUMIDITY, AND CO2 SENSORS SHALL BE INSTALLED AT AN ELEVATION OF 5'4" ABOVE FINISHED FLOOR TO THE TOP UNLESS OTHERWISE NOTED ON DRAWINGS. LOCATION OF THE WALL MOUNTED SENSORS SHALL BE COORDINATED WITH OTHER TRADES FOR A NEAT APPEARANCE. FINAL LOCATION OF SENSORS SHALL BE SUBJECT TO THE APPROVAL OF THE ENGINEER OR THEIR REPRESENTATIVE IN THE FIELD.
- PROVIDE FLEXIBLE NEOPRENE DUCT CONNECTORS ON THE DISCHARGE AND ENTERING SIDES OF PACKAGED ROOFTOP UNITS, FANS, AND OTHER VIBRATING EQUIPMENT TO WHICH DUCTWORK IS ATTACHED.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL TRADES INSTALLATION SCHEDULES. COORDINATE WORK SCHEDULE WITH GENERAL CONTRACTOR.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL RELATED CONSTRUCTION DETAILS AS APPLICABLE TO THE HVAC SYSTEM. CHASE AND WALL PENETRATIONS INTENDED FOR DUCTWORK AND PIPING SHALL BE VERIFIED WITH ARCHITECTURAL DRAWINGS PRIOR TO INSTALLATION.
- MECHANICAL EQUIPMENT, DUCTWORK AND PIPING IS SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE.
- FIELD VERIFY FINAL LOCATIONS TO INSTALL EQUIPMENT IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AND PROPER AIRFLOW CLEARANCE AROUND EQUIPMENT.
- WHEN THE INTENT OF THE DRAWINGS AND SPECIFICATIONS IS NOT CLEAR, OR CAPABLE OF MORE THAN ONE INTERPRETATION, SUCH MATTERS WILL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT/ENGINEER IN WRITING BEFORE THE SUBMISSION OF BIDS. THE ARCHITECT/ENGINEER SHALL MAKE CORRECTION OR EXPLANATION IN WRITING.
- PLANS AND SPECIFICATIONS ARE INTENDED AS A GENERAL DESCRIPTION OF THE WORK TO BE PERFORMED. ALL ITEMS NOT SPECIFICALLY MENTIONED OR SHOWN, BUT NECESSARY FOR THE COMPLETION OF THE INSTALLATION, SHALL BE FURNISHED AND INSTALLED BY THIS CONTRACTOR. THIS CONTRACTOR SHALL THOROUGHLY ACQUAINT HIMSELF WITH THE MECHANICAL, ARCHITECTURAL, STRUCTURAL, AND ELECTRICAL PLANS BEFORE SUBMITTING HIS FINAL BID. NO ADDITIONAL COMPENSATION WILL BE ALLOWED DUE TO THE CONTRACTOR'S FAILURE TO FAMILIARIZE HIMSELF HERSELF WITH THE PLANS.
- CONTRACTOR TO ALLOW SUFFICIENT TIME (APPROXIMATELY 2 WEEKS) FOR EQUIPMENT REVIEW. CONTRACTOR SHALL SUBMIT THE FOLLOWING EQUIPMENT FOR REVIEW (1 HARD COPY) PRIOR TO ORDERING AND INSTALLATION: ROOFTOP UNITS, AIR HANDLING UNITS AND AIR COOLED CONDENSERS, DIFFUSERS AND REGISTERS, EXHAUST FANS AND MAKE UP AIR FANS, DUCT INSULATION, DUCT CONSTRUCTION STANDARDS.
- AFTER THE HEATING AND AIR CONDITIONING SYSTEM INSTALLATIONS ARE COMPLETE, THE CONTRACTOR SHALL HAVE EACH SYSTEM TESTED, ADJUSTED, AND BALANCED BY AN INDEPENDENT TESTING AND BALANCING CONTRACTOR. SEE SPECIFICATIONS FOR TESTING AND BALANCING CONTRACTOR CERTIFICATIONS AND REQUIREMENTS. UPON COMPLETION OF TEST AND BALANCE OF ALL SYSTEMS, THE CONTRACTOR SHALL PRESENT THE OWNER AND ARCHITECT WITH A WRITTEN TEST AND BALANCE REPORT IN A TIMELY MANNER PER SPECIFICATIONS.

HVAC ROOFTOP UNIT SCHEDULE

MARK	AREA SERVED	SUPPLY AIR FAN DATA				ELECTRIC HEAT			UNIT POWER				WEIGHT				COOLING CAPACITY				BASIS OF DESIGN		
		NOMINAL	SUPPLY	OUTSIDE	E.S.P.	CONTROL	VOLTA	VOLTA	PHASE	HP	AMP	RTU	RTU	RTU	RTU	SENSIBLE	SENSIBLE	EDB	EDB	AMBIENT	EER	MANUFACTURER	MODEL
RTU-1	RETAIL	8.5	3400	610	0.5	3.75	7.5	1	208 V	3	44	40	1357	98.1	75.4	75.5	63.9	92/75	12.3	15.7	LENNOX ENLIGHT	LCT102H4E	1, 20
RTU-2	FOOD SERVICE	12.5	5000	900	0.5	3.75	N/A	N/A	208 V	3	64	80	1342	146.1	136	75.2	62.5	92/75	11.0	14.6	LENNOX ENLIGHT	LCT102H4E	2, 20
RTU-3	RETAIL	7.5	3000	540	0.5	3.75	7.5	1	208 V	3	43	30	1330	91.8	68.7	78.1	63.5	92/75	12.5	15.7	LENNOX ENLIGHT	LCT102H4E	1, 2, 20

- NOTES:
- PROVIDE CO2 SENSOR FOR INTERLINK WITH BUILDING AUTOMATION SYSTEM.
 - PROVIDE LENNOX HUMIDITROL HOT GAS REHEAT OPTION.
 - PROVIDE REMOTE WALL MOUNTED COMBINATION TEMPERATURE/HUMIDITY SENSOR MODEL 21W06
 - REFER TO CONTROL SYSTEM NOTES FOR CONTROL COMPONENTS REQUIREMENTS.
 - PROVIDE 30 MINUTE ANTI-SHORT CYCLE TIMER.
 - PROVIDE THRU THE BASE ELECTRICAL AND SINGLE POINT CONNECTION.
 - PROVIDE WITH FACTORY INSTALLED DISCONNECT.
 - PROVIDE WITH 18" ROOF CURB.
 - PROVIDE FACTORY 15 AMP GFCI SERVICE OUTLET WITH WEATHERPROOF COVER. COORDINATE WITH ELECTRICAL CONTRACTOR TO PROVIDE FIELD WIRING TO RECEPTACLE.
 - PROVIDE WITH FACTORY DISCONNECT.
 - PROVIDE WITH MOTORIZED DAMPER AND OUTSIDE AIR INTAKE HOOD.
 - PROVIDE MANUFACTURER'S MOTOR AND DRIVE PACKAGE AS REQUIRED TO MEET SCHEDULED AIR CAPACITIES AND PRESSURE DROP.
 - PROVIDE FACTORY APPLIED PHENOLIC COATING FOR CORROSION PROTECTION ON CONDENSER COILS.
 - PROVIDE BUILDING AUTOMATION SYSTEM (BAS) EQUIPMENT - REFER TO BAS SYSTEM MASTER SPEC FOR SYSTEM DETAILING AND EQUIPMENT PART NUMBERS.
 - PROVIDE FACTORY INSTALLED BACNET BAS INTERFACE.
 - PROVIDE LENNOX DIRTY FILTER SWITCH.
 - PROVIDE LENNOX MIC CONTROL BOARD (STANDARD ON L-SERIES UNITS).
 - TEMPERATURE SETPOINT: 74°F COOLING, 68°F HEATING HUMIDITY SETPOINT: 50% RELATIVE HUMIDITY.
 - PROVIDE WITH FACTORY CONDENSATE PAN WATER LEVEL MONITORING DEVICE FOR COMPLIANCE WITH FBC 2020 MECHANICAL SECTION 307.2.3.
 - PROVIDE WITH FACTORY INSTALLED SUPPLY AND RETURN SMOKE DETECTORS.

OUTSIDE AIR CALCULATION

AREA SERVED	AREA (SQFT)	PEOPLE (1000 SQFT)	# PEOPLE	CFM PERSON	PEOPLE RECD (CFM)	CFM SOFT	SQFT RECD (CFM)	TOTAL CFM CALCULATED	CFM SUPPLY
OFFICE	70	5	2	5	10	0.06	5	15	
ASSOCIATE	100	5	2	5	10	0.06	6	16	
DELIVERY	78	2	1	10	10	0.12	10	20	
RETAIL	1904	15	29	7.5	218	0.12	229	447	610
RTU-1									498
FOOD SVC. 1	316	20	7	7.5	53	0.12	38	91	
FOOD SVC. 2	258	20	6	7.5	45	0.12	31	76	
BACKROOM	140	20	3	7.5	23	0.12	17	40	
STAGING	116	2	1	10	10	0.12	14	24	
WASHROOM	174	20	4	7.5	30	0.12	21	51	
RTU-2									282
RTU-3									204
COFFEE	242	20	5	7.5	38	0.12	30	68	
RETAIL	559	15	9	7.5	68	0.12	68	136	
RTU-3									204

- NOTES:
- OCCUPANCY LOAD VENTILATION RATES ARE BASED ON NET OCCUPABLE SPACE IN ACCORDANCE WITH THE JURISDICTION'S LATEST ACCEPTED VERSION OF THE FLORIDA MECHANICAL CODE, TABLE 403.3.1.1.
 - ANTICIPATED NUMBER OF PEOPLE IS BASED ON AN OCCUPANCY LOAD FACTOR (IF PEOPLE'S) VALUE (BASED ON THE JURISDICTION'S LATEST ACCEPTED VERSION OF THE FLORIDA MECHANICAL CODE, TABLE 403.3.1.1).

HVAC EXHAUST FAN SCHEDULE

MARK	CFM	EXT. STATIC PRESSURE	FAN TYPE	DRIVE TYPE	SONES	HP	FAN RPM	VOLTAGE	PHASE	BASIS OF DESIGN			
										MANUFACTURER	MODEL	FACE SIZE	NOTES
EF-1	1550 CFM	0.250 In-wg	DOWNBLAST	DIRECT	6.9	3/4	700	120 V	1	GREENHECK	G-160	1, 2	
EF-2	60 CFM	0.125 In-wg	INLINE	DIRECT	0.3	2 1/8" WATTS	584	120 V	1	GREENHECK	CSP-B10	3	

- NOTES:
- NO SUBSTITUTIONS PERMITTED.
 - PROVIDE WITH FACTORY DISCONNECT, FACTORY WIRED SOLID STATE SPEED CONTROLLER, 18" HIGH ROOF CURB WITH DAMPER TRAY, BACKDRAFT DAMPER, AND BIRD SCREEN.
 - WIRE FOR CONTINUOUS OPERATION.
 - REFER TO CONTROL SYSTEM NOTES FOR CONTROL COMPONENTS REQUIREMENTS.
 - PROVIDE WITH FACTORY DISCONNECT & FACTORY WIRED SOLID STATE SPEED CONTROLLER. FAN SHALL BE WIRED TO EMERGENCY SHUTOFF SWITCH PROVIDED BY OTHERS. REFERENCE ARCHITECTURAL AND ELECTRICAL DRAWINGS.

HVAC AIR DEVICE SCHEDULE

TYPE MARK	MANUFACTURER	MODEL	SERVICE	DESCRIPTION	MOUNTING TYPE	MATERIAL	NECK SIZE	FACE SIZE	NOTES
CD-1	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	LAY-IN	ALUMINUM	18"X18"	24"X24"	1, 7
CD-2	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	LAY-IN	ALUMINUM	18"X18"	24"X24"	6, 7
CD-3	PRICE	AMD	SUPPLY	LOUVERED FACE DIRECTIONAL DIFFUSER	SURFACE	ALUMINUM	8"X8"	NECK-4"5"	5, 7
G-1	PRICE	630FF	RETURN/EXHAUST	LOUVERED FACE FILTER RETURN GRILLE	LAY-IN	ALUMINUM	20"X20"	NECK-3-3/4"	4
G-2	PRICE	630FF	RETURN/TRANSFER	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	16"X16"	NECK-3-3/4"	4
G-3	PRICE	630FF	RETURN/EXHAUST	LOUVERED FACE FILTER RETURN GRILLE	SURFACE	ALUMINUM	8"X8"	NECK-3-3/4"	4
G-4	PRICE	80FF	TRANSFER	EGG CRATE FACE RETURN GRILLE	LAY-IN	ALUMINUM	22"X22"	NECK-1-11/16"	-
G-5	PRICE	630 D	EXHAUST	LOUVERED FACE EXHAUST GRILLE	SURFACE	ALUMINUM	8"X8"	NECK-1-3/4"	-
LD-1	PRICE	TB04	SUPPLY	48" INSULATED PLENUM W/ 41" SLOTS	LAY-IN	ALUMINUM	SEE PLAN	N/A	2, 3

- NOTES:
- NO SUBSTITUTIONS PERMITTED.
 - FOR LAY-IN CEILINGS PROVIDE WITH 18"X18" FULL FACE APPEARANCE DIFFUSER NECK. PROVIDE WITH FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR". ROUND NECK SIZE SHALL BE EQUAL TO FLEX SIZE SERVING DIFFUSER.
 - PROVIDE WITH PLENUM INTERNALLY LINED WITH COATED FIBERBOARD. EXTERNALLY INSULATE PLENUM UPON INSTALLATION WITH DUCT WRAP INSULATION.
 - PROVIDE WITH CENTER NOTCH OPTION (ON AS REQUIRED WHEN USED IN 2" T BAR CEILING).
 - "OR" STYLE (1/4 TURN FASTENERS ONLY), OMIT HINGE. FILTER TYPE RETURN GRILLES PROVIDED SOLELY FOR MAINTENANCE PURPOSES. OMIT FILTER UPON INSTALLATION.
 - PROVIDE WITH TYPE B REVELED SUPPLY MOUNT FRAME AND FACTORY SQUARE TO ROUND NECK ADAPTER MODEL "SR".
 - PROVIDE LAY-IN STYLE FACE DIFFUSER AND ALUMINUM PLASTER FRAME MODEL APP. COORDINATE LOCATION WITH CEILING FRAMING INSTALLER.
 - PROVIDE WITH FACTORY BACK PAN INSULATION.

HVAC AIR CURTAIN SCHEDULE

MARK	AREA SERVED	BASIS OF DESIGN				UNIT POWER		MOUNTING HEIGHT	NOTES
		MANUFACTURER	MODEL	NOZZLE CFM	HP	VOLTAGE	PHASE		
AC-1	STAGING	POWERED AIRE	BCE-1-48	2155 CFM	0.5	120 V	1	7'-2"	1, 4
AC-2	DELIVERY VESTIBULE	POWERED AIRE	BCE-1-48	2155 CFM	0.5	120 V	1	7'-2"	1, 4

- NOTES:
- NO SUBSTITUTIONS PERMITTED.
 - MOUNT INSIDE BUILDING ABOVE DOOR AT 7'-2" A.F.F. MOUNTING HEIGHT IS FROM BOTTOM OF AIR CURTAIN.
 - PROVIDE WITH NECESSARY MOUNTING BRACKETS AND ACCESSORIES.
 - PROVIDE WITH MODEL SM 300 COMMERCIAL MAGNETIC REED DOOR SWITCH.
 - AIR CURTAIN CONTROLLED BY MAGNETIC REED DOOR SWITCH; FAN ON WHEN DOOR IS OPEN.

LENNOX SETUP PARAMETERS - FLORIDA STORES (R2)

- UNIT ID CONFIGURATIONS (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):
- BACNET CONFIGURATION: GO TO SETTINGS-GENERAL-CONFIGURATION ID1 POSITION & SET TO 'B'.
 - NETWORK CONFIGURATION: GO TO SETUP-NETWORK INTEGRATION; SET TO BACNET.
 - CONTROL MODE: SET CONTROL MODE TO ROOM SENSOR; CO2, TEMP & HUMIDITY (PER UNIT, AS NEEDED).
- INDIVIDUAL PARAMETER CONFIGURATIONS (MECHANICAL CONTRACTOR TO DEFINE / AS APPLICABLE):
- PARAMETER 105 DEHUMID MODE: 7 NO CONDITIONS.
 - PARAMETER 106 DEHUMID SETPOINT: 50. THIS IS A CENTERED SET POINT (+/-).
 - PARAMETER 107 DEHUMID DEBAND: 3 (DEFAULT) THIS IS THE ACTUAL +/- VALUE.
 - PARAMETER 117 CO2 DAMPER MAX OPEN %: 50.
 - PARAMETER 118 CO2 START OPEN PPM: 1200.
 - PARAMETER 119 CO2 FULL OPEN PPM: 1500.
 - PARAMETER 137 OCC HEAT SET POINT: 68 (BACK UP).
 - PARAMETER 139 OCC COOLING SET POINT: 72 (BACK UP).
 - PARAMETER 154 OCC BLOWER MODE: ON-CONTINUOUS 1.
- CFM VALUES / MSAV FAN SPEEDS (AIR BALANCER TO DEFINE / IF APPLICABLE):
- HEAT CFM VALUE: PER THE HVAC SCHEDULE.
 - HIGH COOL CFM VALUE: PER THE HVAC SCHEDULE.
 - LOW COOL CFM VALUE: MATCH THE HIGH COOL CFM VALUE.
 - VENTILATION CFM VALUE: MATCH THE HIGH COOL CFM VALUE.

RTU-1, 2, & 3 TEST AND BALANCE NOTES

- TEST AND BALANCE CONTRACTOR TO OBTAIN INITIAL BALANCE OF COOLING CFM FOR RTU USING FAN SHEAVE ADJUSTMENT TO WITHIN +/- 3% SCHEDULED COOLING CFM. PRODIGY CONTROLLER MAY BE USED FOR FINAL 5% TO OBTAIN SCHEDULED COOLING CFM.
- SET MINIMUM OUTSIDE AIR DAMPER POSITION FOR COOLING AND VERIFY OUTSIDE AIR CFM PER RTU SCHEDULE.
- NOT USED.
- NOT USED.
- USING PRODIGY CONTROLLER, VERIFY HEATING CFM EQUALS COOLING CFM.
- ALL PRODIGY CONTROLLER SETTINGS OTHER THAN THOSE MENTIONED ABOVE SHALL REMAIN AS THEIR DEFAULT VALUE AS SET FROM THE FACTORY.
- VERIFY POSITIVE BUILDING PRESSURE.

AIR BALANCE SCHEDULE

SYSTEM	CFM
RTU-1	+610
RTU-2	-900
RTU-3	+540
EF-1	-1550
BUILDING POSITIVE PRESSURE	+500

RTU-1, 2, & 3 SEQUENCE OF OPERATION

- SUPPLY AIR BLOWER SPEED UNIT HAS FOLLOWING SUPPLY AIR BLOWER SPEED SETTINGS THAT PERTAIN TO THIS INSTALLATION:
- COOLING AIR BLOWER SPEED
 - HEATING AIR BLOWER SPEED
- COOLING MODE:
- Y1 DEMAND: COMPRESSOR 1 OPERATES AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.
 - Y2 DEMAND: ALL COMPRESSORS OPERATE AND SUPPLY AIR BLOWER OPERATES AT COOLING SPEED.
- DEHUMIDIFICATION MODE:
- IF THE UNIT RECEIVES A CALL FOR DEHUMIDIFICATION, ECONOMIZER FREE COOLING IS LOCKED OUT (ON UNITS EQUIPPED WITH ECONOMIZER).
 - CALL FOR DEHUMIDIFICATION, NO Y1 DEMAND: 1ST STAGE COMPRESSOR OPERATES, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS ENERGIZED.
 - Y1 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED AND THE REHEAT VALVE IS ENERGIZED.
 - Y2 DEMAND WITH A CALL FOR DEHUMIDIFICATION: ALL COMPRESSORS OPERATE, SUPPLY AIR BLOWER OPERATES AT COOLING SPEED, AND THE REHEAT VALVE IS DE-ENERGIZED.
- HEATING MODE (ELECTRIC HEAT):
- W1 DEMAND: 1ST STAGE ELECTRIC HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.
 - W2 DEMAND: 2ND STAGE ELECTRIC HEAT IS ENERGIZED AND THE SUPPLY AIR BLOWER OPERATES AT HEATING SPEED.
- MODULATING OUTDOOR AIR DAMPER:
- THE MINIMUM DAMPER POSITION FOR "OCCUPIED HIGH BLOWER" IS ADJUSTED DURING UNIT SETUP TO PROVIDE MINIMUM FRESH AIR REQUIREMENTS PER RTU SCHEDULE.
 - WHEN SUPPLY AIR BLOWER IS OFF, THE OUTDOOR AIR DAMPER IS CLOSED.
 - WHEN UNIT IS IN OCCUPIED MODE AND SUPPLY AIR BLOWER IS OPERATING, THE OUTDOOR AIR DAMPER IS AT MINIMUM "HIGH BLOWER" POSITION.

CUHACI PETERSON

2600 Midland Center Parkway
Suite #200
Maitland, FL 32751
P (407) 661-9100
F (407) 661-9101
c-p.com

CLIENT NAME: WAWA
260 WEST BALT MORE PIKE
WAWA, PENNSYLVANIA 19063

PROJECT NAME: WAWA F88FBL V2021.3
STORE #5434
SR 19, SR 100 (REID ST)
PALATKA, FL

Revision Schedule

No.	Description	Date
1	ISSUE FOR SET	08/25/2022
2	MECHANICAL CHANGES	09/01/2022
3	CHANGE	09/01/2022
4	PRE-BID SET	09/01/2022
5	PROVIDE UPDATE V21.3	09/27/2022
6	CONSTRUCTION SET	09/15/2023

DATE: 08-25-2022
DRAWN: PAK
CHECKED: JJD

M3.0